



DPC: 24/30489197 DC

BSI Group Headquarters

389 Chiswick High Road London W4 4AL

Tel: +44 (0)20 8996 9000

Fax: +44 (0)20 8996 7400

www.bsigroup.com

Date: 13 June 2024

Origin: European

Latest date for receipt of comments: 06 August 2024

Project No. 2024/00839

Responsible committee: FSH/18/5 Watermist systems

Interested committees:

Title: Draft BS EN 14972-13 BS Fixed firefighting systems - Water mist systems. Part 13: Test protocol for wet benches and other similar processing equipment for open nozzle systems.

Please notify the secretary if you are aware of any keywords that might assist in classifying or identifying the standard or if the content of this standard

- i) has any issues related to 3rd party IPR, patent or copyright
- ii) affects other national standard(s)
- iii) requires additional national guidance or information

WARNING: THIS IS A DRAFT AND MUST NOT BE REGARDED OR USED AS A BRITISH STANDARD. THIS DRAFT IS NOT CURRENT BEYOND 06 August 2024

This draft is issued to allow comments from interested parties; all comments will be given consideration prior to publication. No acknowledgement will normally be sent. **See overleaf for information on the submission of comments.**

No copying is allowed, in any form, without prior written permission from BSI except as permitted under the Copyright, Designs and Patent Act 1988 or for circulation within a nominating organization for briefing purposes. Electronic circulation is limited to dissemination by e-mail within such an organization by committee members.

Further copies of this draft may be purchased from BSI Shop <http://shop.bsigroup.com> or from BSI Customer Services, Tel: +44(0) 20 8996 9001 or email cservices@bsigroup.com. British, International and foreign standards are also available from BSI Customer Services.

Information on the co-operating organizations represented on the committees referenced above may be obtained from <https://standardsdevelopment.bsigroup.com/>.

Responsible Committee Secretary: Mrs Susan Revell (BSI)
Direct tel: 020 8996 7195
E-mail: susan.revell@bsigroup.com

Full document details: 24/30489197 DC

Introduction

This draft standard is based on national and international discussions. Your comments on this draft are invited and will assist in the preparation of the consequent standard.

For international standards, comments will be reviewed by the relevant UK national committee before sending the consensus UK vote and comments to the international committee, which will then decide appropriate action. If the international standard is approved, it is usual for the text to be published as a British Standard.

For national standards, comments will be reviewed by the relevant UK national committee and the resulting standards published as a British Standard.

UK Vote

Please indicate whether you consider the UK should submit a negative (with supporting technical reasons) or positive vote on this draft. Please indicate if you are aware of any reason why this draft standard should not be published as a British Standard.

Submission of Comments

- **Annotated drafts are not acceptable and will be rejected.**
- All comments should be submitted online at <https://standardsdevelopment.bsigroup.com/>. You will need to register in order to comment.

Template for comments and secretariat observations

Date: xx/xx/20xx	Document: ISO/DIS xxxx
------------------	------------------------

1	2	(3)	4	5	(6)	7
MB	Clause No./ Subclause No./Annex (e.g. 3.1)	Paragraph/ Figure/Table/Note	Type of comment	Comment (justification for change) by the MB	Proposed change by the MB	Secretariat observations on each comment submitted
	3.1	Definition 1	ed	Definition is ambiguous and needs clarifying.	Amend to read '...so that the mains connector to which no connection...'	
	6.4	Paragraph 2	te	The use of the UV photometer as an alternative cannot be supported as serious problems have been encountered in its use in the UK.	Delete reference to UV photometer.	

CEN/TC 191

Date: 2024-01

prEN 14972-13:2024

Secretariat: BSI

Fixed firefighting systems — Water mist systems — Part 13: Test protocol for wet benches and other similar processing equipment for open nozzle systems

**Ortsfeste Brandbekämpfungsanlagen — Wassernebelsysteme — Teil 13:
Prüfprotokoll für Nassbänke und andere ähnliche Verarbeitungsanlagen für offene
Düsensysteme**

Élément introductif — Élément central — Élément complémentaire

CCMC will prepare and attach the official title page.

Contents	Page
European foreword	3
1 Scope.....	4
2 Normative references.....	4
3 Terms and definitions	4
4 General requirements.....	4
5 Test hall requirements	5
6 Test enclosure requirements	5
6.1 Simulated clean room facility	5
6.1.1 Structure	5
6.1.2 Test conditions	8
6.2 Wet bench mock-up	8
7 Instrumentation requirements	15
8 Fire test requirements	16
8.1 General.....	16
8.2 Fuel.....	16
8.3 Ignition process and pre-burn time	19
8.4 Acceptance criteria.....	19
8.5 Ventilated subsurface (plenum) fire tests	19
8.5.1 General.....	19
8.5.2 Nominal 100 mm, 150 mm, 200 mm, 250 mm, and 300 mm diameter polypropylene pool fires	19
8.5.3 Flammable liquid pool fires	19
8.5.4 Polypropylene pool fire utilizing a single nozzle	20
8.5.5 Flammable liquid pool fires utilizing a single nozzle	20
8.6 Wet bench working surface tests	20
8.6.1 General.....	20
8.6.2 Nominal 100 mm, 150 mm, 200 mm, 250 mm, and 300 mm diameter polypropylene pool fires	20
8.6.3 Flammable liquid pool fires	21
8.6.4 Splash test.....	21
8.7 Unventilated space fire tests	21
8.7.1 General.....	21
8.7.2 Polypropylene pool fire utilizing a single nozzle	21
8.7.3 Flammable liquid pool fires utilizing a single nozzle	22
9 Test report.....	22

European foreword

This document (prEN 14972-13:2024) has been prepared by Technical Committee CEN/TC 191 “Fixed firefighting systems”, the secretariat of which is held by BSI.

This document is currently submitted to the CEN Enquiry.

The EN 14972 series, published under the general title *Fixed firefighting systems — Water mist systems*, consists of the following parts. This list includes standards that are in preparation, and other standards can be added. For the current status of published standards, refer to www.cencenelec.eu.

- *Part 1: Design, installation, inspection and maintenance;*
- *Part 2: Test protocol for shopping areas for automatic nozzle systems;*
- *Part 3: Test protocol for office, school classrooms and hotel for automatic nozzle systems;*
- *Part 4: Test protocol for non-storage occupancies for automatic nozzle systems;*
- *Part 5: Test protocol for car garages for automatic nozzle systems;*
- *Part 6: Test protocol for false floors and false ceilings for automatic nozzle systems;*
- *Part 7: Test protocol for commercial low hazard occupancies for automatic nozzle systems;*
- *Part 8: Test protocol for machinery in enclosures exceeding 260 m³ for open nozzle systems;*
- *Part 9: Test protocol for machinery in enclosures not exceeding 260 m³ for open nozzle systems;*
- *Part 10: Test protocol for atrium protection with sidewall nozzles for open nozzle systems;*
- *Part 11: Test protocol for cable tunnels for open nozzle systems;*
- *Part 12: Test protocol for commercial deep fat cooking fryers for open nozzle systems;*
- *Part 13: Test protocol for wet benches and other similar processing equipment for open nozzle systems;*
- *Part 14: Test protocol for combustion turbines in enclosures exceeding 260 m³ for open nozzle systems;*
- *Part 15: Test protocol for combustion turbines in enclosures not exceeding 260 m³ for open nozzle systems;*
- *Part 16: Test protocol for industrial oil cookers for open nozzle systems;*
- *Part 17: Test protocol for residential occupancies for automatic nozzle systems.*

1 Scope

This document specifies the evaluation of the fire performance of water mist systems for wet benches and other similar processing equipment.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 14972-1:2020, *Fixed firefighting systems — Water mist systems — Design, installation, inspection and maintenance*

3 Terms and definitions

For the purposes of this document, the terms and definitions given in EN 14972-1 apply.

ISO and IEC maintain terminology databases for use in standardization at the following addresses:

- ISO Online browsing platform: available at <https://www.iso.org/obp/>
- IEC Electropedia: available at <https://www.electropedia.org/>

4 General requirements

4.1 Up to a maximum of 5 nozzles used in the fire tests shall be kept for later verification.

4.2 The water mist system, operating without manual intervention, shall successfully complete all described performance fire tests for their specific applications.

4.3 The fire tests shall be conducted until the fire is extinguished, as required by the fire test.

4.4 System components, component locations, operating conditions and test enclosure details shall remain unaltered throughout all the fire tests for a given application.

4.5 All fire tests shall be conducted using the manufacturer instructions in regard to nozzle placement, spray flux, operating pressure, and spray duration. Sprays can be continuous or intermittent in time. In case of intermittent, or cycled, sprays, the time period during which the system is not discharging shall not be greater than 50 % of one complete on/off cycle. The system off period shall not exceed 1 min.

4.6 In conjunction with the performance fire tests, all twin fluid water mist systems shall be subjected to a straight discharge test with no fire to evaluate the resulting discharge and oxygen concentration. This evaluation shall be conducted using the maximum extinguishing agent flow and pressure. The discharge duration for the test shall be the maximum required for the system and occupancy to be protected. Oxygen measurements shall be recorded at a location(s) within the test enclosure. This information shall be used to evaluate personnel safety and shall be accounted for in the manufacturer's DIOM manual.

4.7 The minimum operating nozzle pressure (as specified by the manufacturer) shall be used for all tests. System operating pressures shall be repeatable to within ± 5 %. If the system pressures cannot be controlled within the specified tolerance, fire tests shall be conducted at the minimum and maximum pressure by using external means to control the system pressure.

4.8 The maximum nozzle ceiling height and spacing (as specified by the manufacturer) shall be used for all tests. This includes utilizing the maximum ceiling spacing of the nozzles from the walls.

4.9 The ceiling nozzle arrangement shall have uniform spacing. The ceiling nozzle spacing from the wall shall be uniform, preferably one half of the main spacing.

5 Test hall requirements

5.1 The fire test hall shall be of adequate size with natural or minimal ventilation so as not to interfere with the fire testing within the enclosure or about the wet bench mock-up in the hall.

5.2 The size of the test laboratory shall not impact extinguishment of any test fires (i.e. depletion of oxygen due to an inadequately sized test laboratory).

5.3 For all fire tests, the ceiling, floor, and walls shall be as dry as possible, with only ambient moisture content allowed. The relative humidity in the test enclosure shall not significantly differ from that of the ambient relative humidity. Maximum room relative humidity shall not be more than 70 % prior to the test.

5.4 The fire test hall shall be at an ambient temperature of $(20 \pm 10) ^\circ\text{C}$ prior to the start of the test.

6 Test enclosure requirements

6.1 Simulated clean room facility

6.1.1 Structure

The simulated clean room facility shall be constructed in a large open test hall. The enclosure shall be 3,7 m wide by 5,5 m long by 3,7 m in height. The enclosure shall be constructed of wood or metal frame with an inner lining of minimum 13 mm gypsum or 0,7 mm galvanized steel. A 0,8 m by 2,0 m high personnel door shall be installed with a locking mechanism in one of the walls. A 1,2 m by 2,4 m high removable panel shall also be installed for test enclosure access (the personnel door may be constructed within this panel).

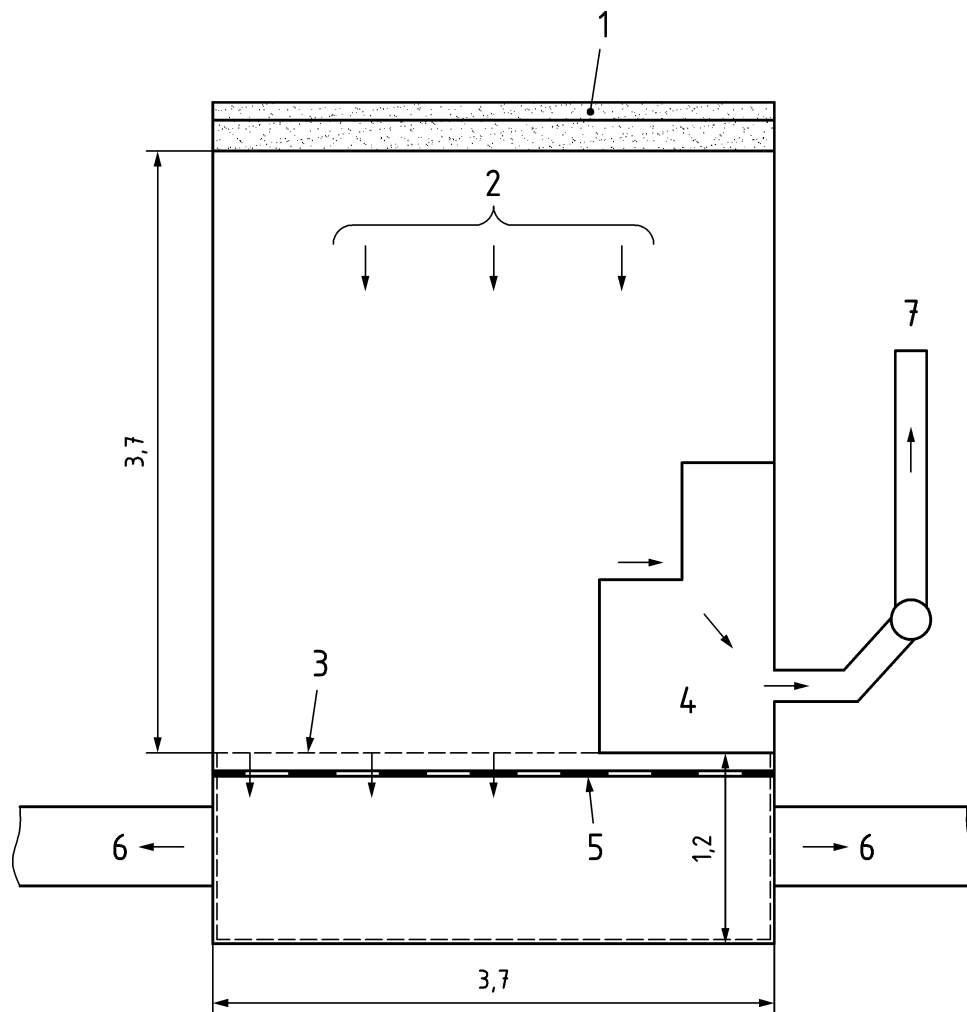
The ceiling of the enclosure shall be constructed of a porous plate to allow inflow of air from the open test hall at the ceiling level. The plate shall include 6,3 mm diameter perforations at 25 mm spacing. This will result in an open area of approximately 6 %.

The floor of the enclosure shall be raised. The floor shall be constructed with closed mesh ca. 2,65 mm steel grating (bearing bar size of 25 mm) tall by 3,2 mm thick. The mesh opening shall be 8 mm by 100 mm. A porous steel plate shall be placed below the steel grating. The plate shall include 6,5 mm diameter perforations at 25 mm spacing. This will result in an open area of approximately 6 %.

A sub-floor shall be constructed underneath the primary enclosure, to allow airflow through the test enclosure floor openings, creating a realistic flow environment surrounding the wet bench mock-up. The sub-floor shall be 3,7 m wide by 5,5 m long by 1,2 m deep and shall be constructed of wood or metal frame with an inner lining of minimum 13 mm gypsum or 0,7 mm galvanized steel.

The front and back 5,5 m walls of the sub-floor shall include 2,3 m wide by 0,7 m high openings. The openings shall be horizontally and vertically centred in each wall of the sub-floor. Each opening shall be ducted to the open test hall (see Figures 1 to 3) and shall include blowers to generate a downward flow in the upper test enclosure. The ductwork and blowers serve as the primary wet bench air flow.

Dimensions in metres

**Key**

- | | |
|---|--------------------------|
| 1 Porous Plate | 5 Metal plate with holes |
| 2 Uniform flow of at least 14 m ³ /min per linear metre of wet bench | 6 Primary blower |
| 3 Raised floor | 7 Secondary blower |
| 4 Wet bench | |

Figure 1 — Clean room simulation facility – Side view