

Australian Standard[®]

Fire detection and alarm systems

Part 11: Manual call points (ISO 7240-11:2005, MOD)



This Australian Standard® was prepared by Committee FP-002, Fire Detection, Warning, Control and Intercom Systems. It was approved on behalf of the Council of Standards Australia on 18 December 2007.
This Standard was published on 27 February 2008.

The following are represented on Committee FP-002:

- Audio Engineering Society
 - Australasian Fire Authorities Council
 - Australian Building Codes Board
 - Australian Chamber of Commerce and Industry
 - Australian Electrical and Electronic Manufacturers Association
 - Australian Industry Group
 - Australian Institute of Building Surveyors
 - CSIRO Materials Science and Engineering
 - Deafness Forum of Australia
 - Department of Defence (Australia)
 - Fire Protection Association Australia
 - Institute of Security Executives
 - National Electrical and Communications Association
 - National fire Industry Association
 - Property Council of Australia
-

This Standard was issued in draft form for comment as DR 03310.

Standards Australia wishes to acknowledge the participation of the expert individuals that contributed to the development of this Standard through their representation on the Committee and through the public comment period.

Keeping Standards up-to-date

Australian Standards® are living documents that reflect progress in science, technology and systems. To maintain their currency, all Standards are periodically reviewed, and new editions are published. Between editions, amendments may be issued.

Standards may also be withdrawn. It is important that readers assure themselves they are using a current Standard, which should include any amendments that may have been published since the Standard was published.

Detailed information about Australian Standards, drafts, amendments and new projects can be found by visiting www.standards.org.au

Standards Australia welcomes suggestions for improvements, and encourages readers to notify us immediately of any apparent inaccuracies or ambiguities. Contact us via email at mail@standards.org.au, or write to Standards Australia, GPO Box 476, Sydney, NSW 2001.

Australian Standard[®]

Fire detection and alarm systems

Part 11: Manual call points (ISO 7240-11:2005, MOD)

First published as AS 7240.11—2008.

COPYRIGHT

© Standards Australia

All rights are reserved. No part of this work may be reproduced or copied in any form or by any means, electronic or mechanical, including photocopying, without the written permission of the publisher.

Published by Standards Australia GPO Box 476, Sydney, NSW 2001, Australia

ISBN 0 7337 8562 X

PREFACE

This Standard was prepared by Standards Australia Committee FP-002, Fire Detection, Warning, Control and Intercom Systems.

This Standard has been adopted with national modifications and has been reproduced from ISO 7240-11:2005, *Fire detection and alarm systems*, Part 11: *Manual call points*.

Variations to ISO 7240-11:2005 are indicated at the appropriate places throughout this standard. Strikethrough (~~example~~) identifies ISO text, tables and figures which, for the purposes of this Australian Standard, are deleted. Where text, tables or figures are added, each is set in its proper place and identified by shading (example). Added figures are not themselves shaded, but are identified by a shaded border.

The objective of this Standard is to provide the requirements and methods of test for manual call points in fire detection and fire alarm systems in and around buildings. The Standard does not cover manual call points that are intrinsically safe for use in hazardous conditions.

Committee FP-002 intends to review the applicability of AS 1603.5, *Automatic fire detection and alarm systems*, Part 5, *Manual call points* after the publication of this Standard.

As this Standard is reproduced from an International Standard, the following applies:

- (a) Its number does not appear on each page of text and its identity is shown only on the cover and title page.
- (b) In the source text 'this International Standard' should read 'this Australian Standard'.
- (c) A full point should be substituted for a comma when referring to a decimal marker.

The term 'normative' has been used in this Standard to define the application of the annex to which it applies. A 'normative' annex is an integral part of a Standard.

The term 'informative' has been used in this Standard to define the application of the appendix to which it applies. An 'informative' appendix is only for information and guidance.

Contents

Page

Introduction	iv
1 Scope.....	1
2 Normative references	1
3 Terms and definitions	2
4 Requirements	3
5 Tests	11
6 Test report	29
Annex A (normative) Test apparatus for test of operation	31
Annex B (informative) Test apparatus for test for non-operation	33
Annex C (informative) Apparatus for impact test.....	34

Introduction

This part of ISO 7240 has been prepared up by Sub-Committee ISO/TC 21/SC3, the secretariat of which is held by SAI and is based on a European Standard EN 54-11 prepared by the European Committee for Standardization CEN/TC 72 "*Fire detection and fire alarm systems*".

This part of ISO 7240 has been drafted on the basis of appearance and functions which should be provided on all manual call points for use in fire detection and fire alarm systems. The colours, dimensions, shapes and methods of operation are based on recognised operating principles which give confidence and recognition to the user when operated in genuine fire alarm situations.

It is important for manual call points to be recognisable and simple to use, without the need to read elaborate instructions so that anyone discovering a fire is able to use the manual call point without previous familiarity with it.

The purpose of a manual call point is to enable a person discovering a fire to initiate the operation of a fire alarm system so that appropriate measures can be taken.

The intention of this International Standard is to specify requirements for operation and reliability. The methods of operation of the manual call points covered are as follows:

- Type A: direct operation (single action);
- Type B: indirect operation (double action).

Both types require the breaking or the visible displacement by change of the position of a frangible element forming part of the front face, which is considered to be the most suitable method for general application and which act as a deterrent to the misuse of the device.

Importance has been placed on identifying the manual call point, the method by which it is activated and an indication to the user that the initiation of an alarm has been given.

The resulting standard takes into account national variances in custom and practice and language in bringing together common elements that contribute towards a standard device for use throughout the world.

The performance of manual call points is assessed from results obtained in specific tests. This part of ISO 7240 is not intended to place any other restrictions on the design and construction of such manual call points.

AUSTRALIAN STANDARD

Fire detection and alarm systems—

Part 11:

Manual call points

1 Scope

This part of ISO 7240 specifies the requirements, test methods and performance criteria for manual call points in fire detection and alarm systems in and around buildings (see ISO 7240-1). It takes into account indoor and outdoor conditions, the appearance and operation of the manual call points for type A “direct operation” and type B “indirect operation” and covers those which are simple mechanical switches, those which are fitted with simple electronic components (e.g. resistors, diodes) and those which contain active electronic components and which work with the control and indicating equipment for signalling and identifying, for example, an address or location.

This part of ISO 7240 does not cover manual call points for special applications, for example manual call points that are intrinsically safe or for use in hazardous conditions, if such applications require additional or other requirements or tests than those given in this standard.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references⁺, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

AS 2700, Colour Standards for general purposes

ISO 209-1, *Wrought aluminium and aluminium alloys — Chemical composition and forms of products — Part 1: Chemical composition*

ISO 3098-0, *Technical product documentation — Lettering — Part 0: General requirements*

ISO 3864, *Safety colours and safety signs*

~~ISO 7240-1, Fire detection and alarm systems — Part 1: General and definition~~

AS 7240.1, *Fire detection and alarm systems — Part 1: General and definitions*

ISO 7240-2, *Fire detection and alarm systems — Part 2: Control and indicating equipment*

~~IEC 60068-1, Environmental testing — Part 1: General and guidance~~

AS 60068.1, *Environmental testing — Part 1: General and guidance*

~~IEC 60068-2-1, Environmental testing — Part 2-1. Tests: Tests A: Cold~~

AS 60068.2.1, *Environmental testing — Part 2-1. Tests: Tests A: Cold*

~~IEC 60068-2-2, Environmental testing — Part 2-2: Tests: Tests B: Dry heat~~

AS 60068.2.2, *Environmental testing — Part 2-2: Tests: Tests B: Dry heat*

~~IEC 60068-2-6, Environmental testing — Part 2-6: Tests: Test Fc: Vibration (sinusoidal)~~

www.standards.org.au

AS 60068.2.6, *Environmental testing — Part 2-6. Tests: Test Fc: Vibration (sinusoidal)*

~~IEC 60068-2-18, *Environmental testing — Part 2-18. Tests: Test R and guidance: Water*~~

AS 60068.2.18, *Environmental testing — Part 2-18. Tests: Test R and guidance: Water*

~~IEC 60068-2-27, *Environmental testing — Part 2-27. Tests: Test Ea and guidance: Shock*~~

AS 60068.2.27, *Environmental testing — Part 2-27. Tests: Test Ea and guidance: Shock*

~~IEC 60068-2-30, *Environmental testing — Part 2-30. Tests: Test Db and guidance: Damp heat cyclic (12 + 12-hour cycle)*~~

AS 60068.2.30, *Environmental testing — Part 2-30. Tests: Test Db and guidance: Damp heat cyclic (12 + 12-hour cycle)*

~~IEC 60068-2-42, *Environmental testing — Part 2-42. Tests: Test Kc: Sulphur dioxide test for contacts and connections*~~

AS 60068.2.42, *Environmental testing — Part 2-42. Tests: Test Kc: Sulphur dioxide test for contacts and connections*

~~IEC 60068-2-78, *Environmental testing — Part 2-78. Tests: Test Cab: Damp heat, steady state*~~

AS 60068.2.78, *Environmental testing — Part 2-78. Tests: Test Cab: Damp heat, steady state*

~~IEC 60081, *Double-capped fluorescent lamps—Performance specifications*~~

AS/NZS 4782.1, *Double-capped fluorescent lamps—Performance specifications, Part 1: General (IEC 60081:2000, MOD)*

~~EN 894-3, *Safety of machinery — Ergonomics requirements for the design of displays and control actuators — Part 3: Control actuators*~~

AS 4024.1903, *Safety of machinery — Displays, controls, actuators and signals — Ergonomics requirements for the design of displays and control actuators — Part 3: Control actuators*

EN 50130-4, *Alarm Systems — Part 4: Electromagnetic compatibility — Product family standard: Immunity requirements for components of fire, intruder and social alarm systems.*

3 Terms and definitions

For the purposes of this document, the terms and definitions given in ISO 7240-1 and the following apply.

3.1

alarm condition

condition of the manual call point after the operating element has been activated

3.2

frangible element

component which is glass or has the appearance of glass and which after receiving a blow or pressure as instructed, is physically broken or is visibly displaced by change of position and remains in that condition until replaced or reset

NOTE The frangible element is intended to give protection against unintentional operation and to be a deterrent against misuse. The visible displacement of the frangible element is accepted as apparent breaking.

3.3

non-resettable frangible element

frangible element that needs to be replaced after the activation of the manual call point, in order for the manual call point to be able to return to the normal condition

3.4**resettable frangible element**

frangible element that can be returned to its original position without replacement, in order for the manual call point to be able to return to the normal condition

3.5**front face**

the area within the outline of the front view of the manual call point excluding the area of the operating face

NOTE See Figure 1.

3.6**manual call point**

a component of a fire detection and fire alarm system which is used for the manual initiation of an alarm [ISO 7240-1]

Manual call points are divided into two types depending on the method of operation:

3.7**type A: direct operation**

a manual call point in which the change to the alarm condition is automatic (i.e. without the need for further manual action) when the frangible element is broken or displaced

3.8**type B: indirect operation**

a manual call point in which the change to the alarm condition requires a separate manual operation of the operating element by the user after the frangible element is broken or displaced

3.9**normal condition**

the condition in which the frangible element is undamaged and the manual call point is operating without giving an alarm or fault signal

3.10**operating element**

mechanical and electrical switching element, part of the manual call point which initiates the alarm signal when operated

3.11**operating face**

that area of the manual call point which may be the visible part of the frangible element or the visible area behind it

NOTE See Figure 1.

3.12**special tool**

a device not normally carried by the public (e.g. a key), normally provided by the manufacturer and which is used for replacing or resetting the frangible element

NOTE It is intended to deter unauthorised access to the manual call point, while being available on site either at a defined location or from a "responsible person" familiar with and having knowledge of the system.

4 Requirements**4.1 Compliance**

In order to comply with this part of ISO 7240, the manual call point shall meet the requirements of this clause, which shall be verified by visual inspection or engineering assessment, shall be tested as described in Clause 5 and shall meet the requirements of the tests.

4.2 Marking and data

4.2.1 Marking

Each manual call point shall be permanently marked with the following information:

- a) a reference to this part of ISO 7240 (i.e. ISO 7240-11:2005);
- b) the name or trademark of the manufacturer or supplier;
- c) the model designation;
- d) environment category (indoor / outdoor, special environmental conditions);
- e) the wiring terminal designations;
- f) some mark(s) or code(s) (e.g. serial number or batch code), by which the manufacturer can identify, at least, the date or batch and place of manufacture, and the version number(s) of any software, contained within the manual call point.

Where any marking on the manual call point uses symbols or abbreviations not in common use then these shall be explained in the data supplied with the device.

The marking shall be visible during installation of the manual call point and shall be accessible during maintenance.

The markings shall not be placed on screws or other easily removable parts.

4.2.2 Data

Either the manual call points shall be supplied with sufficient technical, installation and maintenance data to enable their correct installation and operation or, if all of these data are not supplied with each manual call point, reference to the appropriate data sheet shall be given on, or with, each manual call point.

To enable correct operation of the manual call points, these data shall describe the requirements for the correct processing of the signals from the manual call point. This may be in the form of a full technical specification of these signals, a reference to the appropriate signalling protocol or a reference to suitable types of control and indicating equipment etc.

Additional information may be required by organisations certifying that manual call points produced by a manufacturer conform to the requirements of this part of ISO 7240.

4.3 Frangible element

4.3.1 Normal condition

The normal condition shall be easily recognisable by the appearance of the operating face as detailed in 4.7. The frangible element shall be flat and shall not be broken, deformed or displaced.

4.3.2 Alarm condition

Transfer from the normal condition to the alarm condition shall be achieved by the following and shall be easily recognisable by the change in the appearance of the operating face:

- a) for type A manual call points:
 - 1) breaking the frangible element or
 - 2) displacing the frangible element as a result of the breaking or
 - 3) displacing the frangible element without breaking together with changing the appearance of the front face.
- b) for type B manual call points:
 - 1) breaking and/or displacement of the frangible element as described in 4.3.2 a), to give access to the operating element and

- 2) manual activation of the operating element.

In addition, for type B manual call points, it shall be possible to see that the operating element is in the activated position and it shall not be possible to activate the operating element without breaking or displacing the frangible element [see 4.3.2 b)] or without the use of a special tool (see 4.6)

4.4 Indicators for alarm condition

The alarm condition shall be indicated by:

- a) for type A: the condition of the frangible element as specified in 4.3;
- b) for type B: the frangible element as described in 4.3 together with an identifiable activated position of the operating element.

The alarm condition may be additionally indicated visually by other means, for example lamps or light-emitting diodes (LEDs).

If an additional visual indicator is provided, it shall be positioned within the operating face or within the front face of the manual call point. The visual indicator shall be red, shall identify the manual call point, which released an alarm, until the alarm condition is reset and shall be visible from a distance of 2 m at up to 45° from the axis of the manual call point in any direction, in an ambient light intensity up to 500 lx. Where other conditions of the manual call point may be visually indicated, they shall be clearly distinguishable from the alarm indication, except when the manual call point is switched into a service mode.

4.5 Reset facility

It shall only be possible to reset the manual call point after operation by means of a special tool or special procedure as follows:

- a) for non-resettable frangible elements by inserting a new element;
- b) for resettable frangible elements by resetting the frangible element.

In addition, for type B manual call points, it shall only be possible to return the operating element to its normal condition by means of a special tool.

4.6 Test facility

The manual call point shall be equipped with a facility to carry out routine testing when installed. The operation of this test facility shall:

- a) simulate the alarm condition by activating the operating element without breaking the frangible element; and
- b) allow the manual call point to be reset without breaking the frangible element.

The operation of the test facility shall only be possible using a special tool or special procedure.

4.7 Construction and design

4.7.1 Safety

When operating the frangible element injury to the operator shall not occur.

For type B manual call points the actuation force of the operating element shall meet the requirements of EN 894-3: 2000.

Corners and edges of the manual call points shall be rounded to reduce the possibility of injury.

4.7.2 Shape, dimensions and colours

4.7.2.1 Shape

The front face of the manual call point shall be symmetrical about the horizontal axis and symmetrical about the vertical axis (see Figure 1).

The operating face

- shall be approximately symmetrical about the horizontal axis and approximately symmetrical about the vertical axis (see Figure 1).
- shall be level with or recessed into the front face; it shall not project beyond the front face.
- may have a vertical offset about the horizontal centre line of the front face.

4.7.2.2 Dimensions

The dimensions of the front face a shall be not less than 85 mm and not greater than 150 mm (see Figure 1).

The dimensions of the operating face b shall be not less than $0,4a$ and not greater than $0,8a$ (see Figure 1).

The operating face offset c shall be not greater than $0,1a$ (see Figure 1).

The manual call point shall be designed so that it is capable of being mounted, in accordance with the manufacturer's instructions, with the front face at least 15 mm proud of the surrounding surface.

4.7.2.3 Colours



The colour of the visible surface area of the manual call point when mounted in accordance with 5.1.3 shall be red, except for

- a) the operating face;
- b) the symbols and lettering on the front face specified in 4.7.3.2;
- c) the special tool access, cable entry holes and screws.

The colour of the operating face other than symbols and lettering specified in 4.7.3.3 shall be white.

The colour of the visible part of the operating element (type B manual call point) shall be black.

NOTE Suitable red, white and black colours are specified in ISO 3864.

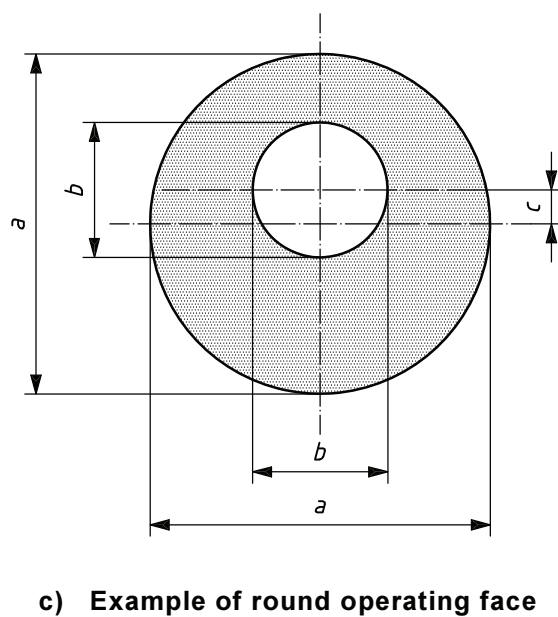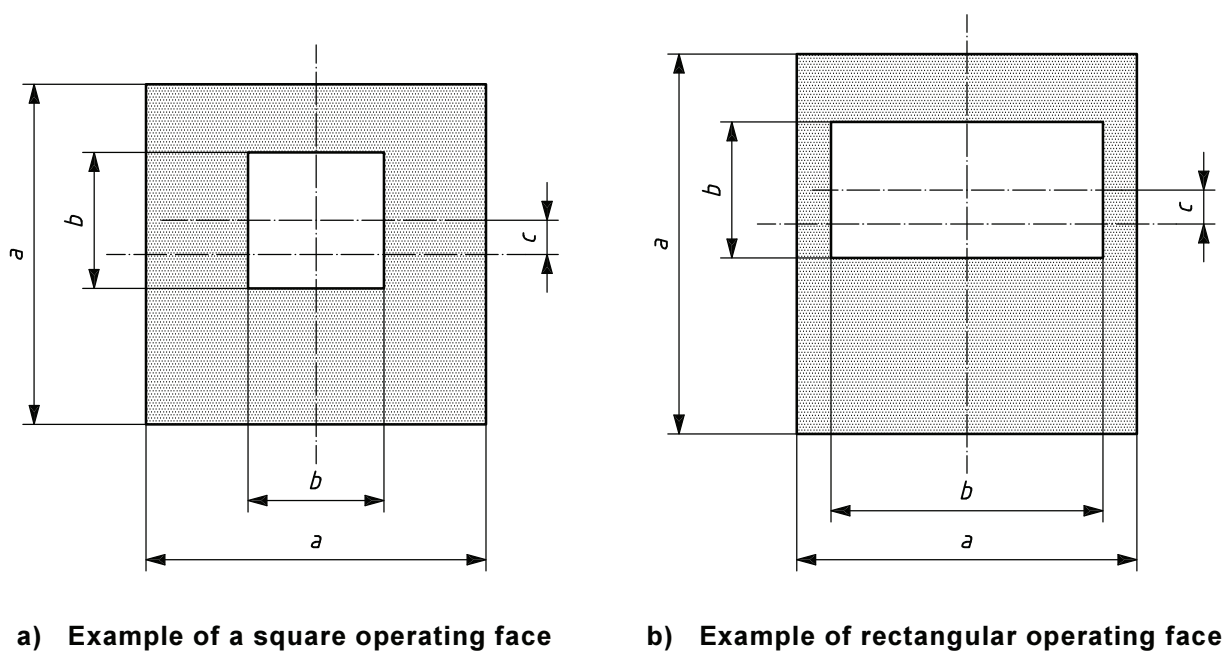

Key

- 1 front face
- 2 operating face

Limitations on the dimensions:

$$85 \text{ mm} \leq a \leq 150 \text{ mm}$$

$$0,4a \leq b \leq 0,8a$$

$$\text{offset } c \leq 0,1a$$

Figure 1 — Manual call point examples

4.7.3 Symbols and lettering

4.7.3.1 General

The manual call point shall be marked, with the appropriate symbols shown in Figure 2, as specified in 4.7.3.2 and 4.7.3.3. Examples of the arrangement of symbols on type A and type B manual call points are given in Figures 3 and 4 respectively.

4.7.3.2 Symbols and lettering on the front face

4.7.3.2.1 On the front face above the operating face and central to the vertical centre line shall be the symbol in accordance with Figure 2 a). This symbol may be supplemented with the word "FIRE", or equivalent words in the national language. This combination shall be on the front face and above the operating face and central to the vertical centre line. The height of the symbol shall be at least $0,15 a$ and the height of the lettering shall not exceed the height of the symbol. The lettering shall be in accordance with ISO 3098-0: 1997, "lettering type B, vertical (V)". Symbols and lettering shall be white in accordance with ISO 3864:1984.

4.7.3.2.2 Markings other than specified in 4.7.3.2.1 (such as company logo or contact address) shall be restricted to the area of the front face below the horizontal centre line of the operating face. The total area for this marking other than red shall not be greater than 5 % of the area of the front face.

4.7.3.3 Symbols and lettering on the operating face

4.7.3.3.1 The operating face of type A manual call points shall be marked with the symbol in accordance with Figure 2 c). The operating face of type B manual call points shall be marked with the symbols in accordance with Figures 2 b) and 2c). The symbol in accordance with Figure 2 b) shall point to the operating element and shall remain clearly visible when the frangible element is broken or displaced. These symbols may be supplemented by appropriate words for instruction. Where supplementary wording is used, this shall indicate position and/or operating action (e.g. "PRESS HERE").


These symbols and lettering for any supplementary instructions shall be black with the black area not exceeding 10 % of the area of the operating face.

NOTE A suitable black colour is specified in ISO 3864:1984.


4.7.3.3.2 Markings other than specified in 4.7.3.3.1 (such as company logo or contact address) shall be restricted to the upper and/or the lower 25 % of the area of the operating face and shall not interfere with the symbols. The total area for this marking other than white shall not be greater than 5 % of the area of the operating face.



a) Symbol on the front face
(ISO 7000, symbol 2685)



b) Symbol on the operating face for activating
the operating element for type B manual call point
(ISO 7000, symbol 2684)

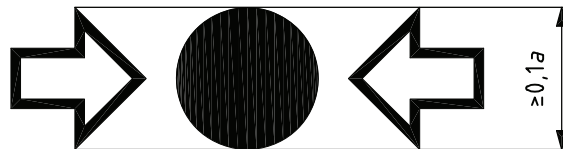

c) Symbol on the operating face (ISO 7000:2004, symbol 1701)

NOTE The dimensions and spacing of the symbols shall be in proportion to the height shown.

Key

a height of the front face, see Figure 1

Figure 2 — Symbols used for manual call points

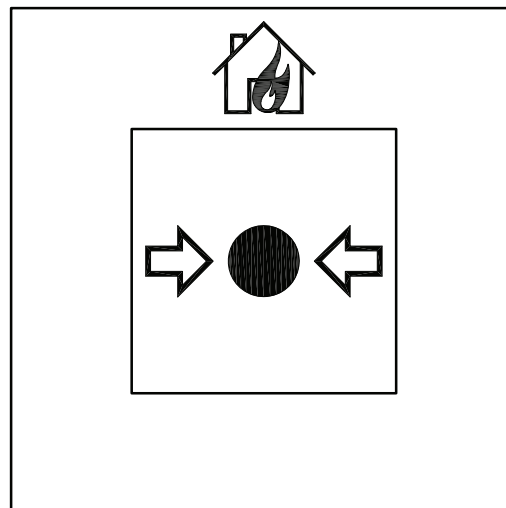


Figure 3 — Example for the front and operating face symbol positions for type A manual call point