

STANDARDS AUSTRALIA/STANDARDS NEW ZEALAND

Amendment No. 1
to
AS/NZS 3003:2018
Electrical installations—Patient areas

CORRECTION

The 2018 edition of AS/NZS 3003 is amended as follows; the amendments should be inserted in the appropriate places.

SUMMARY: This Amendment applies to Figure 14 and Appendix F.


Published on 29 July 2019.

Approved for publication in New Zealand by the New Zealand Standards Approval Board on 3 July 2019.

AMDT
No. 1
JUL
2019

Figure 14

Delete figure, excluding note and title, and *replace* with the following:

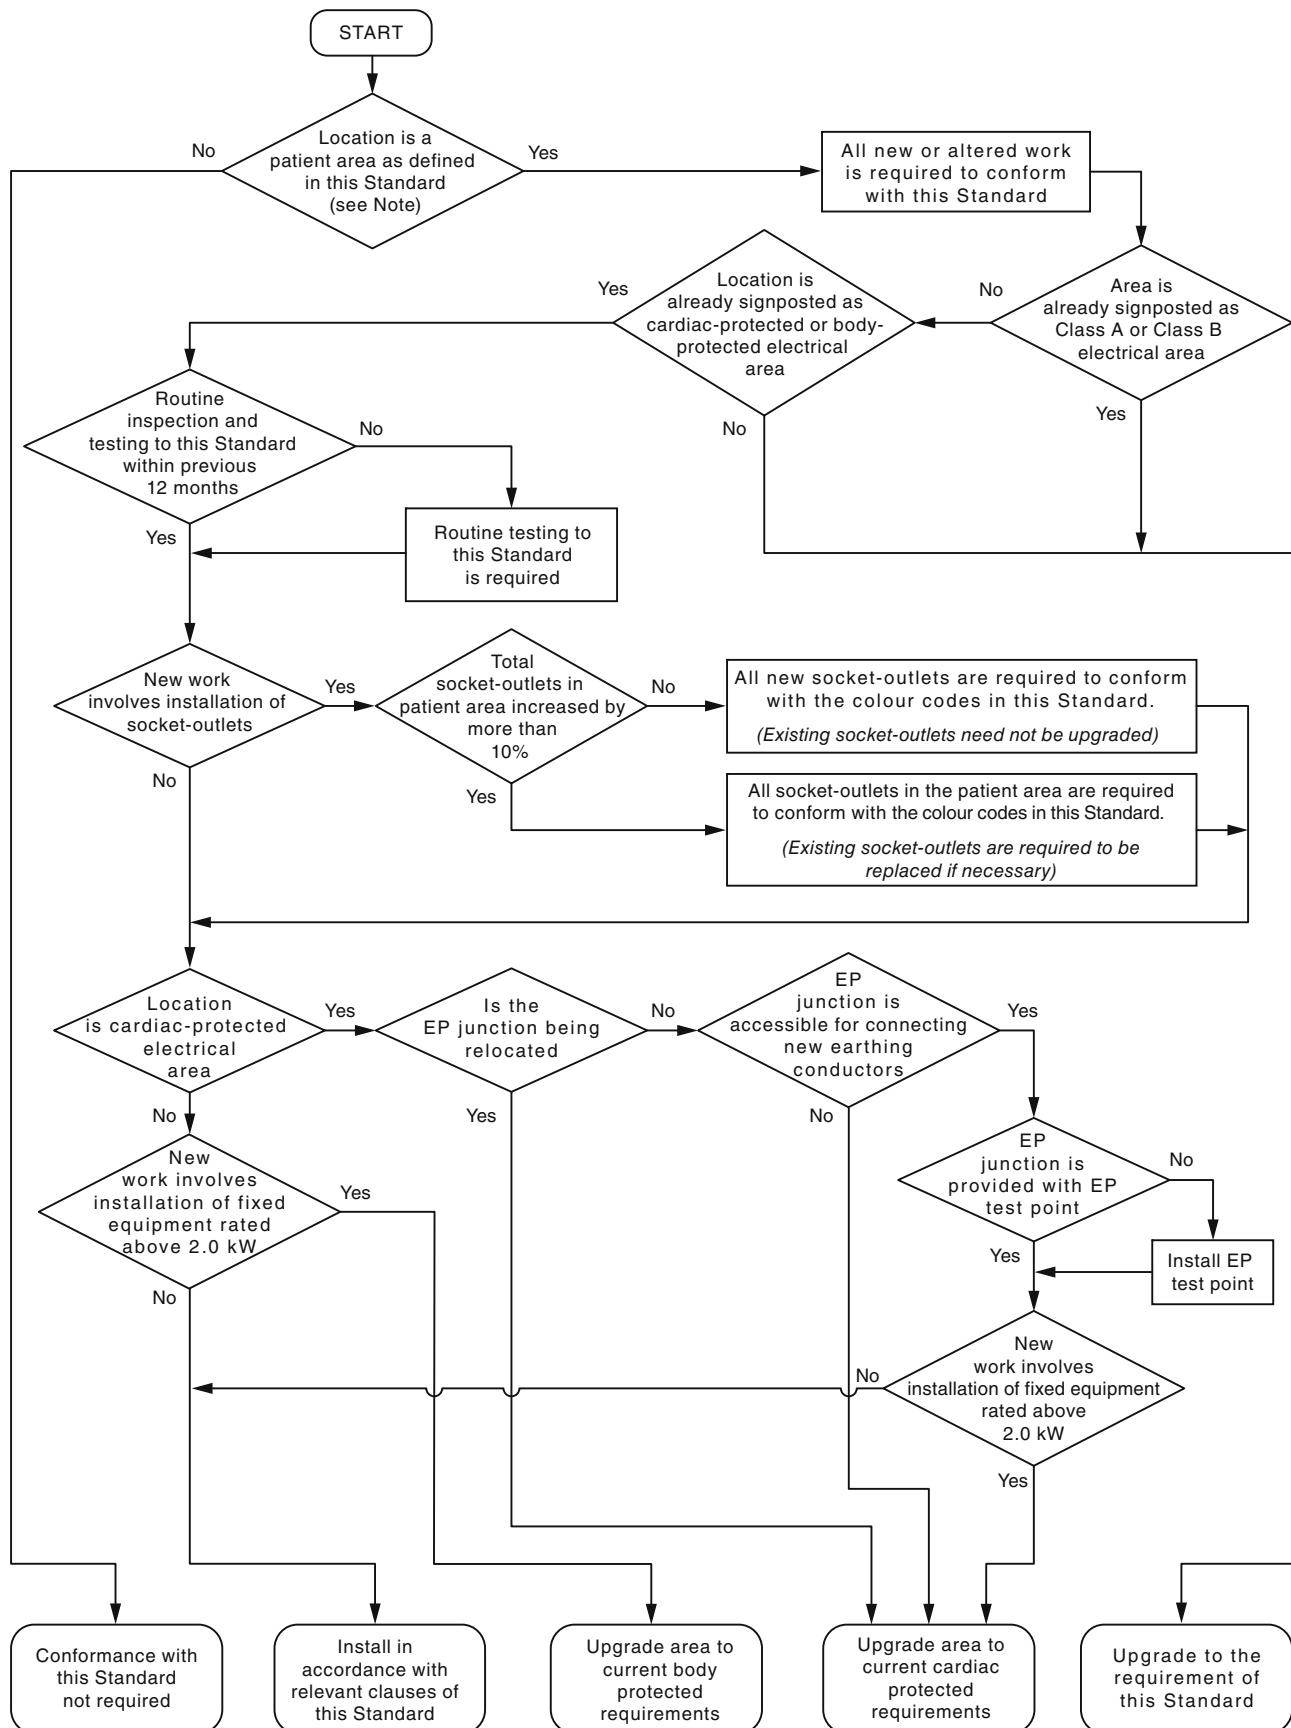

Appendix F

First sentence, *delete* 'Clause 8.2.7' and *replace* with 'Clause 8.3.7'.