This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.

Designation: E2461 – 22

Standard Practice for Determining the Thickness of Glass in Airport Traffic Control Tower Cabs[1]

This standard is issued under the fixed designation E2461; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ε) indicates an editorial change since the last revision or reapproval.

1. Scope

1.1 This practice covers the determination of the thickness of glass installed in airport traffic control towers (ATCT) to resist a specified design loading with a selected probability of breakage less than or equal to either 1 lite per 1000 or 4 lites per 1000 at the first occurrence of the design wind loading.

1.2 The procedures apply to common outward sloping cab glass designs for which the specified loads do not exceed 15 kPa (313 psf).

1.3 The procedures assume control tower cab glass has an aspect ratio no greater than 3.

1.4 The procedures assume control tower cab glass has an area no less than 1.86 m^2 (20 ft^2).

1.5 The use of the procedures assumes the following:

1.5.1 Monolithic and laminated glass installed in ATCTs shall have continuous lateral support along two parallel edges, along any three edges, or along all four edges;

1.5.2 Insulating glass shall have continuous lateral support along all four edges; and

1.5.3 Supported glass edges are simply supported and free to slip in plane.

1.6 The procedures do not apply to any form of wired, patterned, etched, sandblasted, or glass types with surface treatments that reduce the glass strength.

1.7 The procedures do not apply to drilled, notched, or grooved glass.

1.8 The procedures address the determination of thickness and construction type to resist a specified design wind load at a selected probability of breakage. The final glass thickness and construction determined also depends upon a variety of other factors (see 5.4).

1.9 These procedures do not address blast loading on glass.

1.10 These procedures do not apply to triple-glazed insulating glass units.

1.11 The values stated in SI units are to be regarded as standard. The values given in parentheses after SI units are provided for information only and are not considered standard.

1.12 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety, health, and environmental practices and to determine the applicability of regulatory limitations prior to use.*

1.13 *This international standard was developed in accordance with internationally recognized principles on standardization established in the Decision on Principles for the Development of International Standards, Guides and Recommendations issued by the World Trade Organization Technical Barriers to Trade (TBT) Committee.*

2. Referenced Documents

2.1 *ASTM Standards:*[2]

C162 Terminology of Glass and Glass Products
C1036 Specification for Flat Glass
E631 Terminology of Building Constructions
E1300 Practice for Determining Load Resistance of Glass in Buildings

2.2 *American Society of Civil Engineers Standard:*[3]

ASCE 7 Minimum Design Loads for Buildings and Other Structures

3. Terminology

3.1 *Definitions:*

3.1.1 For definitions of general terms related to building construction used in this practice, refer to Terminology E631, and for general terms related to glass and glass products, refer to Terminology C162.

[1] This practice is under the jurisdiction of ASTM Committee E06 on Performance of Buildings and is the direct responsibility of Subcommittee E06.52 on Glass Use in Buildings.

Current edition approved Dec. 15, 2022. Published March 2023. Originally approved in 2005. Last previous edition in 2017 as E2461-12 (2017). DOI: 10.1520/E2461-22.

[2] For referenced ASTM standards, visit the ASTM website, www.astm.org, or contact ASTM Customer Service at service@astm.org. For *Annual Book of ASTM Standards* volume information, refer to the standard's Document Summary page on the ASTM website.

[3] Available from American Society of Civil Engineers (ASCE), 1801 Alexander Bell Dr., Reston, VA 20191, http://www.asce.org.

Copyright © ASTM International, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959. United States

Documents
Document Sharing Hub

Full document details: ASTM E2461-22

3.2 *Definitions of Terms Specific to This Standard:*

3.2.1 *annealed (AN) glass, n*—a flat, monolithic, glass lite of uniform thickness; it is formed by a process whereby the magnitudes of the residual stresses are nearly zero.

3.2.2 *aspect ratio (AR), n*—for glass simply supported along four sides, the ratio of the long dimension to the short dimension for rectangular glass or the ratio of the long dimension to the short dimension of the rectangle that completely encloses trapezoidal glass. For rectangular glass supported continuously along all four edges, AR always equals or exceeds 1.0. For glass simply supported along three sides, the ratio of the length of the longer parallel supported edge to the dimension perpendicular to the parallel supported sides, equal to or greater than 0.5.

3.2.2.1 *Discussion*—The rectangle that completely encloses the trapezoid has two sides parallel to the horizontal edges of the trapezoid and the other two sides perpendicular to the horizontal edges of the trapezoid. All dimensions shall be measured from edge to edge of glass.

3.2.3 *encompassing rectangular area (ERA), n*—the area of the smallest rectangle that will encompass a trapezoidal glass lite. The value of the ERA shall be used as the area when determining deflection in Figs. A2.1-A2.19.

3.2.4 *glass breakage, n*—the fracture of any lite or ply in monolithic, laminated, or insulating glass resulting from stress that an applied uniform lateral load induces.

3.2.5 *Glass Thickness*—

3.2.5.1 *thickness designation for laminated glass (LG), n*—a term used to specify an LG construction based on the combined thicknesses of its component plies.

(1) Add the minimum thicknesses of the individual glass plies and the nominal interlayer thickness. If the sum of all interlayer thicknesses is greater than 1.52 mm (0.060 in.), use 1.52 mm (0.060 in.) in the calculation.

(2) Select the nominal thickness or designation in Table 1 having the closest minimum thickness that is equal to or less than the value obtained in 3.2.5.1.

TABLE 1 Thickness Designations, Minimum Glass Thickness, and Unit Self-Weight

Nominal thickness or designation, mm (in.)	Minimum thickness, mm (in.)	Glass weight Pa (psf)
2.7 (lami)	2.59 (0.102)	67.0 (1.40)
3.0 (⅛)	2.92 (0.115)	74.2 (1.55)
4.0 (5⁄32)	3.78 (0.149)	99.1 (2.07)
5.0 (3⁄16)	4.57 (0.180)	124 (2.59)
6.0 (¼)	5.56 (0.219)	149 (3.11)
8.0 (5⁄16)	7.42 (0.292)	199 (4.15)
10.0 (⅜)	9.02 (0.355)	248 (5.18)
12.0 (½)	11.91 (0.469)	298 (6.22)
16.0 (⅝)	15.09 (0.595)	397 (8.29)
19.0 (¾)	18.26 (0.719)	472 (9.85)
22.0 (⅞)	21.44 (0.844)	546 (11.4)
25.0 (1)	24.4 (0.969)	622 (13.0)
32 (1¼)[A]	27.38 (1.22)	795 (16.6)
38 (1½)[A]	31.6 (1.47)	943 (19.7)
44 (1¾)[A]	44.3 (1.75)	1070 (22.3)
52 (2)[A]	50.3 (2.00)	1220 (25.5)
57 (2¼)[A]	57 (2.25)	1390 (29.1)

[A] Not a glazing industry standard thickness designation.

(3) Exceptions—The construction of two 6 mm (¼ in.) glass plies plus 0.38 mm (0.015 in.) or 0.76 mm (0.030 in.) interlayer shall be defined as 12 mm (½ in.). The construction of two 2.5 mm (3⁄32 in.) glass plies plus 1.52 mm (0.060 in.) interlayer shall be defined as 5 mm (3⁄16 in.). The construction of two 4 mm (5⁄32 in.) glass plies plus any thickness interlayer shall be defined as 8 mm (5⁄16 in.).

3.2.5.2 *thickness designation for monolithic glass, n*—the designated or nominal thickness commonly used in specifying a particular glass product, based on the minimum thicknesses presented in Table 1 and Specification C1036.

3.2.6 *insulating glass (IG) unit, n*—consists of any combination of two glass lites, as defined herein, that enclose a sealed space filled with air or other gas.

3.2.7 *laminated glass (LG), n*—a flat-lite of uniform thickness that is fabricated by bonding two or more monolithic glass lites or plies of equal thickness, as defined herein, together with polyvinyl butyral (PVB) interlayer(s).

3.2.7.1 *Discussion*—Many different interlayer materials are used in LG. The information in this practice applies to polyvinyl butyral (PVB) interlayer or those interlayers that demonstrate equivalency according to Appendix X8 in Practice E1300.

3.2.8 *lateral, adj*—perpendicular to the glass surface.

3.2.9 *load, n*—a uniformly distributed lateral pressure.

3.2.9.1 *design load, n*—the magnitude of the 3 second duration load used to design glass for ATCT cabs. Equations used herein for computing magnitudes for design loads adjust glass self-weight to a magnitude consistent with a 3 second duration.

3.2.9.2 *specified design load, n*—the magnitude in kPa (psf), type (for example, wind or self-weight) and duration of the load. The wind load has a duration of approximately 3 seconds. Glass self-weight (Table 1) has a long duration, typically equal to the in-service life of the window glass lite. Earth facing cab glass is only subjected to wind load and its self-weight.

3.2.9.3 *long duration load, n*—any load lasting approximately 30 days or longer.

3.2.9.4 *short duration load, n*—any load lasting approximately 3 seconds, such as, wind load.

3.2.10 *minimum thickness of monolithic glass, n*—the minimum allowable thickness associated with a nominal or designated glass thickness as given in Table 1 and Specification C1036.

3.2.11 *probability of breakage (P_b), n*—the theoretical fraction of glass lites or plies that would break at the first occurrence of the resistance load, typically expressed in lites per thousand.

3.2.12 *specifying authority, n*—the design professional responsible for interpreting applicable regulations of authorities having jurisdiction and considering appropriate site-specific factors to determine the proper values used to calculate the specified design load and the selection of the Probability of Breakage (P_b) to be used with this practice.

AVA Documents
Document Sharing Hub

Full document details: ASTM E2461-22

4. Summary of Practice

4.1 The use of these procedures requires a specified design load that shall consist of the wind load and the factored lateral component of glass weight. The total design load shall not exceed 15 kPa (313 psf).

4.2 The procedures specified herein facilitate determination of the thickness of an annealed window glass construction required to resist the specified design loading for the selected probability of breakage.

4.3 This standard procedure provides deflection charts in Annex A2 to facilitate determination of approximate center of glass deflection.

5. Significance and Use

5.1 This standard procedure facilitates determination of the thickness of a glass construction required to resist a specified design load with a selected probability of breakage.

5.2 For optical purposes, ATCT cab glass typically utilize only annealed glass products. For this reason, some specifying authorities mandate its use and prohibit heat-strengthened and tempered glass in control cabs. This standard procedure therefore addresses the following glass constructions: annealed monolithic, annealed laminated, and insulating glass fabricated with annealed monolithic or annealed laminated glass, or both. In cases where the specifying authority approves the use of heat-strengthened or fully tempered glass in the control cab or in areas where optical characteristics do not apply but are deemed critical to the facility operation, the NFL values obtained from standard may be adjusted using appropriate Glass Type Factors (GTF) and procedures for their use as specified in Practice E1300.

5.3 Use of these procedures assume:

5.3.1 The glass is free of edge damage and is properly glazed,

5.3.2 The glass has not been subjected to abuse,

5.3.3 The surface condition of the glass is typical of glass that has been in service for several years and is significantly weaker than freshly manufactured glass due to minor abrasions on exposed surfaces,

5.3.4 The glass edge support system is sufficiently stiff to limit the lateral deflections of the supported glass edges to less than 1/175 of their lengths. The specified design load shall be used for this calculation, and

5.3.5 The center of glass deflection shall not result in loss of edge support. Typically maintaining center of glass deflection at or below the magnitude of three times the nominal glass thickness assures that no loss of edge support will occur.

5.4 Many other factors affect the selection of glass type and thickness. These factors include but are not limited to: thermal stresses, the effects of windborne debris, excessive deflections, behavior of glass fragments after breakage, seismic effects, heat flow, edge bite, noise abatement, potential post-breakage consequences, and so forth. In addition, considerations set forth in federal, state, and local building codes along with criteria presented in safety glazing standards and site-specific concerns may control the ultimate glass type and thickness selection.

6. Procedure

6.1 Select a probability of breakage, glass type or construction, and glass thickness(es).

6.2 Compute the design load for monolithic or single laminated glass according to:

$$L_D = L_W + 3.2 L_G \cos\theta \quad (1)$$

where:

L_D = denotes the design load,
L_W = denotes the wind load,
L_G = denotes the weight of the glass, and
θ = denotes the acute angle the glass makes with the horizontal. For monolithic or single laminated glazing, the user shall obtain L_G from Table 1 for the nominal glass thickness. For insulating glass, L_G shall consist of the weights of both glass lites as determined from Table 1.

6.3 *Monolithic Single Glazing Continuously Supported Along all Four Sides:*

6.3.1 Determine the AR.

6.3.2 Determine the required glass thickness from Figs. A1.1-A1.8 (P_B = 0.001) or Figs. A1.9-A1.16 (P_B = 0.004) for the design load and long and short dimensions of glass.

6.3.2.1 The required glass thickness from is the smallest thickness with load resistance greater than or equal to the design load.

6.3.3 Determine the ERA.

6.3.3.1 Determine the approximate maximum center of glass deflection under the design load from Figs. A2.1-A2.8.

6.4 *Laminated Single Glazing Continuously Supported Along All Four Sides:*

6.4.1 Determine the AR.

6.4.2 Determine the required glass thickness from Fig. A1.17a-Fig. A1.28 (P_B = 0.001) or Fig. A1.29a-Fig. A1.40 (P_B = 0.004) for the design load and long and short dimensions of glass.

6.4.2.1 The required glass thickness is the smallest thickness with load resistance greater than or equal to the design load.

6.4.3 Determine the ERA.

6.4.3.1 Determine the approximate maximum center of glass deflection under the design load from Fig. A2.9a-Fig. A2.20.

6.5 *Monolithic Single Glazing Continuously Supported Along Any Three Sides:*

6.5.1 Determine the AR.

6.5.2 Determine the required glass thickness from Figs. A1.41-A1.48 (P_B = 0.001) or Figs. A1.49-A1.56 (P_B = 0.004) for the design load and AR.

6.5.2.1 The required glass thickness is the smallest thickness with load resistance greater than or equal to the design load.

6.5.3 Determine the approximate maximum center of glass deflection under the design load from Figs. A2.21-A2.28.

AVA Documents
Document Sharing Hub

Full document details: ASTM E2461-22

6.6 *Laminated Single Glazing Continuously Supported Along Any Three Sides:*

6.6.1 Determine the AR.

6.6.2 Determine the required glass thickness from Fig. A1.57a-Fig. A1.68 (P_B = 0.001) or Fig. A1.69a-Fig. A1.80 (P_B = 0.004) for the design load and AR.

6.6.2.1 The required glass thickness is the smallest thickness with load resistance greater than or equal to the design load.

6.6.3 Determine the approximate maximum center of glass deflection under the design load from Fig. A2.29a-Fig. A2.40.

6.7 *Monolithic Single Glazing Simply Supported Continuously Along Two Opposite Sides:*

6.7.1 Determine the Longer Horizontal (Supported) Glass Length and the Unsupported Glass Length.

6.7.2 Determine the required glass thickness from Figs. A1.81-A1.88 (P_B = 0.001) or Figs. A1.89-A1.96 (P_B = 0.004) for the design load.

6.7.2.1 The required glass thickness is the smallest thickness with load resistance greater than or equal to the design load.

6.7.3 Determine the approximate maximum center of glass deflection under the design load using procedures from Fig. A2.41.

6.8 *Laminated Single Glazing Simply Supported Continuously Along Two Opposite Sides:*

6.8.1 Determine the Longer Horizontal (Supported) Glass Length and the Unsupported Glass Length.

6.8.2 Determine the required glass thickness from Fig. A1.97a-Fig. A1.108 (P_B = 0.001) or Fig. A1.109a-Fig. A1.120 (P_B = 0.004) for the design load.

6.8.2.1 The required glass thickness is the smallest thickness with load resistance greater than or equal to the design load.

6.8.3 Determine the approximate maximum center of glass deflection under the design load using procedures from Fig. A2.42.

6.9 *Insulating Glass (IG) with Monolithic Glass Lites of Equal (Symmetric) Glass Thickness:*

6.9.1 Compute the design load for IG as $L_{DIG}=5(L_W+3.2L_G\cos\theta)/9$ in which all terms are previously defined. The weight of the glass, L_G, consists of the weight of both glass lites.

6.9.2 Determine the AR.

6.9.3 Determine the required glass thickness for a single lite in the IG unit from Figs. A1.1-A1.8 (P_B = 0.001) or Figs. A1.9-A1.16 (P_B = 0.004) for the specified design load and long and short dimensions of glass.

6.9.3.1 The required glass thickness is the smallest thickness with load resistance greater than or equal to the specified design load.

6.9.4 Determine the ERA.

6.9.4.1 Determine the approximate maximum center of glass deflection as the deflection of one lite in the IG unit under the design load $0.9L_{DIG}$ using Figs. A2.1-A2.8.

6.10 *Insulating Glass (IG) with Laminated Glass Lites of Equal (Symmetric) Glass Thickness.*

6.10.1 Compute the design load for IG as $L_{DIG}=5(L_W+3.2L_G\cos\theta)/9$ in which all terms are previously defined. The weight of the glass, L_G, consists of the weight of both glass lites.

6.10.2 Determine the AR.

6.10.3 Determine the required glass thickness for a single lite in the IG unit from Fig. A1.17a-Fig. A1.28 (P_B = 0.001) or Fig. A1.29a-Fig. A1.40 (P_B = 0.004) for the design load and long and short dimensions of glass.

6.10.3.1 The required glass thickness is the smallest thickness with load resistance greater than or equal to the specified design load.

6.10.4 Determine the ERA.

6.11 Determine the approximate maximum center of glass deflection as the deflection of one lite in the IG unit under the design load $0.9L_{DIG}$ using Fig. A2.9a-Fig. A2.20.

7. Report

7.1 Report the following information:

7.1.1 Date of calculation;

7.1.2 The probability of breakage, design wind load, drawing of the glass shape with dimensions, glass edge support conditions, longer horizontal dimension of the glass, the length of the edge perpendicular to the horizontal dimension in the plane of the glass, aspect ratio, encompassing rectangular area, glass type(s) and thickness(es), weight of the glass, glass type factor(s), approximate lateral deflection; and

7.1.3 A statement that the procedure followed was in accordance with this practice or a full description of any deviations.

8. Precision and Bias

8.1 The load resistance charts (Fig. A1.1-Fig. A1.114) are based upon a theoretical glass breakage model that relates the strength of glass to the surface condition. Complete discussions of the formulation of the model are presented elsewhere.[4]

8.1.1 A conservative estimate of the surface condition and, as appropriate, edge condition for glass design was used in generation of the charts. This surface and edge condition estimates are based upon the best available glass strength data and engineering judgment. It is possible that the information presented in the load resistance charts may change as further data becomes available.

9. Keywords

9.1 annealed glass; deflection; flat glass; glass; insulating glass; laminated glass; load resistance; monolithic glass; probability of breakage; strength; wind load

[4] Norville, H. S., El-Shami, M. M., Jackson, R., and Johnson G., "Design Methodology for Large Trapezoidal Window Glass Lites," *The Use of Glass in Buildings*, ASTM STP 1434.

AVA Documents
Document Sharing Hub

Full document details: ASTM E2461-22

ANNEXES

(Mandatory Information)

A1. LOAD RESISTANCE CHARTS

A1.1 Fig. A1.1-Fig. A1.120 present load resistance charts in both SI and inch-pound units. The design charts were developed using failure prediction models for glass. Practice E1300 discusses the failure prediction models for glass. The load resistance charts presented herein are predicated on the same surface flaw parameters as the non-factored load charts in Practice E1300. The design charts are based on minimum glass thicknesses referenced in Specification C1036. The load resistance charts for laminated glass are based on a shear modulus for the PVB interlayer G=300 kPa (43.5 psi). Note that each set of laminated load resistance charts contains two charts for nominal 6 mm (¼ in.) laminated glass. The "a" load resistance chart represents laminated glass comprised of two nominal 2.7 mm (lami) glass plies and a 0.76 mm (0.060 in.) PVB interlayer. The "b" load resistance chart represents laminated glass comprised of two nominal 3 mm (⅛ in.) glass plies and a 0.76 mm (0.060 in.) PVB interlayer.

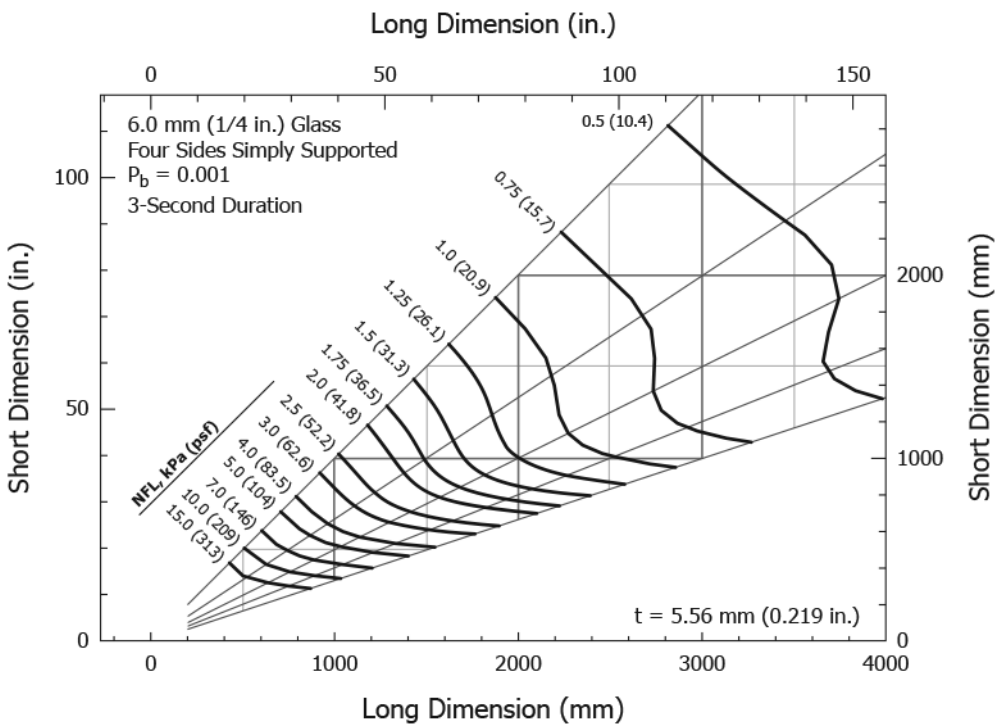

FIG. A1.1 Load Resistance Chart for 6 mm (¼ in.) Annealed Monolithic Glass Continuously Supported Along Four Sides (P_b = 0.001)

Documents
Document Sharing Hub
Full document details: ASTM E2461-22

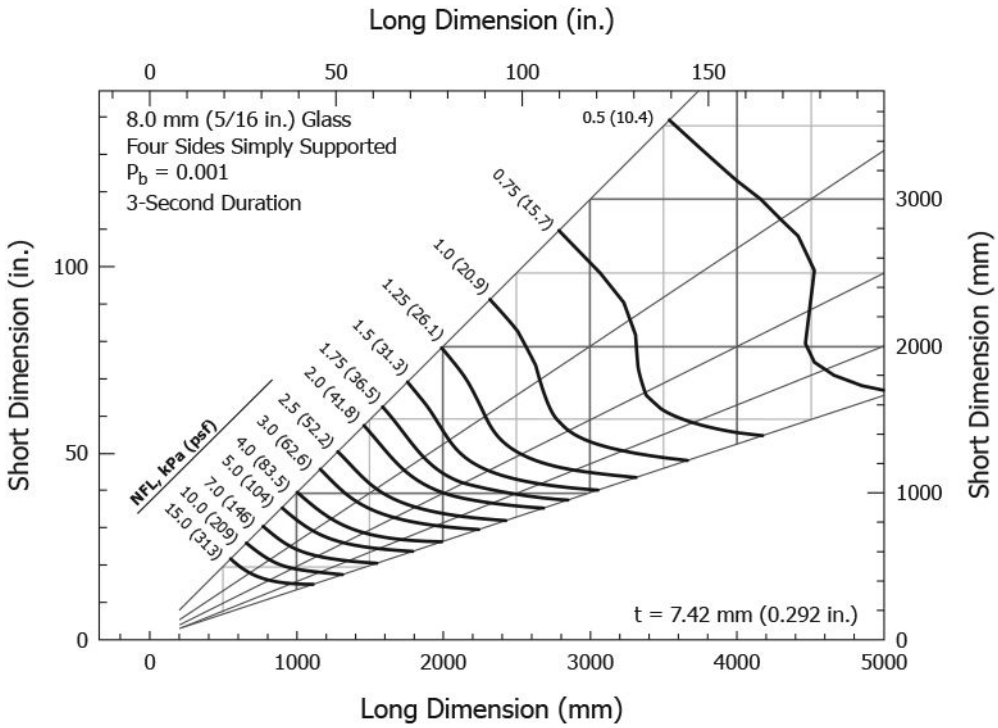

FIG. A1.2 Load Resistance Chart for 8 mm (5⁄16 in.) Annealed Monolithic Glass Continuously Supported Along Four Sides (P_b = 0.001)

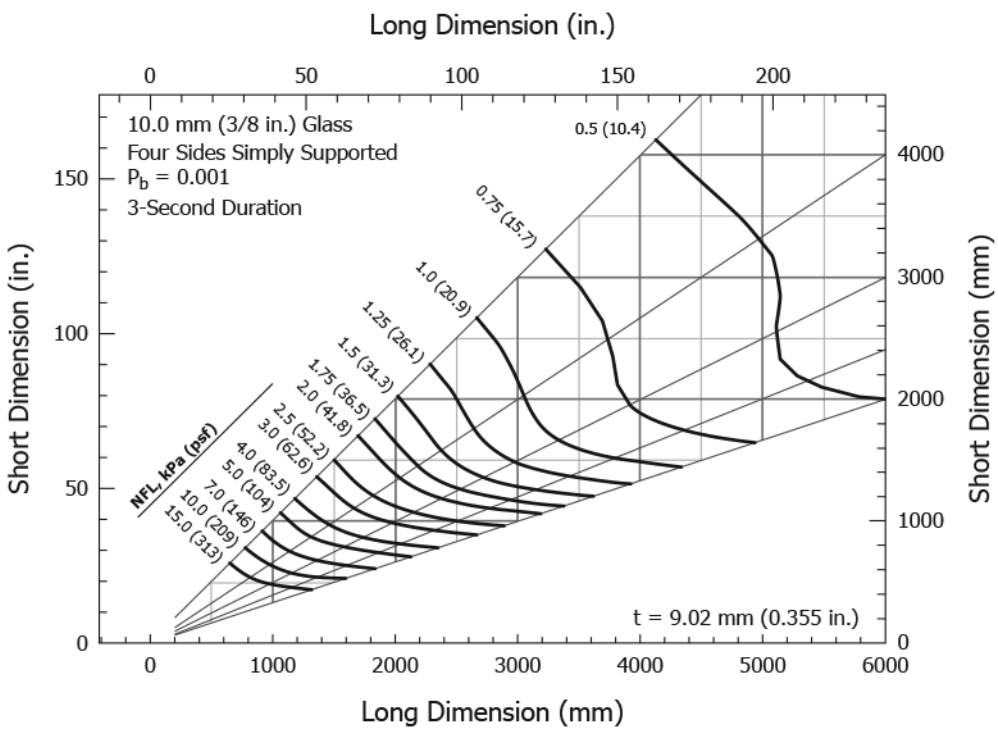

FIG. A1.3 Load Resistance Chart for 10 mm (3⁄8 in.) Annealed Monolithic Glass Continuously Supported Along Four Sides (P_b = 0.001)

Documents
Document Sharing Hub
Full document details: ASTM E2461-22

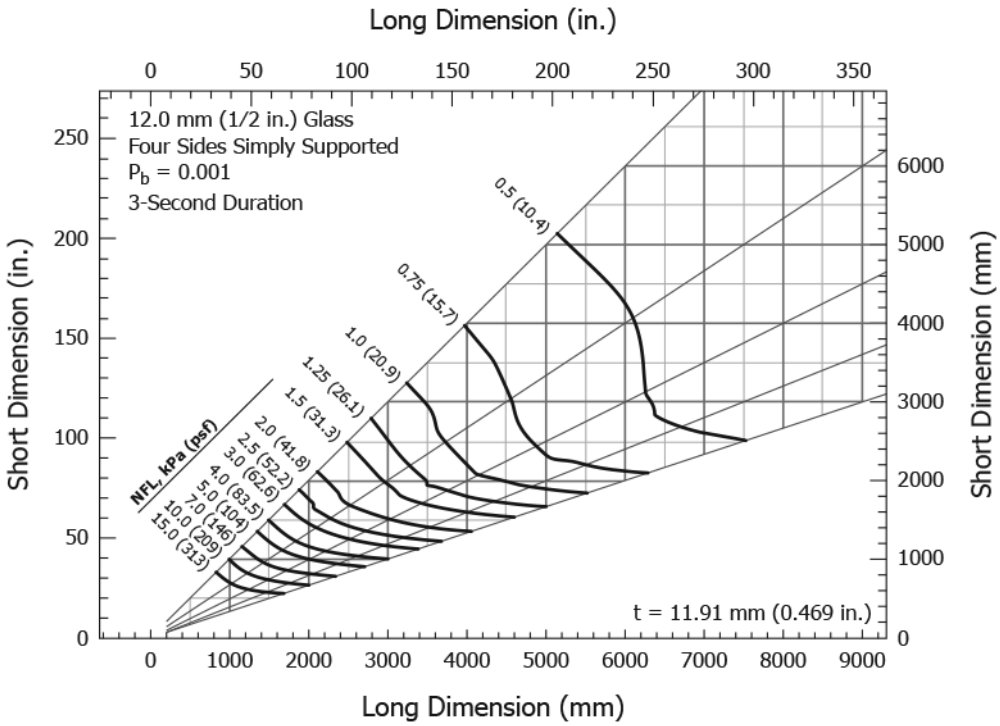

FIG. A1.4 Load Resistance Chart for 12 mm (½ in.) Annealed Monolithic Glass Continuously Supported Along Four Sides (P_b = 0.001)

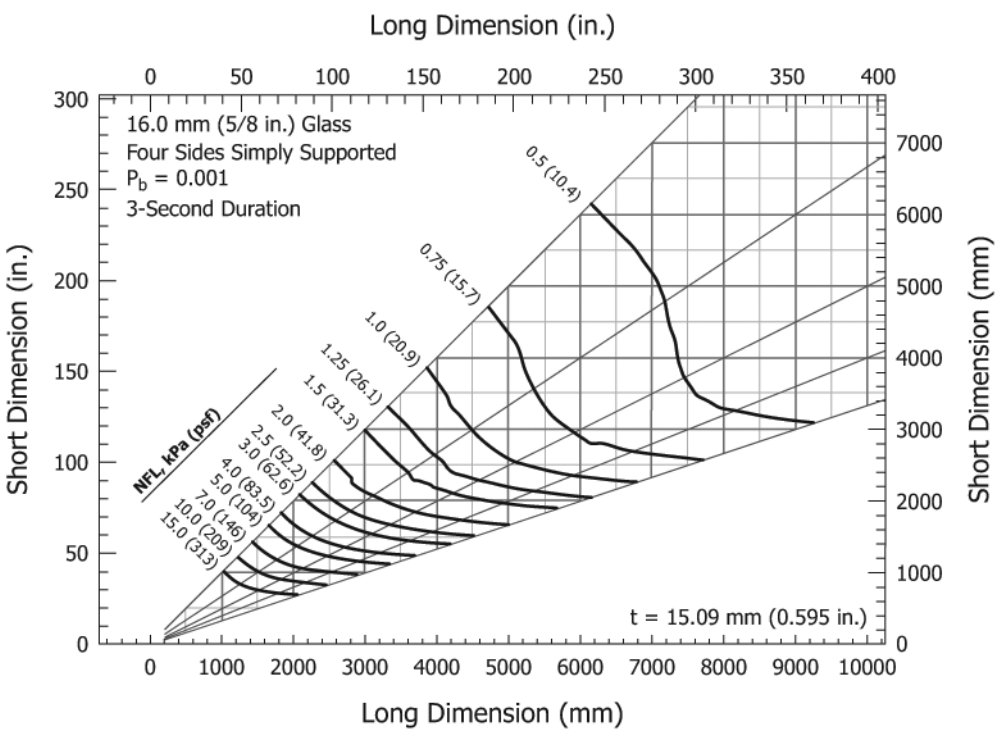

FIG. A1.5 Load Resistance Chart for 16 mm (⅝ in.) Annealed Monolithic Glass Continuously Supported Along Four Sides (P_b = 0.001)

Documents
Document Sharing Hub

Full document details: ASTM E2461-22

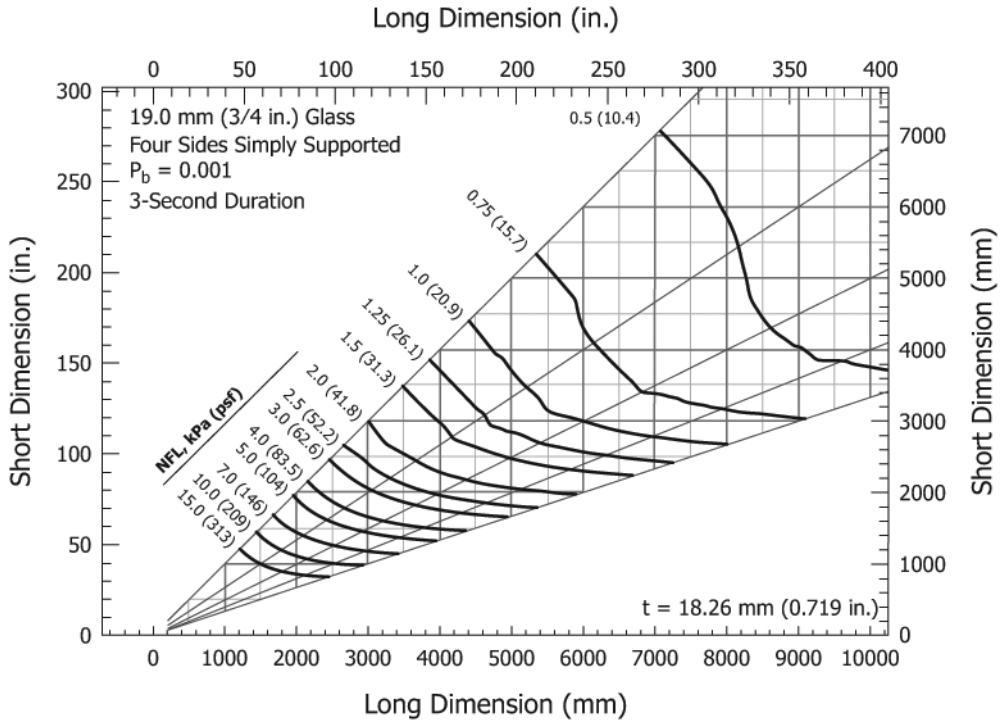

FIG. A1.6 Load Resistance Chart for 19 mm (¾ in.) Annealed Monolithic Glass Continuously Supported Along Four Sides (P_b = 0.001)

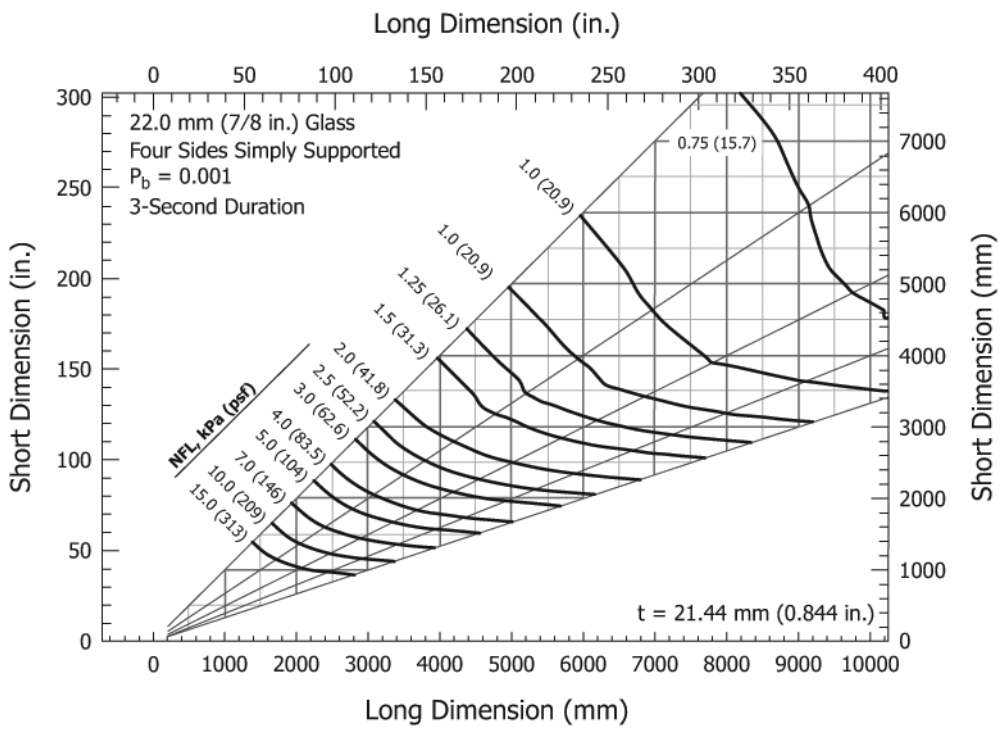

FIG. A1.7 Load Resistance Chart for 22 mm (⅞ in.) Annealed Monolithic Glass Continuously Supported Along Four Sides (P_b = 0.001)

AVA Documents
Document Sharing Hub

Full document details: ASTM E2461-22

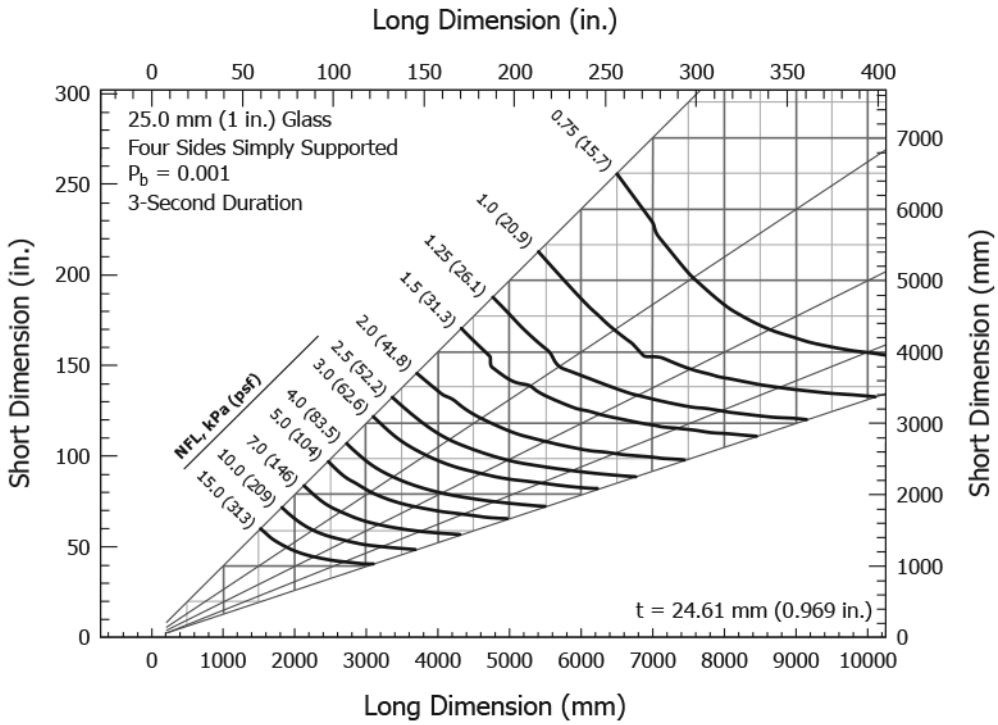

FIG. A1.8 Load Resistance Chart for 25 mm (1 in.) Annealed Monolithic Glass Continuously Supported Along Four Sides (P_b = 0.001)

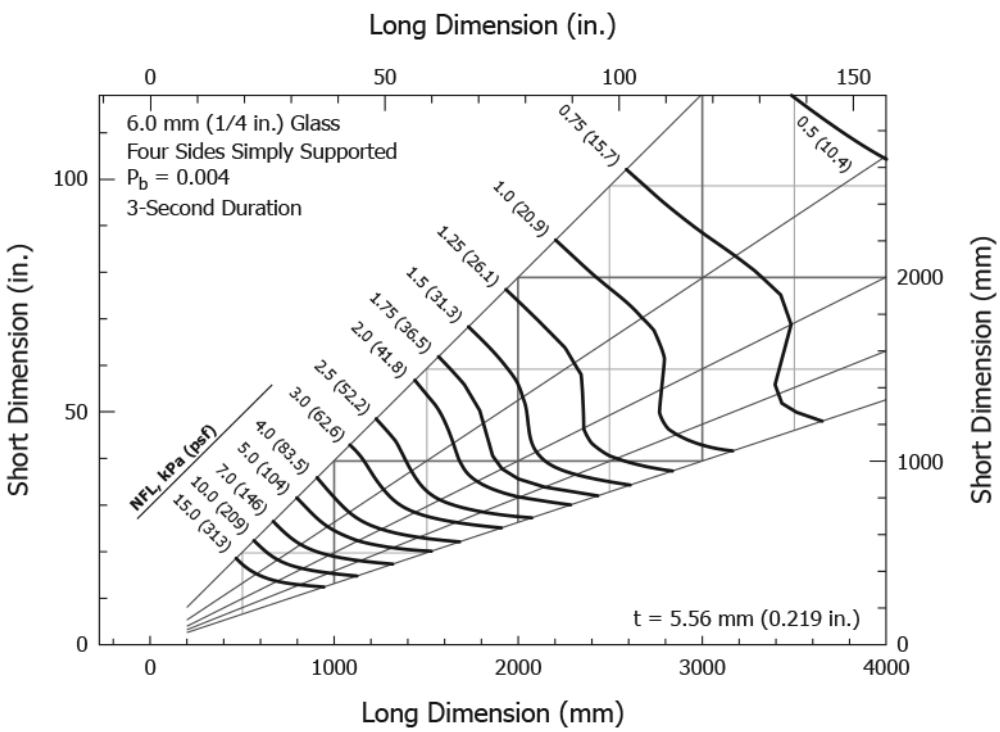

FIG. A1.9 Load Resistance Chart for 6 mm (¼ in.) Annealed Monolithic Glass Continuously Supported Along Four Sides (P_b = 0.004)

Documents
Document Sharing Hub
Full document details: ASTM E2461-22

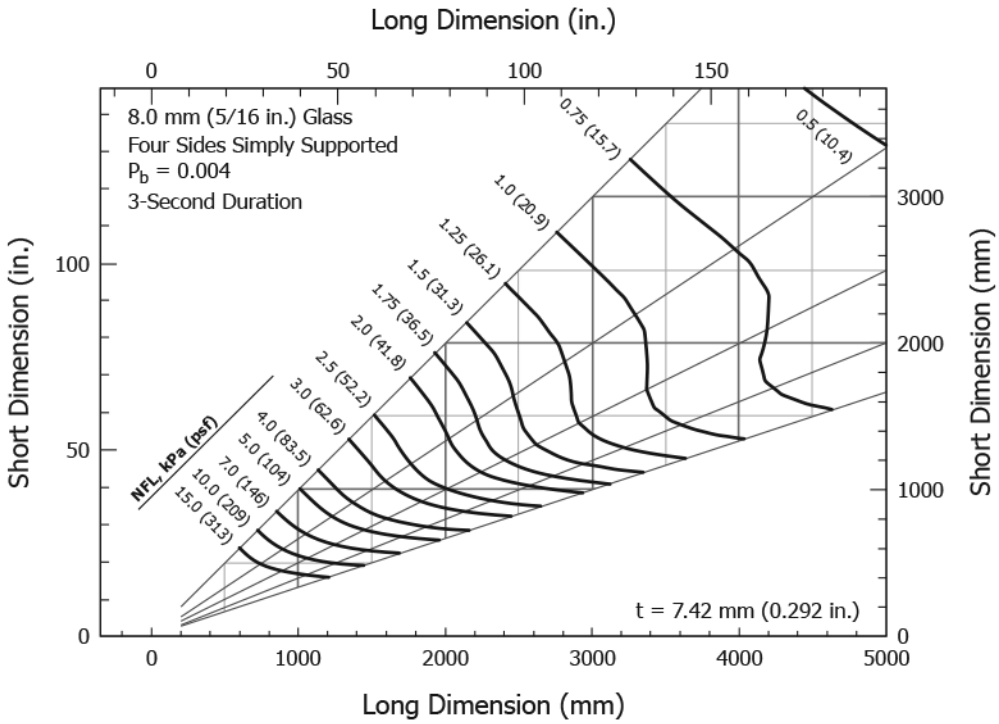

FIG. A1.10 Load Resistance Chart for 8 mm (5⁄16 in.) Annealed Monolithic Glass Continuously Supported Along Four Sides (P_b = 0.004)

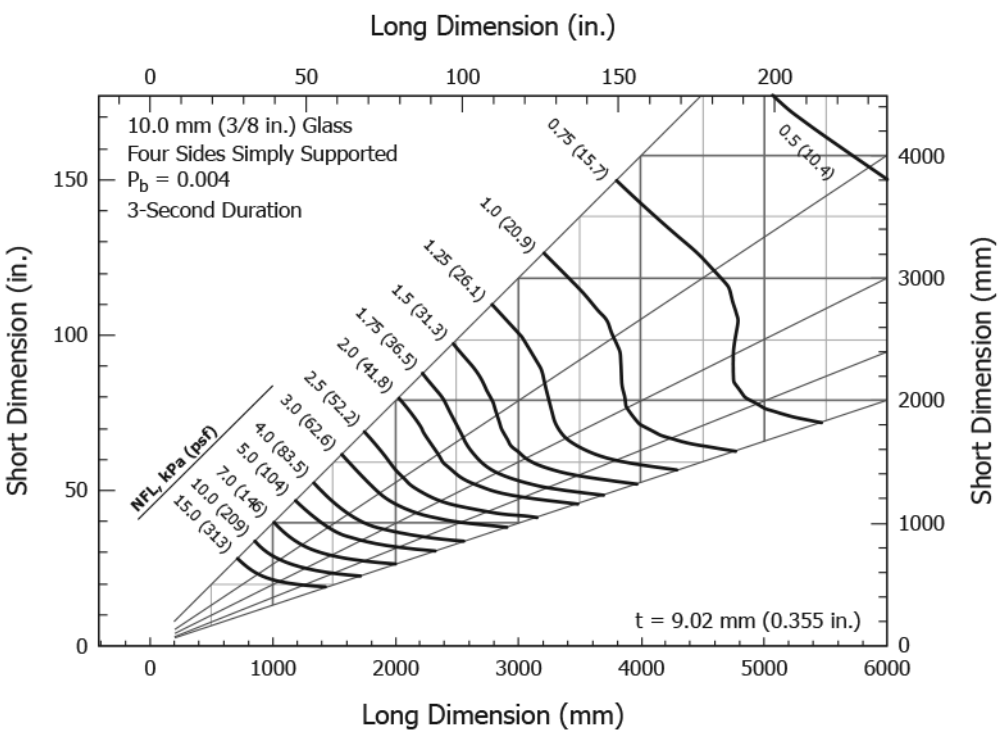

FIG. A1.11 Load Resistance Chart for 10 mm (3⁄8 in.) Annealed Monolithic Glass Continuously Supported Along Four Sides (P_b = 0.004)

Documents
Document Sharing Hub
Full document details: ASTM E2461-22

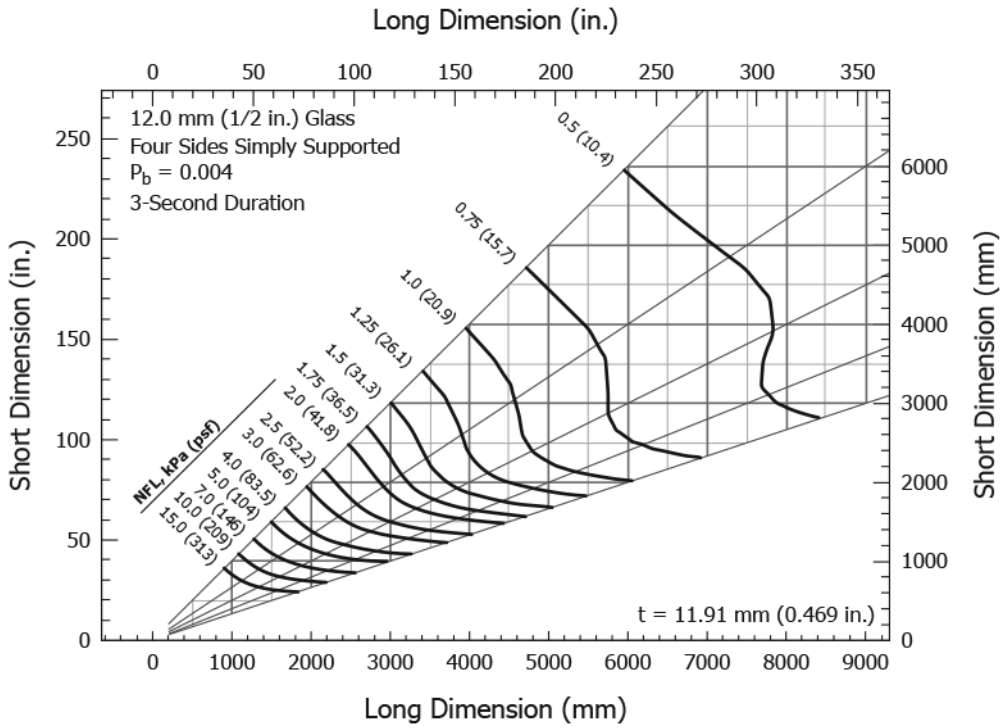

FIG. A1.12 Load Resistance Chart for 12 mm (½ in.) Annealed Monolithic Glass Continuously Supported Along Four Sides (P_b = 0.004)

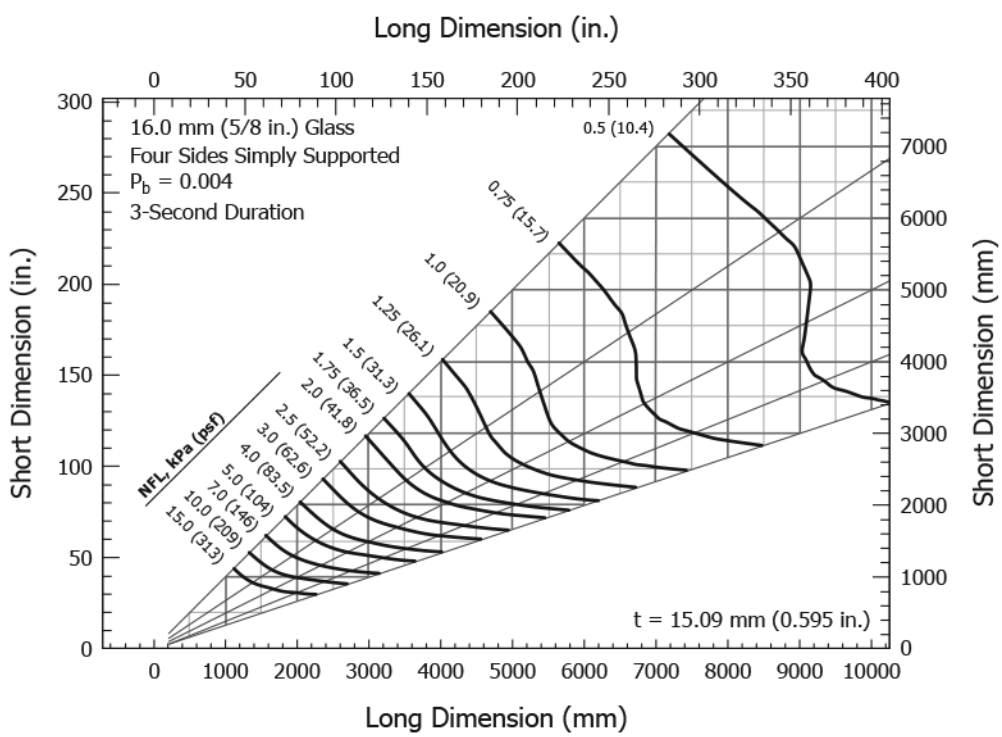

FIG. A1.13 Load Resistance Chart for 16 mm (⅝ in.) Annealed Monolithic Glass Continuously Supported Along Four Sides (P_b = 0.004)

AVA Documents
Document Sharing Hub

Full document details: ASTM E2461-22

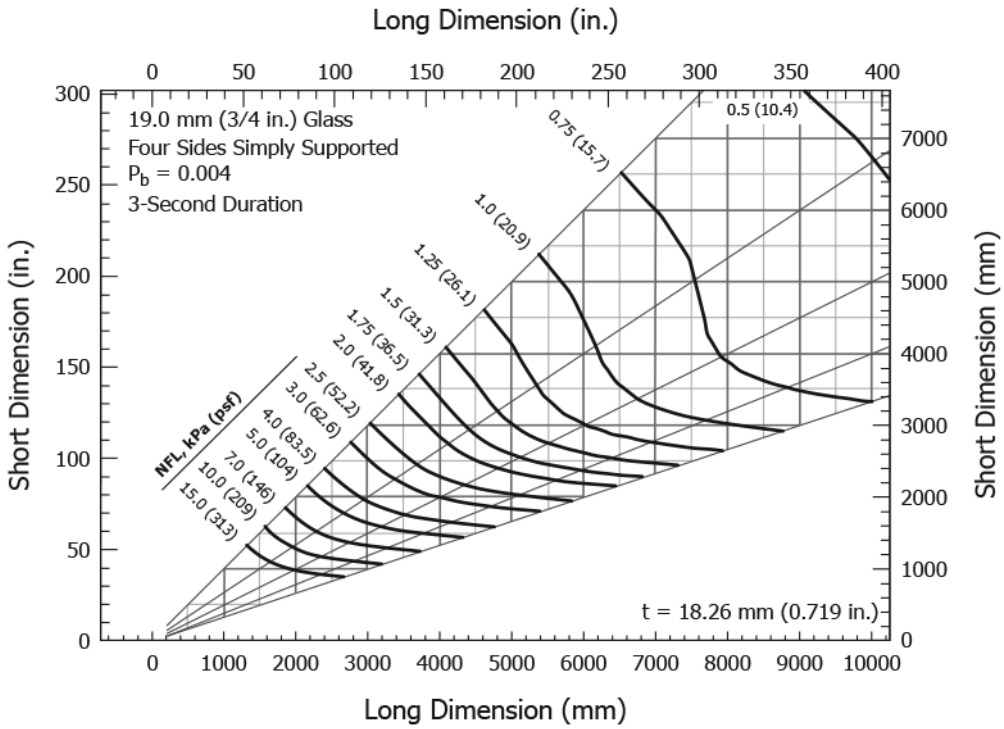

FIG. A1.14 Load Resistance Chart for 19 mm (¾ in.) Annealed Monolithic Glass Continuously Supported Along Four Sides (P_b = 0.004)

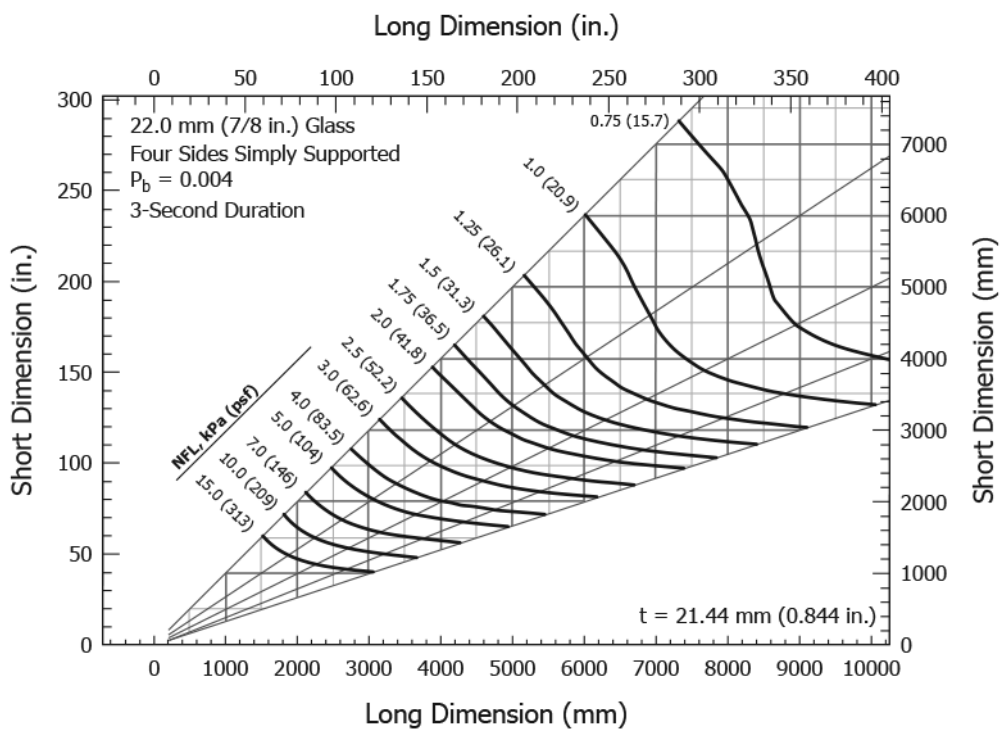

FIG. A1.15 Load Resistance Chart for 22 mm (⅞ in.) Annealed Monolithic Glass Continuously Supported Along Four Sides (P_b = 0.004)

Documents
Document Sharing Hub

Full document details: ASTM E2461-22

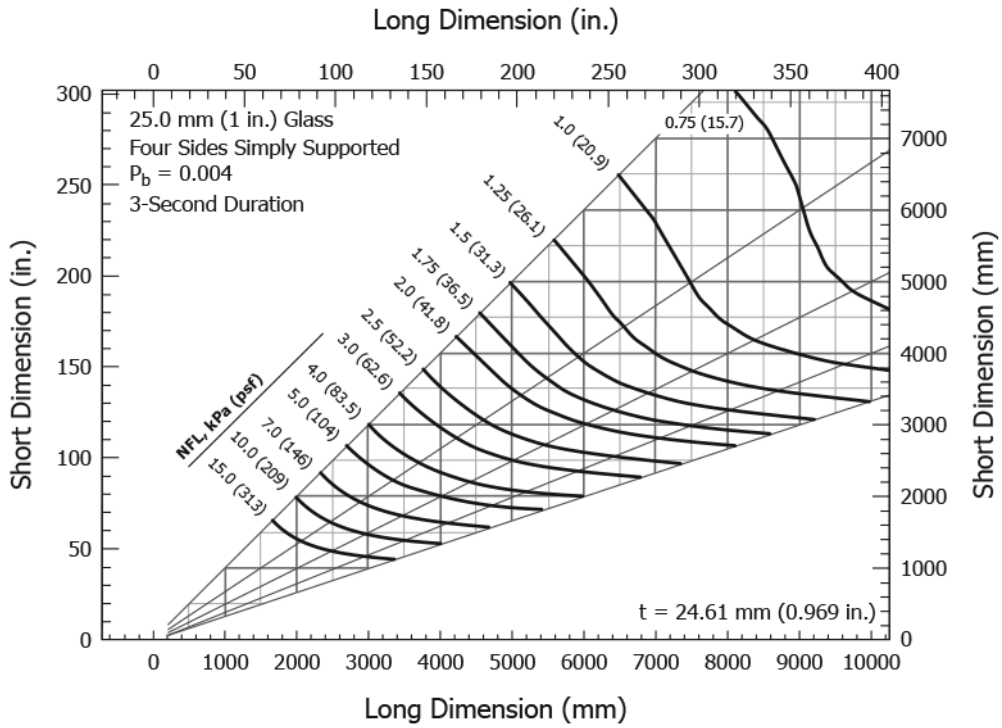

FIG. A1.16 Load Resistance Chart for 25 mm (1 in.) Annealed Monolithic Glass Continuously Supported Along Four Sides (P_b = 0.004)

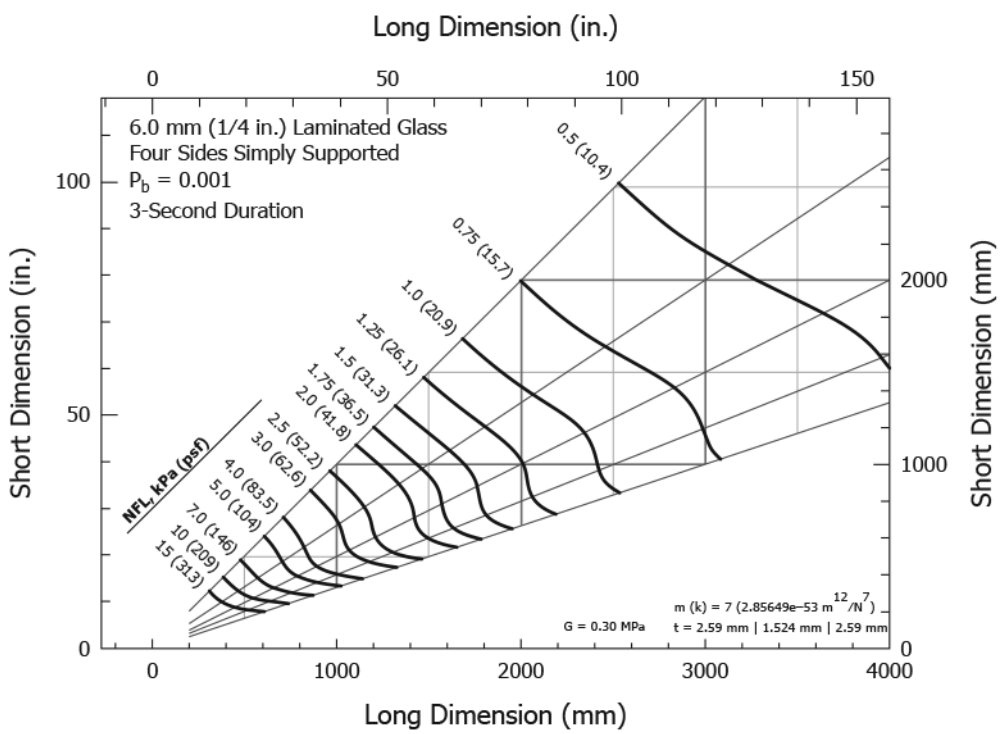

FIG. A1.17 a Load Resistance Chart for 6 mm (¼ in.) Annealed Laminated Glass Continuously Supported Along Four Sides (P_b = 0.001)

Documents
Document Sharing Hub

Full document details: ASTM E2461-22

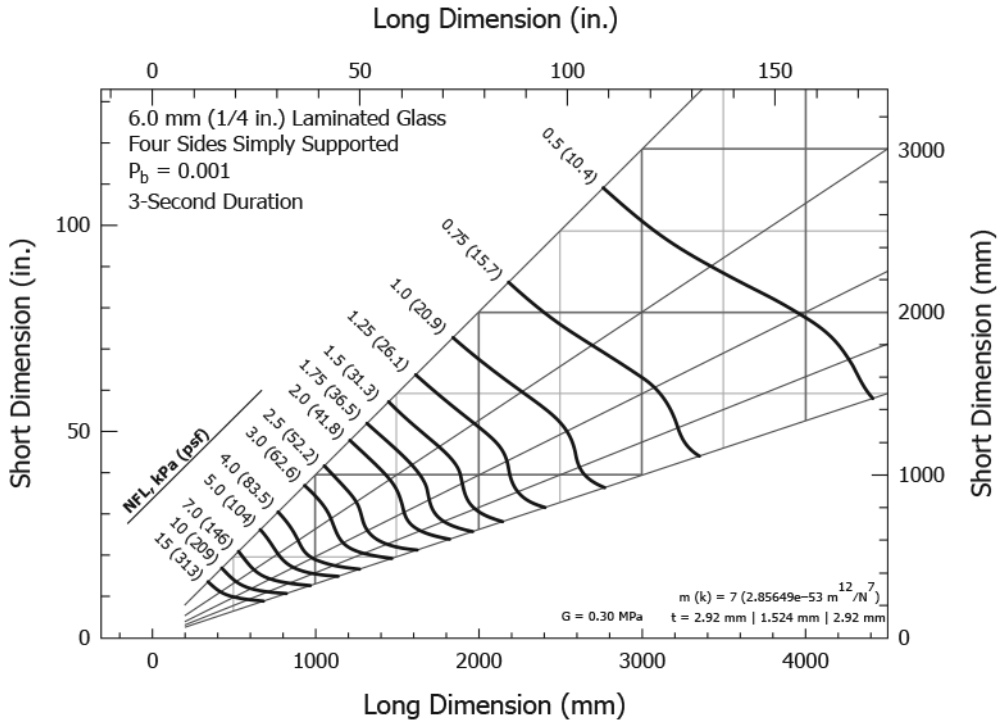

FIG. A1.17 b Load Resistance Chart for 6 mm (¼ in.) Annealed Laminated Glass Continuously Supported Along Four Sides (P_b = 0.001) *(continued)*

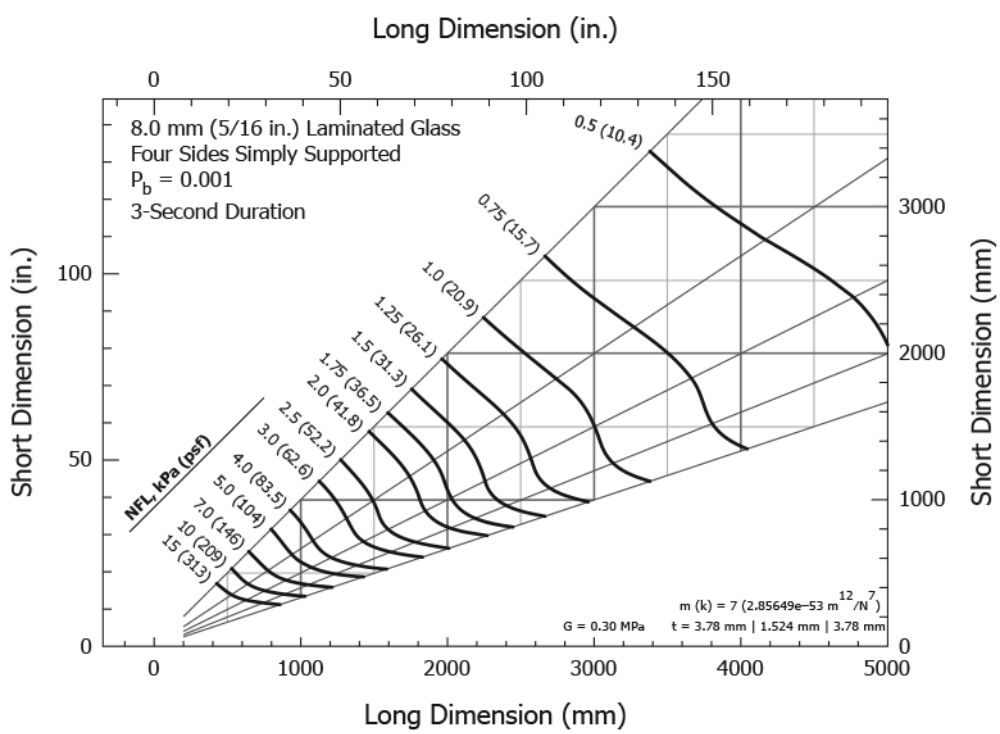

FIG. A1.18 Load Resistance Chart for 8 mm (5⁄16 in.) Annealed Laminated Glass Continuously Supported Along Four Sides (P_b = 0.001)

Documents
Document Sharing Hub
Full document details: ASTM E2461-22

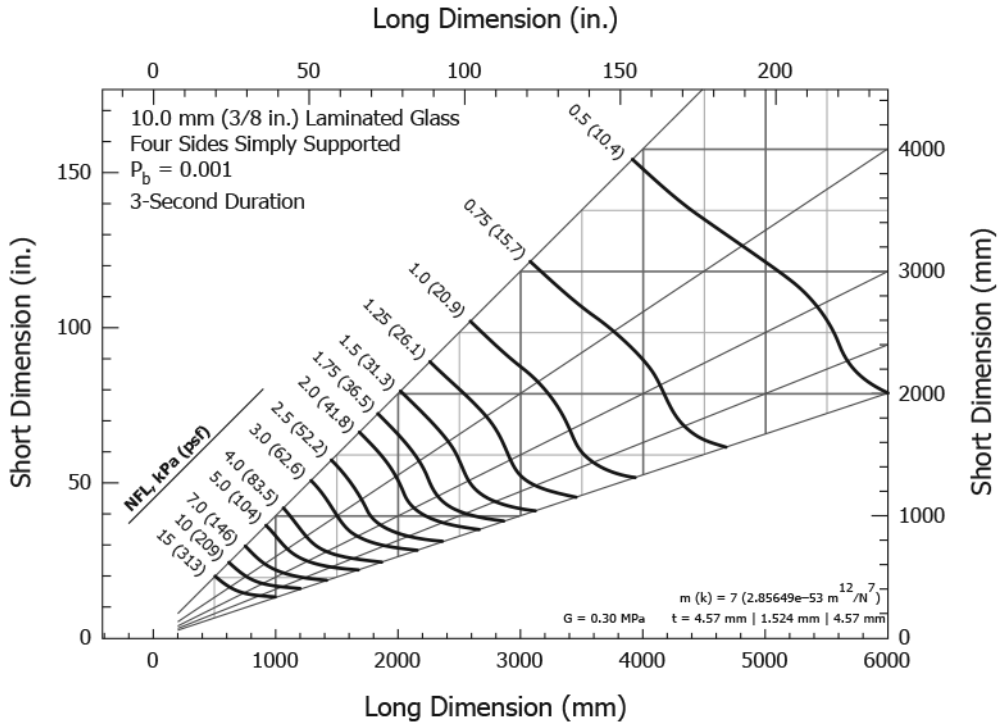

FIG. A1.19 Load Resistance Chart for 10 mm (⅜ in.) Annealed Laminated Glass Continuously Supported Along Four Sides (P_b = 0.001)

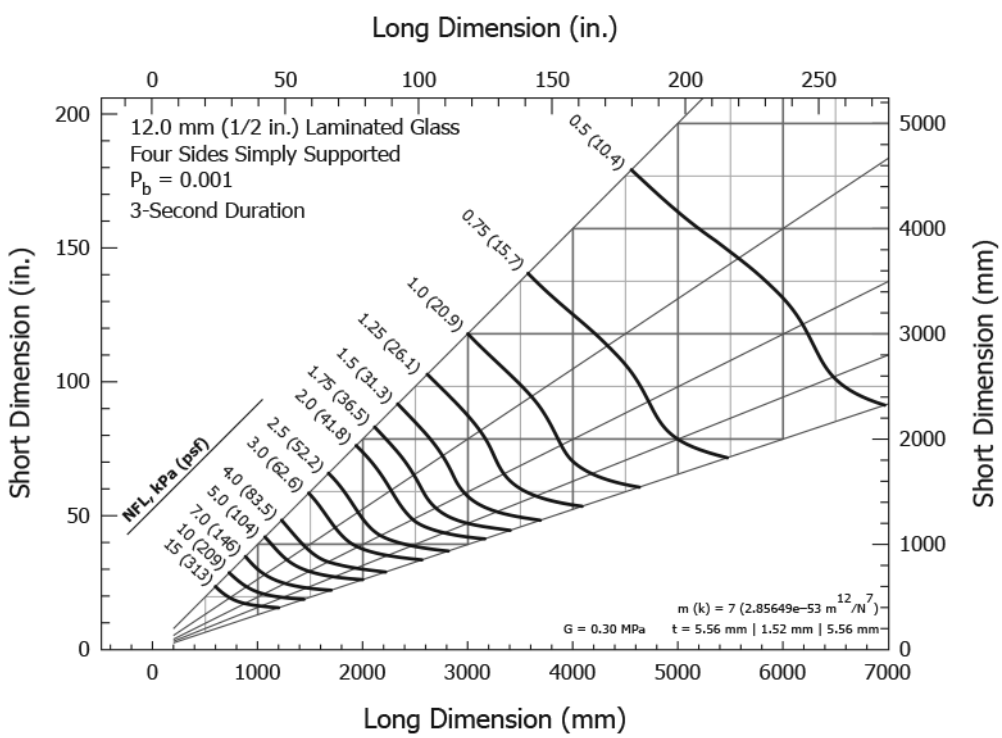

FIG. A1.20 Load Resistance Chart for 12 mm (½ in.) Annealed Laminated Glass Continuously Supported Along Four Sides (P_b = 0.001)

Documents
Document Sharing Hub
Full document details: ASTM E2461-22

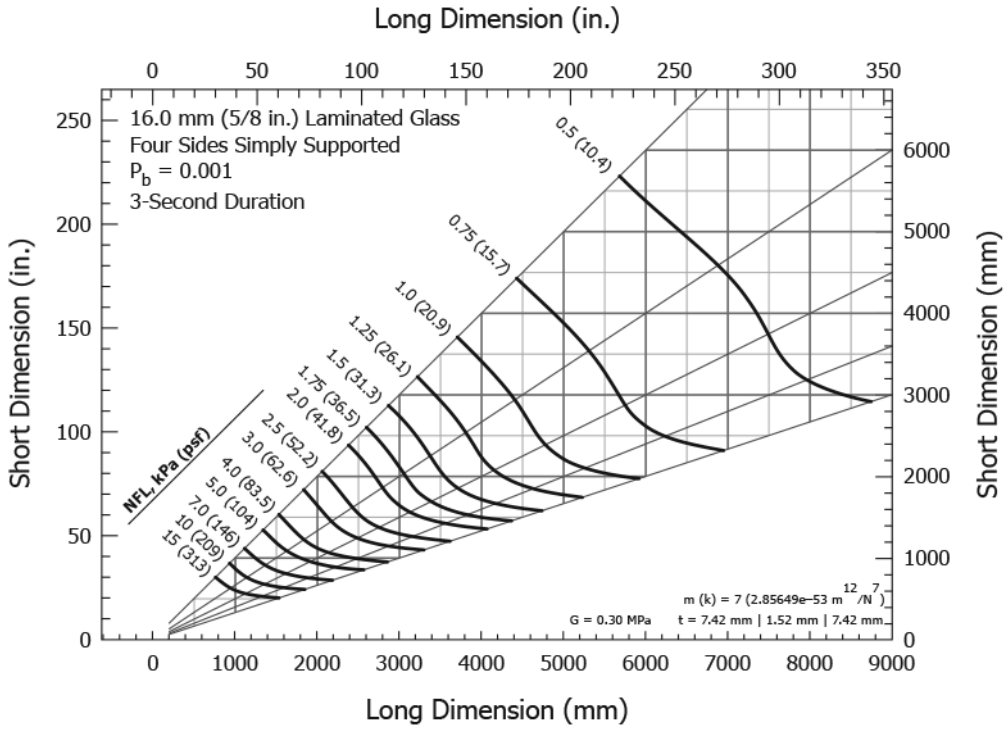

FIG. A1.21 Load Resistance Chart for 16 mm (⅝ in.) Annealed Laminated Glass Continuously Supported Along Four Sides (P_b = 0.001)

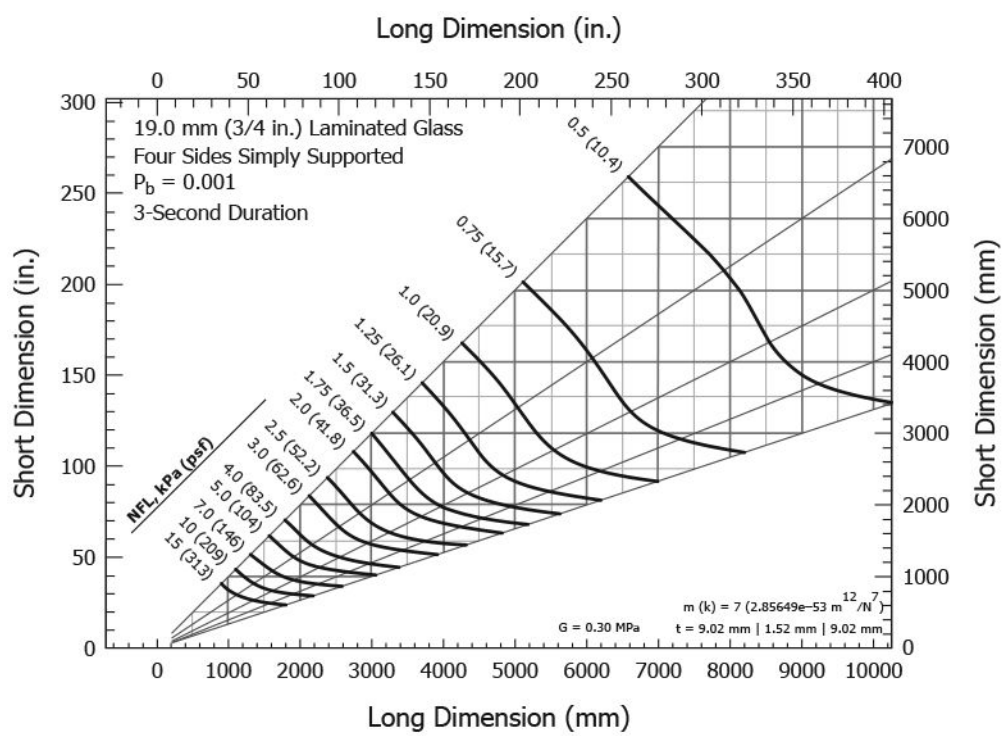

FIG. A1.22 Load Resistance Chart for 19 mm (¾ in.) Annealed Laminated Glass Continuously Supported Along Four Sides (P_b = 0.001)

AVA Documents
Document Sharing Hub

Full document details: ASTM E2461-22

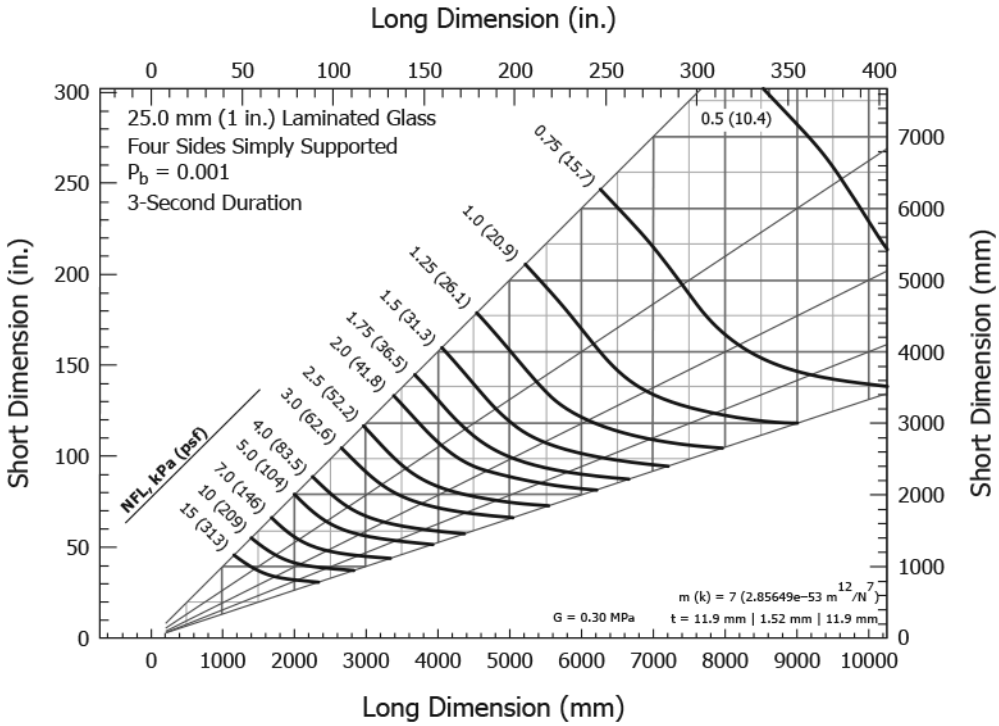

FIG. A1.23 Load Resistance Chart for 25 mm (1 in.) Annealed Laminated Glass Continuously Supported Along Four Sides (P_b = 0.001)

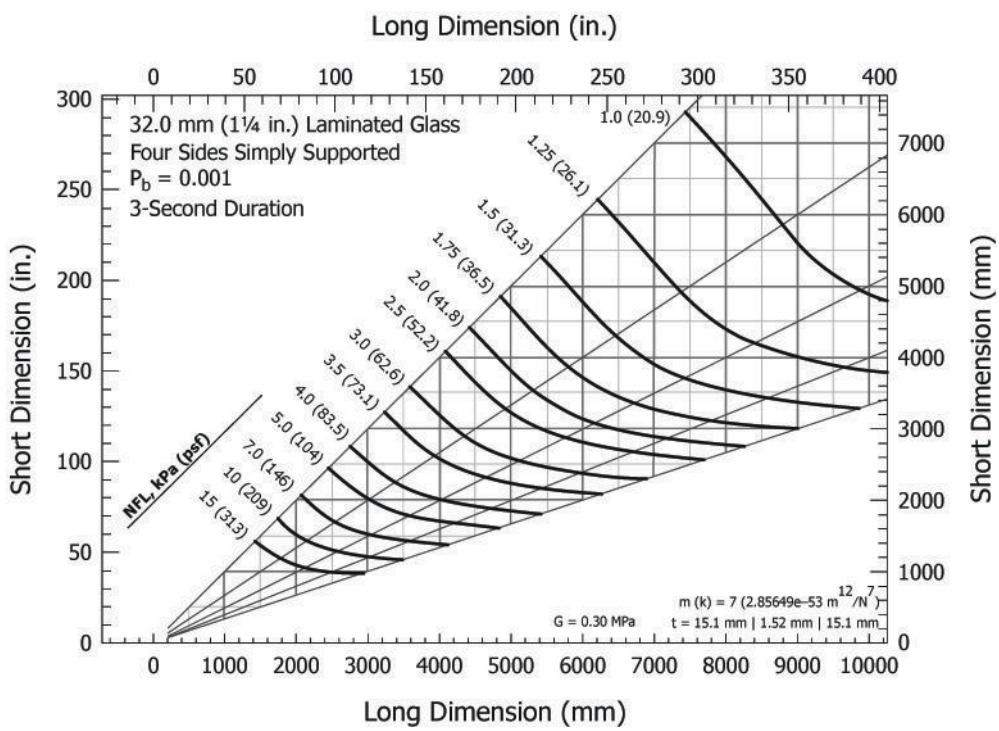

FIG. A1.24 Load Resistance Chart for 32 mm (1¼ in.) Annealed Laminated Glass Continuously Supported Along Four Sides (P_b = 0.001)

Documents
Document Sharing Hub

Full document details: ASTM E2461-22

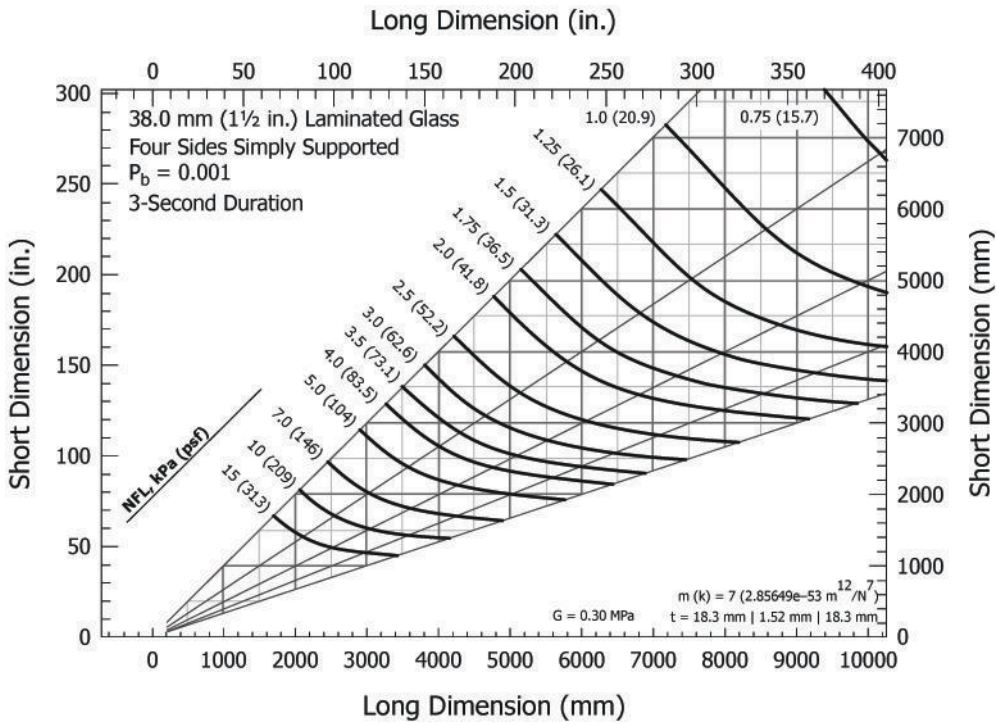

FIG. A1.25 Load Resistance Chart for 38 mm (1½ in.) Annealed Laminated Glass Continuously Supported Along Four Sides (P_b = 0.001)

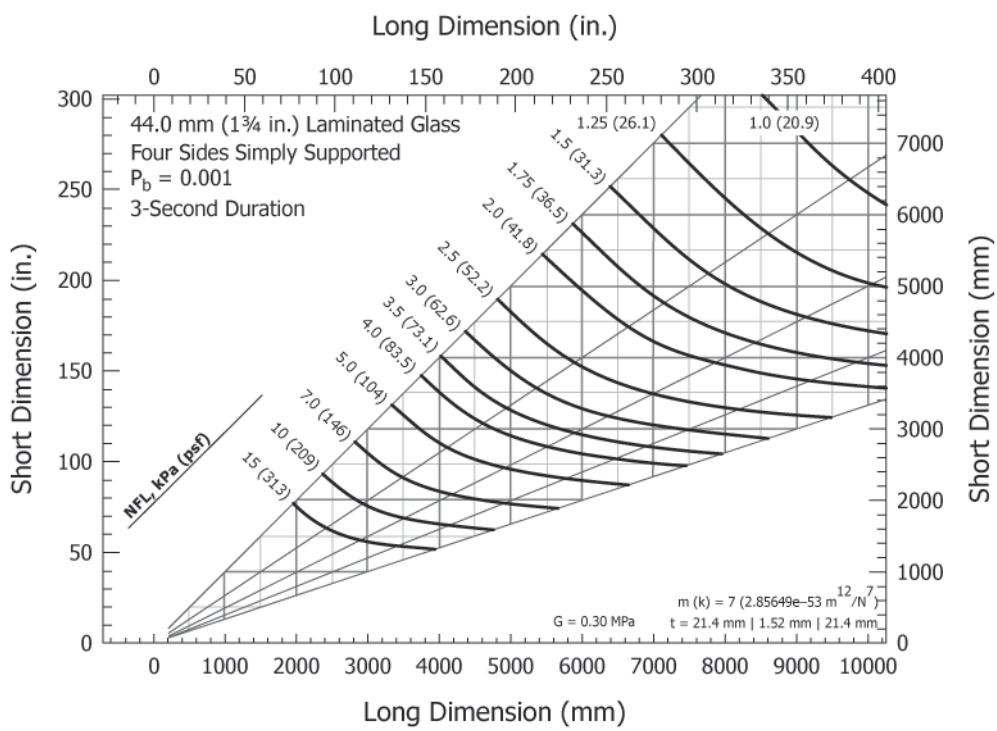

FIG. A1.26 Load Resistance Chart for 44 mm (1¾ in.) Annealed Laminated Glass Continuously Supported Along Four Sides (P_b = 0.001)

AVA Documents
Document Sharing Hub

Full document details: ASTM E2461-22

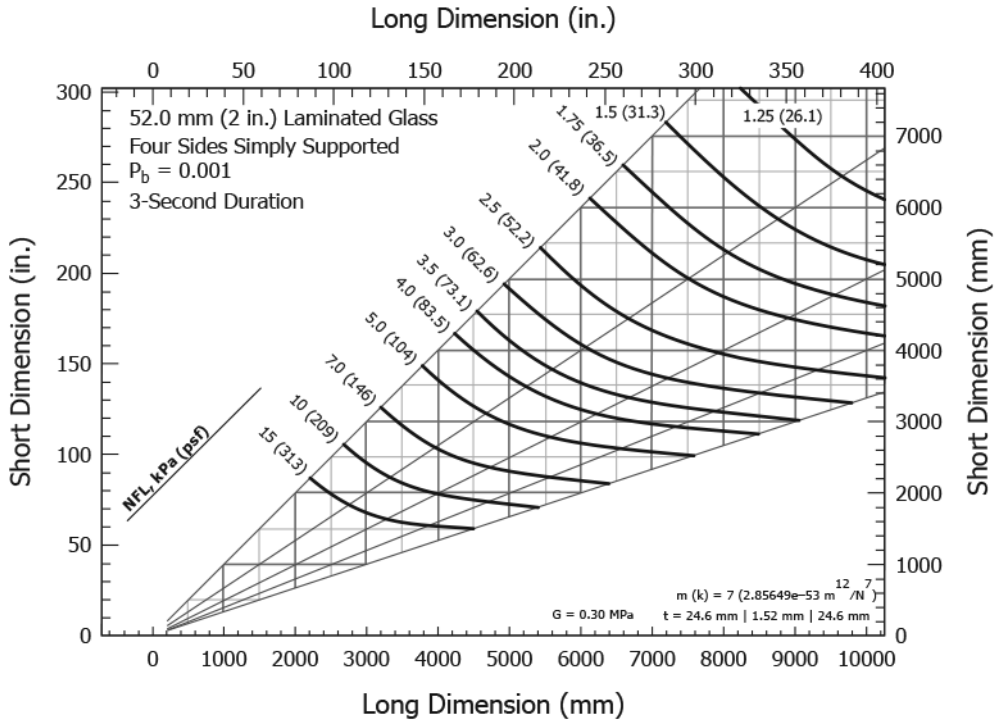

FIG. A1.27 Load Resistance Chart for 52 mm (2 in.) Annealed Laminated Glass Continuously Supported Along Four Sides (P_b = 0.001)

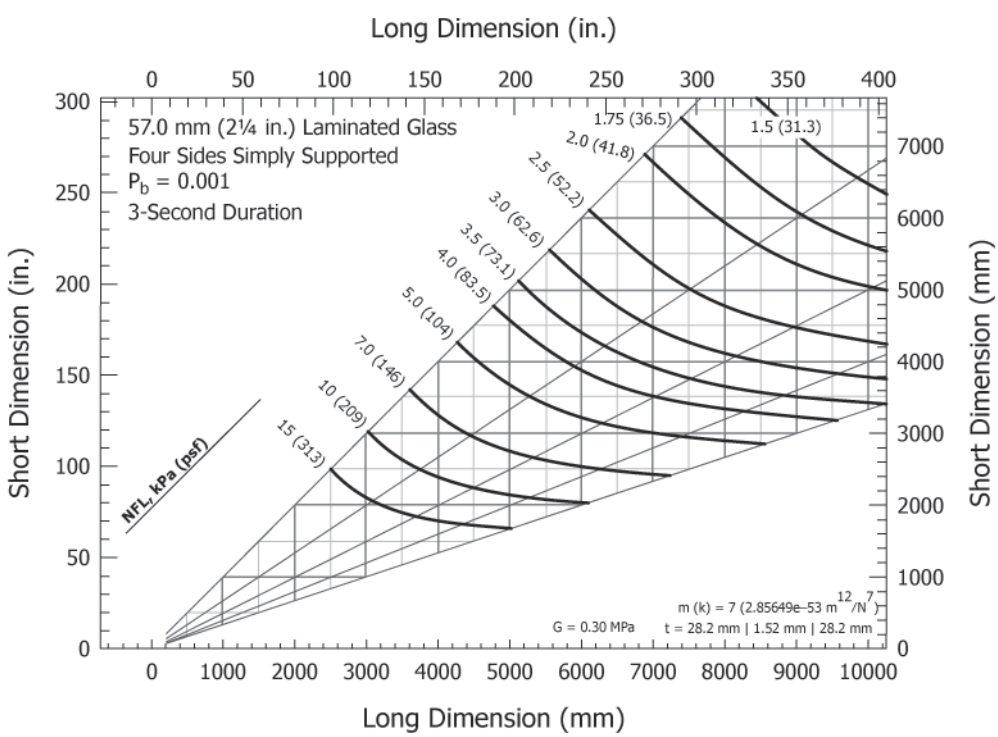

FIG. A1.28 Load Resistance Chart for 57 mm (2¼ in.) Annealed Laminated Glass Continuously Supported Along Four Sides (P_b = 0.001)

AVA Documents
Document Sharing Hub

Full document details: ASTM E2461-22

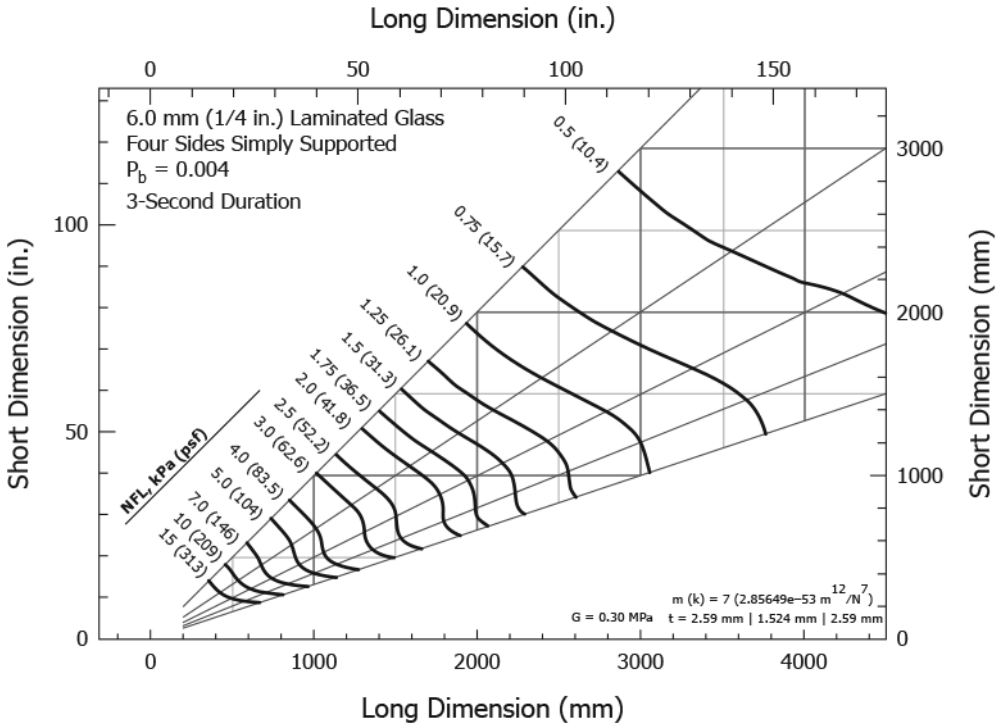

FIG. A1.29 a Load Resistance Chart for 6 mm (¼ in.) Annealed Laminated Glass Continuously Supported Along Four Sides (P_b = 0.004)

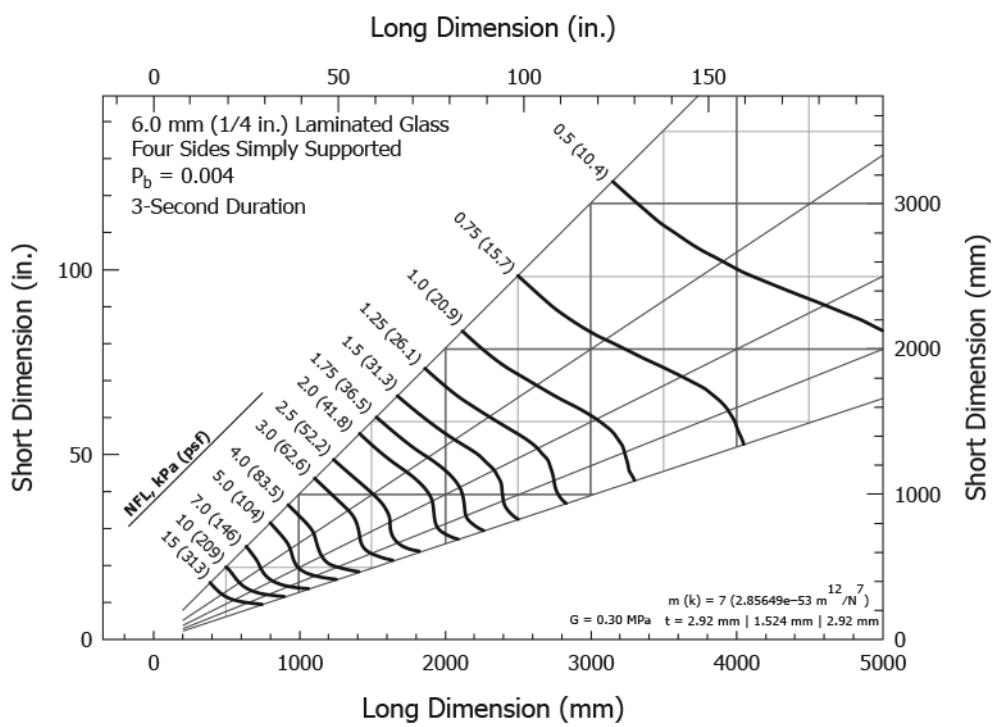

FIG. A1.29 b Load Resistance Chart for 6 mm (¼ in.) Annealed Laminated Glass Continuously Supported Along Four Sides (P_b = 0.004) *(continued)*

Documents
Document Sharing Hub

Full document details: ASTM E2461-22

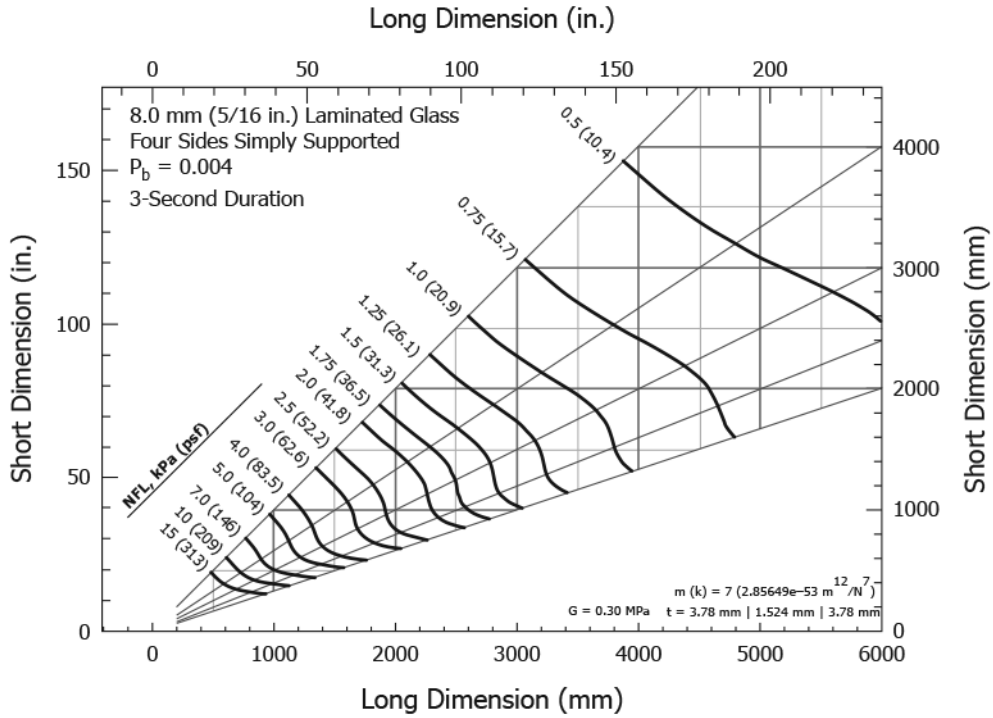

FIG. A1.30 Load Resistance Chart for 8 mm (5/16 in.) Annealed Laminated Glass Continuously Supported Along Four Sides (P_b = 0.004)

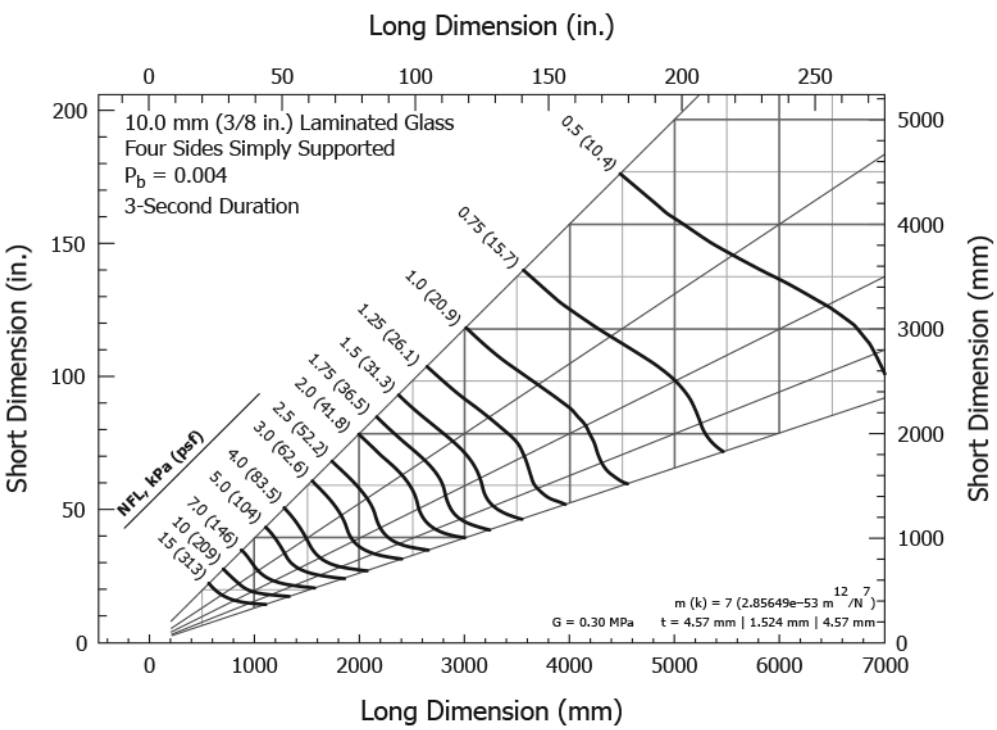

FIG. A1.31 Load Resistance Chart for 10 mm (3/8 in.) Annealed Laminated Glass Continuously Supported Along Four Sides (P_b = 0.004)

Documents
Document Sharing Hub
Full document details: ASTM E2461-22

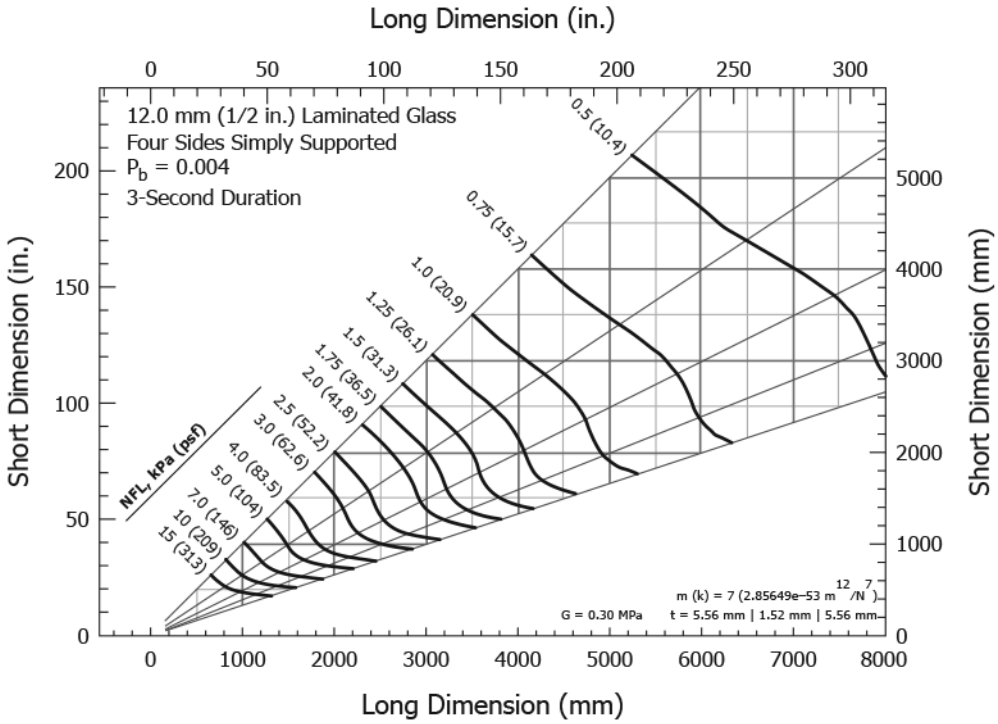

FIG. A1.32 Load Resistance Chart for 12 mm (½ in.) Annealed Laminated Glass Continuously Supported Along Four Sides (P_b = 0.004)

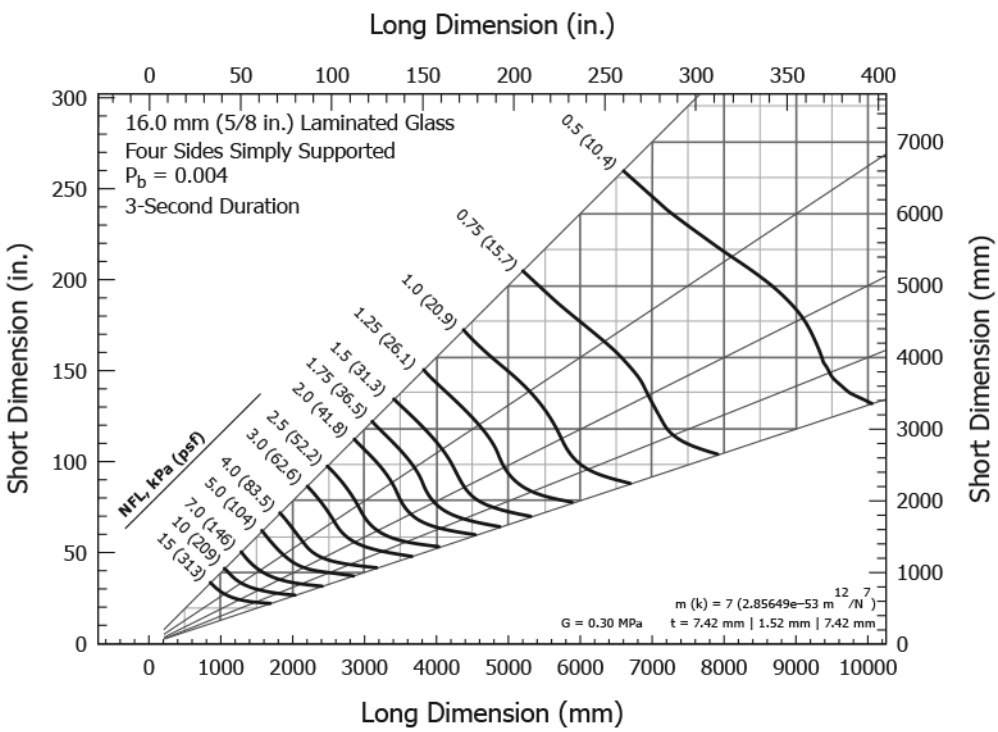

FIG. A1.33 Load Resistance Chart for 16 mm (⅝ in.) Annealed Laminated Glass Continuously Supported Along Four Sides (P_b = 0.004)

AVA Documents
Document Sharing Hub

Full document details: ASTM E2461-22

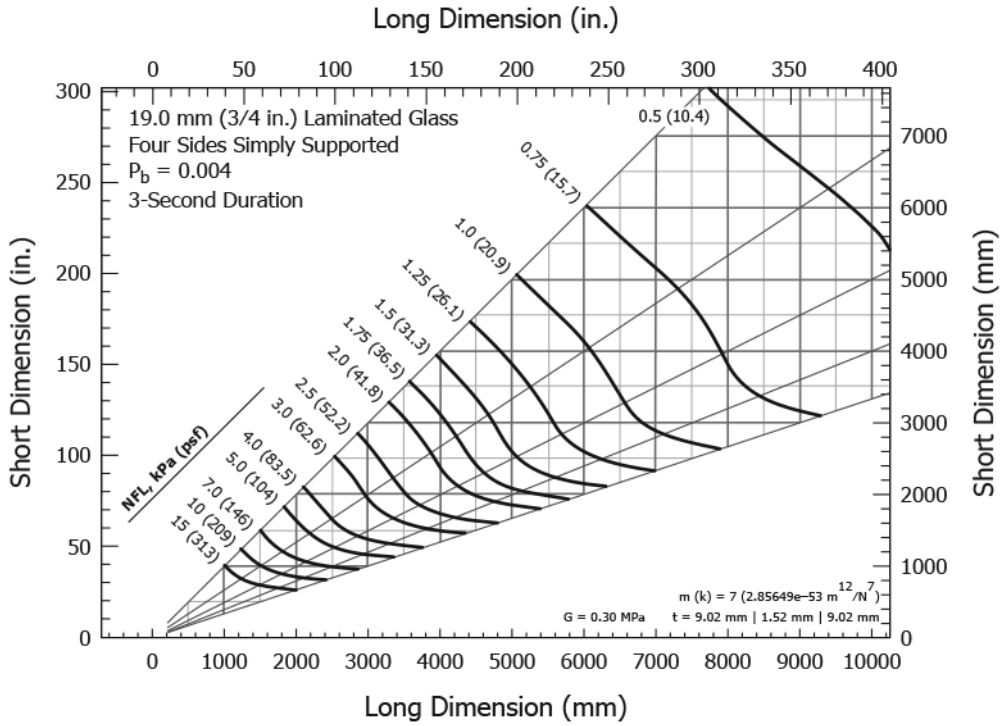

FIG. A1.34 Load Resistance Chart for 19 mm (¾ in.) Annealed Laminated Glass Continuously Supported Along Four Sides (P_b = 0.004)

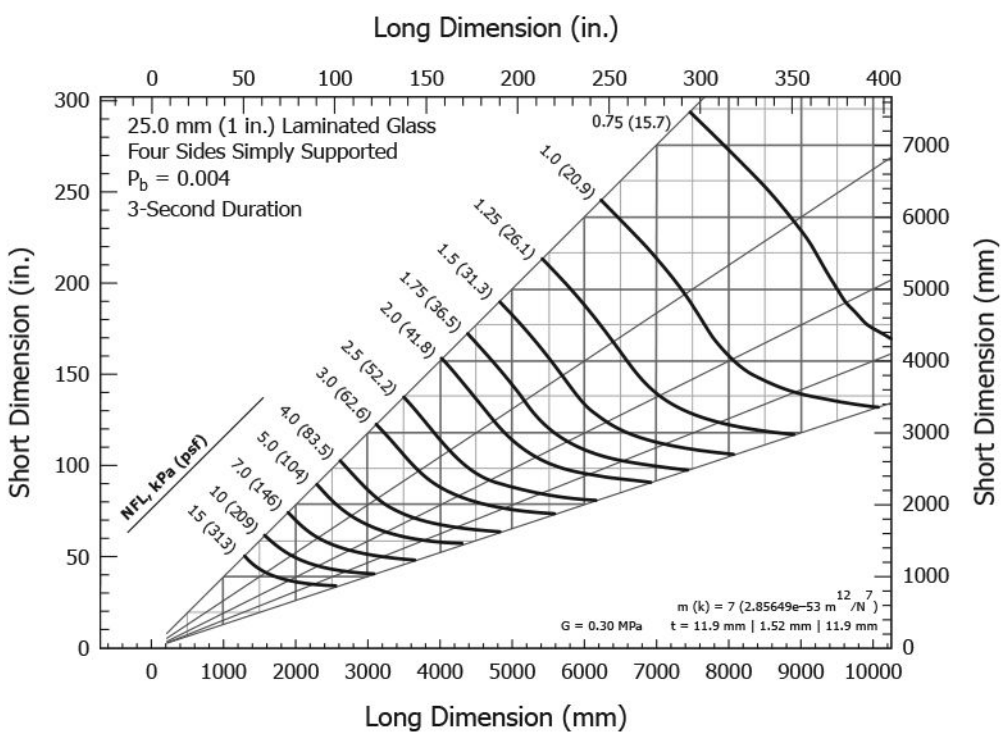

FIG. A1.35 Load Resistance Chart for 25 mm (1 in.) Annealed Laminated Glass Continuously Supported Along Four Sides (P_b = 0.004)

Documents
Document Sharing Hub
Full document details: ASTM E2461-22

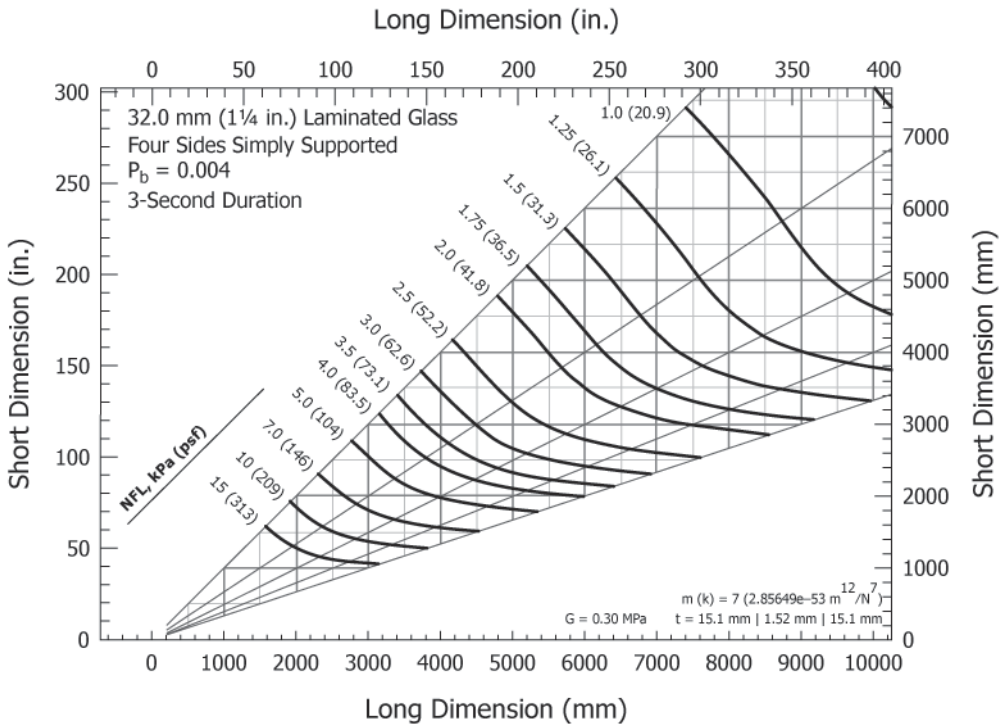

FIG. A1.36 Load Resistance Chart for 32 mm (1¼ in.) Annealed Laminated Glass Continuously Supported Along Four Sides (P_b = 0.004)

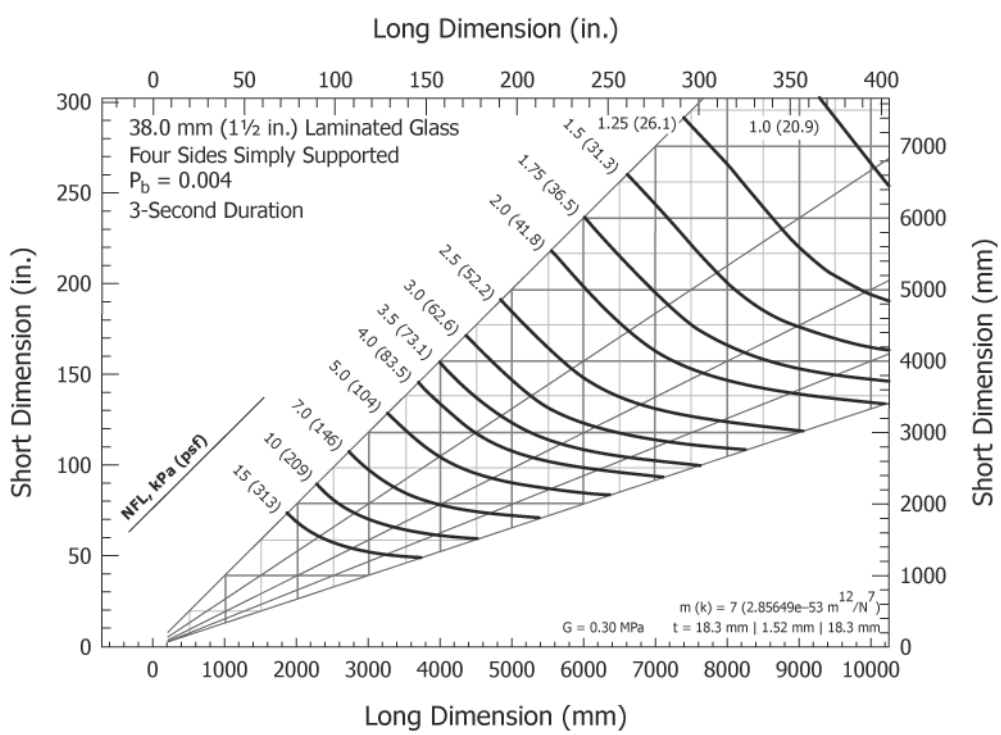

FIG. A1.37 Load Resistance Chart for 38 mm (1½ in.) Annealed Laminated Glass Continuously Supported Along Four Sides (P_b = 0.004)

Documents
Document Sharing Hub

Full document details: ASTM E2461-22

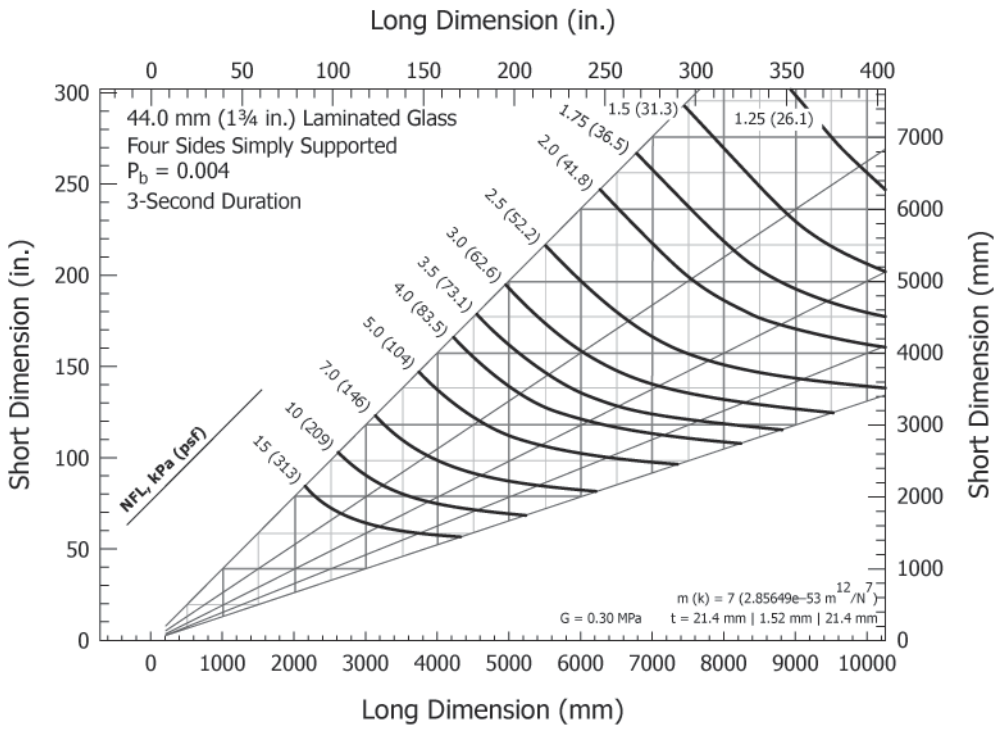

FIG. A1.38 Load Resistance Chart for 44 mm (1¾ in.) Annealed Laminated Glass Continuously Supported Along Four Sides (P_b = 0.004)

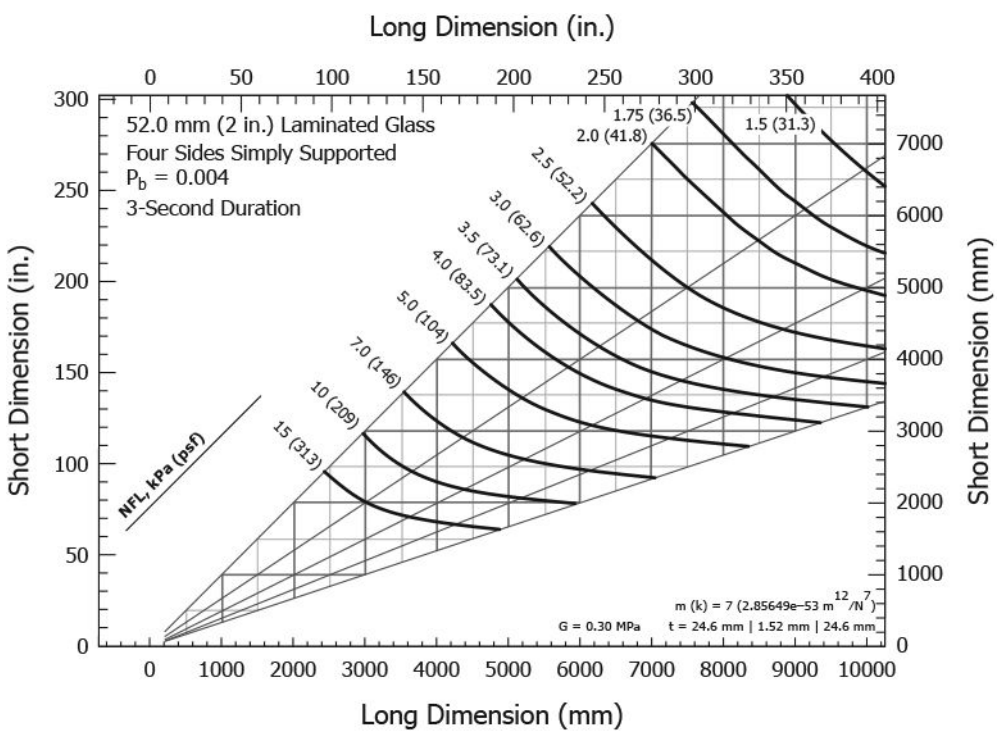

FIG. A1.39 Load Resistance Chart for 52 mm (2 in.) Annealed Laminated Glass Continuously Supported Along Four Sides (P_b = 0.004)

AVA Documents
Document Sharing Hub

Full document details: ASTM E2461-22

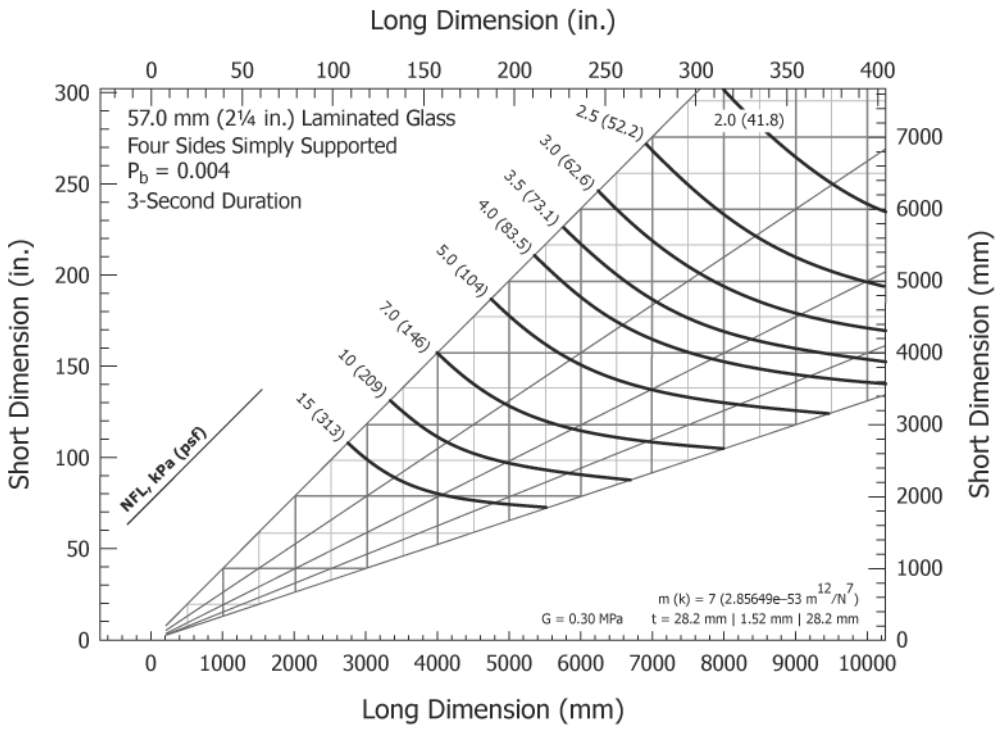

FIG. A1.40 Load Resistance Chart for 57 mm (2¼ in.) Annealed Laminated Glass Continuously Supported Along Four Sides (P_b = 0.004)

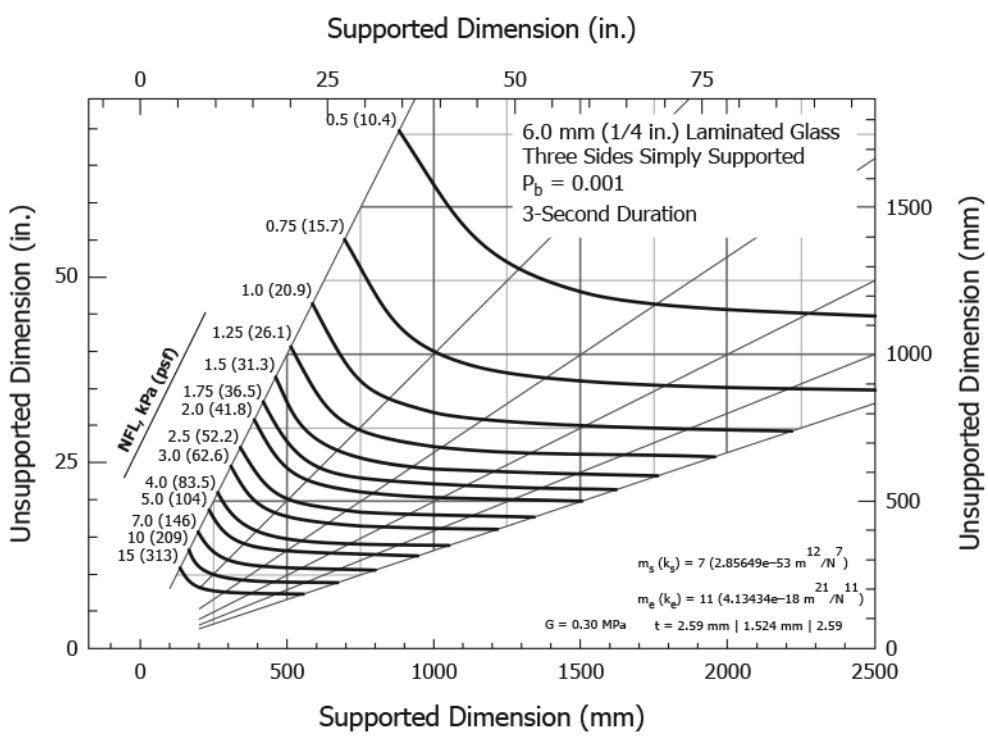

FIG. A1.41 Load Resistance Chart for 6 mm (¼ in.) Annealed Monolithic Glass Continuously Supported Along Three Sides (P_b = 0.001)

Documents
Document Sharing Hub
Full document details: ASTM E2461-22

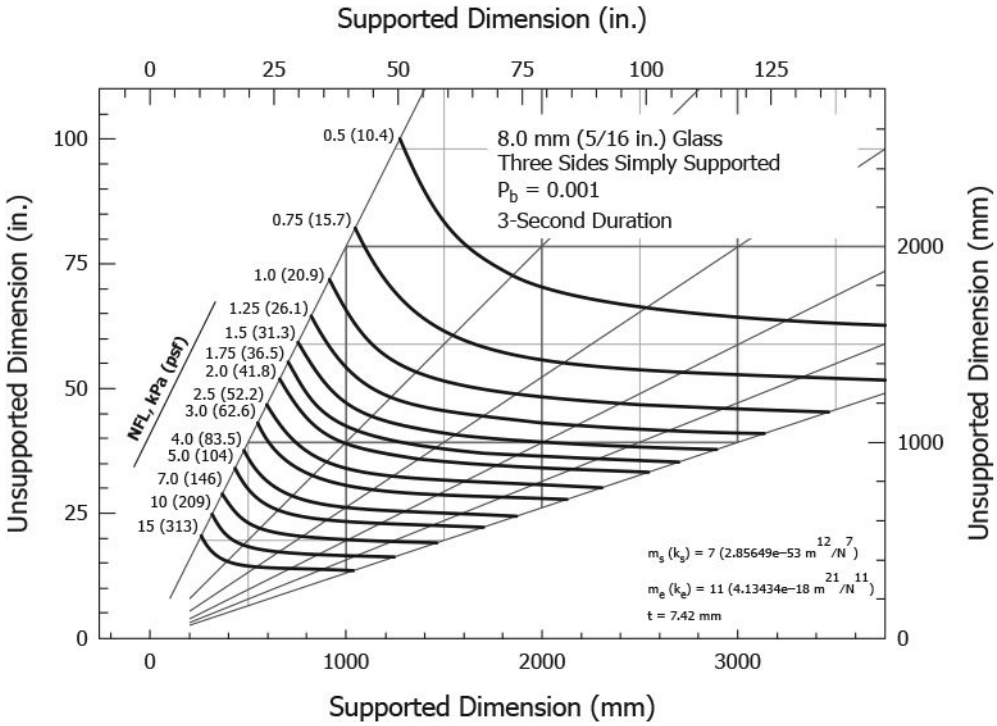

FIG. A1.42 Load Resistance Chart for 8 mm (5⁄16 in.) Annealed Monolithic Glass Continuously Supported Along Three Sides (P_b = 0.001)

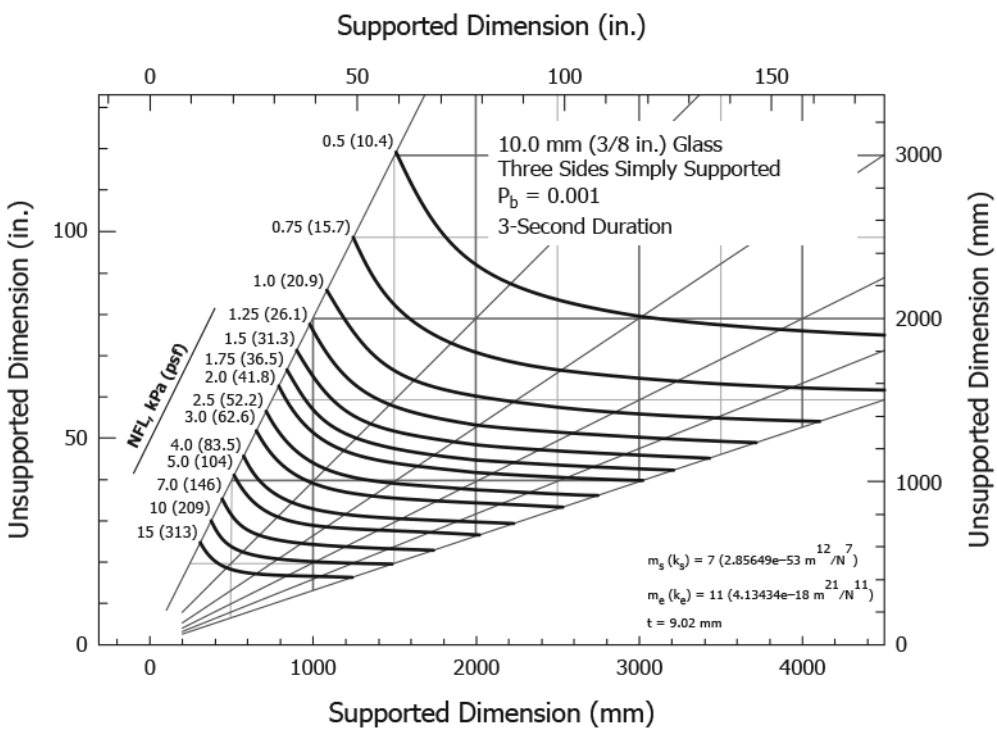

FIG. A1.43 Load Resistance Chart for 10 mm (3⁄8 in.) Annealed Monolithic Glass Continuously Supported Along Three Sides (P_b = 0.001)

Documents
Document Sharing Hub

Full document details: ASTM E2461-22

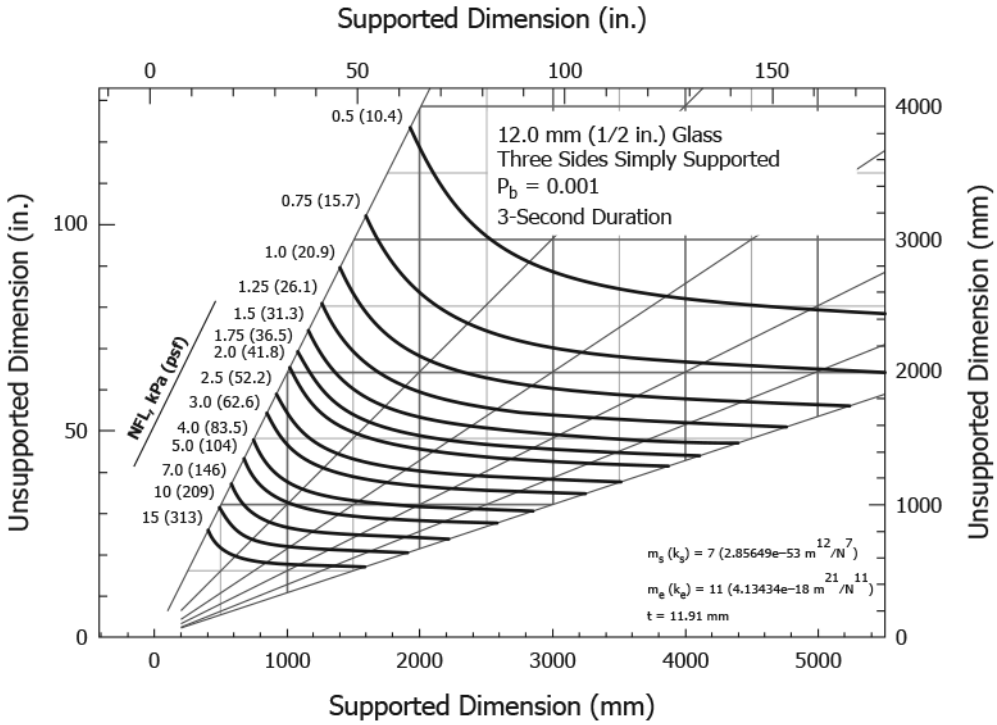

FIG. A1.44 Load Resistance Chart for 12 mm (½ in.) Annealed Monolithic Glass Continuously Supported Along Three Sides (P_b = 0.001)

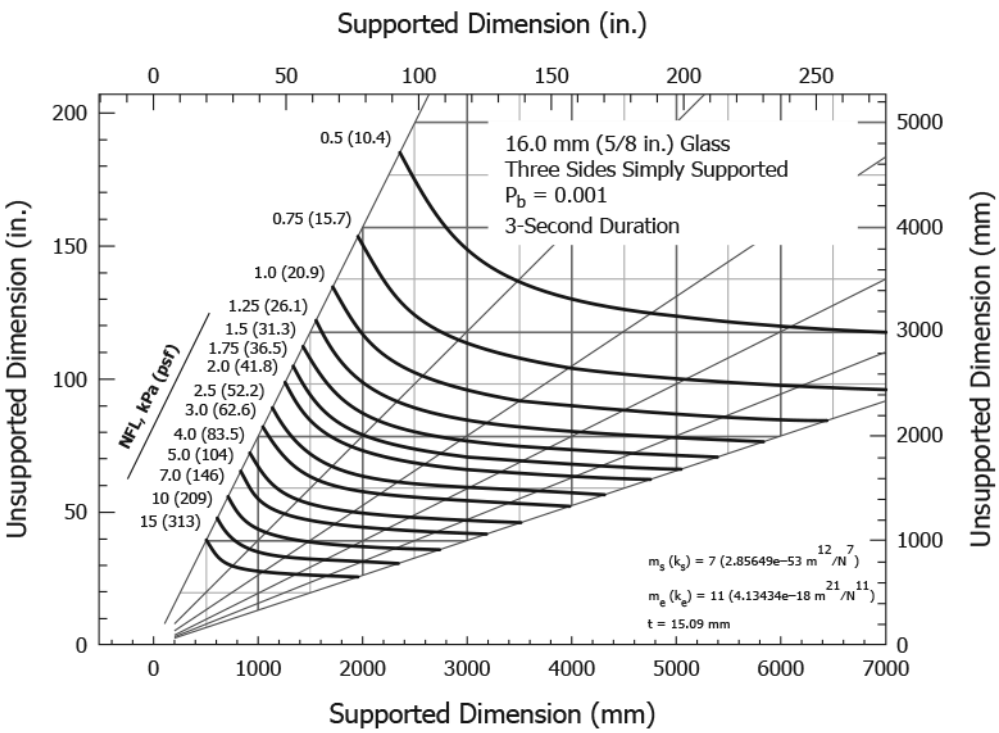

FIG. A1.45 Load Resistance Chart for 16 mm (⅝ in.) Annealed Monolithic Glass Continuously Supported Along Three Sides (P_b = 0.001)

Documents
Document Sharing Hub

Full document details: ASTM E2461-22

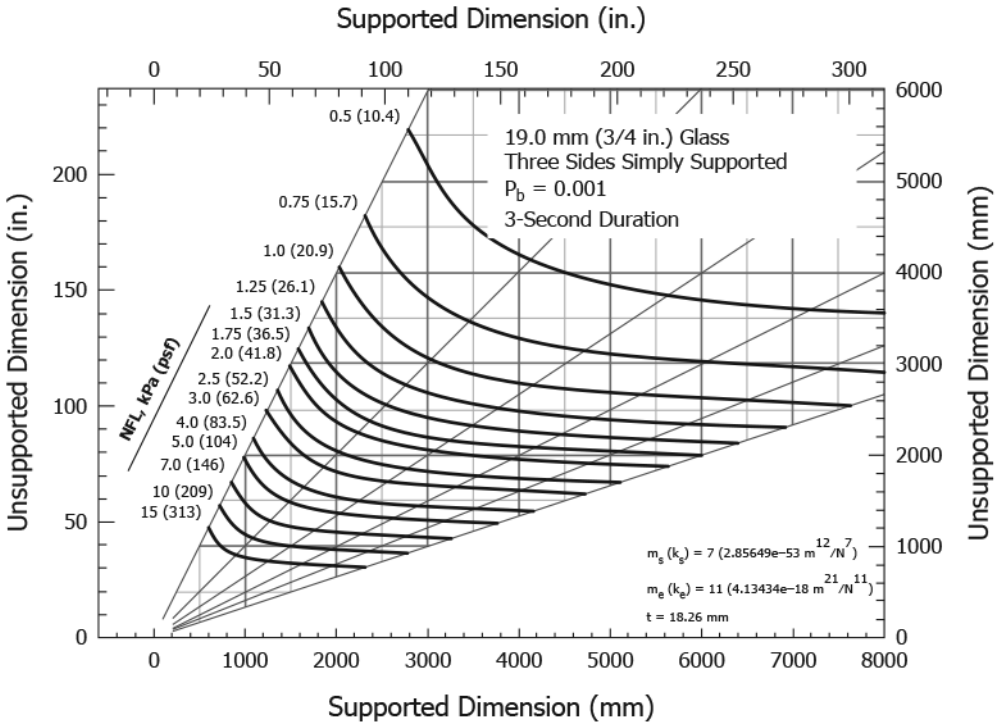

FIG. A1.46 Load Resistance Chart for 19 mm (¾ in.) Annealed Monolithic Glass Continuously Supported Along Three Sides (P_b = 0.001)

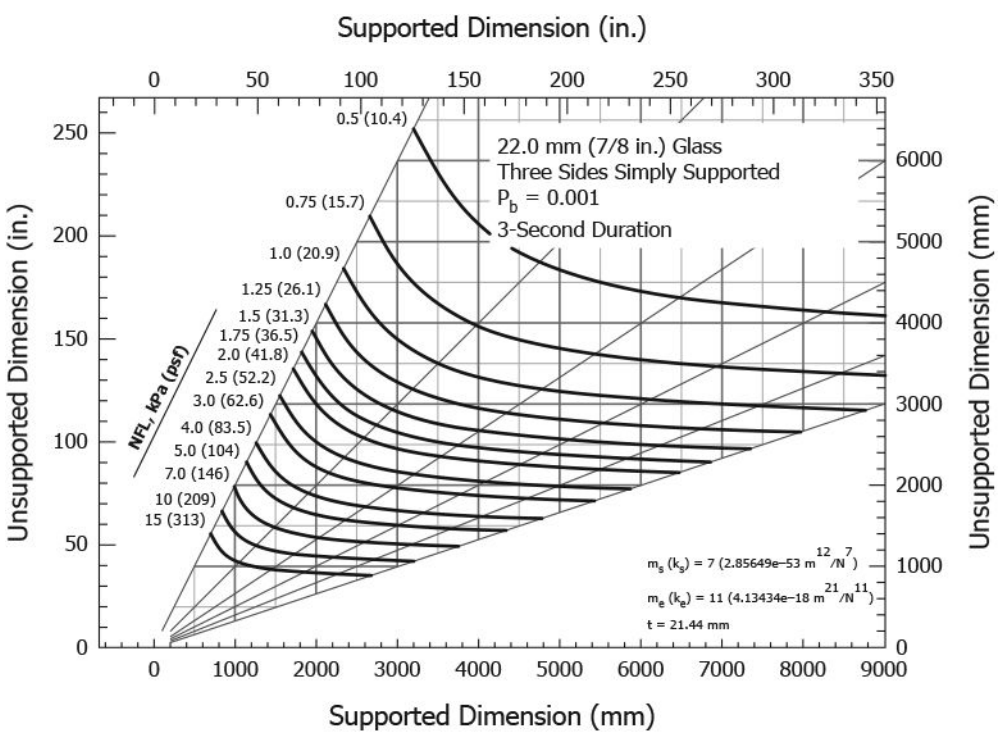

FIG. A1.47 Load Resistance Chart for 22 mm (⅞ in.) Annealed Monolithic Glass Continuously Supported Along Three Sides (P_b = 0.001)

Documents
Document Sharing Hub

Full document details: ASTM E2461-22

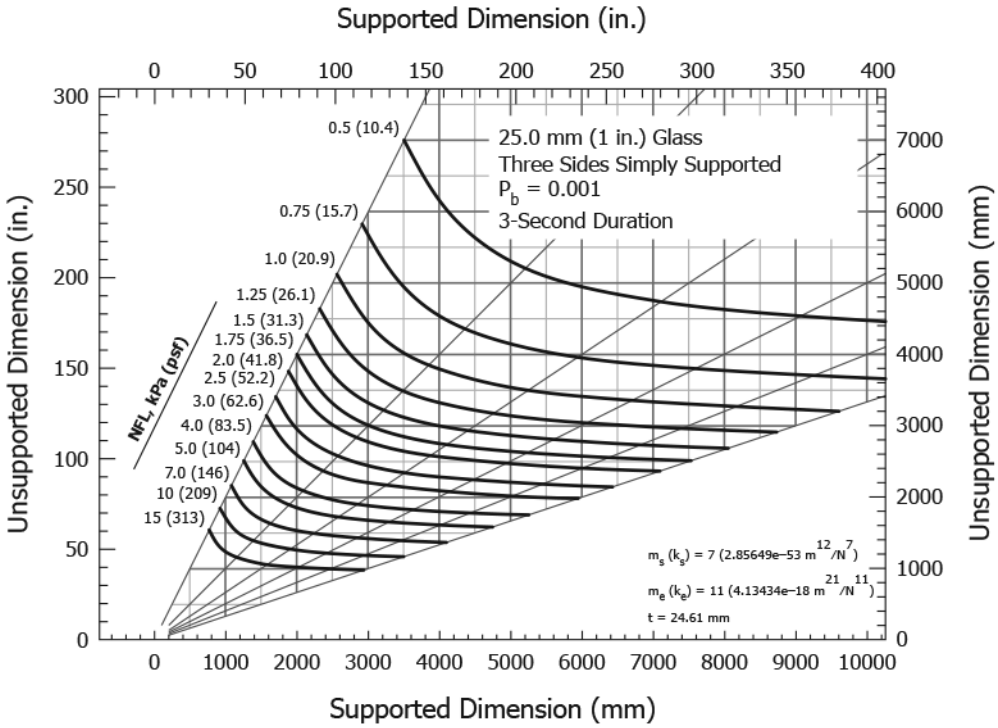

FIG. A1.48 Load Resistance Chart for 25 mm (1 in.) Annealed Monolithic Glass Continuously Supported Along Three Sides (P_b = 0.001)

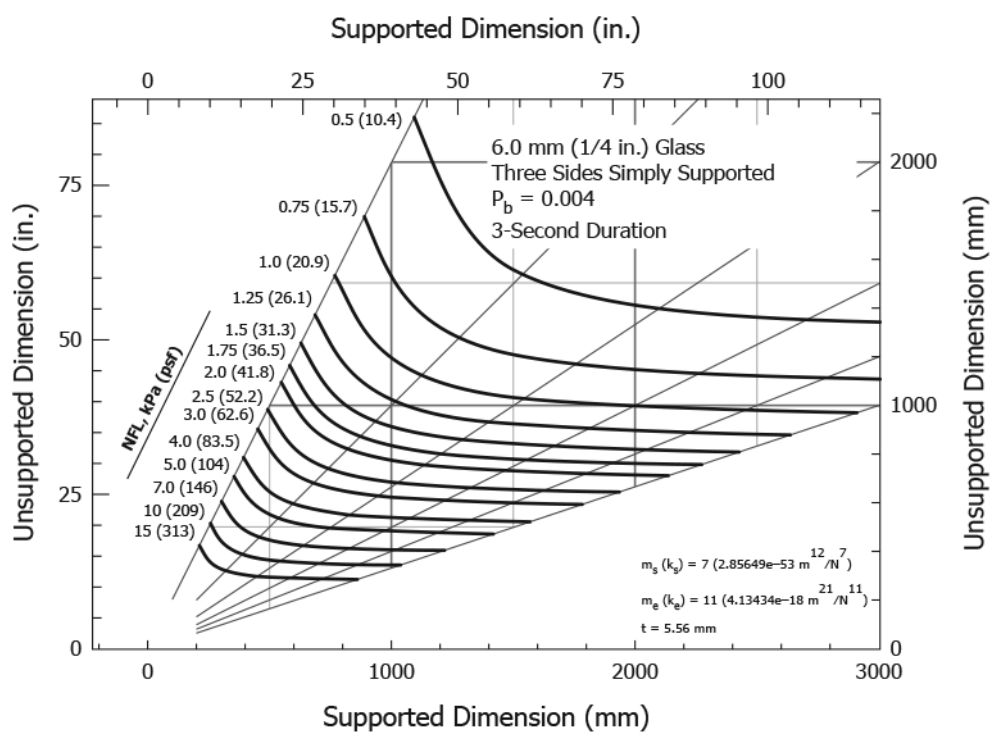

FIG. A1.49 Load Resistance Chart for 6 mm (¼ in.) Annealed Monolithic Glass Continuously Supported Along Three Sides (P_b = 0.004)

Documents
Document Sharing Hub

Full document details: ASTM E2461-22