

Characterization of air quality —

Part 4: Stationary source emissions —

Section 4.3 Method for the manual gravimetric determination of concentration and mass flow rate of particulate material in gas-carrying ducts

UDC 614.715:543.275.3

NO COPYING WITHOUT BSI PERMISSION EXCEPT AS PERMITTED BY COPYRIGHT LAW

BSI
Documents

AVA

Document Sharing Hub

Committees responsible for this British Standard

The preparation of this British Standard was entrusted by the Environment and Pollution Standards Policy Committee (EPC/-) to Technical Committee EPC/44, upon which the following bodies were represented:

- Association of Consulting Scientists
- British Cement Association
- British Coal Corporation
- British Gas plc
- British Steel plc
- Department of Health
- Department of the Environment (Her Majesty's Inspectorate of Pollution)
- Department of Trade and Industry (Laboratory of the Government Chemist)
- Department of Trade and Industry (Warren Spring Laboratory)
- European Resin Manufacturer's Association
- GAMBICA (BEAMA Ltd.)
- Health and Safety Executive
- Institute of Petroleum
- Institution of Environmental Health Officers
- Institution of Gas Engineers
- Lead Development Association
- National Society for Clean Air
- Royal Society of Chemistry

The following bodies were also represented in the drafting of the standard, through subcommittees and panels:

- Agricultural Development and Advisory Service
- Asbestos Information Centre Ltd.
- Asbestosis Research Council
- Electricity Supply Industry in England and Wales
- Filtration Society
- Institute of Energy
- Institute of Wastes Management
- Institution of Chemical Engineers

This British Standard, having been prepared under the direction of the Environment and Pollution Standards Policy Committee, was published under the authority of the Standards Board and comes into effect on 15 October 1992

© BSI 09-1999

The following BSI references relate to the work on this standard:
Committee reference EPC/44
Draft for comment 88/54980 DC

ISBN 0 580 21234 3

Amendments issued since publication

Amd. No.	Date	Comments

Contents

	Page
Committees responsible	Inside front cover
National foreword	iii
1 Scope	1
2 Normative reference	1
3 Definitions	1
4 Symbols with their corresponding units, subscripts and index	3
5 Principle	3
6 Summary of the method	3
7 Review of measurements and calculations	6
8 Apparatus	7
9 Advance preparations	13
10 Preparatory work before sampling	14
11 Sampling procedure	16
12 Weighing	18
13 Method of calculation	18
14 Accuracy	21
15 Test report	21
Annex A (normative) Factors affecting the accuracy of the method	22
Annex B (normative) Methods and rules for determining the position of sampling points in circular and rectangular ducts	22
Annex C (normative) Care and use of Pitot static tubes	24
Annex D (normative) Calibration of Pitot tubes	25
Annex E (normative) Recommendations regarding sampling locations not meeting the requirement of a straight duct length of seven duct diameters	26
Annex F (normative) Alternative method of determining the particulate mass flow rate in the duct	27
Annex G (informative) Bibliography	27
Figure 1 — Illustration of definitions in relation to a circular duct	2
Figure 2 — Isokinetic sampling	2
Figure 3 — Example of a measuring equipment arrangement (see 8.2), without water removal upstream of the gas metering device	5
Figure 4 — Example of a measuring equipment arrangement (see 8.2), with water removal upstream of the gas metering device	6
Figure 5 — Diagram of measurement and calculation, with water removal before measurement of gas sample volume	8
Figure 6 — Diagram of measurement and calculation, without water removal before measurement of gas sample volume	9
Figure 7 — Example of shape of the nozzle (1)	12
Figure B.1 — Sampling point positions in circular ducts — General rule (showing positions for ducts over 2 m in diameter)	23
Figure B.2 — Sampling point positions in circular ducts — Tangential rule (showing positions for ducts over 2 m in diameter)	23
Figure B.3 — Illustrations of sampling point positions in rectangular (and square) ducts	24
Figure D.1 — Schematic illustration of Pitot static tubes	26

	Page
Table 1 — Symbols and their corresponding units	4
Table 2 — Subscript and index	4
Table 3 — List of equipment parts	10
Table 4 — Minimum number of sampling points for circular ducts	15
Table 5 — Minimum number of sampling points for rectangular ducts	15
Table B.1 — Values of K_1 as a percentage — General rule for circular ducts	23
Table B.2 — Values of K_1 as a percentage — Tangential rule for circular ducts	24
Table E.1 — Minimum sampling location distances from obstacles	26
List of references	Inside back cover

National foreword

This Section of BS 6069 has been prepared under the direction of the Environment and Pollution Standards Policy Committee and is identical with ISO 9096:1992 *Stationary source emissions — Determination of concentration and mass flow rate of particulate material in gas-carrying ducts — Manual gravimetric method*. The International Standard was prepared by Technical Committee 146, Air quality, of the International Organization for Standardization (ISO) with the active participation and approval of the UK.

BS 6069 is being published in a series of Parts and Sections that will generally correspond to particular International Standards arising from the UK participation in the work of ISO/TC 146. This Section of BS 6069 is one of several relating to stationary source emissions that are being published as Sections of Part 4. Methods concerning workplace atmospheres are being published as Sections of Part 3 of BS 6069. Topics relating to other aspects of air quality characterization will be published as further Parts or Sections of BS 6069.

The following Parts of BS 6069 have already been published:

- *Part 1: Units of measurement;*
- *Part 2: Glossary.*

Methods for the determination of particular constituents of ambient air are being published as Parts of BS 1747 *Methods for the measurement of air pollution*.

Cross-reference

International Standard	Corresponding British Standard
ISO 3966:1977	BS 1042 <i>Measurement of fluid flow in closed conduits</i> Section 2.1:1983 <i>Method using Pitot static tubes</i> (Identical)

Textual errors. When adopting the text of the International Standard, the following textual errors were discovered. They have been marked in the text and have been reported to ISO in a proposal to amend the text of the International Standard.

In Figure 3 and Figure 4, reference to Table 1 should be to Table 3.

In equation B.1, “ n_d ”, should be read as, “ n_{dia} ” in equation B.2,

$$\sqrt{\frac{1-2i-1}{2n_r}} \text{ should be read as } \sqrt{1-\frac{(2i-1)}{2n_r}}$$

In the keys to equations B.1 and B.2 the text “ i is the number of individual points along the diameter;” should be read as “ i is the individual position on the sampling line, i.e. i varies between 1 and n (see Table 1).”

A British Standard does not purport to include all the necessary provisions of a contract. Users of British Standards are responsible for their correct application.

Compliance with a British Standard does not of itself confer immunity from legal obligations.

Summary of pages

This document comprises a front cover, an inside front cover, pages i to iv, pages 1 to 28, an inside back cover and a back cover.

This standard has been updated (see copyright date) and may have had amendments incorporated. This will be indicated in the amendment table on the inside front cover.

WARNING — SAFETY PRECAUTIONS

GENERAL

Sampling operations may involve a variety of hazards depending on the circumstances. All those concerned, e.g. management, sampling operators and control authorities, shall consider the likely hazards adequately beforehand.

If hazards cannot be eliminated, it will be necessary to make appropriate safety arrangements with regard to any specific local, national or international regulations before sampling operations commence.

The hazards most likely to be encountered and the means of reducing them include those described below.

On every occasion, plant management and plant operators should be aware that sampling operations are taking place. Management should consider what appropriate safety procedures, e.g. work permits, should be adopted and ensure that they are understood by all those likely to be concerned.

HAZARDS TO SAMPLING OPERATORS

- a) Working at heights or under conditions of difficult access — Consider a means of escape and the need for guard rails and base boards (see 9.5), warning systems, etc. Telecommunication will be desirable at remote locations. It is recommended that operators do not work alone.
- b) Exposure to toxic, corrosive or hot gases or dusts from the access ports or from elsewhere in the processing plant — Consider circumstances, monitoring or warning systems, personal protective equipment, etc.
- c) Electrical hazards, from electrical equipment or electrostatic charge — Consider equipment protection, earthing, etc. (see 9.5).
- d) Noise and heat from the plant or equipment — Consider protective measures.
- e) Handling of heavy or bulky equipment — Consider lifting arrangements and accessibility of sampling location.

HAZARDS TO OTHER PERSONNEL

- a) Objects falling from the platform — Consider warning signs, barricading, etc.
- b) Presence of temporary equipment, e.g. cables causing trip hazards — Consider warning signs etc.

HAZARDS TO PLANT

- a) Ignition of flammable gases — Consider using non-sparking equipment, etc.
- b) Equipment dropped into duct system — Take special care that sampling heads etc. cannot become detached.

1 Scope

This International Standard specifies a manual gravimetric method for the measurement of the concentration and mass flow rate of particulate matter in a moving gas stream in confined spaces such as ducts, chimneys and flues. This method can be used to determine concentrations ranging from $0,005 \text{ g/m}^3$ to 10 g/m^3 . For concentrations under $0,050 \text{ g/m}^3$, the inaccuracy of this method will be greater than $\pm 10 \%$ (see clauses 12 and 14).

It is primarily a reference method for the determination of particulate matter emitted from stationary sources and it can also be used for calibrating automatic continuous particulate monitors. The method should be applied as much as possible under steady state conditions of the gas flow in the duct. It is not suitable for use on ventilation or air conditioning systems, indoor atmospheres, or gases carrying droplets.

This international Standard also sets out requirements for the design features of apparatus which can be used for the determinations if correctly used and indicates basic requirements for the positioning of sampling facilities.

If any of the requirements of this International Standard are not fulfilled, the method can still be applied in special cases but the uncertainty on particulate concentration or flow rate may be larger (see clause 14).

2 Normative reference

The following standard contains provisions which, through reference in this text, constitute provisions of this International Standard. At the time of publication, the edition indicated was valid. All standards are subject to revision, and parties to agreements based on this International Standard are encouraged to investigate the possibility of applying the most recent edition of the standard indicated below. Members of IEC and ISO maintain registers of currently valid International Standards. ISO 3966:1977, *Measurement of fluid flow in closed conduits — Velocity area method using Pitot static tubes*.

3 Definitions

For the purposes of this International Standard, the following definitions apply.

3.1

access port

a hole in the duct at the extremity of a sampling line, through which the sampling probe is inserted [see Figure 1 and *sampling line* (3.15)]

3.2

actual conditions

temperature and pressure at the sampling points

3.3

cumulative sampling

the collection of a single composite sample obtained by sampling for the required period at each sampling point in turn

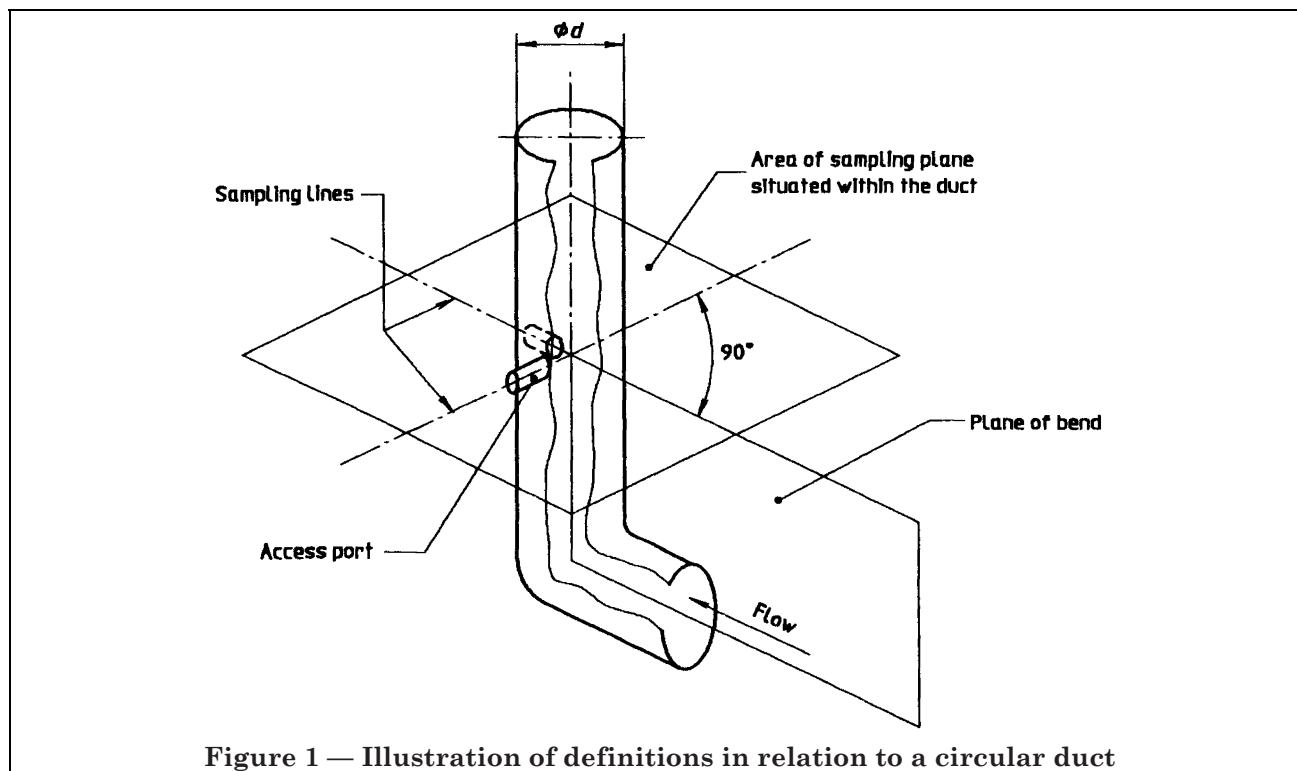


Figure 1 — Illustration of definitions in relation to a circular duct

3.4
duct; flue; chimney; stack

an enclosed structure through which gases travel

3.5
effective pressure

the difference between the pressure at the sampling point and the pressure of the ambient air at equal altitude

3.6
gas

a mixture of gaseous compounds or elements which may carry particulate matter flowing in a duct

3.7
hydraulic diameter

the characteristic dimension of a duct cross-section defined by

$$\frac{4 \times \text{Area of sampling plane}}{\text{Perimeter of sampling plane}}$$

3.8
incremental sampling

the collection and removal of individual samples from each sampling point

3.9
isokinetic sampling

sampling at a rate such that the velocity and direction of the gas entering the sampling nozzle (v'_N) is the same as that of the gas in the duct at the sampling point v'_a (see Figure 2)

3.10
particulate concentration

mass of particulate matter per unit volume of duct gas at defined gas temperature and pressure

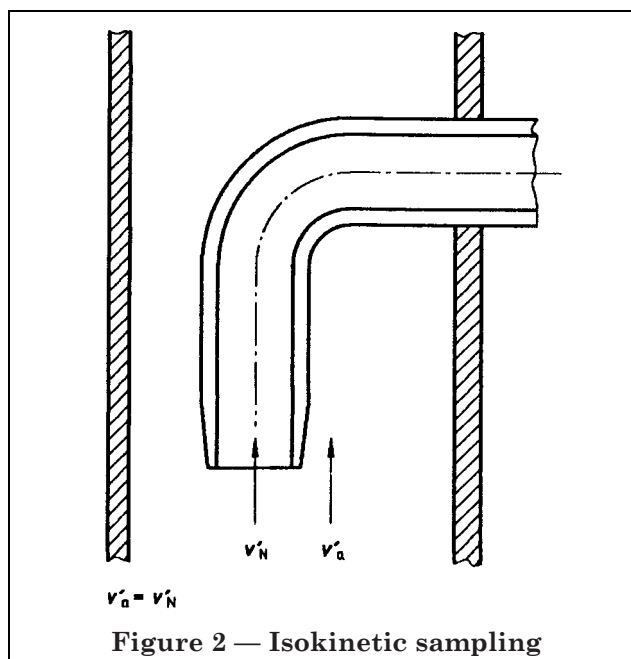


Figure 2 — Isokinetic sampling

3.11
particulate flow rate

mass of particulate matter contained in a duct gas flow per unit time

3.12**particles; particulate matter**

solid particles, of any shape, structure or density, dispersed in the continuous gas phase

3.13**representative gas sample**

a gas sample having the same mean particulate concentration as prevails in the sampling plane during sampling

3.14**sampling plane**

the plane normal to the centreline of the duct at the sampling position (see Figure 1)

3.15**sampling line**

the line in the sampling plane along which the sampling points are located (see Figure 1), bounded by the inner duct wall

3.16**sampling point**

specific location on a sampling line at which a sample is extracted

3.17**sampling location**

a suitable position for carrying out sampling in the duct

3.18**site**

works or plant where sampling is to be carried out

3.19**standard conditions**

standard temperature and pressure of the gas, i.e. 273 K and 101,3 kPa

4 Symbols with their corresponding units, subscripts and index

4.1 Symbols and their corresponding units

See Table 1.

4.2 Subscript and index

See Table 2.

5 Principle

A sharp-edged nozzle is positioned in the duct facing into the moving gas stream and a sample flow of the gas is extracted isokinetically for a measured period of time. To allow for non-uniformity of the distribution of particulate concentration in the duct, samples are taken at a pre-selected number of stated positions in the duct cross-section. The particulate matter entrained in the gas sample is separated by a filter medium, then dried and weighed. The particulate concentration is calculated from the weighed particulate mass and the gas sample volume. The particulate mass flow rate is calculated from the particulate concentration and the duct gas volumetric flow rate. The particulate mass flow rate can also be calculated from the weighed particulate mass, the sampling time and the areas of the sampling plane and the nozzle opening.

6 Summary of the method

A representative gas sample is withdrawn from the source. The degree to which this sample represents the total gas flow depends on

- homogeneity of the gas velocity within the sampling plane;
- a sufficient number of sampling points in the sampling plane;
- isokinetic withdrawal of the sample.

Normally the gas has to be sampled at more than one sampling point in the sampling plane, dependent on the sampling plane area. This plane is usually divided into equal areas, at the centres of which gas is withdrawn (see Annex B). To determine the particulate concentration in the plane, the nozzle is moved from one sampling point to the other, extracting gas isokinetically at each point. Sampling periods should be equal for each sampling point, resulting in a composite sample. If equal sampling areas cannot be chosen, the sampling period shall be proportional to the sampling area.

Table 1 — Symbols and their corresponding units

Symbol	Meaning	Unit
a	Effective nozzle area	m^2
A	Sampling plane area	m^2
c	Particulate concentration	g/m^3
δ	Thickness of nozzle wall at the tip	m
d	Duct diameter at sampling plane	m
d_H	Hydraulic duct diameter at sampling plane	m
d_{N1}	Inner nozzle diameter	m
d_{N2}	Outer nozzle diameter	m
d_o	Orifice diameter	m
f	Water vapour concentration	kg/m^3
i	Individual position on sampling line (diameter or radius)	—
K	Calibration factor	—
l	Characteristic length	m
l_1	Greater side length of sampling plane	m
l_2	Smaller side length of sampling plane	m
m	Collected particulate mass	g
M	Molar mass	kg/kmol
n_d	Number of sampling points on sampling diameter	—
n_{dia}	Number of sampling diameters (sampling lines)	—
n_r	Number of sampling points on sampling radius ($0,5d$)	—
n_1	Number of divisions of l_1	—
n_2	Number of divisions of l_2	—
p	Absolute pressure	Pa
p_{am}	Ambient pressure	Pa
p_e	Effective pressure ($p_e = p - p_{\text{am}}$)	Pa
Δp	Differential pressure across flow measuring device	Pa
q_m	Particulate flow rate in duct	g/h
q_V	Gas volumetric flow rate	m^3/h
r	Volume fraction of gaseous component	—
ρ	Gas density	kg/m^3
t	Sampling time (total)	h
Δt	Sampling time per sampling point	h
T	Temperature (absolute)	K
Θ	Temperature	$^{\circ}\text{C}$
v	Gas velocity	m/s
V	Gas volume	m^3
V_m	Molar volume of a gas	m^3/kmol
x_i	Distance from wall to individual sampling point along diameter or radius	m

Table 2 — Subscript and index

Subscript or index	Meaning
a	Actual conditions in sampling plane
g	Any gas measuring device
i	Individual value
n	Standard conditions
N	Nozzle
o	Orifice
Pt	Pitot tube
w	Water vapour
$'$	Moisture included

The sample is extracted through a sampling train, which principally consists of

- a sampling probe tube with entry nozzle;
- a particle separator, in-stack or external;
- a gas metering system, in-stack or external;
- and
- a suction system.

The particle separator and/or the gas metering system may be either located in the duct, or placed outside the duct.

Illustrations of sampling trains are given schematically in Figure 3 and Figure 4. The numbers in these figures correspond to the items listed in Table 3 and are different from those used in Figure 5 and Figure 6 and in clauses 7 and 13.

It is necessary to avoid condensation of vapour (water, sulphuric acid, etc.) in the sampling train during gas sampling, because it will interfere with particle separation, particulate condition and flow measurement. To this end, the probe tube, the particle separator and the gas flow measuring device are heated above the relevant dew-point.


The water vapour may intentionally be removed downstream of the particle separator, to make use of a dry gasmeter for the measurement of sample gas volume, if the water vapour content of the duct gas does not vary appreciably during sampling.

For isokinetic sampling, the gas velocity at the sampling point in the duct has to be measured, and the corresponding sample gas flow has to be calculated and adjusted.

Normally, a Pitot static tube is used for the measurement of duct gas velocity. If the sample gas flow measuring device is used within the duct, the relation between the measured pressure drop and the Pitot static tube differential pressure is simple, facilitating the adjustment to isokinetic conditions. If the gas metering device is located outside the duct, the calculation of the isokinetic sample gas flow rate is more complicated. The calculation may also include the duct gas density under standard conditions (which may be derived from the dry gas composition and the moisture content), the temperature and static pressure of the gas in the duct and the gas metering device, and the water vapour content of the duct gas, if the sample gas flow is measured after water removal.

After sampling, the collected particulate matter is completely recovered (which can necessitate cleaning of the probe and nozzle), dried and weighed.

Methods of calculating the particulate concentration and mass flow in the duct are presented in clauses 7 and 13. An alternative method of calculation of the particulate mass flow rate in the duct is presented in Annex F.

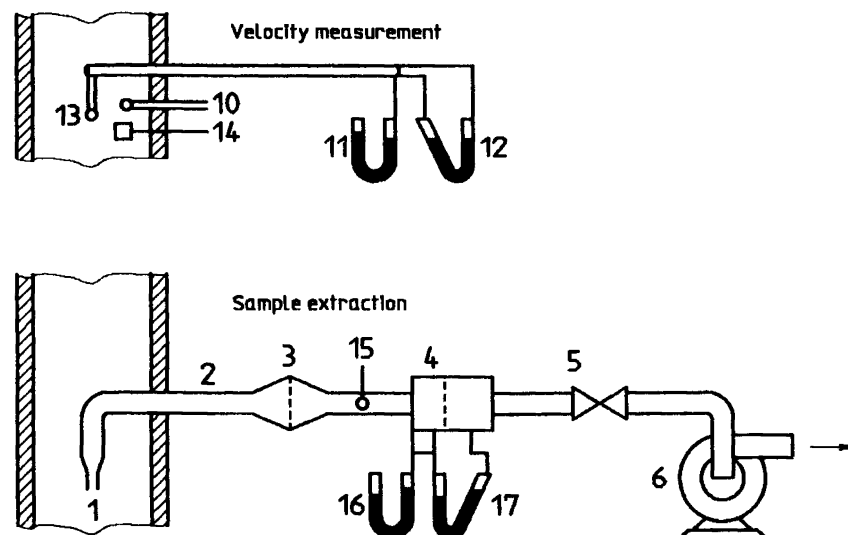

The numbers correspond to items listed in Table 1^a.

^a See national foreword for details of textual error.

Figure 3 — Example of a measuring equipment arrangement (see 8.2), without water removal upstream of the gas metering device