

Refrigerating systems and heat pumps — Safety and environmental requirements — Positive displacement refrigerant compressors

ICS 23.140; 27.080

National foreword

This British Standard is the UK implementation of EN 12693:2008.

The UK participation in its preparation was entrusted to Technical Committee RHE/18, Refrigeration safety.

A list of organizations represented on this committee can be obtained on request to its secretary.

This publication does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

Compliance with a British Standard cannot confer immunity from legal obligations.

This British Standard was published under the authority of the Standards Policy and Strategy Committee on 31 July 2008

© BSI 2008

ISBN 978 0 580 57424 5

Amendments/corrigenda issued since publication

Date	Comments

English Version

Refrigerating systems and heat pumps - Safety and
environmental requirements - Positive displacement refrigerant
compressors

Systèmes de réfrigération et pompes à chaleur - Exigences
de sécurité et d'environnement - Compresseurs
volumétriques pour fluides frigorigènes

Kälteanlagen und Wärmepumpen - Sicherheitstechnische
und umweltrelevante Anforderungen - Verdrängerverdichter
für Kältemittel

This European Standard was approved by CEN on 25 April 2008.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

Management Centre: rue de Stassart, 36 B-1050 Brussels

Contents

Page

Foreword.....	3
Introduction	4
1 Scope	4
2 Normative references	5
3 Terms and definitions	7
3.6 Symbols	8
4 List of significant hazards	10
5 Safety requirements and/or protective measures	12
5.1 General.....	12
5.2 Protection of moving parts	12
5.3 Safety to prevent loss of stability	12
5.4 Safety during handling.....	12
5.5 Safety to prevent rupture or bursting.....	12
5.6 Electrical safety.....	14
5.7 Measures to reduce emissions of substances	16
6 Verification of safety requirements and/or protective measures	16
6.1 General.....	16
6.2 Type test	17
6.3 Individual test.....	19
7 Marking, graphical symbols, written warnings.....	20
7.1 General.....	20
7.2 Marking	21
7.3 Graphical symbols, written warnings and information.....	22
8 Documentation and information for the user	22
8.1 General.....	22
8.2 Instruction handbook	22
Annex A (informative) Basic design criteria for refrigerant compressors	24
Annex B (normative) Procedure for the design of a refrigerant compressor	25
Annex C (normative) Materials	28
Annex D (normative) Determination of the allowable pressure at the maximum operating temperature	30
Annex E (normative) Determination of the allowable pressure at minimum operating temperature (requirements to avoid brittle fracture)	31
Annex F (informative) Compilation of material characteristics of often used materials	37
Annex ZA (informative) Relationship between this European Standard and the Essential Requirements of EU Directive 98/37/EC	61
Annex ZB (informative) Relationship between this European Standard and the Essential Requirements of EU Directive 2006/42/EC	62
Bibliography	63

Foreword

This document (EN 12693:2008) has been prepared by Technical Committee CEN/TC 182 "Refrigerating systems, safety and environmental requirements", the secretariat of which is held by DIN.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by November 2008, and conflicting national standards shall be withdrawn at the latest by November 2008.

This document has been prepared under a mandate given to CEN by the European Commission and the European Free Trade Association, and supports essential requirements of EU Directives 98/37/EC and 2006/42/EC.

For relationship with EU Directive(s) see informative Annexes ZA and ZB, which are an integral part of this document.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN [and/or CENELEC] shall not be held responsible for identifying any or all such patent rights.

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Bulgaria, Cyprus, Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and United Kingdom.

Introduction

This standard is a type C standard as stated in EN ISO 12100.

The machinery concerned and the extent to which hazards, hazardous situations and hazardous events are covered are indicated in the scope of this standard.

When provisions of this type C standard are different from those which are stated in type A or B standards, the provisions of this type C standard take precedence over the provisions of the other standards, for machines that have been designed and built according to the provisions of this type C standard.

1 Scope

This standard applies to positive displacement refrigerant compressors for stationary and mobile refrigerating systems and heat pumps defined in 3.1, hereafter called compressors.

It applies for compressors used in commercial and industrial appliances and with electrical energy supply including integral motors, up to 1 000 VAC and 1 500 VDC.

It applies to open drive, semi hermetic and hermetic motor compressors, which contain a positive compression function.

This standard is not applicable to:

- compressors used in household appliance for which EN 60335-2-34 applies;
- compressors using water or air as refrigerant.

This standard does not deal with requirements for vibration and noise.

NOTE 1 Compressors for automotive comfort air conditioning systems can be developed according e.g. SAE J 639.

NOTE 2 Noise emission depends on the complete installation of the built-in compressors and the corresponding operating conditions.

For semi-hermetic and open drive compressors which include moving parts and for which the external envelope is primarily designed for mechanical loads, thermal loads (to limit the possible deformation due to temperature), stiffness of the structure (external mechanical loads and weight of the equipment), taking into account established safe industrial practice, it is considered that pressure is not a significant design factor.

Attached parts covering other functions e.g. oil separators, oil coolers, suction accumulators shall comply to EN 14276-1 or EN 13445-6 (cast iron) or EN 13445-8 (aluminium) or showing compliance to the relevant European requirements. This applies also to shells for hermetic compressors either welded or with any kind of permanent joint.

Requirements for compressors used in explosive atmospheres are not covered by this standard.

NOTE 3 For further guidance see EN 13463-1.

This standard deals with all significant hazards, hazardous situations and events relevant to compressors, when they are used as intended and under conditions for misuse which are reasonably foreseeable by the manufacturer (see Clause 4).

This standard specifies safety requirements for the design, construction, manufacture and testing, documentation and marking of compressors, including integral accessories, e.g. shut-off valve, if necessary.

The requirements in this standard take account of the intended use, as defined in 3.12 of EN ISO 12100-1:2003.

This standard relates to the compressor itself which is to be incorporated in a refrigerating system.

This standard is not applicable to compressors as defined in the scope which are manufactured before the date of publication as EN.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

EN 287-1, *Qualification test of welders — Fusion welding — Part 1: Steels*

EN 294, *Safety of machinery — Safety distance to prevent danger zones being reached by the upper limbs*

EN 378-1:2008, *Refrigerating systems and heat pumps — Safety and environmental requirements — Part 1: Basic requirements, definitions, classification and selection criteria*

EN 378-2:2008, *Refrigerating systems and heat pumps — Safety and environmental requirements — Part 2: Design, construction, testing, marking and documentation*

EN 378-3, *Refrigerating systems and heat pumps — Safety and environmental requirements — Part 3: Installation site and personal protection*

EN 378-4, *Refrigerating systems and heat pumps — Safety and environmental requirements — Part 4: Operation, maintenance, repair and recovery*

EN 837-1, *Pressure gauges — Part 1: Bourdon tube pressure gauges — Dimensions, metrology, requirements and testing*

EN 837-3, *Pressure gauges — Part 3: Diaphragm and capsule pressure gauges — Dimensions, metrology, requirements and testing*

EN 953, *Safety of machinery — Guards — General requirements for the design and construction of fixed and movable guards*

EN 1050, *Safety of Machinery — Principles for risk assessment*

EN 1515 (all parts), *Flanges and their joints — Bolting*

EN 1561, *Founding — Grey cast irons*

EN 1563, *Founding — Spheroidal graphite cast irons*

EN 1779, *Non-destructive testing — Leak testing — Criteria for method and technique selection*

EN 10045-1, *Metallic materials — Charpy impact test — Part 1: Test method*

EN 10204, *Metallic products — Types of inspection documents*

EN 12178, *Refrigerating systems and heat pumps — Liquid level indicating devices — Requirements, testing and marking*

EN 12516-2, *Industrial valves — Shell design strength — Part 2: Calculation method for steel valve shells*

EN 13136:2001, *Refrigerating systems and heat pumps — Pressure relief devices and their associated piping — Methods for calculation*

EN 13445-2:2002, *Unfired pressure vessels — Part 2: Materials*

EN 13445-3, *Unfired pressure vessels — Part 3: Design*

EN 20898 (all parts), *Mechanical properties of fasteners*

EN 60034-1:2004, *Electrical rotating machinery — Part 1: Rating and performance (IEC 60034-1:2004)*

EN 60204-1:2006, *Safety of machinery — Electrical equipment of machines — Part 1: General requirements (IEC 60204-1:2005, modified)*

EN 60335-2-34, *Household and similar electrical appliances — Safety — Part 2-34: Particular requirements for motor-compressors (IEC 60335-2-34:2002)*

EN 60529, *Degrees of protection provided by enclosures (IP Code) (IEC 60529:1989)*

EN 60947-4-1, *Low-voltage switchgear and controlgear — Part 4-1: Contactors and motor-starters — Electromechanical contactors and motor-starters (IEC 60947-4-1:2000)*

EN 60999 (all parts), *Connecting Devices — Electrical copper conductors — Safety requirements for screw-type and screwless-type clamping units*

EN 61010-1, *Safety requirements for electrical equipment for measurement, control and laboratory use — Part 1: General requirements (IEC 61010-1:2001)*

EN ISO 898 (all parts), *Mechanical properties of fasteners made of carbon steel and alloy steel*

EN ISO 4126-2, *Safety devices for protection against excessive pressure — Part 2: Bursting disc safety devices (ISO 4126-2:2003)*

EN ISO 9606-2, *Qualification test of welders — Fusion welding — Part 2: Aluminium and aluminium alloys (ISO 9606-2:2004)*

EN ISO 12100-1:2003, *Safety of machinery — Basic concepts, general principles for design — Part 1: Basic terminology, methodology (ISO 12100-1:2003)*

EN ISO 12100-2:2003, *Safety of machinery — Basic concepts, general principles for design — Part 2: Technical principles (ISO 12100-2:2003)*

EN ISO 15607, *Specification and qualification of welding procedures for metallic materials — General rules (ISO 15607:2003)*

EN ISO 15614-1, *Specification and qualification of welding procedures for metallic materials — Welding procedure test — Part 1: Arc and gas welding of steels and arc welding of nickel and nickel alloys (ISO 15614-1:2004)*

EN ISO 15614-2, *Specification and qualification of welding procedures for metallic materials — Welding procedure test — Part 2: Arc welding of aluminium and its alloys (ISO 15614-2:2005)*

CR ISO 15608:2000, *Welding — Guidelines for a metallic material grouping system (ISO/TR 15608:2000)*

3 Terms and definitions

For the purposes of this document, the terms and definitions given in EN 378-1:2008, EN ISO 12100-1:2003 and the following apply.

NOTE All pressures are gauge pressures unless otherwise specified.

3.1

positive displacement compressor

compressor in which compression is obtained by changing the internal volume of the compression chamber

3.2

specified maximum allowable pressure, PS

maximum allowable pressure as stated by the compressor manufacturer

3.3

specified maximum allowable standstill pressure, PS_s

maximum allowable value for the equalisation pressure in the compressor as stated by the compressor manufacturer

NOTE 1 This pressure corresponds to different maximum permissible ambient temperatures for different refrigerants (see 6.5.2).

NOTE 2 $PS_s \leq PS$

3.4

compressor overflow device

device specifically intended to protect the compressor against bursting caused by abnormal conditions, e.g. the discharge valve shut. The device relieves from the high pressure/intermediate side of the compressor to a lower pressure side

NOTE The device may be a bursting disc or may be a spring loaded overflow valve. Spring loaded overflow valves can be either back pressure compensating or back pressure dependent type.

3.5

Temperature load cases

3.5.1

min $t_{0\ 100}$

lowest temperature at which component material can be used at a load of up to 100 % of the allowable design stress at 20 °C, taking the safety factors according to Table B.2 into account

3.5.2

min $t_{0\ 75}$

lowest temperature at which component material can be used, at a load of up to 75 % maximum of the allowable design stress at 20 °C, taking the safety factors according to Table B.2 into account

3.5.3

min $t_{0\ 25}$

lowest temperature at which component material can be used, at a load of up to 25 % maximum of the allowable design stress at 20 °C, taking the safety factors according to Table B.2 into account

3.5.4

fasteners

screws, double end studs, reduced shank bolts, studs and nuts with designation system according to EN ISO 898 and EN 20898 or EN 1515 (property classes)

3.6 Symbols

For the purposes of this document, the following symbols apply.

Table 1 — Symbols

Symbol	Term	Unit
A	Elongation after fracture	%
KV	Impact rupture energy	J
KV_0	Threshold value of impact rupture energy, where the impact rupture energy is defined as independent of the temperature	J
KV_0^t	Standard value of impact rupture energy at standard temperature of the material	J
$KV_{TS \min.}$	Impact rupture energy at minimum operating temperature $TS_{\min.}$	J
P_{burst}	Burst pressure	MPa
$\min t_{0 \ 100}$	The lowest temperature according to the European Standards of the respective materials at which the compressor can be used at a load of up to 100 % of the allowable design stress at 20 °C, taking into account the safety factors	
$\min t_{0 \ 75}$	The lowest temperature at which the compressor can be used, if its load amounts to 75 % maximum of the allowable design stress at 20 °C, taking into account the safety factors	
$\min t_{0 \ 25}$	The lowest temperature at which pressure parts can be used, if their load amounts to 25 % maximum of the allowable design stress at 20 °C, taking into account the safety factors	
P_F	Maximum allowable design test pressure	MPa
PS	Maximum allowable pressure in common sense, without regarding any influence of temperature	MPa or bar ^a
PS_S	Maximum allowable standstill pressure	MPa or bar ^a
PS_0	Maximum allowable pressure at ambient temperature (– 10 °C to + 50 °C) according to strength design (without temperature correction)	MPa or bar ^a
$PS_{TS \max.}$	Maximum allowable pressure at maximum operating temperature	MPa or bar ^a
$PS_{TS \min.}$	Maximum allowable pressure at minimum operating temperature	MPa or bar ^a
$R_{p \ 0,2}$	Proof strength, 0,2 % offset at room temperature	MPa, N/mm ²
$R_{p \ 1,0}$	Proof strength, 1,0 % offset at room temperature	MPa, N/mm ²
$R_{p \ 0,2 \ TS \ max.}$	Proof strength, 0,2 % offset at highest operating temperature	MPa, N/mm ²
$R_{p \ 1,0 \ TS \ max.}$	Proof strength, 1,0 % offset at highest operating temperature	MPa, N/mm ²
R_{eH}	Upper yield strength	MPa, N/mm ²
$R_{eH \ TS \ max.}$	Upper yield strength at highest operating temperature	MPa, N/mm ²

Table 1 (continued)

Symbol	Term	Unit
R_m	Tensile strength	MPa, N/mm ²
$R_{m\ TS\ max.}$	Tensile strength at highest operating temperature	MPa, N/mm ²
S_{con}	Safety factor	—
$S_{TS\ min.}$	Factor taking into consideration the impact strength reduction due to the minimum operating temperature	—
$S_{TS\ max.}$	Factor to allow for the reduction in strength due to the highest operating temperature	—
σ_{con}	Initial design stress	MPa, N/mm ²
TS	Operating temperature	°C
$TS_{min.}$	Lowest operating temperature	°C
$TS_{max.}$	Highest operating temperature	°C
^a 1 MPa = 10 bar. NOTE 1 bar = 0,1 MPa = 100 kPa = 100 000 PA = 14,5 PSI.		

4 List of significant hazards

See Table 2.

This clause contains all significant hazards, hazardous situations and events, as far as they are dealt with in this standard, identified by risk assessment as significant for type of compressors and which requires action to eliminate or reduce the risk. The risk assessment shall be made according to EN 1050. The compressors shall be manufactured in accordance with the principle listed in EN ISO 12100-2 to eliminate or reduce the foreseeable risk.

Table 2 — List of significant hazards, hazardous situations, safety requirements and/or measures

Significant hazard according to EN 1050	Hazardous situation	Safety requirements and/or measures	Reference	Verification
Mechanical				
Moving parts	Possible injuries to human body	Guards	5.2	V
Loss of stability	Possible injuries at transport and operation	Fixing points Lifting points Lifting points	5.3 5.4, 7.3.1 6.2.5	V D / V T
Rupture or bursting	Possible injuries from ejected parts or fluid	Design criteria Strength test Tightness test	5.5 6.2.2, 6.2.3, 6.3.2 6.3.3	D T T V
Electrical				
Contact live parts	Possible injuries from electrocution	Design criteria Earthing Internal wiring High potential test Protection devices	5.6.1, 5.6.2, 5.6.3, 5.6.4, 5.6.5, 5.6.9 5.6.6 5.6.7 5.6.8, 6.2.4, 6.3.4 5.6.10	D D D T V
Electrostatic phenomena	Possible injuries from electric shock	Earthing	5.6.6	D
Thermal				
Contact with hot or cold objects	Possible injuries to the skin	Warning	8.2	

Table 2 (continued)

Significant hazard according to EN 12100-1	Hazardous situation	Safety requirements and/or measures	Reference	Verification
Materials and substances				
Contact or inhaling gasses	Possible injuries from aggressive media at draining	Means and instructions Warning	5.7 7.3.2	V V
NOTE Verification methods: V Visual inspection, verifies the required features of the components T A test or check verifies that the features provided perform their function in such a way that the requirement is met M Measurement verifies that requirements are met to the specified limits D Drawing and / or calculations verify that the design characteristics meet the requirements				

5 Safety requirements and/or protective measures

5.1 General

Compressors shall comply with the safety requirements and/or measures of this clause.

In addition, the compressors shall be designed according to the principles of EN ISO 12100 for relevant but not significant hazard, which are not dealt with by this standard.

Furthermore, the refrigerating system which the compressor is part of, shall be in accordance with the requirements of the EN 378 series.

As surface temperatures on a refrigerant compressor and the attached parts and piping depend on operating conditions and properties of specific refrigerants, protection shall be provided considering the requirements in EN ISO 13732-1.

5.2 Protection of moving parts

Protection shall be provided for moving parts such as automatic drives, fans or indicators of capacity controls by fixed guards according to EN 953. Openings such as slots, holes, etc. shall comply with EN 294.

5.3 Safety to prevent loss of stability

Compressors shall be equipped with fixing points to ensure that they shall not tip or fall over during transport and operation.

5.4 Safety during handling

Compressors above 25 kg weight shall be equipped with lifting points or arrangement to enable safe lifting, installation and maintenance. Lifting points or arrangements shall be designed for to carry 1,25 times the weight of the compressor allocated to the individual lifting point.

NOTE For design it is sufficient to use a factor 2 against deformation and a factor 3 against fracture correlated to vertical lifting.

5.5 Safety to prevent rupture or bursting

5.5.1 General

Compressors and associated components shall be designed and manufactured to withstand the pressure and temperatures which can occur during operation, standstill and transportation taking into account the thermal, chemical and mechanical stresses to be expected.

The materials shall be selected based upon suitability for the application. The choice of materials and selection of dimensions shall be based on the need for sufficient strength, rigidity and stability to cope with dynamic effects. The ability of the compressor to withstand internal pressure shall be demonstrated by type test (see 6.2) or by individual test (see 6.3).

5.5.2 Pressure requirements

The compressor design pressure for standard applications shall be in accordance with the refrigerant saturation pressures corresponding to the temperatures given in EN 378-2 or as specified by the compressor manufacturer.

For refrigerants and applications not covered by EN 378-2, the maximum allowable pressure PS and the specified maximum allowable standstill pressure PS_S shall be specified by the manufacturer in the Instructions for use under consideration of the required application ranges. For further requirements, see 6.2 and 6.3.

5.5.3 Materials

5.5.3.1 General

The materials shall be selected to allow for the thermal, chemical and mechanical stresses expected during operation, standstill and transportation throughout the foreseeable life of the compressor parts.

Compressor and compressor parts shall comply with the requirements of Annexes B, C, D and E.

NOTE Basic design criteria for refrigerant compressors are described in Annex A.

5.5.3.2 Requirements to avoid brittle fracture

For compressor and compressor parts with reduced ductility at low temperatures below $-10\text{ }^{\circ}\text{C}$, the allowable temperature should be reduced according Annex F.

Examples are given in Annex E.

5.5.4 Sight glasses

If sight glasses are used, safety requirements according to EN 12178 shall apply.

5.5.5 Application of pressure relief devices

5.5.5.1 Protection against discharge shut off valve closed

The manufacturer shall protect compressor stages fitted with a shut-off valve between stages and compressors with a nominal swept volume $> 90\text{ m}^3/\text{h}$ (25 l/s) against rupture by incorporating either a compressor overflow device or an external relief device or safety valve. In case of multiple stage compressors, the swept volume of the high pressure stage shall be considered as the 'nominal swept volume' for the purposes of this clause.

NOTE Internal damage of the compressor from overloading and overheating may result if the overflow device operates.

The compressor overflow device shall be sized to relieve the refrigerant flow produced by the compressor at a suction pressure corresponding to $10\text{ }^{\circ}\text{C}$ saturated. If the maximum allowable evaporation temperature differs from the value of $10\text{ }^{\circ}\text{C}$ by more than 5 K then the overflow device shall be sized to the pressure corresponding to that temperature.

The compressor overflow device shall relieve to a lower pressure part of the compressor/system or to a special container.

Relief devices discharging to atmosphere or external safety valves discharging to the compressor/system shall be in accordance to EN 13136.

Bursting discs shall be in accordance with EN 13136:2003, 7.3 and EN ISO 4126-2.

The dimensions of the compressor overflow device shall be verified by testing according to 6.2.3.

It shall not be possible to isolate compressor overflow devices, relief devices or safety valves.

The compressor overflow device shall not be used for system pressure protection.

5.5.5.2 Protection against standstill pressure higher than operating pressure

In case of CO₂, a relief device discharging to the atmosphere shall be used in order to protect the compressor against pressure higher than *PS*. This shall be carried out in a safe manner to avoid risk for personnel, see EN 378-2.

5.6 Electrical safety

5.6.1 General

The electrical components and system of which the compressor is part as far as relevant shall conform to the requirements of EN 60204-1 and the requirements of the following additions.

Open type compressors as far as relevant are concerned insofar as they are equipped with accessories e.g. fans, heaters, solenoid valves, electrical control devices.

5.6.2 Classification

Motor compressors and electrical devices enclosures shall be Class I and at least IP 21 as defined in EN 60529.

5.6.3 Determination of current ratings

The following current ratings shall be determined for the compressor:

— max. operating current

is the maximum current that the compressor consumes at the running condition within its intended operating range, at the minimum specified operating voltage, for the refrigerant which gives the highest power consumption.

NOTE Usually, compressors are released for more than one refrigerant.

— locked rotor amps

shall be indicated at the rated voltage or at the average medium voltage if a range is specified, and at the frequency giving the highest locked rotor amperage value. Measurements shall be taken with rotor firmly locked against movement and at stabilized current level maximum 4 s after the stator has been energized. Test shall start with the compressor enclosure at a temperature of 32 °C ± 8 K.

5.6.4 Protection against access to live parts

Compressors shall be constructed and contained such that unintended touching of live parts is impossible as defined in Clause 6 of EN 60204-1:2006. Covers shall only be removable by using tools.

Flow of refrigerant gas shall be conducted such that condensation of moisture around electrical connectors and terminals is avoided. Spacings between live parts (energized parts) and dead metal parts (non-conductive, non-energized parts) inside and outside the compressor enclosure shall be at least as given in Table 3.

Table 3 — Spacings

Minimum acceptable spacings at un-insulated live parts of opposite polarity and between an un-insulated live part and a dead metal part [mm]		
Voltage range	Through-space	Over-surface
≤ 130 V	1,5	2,0
> 130 V and ≤ 250 V	3,0	4,0
> 250 V and ≤ 480 V	4,0	5,0
> 480 V and ≤ 750 V	4,5	6,0
750 V and $\leq 1\,000$ V	5,5	7,5

Spacings at the leads of tubed heaters for voltage range up to 250 V may be at least 1,0 mm if surroundings are protected against dirt.

5.6.5 Connecting devices

Connecting devices shall comply with EN 60999.

5.6.6 Provisions for earthing

Motor compressors shall be equipped with provisions for earthing according to 10.1 of EN 60034-1:2004.

5.6.7 Internal wiring

Internal wiring shall be routed, supported or otherwise protected against bending and cutting. Insulation and supports shall be resistant against impact of vibration. Rough surfaces, sharp edges or contact to moving parts shall be avoided where wiring is installed. Sleeves shall be applied on motor winding lead ends where they are extended and fitted to connectors.

Openings through which insulated wires pass shall have smooth, rounded surfaces. In case of sheet metal, openings shall be protected by bushings or sleeves.

5.6.8 High potential test

The high potential test shall be made according to 6.2.4 and 6.3.4.

5.6.9 Insulating materials

Insulating materials shall be resistant against refrigerants and lubricants used in the compressor and the refrigerant circuit installation. They shall be made from materials resistant against corrosion or coated to be corrosion protected. Impact of temperature by cooling and heating to temperatures which occur during operation of the motor compressor shall be respected.

5.6.10 Motor compressors protection devices

Motor compressors shall be equipped with protection devices interrupting the motor current. These devices shall be such that the temperature of any accessible surface shall not exceed 150 °C under normal or abnormal operating conditions, e.g. locked rotor or failed phase / single phase condition (3 phase motors). Thermal protection devices shall switch off the motor current directly (e.g. line break device located inside the compressor housing) or act to interrupt the motor contactor in the control panel (e.g. electronic module). These devices may be of the automatic or manual reset type and shall comply with the requirements of EN 61010-1.

If the protection device is of automatic reset type, it may be used in case the manufacturer's documentation/guidelines indicate the compressor has passed a 2 000 cycles locked rotor type test.

In addition to the over-current protection devices described above, motor compressors may also be equipped with external manual reset over-current devices rated in accordance with EN 60947-4-1. In such cases the locked rotor test does not need to be performed, provided that the use of such over-current devices is a mandatory requirement recorded in the compressor manufacturer's documentation.

5.7 Measures to reduce emissions of substances

Compressors shall be designed so that recovery of lubricant and refrigerant is possible in a safe and environmentally acceptable manner (for example service connections, see EN 378-4). Special instructions shall be given in the documentation for the user (manufacturer manual).

6 Verification of safety requirements and/or protective measures

6.1 General

For each safety requirement and/or protective measure, except if it is self-evident, a method of verification shall be established:

- a) by testing according to 6.2;
- b) by measures (e.g. "strength");
- c) by calculation;
- d) by visual inspection.

Compressors shall be tested by the manufacturer: Either a type test according to 6.2 together with an individual test according to 6.3.2.2 shall be performed or an individual test according to 6.3.2.3.

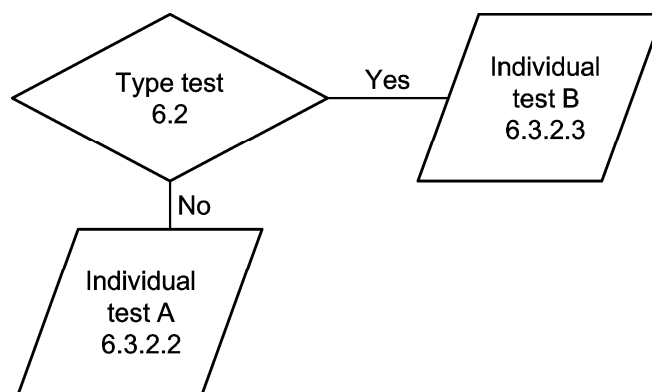


Figure 1 — Flowchart: tests

If a compressor is released by the manufacturer for different applications, the tests shall be made according to the most demanding requirements.

All test results shall be recorded.

NOTE Instead of a strength type test (6.2.2) also an individual strength test according to 6.3.2.2 can be performed.

6.2 Type test

6.2.1 General

All types of compressor shall be type tested for strength, function of the pressure relieve device if installed, and electrical safety.

6.2.2 Strength test

If an individual strength test is chosen according to 6.3.2.1, following type test shall be performed.

Two representative samples of each compressor design platform shall be selected and tested. This selection shall reflect worst case conditions with regard to strength. The test shall be made at least once a year.

NOTE 1 Verification can be made by a notified body or within the manufacture's certified Quality Management system.

The high pressure side enclosure of the compressor shall withstand without rupture a test pressure of at least $3,0 \times PS$.

The low pressure side enclosure of the compressor shall withstand without rupture test pressure of at least $3,0 \times PS_S$.

The pressure shall be increased gradually until the required maximum test pressure is reached. The pressure shall be maintained for at least 30 min. The pressure shall be relieved gradually. The test shall be reported.

Arrangements for sealing openings and applying test pressures shall not influence the response of the compressor being tested.

The compressor shall be considered to be acceptable if on completion of the pressure test, an examination shows there are no signs of rupture.

The sample tested shall not be returned for use in normal production.

NOTE 2 A hydraulic test is recommended for safety. During this test, leaks and permanent deformations at a pressure greater than 2 times PS or PS_S , as appropriate, are acceptable. For the purposes of this test special gaskets may be used.

NOTE 3 If compressor design is such that high and low pressure side cannot be separated for type testing, the test pressures specified for the high pressure side can be used.

6.2.3 Pressure relief device

Compressors with a compressor pressure relief device between the high pressure and the low or intermediate pressure side shall also withstand on the high pressure side a pressure at least 3 times the pressure developed while the device is relieving — based on conditions specified in 5.5.5.

In case of backpressure compensating relief valves, a calculation according to EN 13136 under the conditions that

- the opening pressure is $1,1 \times PS$,
 - the massflow is calculated to critical flow, and
 - the calculated massflow shall be higher than the delivery rate of the compressor,
- is sufficient.

NOTE If it can be established that the combination of the size of the motor and the size of the compressor is such that the compressor could not run with a suction pressure corresponding to 10 °C saturated, the test should be carried out at the highest suction pressure at which the compressor will run.

6.2.4 Verification of electrical safety

6.2.4.1 High potential test

Each motor compressor shall be tested according to 8.1 of EN 60034-1:2004. The test-voltage is determined by Table 14 of EN 60034-1:2004.

During the test, the compressor shall be filled with dry air, nitrogen or a relevant refrigerant at the manufacturer's choice.

6.2.4.2 Requirements on motor protection

Motor compressors shall be type tested for temperature protection under locked rotor conditions. This requires preparation by using specific parts to prevent the rotor from turning. The test compressor shall be equipped with thermal probes recording surface temperature at places where highest surface temperatures will occur.

Motor compressors equipped with automatic reset thermal protection devices shall withstand 2 000 locked rotor cycles at rated voltage. The maximum surface temperature shall not exceed 150 °C. After completion of the locked rotor test, the motor compressor shall pass a high potential test according to EN 60034-1:2004, 8.1. The test voltage is determined by reference to Table 14 of EN 60034-1:2004. The leakage current shall not exceed 3,5 mA or 3,5 mA per kW rated input power, whichever is higher. Independent of input power rating, leakage current shall not exceed 30 mA for motors up to 25 A maximum rated current.

The test may be terminated after 15 days if 2 000 cycles are not completed, provided that the temperature of the enclosure has been measured after 12 and 15 days and has not risen by more than 5 K between these measurements.

Motor compressors equipped with manual reset thermal protection devices shall withstand 50 locked rotor cycles at rated voltage or until the maximum surface temperature remains constant within 5 K for 1 h, whichever is the longer. The maximum surface temperature shall not exceed 150 °C.

After completion of the locked rotor test, the motor compressor shall pass a high potential test according to EN 60034-1:2004, 8.1. The test voltage is determined by reference to Table 14 of EN 60034-1:2004. The leakage current shall not exceed 3,5 mA or 3,5 mA per kW rated input power, whichever is higher. Independent of input power rating, leakage current shall not exceed 30 mA for motors up to 25 A maximum rated current.

The motor compressor shall be filled with oil and gaseous refrigerant in appropriate quantities during the locked rotor test. If a compressor is released for several refrigerants, the manufacturer may choose the type of refrigerant for the test. Only one refrigerant needs to be tested.

The voltage during the locked rotor test shall be at the maximum of the specified operating voltage range. Motor compressors having a dual voltage rating shall be tested at each voltage.

NOTE For test evaluation purposes, it is recommended that the motor compressors are also subjected to the high potential test as defined before the locked rotor test.

6.2.5 Lifting points

The lifting points or arrangements shall be tested by lifting up the compressor including an additional weight of 25 % for the period of 10 min.

NOTE This test does not avoid damage in case of an emergency stop.

6.3 Individual test

6.3.1 General

All individual compressors (enclosure and optional components greater than 50 mm equivalent diameter) shall be tested on strength, tightness and electrical safety during or after manufacture.

6.3.2 Strength test

6.3.2.1 General

If no type strength test is performed, an individual strength test according to 6.3.2.2 (strength test A) shall be performed during manufacture.

If a type strength test is performed according to 6.2, an individual strength test according to 6.3.2.3 (strength test B) shall be performed during manufacture.

The test shall be made with dry air or inert gas or an equivalent alternative testing procedure.

If compressor design is such that high and low pressure side cannot be separated during the test, the pressures specified for the high pressure side shall be used.

6.3.2.2 Individual strength test A

The high pressure side enclosure of the compressor shall withstand without rupture a test pressure of $1,5 \times PS$.

The low pressure side enclosure of the compressor shall withstand without rupture a test pressure of $1,5 \times PS_S$.

6.3.2.3 Individual strength test B

The high pressure side enclosure of the compressor shall withstand without rupture a test pressure of $1,1 \times PS$.

The low pressure side enclosure of the compressor shall withstand without rupture a test pressure of $1,1 \times PS_S$.

6.3.3 Test for tightness

The high pressure side enclosure of the compressor shall be tested and proven tight at no less than $1,0 \times PS$.

The low pressure side enclosure of the compressor shall be tested and proven tight at no less than $1,0 \times PS_S$.

The test shall be made with dry air or inert gas.

If compressor design is such that high and low pressure side cannot be separated during the test, the pressures specified for the high pressure side shall be used.

For tightness test, a procedure according to EN 1779 shall be applied where the sensitivity of detection is a minimum 10^{-4} Pa m³/s.

NOTE A method other than pressure testing at the design pressure may be employed if it can be demonstrated that the alternative test method (e.g. helium test) produces results that are at least equivalent to the pressure test method.

6.3.4 Verification of electrical safety

Each motor compressor shall pass a high potential test according to EN 60034-1:2004, 8.1. The test voltage is determined by Table 14 of EN 60034-1:2004, 8.1. The one minute test may be replaced by a 5 s test in case