

Compressor and condensing units for refrigeration — Performance testing and test methods —

Part 1: Refrigerant compressors

ICS 23.140; 27.200

National foreword

This British Standard is the UK implementation of EN 13771-1:2003. It supersedes BS 3122-1:1990, which is withdrawn.

The UK participation in its preparation was entrusted to Technical Committee RHE/4, Testing of refrigerant compressors.

A list of organizations represented on this committee can be obtained on request to its secretary.

This publication does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

Compliance with a British Standard cannot confer immunity from legal obligations.

This British Standard was published under the authority of the Standards Policy and Strategy Committee on 25 April 2003

© BSI 2009

Amendments/corrigenda issued since publication

Date	Comments
30 June 2009	Supersession details added to National foreword

ISBN 978 0 580 65205 9

English version

Compressors and condensing units for refrigeration -
Performance testing and test methods - Part 1: Refrigerant
compressors

Compresseurs et unités de condensation pour la
réfrigération - Essais de performances et méthodes d'essai
- Partie 1: Compresseurs pour fluides frigorigènes

Kältemittel-Verdichter und Verflüssigungssätze für die
Kälteanwendung - Leistungsprüfung und Prüfverfahren -
Teil 1: Kältemittel-Verdichter

This European Standard was approved by CEN on 9 January 2003.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Luxembourg, Malta, Netherlands, Norway, Portugal, Slovakia, Spain, Sweden, Switzerland and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

Management Centre: rue de Stassart, 36 B-1050 Brussels

Contents

	page
Foreword	3
1 Scope	3
2 Normative references	3
3 Terms, definitions and symbols	4
4 General requirements	7
5 Test methods	11
6 Determination of the power absorbed by the compressor	21
7 Test report	21
Annex A (normative) Measuring instruments and the uncertainties of measurement	23
Bibliography	26

Foreword

This document EN 13771-1:2003 has been prepared by Technical Committee CEN/TC 113 "Heat pumps and air conditioning units", the secretariat of which is held by AENOR.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by October 2003, and conflicting national standards shall be withdrawn at the latest by October 2003.

It consists of the following parts:

Part 1: Refrigerant compressors

Part 2: Condensing units for refrigeration

Annex A is normative.

This document includes a Bibliography.

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard : Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Luxembourg, Malta, Netherlands, Norway, Portugal, Slovakia, Spain, Sweden, Switzerland and the United Kingdom.

1 Scope

This part of this European Standard applies only to refrigerant compressors and describes a number of selected performance test methods. These methods provide sufficiently accurate results for the determination of the refrigerating capacity, power absorbed, refrigerant mass flow, isentropic efficiency and the coefficient of performance.

This standard applies only to performance tests conducted at the manufacturer's works or wherever the equipment for testing to the accuracy required is available.

The type of measuring instrument and the allowable uncertainty within which measurements shall be made are listed in normative annex A.

2 Normative references

This European Standard incorporates by dated or undated reference, provisions from other publications. These normative references are cited at the appropriate places in the text, and the publications are listed hereafter. For dated references, subsequent amendments to or revisions of any of these publications apply to this European Standard only when incorporated in it by amendment or revision. For undated references the latest edition of the publication referred to applies (including amendments).

EN 378-1:2000, *Refrigerating systems and heat pumps - Safety and environmental requirements - Part 1: Basic requirements, definitions, classification and selection criteria.*

EN 378-2, *Refrigerating systems and heat pumps - Safety and environmental requirements - Part 2: Design, construction, testing, marking and documentation.*

EN ISO 5167-1, *Measurement of fluid flow by means of pressure differential devices - Part 1: Orifice plates, nozzles and Venturi tubes inserted in circular cross-section conduits running full (ISO 5167-1:1991)*

ISO/TR 5168, *Measurement of fluid flow - Evaluation of uncertainties.*

3 Terms, definitions and symbols

For the purposes of this European Standard, the following terms and definitions apply.

3.1 Terms and definitions

3.1.1

refrigerating capacity (Φ_0)

product of the mass flow of refrigerant through the compressor and the difference between the specific enthalpy of the refrigerant at the compressor inlet and the specific enthalpy of saturated liquid. The refrigerant at the compressor inlet is superheated above the suction dew point temperature to the stated value. The saturated liquid is at a pressure corresponding to the compressor discharge dew point temperature

3.1.2

volumetric efficiency (η_v)

ratio of the actual volume rate of flow under suction conditions at the requirements specified in 4.9, to the displacement of the compressor

3.1.3

power absorbed (P)

- for externally driven compressors: the power at the compressor shaft;
- for motor compressors: the electrical power input at the motor terminals

3.1.4

refrigerant mass flow (q_m)

total refrigerant mass flow at the compressor suction inlet

3.1.5

isentropic efficiency (η_i)

ratio of the product of the mass flow and the change in isentropic enthalpy across the compressor to the power absorbed

3.1.6

coefficient of performance (COP_r)

ratio of the refrigerating capacity to the power absorbed

NOTE All the above are at the basic test condition.

3.1.7

oil circulation in the refrigerating system (x_{oil})

ratio of the measured oil mass flow to the mass flow of the circulating oil/refrigerant mixture

3.2 Symbols

For the purposes of this European Standard, the symbols of Table 1 apply.

Table 1 — Symbols


Symbol	Designation	SI unit
c	Specific heat capacity of liquid	J/(kg K)
c_{oil}	Specific heat capacity of oil	J/(kg K)
f	Nominal electrical frequency	Hz
f_a	Actual electrical frequency	Hz
F	Heat leakage factor	W/K
h_{l2}	Specific enthalpy of liquid refrigerant at bubble point corresponding to the pressure at the compressor outlet according to the basic test conditions	J/kg
h_{l4}	Specific enthalpy of liquid refrigerant at the outlet of the condensor	J/kg
h_{l5}	Specific enthalpy of liquid refrigerant at the inlet in the expansion device	J/kg
h_{gt}	Specific enthalpy of refrigerant vapour at the compressor outlet having the same entropy as the refrigerant vapour at the compressor inlet (basic test conditions)	J/kg
h_{g1}	Specific enthalpy of the refrigerant vapour at the compressor inlet at the basic test conditions	J/kg
h_{g3}	Specific enthalpy of the refrigerant vapour at the inlet of the condenser	J/kg
h_{g6}	Specific enthalpy of the refrigerant vapour at the outlet of the calorimeter	J/kg
n	Nominal compressor speed	1/min
n_a	Actual compressor speed	1/min
P	Power absorbed	W
P_0	Power absorbed at the basic test conditions	W
P_a	Actual power absorbed	W
p_{g1}	Absolute pressure, compressor inlet	MPa
p_{g2}	Absolute pressure, compressor outlet	MPa
p_{g3}	Pressure of the refrigerant vapour entering the condenser	MPa
p_{g6}	Pressure of the refrigerant vapour of the evaporator outlet	MPa
p_{l4}	Pressure of the refrigerant liquid leaving the condenser	MPa
p_{l5}	Pressure of the refrigerant liquid entering the expansion device	MPa

Table 1 (continued)

Symbol	Designation	SI unit
p_s	Absolute pressure of the secondary fluid	MPa
q_m	Refrigerant mass flow as determined by the test	kg/s
q_{m0}	Refrigerant mass flow at the basic test conditions	kg/s
q_{mf}	Fluid mass flow	kg/s
q_{moil}	Oil mass flow	kg/s
q_{mx}	Mass flow of liquid refrigerant/oil mixture	kg/s
q_v	Refrigerant volume flow	m ³ /s
q_{vx}	Volume flow of refrigerant/oil mixture	m ³ /s
t_a	Ambient temperature	°C
t_c	Mean surface temperature of the calorimeter (basic test conditions)	°C
t_{ga}	Actual temperature at the compression inlet	°C
t_{g1}	Refrigerant vapour temperature at the compressor inlet (basic test conditions)	°C
t_{g3}	Temperature of the refrigerant vapour entering condenser	°C
t_{g6}	Temperature of the refrigerant vapour at the evaporator outlet	°C
t_{l2}	Saturation temperature of the liquid refrigerant corresponding to the pressure at the compressor outlet	°C
t_{l4}	Temperature of the refrigerant liquid leaving the condenser	°C
t_{l5}	Temperature of the refrigerant liquid entering the expansion device	°C
t_r	Average bubble point temperature of the refrigerant	°C
t_s	Saturation temperature of the secondary fluid	°C
t_x	Reference temperature	°C
t_1	Inlet temperature of the fluid	°C
t_2	Outlet temperature of the fluid	°C
U	Nominal electrical voltage	V
V_{sw}	Compressor displacement	m ³ /s
x_{oil}	Oil circulation in the refrigerating system, expressed in kilogram per kilogram of mixture	kg/kg
COP_r	Coefficient of performance	—
η_i	Isentropic efficiency	—
η_v	Volumetric efficiency	—
v_{ga}	Actual specific volume of refrigerant vapour at the inlet of the compressor	m ³ /kg
v_{g1}	Specific volume of refrigerant vapour at the inlet of the compressor at the basic test conditions	m ³ /kg
ρ_m	Density of refrigerant corresponding to pressure and temperature at which the flow rate is measured	kg/m ³
Φ_i	Heat input to the calorimeter	W
Φ_n	Electrical input to the heater	W
Φ_0	Refrigerating capacity of the compressor at the basic test conditions	W

3.3 Refrigerant circuit state points

Figure 1 illustrates the state of the refrigerant as it passes through the system

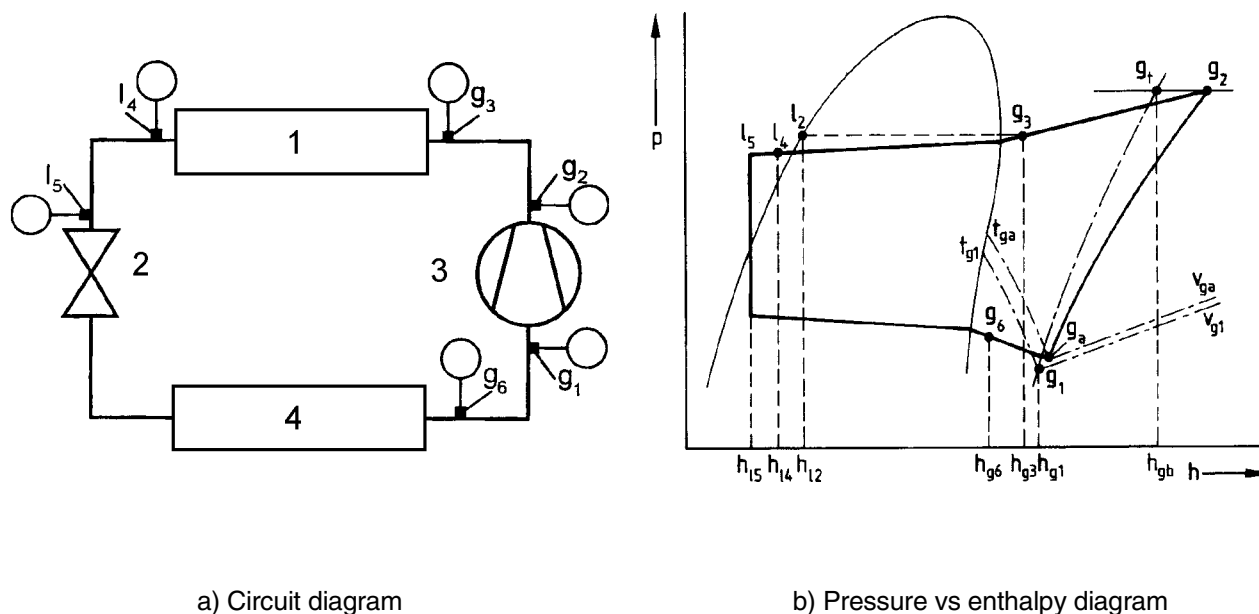

a) Circuit diagram

b) Pressure vs enthalpy diagram

Key

- 1 Condenser
- 2 Expansion device
- 3 Compressor
- 4 Evaporator

Figure 1 - Refrigerant circuit

4 General requirements

4.1 Calculation methods

4.1.1 Principle

The determination of the refrigerating capacity of a compressor at the basic test conditions comprises:

- the evaluation of the actual mass flow of refrigerant through the compressor when operating within the limits allowed to the basic test conditions in 4.9;
- the correction of this mass flow to that, at the basic test conditions using the ratio of the actual specific volume (v_{ga}) of the refrigerant vapour at the compressor suction to the specific volume of the vapour at the basic test conditions (v_{g1});
- the product of the corrected mass flow and the difference between the specific enthalpies at the basic test conditions of the refrigerant vapour at the compressor suction (h_{g1}) and the liquid refrigerant at a pressure corresponding the compressor discharge dew point temperature (h_{l2}).

NOTE For the purposes of this standard it is assumed that the volume flow rate is constant when the compressor is operating within the limits allowed in 4.9.