

Specification for

Wrought steel enclosures for gas-filled high-voltage switchgear and controlgear

This European Standard EN 50068:1991 has the status of a
British Standard

NO COPYING WITHOUT BSI PERMISSION EXCEPT AS PERMITTED BY COPYRIGHT LAW



Document Sharing Hub

Cooperating organizations

The European Committee for Electrotechnical Standardization (CENELEC), under whose supervision this European Standard was prepared, comprises the National Committees of the following countries:

Austria	Luxemburg
Belgium	Netherlands
Denmark	Norway
Finland	Portugal
France	Spain
Germany	Sweden
Greece	Switzerland
Iceland	United Kingdom
Ireland	
Italy	

This British Standard, having been prepared under the direction of the Power Electrical Engineering Standards Policy Committee, was published under the authority of the Standards Board and comes into effect on 30 September 1991

© BSI 12-1999

The following BSI references relate to the work on this standard:
Committee reference PEL/92
Draft announced in *BSI News* December 1988

ISBN 0 580 19622 4

Amendments issued since publication

Amd. No.	Date	Comments
8054	January 1994	Indicated by a sideline in the margin

Contents

	Page
Cooperating organizations	Inside front cover
National foreword	ii
Foreword	2
Text of EN 50068	5
National appendix NA (informative)	Inside back cover
National appendix NB (informative)	Inside back cover

National foreword

This British Standard has been prepared under the direction of the Power Electrical Engineering Standards Policy Committee and is the English language version of EN 50068:1991 and its Amendment A1:1993 “*Wrought steel enclosures for gas-filled high-voltage switchgear and controlgear*” published by the European Committee for Electrotechnical Standardization (CENELEC).

National appendix NA gives the constitution of the committees responsible for UK participation in the preparation of this standard.

National appendix NB gives details of International Standards quoted in this standard for which there is an identical or technically equivalent British Standard.

A British Standard does not purport to include all the necessary provisions of a contract. Users of British Standards are responsible for their correct application.

Compliance with a British Standard does not of itself confer immunity from legal obligations.

Summary of pages

This document comprises a front cover, an inside front cover, pages i and ii, the EN title page, pages 2 to 70, an inside back cover and a back cover.

This standard has been updated (see copyright date) and may have had amendments incorporated. This will be indicated in the amendment table on the inside front cover.

UDC 621.316.54-213.34-034.14

Descriptors: Enclosure, high-voltage switching device, H.V. metal enclosed switchgear and controlgear, pressurized closure, wrought steel

English version

Wrought steel enclosures for gas-filled high-voltage switchgear and controlgear

(includes amendment A1:1993)

Enveloppes en acier soudé pour l'appareillage
à haute tension sous pression de gaz
(inclut l'amendement A1:1993)

Kapselungen aus Schmiedestahl für
gasgefüllte Hochspannungs- Schaltgeräte
und -Schaltanlagen
(enthält Änderungen A1:1993)

This European Standard was approved by CENELEC on 5 March 1990. CENELEC members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration.

Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the Central Secretariat or to any CENELEC member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CENELEC member into its own language and notified to the Central Secretariat has the same status as the official versions.

CENELEC members are the national electrotechnical committees of Austria, Belgium, Denmark, Finland, France, Germany, Greece, Iceland, Ireland, Italy, Luxembourg, Netherlands, Norway, Portugal, Spain, Sweden, Switzerland and United Kingdom.

CENELEC

European Committee for Electrotechnical Standardization
Comité Européen de Normalisation Electrotechnique
Europäisches Komitee für Elektrotechnische Normung

Central Secretariat: rue de Stassart 35, B-1050 Brussels

© 1991 Copyright reserved to CENELEC members

Ref. No. EN 50068:1991
 **Documents**
Document Sharing Hub

Foreword

At the request of CENELEC Technical Committee TC 17C, the text of the draft EN 50068 prepared by TC 17C was submitted to the Unique Acceptance Procedure (UAP).

The text of the draft was approved by CENELEC as EN 50068 on 5 March 1990.

The following dates were fixed:

- latest date of publication of an identical national standard (dop) 1991-06-01
- latest date of withdrawal of conflicting national standards (dow) 1991-06-01

For products which have complied with the relevant national standard before 1991-06-01, as shown by the manufacturer or by a certification body, this previous standard may continue to apply for production until 1996-06-01.

This document forms a supplement to EN 50052 (1986): “Cast aluminium alloy enclosures for gas-filled high-voltage switchgear and controlgear” and EN 50064 (1989): “Wrought aluminium and aluminium alloy enclosures for gas-filled high-voltage switchgear and controlgear”, concerning welded enclosures for the same type of switchgear and controlgear but composed of parts made of wrought steel. It is based on the general specifications given in HD 358 S2 (IEC 517 (1986) ed 2) which are however not sufficient to satisfy the conditions for the service allowance of pressurized high-voltage switchgear and controlgear.)

These specifications are appropriate for pressurized switchgear enclosures allowing an economic production without sacrificing aspects of safety. For unusual shapes dictated by electrical conditions they permit the verification of sound design by proof tests instead of calculations. Nevertheless this European Standard makes use of many internationally well acknowledged calculation rules and the Technical Committee will in addition pursue the progress in standardization in CEN/TC 121 and ISO/TC 44 on welding and allied processes.

For the time being reference can only be made to published International Standards as far as they are appropriate for the purpose of production of enclosures to be used in gas-filled switchgear and controlgear.

The present EN has been established as an international specification for the design, construction, testing, inspection and certification of pressurized enclosures used in high-voltage switchgear and controlgear. This standard follows to that extent also Article 2 of the Directive 76/767/EEC.

The European Standard contains two normative and one informative technical annexes:

- Annex A: Welding procedure and welder performance tests.
- Annex B: Sample of record form.
- Annex C: National deviations.

List of standards referred to in this standard:

HD 358 S2	Gas-insulated
(IEC 517 (1986) ed 2)	metal-enclosed switchgear for rated voltages of 72,5 kV and above
ISO 6213:1983	Welding: Items to be considered to ensure quality in welding structures
ISO 9000:1987	Guidelines for selection and use of the standards on quality management, quality system elements and quality assurance
ISO/IEC Guide 2:1986	General terms and their definitions concerning standardization and related activities
ISO 6520:1982	Classification of imperfections in metallic fusion welds, with explanations
ISO/R 373:1964	General principles for fatigue testing of metals

Foreword to Amendment A1

This amendment was prepared by CENELEC Technical Committee TC17C, High-voltage enclosed switchgear and controlgear.

The text of the draft was submitted to the voting procedure in March 1993 and was approved by CENELEC as amendment A1 to EN 50068:1991 on July 6, 1993.

The following dates were accepted:

- latest date of publication of an identical national standard (dop) 1994-10-01
- latest date of withdrawal of conflicting national standards (dow) 1994-10-01

Text of amendment

2.1 Type of equipment (page 5)

The first paragraph has to be changed as follows (new text in bold letters);

... of high-voltage switchgear and controlgear,
where the gas is used principally for its dielectric and/or arc-quenching properties, with rated voltages.

- **1 kV and up to and including 52 kV and with gas-filled compartments with design pressure greater than 3 bar (gauge);**
- **and with rated voltage 72,5 kV and above.**

Annex C (page 67) — only English version

Clause **7.5.3.2**, Italy:

The formula for “ σ ” has to be corrected as follows:

$$\sigma = \frac{K}{4,8}$$

Contents

	Page
Foreword	2
1 Introduction	5
2 Scope and field of application	5
3 Definitions	6
4 Materials	7
5 Design	7
6 Manufacture and workmanship	40
7 Inspection and testing	46
8 Pressure relief devices	53
9 Certification and marking	53
Annex A Welding procedure and welder performance tests	55
Annex B Sample of record form	65
Annex C (informative) National deviations	67
Figure 1 to Figure 4 — Typical connections between cylindrical and conical shells	11
Figure 5 — Design factor β and numerical factor $1/\cos \varphi$	13
Figure 6 — Dished end	15
Figure 7 — Dished end with branch	15
Figure 8 — Dished end with knuckle and crown of unequal wall thickness	15
Figure 9 — Welded joint outside $0,6D_a$: $v = 0,75$ resp. $1,0$	16
Figure 10 — Welded joint inside $0,6D_a$: $v = 1,0$	16
Figure 11 — Welded dished end from crown and knuckle components inside $0,6D_a$: $v = 1,0$	17
Figure 12 — Welded dished end from crown and knuckle components outside $0,6D_a$: $v = 0,75$ resp. $1,0$	17
Figure 13 — Design factor β for dished ends of the Klöpper type	19
Figure 14 — Design factor β for dished ends of the Korbboogen type	19
Figure 15 — Determination of the buckling pressure	20
Figure 16 — Increased thickness of a cylindrical shell	21
Figure 17 — Increased thickness of a conical shell	21
Figure 18 — Local increase by reinforcement rings	21
Figure 19 — Pad reinforcement	21
Figure 20 — Branch reinforcement	22

	Page		Page
Figure 21 — Necked out opening	22	Figure A.3 — Test piece for fillet weld in plate	61
Figure 22 — Calculation scheme for cylindrical shells	23	Figure A.4 — Test piece for branch connection in pipe	63
Figure 23 — Calculation scheme for spherical shells	24	Figure A.5 — Dimensions of tensile test specimen from pipe of outside diameter greater than 35 mm	64
Figure 24 — Calculation scheme for adjacent branches in longitudinal direction of a cylinder	24	Table 1 — Examples of materials (not exhaustive; other steels may be used from national standards)	8
Figure 25 — Calculation scheme for adjacent branches in a sphere or in circumferential direction of a cylinder	25	Table 2 — Design factor β for conical shells and numerical factors $\cos \varphi$ and $1/\cos \varphi$	13
Figure 26 — Branch and pad reinforcement	26	Table 3 — The factor “A” as a function of K_1 and K_2	35
Figure 27 — Weakening factor v_A for openings and branches perpendicular to cylindrical and conical shells	27	Table 4 — Values of “ln m ” as function of “ m ”	36
Figure 28 — Weakening factor v_A for openings and branches perpendicular to spherical shells	28	Table 5 — Circumferential tolerances	43
Figure 29 — Circular flange joint	29	Table 6 — Circularity tolerances for shells	43
Figure 30 — Examples of different flange types	31	Table 7 — Acceptance levels for imperfections	50
Figure 31 — Forces and moment arms for flanges with O-ring seal	32	Table A.1	57
Figure 32 — Hubless flange sections for stress calculation	32	Table A.2 — Number of test specimens required	60
Figure 33 — Flange with untapered hub section for stress calculation	33		
Figure 34 — The factor “A” as a function of K_1 and K_2	35		
Figure 35 — Graph showing in (D_y/D_i) as a function of $m = D_y/D_i$	36		
Figure 36 — Forces and moment arms for flanges with O-ring seal	37		
Figure 37 — Flange with large fillet radius sections for stress calculation	38		
Figure 38 — Flange with tapered hub sections for stress calculation	39		
Figure 39 — Flange with flat circular cover and O-ring seal	40		
Figure 40 — Butt welds in plates of unequal thickness with approximately coincident middle lines	47		
Figure 41 — Butt welds in plates of unequal thickness with offset of middle lines	48		
Figure A.1 — Test piece for butt weld in plate	59		
Figure A.2 — Test piece for butt weld in pipe	59		

1 Introduction

This standard covers the requirements for the design, construction, testing, inspection and certification of gas-filled enclosures for use specifically in high-voltage switchgear and controlgear or for associated gas-filled equipment. Special consideration is given to these enclosures for the following reasons.

- a) The enclosures usually form the containment of electrical equipment, thus their shape is determined by electrical rather than mechanical considerations.
- b) The enclosures are installed in restricted access areas and the equipment is operated by experts and instructed persons only.
- c) As the thorough drying of the inert, non-corrosive gas-filling medium is fundamental to the satisfactory operation of the electrical equipment it is periodically checked. For this reason, no internal corrosion allowance is required on the wall thickness of these enclosures.
- d) The enclosures are subjected to only small fluctuations of pressure as the gas-filling density shall be maintained within close limits to ensure satisfactory insulating and arc-quenching properties. Therefore, the enclosures are not liable to fatigue due to pressure cycling.
- e) The operating pressure is relatively low.

For the foregoing reasons, and to ensure the minimum disturbance hence reducing the risk of moisture and dust entering the enclosures which would prevent correct electrical operation of the switchgear, no pressure tests shall be carried out after installation and before placing in service and no periodic inspection of the enclosure interiors or pressure tests shall be carried out after the equipment is placed in service.

2 Scope and field of application

2.1 Type of equipment

This standard applies to fusion welded wrought steel enclosures pressurized with dry air, inert gases, for example sulphur hexafluoride or nitrogen or a mixture of such gases, used in indoor or outdoor installations of high-voltage switchgear and controlgear with rated voltages 72,5 kV and above, where the gas is used principally for its dielectric and/or arc-quenching properties.

The enclosures comprise parts of electrical equipment not necessarily limited to the following examples:

- Circuit-breakers
- Switch-disconnectors
- Disconnectors
- Earthing switches
- Current transformers
- Voltage transformers
- Surge arrestors
- Busbars and connections

The scope also covers pressurized components such as the centre chamber of live tank switchgear, gas-insulated current transformers, etc.

2.2 Production

The production of the enclosures shall be in accordance with documented welding procedures which shall be carried out by well trained and supervised welding personnel. Where International Standards (ISO or CEN) are not available national standards may be used.

NOTE The standard will be revised as soon as possible when ISO or CEN standards covering the various aspects are available.

2.3 Quality assurance

It is the intention of this standard that the switchgear manufacturer shall be responsible for achieving and maintaining a consistent and adequate quality of product.

Sufficient examinations shall be made by the enclosure manufacturer to ensure that the materials, production and testing comply in all respects with the requirements of this standard and ISO 6213:1983. Inspection by user's inspectors shall not absolve the switchgear manufacturer from this responsibility to exercise such quality assurance procedures as to ensure that the requirements and intent of this standard are satisfied.

NOTE Reference should be made to the ISO 9000 series of standards for quality systems.

3 Definitions

3.1

national standard

a technical specification established by general agreement with the important part of the concerned interests, approved by a recognized national standards organization and made available to the public (ISO/IEC Guide 2:1986)

3.2

enclosure

a part of gas-insulated metal-enclosed switchgear retaining the insulated gas under the prescribed conditions necessary to maintain safely the rated insulation level, protecting the equipment against external influences and providing a high degree of protection to personnel.

HD 358 S2 = IEC 517 (1986) ed 2

3.3

manufacturer

individual or body responsible for designing and producing the enclosure. In this standard this is the switchgear manufacturer

3.4

designer

individual or body who determines the shape, dimensions and thickness of the enclosure and selects the materials and method of construction and testing

3.5

design pressure (of an enclosure)

pressure used to determine the thickness of the enclosure. It is at least the upper limit of pressure reached within the enclosure at the design temperature. HD 358 S2 = IEC 517 (1986) ed 2

3.6

design temperature (of an enclosure)

highest temperature reached by the enclosure which can occur under service conditions. This is generally the upper limit of ambient air temperature increased by the temperature rise due to the flow of rated normal current. HD 358 S2 = IEC 517 (1986) ed 2

NOTE Solar radiation should be taken into account when it has a significant effect on the temperature of the gas and on the mechanical properties of some materials. Similarly, the effects of low temperatures on the properties of some materials should be considered.

3.7 Weld imperfections

3.7.1

lack of fusion

lack of union between weld metal and parent metal or weld metal and weld metal. ISO 6520:1982, No. 400

3.7.2

overlap

excess of weld metal at the toe of a weld covering the parent metal surface but not fused to it. ISO 6520:1982, No. 506

3.7.3

undercut

a groove at the toe(s) (or at the root) of a weld run due to welding. ISO 6520:1982, No. 5012

3.8

heat treatment

process in which the metal or the alloy in the solid state is subjected to one or more temperature cycles, to confer certain desired properties

3.9**fatigue**

change of the properties of a material due to repeated application of stresses or strains which leads, in particular, to cracks or rupture. ISO/R 373:1964

3.10**tensile strength**

the maximum unit stress related to the initial cross-section of the test specimen at which the material ruptures

3.11**test piece**

two or more parts of material welded together in accordance with a specified weld procedure, in order to make one or more test specimens

3.12**test specimen**

portion detached from a test piece, in specified dimensions, finally prepared as required for testing

4 Materials

Any suitable steel is permissible; a list of examples is given in Table 1. The properties of the materials should be taken from the applicable standards.

5 Design**5.1 General**

The rules for the design of enclosures of gas-insulated switchgear and controlgear prescribed in this clause are solely for the purpose of determining the dimensions and the minimum thickness to ensure safety of the enclosures against gross plastic deformation, incremental collapse and collapse through buckling with the materials given in clause 4.

The rules take into account that these enclosures are subjected to particular operating conditions (clause 1) which distinguish them from compressed air receivers and similar storage vessels.

The thicknesses determined by the various equations are minima and therefore the specific nominal thickness shall be increased by the amount of any negative tolerance permitted by the material specification.

NOTE There are designs of enclosures which differ in geometry from those for which equations are given in sub-clauses 5.7 and 5.8. These are permitted provided the calculations are justified or proof tests are carried out as prescribed in 7.5.3.

5.2 Corrosion allowance

The enclosures are filled in service with a non-corrosive thoroughly dried gas, therefore, no internal corrosion allowance is necessary.

5.3 Design considerations

The geometry of an enclosure may be determined by electrical rather than mechanical considerations. This constraint can result in an enclosure geometry which requires an unacceptable degree of calculation or which cannot be calculated at all.

In the case of such an enclosure or an enclosure for which calculations are not made, a proof test of the individual housing is necessary before the internal parts are added.

Table 1 — Examples of materials (not exhaustive; other steels may be used from national standards)

Euro	Standard	Germany	Austria	Switzerland	France	Sweden	Italy	U.K.
25	Fe36OB Fe36OC Fe36OD Fe51OD	DIN 17100 ST 52-3 UST 37-2 RST 37-2 ST 37-3	As Germany	DIN 17440 x 6 Cr Ni 1810 x 2 Cr Ni 1911 x 6 Cr Ni Ti 1810	NFA 36 – 205 A37 – CP A37 – AP A37 – FP A42 – CP A42 – AP A42 – FP A48 – CP A48 – AP A48 – FP	SS14 13 30-01 SS14 14 30-01 SS14 14 32-01 SS14 21 06-01 SS14 21 17-01	UN1 5869-75 UN1 7382-75 UN1 7070-82 UN1 8317-81 UN1 7660-77 [forgings]	BS 1501 151 400 151 430A 321 S12 BS 1449 321 S12 BS 970 316 S16 BS 4360 Grade 43A
28	Fe42-1KP Fe42-1KW Fe42-2KW	DIN 17440		KBL HII				
11	T1-3 FeE355KG FeE355KT	x 6 Cr Ni Ti 1810 x 6 Cr Ni Nb 1810			A52 – CP A52 – AP A52 – FP	SS 142333 SS 142343	UN1 7660-77	
30	Fe42B1 Fe42B3 Fe42-3				NFA 36 – 601 [forgings] A37 – CP A37 – AP A37 – FP A42 – CP A42 – AP A42 – FP A48 – CP A48 – AP A48 – FP			
NOTE Alignment of materials horizontally does not imply equivalence.								

When designing an enclosure, account shall be taken of the following, if applicable.

- a) The possible evacuation of the enclosures as part of the filling process.

For enclosures of this type it is usually necessary to evacuate the air before introducing gas pressure, this ensures purity of the gas. The evacuated condition is therefore not an operational condition and in most cases enclosures designed for internal pressure will be suitable for the evacuated condition without buckling.

For certain long lengths and large diameters of busbar sections, however, it is possible that the enclosure will buckle due to external pressure. In such cases the design should be checked for external pressure and the enclosure strengthened if necessary. Since this is not an operational condition it is not a matter of safety.

- b) The full differential pressure possible across the enclosure wall.

- c) Superimposed loads and vibrations by external effects.

- d) Stresses caused by temperature differences including transient conditions and by differences in coefficients of thermal expansion.

- e) Effects of solar radiation.

NOTE Pressure stresses due to an internal electrical fault are not considered in the design of an enclosure since after such an occurrence the enclosure would be carefully checked and, if necessary, replaced.

For the case of arcing due to an internal fault, reference is made to HD 358 S2 (IEC 517 (1986) ed 2).

5.4 Design pressure

The design is based on the design pressure as defined in clause 3.5.

5.5 Design temperature

The selection of material and the determination of the design stress depend upon the highest wall temperature which can be expected during service at the design pressure (p).

5.6 Design stress basis

The nominal design strength K shall be selected from the material standard, where

K = yield strength or 0,2 % proof stress at the design temperature.

(For austenitic steels the 1 % proof stress may be used).

The safety factor against yield strength, 0,2 % proof stress or 1 % proof stress, is $S = 1,5$. Hence it follows the permissible design stress $\sigma = K/1,5$.

5.7 Calculation of shells, dished ends, openings, screws and bolts

For the purpose of calculation of shells, dished ends, bolts, screws and openings the following specific symbols are used:

D_a	external diameter of shells	mm
D_i	internal diameter of shells	mm
D_k	design diameter	mm
D_m	mean diameter of gaskets	mm
d_i	internal diameter of openings and branches	mm
t	required wall thickness	mm
l'_s	protruding length of branches	mm
t_A	required wall thickness at openings	mm
t_S	branch wall thickness	mm
x	distance over which the governing stress is assumed to act	mm
R	crown radius of dished ends	mm
r	knuckle radius	mm
h_1	height of the straight flange of dished ends	mm
h_2	depth of dished ends	mm
v	weld joint factor	

v_A	weakening factor	—
p	design pressure	bar
p_B	buckling pressure	bar
P_s	total screw clamping force	N
P_i	loading of an area (A) with regard to internal pressure	N
A_b	design area of screw threads	mm ²
L	centre distance of branches	mm
β	design factor	
n	number of screws per flange joint $P_s/P_i = P'_s/P'_i$	—
P'_i	loading per screw = P_i/n	N
P'_s	clamping force per screw = P_s/n	N

5.7.1 Cylindrical shells

The required wall thickness is:

$$t = \frac{D_a \cdot p}{20 (K/1,5) \cdot v + p} \quad (\text{Equation 1})$$

The minimum permissible wall thickness of cylindrical shells is 3 mm.

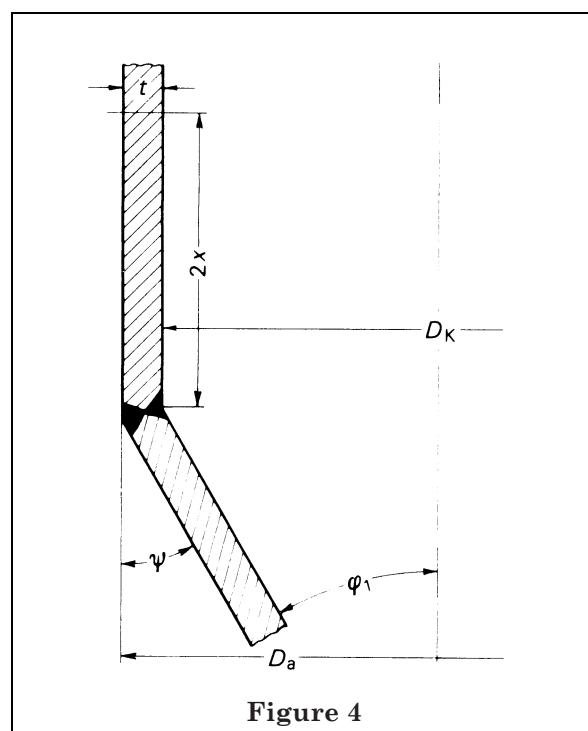
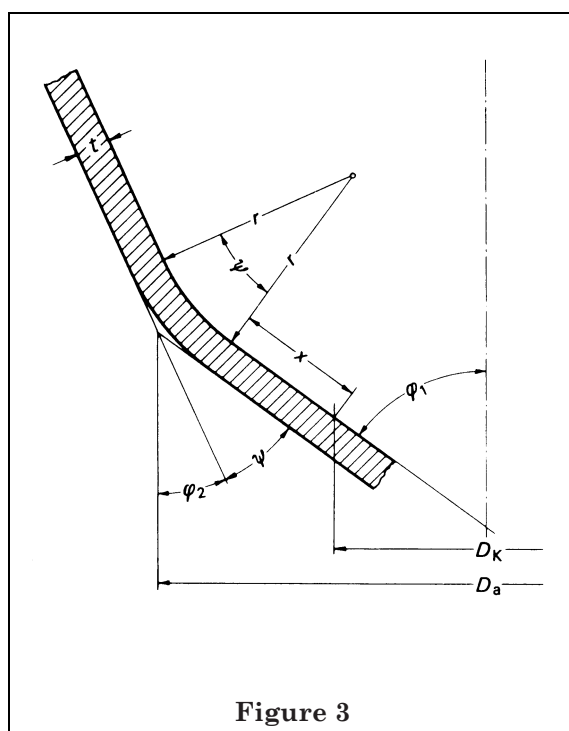
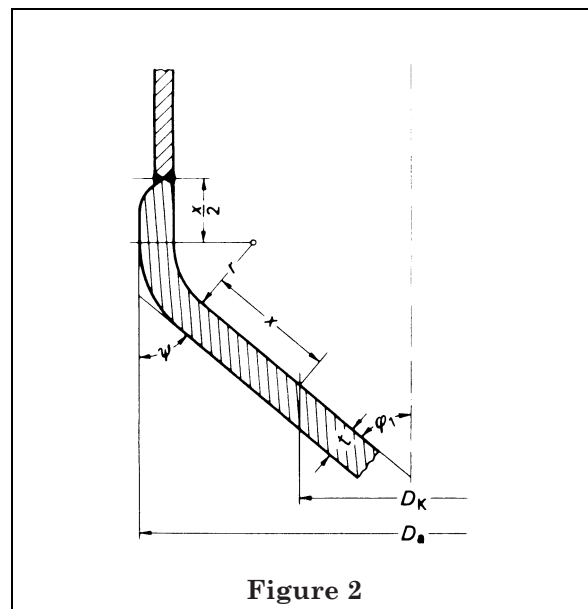
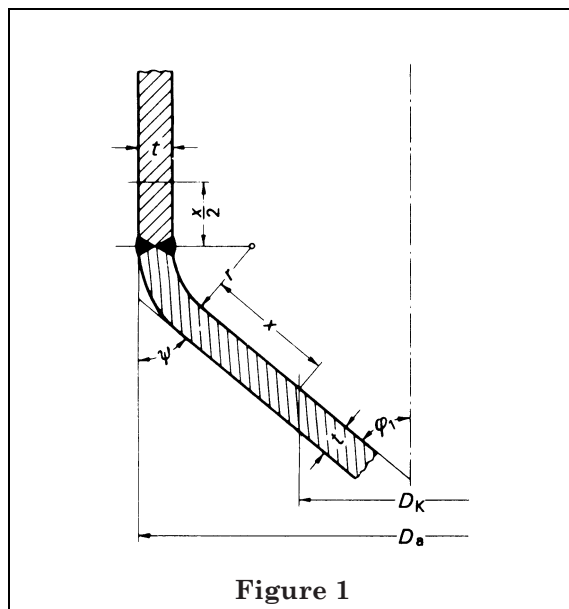


Figure 1 to Figure 4 — Typical connections between cylindrical and conical shells

5.7.2 Spherical shells

The required wall thickness is:

$$t = \frac{D_a \cdot p}{40 (K/1,5) \cdot v + p} \quad (\text{Equation 2})$$

The minimum permissible wall thickness of spherical shells is 3 mm.

5.7.3 Conical shells

The determination of the wall thickness of conical shells is based on the stress in the meridional direction (bending stress) in the knuckle or the circumferential joint at the wide end of the cone and the stress in the tangential direction (membrane stress) away from the knuckle (see Figure 1 to Figure 4). The greater wall thickness calculated according to 5.7.3.1 or 5.7.3.2 is to be taken into consideration. For the shallow conical shells with an angle of slope to the axis of the cone $\varphi_1 > 70^\circ$ the wall thickness shall be determined according to 5.7.3.3 even if smaller wall thicknesses as according to 5.7.3.1 and 5.7.3.2 are found.

In equations 3 and 7 the weld joint factor (v) refers to the circumferential joint and in equation 6 to the longitudinal joint.

If the distance between the circumferential joint and the knuckle is at least $0,5x$ then the equations 3 and 7 is the weld joint factor $v = 1,0$.

The minimum permissible wall thickness of conical shells is 3 mm.

5.7.3.1 Calculation based on the stress in meridional direction

The required wall thickness is:

$$t = \frac{D_a \cdot p \cdot \beta}{40 (K/1,5) \cdot v} \quad (\text{Equation 3})$$

The design factor β is to be taken from Table 2 or Figure 5 depending on the difference Ψ between the angles of slope of two adjoining shells

$$\Psi = \varphi_1 - \varphi_2 \quad (\text{Equation 4})$$

and the ratio of the knuckle radius by the external diameter of the shell r/D_a .

A. Shells with knuckle (Figure 1 and Figure 2)

If the wide end of a conical shell is flanged to a knuckle then the wall thickness in the knuckle shall be determined according to equation 3 and shall be maintained away from the knuckle in the conical section over a distance of at least

$$x = \sqrt{D_a \cdot t} \quad (\text{Equation 5})$$


and along the cylindrical section over a distance of at least $0,5x$.

B. Shells without knuckle (Figure 4)

Conical shells may be connected with each other or with cylindrical shells by means of welded butt joints providing the following is met:

- $\Psi \leq 30^\circ$;
- joints welded from both sides;
- the length of the two shells shall be at least $2x$ according to equation 5.

If deviating from b) the butt joints are to be welded from one side only, then equivalence with joints welded from both sides shall be demonstrated by a welding procedure test.

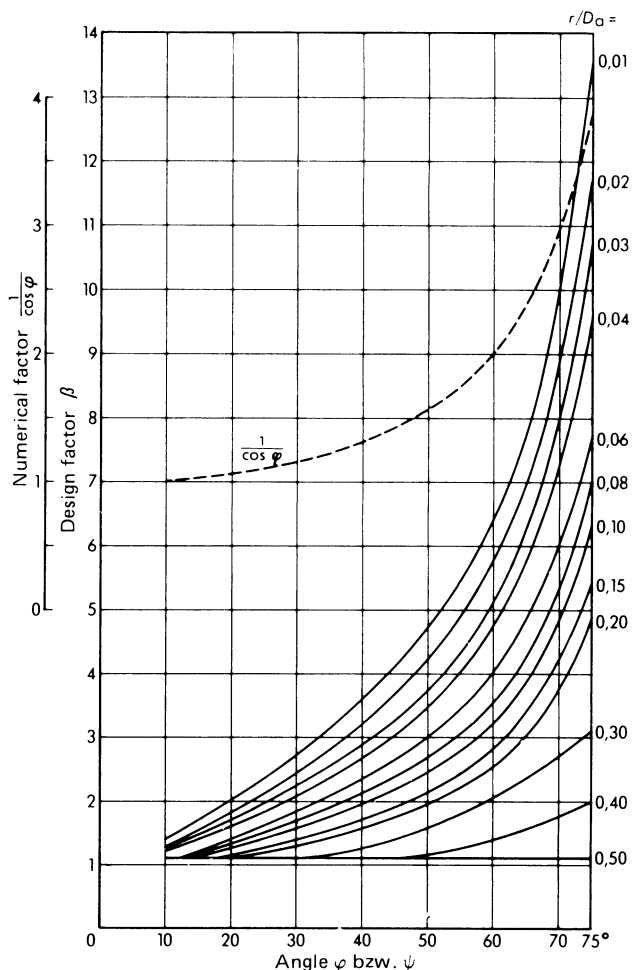Figure 5 — Design factor β and numerical factor $1/\cos \varphi$ Table 2 — Design factor β for conical shells and numerical factors $\cos \varphi$ and $1/\cos \varphi$

Angle φ resp. ψ	β for a ratio of r/D_a												$\cos \varphi$	$\frac{1}{\cos \varphi}$
	0,01	0,02	0,03	0,04	0,06	0,08	0,10	0,15	0,2	0,3	0,4	0,5		
10	1,4	1,3	1,2	1,2	1,1	1,1	1,1	1,1	1,1	1,1	1,1	1,1	0,985	1,015
20	2,0	1,8	1,7	1,6	1,4	1,3	1,2	1,1	1,1	1,1	1,1	1,1	0,940	1,064
30	2,7	2,4	2,2	2,0	1,8	1,7	1,6	1,4	1,3	1,1	1,1	1,1	0,866	1,155
45	4,1	3,7	3,3	3,0	2,6	2,4	2,2	1,9	1,8	1,4	1,1	1,1	0,707	1,414
60	6,4	5,7	5,1	4,7	4,0	3,5	3,2	2,8	2,5	2,0	1,4	1,1	0,500	2,000
70	10,0	9,0	8,0	7,2	6,0	5,3	4,9	4,2	3,7	2,7	1,7	1,1	0,342	2,920
75	13,6	11,7	10,7	9,5	7,7	7,0	6,3	5,4	4,8	3,1	2,0	1,1	0,259	3,861

The wall thickness for both shells at the butt joint shall be determined under consideration of the bending stress in the circumferential seam according to equation 3.

5.7.3.2 Calculation based on the stress in tangential direction

The required wall thickness is:

$$t = \frac{D_k \cdot p}{20 (K/1,5) \cdot v - p} \cdot \frac{1}{\cos \varphi_1} \quad (\text{Equation 6})$$

where the weld joint factor (v) is the efficiency of the longitudinal joint and the numerical factor $1/\cos \varphi_1$ has been taken from Table 2 or Figure 5.

The design diameter (D_k) is to be determined according to Figure 1 to Figure 4 and the distance x according to equation 5.

In the case of conical shells connected with each other the wall thickness shall be calculated for each shell with its individual angle of slope to the axis (φ_1 or φ_2) of the enclosure.

5.7.3.3 Shallow conical shells ($\varphi_1 > 70^\circ$)

The required wall thickness is:

$$t = 0,3 (D_a - r) \frac{\psi_1}{90} \sqrt{\frac{p}{10 (K/1,5) \cdot v}} \quad (\text{Equation 7})$$

If the distance between knuckle and circumferential joint is at least:

$$x = 0,5 \sqrt{\frac{D_a \cdot t}{\cos \varphi_1}} \quad (\text{Equation 8})$$

then the weld joint factor is $v = 1,0$.

Provided the requirements for shells without knuckle are met (see 5.7.3.1), conical shells with different angles of slope may be joined by butt welds. This requires a knuckle radius of $r = 0$ in equation 7.

5.7.4 Dished ends subject to internal pressure

5.7.4.1 General

These rules apply for torispherical dished ends (see Figure 6) of the Korbogen and Klöpper type and for hemispherical dished ends subject to internal pressure within the following limits:

A. Klöpper type

$$R = D_a$$

$$r = 0,1D_a$$

$$h_1 \geq 3,5t$$

$$h_2 = 0,1935D_a - 0,455t$$

$$0,001 \leq t/D_a \leq 0,1 \quad (\text{Equation 9})$$

B. Korbogen type

$$R = 0,8D_a$$

$$r = 0,154D_a$$

$$h_1 \geq 3,0t$$

$$h_2 = 0,255D_a - 0,635t$$

$$0,001 \leq t/D_a \leq 0,1 \quad (\text{Equation 10})$$

C. Hemispherical dished ends

$$D_a/D_i \leq 1,2 \quad (\text{Equation 11})$$

Other configurations for dished ends may be used with appropriate calculation or proof test.

Up to a wall thickness of 50 mm the height of the straight flange (h_1) need not exceed 150 mm. With hemispherical dished ends no straight flange is required.

Shorter straight flanges (h_1) are acceptable provided the circumferential joint between dished end and cylindrical shell is non-destructively tested to the same extent as a fully strengthened butt joint with a design stress level equal to the permissible design stress level.

If a dished end is welded together from crown and knuckle components, the joint shall be at a sufficient distance from the knuckle. The distance shall be regarded to be sufficient, if in the case where

a) crown and knuckle are of different thickness (see Figure 8)

$$x = 0,5 \sqrt{R \cdot t} \quad (\text{Equation 12})$$

b) crown and knuckle are of equal thickness (see Figure 6)

$x = 3,5t$ for dished ends of the Klöpper type

$x = 3,0t$ for dished ends of the Korbboogen type

with a minimum however of at least 100 mm.

NOTE When determining the transition from the knuckle to the crown of a dished end the starting point shall be the internal diameter. With thin-walled dished ends of the Klöpper type the transition is about $0,89D_i$, and with thin-walled dished ends of the Korbboogen type it is about $0,86D_i$. These factors get less as the wall thickness increases.

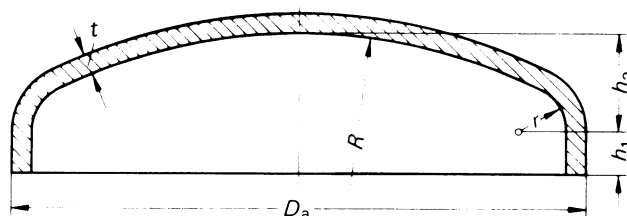


Figure 6 — Dished end

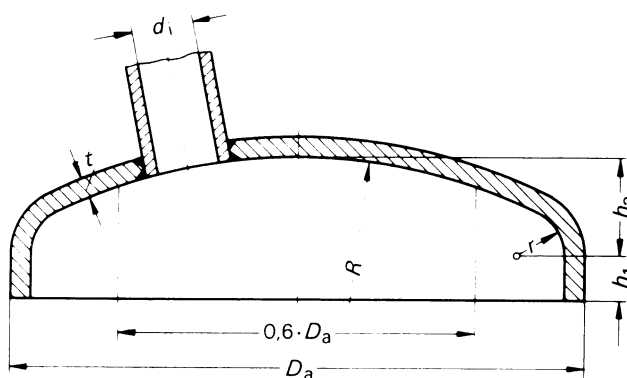


Figure 7 — Dished end with branch

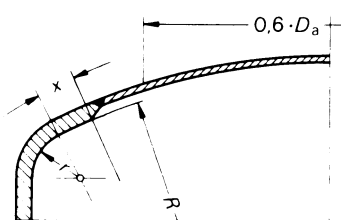


Figure 8 — Dished end with knuckle and crown of unequal wall thickness

5.7.4.2 Percentage of the permissible design stress level in joints

A weld joint factor $v = 1,0$ may be applied, if the extent of testing corresponds to that specified for a design stress level equal to the permissible design stress level or if the dished end is made from one plate.

A weld joint factor $v = 1,0$ may also be applied in the case of welded dished ends (with the exception of hemispherical dished ends) regardless of the extent of testing provided the welded joint intersects the crown area of $0,6D_a$ (see Figure 10 and Figure 11). If the welded joint does not intersect the crown area of $0,6D_a$, the weld joint factor is $v = 0,75$ or $v = 1,0$ according to the extent of testing (see Figure 9 and Figure 12).

5.7.4.3 Weakening due to openings and branches (Figure 7)

Openings in the crown are of $0,6D_a$ of dished ends of the Korbogen and Klöpper type and in hemispherical dished ends are to be checked for adequate reinforcement according to 5.7.5 without taking into account the design factor β . In the case of pad reinforcement the pad shall not go beyond $0,8D_a$ with dished ends of the Klöpper type and $0,7D_a$ with dished ends of the Korbogen type.

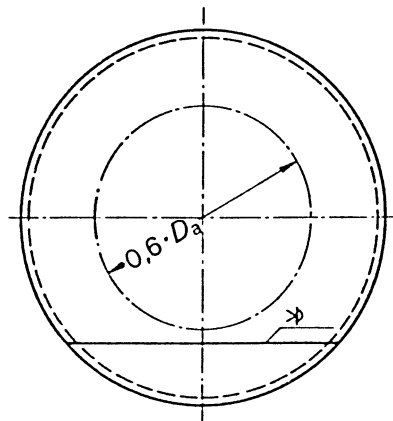


Figure 9 — Welded joint outside $0,6D_a$: $v = 0,75$ resp. $1,0$

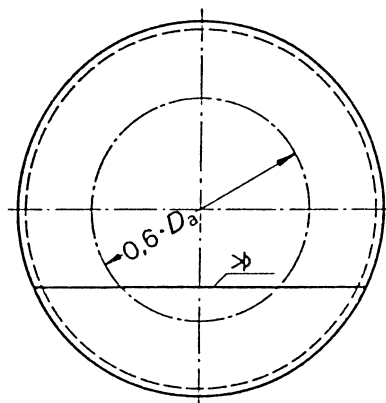


Figure 10 — Welded joint inside $0,6D_a$: $v = 1,0$

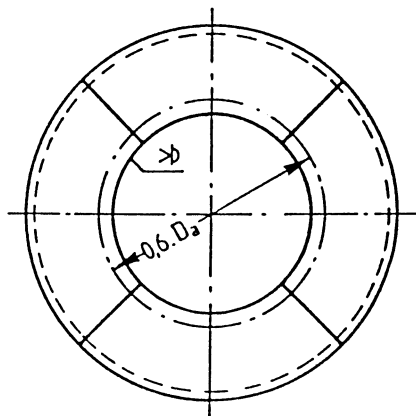


Figure 11 — Welded dished end from crown and knuckle components inside $0,6D_a$: $v = 1,0$

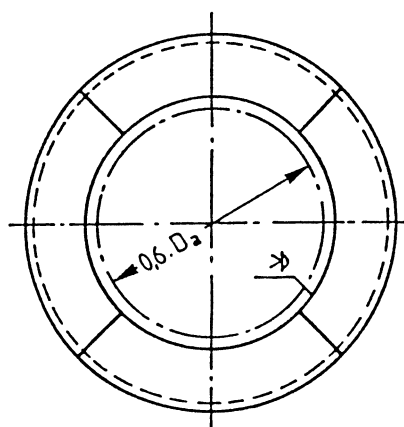


Figure 12 — Welded dished end from crown and knuckle components outside $0,6D_a$: $v = 0,75$ resp. $1,0$

For openings outside the crown area of $0,6D_a$ increased design factors β according to Figure 13 and Figure 14 apply. Where the ligament between adjacent openings is not entirely within $0,6D_a$ then the minimum width of the ligament shall be at least equal to the sum of half the opening diameters measured on the distance between the centres of the openings.

5.7.4.4 Calculation rules

The required wall thickness of the crown is:

$$t = \frac{D_a \cdot p}{40 (K/1,5) \cdot v + p} \quad (\text{Equation 13})$$

The required wall thickness of the knuckle is:

$$t = \frac{D_a \cdot p \cdot \beta}{40 (K/1,5) \cdot v} \quad (\text{Equation 14})$$

The design factors β for dished ends (with or without openings and branches) are to be taken from;

- Figure 13 for dished ends of the Klöpper type
- Figure 14 for dished ends of the Korbboogen type

as a function of t/D_a and d_i/D_a .

The curves with $d_i/D_a > 0$ apply for reinforced openings in the whole crown and knuckle area. The design factor $\beta = 1,1$ applies regardless of the wall thickness to hemispherical dished ends in a distance of:

$$x = 0,5 \sqrt{R \cdot t} \quad (\text{Equation 15})$$

adjacent to the welded joint.

With dished ends of the Klöpper type and Korbogen type subject to internal pressure an additional check is required to make sure whether the knuckle is adequately dimensioned to prevent elastic buckling (the formation of folds in the knuckle). This is the case where the buckling pressure (p_B) according to Figure 15 is equal or higher than 1,5 times the design pressure (p).

The minimum permissible wall thickness of dished ends is 3 mm.

The stress distribution due to internal pressure in dished ends of the Korbogen and Klöpper type is determined by means of the elastic analysis (see Annex A).

5.7.5 Openings in cylindrical, conical and spherical shells subject to internal pressure

5.7.5.1 General

These rules apply for circular openings in cylindrical, conical and spherical shells subject to internal pressure and for their compensation.

These rules cover ratios of $d_i/D_a \leq 1,0$.

NOTE Experience has shown that in the case of great diameter ratios, stresses occur in the cross section perpendicular to the enclosure axis (gusset area).

The results available from research work in this field are not sufficient as to establish general design rules. Generally, these stresses do not result in failure as long as no creep occurs and damage by cyclic loading is not expected.

Additional external forces and moments are not covered by these rules and are therefore to be considered separately.

For conical shells these rules apply only if the wall thickness is determined by the circumferential stress.

These rules permit plastic deformations of up to 1 % at highly stressed local areas during pressure test. Therefore openings shall be designed carefully. Abrupt changes of geometry should be avoided.

5.7.5.2 Compensation methods

A. Increased wall thickness of the shell

Openings are reinforced by increasing the wall thickness of the shell (see Figure 16 and Figure 17).

B. Local increase of the wall thickness

Openings are reinforced by means of a set-in or set-on ring or pad (see Figure 18 and Figure 19).

C. Increased wall thickness of the branch

Openings are reinforced by increasing the wall thickness of the branch (see Figure 20 and Figure 21).

