

Batch control —

Part 1: Models and terminology

The European Standard EN 61512-1:1999 has the status of a British Standard

ICS 01.040.25; 25.040.40

National foreword

This British Standard is the English language version of EN 61512-1:1999. It is identical with IEC 61512-1:1997.

The UK participation in its preparation was entrusted by Technical Committee GEL/65, Measurement and control, to Subcommittee GEL/65/1, System considerations, which has the responsibility to:

- aid enquirers to understand the text;
- present to the responsible international/European committee any enquiries on the interpretation, or proposals for change, and keep the UK interests informed;
- monitor related international and European developments and promulgate them in the UK.

A list of organizations represented on this subcommittee can be obtained on request to its secretary.

From 1 January 1997, all IEC publications have the number 60000 added to the old number. For instance, IEC 27-1 has been renumbered as IEC 60027-1. For a period of time during the change over from one numbering system to the other, publications may contain identifiers from both systems.

Cross-references

Attention is drawn to the fact that CEN and CENELEC Standards normally include an annex which lists normative references to international publications with their corresponding European publications. The British Standards which implement these international or European publications may be found in the BSI Standards Catalogue under the section entitled “International Standards Correspondence Index”, or by using the “Find” facility of the BSI Standards Electronic Catalogue.

A British Standard does not purport to include all the necessary provisions of a contract. Users of British Standards are responsible for their correct application.

Compliance with a British Standard does not of itself confer immunity from legal obligations.

Summary of pages

This document comprises a front cover, an inside front cover, the EN title page, pages 2 to 89, the annex ZA page, an inside back cover and a back cover.

The BSI copyright notice displayed in this document indicates when the document was last issued.

This British Standard, having been prepared under the direction of the Electrotechnical Sector Committee, was published under the authority of the Standards Committee and comes into effect on 15 October 1999

© BSI 10-1999

ISBN 0 580 35060 6

Amendments issued since publication

Amd. No.	Date	Comments

English version

Batch control
Part 1: Models and terminology
(IEC 61512-1:1997)

Contrôle-commande des processus
de fabrication par lots
Partie 1: Modèles et terminologie
(CEI 61512-1:1997)

Chargenorientierte Fahrweise
Teil 1: Modelle und Terminologie
(IEC 61512-1:1997)

This European Standard was approved by CENELEC on 1999-05-01. CENELEC members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration.

Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the Central Secretariat or to any CENELEC member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CENELEC member into its own language and notified to the Central Secretariat has the same status as the official versions.

CENELEC members are the national electrotechnical committees of Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Iceland, Ireland, Italy, Luxembourg, Netherlands, Norway, Portugal, Spain, Sweden, Switzerland and United Kingdom.

CENELEC

European Committee for Electrotechnical Standardization
Comité Européen de Normalisation Electrotechnique
Europäisches Komitee für Elektrotechnische Normung

Central Secretariat: rue de Stassart 35, B - 1050 Brussels

Foreword

The text of the International Standard IEC 61512-1:1997, prepared by SC 65A, System aspects, of IEC TC 65, Industrial-process measurement and control, was submitted to the formal vote and was approved by CENELEC as EN 61512-1 on 1999-05-01 without any modification.

The following dates were fixed:

- latest date by which the EN has to be implemented
at national level by publication of an identical
national standard or by endorsement (dop) 2000-08-01
- latest date by which the national standards conflicting
with the EN have to be withdrawn (dow) 2002-08-01

Annexes designated "normative" are part of the body of the standard.

Annexes designated "informative" are given for information only.

In this standard, annexes A and ZA are normative and annex B is informative.

Annex ZA has been added by CENELEC.

Endorsement notice

The text of the International Standard IEC 61512-1:1997 was approved by CENELEC as a European Standard without any modification.

CONTENTS

	Page
INTRODUCTION	6
Clause	
1 Scope	7
2 Normative references	7
3 Definitions	7
4 Batch processes and equipment	12
4.1 Processes, batches and batch processes	12
4.1.1 Continuous processes	12
4.1.2 Discrete parts manufacturing processes	12
4.1.3 Batch processes	12
4.2 Physical model	14
4.2.1 Enterprise level	16
4.2.2 Site level	16
4.2.3 Area level	16
4.2.4 Process cell level	16
4.2.5 Unit level	17
4.2.6 Equipment module level	17
4.2.7 Control module level	17
4.3 Process cell classification	18
4.3.1 Classification by number of products	18
4.3.2 Classification by physical structure	18
5 Batch control concepts	20
5.1 Structure for batch control	21
5.1.1 Basic control	21
5.1.2 Procedural control	21
5.1.3 Coordination control	23
5.2 Equipment entities	24
5.2.1 Procedural control model/physical model/process model relationship	24
5.2.2 Equipment control in equipment entities	24
5.2.3 Structuring of equipment entities	28
5.3 Recipes	29
5.3.1 Recipe types	29
5.3.2 Recipe contents	32
5.3.3 Control recipe procedure/equipment control relationship	37
5.3.4 Recipe transportability	45
5.4 Production plans and schedules	46

Clause	Page
5.5 Production information	47
5.5.1 Batch-specific information	47
5.5.2 Common (non-batch specific) batch information	48
5.5.3 Batch history	48
5.5.4 Batch reports	48
5.6 Allocation and arbitration	49
5.6.1 Allocation	49
5.6.2 Arbitration	50
5.7 Modes and states	50
5.7.1 Modes	50
5.7.2 States	52
5.8 Exception handling	55
6 Batch control activities and functions	56
6.1 Management activities	56
6.1.1 Control activity model	56
6.1.2 Information handling	58
6.1.3 Process and control engineering	60
6.2 Recipe management	61
6.2.1 Manage general recipes	61
6.2.2 Define general recipe procedural elements	62
6.2.3 Manage site recipes	63
6.2.4 Manage master recipes	63
6.2.5 Define master recipe procedural elements	64
6.3 Production planning and scheduling	65
6.4 Production information management	65
6.4.1 Receiving and storing batch history information	66
6.4.2 Manipulating historical data	69
6.4.3 Producing batch reports	69
6.5 Process management	71
6.5.1 Manage batches	72
6.5.2 Manage process cell resources	74
6.5.3 Collect batch and process cell information	75
6.6 Unit supervision	75
6.6.1 Acquire and execute procedural elements	76
6.6.2 Manage unit resources	77
6.6.3 Collect batch and unit information	77
6.7 Process control	78
6.7.1 Execute equipment phases	79
6.7.2 Execute basic control	80
6.7.3 Collect data	80
6.8 Personnel and environmental protection	81

Figures	Page
1 Process model (entity-relationship diagram).....	14
2 Physical model	15
3 Single-path structure	18
4 Multiple-path structure.....	19
5 Network structure	20
6 Procedural control model.....	22
7 Procedural control/equipment mapping to achieve process functionality.....	25
8 Recipe types	30
9 General recipe procedure.....	34
10 Master recipe procedure	35
11 Procedural element relationships in the site recipe and master recipe	36
12 Control recipe procedure/equipment control separation.....	38
13 Control recipe procedure example with unit procedures, operations and phases	40
14 Control recipe procedure example with unit procedures and operations.....	41
15 Control recipe procedure example with unit procedures	42
16 Control recipe procedure example with only a procedure	43
17 Control recipe procedure/equipment control collapsibility examples.....	45
18 State transition diagram for example states for procedural elements.....	55
19 Management activity model	57
20 Simultaneous definition/selection of procedural elements and equipment entities.....	60
21 Recipe management	62
22 Process management	72
23 Unit supervision.....	76
24 Process control	79
 Tables	
1 Possible implementations of example modes.....	51
2 State transition matrix for example states for procedural elements.....	54
 Annexes	
A Model philosophy.....	82
B Bibliography	89
ZA Normative references to international publications with their corresponding European publications	90

INTRODUCTION

The models and terminology defined in this part of IEC 61512

- emphasize good practices for the design and operation of batch manufacturing plants;
- can be used to improve control of batch manufacturing plants; and
- can be applied regardless of the degree of automation.

Specifically, this standard provides a standard terminology and a consistent set of concepts and models for batch manufacturing plants and batch control that will improve communications between all parties involved; and that will

- reduce the user's time to reach full production levels for new products;
- enable vendors to supply appropriate tools for implementing batch control;
- enable users to better identify their needs;
- make recipe development straightforward enough to be accomplished without the services of a control systems engineer;
- reduce the cost of automating batch processes; and
- reduce life-cycle engineering efforts.

It is not the intent of this standard to

- suggest that there is only one way to implement or apply batch control;
- force users to abandon their current way of dealing with their batch processes; or
- restrict development in the area of batch control.

The models presented in this standard are presumed to be complete as indicated. However, they may be collapsed and expanded as described below. The unit and the control module levels may not be omitted from the physical model. The master recipe and the control recipe may not be omitted from the recipe-type model. Specific rules for collapsing and expanding these models are not covered in this standard.

- Collapsing: elements in the models may be omitted as long as the model remains consistent, and the functions of the element removed are taken into account.
- Expanding: elements may be added to the modules. When they are added between related elements, the integrity of the original relationship should be maintained.

BATCH CONTROL – Part 1: Models and terminology

1 Scope

This part of IEC 61512 on batch control defines reference models for batch control as used in the process industries and terminology that helps explain the relationships between these models and terms. This standard may not apply to all batch control applications.

2 Normative references

The following normative documents contain provisions, which through reference in this text, constitute provisions of this part of IEC 61512. At the time of publication, the editions indicated were valid. All normative documents are subject to revision, and parties to agreements based on this part of IEC 61512 are encouraged to investigate the possibility of applying the most recent editions of the normative documents indicated below. Members of IEC and ISO maintain registers of currently valid International Standards.

IEC 60848: 1988, *Preparation of function charts for control systems*

NOTE – Structures defined in IEC 60848 may be useful in the definition of procedural control and, in particular, in the definition of a phase.

IEC 60902: 1987, *Industrial-process measurement and control – Terms and definitions*

3 Definitions

For the purpose of this part of IEC 61512, the following definitions apply. Definitions found in IEC 60902 were used as a basis for definitions in this part of IEC 61512. Where necessary, the specific connotation of terms used in batch control was included.

3.1 allocation: A form of coordination control that assigns a resource to a batch or unit.

NOTE – An allocation can be for the entire resource or for portions of a resource.

3.2 arbitration: A form of coordination control that determines how a resource should be allocated when there are more requests for the resource than can be accommodated at one time.

3.3 area: A component of a batch manufacturing site that is identified by physical, geographical, or logical segmentation within the site.

NOTE – An area may contain process cells, units, equipment modules, and control modules.

3.4 basic control: Control that is dedicated to establishing and maintaining a specific state of equipment or process condition.

NOTE – Basic control may include regulatory control, interlocking, monitoring, exception handling, and discrete or sequential control.

3.5 batch

- (1) The material that is being produced or that has been produced by a single execution of a batch process.
- (2) An entity that represents the production of a material at any point in the process.

NOTE – Batch means both the material made by and during the process and also an entity that represents the production of that material. Batch is used as an abstract contraction of the words "the production of a batch."

3.6 batch control: Control activities and control functions that provide a means to process finite quantities of input materials by subjecting them to an ordered set of processing activities over a finite period of time using one or more pieces of equipment.

3.7 batch process: A process that leads to the production of finite quantities of material by subjecting quantities of input materials to an ordered set of processing activities over a finite period of time using one or more pieces of equipment.

3.8 batch schedule: A list of batches to be produced in a specific process cell.

NOTE – The batch schedule typically contains such information as what to produce, how much to produce, when or in what order the batches are needed, and what equipment to use.

3.9 common resource: A resource that can provide services to more than one requester.

NOTE – Common resources are identified as either exclusive-use resources or shared-use resources (see 3.22 and 3.54).

3.10 control module: The lowest level grouping of equipment in the physical model that can carry out basic control.

NOTE – This term applies to both the physical equipment and the equipment entity.

3.11 control recipe: A type of recipe which, through its execution, defines the manufacture of a single batch of a specific product.

3.12 coordination control: A type of control that directs, initiates, and/or modifies the execution of procedural control and the utilization of equipment entities.

3.13 enterprise: An organization that coordinates the operation of one or more sites.

3.14 equipment control: The equipment-specific functionality that provides the actual control capability for an equipment entity, including procedural, basic and coordination control, and that is not part of the recipe.

3.15 equipment entity: A collection of physical processing and control equipment and equipment control grouped together to perform a certain control function or set of control functions.

3.16 equipment module: A functional group of equipment that can carry out a finite number of specific minor processing activities.

NOTES

1 An equipment module is typically centered around a piece of process equipment (a weigh tank, a process heater, a scrubber, etc.). This term applies to both the physical equipment and the equipment entity.

2 Examples of minor process activities are dosing and weighing.

3.17 equipment operation: An operation that is part of equipment control.

- 3.18 **equipment phase:** A phase that is part of equipment control.
- 3.19 **equipment procedure:** A procedure that is part of equipment control.
- 3.20 **equipment unit procedure:** A unit procedure that is part of equipment control.
- 3.21 **exception handling:** Those functions that deal with plant or process contingencies and other events which occur outside the normal or desired behaviour of batch control.
- 3.22 **exclusive-use resource:** A common resource that only one user can use at any given time.
- 3.23 **formula:** A category of recipe information that includes process inputs, process parameters and process outputs.
- 3.24 **general recipe:** A type of recipe that expresses equipment and site-independent processing requirements.
- 3.25 **header:** Information about the purpose, source and version of the recipe such as recipe and product identification, creator, and issue date.
- 3.26 **ID:** A unique identifier for batches, lots, operators, technicians, and raw materials.
- 3.27 **line; train:** See definition for train.
- 3.28 **lot:** A unique amount of material having a set of common traits.
- NOTE – Some examples of common traits are material source, the master recipe used to produce the material and distinct physical properties.
- 3.29 **master recipe:** A type of recipe that accounts for equipment capabilities and may include process cell-specific information.
- 3.30 **mode:** The manner in which the transition of sequential functions are carried out within a procedural element or the accessibility for manipulating the states of equipment entities manually or by other types of control.
- 3.31 **operation:** A procedural element defining an independent processing activity consisting of the algorithm necessary for the initiation, organization and control of phases.
- 3.32 **path; stream:** The order of equipment within a process cell that is used, or is expected to be used, in the production of a specific batch.
- 3.33 **personnel and environmental protection:** The control activity that
- prevents events from occurring that would cause the process to react in a manner that would jeopardize personnel safety and/or harm the environment; and/or
 - takes additional measures, such as starting standby equipment, to prevent an abnormal condition from proceeding to a more undesirable state that would jeopardize personnel safety and/or harm the environment.

3.34 **phase:** The lowest level of procedural element in the procedural control model.

3.35 **procedural control:** Control that directs equipment-oriented actions to take place in an ordered sequence in order to carry out some process-oriented task.

3.36 **procedural element:** A building block for procedural control that is defined by the procedural control model.

3.37 **procedure:** The strategy for carrying out a process.

NOTE – In general, this refers to the strategy for making a batch within a process cell. It may also refer to a process that does not result in the production of a product, such as a clean-in-place procedure.

3.38 **process:** A sequence of chemical, physical, or biological activities for the conversion, transport or storage of material or energy.

3.39 **process action:** Minor processing activities that are combined to make up a process operation.

NOTE – Process actions are the lowest level of processing activity within the process model.

3.40 **process cell:** A logical grouping of equipment that includes the equipment required for production of one or more batches. It defines the span of logical control of one set of process equipment within an area.

NOTE – This term applies to both the physical equipment and the equipment entity.

3.41 **process control:** The control activity that includes the control functions needed to provide sequential, regulatory and discrete control, and to gather and display data.

3.42 **process input:** The identification and quantity of a raw material or other resource required to make a product.

3.43 **process management:** The control activity that includes the control functions needed to manage batch production within a process cell.

3.44 **process operation:** A major processing activity that usually results in a chemical or physical change in the material being processed and that is defined without consideration of the actual target equipment configuration.

3.45 **process output:** An identification and quantity of material or energy expected to result from one execution of a control recipe.

3.46 **process parameter:** Information that is needed to manufacture a material but does not fall into the classification of process input or process output.

NOTE – Examples of process parameter information are temperature, pressure and time.

3.47 **process stage:** A part of a process that usually operates independently from other process stages and that usually results in a planned sequence of chemical or physical changes in the material being processed.

3.48 recipe: The necessary set of information that uniquely defines the production requirements for a specific product.

NOTE – There are four types of recipes defined in this standard: general, site, master and control.

3.49 recipe management: The control activity that includes the control functions needed to create, store and maintain general, site and master recipes.

3.50 recipe operation: An operation that is part of a recipe procedure in a master or control recipe.

3.51 recipe phase: A phase that is part of a recipe procedure in a master or control recipe.

3.52 recipe procedure: The part of a recipe that defines the strategy for producing a batch.

3.53 recipe unit procedure: A unit procedure that is part of a recipe procedure in a master or control recipe.

3.54 shared-use resource: A common resource that can be used by more than one user at a time.

3.55 site: A component of a batch manufacturing enterprise that is identified by physical, geographical, or logical segmentation within the enterprise.

NOTE – A site may contain areas, process cells, units, equipment modules and control modules.

3.56 site recipe: A type of recipe that is site-specific.

NOTE – Site recipes may be derived from general recipes recognizing local constraints, such as language and available raw materials.

3.57 state: The condition of an equipment entity or of a procedural element at a given time.

NOTE – The number of possible states and their names vary for equipment and for procedural elements.

3.58 stream; path: See definition for path.

3.59 train; line: A collection of one or more units and associated lower level equipment groupings that has the ability to be used to make a batch of material.

3.60 unit: A collection of associated control modules and/or equipment modules and other process equipment in which one or more major processing activities can be conducted.

NOTES

1 Units are presumed to operate on only one batch at a time. Units operate relatively independently of one another.

2 This term applies to both the physical equipment and the equipment entity.

3 Examples of major processing activities are react, crystallize, and make a solution.

3.61 unit procedure: A strategy for carrying out a contiguous process within a unit. It consists of contiguous operations and the algorithm necessary for the initiation, organization and control of those operations.

3.62 unit recipe: The part of a control recipe that uniquely defines the contiguous production requirements for a unit.

NOTE – The unit recipe contains the unit procedure and its related formula, header, equipment requirements and other information.

3.63 unit supervision: The control activity that includes control functions needed to supervise the unit and the unit's resources.

4 Batch processes and equipment

This clause provides an overview of batch processing and the batch manufacturing plant. The models and terminology defined in this clause provide a foundation for understanding the application of batch control to the batch manufacturing plant in clauses 5 and 6. Specifically, this clause discusses batch processes, a physical model, and process cell classification.

4.1 *Processes, batches and batch processes*

A process is a sequence of chemical, physical or biological activities for the conversion, transport or storage of material or energy. Industrial manufacturing processes can generally be classified as continuous, discrete parts manufacturing or batch. How a process is classified depends on whether the output from the process appears in a continuous flow (continuous), in finite quantities of parts (discrete parts manufacturing), or in finite quantities of material (batches). Although aspects of this standard may apply to discrete parts manufacturing or continuous processes, this standard does not specifically address these types of processes.

4.1.1 *Continuous processes*

In a continuous process, materials are passed in a continuous flow through processing equipment. Once established in a steady operating state, the nature of the process is not dependent on the length of time of operation. Start-ups, transitions and shutdowns do not usually contribute to achieving the desired processing.

4.1.2 *Discrete parts manufacturing processes*

In a discrete parts manufacturing process, products are classified into production lots that are based on common raw materials, production requirements and production histories. In a discrete parts manufacturing process, a specified quantity of product moves as a unit (group of parts) between workstations, and each part maintains its unique identity.

4.1.3 *Batch processes*

The batch processes addressed in this standard lead to the production of finite quantities of material (batches) by subjecting quantities of input materials to a defined order of processing actions using one or more pieces of equipment. The product produced by a batch process is called a batch. Batch processes are discontinuous processes. Batch processes are neither discrete nor continuous; however, they have characteristics of both.

The subdivisions of a batch process can be organized in a hierarchical fashion as shown in figure 1. The example batch process used in the following subclauses is the production of polyvinyl chloride by the polymerization of vinyl chloride monomer.

4.1.3.1 *Process stages*


The process consists of one or more process stages which are organized as an ordered set, which can be serial, parallel or both. A process stage is a part of a process that usually operates independently from other process stages. It usually results in a planned sequence of chemical or physical changes in the material being processed. Typical process stages in the polyvinyl chloride process might be the following:

- polymerize: polymerize vinyl chloride monomer into polyvinyl chloride;
- recover: recover residual vinyl chloride monomer;
- dry: dry polyvinyl chloride.

4.1.3.2 *Process operations*

Each process stage consists of an ordered set of one or more process operations. Process operations represent major processing activities. A process operation usually results in a chemical or physical change in the material being processed. Typical process operations for the polymerization of vinyl chloride monomer into polyvinyl chloride process stage might be the following:

- prepare reactor: evacuate the reactor to remove oxygen;
- charge: add demineralized water and surfactants;
- react: add vinyl chloride monomer and catalyst, heat to 55 °C – 60 °C and hold at this temperature until the reactor pressure decreases.

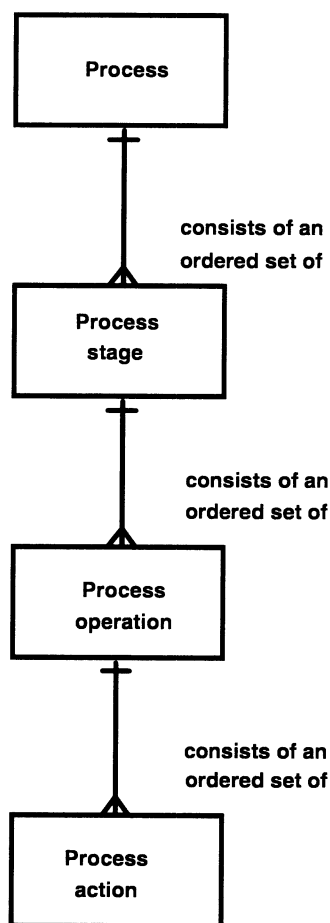

NOTE – Annex A provides an explanation of the format and general associations used in creating the diagrams in this international standard.

Figure 1 – Process model (entity-relationship diagram)

4.1.3.3 *Process actions*

Each process operation can be subdivided into an ordered set of one or more process actions that carry out the processing required by the process operation. Process actions describe minor processing activities that are combined to make up a process operation. Typical process actions for the react process operation might be the following:


- add: add the required amount of catalyst to the reactor;
- add: add the required amount of vinyl chloride monomer to the reactor;
- heat: heat the reactor contents to 55 °C – 60 °C;
- hold: hold the reactor contents at 55 °C – 60 °C until the reactor pressure decreases.

4.2 *Physical model*

The following subclauses discuss a physical model that can be used to describe the physical assets of an enterprise in terms of enterprises, sites, areas, process cells, units, equipment modules and control modules.

The physical assets of an enterprise involved in batch manufacturing are usually organized in a hierarchical fashion as described in figure 2. Lower level groupings are combined to form higher levels in the hierarchy. In some cases, a grouping within one level may be incorporated into another grouping at that same level.

The model has seven levels, starting at the top with an enterprise, a site and an area. These three levels are frequently defined by business considerations and are not modelled further in this standard. The three higher levels are part of the model to properly identify the relationship of the lower level equipment to the manufacturing enterprise.

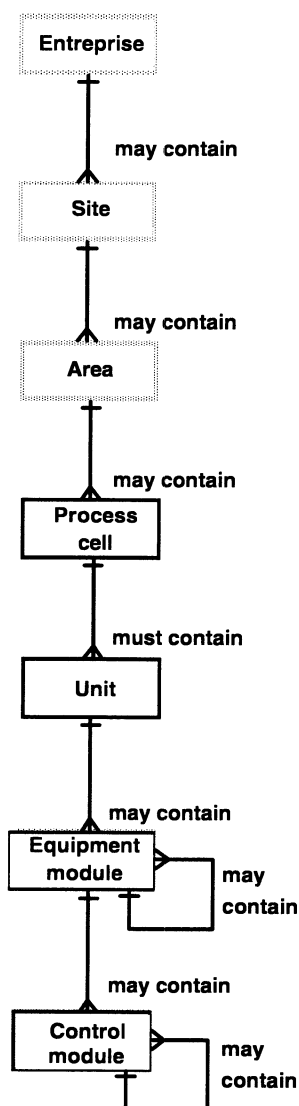

NOTE – The boxes for the top three levels are shown with slashed lines to indicate that the criteria that are used for configuring the boundaries of these three levels is often beyond the scope of batch control and this standard. Therefore, criteria for configuring the boundaries of these three levels of the physical model will not be discussed in this standard.

Figure 2 – Physical model

The lower four levels of this model refer to specific equipment types. An equipment type in figure 2 is a collection of physical processing and control equipment grouped together for a specific purpose. The lower levels in the model are specific to technically defined and bounded groupings of equipment. The four lower equipment levels (process cells, units, equipment modules and control modules) are defined by engineering activities (see 5.2.3 and 6.1.3). During these engineering activities, the equipment at lower levels is grouped together to form a new higher level equipment grouping. This is done to simplify operation of that equipment by treating it as a single larger piece of equipment. Once created, the equipment cannot be split up except by re-engineering the equipment in that level.

4.2.1 *Enterprise level*

An enterprise is a collection of one or more sites. It may contain sites, areas, process cells, units, equipment modules and control modules.

The enterprise is responsible for determining what products will be manufactured, at which sites they will be manufactured, and in general how they will be manufactured.

There are many factors other than batch control that affect the boundaries of an enterprise. Therefore, the criteria for configuring the boundaries of an enterprise are not covered in this standard.

4.2.2 *Site level*

A site is a physical, geographical, or logical grouping determined by the enterprise. It may contain areas, process cells, units, equipment modules and control modules.

The boundaries of a site are usually based on organizational or business criteria as opposed to technical criteria. There are many factors other than batch control that affect these boundaries. Therefore, the criteria for configuring the boundaries of a site are not covered in this standard.

4.2.3 *Area level*

An area is a physical, geographical, or logical grouping determined by the site. It may contain process cells, units, equipment modules and control modules.

The boundaries of an area are usually based on organizational or business criteria as opposed to technical criteria. There are many factors other than batch control that affect these boundaries. Therefore, the criteria for configuring the boundaries of an area are not covered in this standard.

4.2.4 *Process cell level*

A process cell contains all of the units, equipment modules and control modules required to make one or more batches.

Process control activities respond to a combination of control requirements using a variety of methods and techniques. Requirements that cause physical control actions may include responses to process conditions or to comply with administrative requirements.

A frequently recognized subdivision of a process cell is the train. A train is composed of all units and other equipment that may be utilized by a specific batch. A batch does not always use all the equipment in a train. Furthermore, more than one batch and more than one product may use a train simultaneously. The order of equipment actually used or expected to be used by a batch is called the path. Although a process cell may contain more than one train, no train may contain equipment outside the boundaries of the process cell.

A process cell is a logical grouping of equipment that includes the equipment required for production of one or more batches. It defines the span of logical control of one set of process equipment within an area. The existence of the process cell allows for production scheduling on a process cell basis, and also allows for process cell-wide control strategies to be designed. These process cell-wide control strategies might be particularly useful in emergency situations.

4.2.5 *Unit level*

A unit is made up of equipment modules and control modules. The modules that make up the unit may be configured as part of the unit or may be acquired temporarily to carry out specific tasks.

One or more major processing activities – such as react, crystallize, and make a solution – can be conducted in a unit. It combines all necessary physical processing and control equipment required to perform those activities as an independent equipment grouping. It is usually centered on a major piece of processing equipment, such as a mixing tank or reactor. Physically, it includes or can acquire the services of all logically related equipment necessary to complete the major processing task(s) required of it. Units operate relatively independently of each other.

A unit frequently contains or operates on a complete batch of material at some point in the processing sequence of that batch. However, in other circumstances, it may contain or operate on only a portion of a batch. This standard presumes that the unit does not operate on more than one batch at the same time.

4.2.6 *Equipment module level*

Physically, the equipment module may be made up of control modules and subordinate equipment modules. An equipment module may be part of a unit or a stand-alone equipment grouping within a process cell. If engineered as a stand-alone equipment grouping, it can be an exclusive-use resource or a shared-use resource.

An equipment module can carry out a finite number of specific minor processing activities such as dosing and weighing. It combines all necessary physical processing and control equipment required to perform those activities. It is usually centered on a piece of processing equipment, such as a filter. Functionally, the scope of the equipment module is defined by the finite tasks it is designed to carry out.

4.2.7 *Control module level*

A control module is typically a collection of sensors, actuators, other control modules, and associated processing equipment that, from the point of view of control, is operated as a single entity. A control module can also be made up of other control modules. For example, a header control module could be defined as a combination of several on/off automatic block valve control modules.

Some examples of control modules are

- a regulating device consisting of a transmitter, a controller and a control valve that is operated via the set point of the device;
- a state-oriented device that consists of an on/off automatic block valve with position feedback switches, that is operated via the set point of the device; or
- a header that contains several on/off automatic block valves and that coordinates the valves to direct flow to one or several destinations based upon the set point directed to the header control module.

4.3 Process cell classification

The following subclauses discuss the classification of process cells by the number of different products manufactured in the process cell and by the physical structure of the equipment used in the manufacturing.

4.3.1 Classification by number of products

A process cell is classified as single product or multi product based on the number of products planned for production in that process cell.

A *single-product* process cell produces the same product in each batch. Variations in procedures and parameters are possible. For example, variations may occur in order to compensate for differences in equipment, to compensate for substitute raw materials, to compensate for changes in environmental conditions or to optimize the process.

A *multi-product* process cell produces different products utilizing different methods of production or control. There are two possibilities:

- all products are produced with the same procedure using different formula values (varying materials and/or process parameters);
- the products are produced using different procedures.

4.3.2 Classification by physical structure

The basic types of physical structures discussed here are *single path*, *multiple path* and *network*.

A *single-path* structure is a group of units through which a batch passes sequentially (see figure 3). A single-path structure could be a single unit, such as a reactor, or several units in sequence. Multiple input materials are typically used; multiple finished materials may be generated. Several batches may be in progress at the same time.

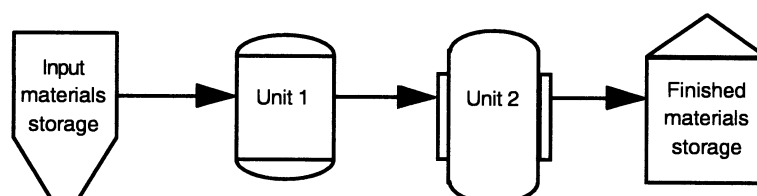


Figure 3 – Single-path structure

A *multiple-path* structure is shown in figure 4. It consists of multiple single-path structures in parallel with no product transfer between them. The units may share raw material sources and product storage. Several batches may be in progress at the same time. Although units within a multi-path structure may be physically similar, it is possible to have paths and units within a multi-path structure that are of radically different physical design.

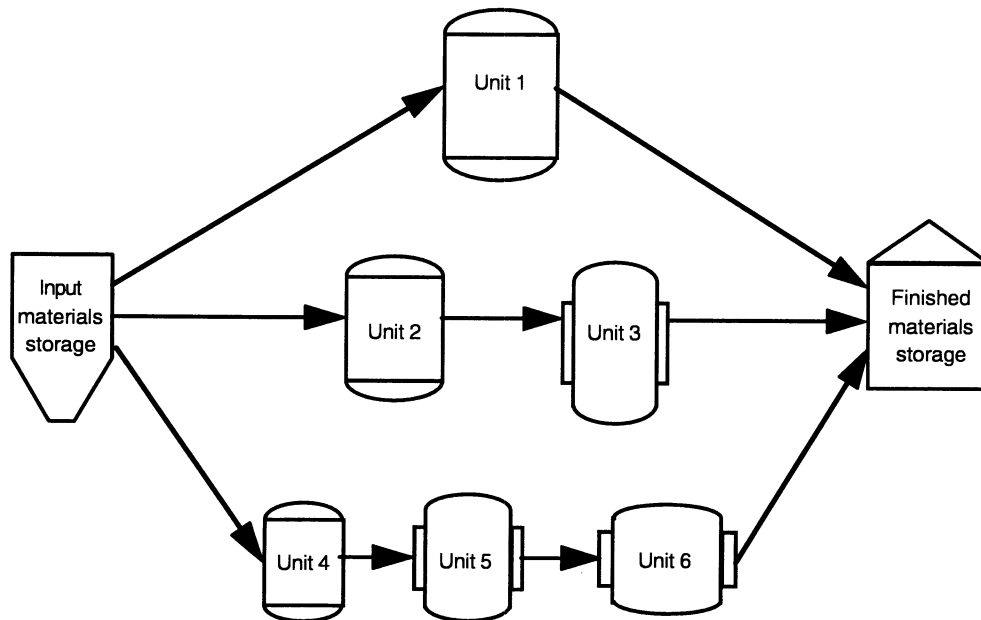


Figure 4 – Multiple-path structure

A *network* structure is shown in figure 5. The paths may be either fixed or variable. When the paths are fixed, the same units are used in the same sequence. When the path is variable, the sequence may be determined at the beginning of the batch or it may be determined as the batch is being produced. The path could also be totally flexible. For example, a batch could start with any unit and take multiple paths through the process cell. The units themselves may be portable within the process cell. In this case, verification of the process connections may be an important part of the procedures. Note that several batches may be in production at the same time. The units may share raw material sources and product storage.

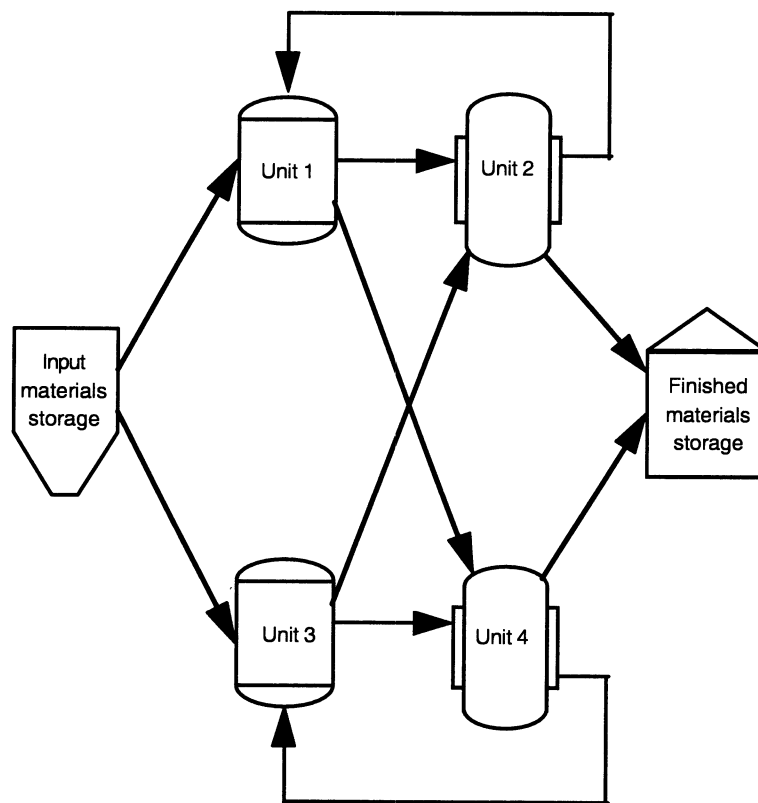


Figure 5 – Network structure

5 Batch control concepts

This clause discusses the batch control concepts needed to address the batch processing/batch manufacturing needs presented in the preceding clause and to define a consistent way of operating a batch manufacturing plant. A structure for batch control is discussed that introduces three types of control needed for batch manufacturing. When these control types are applied to equipment, the resulting equipment entities provide process functionality and control capability.

The concept of recipes is discussed, including the four types of recipes described in this standard and the contents of these recipes (in terms of the information categories used to describe a recipe). A relationship is established between the procedure in a recipe and the control associated with specific equipment entities (equipment control). The concept of collapsibility of the recipe procedure and of equipment control is discussed. Recipe transportability criteria are introduced for the four types of recipes.

Production plans and schedules, reference information, production information, allocation and arbitration, modes and states, and exception handling are other batch control concepts discussed in this clause.

The models and terminology introduced in this clause are intended to establish the necessary batch control understanding so that the control functions that are needed to address the diverse control requirements of batch manufacturing can be discussed in clause 6.

5.1 *Structure for batch control*

Clause 4 introduced a physical model that defined terms for the hierarchy of equipment typically found in a batch manufacturing environment. The following subclauses describe the three types of control (basic control, procedural control, and coordination control) typically needed in batch manufacturing.

5.1.1 *Basic control*

Basic control comprises the control dedicated to establishing and maintaining a specific state of equipment and process. Basic control

- includes regulatory control, interlocking, monitoring, exception handling and repetitive-discrete or sequential control;
- may respond to process conditions that could influence the control outputs or trigger corrective actions;
- may be activated, deactivated or modified by operator commands or by procedural or coordination control.

Basic control in a batch environment is, in principle, no different from the control of continuous processes. However, in the batch environment, there may be higher requirements on the ability for basic control to receive commands and to modify its behaviour based on these commands.

5.1.2 *Procedural control*

Procedural control directs equipment-oriented actions to take place in an ordered sequence in order to carry out a process-oriented task.

Procedural control is a characteristic of batch processes. It is the control that enables equipment to perform a batch process.

Procedural control is made up of procedural elements that are combined in a hierarchical manner to accomplish the task of a complete process as defined by the process model. The hierarchy of identified and named procedural elements is illustrated in figure 6 and consists of procedures, unit procedures, operations and phases.

5.1.2.1 *Procedure*

The procedure is the highest level in the hierarchy and defines the strategy for carrying out a major processing action such as making a batch. It is defined in terms of an ordered set of unit procedures. An example of a procedure is "make PVC."

5.1.2.2 Unit procedure

A unit procedure consists of an ordered set of operations that cause a contiguous production sequence to take place within a unit. Only one operation is presumed to be active in a unit at any time. An operation is carried to completion in a single unit. However, multiple unit procedures of one procedure may run concurrently, each in different units. Examples of unit procedures include the following:

- polymerize VCM;
- recover residual VCM;
- dry PVC.

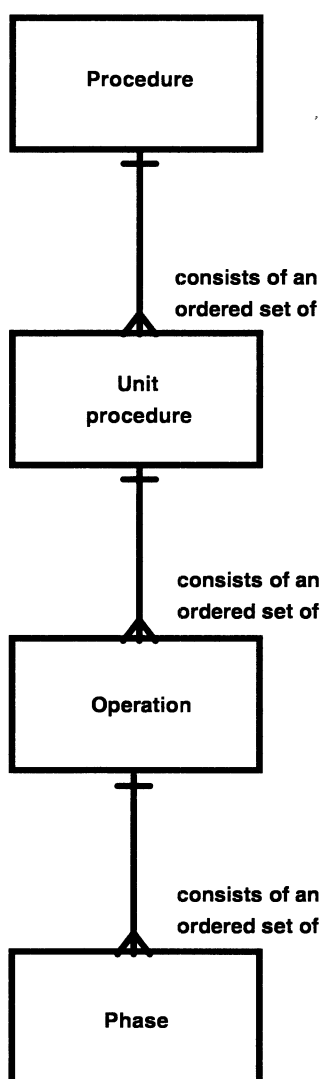


Figure 6 – Procedural control model

5.1.2.3 Operation

An operation is an ordered set of phases that defines a major processing sequence that takes the material being processed from one state to another, usually involving a chemical or physical change. It is often desirable to locate operation boundaries at points in the procedure where normal processing can safely be suspended.

Examples of operations include the following:

- preparation: pull a vacuum on the reactor and coat the walls with antifoulant;
- charge: add demineralized water and surfactants;
- react: add VCM and catalyst, heat and wait for the reactor pressure to drop.

5.1.2.4 *Phase*

A phase is the smallest element of procedural control that can accomplish a process-oriented task. A phase may be subdivided into smaller parts. The steps and transitions as described in IEC 60848 document one method of defining subdivisions of a phase.

A phase can issue one or more commands or cause one or more actions, such as

- enabling and disabling regulating and state-oriented types of basic control and specifying their set points and initial output values;
- setting, clearing, and changing alarm and other limits;
- setting and changing controller constants, controller modes and types of algorithms;
- reading process variables, such as the gas density, gas temperature and volumetric flow rate from a flow meter, and calculating the mass flow rate through the flow meter;
- conducting operator authorization checks.

The execution of a phase may result in

- commands to basic control,
- commands to other phases (either in the same or another equipment entity), and/or
- the collection of data.

A phase is intended to cause or define a process-oriented action, while the logic or set of steps that make up a phase are equipment specific. Examples of phases include the following:

- add VCM;
- add catalyst;
- heat.

5.1.3 *Coordination control*

Coordination control directs, initiates and/or modifies the execution of procedural control and the utilization of equipment entities. It is time-varying in nature, like procedural control, but it is not structured along a specific process-oriented task.

Examples of coordination control are algorithms for

- supervising availability or capacity of equipment;
- allocating equipment to batches;
- arbitrating requests for allocation;
- coordinating common resource equipment;
- selecting procedural elements to be executed;
- propagating modes.

The control functions that are needed to implement coordination control are discussed in more detail in 6.1.

5.2 *Equipment entities*

The following subclauses discuss equipment entities that are formed from the combination of equipment control and physical equipment. This combination results in four equipment entities: process cells, units, equipment modules and control modules. Guidelines for structuring these equipment entities are also discussed.

When the terms process cell, unit, equipment module and control module are used, they generally refer to the equipment and its associated equipment control. Whether equipment control in an equipment entity is implemented manually or by way of automation, it is only through the exercise of equipment control that the equipment can produce a batch.

The concept of equipment control being part of an equipment entity is not a statement of the physical implementation of equipment control, but an understanding on a logical basis. However, it is essential that equipment control is identified for a particular equipment entity.

This interaction of equipment control and physical equipment is described purposely without any reference to language or implementation. A framework is defined within which equipment control and physical equipment may be defined and discussed.

5.2.1 *Procedural control model/physical model/process model relationship*

The general relationship between the procedural control model, the physical model, and the process model is illustrated in figure 7. This mapping of procedural control with individual equipment provides processing functionality described in the process model.

The concept of equipment capabilities and usage of these capabilities to accomplish processing tasks is a major point of this standard. The procedural control capability of equipment entities is the mechanism that enables this. The procedural control may be entirely defined as part of equipment control or it may be based on procedural information passed on to the equipment entity from the recipe.

5.2.2 *Equipment control in equipment entities*

The control capability possible in the different equipment entities are important characteristics and a main basis for classification of equipment entities. In the following paragraphs equipment control for the individual equipment entities is discussed.

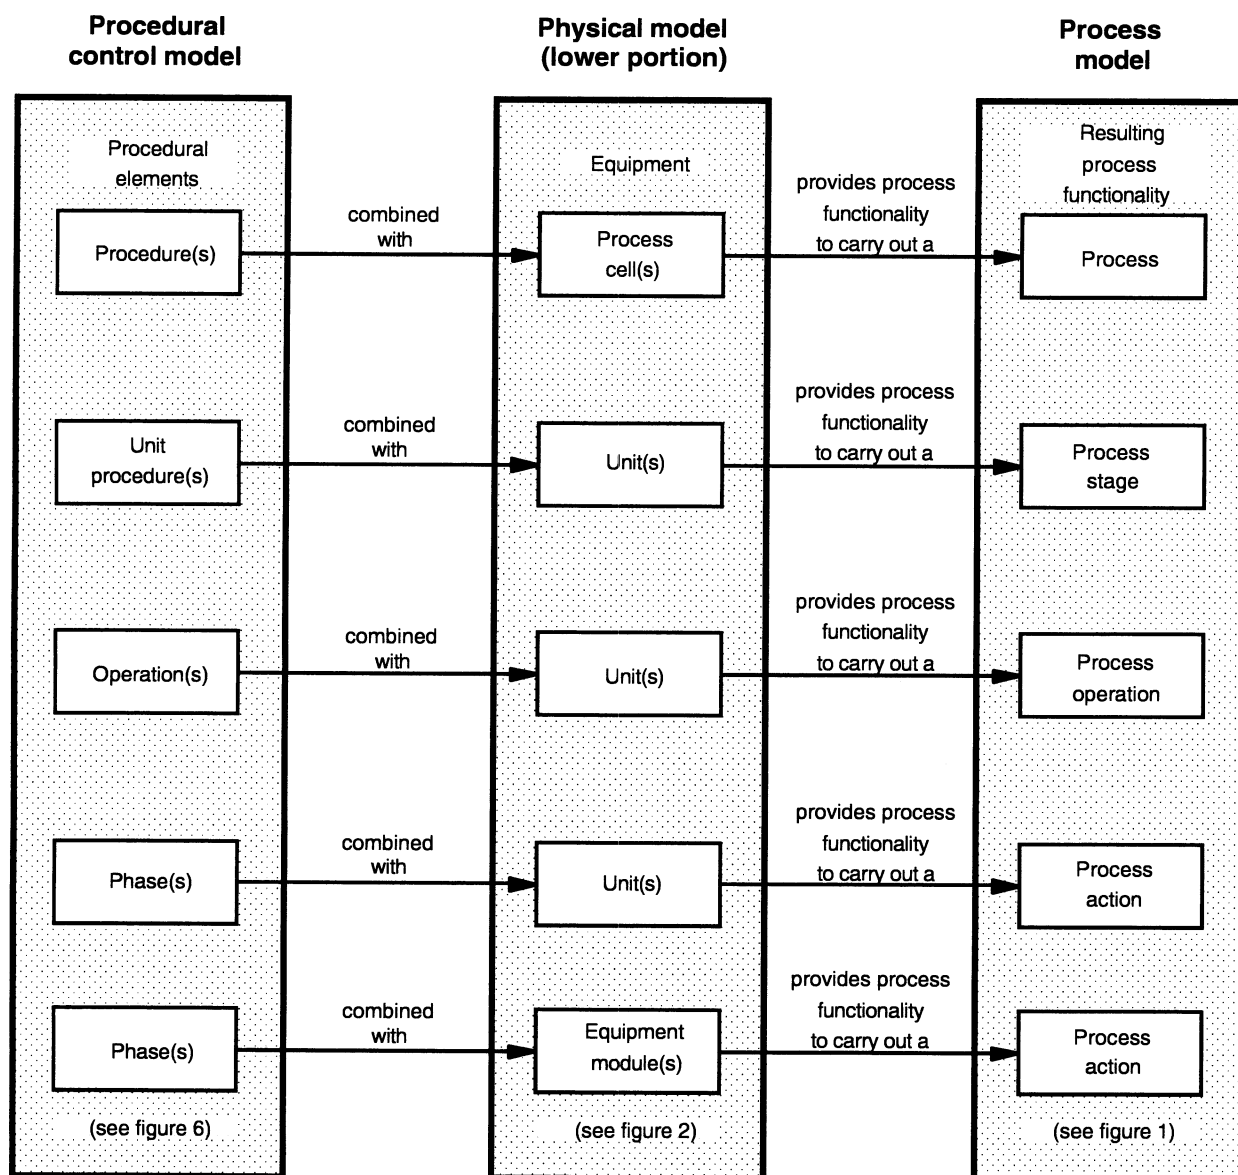


Figure 7 – Procedural control/equipment mapping to achieve process functionality

5.2.2.1 *Process cell*

The process cell is capable of orchestrating all processing activities for one or more batches. It receives recipes containing procedure, parameter, and other information and a schedule containing operational requirements for each batch. It may also need to prepare and monitor equipment or resources not currently involved in batch processing, such as which units are available, what units and piping are going through a clean-in-place (CIP) routine, and what the current inventories of raw materials are.

The complexity of control within the process cell will depend on the equipment available within the process cell, the interconnectivity among this equipment, the degree of freedom of movement of batches through this equipment, and the arbitration of the use of this equipment so that the equipment can be used most effectively.

Equipment control in the process cell may be distributed in the same manner as the physical equipment is subdivided. For example, if the process cell is subdivided into trains, equipment control within the process cell may be distributed among the various trains.

Equipment modules and control modules may exist as separate entities under direct control of the process cell.

5.2.2.1.1 *Basic control in process cells*

The process cell may include basic control that spans several units. For example, an interlock that shuts one unit down may need to be propagated to the upstream units that are feeding this particular unit.

5.2.2.1.2 *Procedural control in process cells*

The execution of a procedure and initiation of the individual unit procedures is a process cell responsibility. The execution may or may not be integral to the coordination control involved with the movement of batches as described in 5.2.2.1.3.

5.2.2.1.3 *Coordination control in process cells*

More coordination control is needed in process cells than in the lower level equipment entities because

- the process cell may contain multiple units and process multiple batches at the same time. This involves coordinating the execution of a number of different procedures;
- the control of the movement of batches may involve a number of choices between alternate paths. Although these choices may be made via links between units, actual routing may be determined by the process cell;
- arbitration may be needed at the process cell level to optimize the use of resources, such as shared resources and resources that should be reserved well in advance of the time actually needed.

Examples of coordination control in a process cell include algorithms that

- manage the initialization and movement of the batches being processed within the process cell; and
- initiate and/or associate unit procedures, parameters and other information in individual units in the proper order to cause them to process the product described by the unique combination of schedules and recipes.

5.2.2.2 *Unit*

Units coordinate the functions of the lower level entities such as equipment modules and control modules. The primary purpose of equipment control in a unit is control of the processing of the batch that is currently associated with the unit.

5.2.2.2.1 *Basic control in units*

Basic control in a unit is generally performed by regulatory control and discrete control in equipment modules and control modules within the unit.

5.2.2.2.2 *Procedural control in units*

Units may include and execute equipment phases, equipment operations and equipment unit procedures or they may execute recipe operations and recipe unit procedures passed on to it.

5.2.2.2.3 *Coordination control in units*

Equipment control in a unit will include a substantially higher level of coordination control than any of the lower level equipment entities. This may include, for example, algorithms that manage unit and acquired resources; arbitrate requests for services from other units or from the process cell; acquire the services of resources from outside the unit and communicate with other equipment entities outside unit boundaries.

5.2.2.3 *Equipment module*

The primary purpose of equipment control in an equipment module is coordination of the functions of other equipment modules and lower level control modules. An equipment module may be commanded by a process cell, a unit, an operator, or, in some cases, another equipment module.

5.2.2.3.1 *Basic control in equipment modules*

Basic control in an equipment module is generally performed by regulatory control and discrete control in control modules within the equipment module.

5.2.2.3.2 *Procedural control in equipment modules*

Equipment modules may execute equipment phases but they do not have the capability of executing higher level procedural elements.

5.2.2.3.3 *Coordination control in equipment modules*

Coordination control in an equipment module includes coordination of its component parts and may include algorithms for propagating modes and for arbitrating requests from units.

5.2.2.4 *Control module*

Equipment control normally found at this level directly manipulates actuators and other control modules. A control module can direct commands to other control modules and to actuators if they have been configured as part of the control module. Control of the process is effected through the equipment-specific manipulation of control modules and actuators.

Examples of equipment control in control modules include

- opening or closing a valve, with confirmation failure alarms;
- regulating the position of a control valve based on a sensor reading and PID control algorithm;
- setting and maintaining the state of several valves in a material header.