BS EN IEC 61158-4-28:2023

BSI Standards Publication

Industrial communication networks — Fieldbus specifications

Part 4-28: Data-link layer protocol specification — Type 28 elements

Documents
Document Sharing Hub

Full document details: BS EN IEC 61158-4-28:2023

National foreword

This British Standard is the UK implementation of EN IEC 61158-4-28:2023. It is identical to IEC 61158-4-28:2023.

The UK participation in its preparation was entrusted to Technical Committee GEL/65, Measurement and control.

A list of organizations represented on this committee can be obtained on request to its committee manager.

Contractual and legal considerations

This publication has been prepared in good faith, however no representation, warranty, assurance or undertaking (express or implied) is or will be made, and no responsibility or liability is or will be accepted by BSI in relation to the adequacy, accuracy, completeness or reasonableness of this publication. All and any such responsibility and liability is expressly disclaimed to the full extent permitted by the law.

This publication is provided as is, and is to be used at the recipient's own risk.

The recipient is advised to consider seeking professional guidance with respect to its use of this publication.

This publication is not intended to constitute a contract. Users are responsible for its correct application.

© The British Standards Institution 2023
Published by BSI Standards Limited 2023

ISBN 978 0 539 11916 9

ICS 25.040; 25.040.40; 33.040.01; 33.040.40

Compliance with a British Standard cannot confer immunity from legal obligations.

This British Standard was published under the authority of the Standards Policy and Strategy Committee on 30 April 2023.

Amendments/corrigenda issued since publication

Date	Text affected

Documents
Document Sharing Hub

Full document details: BS EN IEC 61158-4-28:2023

EUROPEAN STANDARD

NORME EUROPÉENNE

EUROPÄISCHE NORM

EN IEC 61158-4-28

April 2023

ICS 25.040

English Version

Industrial communication networks - Fieldbus specifications - Part 4-28: Data-link layer protocol specification - Type 28 elements (IEC 61158-4-28:2023)

Réseaux de communication industriels - Spécifications des bus de terrain - Partie 4-28: Spécification du protocole de la couche liaison de données - Éléments de type 28 (IEC 61158-4-28:2023)

Industrielle Kommunikationsnetze - Feldbusse - Teil 4-28: Protokollspezifikation des Data Link Layer (Sicherungsschicht) - Typ 28-Elemente (IEC 61158-4-28:2023)

This European Standard was approved by CENELEC on 2023-04-11. CENELEC members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration.

Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CENELEC member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CENELEC member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CENELEC members are the national electrotechnical committees of Austria, Belgium, Bulgaria, Croatia, Cyprus, the Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, the Netherlands, Norway, Poland, Portugal, Republic of North Macedonia, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Türkiye and the United Kingdom.

European Committee for Electrotechnical Standardization
Comité Européen de Normalisation Electrotechnique
Europäisches Komitee für Elektrotechnische Normung

CEN-CENELEC Management Centre: Rue de la Science 23, B-1040 Brussels

© 2023 CENELEC All rights of exploitation in any form and by any means reserved worldwide for CENELEC Members.

Ref. No. EN IEC 61158-4-28:2023 E

Documents
Document Sharing Hub

Full document details: BS EN IEC 61158-4-28:2023

European foreword

The text of document 65C/1206/FDIS, future edition 1 of IEC 61158-4-28, prepared by SC 65C "Industrial networks" of IEC/TC 65 "Industrial-process measurement, control and automation" was submitted to the IEC-CENELEC parallel vote and approved by CENELEC as EN IEC 61158-4-28:2023.

The following dates are fixed:

- latest date by which the document has to be implemented at national level by publication of an identical national standard or by endorsement (dop) 2024-01-11
- latest date by which the national standards conflicting with the document have to be withdrawn (dow) 2026-04-11

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CENELEC shall not be held responsible for identifying any or all such patent rights.

Any feedback and questions on this document should be directed to the users' national committee. A complete listing of these bodies can be found on the CENELEC website.

Endorsement notice

The text of the International Standard IEC 61158-4-28:2023 was approved by CENELEC as a European Standard without any modification.

In the official version, for Bibliography, the following notes have to be added for the standard indicated:

IEC 61158-1	NOTE Approved as EN IEC 61158-1
IEC 61158-5-28	NOTE Approved as EN IEC 61158-5-28
IEC 61158-6-28	NOTE Approved as EN IEC 61158-6-28[1]
IEC 61784-1 (series)	NOTE Approved as EN IEC 61784-1 (series)[2]
IEC 61784-2 (series)	NOTE Approved as EN IEC 61784-2 (series)[3]

[1] To be published. Stage at time of publication: prEN IEC 61158-6-28:2023.

[2] To be published. Stage at the time of publication: FprEN IEC 61784-1-X:2023.

[3] To be published. Stage at the time of publication: FprEN IEC 61784-2-X:2023.

AVA Documents
Document Sharing Hub

Full document details: BS EN IEC 61158-4-28:2023

Annex ZA
(normative)

Normative references to international publications with their corresponding European publications

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

NOTE 1 Where an International Publication has been modified by common modifications, indicated by (mod), the relevant EN/HD applies.

NOTE 2 Up-to-date information on the latest versions of the European Standards listed in this annex is available here: www.cencenelec.eu.

Publication	Year	Title	EN/HD	Year
IEC 61158-2	2023	Industrial communication networks - Fieldbus specifications - Part 2: Physical layer specification and service definition	EN IEC 61158-2	2023
IEC 61158-3-28	2023	Industrial communication networks - Fieldbus specifications - Part 3-28: Data-link layer service definition - Type 28 elements	EN IEC 61158-3-28	2023
ISO/IEC 7498-1	1994	Information technology - Open Systems Interconnection - Basic reference model: The basic model	-	-
ISO/IEC 7498-3	1997	Information technology - Open Systems Interconnection - Basic reference model: Naming and addressing	-	-
ISO/IEC 8886	1996	Information technology - Open Systems Interconnection - Data link service definition	-	-
ISO/IEC 10731	1994	Information technology - Open Systems Interconnection - Basic Reference Model - Conventions for the definition of OSI services	-	-
ISO/IEC/IEEE 8802-3	2021	Telecommunications and exchange between information technology systems - Requirements for local and metropolitan area networks - Part 3: Standard for Ethernet	-	-

Documents
Document Sharing Hub

Full document details: BS EN IEC 61158-4-28:2023

Documents
Document Sharing Hub

Full document details: BS EN IEC 61158-4-28:2023

CONTENTS

FOREWORD 5
INTRODUCTION 7
1 Scope 8
1.1 General 8
1.2 Specifications 8
1.3 Procedures 8
1.4 Applicability 8
1.5 Conformance 8
2 Normative references 9
3 Terms, definitions, symbols, abbreviated terms and conventions 9
3.1 Reference model terms and definitions 9
3.2 Service convention terms and definitions 11
3.3 Common terms and definitions 12
3.4 Additional Type 28 terms and definitions 13
3.5 Additional Type 28 symbols and abbreviations 15
4 Overview of the DL-protocol 16
4.1 DLL protocol architecture 16
4.2 DLL working mechanism 18
4.2.1 Node 18
4.2.2 Addressing 18
4.2.3 Multicast 19
4.2.4 Resource mapping and scheduling 19
5 DLPDU structure 21
5.1 Universal DLPDU structure 21
5.2 Basic configuration DLPDU 23
5.3 Address assignment DLPDU 25
5.4 Multicast assignment DLPDU 25
5.5 Resource allocation DLPDU 26
5.6 Access notification DLPDU 28
5.7 Resource application DLPDU 29
5.8 Resource release DLPDU 30
5.9 Status query DLPDU 30
5.10 Status response DLPDU 31
5.11 Announcement DLPDU 32
5.12 Clock synchronization DLPDU 33
5.13 Common DLPDU 34
6 Working procedure 35
6.1 Initialization procedure 35
6.1.1 Basic configuration 35
6.1.2 Resource mapping configuration 35
6.2 DLL node management procedure 37
6.2.1 DLL maintenance 37
6.2.2 Node join 38
6.2.3 Node query 39
6.2.4 Node leave 39
6.3 Data transmission procedure 40

AVA Documents Document Sharing Hub

Full document details: BS EN IEC 61158-4-28:2023

6.4 Clock synchronization procedure 42
7 State machine 44
7.1 DLDE state machine 44
7.2 DLME state machine 47
7.3 DLCE state machine 48
8 Error handling 49
8.1 General 49
8.2 Possible sources and characteristics of errors 49
8.3 Error handling of MN / TN 50
8.4 PhL error source 50
8.4.1 General 50
8.4.2 Lost connection 50
8.4.3 CRC error 50
8.4.4 Buffer overflow 50
8.4.5 Symbol resource conflict 50
8.4.6 Symbol resource insufficient 50
Annex A (informative) Example for NodeID and MAC address mapping 51
Annex B (informative) Example for multicast group working mechanism 52
Bibliography 53

Figure 1 – Relationships of DLSAPs, DLSAP-addresses and group DL-addresses 12
Figure 2 – Bitmap data type diagram 15
Figure 3 – DLL in Type 28 protocol stack architecture 16
Figure 4 – Relationship of the fieldbus DLL to other fieldbus layers and to users of the fieldbus DLS 17
Figure 5 – Type 28 DLL protocol architecture diagram 17
Figure 6 – Resource mapping between DLL and PhL 20
Figure 7 – DLL resource mapping message queue scheduling diagram 21
Figure 8 – Universal DLPDU structure 22
Figure 9 – Basic configuration DLPDU structure 23
Figure 10 – General configuration block structure 24
Figure 11 – Address allocation DLPDU structure 25
Figure 12 – Multicast assignment DLPDU structure 26
Figure 13 – Resource allocation DLPDU structure 27
Figure 14 – Access notification DLPDU structure 28
Figure 15 – Resource application DLPDU structure 29
Figure 16 – Resource release DLPDU structure 30
Figure 17 – Status query DLPDU structure 31
Figure 18 – Status response DLPDU structure 31
Figure 19 – Announcement DLPDU structure 32
Figure 20 – Clock synchronization DLPDU structure 34
Figure 21 – Common DLPDU structure 35
Figure 22 – Resource mapping configuration diagram 36
Figure 23 – Initial access configuration procedure diagram 37
Figure 24 – The random access configuration procedure diagram 38

AVA Documents
Document Sharing Hub

Full document details: BS EN IEC 61158-4-28:2023

Figure 25 – Node leave procedure diagram 40
Figure 26 – DLS data sending procedure diagram 41
Figure 27 – DLS data receiving procedure diagram 42
Figure 28 – Clock synchronization delay measurement procedure diagram 43
Figure 29 – Clock register structure diagram 43
Figure 30 – Clock synchronization procedure 44
Figure 31 – DLDE state machine 45
Figure 32 – DLME state machine 47
Figure 33 – DLCE state machine 48
Figure B.1 – Multicast working mechanism diagram 52

Table 1 – NodeID address assignment of Type 28 DLL 18
Table 2 – NodeID and MAC address mapping table 18
Table 3 – Members of multicast group mapping table 19
Table 4 – DLDE state transition 46
Table 5 – DLME state machine state transition 48
Table 6 – DLCE state machine state transition 49
Table A.1 – Example of NodeID and MAC address mapping table saved on TN 51

Documents
Document Sharing Hub

Full document details: BS EN IEC 61158-4-28:2023

INTERNATIONAL ELECTROTECHNICAL COMMISSION

_____

INDUSTRIAL COMMUNICATION NETWORKS – FIELDBUS SPECIFICATIONS –

Part 4-28: Data-link layer protocol specification – Type 28 elements

FOREWORD

1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
6) All users should ensure that they have the latest edition of this publication.
7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

Attention is drawn to the fact that the use of the associated protocol type is restricted by its intellectual-property-right holders. In all cases, the commitment to limited release of intellectual-property-rights made by the holders of those rights permits a layer protocol type to be used with other layer protocols of the same type, or in other type combinations explicitly authorized by its intellectual-property-right holders.

NOTE Combinations of protocol types are specified in the IEC 61784-1 series and the IEC 61784-2 series.

IEC 61158-4-28 has been prepared by subcommittee 65C: Industrial networks, of IEC technical committee 65: Industrial-process measurement, control and automation. It is an International Standard.

Documents
Document Sharing Hub

Full document details: BS EN IEC 61158-4-28:2023

The text of this International Standard is based on the following documents:

Draft	Report on voting
65C/1206/FDIS	65C/1235/RVD

Full information on the voting for its approval can be found in the report on voting indicated in the above table.

The language used for the development of this International Standard is English.

This document was drafted in accordance with ISO/IEC Directives, Part 2, and developed in accordance with ISO/IEC Directives, Part 1 and ISO/IEC Directives, IEC Supplement, available at www.iec.ch/members_experts/refdocs. The main document types developed by IEC are described in greater detail at www.iec.ch/publications.

A list of all parts of the IEC 61158 series, published under the general title *Industrial communication networks – Fieldbus specifications*, can be found on the IEC web site.

The committee has decided that the contents of this document will remain unchanged until the stability date indicated on the IEC website under webstore.iec.ch in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

IMPORTANT – The "colour inside" logo on the cover page of this document indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.

Documents
Document Sharing Hub

Full document details: BS EN IEC 61158-4-28:2023

INTRODUCTION

This part of IEC 61158 is one of a series produced to facilitate the interconnection of automation system components. It is related to other standards in the set as defined by the “three-layer” fieldbus reference model described in IEC 61158-1.

The data-link protocol provides the data-link service by making use of the services available from the physical layer. The primary aim of this document is to provide a set of rules for communication expressed in terms of the procedures to be carried out by peer data-link entities (DLEs) at the time of communication. These rules for communication are intended to provide a sound basis for development in order to serve a variety of purposes:

a) as a guide for implementers and designers;

b) for use in the testing and procurement of equipment;

c) as part of an agreement for the admittance of systems into the open systems environment;

d) as a refinement to the understanding of time-critical communications within OSI.

This document is concerned, in particular, with the communication and interworking of sensors, effectors and other automation devices. By using this document together with other standard positioned within the OSI or fieldbus reference models, otherwise incompatible systems could work together in any combination.

Documents
Document Sharing Hub

Full document details: BS EN IEC 61158-4-28:2023

INDUSTRIAL COMMUNICATION NETWORKS – FIELDBUS SPECIFICATIONS –

Part 4-28: Data-link layer protocol specification – Type 28 elements

1 Scope

1.1 General

The data-link layer provides several types of messaging communications between devices in an automation environment.

This part of IEC 61158 provides a means of connecting devices through a partial mesh network, such that most failures of an interconnection between two devices can be circumvented. In common practice, the devices are interconnected in a non-redundant hierarchical manner reflecting application needs.

1.2 Specifications

This document specifies

a) procedures for the timely transfer of data and control information from one data-link user entity to a peer user entity, and among the data-link entities forming the distributed data-link service provider;

b) the structure of the fieldbus DLPDUs used for the transfer of data and control information by the protocol of this document, and their representation as physical interface data units.

1.3 Procedures

The procedures are defined in terms of

a) the interactions between peer DL-entities (DLEs) through the exchange of the fieldbus DLPDUs;

b) the interactions between a DL-service (DLS) provider and a DLS-user in the same system through the exchange of DLS primitives;

c) the interactions between a DLS-provider and a Ph-service provider in the same system through the exchange of Ph-service primitives.

1.4 Applicability

These procedures are applicable to instances of communication between systems which support time-critical communications services within the data-link layer of the OSI or the fieldbus reference models, and which require the ability to interconnect in an open systems interconnection environment.

1.5 Conformance

This document also specifies conformance requirements for systems implementing these procedures. This document does not contain tests to demonstrate compliance with such requirements.

AVA Documents Document Sharing Hub

Full document details: BS EN IEC 61158-4-28:2023

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

NOTE All parts of the IEC 61158 series, as well as the IEC 61784-1 series and the IEC 61784-2 series are maintained simultaneously. Cross-references to these documents within the text therefore refer to the editions as dated in this list of normative references.

IEC 61158-2:2023, *Industrial communication networks – Fieldbus specifications – Part 2: Physical layer specification and service definition*

IEC 61158-3-28:2023, *Industrial communication networks – Fieldbus specifications – Part 3-28: Data-link layer service definition – Type 28 elements*

ISO/IEC 7498-1:1994, *Information technology – Open Systems Interconnection – Basic Reference Model – Basic Reference Model: The Basic Model*

ISO/IEC 7498-3:1997, *Information technology – Open Systems Interconnection – Basic Reference Model: Naming and addressing*

ISO/IEC 10731:1994, *Information technology – Open Systems Interconnection – Basic Reference Model – Conventions for the definition of OSI services*

ISO/IEC 8886:1996, *Information technology – Open Systems Interconnection – Data link service definition*

ISO/IEC/IEEE 8802-3:2021, *Information technology – Telecommunications and information exchange between systems – Local and metropolitan area networks – Specific requirements – Part 3: Standard for Ethernet*

3 Terms, definitions, symbols, abbreviated terms and conventions

For the purposes of this document, the following terms, definitions, symbols and abbreviated terms apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at https://www.electropedia.org/
- ISO Online browsing platform: available at https://www.iso.org/obp

3.1 Reference model terms and definitions

This document is based in part on the concepts developed in ISO/IEC 7498-1 and ISO/IEC 7498-3, and makes use of the following terms defined therein:

3.1.1 called-DL-address **[ISO/IEC 7498-3]**

3.1.2 calling-DL-address **[ISO/IEC 7498-3]**

3.1.3 centralized multi-end-point-connection **[ISO/IEC 7498-1]**

3.1.4 correspondent (N)-entities **[ISO/IEC 7498-1]**
correspondent DL-entities (N=2)
correspondent Ph-entities (N=1)

3.1.5 Demultiplexing **[ISO/IEC 7498-1]**

AVA Documents Document Sharing Hub

Full document details: BS EN IEC 61158-4-28:2023

3.1.6	**DL-address**	**[ISO/IEC 7498-3]**
3.1.7	**DL-address-mapping**	**ISO/IEC 7498-1]**
3.1.8	**DL-connection**	**[ISO/IEC 7498-1]**
3.1.9	**DL-connection-end-point**	**[ISO/IEC 7498-1]**
3.1.10	**DL-connection-end-point-identifier**	**[ISO/IEC 7498-1]**
3.1.11	**DL-connection-mode transmission**	**[ISO/IEC 7498-1]**
3.1.12	**DL-connectionless-mode transmission**	**[ISO/IEC 7498-1]**
3.1.13	**DL-data-sink**	**[ISO/IEC 7498-1]**
3.1.14	**DL-data-source**	**[ISO/IEC 7498-1]**
3.1.15	**DL-duplex-transmission**	**[ISO/IEC 7498-1]**
3.1.16	**DL-facility**	**[ISO/IEC 7498-1]**
3.1.17	**DL-local-view**	**[ISO/IEC 7498-3]**
3.1.18	**DL-name**	**[ISO/IEC 7498-3]**
3.1.19	**DL-protocol**	**[ISO/IEC 7498-1]**
3.1.20	**DL-protocol-connection-identifier**	**[ISO/IEC 7498-1]**
3.1.21	**DL-protocol-control-information**	**[ISO/IEC 7498-1]**
3.1.22	**DL-protocol-data-unit**	**[ISO/IEC 7498-1]**
3.1.23	**DL-protocol-version-identifier**	**[ISO/IEC 7498-1]**
3.1.24	**DL-relay**	**[ISO/IEC 7498-1]**
3.1.25	**DL-service-connection-identifier**	**[ISO/IEC 7498-1]**
3.1.26	**DL-service-data-unit**	**[ISO/IEC 7498-1]**
3.1.27	**DL-simplex-transmission**	**[ISO/IEC 7498-1]**
3.1.28	**DL-subsystem**	**[ISO/IEC 7498-1]**
3.1.29	**DL-user-data**	**[ISO/IEC 7498-1]**
3.1.30	**flow control**	**[ISO/IEC 7498-1]**
3.1.31	**layer-management**	**[ISO/IEC 7498-1]**
3.1.32	**Multiplexing**	**[ISO/IEC 7498-3]**
3.1.33	**naming-(addressing)-authority**	**[ISO/IEC 7498-3]**
3.1.34	**naming-(addressing)-domain**	**[ISO/IEC 7498-3]**
3.1.35	**naming-(addressing)-subdomain**	**[ISO/IEC 7498-3]**
3.1.36	**(N)-entity** **DL-entity** **Ph-entity**	**[ISO/IEC 7498-1]**
3.1.37	**(N)-interface-data-unit** **DL-service-data-unit (N=2)** **Ph-interface-data-unit (N=1)**	**[ISO/IEC 7498-1]**
3.1.38	**(N)-layer** **DL-layer (N=2)** **Ph-layer (N=1)**	**[ISO/IEC 7498-1]**
3.1.39	**(N)-service** **DL-service (N=2)** **Ph-service (N=1)**	**[ISO/IEC 7498-1]**
3.1.40	**(N)-service-access-point** **DL-service-access-point (N=2)** **Ph-service-access-point (N=1)**	**[ISO/IEC 7498-1]**

Documents
Document Sharing Hub
Full document details: BS EN IEC 61158-4-28:2023

3.1.41 (N)-service-access-point-address [ISO/IEC 7498-1]
DL-service-access-point-address (N=2)
Ph-service-access-point-address (N=1)

3.1.42 peer-entities [ISO/IEC 7498-1]

3.1.43 Ph-interface-control-information [ISO/IEC 7498-1]

3.1.44 Ph-interface-data [ISO/IEC 7498-1]

3.1.45 primitive name [ISO/IEC 7498-3]

3.1.46 Reassembling [ISO/IEC 7498-1]

3.1.47 Recombining [ISO/IEC 7498-1]

3.1.48 Reset [ISO/IEC 7498-1]

3.1.49 responding-DL-address [ISO/IEC 7498-3]

3.1.50 Routing [ISO/IEC 7498-1]

3.1.51 Segmenting [ISO/IEC 7498-1]

3.1.52 Sequencing [ISO/IEC 7498-1]

3.1.53 Splitting [ISO/IEC 7498-1]

3.1.54 Synonymous name [ISO/IEC 7498-3]

3.1.55 Systems-management [ISO/IEC 7498-1]

3.2 Service convention terms and definitions

This document also makes use of the following terms defined in ISO/IEC 10731 as they apply to the data-link layer:

3.2.1 acceptor

3.2.2 asymmetrical service

3.2.3 confirm (primitive);
requestor.deliver (primitive)

3.2.4 deliver (primitive)

3.2.5 DL-confirmed-facility

3.2.6 DL-facility

3.2.7 DL-local-view

3.2.8 DL-mandatory-facility

3.2.9 DL-non-confirmed-facility

3.2.10 DL-provider-initiated-facility

3.2.11 DL-provider-optional-facility

3.2.12 DL-service-primitive;
primitive

3.2.13 DL-service-provider

3.2.14 DL-service-user

3.2.15 DLS-user-optional-facility

3.2.16 indication (primitive);
acceptor.deliver (primitive)

3.2.17 multi-peer

3.2.18 request (primitive);
requestor.submit (primitive)

3.2.19 requestor

Documents
Document Sharing Hub
Full document details: BS EN IEC 61158-4-28:2023

3.2.20 response (primitive); acceptor.submit (primitive)

3.2.21 submit (primitive)

3.2.22 symmetrical service

3.3 Common terms and definitions

For the purposes of this document, the following terms and definitions apply.

NOTE Many definitions are common to more than one protocol Type; they are not necessarily used by all protocol types.

3.3.1
DL-segment, link, local link
single DL-subnetwork in which any of the connected DLEs may communicate directly, without any intervening DL-relaying, whenever all of those DLEs that are participating in an instance of communication are simultaneously attentive to the DL-subnetwork during the period(s) of attempted communication

3.3.2
DLSAP
distinctive point at which DL-services are provided by a single DL-entity to a single higher-layer entity

Note 1 to entry: This definition, derived from ISO/IEC 7498-1, is repeated here to facilitate understanding of the critical distinction between DLSAPs and their DL-addresses (see Figure 1).

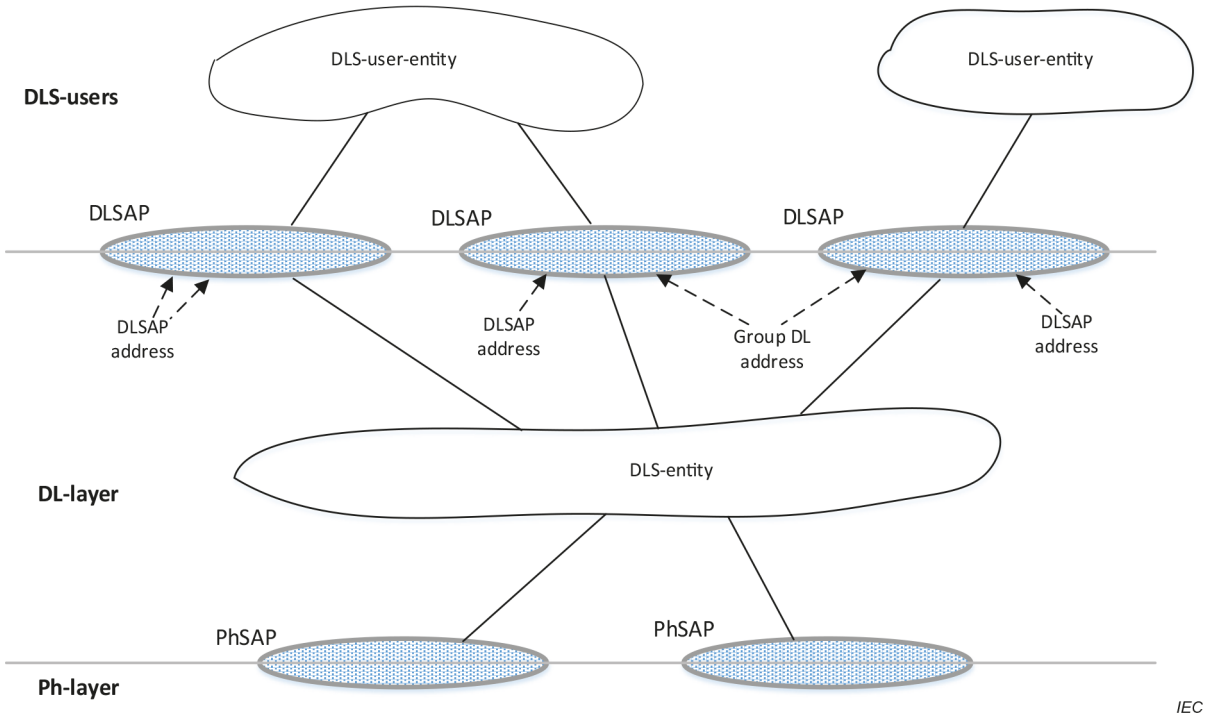

Note 2 to entry: DLSAPs and PhSAPs are depicted as ovals spanning the boundary between two adjacent layers.

Note 3 to entry: DL-addresses are depicted as designating small gaps (points of access) in the DLL portion of a DLSAP.

Note 4 to entry: A single DL-entity may have multiple DLSAP-addresses and group DL-addresses associated with a single DLSAP.

Figure 1 – Relationships of DLSAPs, DLSAP-addresses and group DL-addresses

AVA Documents Document Sharing Hub

Full document details: BS EN IEC 61158-4-28:2023

3.3.3
DL(SAP)-address
either an individual DLSAP-address, designating a single DLSAP of a single DLS user, or a group DL-address potentially designating multiple DLSAPs where each DLSAP is from a single DLS-user

Note 1 to entry: This terminology is chosen because ISO/IEC 7498-3 does not permit the use of the term DLSAP address to designate more than a single DLSAP at a single DLS-user.

3.3.4
(individual) DLSAP-address
DL-address that designates only one DLSAP within the extended link

Note 1 to entry: A single DL-entity may have multiple DLSAP-addresses associated with a single DLSAP.

3.3.5
extended link
DL-subnetwork, consisting of the maximal set of links interconnected by DL-relays, sharing a single DL-name (DL-address) space, in which any of the connected DL-entities may communicate, one with another, either directly or with the assistance of one or more of those intervening DL-relay entities

Note 1 to entry: An extended link may be composed of just a single link.

3.3.6
frame
denigrated synonym for DLPDU

3.3.7
group DL-address
DL-address that potentially designates more than one DLSAP within the extended link

Note 1 to entry: A single DL-entity may have multiple group DL-addresses associated with a single DLSAP. A single DL-entity may also have a single group DL-address associated with more than one DLSAP.

3.3.8
node
single DL-entity as it appears on one local link

3.3.9
receiving DLS-user
DL-service user that acts as a recipient of DLS-user-data

Note 1 to entry: A DL-service user can be concurrently both a sending and receiving DLS-user.

3.3.10
sending DLS-user
DL-service user that acts as a source of DLS-user-data

3.4 Additional Type 28 terms and definitions

3.4.1
control device
device that controls all field devices for logical operations, timing, calculations, etc.

3.4.2
management node
device for allocating and managing Type 28 network physical communication resources

Documents
Document Sharing Hub
Full document details: BS EN IEC 61158-4-28:2023