



BSI Standards Publication

Industrial communication networks - Fieldbus specifications

Part 5-21: Application layer service definition - Type 21 elements

National foreword

This British Standard is the UK implementation of EN IEC 61158-5-21:2019. It is identical to IEC 61158-5-21:2019. It supersedes BS EN 61158-5-21:2012, which will be withdrawn on 15 May 2022.

The UK participation in its preparation was entrusted to Technical Committee GEL/65/3, Industrial communications: process measurement and control, including fieldbus.

A list of organizations represented on this committee can be obtained on request to its secretary.

This publication does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

© The British Standards Institution 2019
Published by BSI Standards Limited 2019

ISBN 978 0 539 04842 1

ICS 35.110; 35.100.70; 25.040.40

Compliance with a British Standard cannot confer immunity from legal obligations.

This British Standard was published under the authority of the Standards Policy and Strategy Committee on 31 July 2019.

Amendments/corrigenda issued since publication

Date	Text affected
------	---------------

English Version

Industrial communication networks - Fieldbus specifications -
Part 5-21: Application layer service definition - Type 21 elements
(IEC 61158-5-21:2019)

Réseaux de communication industriels- Spécifications des
bus de terrain - Partie 5-21 : Définition des services de la
couche application - Éléments de type 21
(IEC 61158-5-21:2019)

Industrielle Kommunikationsnetze - Feldbusse - Teil 5-21:
Dienstfestlegungen des Application Layer
(Anwendungsschicht) - Typ 21-Elemente
(IEC 61158-5-21:2019)

This European Standard was approved by CENELEC on 2019-05-15. CENELEC members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration.

Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CENELEC member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CENELEC member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CENELEC members are the national electrotechnical committees of Austria, Belgium, Bulgaria, Croatia, Cyprus, the Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, the Netherlands, Norway, Poland, Portugal, Republic of North Macedonia, Romania, Serbia, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.



European Committee for Electrotechnical Standardization
Comité Européen de Normalisation Electrotechnique
Europäisches Komitee für Elektrotechnische Normung

CEN-CENELEC Management Centre: Rue de la Science 23, B-1040 Brussels

European foreword

The text of document 65C/947/FDIS, future edition 2 of IEC 61158-5-21, prepared by SC 65C "Industrial networks" of IEC/TC 65 "Industrial-process measurement, control and automation" was submitted to the IEC-CENELEC parallel vote and approved by CENELEC as EN IEC 61158-5-21:2019.

The following dates are fixed:

- latest date by which the document has to be implemented at national level by publication of an identical national standard or by endorsement (dop) 2020-02-15
- latest date by which the national standards conflicting with the document have to be withdrawn (dow) 2022-05-15

This document supersedes EN 61158-5-21:2012.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CENELEC shall not be held responsible for identifying any or all such patent rights.

Endorsement notice

The text of the International Standard IEC 61158-5-21:2019 was approved by CENELEC as a European Standard without any modification.

In the official version, for Bibliography, the following notes have to be added for the standards indicated:

IEC 61158-1:2019	NOTE	Harmonized as EN IEC 61158-1:2019 (not modified)
IEC 61158-2	NOTE	Harmonized as EN 61158-2

Annex ZA

(normative)

Normative references to international publications with their corresponding European publications

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

NOTE 1 Where an International Publication has been modified by common modifications, indicated by (mod), the relevant EN/HD applies.

NOTE 2 Up-to-date information on the latest versions of the European Standards listed in this annex is available here: www.cenelec.eu.

<u>Publication</u>	<u>Year</u>	<u>Title</u>	<u>EN/HD</u>	<u>Year</u>
ISO/IEC/IEEE 60559	2011	Information technology - Microprocessor Systems - Floating-Point arithmetic	-	-
IEC 61158-3-21	2019	Industrial communication networks - Fieldbus specifications - Part 3-21: Data-link layer service definition - Type 21 elements	-	-
IEC 61158-4-21	2019	Industrial communication networks - Fieldbus specifications - Part 4-21: Data-link layer protocol specification - Type 21 elements	EN IEC 61158-4-21	2019
IEC 61158-6-21	2019	Industrial communication networks - Fieldbus specifications - Part 6-21: Application layer protocol specification - Type 21 elements	EN 61158-6-21	2019
ISO/IEC 7498-1	-	Information technology - Open Systems Interconnection - Basic reference model: The basic model	-	-
ISO/IEC 7498-3	-	Information technology - Open Systems Interconnection - Basic reference model: Naming and addressing	-	-
ISO/IEC 8822	-	Information technology - Open Systems Interconnection - Presentation service definition	-	-
ISO/IEC 8824	series	Information technology - Abstract Syntax Notation One (ASN.1): Specification of basic notation	-	-
ISO/IEC 9545	-	Information technology - Open Systems Interconnection - Application layer structure	-	-
ISO/IEC 10731	-	Information technology - Open Systems Interconnection - Basic Reference Model - Conventions for the definition of OSI services	-	-

This page deliberately left blank

CONTENTS

FOREWORD.....	5
INTRODUCTION.....	7
1 Scope.....	8
1.1 Overview	8
1.2 Specifications	9
1.3 Conformance	9
2 Normative references	9
3 Terms, definitions, symbols, abbreviations, and conventions	10
3.1 Terms and definitions from other ISO/IEC standards.....	10
3.1.1 ISO/IEC 7498-1 terms.....	10
3.1.2 ISO/IEC 8822 terms.....	10
3.1.3 ISO/IEC 8824-1 terms.....	10
3.1.4 ISO/IEC 9545 terms.....	11
3.2 Fieldbus data link layer terms	11
3.3 Fieldbus application layer specific definitions.....	11
3.4 Abbreviations and symbols	17
3.5 Conventions.....	17
3.5.1 Overview	17
3.5.2 General conventions.....	18
3.5.3 Conventions for class definitions	18
3.5.4 Conventions for service definitions	19
4 Concepts	20
4.1 Common concepts	20
4.1.1 Overview	20
4.1.2 Architectural relationships	21
4.1.3 Fieldbus application layer structure	23
4.1.4 Fieldbus application layer naming and addressing	34
4.1.5 Architecture summary	35
4.1.6 FAL service procedures	36
4.1.7 Common FAL attributes	37
4.1.8 Common FAL service parameters	37
4.1.9 APDU size	38
4.2 Type specific concepts.....	38
4.2.1 Node, AP, and object dictionary.....	40
4.2.2 APO ASEs.....	41
5 Data type ASE.....	41
5.1 General.....	41
5.1.1 Overview	41
5.1.2 Basic type overview	42
5.1.3 Fixed-length type overview	42
5.1.4 Constructed type overview.....	43
5.1.5 Specification of user-defined data types	43
5.1.6 Transfer of user data	43
5.2 Formal definition of data type objects.....	44
5.2.1 Data type class.....	44
5.3 FAL defined data types	45

5.3.1	Fixed-length types	45
5.3.2	String types	48
5.4	Data type ASE service specification	49
6	Communication model specification	49
6.1	ASEs	49
6.1.1	Application process ASE	49
6.1.2	Service data object ASE	55
6.1.3	Process data object ASE	65
6.1.4	Application relationship ASE	68
6.2	ARs	75
6.2.1	Point-to-point user-triggered confirmed client/server AREP (PTC-AR)	75
6.2.2	Multipoint network-scheduled unconfirmed publisher-subscriber AREP (MSU-AR)	76
6.2.3	Multipoint user-triggered unconfirmed publisher-subscriber AREP (MTU-AR)	78
6.3	Summary of FAL classes	79
6.4	Permitted FAL services by AREP role	79
	Bibliography	80
	Figure 1 – Relationship to the OSI Basic Reference Model	21
	Figure 2 – Architectural positioning of the fieldbus application layer	22
	Figure 3 – Client/server interactions	24
	Figure 4 – Pull model interactions	25
	Figure 5 – Push model interactions	26
	Figure 6 – APOs services conveyed by the FAL	28
	Figure 7 – Application entity structure	30
	Figure 8 – FAL management of objects	31
	Figure 9 – ASE service conveyance	32
	Figure 10 – Defined and established AREPs	34
	Figure 11 – FAL architectural components	36
	Figure 12 – Interaction between FAL and DLL	39
	Figure 13 – Publisher-subscriber communication model	39
	Figure 14 – Client-server communication model	40
	Figure 15 – Object model	40
	Figure 16 – ASEs of a Type 21 application	41
	Figure 17 – Data type class hierarchy example	42
	Figure 18 – The AR ASE conveys APDUs between APs	68
	Table 1 – Types of timeliness	27
	Table 2 – Overall structure of the OD	40
	Table 3 – Identify service	52
	Table 4 – Status service	54
	Table 5 – Access rights for object	56
	Table 6 – Read service	57
	Table 7 – Write service	59

Table 8 – Write and Read service	61
Table 9 – Write and Read Multiple service	63
Table 10 – TB-transfer	67
Table 11 – COS-transfer	67
Table 12 – Conveyance of service primitives by AREP role.....	69
Table 13 – Valid combinations of AREP roles involved in an AR	69
Table 14 – AR-unconfirmed send	73
Table 15 – AR-confirmed send.....	74
Table 16 – FAL class summary	79
Table 17 – Services by AREP role	79

INTERNATIONAL ELECTROTECHNICAL COMMISSION

**INDUSTRIAL COMMUNICATION NETWORKS –
FIELD BUS SPECIFICATIONS –****Part 5-21: Application layer service definition –
Type 21 elements****FOREWORD**

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

Attention is drawn to the fact that the use of the associated protocol type is restricted by its intellectual-property-right holders. In all cases, the commitment to limited release of intellectual-property-rights made by the holders of those rights permits a layer protocol type to be used with other layer protocols of the same type, or in other type combinations explicitly authorized by its intellectual-property-right holders.

NOTE Combinations of protocol types are specified in IEC 61784-1 and IEC 61784-2.

International Standard IEC 61158-5-21 has been prepared by subcommittee 65C: Industrial networks, of IEC technical committee 65: Industrial process measurement, control and automation.

This second edition cancels and replaces the first edition published in 2010. This edition constitutes a technical revision.

This edition includes the following significant technical changes with respect to the previous edition:

- added Write and Read service;
- miscellaneous editorial corrections.

The text of this International Standard is based on the following documents:

FDIS	Report on voting
65C/947/FDIS	65C/950/RVD

Full information on the voting for the approval of this International Standard can be found in the report on voting indicated in the above table.

This publication has been drafted in accordance with ISO/IEC Directives, Part 2.

A list of all parts of the IEC 61158 series, published under the general title *Industrial communication networks – Fieldbus specifications*, can be found on the IEC web site.

The committee has decided that the contents of this publication will remain unchanged until the stability date indicated on the IEC web site under "<http://webstore.iec.ch>" in the data related to the specific publication. At this date, the publication will be:

- reconfirmed;
- withdrawn;
- replaced by a revised edition, or
- amended.

A bilingual version of this publication may be issued at a later date.

INTRODUCTION

This document is one of a series produced to facilitate the interconnection of automation system components. It is related to other standards in the set as defined by the “three-layer” fieldbus reference model described in IEC 61158-1.

The application service is provided by the application protocol making use of the services available from the data-link or other immediately lower layer. This document defines the application service characteristics that fieldbus applications and/or system management may exploit.

Throughout the set of fieldbus standards, the term “service” refers to the abstract capability provided by one layer of the OSI Basic Reference Model to the layer immediately above. Thus, the application layer service defined in this document is a conceptual architectural service, independent of administrative and implementation divisions.

INDUSTRIAL COMMUNICATION NETWORKS – FIELDBUS SPECIFICATIONS –

Part 5-21: Application layer service definition – Type 21 elements

1 Scope

1.1 Overview

The Fieldbus Application Layer (FAL) provides user programs with a means to access the fieldbus communication environment. In this respect, the FAL can be considered a window between corresponding application programs.

This part of IEC 61158 provides the common elements for basic time-critical and non-time-critical messaging communications between application programs in an automation environment as well as material specific to the Type 21 protocol. The term “time-critical” is used to represent the presence of a time-window within which one or more specified actions are required to be completed with some defined level of certainty. Failure to complete specified actions within the time window risks failure of the applications requesting the actions, with attendant risk to equipment, plant, and possibly human life.

This International Standard defines, in an abstract way, the externally visible service provided by the FAL in terms of:

- a) an abstract model for defining application resources (objects) capable of being manipulated by users via the FAL service;
- b) the primitive actions and events of the service;
- c) the parameters associated with each primitive action and event, and the form that they take;
- d) the interrelationship between these actions and events, and their valid sequences.

The purpose of this document is to define the services provided to:

- a) the FAL-user at the boundary between the user and the application layer of the fieldbus Reference Model;
- b) systems management at the boundary between the application layer and systems management of the fieldbus Reference Model.

This document describes the structure and services of the IEC FAL, in conformance with the OSI Basic Reference Model (ISO/IEC 7498) and the OSI Application layer Structure (ISO/IEC 9545).

FAL services and protocols are provided by FAL application entities (AEs) contained in the application processes. The FAL AE is composed of a set of object-oriented Application Service Elements (ASEs) and a Layer Management Entity (LME) that manages the AE. The ASEs provide communication services that operate on a set of related application process object (APO) classes. One of the FAL ASEs is a management ASE that provides a common set of services for management of the instances of FAL classes.

Although these services specify how requests and responses are issued and delivered from the perspective of applications, they do not include a specification of what the requesting and responding applications are to do with them. That is, these services only define what requests and responses applications can send or receive, not the functions of the applications

themselves. This permits greater flexibility to the FAL-users in standardizing such object behavior. In addition to these services, some supporting services are also defined in this document to provide access to the FAL to control certain aspects of its operation.

1.2 Specifications

The principal objective of this document is to specify the characteristics of conceptual application layer services suitable for time-critical communications, and thus supplement the OSI Basic Reference Model in guiding the development of application layer protocols for time-critical communications.

A secondary objective is to provide migration paths from previously existing industrial communications protocols. This latter objective gives rise to the diversity of services standardized as the various types of IEC 61158, and the corresponding protocols standardized in subparts of IEC 61158-6.

This document may be used as the basis for formal application programming interfaces. Nevertheless, it is not a formal programming interface, and any such interface must address implementation issues not covered by this document, including:

- a) sizes and octet ordering of various multi-octet service parameters;
- b) correlation of paired primitives for request and confirmation, or indication and response.

1.3 Conformance

This document does not specify individual implementations or products, nor does it constrain the implementations of application layer entities in industrial automation systems.

There is no conformance of equipment to this application layer service definition standard. Instead, conformance is achieved through the implementation of conforming application layer protocols that fulfill any given type of application layer services as defined in this document.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

NOTE All parts of the IEC 61158 series, as well as IEC 61784 1 and IEC 61784 2 are maintained simultaneously. Cross-references to these documents within the text therefore refer to the editions as dated in this list of normative references.

ISO/IEC/IEEE 60559:2011, *Information technology – Microprocessor Systems – Floating-Point arithmetic*

IEC 61158-3-21:2019, *Industrial communication networks – Fieldbus specifications – Part 3-21: Data-link layer service definition – Type 21 elements*

IEC 61158-4-21:2019, *Industrial communication networks – Fieldbus specifications – Part 4-21: Data-link layer protocol specification – Type 21 elements*

IEC 61158-6-21:2019, *Industrial communication networks – Fieldbus specifications – Part 6-21: Application layer protocol specification – Type 21 elements*

ISO/IEC 7498-1, *Information technology – Open Systems Interconnection – Basic Reference Model: The Basic Model*

ISO/IEC 7498-3, *Information technology – Open Systems Interconnection – Basic Reference Model: Naming and addressing*

ISO/IEC 8822, *Information technology – Open Systems Interconnection – Presentation service definition*

ISO/IEC 8824 (all parts), *Information Technology – Abstract Syntax Notation One (ASN-1)*

ISO/IEC 9545, *Information technology – Open Systems Interconnection – Application layer structure*

ISO/IEC 10731, *Information technology – Open Systems Interconnection – Basic Reference Model – Conventions for the definition of OSI services*

3 Terms, definitions, symbols, abbreviations, and conventions

For the purposes of this document, the following terms, definitions, symbols, abbreviations and conventions apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <http://www.electropedia.org/>
- ISO Online browsing platform: available at <http://www.iso.org/obp>

3.1 Terms and definitions from other ISO/IEC standards

3.1.1 ISO/IEC 7498-1 terms

- a) application entity
- b) application process
- c) application protocol data unit
- d) application service element
- e) application entity invocation
- f) application process invocation
- g) application transaction
- h) real open system
- i) transfer syntax

3.1.2 ISO/IEC 8822 terms

- a) abstract syntax
- b) presentation context

3.1.3 ISO/IEC 8824-1 terms

For the purposes of this document, the following terms as defined in ISO/IEC 8824-1 apply:

- a) object identifier
- b) type

3.1.4 ISO/IEC 9545 terms

- a) application-association
- b) application-context
- c) application context name
- d) application-entity-invocation
- e) application-entity-type
- f) application-process-invocation
- g) application-process-type
- h) application-service-element
- i) application control service element

3.2 Fieldbus data link layer terms

For the purposes of this document, the following terms as defined in IEC 61158-3-21 and IEC 61158-4-21 apply.

- a) DL-Time
- b) DL-Scheduling-policy
- c) DLCEP
- d) DLC
- e) DL-connection-oriented mode
- f) DLPDU
- g) DLSDU
- h) DLSAP
- i) link
- j) ISO/IEC/IEEE 8802-3 MAC address
- k) DL-entity identifier

3.3 Fieldbus application layer specific definitions

3.3.1

application

function or data structure for which data are consumed or produced

3.3.2

application objects

multiple object classes that manage and provide a runtime exchange of messages across the network and within the network device

3.3.3

application process

part of a distributed application on a network, which is located on one device and addressed unambiguously

3.3.4

application process object

component of an application process that is identifiable and accessible through an FAL application relationship

Note 1 to entry: Application process object definitions are composed of a set of values for the attributes of their class (see the definition for "application process object class"). Application process object definitions may be accessed remotely using the services of the FAL Object Management ASE. FAL Object Management services can

be used to load or update object definitions, to read object definitions, and to create and delete application objects and their corresponding definitions dynamically.

3.3.5

application process object class

class of application process objects defined in terms of the set of their network-accessible attributes and services

3.3.6

application relationship

cooperative association between two or more application-entity-invocations for the purpose of exchange of information and coordination of their joint operation

Note 1 to entry: This relationship is activated either by the exchange of application-protocol-data-units or as a result of preconfiguration activities.

3.3.7

application relationship application service element

application-service-element that provides the exclusive means for establishing and terminating all application relationships

3.3.8

application relationship endpoint

context and behavior of an application relationship as seen and maintained by one of the application processes involved in the application relationship

Note 1 to entry: Each application process involved in the application relationship maintains its own application relationship endpoint.

3.3.9

attribute

description of an externally visible characteristic or feature of an object

Note 1 to entry: The attributes of an object contain information about variable portions of an object. Typically, they provide status information or govern the operation of an object. Attributes may also affect the behavior of an object. Attributes are divided into class attributes and instance attributes.

3.3.10

behavior

indication of how an object responds to particular events

3.3.11

channel

single physical or logical link of an input or output application object of a server to the process

3.3.12

class

set of objects, all of which represent the same type of system component

Note 1 to entry: A class is a generalization of an object, a template for defining variables and methods. All objects in a class are identical in form and behavior, but usually contain different data in their attributes.

3.3.13

class attributes

attribute shared by all objects within the same class

3.3.14

class code

unique identifier assigned to each object class

3.3.15**class-specific service**

service defined by a particular object class to perform a required function that is not performed by a common service

Note 1 to entry: A class-specific object is unique to the object class that defines it.

3.3.16**client**

- a) object that uses the services of another (server) object to perform a task
- b) initiator of a message to which a server reacts

3.3.17**consume**

act of receiving data from a producer

3.3.18**consumer**

node or sink that receives data from a producer

3.3.19**consuming application**

application that consumes data

3.3.20**conveyance path**

unidirectional flow of APDUs across an application relationship

3.3.21**cyclic**

repetitive in a regular manner

3.3.22**data consistency**

means for coherent transmission and access of the input- or output-data object between and within client and server

3.3.23**device**

physical hardware connected to the link

Note 1 to entry: A device may contain more than one node.

3.3.24**device profile**

collection of device-dependent information and functionality providing consistency between similar devices of the same device type

3.3.25**diagnostic information**

all data available at the server for maintenance purposes

3.3.26**end node**

producing or consuming node

3.3.27

endpoint

one of the communicating entities involved in a connection

3.3.28

error

discrepancy between a computed, observed, or measured value or condition and the specified or theoretically correct value or condition

3.3.29

error class

general grouping for related error definitions and corresponding error codes

3.3.30

error code

identification of a specific type of error within an error class

3.3.31

event

instance of a change of conditions

3.3.32

FIFO variable

variable object class composed of a set of homogeneously typed elements, where the first written element is the first element that can be read

Note 1 to entry: In a fieldbus system, only one complete element can be transferred as a result of one service invocation.

3.3.33

frame

simplified synonym for data link protocol data unit (DLPDU)

3.3.34

group

<general> general term for a collection of objects

3.3.35

group

<addressing> when describing an address, an address that identifies more than one entity

3.3.36

invocation

act of using a service or other resource of an application process

Note 1 to entry: Each invocation represents a separate thread of control that may be described by its context. Once the service completes, or use of the resource is released, the invocation ceases to exist. For service invocations, a service that has been initiated but not yet completed is referred to as an outstanding service invocation. For service invocations, an Invoke ID may be used to identify the service invocation unambiguously and differentiate it from other outstanding service invocations.

3.3.37

index

address of an object within an application process

3.3.38

instance

actual physical occurrence of an object within a class that identifies one of many objects in the same object class

EXAMPLE California is an instance of the object class US-state.

Note 1 to entry: The terms object, instance, and object instance are used to refer to a specific instance.

3.3.39

instance attributes

attribute that is unique to an object instance and not shared by the object class

3.3.40

instantiated

object that has been created in a device

3.3.41

logical device

specific FAL class that abstracts a software component or a firmware component as an autonomous self-contained facility of an automation device

3.3.42

manufacturer ID

identification of each product manufacturer by a unique number

3.3.43

management information

network-accessible information that supports management of the operation of the fieldbus system, including the application layer

Note 1 to entry: Managing includes functions, such as controlling, monitoring, and diagnosis.

3.3.44

network

set of nodes connected by some type of communication medium, including any intervening repeaters, bridges, routers, and lower-layer gateways

3.3.45

object

abstract representation of a particular component within a device, usually a collection of related data in the form of variables, and methods (procedures) for operating on that data that have clearly defined interface and behavior

3.3.46

object dictionary

collection of definitions, communication-specific attributes and parameters, and application-dependent data

3.3.47

object-specific service

service unique to the object class that defines it

3.3.48

physical device

automation or other network device

3.3.49

point-to-point connection

connection that exists between exactly two application objects

3.3.50

pre-established AR endpoint

AR endpoint placed in an established state during configuration of the AEs that control its endpoints

3.3.51

process data

object(s) that are already pre-processed and transferred cyclically for the purpose of information or further processing

3.3.52

produce

act of sending data to be received by a consumer

3.3.53

producer

node that is responsible for sending data

3.3.54

property

general term for descriptive information about an object

3.3.55

provider

source of a data connection

3.3.56

publisher

role of an AR endpoint that transmits APDUs onto the fieldbus for consumption by one or more subscribers

Note 1 to entry: A publisher may not be aware of the identity or number of subscribers.

3.3.57

publishing manager

role of an AR endpoint in which it issues one or more confirmed service request application protocol data units (APDUs) to a publisher to request that a specified object be published. Two types of publishing managers are defined by this document, pull publishing managers and push publishing managers, each of which is defined separately.

3.3.58

push publisher

type of publisher that publishes an object in an unconfirmed service request APDU

3.3.59

push publishing manager

type of publishing manager that requests that a specified object be published using an unconfirmed service

3.3.60

push subscriber

type of subscriber that recognizes received unconfirmed service request APDUs as published object data

3.3.61

server

a) role of an application relationship endpoint (AREP) in which it returns a confirmed service response APDU to the client that initiated the request

b) object that provides services to another (client) object

3.3.62

service

operation or function than an object and/or object class performs upon request from another object and/or object class

3.3.63

station

host of one AP, identified by a unique data link connection endpoint (DLCEP)-address

3.3.64

subscriber

role of an AREP in which it receives APDUs produced by a publisher

3.4 Abbreviations and symbols

AE	Application Entity
AL	Application Layer
ALME	Application Layer Management Entity
ALP	Application Layer Protocol
APO	Application Object
AP	Application Process
APDU	Application Protocol Data Unit
AR	Application Relationship
AREP	Application Relationship End Point
ASCII	American Standard Code for Information Interchange
ASE	Application Service Element
Cnf	Confirmation
DL-	(as a prefix) Data Link -
DLCEP	Data Link Connection End Point
DLL	Data Link Layer
DLM	Data Link Management
DLSAP	Data Link Service Access Point
DLSDU	DL-service-data-unit
DNS	Domain Name Service
FAL	Fieldbus Application Layer
Ind	Indication
Req	Request
Rsp	Response

3.5 Conventions

3.5.1 Overview

The FAL is defined as a set of object-oriented ASEs. Each ASE is specified in a separate subclause. Each ASE specification is composed of two parts: its class specification and its service specification.

The class specification defines the attributes of the class. Access to these attributes is beyond the scope of this document except where specified. The service specification defines the services provided by the ASE.

3.5.2 General conventions

This document uses the descriptive conventions given in ISO/IEC 10731.

3.5.3 Conventions for class definitions

Class definitions are described using templates. Each template consists of a list of attributes for the class. The general form of the template is as shown below:

FAL ASE:	ASE name
CLASS:	Class name
CLASS ID:	#
PARENT CLASS:	Parent class name
ATTRIBUTES:	
1 (o) Key Attribute:	numeric identifier
2 (o) Key Attribute:	name
3 (m) Attribute:	attribute name(values)
4 (m) Attribute:	attribute name(values)
4.1 (s) Attribute:	attribute name(values)
4.2 (s) Attribute:	attribute name(values)
4.3 (s) Attribute:	attribute name(values)
5 (c) Constraint:	constraint expression
5.1 (m) Attribute:	attribute name(values)
5.2 (o) Attribute:	attribute name(values)
6 (m) Attribute:	attribute name(values)
6.1 (s) Attribute:	attribute name(values)
6.2 (s) Attribute:	attribute name(values)
SERVICES:	
1 (o) OpsService:	service name
2 (c) Constraint:	constraint expression
2.1 (o) OpsService:	service name
3 (m) MgtService:	service name

- (1) The FAL ASE: entry is the name of the FAL ASE that provides the services for the class being specified.
- (2) The CLASS: entry is the name of the class being specified. All objects defined using this template will be an instance of this class. The class may be specified by this document, or by a user of this document.
- (3) The CLASS ID: entry is a number that identifies the class being specified. This number is not used for Type 21 elements.
- (4) The PARENT CLASS: entry is the name of the parent class for the class being specified. All attributes defined for the parent class and inherited by it are inherited for the class being defined, and therefore do not have to be redefined in the template for this class.

NOTE The parent-class TOP indicates that the class being defined is an initial class definition. The parent class TOP is used as a starting point from which all other classes are defined. The use of TOP is reserved for classes defined by this document.

- (5) The ATTRIBUTES label indicates that the following entries are attributes defined for the class.
 - a) Each of the attribute entries contains a line number in column 1; a mandatory (m), optional (o), conditional (c), or selector (s) indicator in column 2; an attribute type label

in column 3; a name or a conditional expression in column 4; and an optional list of enumerated values in column 5. In the column following the list of values, the default value for the attribute may be specified.

- b) Objects are normally identified by a numeric identifier or by an object name, or by both. In the class templates, these key attributes are defined under the key attribute.
- c) The line number defines the sequence and the level of nesting of the line. Each nesting level is identified by period. The numbers below refer to the general template form above. Nesting is used to specify:
 - i) fields of a structured attribute (4.1, 4.2, 4.3);
 - ii) attributes conditional on a constraint statement. Attributes may be mandatory (5.1) or optional (5.2) if the constraint is true. Not all optional attributes require constraint statements as does the attribute defined in (5.2);
 - iii) the selection fields of a choice type attribute (6.1 and 6.2).
- (6) The SERVICES label indicates that the following entries are services defined for the class.
 - a) An (m) in column 2 indicates that the service is mandatory for the class, while an (o) indicates that it is optional. A (c) in this column indicates that the service is conditional. When all services defined for a class are defined as optional, at least one has to be selected when an instance of the class is defined.
 - b) The label “OpsService” designates an operational service (1).
 - c) The label “MgtService” designates a management service (2).
 - d) The line number defines the sequence and the level of nesting of the line. Each nesting level is identified by period. Nesting within the list of services is used to specify services conditional on a constraint statement.

3.5.4 Conventions for service definitions

3.5.4.1 General

The service model, service primitives, and time-sequence diagrams used are entirely abstract descriptions; they do not represent a specification for implementation.

3.5.4.2 Service parameters

Service primitives are used to represent interactions between service user and service provider (ISO/IEC 10731). They convey parameters that indicate information available in the user/provider interaction. In any particular interface, not all parameters must be stated explicitly.

The service definition of this document uses a tabular format to describe the component parameters of the ASE service primitives. The parameters that apply to each group of service primitives are set out in tables. Each table consists of up to five columns:

- a) parameter name;
- b) request primitive;
- c) indication primitive;
- d) response primitive;
- e) confirmation primitive.

One parameter, or a component, is listed in each row of each table. Under the appropriate service primitive columns, a code is used to specify the type of usage of the parameter on the primitive specified in the column:

- M The parameter is mandatory for the primitive.

- U The parameter is a user option, and may or may not be provided depending on dynamic usage of the service user. When not provided, a default value for the parameter is assumed.
- C The parameter is conditional upon other parameters or upon the environment of the service user.
- (blank) The parameter is never present.
- S The parameter is a selected item.

Some entries are further qualified by items in parentheses. These may be:

- a) a parameter-specific constraint:
 - “(=)” indicates that the parameter is semantically equivalent to the parameter in the service primitive to its immediate left in the table;
- b) an indication that some note applies to the entry:
 - “(n)” indicates that the following note “n” contains additional information pertaining to the parameter and its use.

3.5.4.3 Service procedures

The service procedures are defined in terms of:

- The interactions between application entities through the exchange of fieldbus APDUs;
- The interactions between an application layer service provider and an application layer service user in the same system through the invocation of application layer service primitives.

These procedures are applicable to instances of communication between systems that support time-constrained communications services within the fieldbus application layer.

4 Concepts

4.1 Common concepts

4.1.1 Overview

The fieldbus is intended to be used in factories and process plants to interconnect primary automation devices (e.g., sensors, actuators, local display devices, annunciators, programmable logic controllers, small single loop controllers, and standalone field controls) with control and monitoring equipment located in control rooms.

Primary automation devices are associated with the lowest levels of the industrial automation hierarchy and perform a limited set of functions within a definite time window. Some of these functions include diagnostics, data validation, and handling of multiple inputs and outputs.

These primary automation devices, also called field devices, are located close to the process fluids, the fabricated part, the machine, the operator, and the environment. This use positions the fieldbus at the lowest levels of the computer integrated manufacturing (CIM) architecture.

Some of the expected benefits in using fieldbus systems are reductions in wiring, increases in the amount of data exchanged, a wider distribution of control between the primary automation devices and the control room equipment, and satisfaction of time-critical constraints.

Subclause 4.1 describes the fundamentals of the FAL. Detailed descriptive information about each of the FAL ASEs can be found in the overview subclause of each of the communication model specifications.

4.1.2 Architectural relationships

4.1.2.1 Relationship to the application layer of the OSI Basic Reference Model

The functions of the FAL have been described according to OSI layering principles. However, the FAL's architectural relationship to the lower layers is different, as follows (see Figure 1):

- a) the FAL groups OSI functions together with extensions to cover time-critical requirements. The OSI application layer structure standard (ISO/IEC 9545) was used as a basis for the FAL specification;
- b) the FAL directly uses the services of the underlying layer. The underlying layer may be the DLL or any layer in between. When using the underlying layer, the FAL may provide functions normally associated with the OSI middle layers for proper mapping onto the underlying layer.

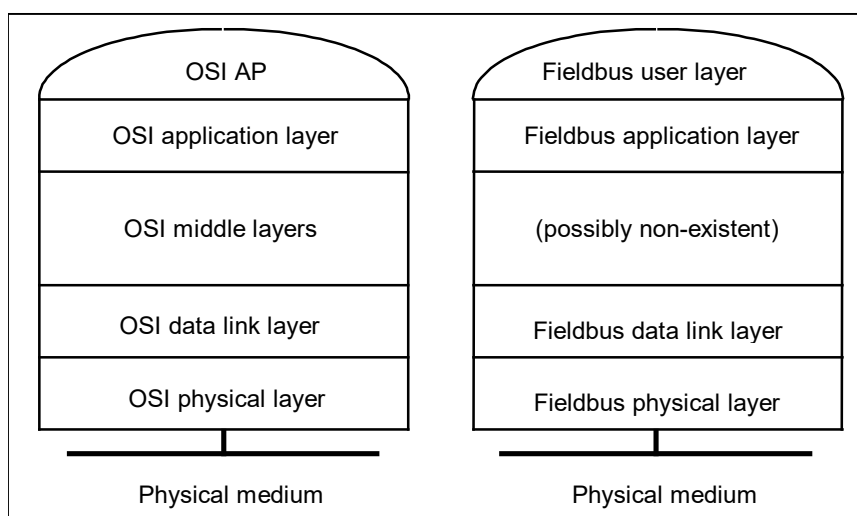


Figure 1 – Relationship to the OSI Basic Reference Model

4.1.2.2 Relationships to other fieldbus entities

4.1.2.2.1 General

The FAL architectural relationships illustrated in Figure 2 have been designed to support the interoperability needs of time-critical systems distributed in the fieldbus environment.

In this environment, the FAL provides communications services to time-critical and non-time-critical applications located in fieldbus devices.

In addition, the FAL uses the DLL directly to transfer its application layer protocol data units, using a set of data transfer services and a set of supporting services to control the operational aspects of the DLL.