BS EN ISO 17349:2016

BSI Standards Publication

Petroleum and natural gas industries — Offshore platforms handling streams with high content of CO_2 at high pressures

bsi.

...making excellence a habit.™

Document Sharing Hub

National foreword

This British Standard is the UK implementation of EN ISO 17349:2016.

The UK participation in its preparation was entrusted to Technical Committee PSE/17, Materials and equipment for petroleum, petrochemical and natural gas industries.

A list of organizations represented on this committee can be obtained on request to its secretary.

This publication does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

© The British Standards Institution 2016.
Published by BSI Standards Limited 2016

ISBN 978 0 580 87251 8

ICS 75.020

Compliance with a British Standard cannot confer immunity from legal obligations.

This British Standard was published under the authority of the Standards Policy and Strategy Committee on 31 March 2016.

Amendments/corrigenda issued since publication

Date	Text affected

Documents
Document Sharing Hub

Full document details: BS EN ISO 17349:2016

EUROPEAN STANDARD

NORME EUROPÉENNE

EUROPÄISCHE NORM

EN ISO 17349

March 2016

ICS 75.020

English Version

Petroleum and natural gas industries - Offshore platforms handling streams with high content of CO_2 at high pressures (ISO 17349:2016)

Industries du pétrole et du gaz naturel - Plates-formes en mer traitant des courants à fort teneur en CO_2 à haute pression (ISO 17349:2016)

Erdöl-, petrochemische und Erdgasindustrie - Dampf mit hohem CO_2 Gehalt bei hohen Drücken und hohen Durchflussraten - Richtlinien (ISO 17349:2016)

This European Standard was approved by CEN on 10 January 2016.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and United Kingdom.

EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

CEN-CENELEC Management Centre: Avenue Marnix 17, B-1000 Brussels

© 2016 CEN All rights of exploitation in any form and by any means reserved worldwide for CEN national Members.

Ref. No. EN ISO 17349:2016 E

Documents
Document Sharing Hub

Full document details: BS EN ISO 17349:2016

European foreword

This document (EN ISO 17349:2016) has been prepared by Technical Committee ISO/TC 67 "Materials, equipment and offshore structures for petroleum, petrochemical and natural gas industries" in collaboration with Technical Committee CEN/TC 12 “Materials, equipment and offshore structures for petroleum, petrochemical and natural gas industries” the secretariat of which is held by NEN.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by September 2016, and conflicting national standards shall be withdrawn at the latest by September 2016.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN [and/or CENELEC] shall not be held responsible for identifying any or all such patent rights.

According to the CEN-CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.

Endorsement notice

The text of ISO 17349:2016 has been approved by CEN as EN ISO 17349:2016 without any modification.

Documents
Document Sharing Hub

Full document details: BS EN ISO 17349:2016

Contents

Page

Foreword ... **v**
Introduction ... **vi**
1 Scope ... **1**
2 Normative references ... **1**
3 Terms and definitions ... **2**
4 Abbreviated terms ... **4**
5 Overview of CO_2-rich streams behaviour ... **5**
5.1 General ... 5
5.2 Hydrate formation ... 5
5.3 CO_2 solid formation ... 6
5.4 Flow metering ... 6
6 Blow down, depressuring and relieving of plant and equipment ... **6**
7 Flare and vent system configuration ... **7**
7.1 General ... 7
7.2 System selection ... 7
7.3 System configuration ... 8
7.3.1 Flare ... 8
7.3.2 Vent ... 9
8 Materials ... **9**
8.1 Corrosion ... 9
8.1.1 General ... 9
8.1.2 Internal corrosion control by dehydration ... 9
8.1.3 CRAs ... 10
8.1.4 Internal corrosion protecting chemicals ... 10
8.1.5 Internal organic coatings ... 10
8.2 Brittle fracture ... 10
8.3 Ductile fracture ... 10
8.4 Lubricants ... 10
8.5 Non-metallic seals for CO_2 service ... 11
9 Safety ... **11**
9.1 General ... 11
9.2 Impacts of the loss of containment of CO_2-rich streams ... 11
9.2.1 General ... 11
9.2.2 Respiratory physiological parameters ... 12
9.2.3 Low temperature impact ... 12
9.2.4 CO_2-rich stream BLEVE ... 12
9.3 Hazard identification and risk assessment and management ... 12
9.3.1 General ... 12
9.3.2 Hazard identification ... 13
9.3.3 Risk assessment and management ... 13
9.4 Consequence analysis ... 14
9.4.1 General ... 14
9.4.2 CO_2 dispersion ... 14
9.4.3 Effects of cold CO_2 jet ... 14
9.5 CO_2 detection ... 14
9.6 Strategies ... 15
Annex A (informative) **Evaluation of EOS for CO_2-rich streams** ... **16**
Annex B (informative) **Hydrate formation** ... **22**
Annex C (informative) **Water content specification** ... **26**

© ISO 2016 – All rights reserved

AVA Documents
Document Sharing Hub
Full document details: BS EN ISO 17349:2016

Annex D (informative) **Depressuring of CO_2-rich streams** **33**
Annex E (informative) **Configuration of flare and vent systems** **37**
Annex F (informative) **Boiling liquid expanding vapour explosion (BLEVE)** **40**
Annex G (informative) **Methodology for evaluation of running ductile fracture** **42**
Annex H (informative) **Non-metallic materials for use in CO_2 service** **44**
Annex I (informative) **CO_2 toxicology information** **45**
Bibliography **48**

© ISO 2016 – All rights reserved
Documents
Document Sharing Hub
Full document details: BS EN ISO 17349:2016

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular the different approval criteria needed for the different types of ISO documents should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see www.iso.org/directives).

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights. Details of any patent rights identified during the development of the document will be in the Introduction and/or on the ISO list of patent declarations received (see www.iso.org/patents).

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation on the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the WTO principles in the Technical Barriers to Trade (TBT), see the following URL: Foreword — Supplementary information.

The committee responsible for this document is ISO/TC 67, *Materials, equipment and offshore structures for petroleum, petrochemical and natural gas industries*.

© ISO 2016 – All rights reserved

Documents
Document Sharing Hub
Full document details: BS EN ISO 17349:2016

Introduction

In recent years, the oil industry has been facing challenges in developing and operating high-CO_2 content offshore fields. The CO_2-rich streams, separated from the produced natural gas, can be injected to enhance oil recovery from the reservoirs. Even in cases where the oil recovery increase is not so significant, operators have to consider the CO_2-rich stream compression and injection, in order to avoid its venting to the atmosphere.

Main concerns comprise surface safety system and material selection areas, which lack specific standards and regulations for this scenario. The commercial tools available, for instance, to model the dispersion of gases, need to be validated for CO_2 and CO_2/hydrocarbon mixtures, which have distinctive thermodynamic behaviour. This will affect the choice of materials and plant design.

This International Standard addresses concepts and criteria for processing CO_2-rich streams, as a supplement to existing standards for offshore installations.

© ISO 2016 – All rights reserved
Documents
Document Sharing Hub
Full document details: BS EN ISO 17349:2016

Petroleum and natural gas industries — Offshore platforms handling streams with high content of CO_2 at high pressures

1 Scope

This International Standard contains provisions for design of topside facilities for offshore plants handling CO_2-rich streams at high pressures; i.e. CO_2 molar concentration above 10 %. The surface systems include usual offshore process unit operations, as shown in Figure 1.

This International Standard is applicable only to topside facilities of fixed and floating oil and gas production offshore units up to the last barrier, such as an ESDV. Subsea production systems and Cryogenic CO_2 separation are not covered.

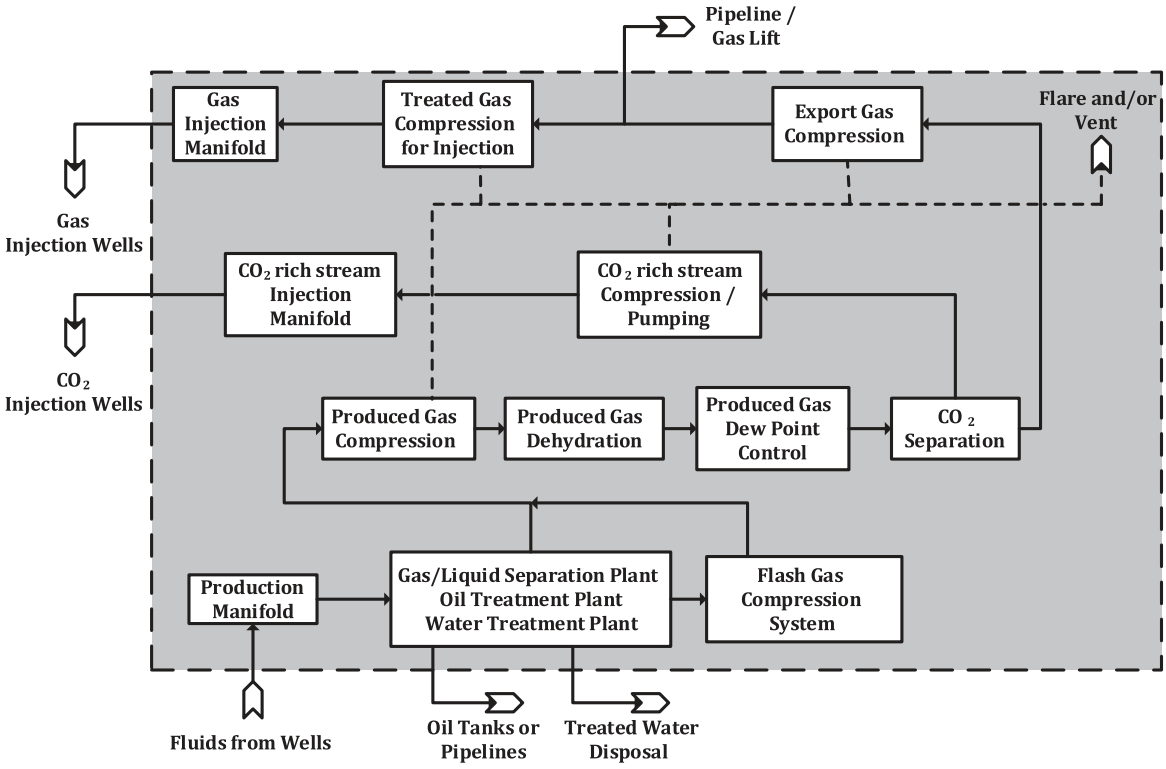

NOTE This example is within the scope of this International Standard.

Figure 1 — Example of a Process Flow Diagram (in grey zone)

2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies..

ISO 13702, *Petroleum and natural gas industries — Control and mitigation of fires and explosions on offshore production installations — Requirements and guidelines*

© ISO 2016 – All rights reserved

Documents Document Sharing Hub

Full document details: BS EN ISO 17349:2016

ISO 15156 (all parts), *Petroleum and natural gas industries — Materials for use in H_2S-containing environments in oil and gas production*

ISO 21457, *Petroleum, petrochemical and natural gas industries — Materials selection and corrosion control for oil and gas production systems*

ISO 23936-1, *Petroleum, petrochemical and natural gas industries — Non-metallic materials in contact with media related to oil and gas production — Part 1: Thermoplastics*

ISO 23936-2:2011, *Petroleum, petrochemical and natural gas industries — Non-metallic materials in contact with media related to oil and gas production — Part 2: Elastomers*

API STD 521, *Pressure-relieving and Depressuring Systems, API Standard, January 2014*

3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

3.1
compressibility factor
Z
thermodynamic property for modifying the ideal gas law to account for the real gas behaviour

3.2
corrosion resistant alloy
CRA
alloy intended to be resistant to general and localized corrosion by oil field environments that are corrosive to carbon steels

[SOURCE: ISO 15156-1:2015, 3.6]

3.3
dense phase
fluid state (supercritical or liquid) above critical pressure

3.4
equation of state
EOS
thermodynamic equation describing the state of matter under a given set of physical conditions

3.5
free water
water not dissolved in the CO_2-rich stream

Note 1 to entry: This can be pure water, water with dissolved salts, water wet salts, water glycol mixtures or other mixtures containing water.

3.6
gas-assisted flare
flare with gas assistance system in order to increase gas net heating value

3.7
high-velocity tip flare
flare with gas exit velocities higher than 122 m/s

3.8
high-velocity vent
vent with gas exit velocities higher than 150 m/s

© ISO 2016 – All rights reserved
Documents
Document Sharing Hub
Full document details: BS EN ISO 17349:2016

3.9
hydrate
solid, crystalline compound of water and light hydrocarbons or CO_2, in which the water molecules combine with the gas molecules to form a solid

3.10
CRA clad
metallic coating of CRA in which the bond between the parent metal and liner is metallurgical

3.11
low-velocity tip flare
flare with gas exit velocities lower than 122 m/s

3.12
low-velocity vent
vent with gas exit velocities lower than 150 m/s

3.13
minimum design temperature
minimum temperature below which the application limits for the materials involved are exceeded

3.14
platform
complete assembly, including structure, topsides, foundations and stationkeeping systems

[SOURCE: ISO 19900:2013, 3.35]

3.15
rapid gas decompression
RGD
depressurization
explosive decompression
rapid pressure-drop in a high pressure gas-containing system which disrupts the equilibrium between external gas pressure and the concentration of gas dissolved inside any polymer, with the result that excess gas tries to escape from the solution at points throughout the material, causing expansion

[SOURCE: ISO 23936-2:2011, 3.1.10]

3.16
supercritical phase
fluid state above critical pressure and temperature

3.17
topsides
structures and equipment placed on a supporting structure (fixed or floating) to provide some or all of a platform's functions

Note 1 to entry: For a ship-shaped floating structure, the deck is not part of the topsides.

Note 2 to entry: For a jack-up, the hull is not part of the topsides.

Note 3 to entry: A separate fabricated deck or module support frame is part of the topsides.

[SOURCE: ISO 19900:2013, 3.52]

3.18
triple point
temperature and pressure where CO_2 exists as a gas, liquid and solid simultaneously

© ISO 2016 – All rights reserved

Documents
Document Sharing Hub
Full document details: BS EN ISO 17349:2016

4 Abbreviated terms

AIV	acoustically induced vibration
BLEVE	boiling liquid expanding vapour explosion
BDV	blow down valve
CH_4	methane
CO_2	carbon dioxide
CCR	central control room
CRA	corrosion resistant alloy
EERS	evacuation, escape and rescue strategy
EOS	equation of state
ESD	emergency shut down
FES	fire and explosion strategy
GDU	gas dehydration unit
H_2S	hydrogen sulfide
HC	hydrocarbon
HP	high pressure
HSE	health, safety and environment
IDLH	immediately dangerous to life or health
LP	low pressure
MMSCF	million standard cubic feet gas (60 °F and 1 atm)
NHV	net heating value
NIOSH	National Institute for Occupational Safety and Health
NIST	National Institute of Standards and Technology
OSHA	Occupational Safety and Health Administration
Pa	ambient pressure
Pc	critical pressure
PEL	permissible exposure limit
PHA	Preliminary Hazard Analysis
ppmv	parts per million, volumetric basis
PR	Peng-Robinson EOS
PR-HV	Peng-Robinson EOS modified by using mixing rule of Huron-Vidal and Peneloux factor

© ISO 2016 – All rights reserved
Documents
Document Sharing Hub
Full document details: BS EN ISO 17349:2016

PR-SV	Peng-Robinson-Stryjek-Vera EOS
PSV	pressure safety valve
RGD	rapid gas decompression
RO	restriction orifice
SCF	standard cubic feet
SVLE	solid-liquid-vapour equilibrium
STEL	short-term exposure limit
SRK	Soave-Redlich-Kwong EOS
Tc	critical temperature
TWA	time weighted average
v_{max}	maximum permitted velocity, expressed in m/s
Z	compressibility factor

5 Overview of CO_2-rich streams behaviour

5.1 General

In an offshore plant design, CO_2-rich streams can be handled close to or above its critical pressure (dense phase) or above its critical pressure and temperature (supercritical phase).[8] In the latter, some of its properties are similar to that of a liquid (e.g. density) and other similar to that of a gas (e.g. viscosity). The physical and thermodynamic properties of the CO_2-rich streams will have an impact on issues like hydrate formation and depressuring.

The design of a plant handling CO_2-rich streams at high pressures should be conducted using an EOS supported by experimental data in the range of operations. Examples of this approach are shown in Annex A. If experimental data are not available, data from thermodynamic based models, including readily available EOS, should be used taking into account any related uncertainties therefore allowing for sufficient safety margins.

Particular attention should be given when performing simulations near the critical point due to strong variation on stream properties and uncertainty on the description of the existing phases. For that reason, equipment normal operation envelope should avoid critical point region.

5.2 Hydrate formation

CO_2-rich streams can present a potential risk for hydrate formation similar to sweet natural gas, if water is present (as free water or in gas phase).

For high pressures, CO_2 has an inhibitor effect on hydrate formation, since an increase on the CO_2 concentration shifts the hydrate equilibrium curve towards low temperatures, as it can be seen in Annex B.

Dehydration unit design should take into account all operational conditions, including low temperatures that might occur in process systems and pipeline segments downstream from the offshore plant. Special attention should be given to the fact that CO_2 tends to increase water-holding capacity at higher pressures.

© ISO 2016 – All rights reserved

Documents
Document Sharing Hub
Full document details: BS EN ISO 17349:2016

For that reason, depending on CO_2 content in the stream, it is not safe to set a water dew point specification based on higher pressure requirements only, since water condensation can occur at lower pressures (see Figure B.1).

As a first approach, a margin of 10 °C on water dew point or a reduction down to 50 % of the water saturation content should be considered.

An example of moisture content specification for Dehydration Unit is presented in Annex C.

5.3 CO_2 solid formation

Solid formation can be observed in a CO_2-rich stream depending on temperature and pressure. Low temperatures that lead to solid formation can be achieved during planned and unplanned depressuring operations, for equipment maintenance purposes and emergency conditions as well. Annex D presents phase diagram for CO_2-rich streams and discusses solid formation based on experimental and theoretical calculations.

The influence of methane content in solid formation temperature can be found in Reference [9]. The frost point is presented for a CO_2-CH_4 mixture in a wide range of concentrations, showing that increasing CH_4 content shifts the frost point curve toward lower temperatures, as shown in Annex D.

According to References [9] and [10], there is an indication that solid formed from a CO_2-rich stream in low temperature operations may be considered as composed of pure CO_2. Therefore, in the absence of experimental data and specific phase diagrams for mixtures with the solid region represented, available phase diagrams for pure CO_2 may be used as conservative approach, in order to predict the low temperatures in which solid formation is expected in an offshore plant design.

Process plant design should take into account the predicted low temperatures with additional design margin in order to specify suitable mitigation measures to avoid or deal with solid formation. More details are presented in Clause 6.

5.4 Flow metering

Design of metering systems shall take into account the peculiarities of behaviour of CO_2-rich streams. Preferably, metering systems should be located in plant sections where physical and transport properties are stable and predictable, i.e. far from critical point or phase transitions. Depending on the process, this means some meters may be designed for gas phase, while others for liquid phase.[11]

Flow computers with input for composition as well as temperature and pressure online measurements using the AGA-8 method, commonly used for natural gas, may be extended to CO_2-rich streams as long as conditions guarantee gas phase.[12] AGA-8 method also shows good predictability of supercritical phase as shown in Annex A.

Differential pressure flow meters such as orifice plates, Venturi or V-Cone are well suitable and robust, especially when working at very high pressures. Coriolis meters, being mass flow meters, are less susceptible to the variation of fluid properties or phase changes as long as no solids are formed but can be limited to operational pressures due to meter body construction.

Special care should be taken regarding changes in the CO_2-rich stream properties and potential flashing, so meter sizing and location should be properly selected.

6 Blow down, depressuring and relieving of plant and equipment

Temperature decrease observed in CO_2-rich streams during depressuring depends upon the initial and final pressures, initial temperature and stream composition.

In order to avoid brittle fracture, minimum temperatures achieved during an isenthalpic depressuring should be considered for material selection of let-down pressure devices (PSVs, BDVs, ROs) and for the

© ISO 2016 – All rights reserved
Documents
Document Sharing Hub
Full document details: BS EN ISO 17349:2016

entire low pressure system. Piping sections upstream the let-down pressure device can also be subjected to low temperatures and should be designed for co-incident high pressure at minimum temperature.

Apart from low temperature effects, designing relief systems of process plants (equipment or piping) should consider solid CO_2 formation, hydrate formation, adhesion and two-phase flow analysis.

Plant design should avoid operational conditions that lead to the triple point and solid formation in order to prevent plugging, piping erosion and vibration. Annex D presents examples of depressuring route in a phase diagram for CO_2-rich streams.

Designer should evaluate the following:

— control of blow down rate (such as manual assisted operations, restriction orifice or automatic control in steps);

— selection of backpressure of the blow down relief header higher than triple point and frost line. In this case proper transient studies should be carried out for a better evaluation of the whole relief system;

— avoiding pockets and minimizing bends in pipe segments downstream relief device up to main flare or vent header;

— main flare or vent header configuration to avoid potential plugging;

— use of heat tracing;

— application the full upstream pressure rating to the blow down systems in the event of risk of plugging.

For depressuring criteria, designer shall comply with API STD 521 requirements even in cases of non-flammable CO_2-rich streams.

ESD system design should consider proper installation of shutdown/isolation valves in order to limit inventory and thereby minimize trapped fluid amount and potential for incident escalation.

The risk of Rapid Gas Decompression (RGD) damages to non-metallic materials can impose limitations on the depressuring rate. This scenario should be included in the consequence analysis.

7 Flare and vent system configuration

7.1 General

Flare and Vent system design shall comply with API STD 521.

Design of CO_2-rich streams flare and vent systems shall consider the following aspects, as a minimum:

— CO_2-rich streams composition and respective minimum net heating values (NHVs);

— combustibility (flare);

— safe gas dispersion (vent);

— CO_2 solid formation (see Clause 5);

— temperature profile during depressuring (see Clause 6 and Clause 8);

— selection of metallic and non-metallic materials (see Clause 8).

7.2 System selection

Possible flare and vent system configurations are described in Table E.1.

In case of H_2S present in CO_2-rich streams, flaring should be preferred instead of venting. For flare systems, design should comply with H_2S destruction temperature, as low NHV streams have lower

© ISO 2016 – All rights reserved

AVA Documents Document Sharing Hub
Full document details: BS EN ISO 17349:2016

flame temperature. For vent systems, design shall warrant proper H_2S dispersion due to hazard and safety aspects.

Flaring gases with low NHV influences ignition stability and can cause flame extinction. Header and disposal segregation between low and high NHV releases may be considered as an option.

For streams with NHV lower than 7,5 MJ/Sm^3 (200 BTU/SCF), which corresponds approximately to a 75 % (molar) CO_2 mixture with methane, vent or gas-assisted low-velocity tip flare should be used. Minimum NHV shall be ensured in flare systems to allow flammability and combustion efficiency at the flare tip, by mixing assistance fuel gas from a reliable source to CO_2-rich streams being relieved. The capacity of assistance fuel gas should be designed for the worst-case scenario.

For streams with NHV higher than 7,5 MJ/Sm^3 (200 BTU/SCF) and lower than 28,1 MJ/Sm^3 (800 BTU/SCF), high-velocity tip flares are not recommended. The use of such tip compared with low velocity one shall be carefully evaluated. Manufacturer guarantee is required in case the high-velocity tip will be used.

For high-velocity tip flares, a typical minimum NHV gas mixture to be burned is 28,1 MJ/Sm^3 (800 BTU/SCF). This corresponds approximately to a 25 % (molar) CO_2 mixture with methane.

7.3 System configuration

7.3.1 Flare

For units dealing with CO_2-rich streams, alternative flare system for low NHV and/or low temperature may be considered in additional to typical HP and LP systems.

The ignition of CO_2-rich streams requires a high energy ignition source. Such condition can be achieved by increasing the number of pilot burners in relation to minimum requirements of pilot manufacturers' recommendations as detailed in ISO 25457.

To ensure combustion, special attention shall be given to flare tip velocities. It is important to take into account the following considerations: Low-velocity flares are those designed for and operated with an exit tip velocity lower than the maximum permitted velocity, v_{max}, as determined by the Formula (1), limited to 122 m/s (400 ft/s).

$$\log_{10}\left(v_{max}\right) = (NHV + K1) / K2 \tag{1}$$

where

v_{max} is the maximum permitted velocity, expressed in m/s;

$K1$ is the constant equal to 28,8;

$K2$ is the constant equal to 31,7;

NHV is the net heating value, expressed in MJ/Sm^3.

The method to determine the maximum permitted velocity v_{max} is shown in Reference [13].

As a rule, maximum permitted velocity calculated from Formula (1) will dictate flare tip area equivalent diameter. Effects of low temperature on flame stability can be countered by lowering velocity or adding assistance gas. Flare tip design will be dictated by flare tip suppliers and experimental evidence should be required for all critical relief scenarios and/or unproven solutions. Interaction with flare tip suppliers is recommended from the early phases of design.

Designer should evaluate noise and acoustically induced vibration (AIV) aspects.

Flare thermal design shall comply with API STD 521, following recommendations about admissible total radiation fluxes over the working areas, without the need of any heat shield in the unit.

© ISO 2016 – All rights reserved
AVA Documents Document Sharing Hub
Full document details: BS EN ISO 17349:2016

Dispersion simulations are necessary for defining the following designing aspects: flare length, height, position and orientation due to dominant wind directions. The snuffed flare scenario should be one of those covered by dispersion studies, especially considering that low temperature releases are less likely to ignite.

7.3.2 Vent

Vent tip location shall be assessed based on dispersion studies, practical safety zones, noise, acoustically induced vibration (AIV) and thermal radiation in case of accidental ignition scenario.

Dispersion simulations, including evaluation of the CO_2 plume, are necessary for defining the following designing aspects: vent length, height, position and orientation due to dominant wind directions. The final location of the outlet orifices shall ensure that the low flow discharges be adequately dispersed.

As a general recommendation, the vent tip should be pointing 45° from the horizontal plane in the direction away from working areas. Some protection against rain may be provided.

When designing the vent system, consideration should be given to the formation of solid CO_2 due to low temperatures downstream of blow down/relief valves. If solid CO_2 formation is possible, the vent design should minimize the potential for blockage.

High-velocity vents are recommended whenever possible, in order to reduce potential CO_2 or hydrate plugging, solid adhesion and improve gas dispersion.

8 Materials

8.1 Corrosion

8.1.1 General

Internal corrosion can be a significant risk to the carbon steel piping and equipment integrity dealing with CO_2-rich streams in presence of free water. Free water combined with high CO_2 partial pressure is likely to lead to high corrosion rates. As discussed is Annexes B and C, water can be less likely to drop out from vapour phase CO_2-rich streams when compared to natural gas.

The presence of H_2S in combination with free water will have a significant effect on the corrosion rate. The possibility of oxidizing species ingress in the presence of H_2S can induce elemental sulfur deposition leading to higher corrosion rates.

Materials selection shall comply with ISO 21457. Physicochemical and corrosion models used for internal corrosion evaluation should take into account considering high CO_2 contents and high pressures.

Piping, fittings and equipment with fluids containing H_2S shall be evaluated according to ISO 15156 (all parts).

Pipe segments and other parts of the system that can have stagnant conditions (pockets) should be evaluated carefully for internal corrosion.

8.1.2 Internal corrosion control by dehydration

In general, for carbon steel piping and equipment no internal corrosion protection is required providing that free water in the CO_2-rich streams be avoided through a strict water content control procedure. This consideration should be used downstream of the dehydration system. Moisture content monitoring should be considered as part of piping and equipment design and operation.

Upset conditions and downtimes shall be taken into account. This can include dehydration system failure and dehydration off-spec when specifying critical systems where significant failure cannot be tolerated.

© ISO 2016 – All rights reserved

Documents
Document Sharing Hub
Full document details: BS EN ISO 17349:2016

8.1.3 CRAs

Most of CRAs are suitable for wet CO_2-rich streams applications. The use of solid CRA or CRA clad for corrosion prevention should be considered for the dehydration system itself and the upstream facilities. Some guidelines for selecting CRAs are indicated in ISO 21457.

8.1.4 Internal corrosion protecting chemicals

Reliance on pH stabilization and injection of corrosion inhibitors can be an effective way to control CO_2-rich streams corrosion rates where free water is present. If this approach is to be adopted a qualification program is required, in order to ensure the effectiveness of this solution.

8.1.5 Internal organic coatings

Internal coating for corrosion protection is not recommended where there is a risk of damage such as detachment from the base pipe material due to RGD, erosion, installation and work-overs. Extensive corrosion rates are likely to result in sections with coating damages.[14]

8.2 Brittle fracture

If a CO_2-rich stream experiences depressuring, it can cool down rapidly because of the Joule-Thomson effect. Selected materials shall be suitable for the minimum design temperature. This applies to both parent metal and welded joints.

These materials with guaranteed low-temperature properties shall be applied to vessels, pipes, valves and fittings, including body and internals of pressure relief devices. In addition, the low temperature upstream pressure let down device in piping sections should be considered (refer to Clause 5).

8.3 Ductile fracture

Piping systems handling CO_2-rich streams are more susceptible to running ductile fractures than those for natural gas service. When a fracture initiates in a pipe with dense phase CO_2-rich stream and vapour starts to form, the decompression speed drops rapidly, keeping the pipe subjected to a high loading state. The selected piping material should resist this high loading state and thus prevent fracture propagation.

Likelihood of fracture propagation depends on piping material and thickness, on operation temperature and pressure and on the physical properties of the CO_2-rich stream.[15] A methodology for evaluating ductile fracture propagation is described in Annex G.

8.4 Lubricants

Petroleum based greases and many synthetic types of greases, used in components such as valves and pumps, can be deteriorated by CO_2-rich streams. The compatibility of the applied grease with specified CO_2-rich streams should be taken into account for the entire operating envelope of pressure and temperature.

The phase equilibrium between different kinds of lubricants and CO_2 indicates a three-phase area where two liquid phases and vapour coexist. These regions should be avoided at lubrication point. Besides, the CO_2 solubility in the lubricant reduces significantly its viscosity and can jeopardize lubrication.

There are specific lubricants and greases designed for CO_2 applications. This applies in particular to safety critical valves such as block valves, check valves and pressure relief valves where lubrication can significantly affect the ability of the valve to operate in an emergency. One possibility is to minimize the contact between lubricant and gas, so that effects will be reduced.

© ISO 2016 – All rights reserved
Documents
Document Sharing Hub
Full document details: BS EN ISO 17349:2016

8.5 Non-metallic seals for CO_2 service

The materials selected shall be compatible with all states of the CO_2-rich streams. In a dense phase, CO_2-rich streams can behave as an efficient solvent and it can penetrate and saturate some non-metallic materials.

The possibility of swelling during dense phase exposure and explosive decompression damage during rapid gas decompression shall be considered for elastomer sealing. Candidate materials need also to be tested for the potential low temperature conditions that can occur during depressurization (Joule-Thomson effect).

CO_2-rich streams can cause different types of deterioration mechanisms like swelling and cracks after rapid decompression of several components, such as: O-rings, seals, gaskets and valve seats.

Non-metallic materials shall be qualified to ensure the following:

— chemical/physical compatibility with CO_2 and other chemical components in the CO_2 stream without causing significant decomposing/extraction, swelling, hardening or unacceptable negative impact on material key properties;

— resistance to full temperature range;

— ability to resist destructive decompression (RGD).

All non-metallic seals and packing elements selected shall be qualified for the intended design conditions. ISO 23936-1 and ISO 23936-2 shall be used as references. Concerning RGD evaluation for thermoplastics, ISO 23936-2 shall be used as reference, however with modified acceptance criteria: no blisters nor cracks nor holes are acceptable.

Annex H gives some tests for non-metallic materials commonly used in CO_2-rich stream applications.

9 Safety

9.1 General

Offshore units handling CO_2-rich streams at high pressures are a relatively novel process and, depending on process conditions and applied technology, complexity can be increased due to fluid dynamic properties of dense phase CO_2-rich streams. This introduces a number of new hazard management issues that should be addressed.

9.2 Impacts of the loss of containment of CO_2-rich streams

9.2.1 General

When the temperature of a CO_2-rich stream plume is below the water dew point temperature in the atmosphere into which it is being released, water vapour will condense to form a visible cloud. Otherwise, high temperature and pressure releases will take longer time to be visually perceived.

The visible cloud represents the extent of the water vapour condensation and does not represent the extent of the CO_2 plume. If a high temperature CO_2 stream is leaking (e.g. a leak from a compressor discharge), no visible cloud will be produced.

If the ambient atmosphere into which a CO_2 release flows is dry, the water vapour cloud will be smaller than on a humid day. As a result, the absence of a visible cloud should not be taken as an indication of the absence of a CO_2 leak. Otherwise, the presence of a visible cloud should not be taken as an indication of the exclusive presence of a CO_2 leak.

© ISO 2016 – All rights reserved

Documents
Document Sharing Hub
Full document details: BS EN ISO 17349:2016