

Rotodynamic pumps — Hydraulic performance acceptance tests — Grades 1 and 2

The European Standard EN ISO 9906:1999 has the status of a
British Standard

ICS 23.080

National foreword

This British Standard is the official English language version of EN ISO 9906:1999. It is identical with ISO 9906:1999. It supersedes BS 5316-1:1976 and BS 5316-2:1977, which are withdrawn.

The UK participation in its preparation was entrusted to Technical Committee MCE/6, Pumps and pump testing, which has the responsibility to:

- aid enquirers to understand the text;
- present to the responsible international/European committee any enquiries on the interpretation, or proposals for change, and keep the UK interests informed;
- monitor related international and European developments and promulgate them in the UK.

A list of organizations represented on this subcommittee can be obtained on request to its secretary.

Cross-references

The British Standards which implement international or European publications referred to in this document may be found in the *BSI Catalogue* under the section entitled “International Standards Correspondence Index”, or by using the “Search” facility of the *BSI Electronic Catalogue* or of British Standards Online.

This publication does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

Compliance with a British Standard does not of itself confer immunity from legal obligations.

Summary of pages

This document comprises a front cover, an inside front cover, the EN ISO title page, the EN ISO foreword page, the ISO title page, pages ii to v, a blank page, pages 1 to 63 and a back cover.

The BSI copyright notice displayed in this document indicates when the document was last issued.

Amendments issued since publication

Amd. No.	Date	Comments
13508 Corrigendum No. 1	30 January 2001	Addition of supersession details
13945 Corrigendum No. 2	7 October 2002	Corrections to EN foreword and addition of Annex ZA

This British Standard, having been prepared under the direction of the Engineering Sector Committee, was published under the authority of the Standards Committee and comes into effect on 15 August 2000

© BSI 7 October 2002

ISBN 0 580 34421 5

English version

**Rotodynamic pumps - Hydraulic performance acceptance tests -
Grades 1 and 2 (ISO 9906:1999)**

Pompes rotodynamiques - Essais de fonctionnement
hydraulique pour la réception - Niveaux 1 et 2 (ISO
9906:1999)

Kreiselpumpen - Norm für hydraulische Abnahmeversuche
- Klasse 1 und 2 (ISO 9906:1999)

This European Standard was approved by CEN on 20 August 1999.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the Central Secretariat or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the Central Secretariat has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Iceland, Ireland, Italy, Luxembourg, Netherlands, Norway, Portugal, Spain, Sweden, Switzerland and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

Central Secretariat: rue de Stassart, 36 B-1050 Brussels

CORRECTED 2002-05-08

Foreword

This document (ISO 9906:1999) has been prepared by Technical Committee ISO/TC 115, Pumps, in collaboration with Technical Committee CEN/TC 197, Pumps, the Secretariat of which is held by AFNOR.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by June 2000, and conflicting national standards shall be withdrawn at the latest by June 2000.

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Iceland, Ireland, Italy, Luxembourg, Netherlands, Norway, Portugal, Spain, Sweden, Switzerland and the United Kingdom.

Endorsement notice

The text of the International Standard ISO 9906:1999 has been approved by CEN as a European Standard without any modifications.

NOTE Normative references to International Standards are listed in annex ZA (normative).

INTERNATIONAL STANDARD

EN ISO 9906:1999

**ISO
9906**

First edition
1999-12-15

Rotodynamic pumps — Hydraulic performance acceptance tests — Grades 1 and 2

*Pompes rotodynamiques — Essais de fonctionnement hydraulique pour
la réception — Niveaux 1 et 2*



Contents

1 Scope 1

2 Normative references 1

3 Terms, definitions and symbols 2

4 Guarantees 8

4.1 Subjects of guarantees 8

4.2 Other conditions of guarantee 8

5 Execution of tests 8

5.1 Subjects of tests 8

5.2 Organization of tests 9

5.3 Test arrangements 11

5.4 Test conditions 13

6 Analysis of test results 17

6.1 Translation of the test results to the guarantee conditions 17

6.2 Measuring uncertainties 18

6.3 Values of tolerance factors 20

6.4 Verification of guarantees 20

6.5 Obtaining specified characteristics 21

7 Measurement of flow rate 22

7.1 Measurement by weighing 22

7.2 Volumetric method 22

7.3 Differential pressure devices 22

7.4 Thin-plate weirs 23

7.5 Velocity area methods 23

7.6 Tracers methods	23
7.7 Other methods	23
8 Measurement of pump total head	24
8.1 General	24
8.2 Definitions of the measuring sections	25
8.3 Water level measurement	30
8.4 Pressure measurements	31
9 Measurement of speed of rotation	34
10 Measurement of pump power input	35
10.1 General	35
10.2 Measurement of torque	35
10.3 Electric power measurements	35
10.4 Special cases	35
11 Cavitation tests	36
11.1 General	36
11.2 Test installations	38
11.3 Determination of the NPSH required by the pump	39
Annex A (normative) Tolerance factors for pumps produced in series with selection made from typical performance curves and for pumps with a driver power input less than 10kW (relevant to series pumps grade 2)	42
Annex B (normative) Determination of reduced impeller diameters	43
Annex C (normative) Friction losses	44
Annex D (informative) Conversion to SI units	49
Annex E (informative) Guide for suitable time periods between calibration of test instruments	50
Annex F (informative) Costs and repetition of tests	51
Annex G (informative) Performance correction chart for viscous liquids	52
Annex H (informative) NPSHR reduction for pumps handling hydrocarbon liquids and high temperature water	55
Annex I (informative) Statistical evaluation of measurement results	57
Annex J (informative) Pump test sheet	59
Annex K (informative) Checklist	60
Annex ZA (normative) Normative references to international publications with their relevant European publications	61
Bibliography	62

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

International Standards are drafted in accordance with the rules given in the ISO/IEC Directives, Part 3.

Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

International Standard ISO 9906 was prepared by Technical Committee ISO/TC 115, *Pumps*, Subcommittee SC 2, *Methods of measuring and testing*.

This first edition of ISO 9906 cancels and replaces ISO 2548:1975 and ISO 3555:1977, which have been combined and technically revised (see Introduction).

Annexes A, B and C form a normative part of this International Standard. Annexes D to K are for information only.

Introduction

This International Standard combines and replaces the former acceptance test standards ISO 3555:1977 (corresponding to grade 1 of this International Standard) and ISO 2548:1975 (corresponding to grade 2 of this International Standard), but there is an important change in the verification of guarantees, because the uncertainty of measurement must not influence the acceptability of a pump and the tolerances are due to constructional differences only.

New tolerance factors have been introduced to ensure as far as possible that a pump which was acceptable under the previous International Standards (ISO 2548 and/or ISO 3555) would also be acceptable under this International Standard.

Contrary to this International Standard, ISO 5198 is not to be understood as an acceptance test code. It gives guidance for measurements of very high accuracy and for the thermodynamic method for direct measurement of efficiencies, but it does not recommend verification of guarantees.

Terms used in this International Standard such as “guarantee” or “acceptance” should be understood in a technical but not in a legal sense. The term “guarantee” therefore specifies values for checking purposes determined in the contract, but does not say anything about the rights or duties arising, if these values are not reached or fulfilled. The term “acceptance” does not have any legal meaning here, either. Therefore, an acceptance test carried out successfully alone does not represent an “acceptance” in the legal sense.

Rotodynamic pumps — Hydraulic performance acceptance tests — Grades 1 and 2

1 Scope

This International Standard specifies hydraulic performance tests for acceptance of rotodynamic pumps (centrifugal, mixed flow and axial pumps, hereinafter simply designated as “pumps”). It is applicable to pumps of any size and to any pumped liquids behaving as clean cold water (such as defined in 5.4.5.2). It is neither concerned with the structural details of the pump nor with the mechanical properties of their components.

This International Standard contains two grades of accuracy of measurement: grade 1 for higher accuracy, and grade 2 for lower accuracy. These grades include different values for tolerance factors, for allowable fluctuations and uncertainties of measurement.

For pumps produced in series with selection made from typical performance curves and for pumps with power input of less than 10 kW, see annex A for higher tolerance factors.

This International Standard is applicable both to a pump itself without any fittings and to a combination of a pump associated with all or part of its upstream and/or downstream fittings.

2 Normative references

The following normative documents contain provisions which, through reference in this text, constitute provisions of this International Standard. For dated references, subsequent amendments to, or revisions of, any of these publications do not apply. However, parties to agreements based on this International Standard are encouraged to investigate the possibility of applying the most recent editions of the normative documents indicated below. For undated references, the latest edition of the normative document referred to applies. Members of ISO and IEC maintain registers of currently valid International Standards.

ISO 1438-1, *Water flow measurement in open channels using weirs and Venturi flumes — Part 1: Thin-plate weirs.*

ISO 2186, *Fluid flow in closed conduits — Connections for pressure signal transmissions between primary and secondary elements.*

ISO 3354, *Measurement of clean water flow in closed conduits — Velocity-area method using, current-meters in full conduits and under regular flow conditions.*

ISO 3966, *Measurement of fluid flow in closed conduits — Velocity area method using Pitot static tubes.*

ISO 4373, *Measurement of liquid flow in open channels — Water-level measuring devices.*

ISO 5167-1, *Measurement of fluid flow by means of pressure differential devices — Part 1: Orifice plates, nozzles and Venturi tubes inserted in circular cross-section conduits running full.*

ISO 5198, *Centrifugal, mixed flow and axial pumps — Code for hydraulic performance tests — Precision grade.*

ISO 7194, *Measurement of fluid flow in closed conduits — Velocity-area methods of flow measurement in swirling or asymmetric flow conditions in circular ducts by means of current-meters or Pitot-static tubes.*

ISO 8316, *Measurement of liquid flow in closed conduits — Method by collection of the liquid in a volumetric tank.*

ISO 9104, *Measurement of liquid flow in closed conduits — Methods of evaluating the performance of electromagnetic flow-meters for liquids.*

IEC 60034-2, *Recommendations for rotating electrical machinery (excluding machines for traction vehicles) — Part 2: Determination of efficiency of rotating electrical machinery.*

IEC 60051, *Recommendations for direct acting electrical measuring instruments and their accessories.*

3 Terms, definitions and symbols

For the purposes of this International Standard, the following terms, definitions and symbols apply.

NOTE 1 The definitions, particularly those given for head and net positive suction head (NPSH), may not be appropriate for general use in hydrodynamics, and are for the purposes of this International Standard only. Some terms in current use but not strictly necessary for the use of this International Standard are not defined.

NOTE 2 Table 1 gives an alphabetical list of symbols used, and Table 2 gives a list of subscripts. In this International Standard all formulae are given in coherent SI units. For conversion of other units to SI units, see annex D.

NOTE 3 In order to avoid any error of interpretation, it is deemed desirable to reproduce the definitions of quantities and units as given in ISO 31 and to supplement these definitions by some specific information on their use in this International Standard.

3.1 angular velocity

number of radians of a shaft per unit time

$$= 2 \pi n$$

3.2 speed of rotation

number of rotations per unit time

3.3 density

mass per unit volume

3.4 pressure

force per unit area

NOTE In this International Standard all pressures are gauge pressures, i.e. measured with respect to the atmospheric pressure, except for atmospheric pressure and the vapour pressure which are absolute pressures.

3.5 power

energy transferred per unit time

3.6 Reynolds number

$$Re = \frac{UD}{\nu}$$

3.7 mass flow rate

external mass flow rate of the pump, i.e. the rate of flow discharged into the pipe from the outlet branch of the pump

NOTE 1 The following losses or abstractions are inherent to the pump:

- a) discharge necessary for hydraulic balancing of axial thrust;
- b) cooling of bearings of the pump itself;
- c) liquid seal to the packing.

NOTE 2 Leakage from the fittings, internal leakage, etc., are not to be reckoned in the rate of flow. On the contrary, all derived flows for other purposes, such as

¾ cooling of the motor bearings;

¾ cooling of a gear box (bearings, oil cooler), etc.

are to be reckoned in the rate of flow.

NOTE 3 Whether and how these flows are to be taken into account depends on the location of their derivation and of the section of flow-measurement, respectively.

3.8

volume flow rate

outlet volume flow rate has the following value:

$$Q = \frac{q}{\rho}$$

NOTE In this International Standard the symbol Q may also designate the volume flow rate in any given section. It is the quotient of the mass flow rate in this section and the density. (The section may be designated by subscripts.)

3.9

mean velocity

mean axial velocity of flow equal to the volume flow rate divided by the pipe cross section area

$$U = \frac{Q}{A}$$

NOTE Attention is drawn to the fact that in this case Q may vary for different reasons across the circuit.

3.10

local velocity

velocity of flow at any point

3.11

head

energy per unit mass of fluid, divided by acceleration due to gravity, g

3.12

reference plane

any horizontal plane used as a datum for height measurement

NOTE For practical reasons it is preferable not to specify an imaginary reference plane.

3.13

height above reference plane

height of the considered point above the reference plane

NOTE Its value is:

¾ positive, if the considered point is above the reference plane;

¾ negative, if the considered point is below the reference plane.

See Figures 3 and 4.

3.14
gauge pressure

pressure relative to atmospheric pressure

NOTE 1 Its value is:

$\frac{3}{4}$ positive, if this pressure is greater than the atmospheric pressure;

$\frac{3}{4}$ negative, if this pressure is less than the atmospheric pressure.

NOTE 2 All pressures in this International Standard are gauge pressures read from a manometer or similar pressure-sensing instrument, except atmospheric pressure and the vapour pressure of the liquid, which are expressed as absolute pressures.

3.15
velocity head

kinetic energy per unit mass of the liquid in movement, divided by g :

$$\frac{U^2}{2g}$$

3.16
total head

in any section, the total head is given by:

$$H_x = z_x + \frac{p_x}{\rho g} + \frac{U_x^2}{2g}$$

where z is the height of the centre of the cross-section above the reference plane and p is the gauge pressure related to the centre of the cross-section

NOTE The absolute total head in any section is given by:

$$H_{x(\text{abs})} = z_x + \frac{p_x}{\rho g} + \frac{p_{\text{amb}}}{\rho g} + \frac{U_x^2}{2g}$$

3.17
inlet total head

total head in the inlet section of the pump:

$$H_1 = z_1 + \frac{p_1}{\rho g} + \frac{U_1^2}{2g}$$

3.18
outlet total head

total head in the outlet section of the pump:

$$H_2 = z_2 + \frac{p_2}{\rho g} + \frac{U_2^2}{2g}$$

3.19
pump total head

algebraic difference between the outlet total head H_2 and the inlet total head H_1

NOTE 1 If the compressibility is negligible, $H = H_2 - H_1$.

If the compressibility of the pumped liquid is significant, the density ρ should be replaced by the mean value:

$$\rho_m = \frac{\rho_1 + \rho_2}{2}$$

and the pump total head should be calculated by the formula:

$$H = z_2 - z_1 + \frac{p_2 - p_1}{\rho_m g} + \frac{U_2^2 - U_1^2}{2g}$$

NOTE 2 The mathematically correct symbol would be H_{1-2} .

3.20

specific energy

energy per unit mass of liquid:

$$y = gH$$

3.21

loss of head at inlet

difference between the total head of the liquid at the measuring point and the total head of the liquid in the inlet section of the pump

3.22

loss of head at outlet

difference between the total head of the liquid in the outlet section of the pump and the total head of the liquid at the measuring point

3.23

pipe friction loss coefficient

coefficient for the head loss by friction in the pipe

3.24

net positive suction head

NPSH

absolute inlet total head above the head equivalent to the vapour pressure relative to the NPSH datum plane:

$$\text{NPSH} = H_1 - z_D + \frac{p_{\text{amb}} - p_v}{\rho_1 g}$$

NOTE This NPSH relates to the NPSH datum plane, whereas the inlet total head relates to the reference plane.

3.25

NPSH datum plane

<multistage pumps> horizontal plane through the centre of the circle described by the external points of the entrance edges of the impeller blades

3.26

NPSH datum plane

<double inlet pumps with vertical or inclined axis> plane through the higher centre

NOTE The manufacturer should indicate the position of this plane with respect to precise reference points on the pump.

See Figure 1.

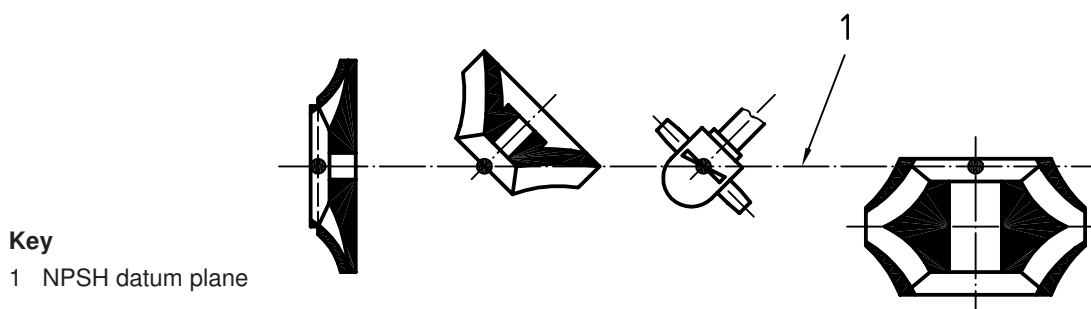


Figure 1 — NPSH datum plane

3.27
available NPSH
NPSHA

NPSH available as determined by the conditions of the installation for a specified flow rate

3.28
required NPSH
NPSHR

minimum NPSH given by the manufacturer/supplier for a pump achieving a specified performance at a specified flow rate, speed and pumped liquid (occurrence of visible cavitation, increase of noise and vibration due to cavitation, beginning of head or efficiency drop, head or efficiency drop of a given amount, limitation of cavitation erosion)

3.29
NPSH3

NPSH required for a drop of 3 % of the total head of the first stage of the pump as standard basis for use in performance curves

3.30
type number

dimensionless quantity calculated at the point of best efficiency which is defined by the following formula:

$$K = \frac{2 \pi n Q^{1/2}}{(gH)^{3/4}} = \frac{Q^{1/2}}{y^{3/4}}$$

where Q' is the volume rate of flow per eye and H' is the head of the first stage

NOTE The type number is to be taken at maximum diameter of the first stage impeller.

3.31
pump power input

power transmitted to the pump by its driver

3.32
pump power output

mechanical power transferred to the liquid during its passage through the pump:

$$P_u = \rho Q g H = \rho Q y$$

3.33
driver power input

power absorbed by the pump driver

3.34
pump efficiency

pump power output divided by the pump power input

$$\eta = \frac{P_u}{P}$$

3.35
overall efficiency

pump power output divided by the driver power input

$$\eta_{gr} = \frac{P_u}{P_{gr}}$$

Table 1 — Alphabetical list of basic letters used as symbols

Symbol	Quantity	Unit
<i>A</i>	Area	m ²
<i>D</i>	Diameter	m
<i>E</i>	Energy	J
<i>e</i>	Overall uncertainty, relative value	%
<i>f</i>	Frequency	s ⁻¹ , Hz
<i>g</i>	Acceleration due to gravity ^a	m/s ²
<i>H</i>	Pump total head	m
<i>H_J</i>	Losses in terms of head of liquid	m
<i>k</i>	Equivalent uniform roughness	m
<i>K</i>	Type number	(pure number)
<i>l</i>	Length	m
<i>m</i>	Mass	kg
<i>n</i>	Speed of rotation	s ⁻¹ , min ⁻¹
NPSH	Net positive suction head	m
<i>p</i>	Pressure	Pa
<i>P</i>	Power	W
<i>q</i>	Mass flow rate ^b	kg/s
<i>Q</i>	Volume flow rate ^c	m ³ /s
<i>Re</i>	Reynolds number	(pure number)
<i>t</i>	Tolerance factor, relative value	%
<i>t</i>	Time	s
<i>T</i>	Torque	Nm
<i>U</i>	Mean velocity	m/s
<i>v</i>	Local velocity	m/s
<i>V</i>	Volume	m ³
<i>y</i>	Specific energy	J/kg
<i>z</i>	Height above reference plane	m
<i>z_D</i>	Difference between NPSH datum plane (see 3.25) and reference plane	m
<i>η</i>	Efficiency	(pure number)
<i>Θ</i>	Temperature	°C
<i>λ</i>	Pipe friction loss coefficient	(pure number)
<i>ν</i>	Kinematic viscosity	m ² /s
<i>ρ</i>	Density	kg/m ³
<i>ω</i>	Angular velocity	rad/s

^a In principle, the local value of *g* should be used. Nevertheless, for grade 2 it is sufficient to use a value of 9,81 m/s². For the calculation of the local value $g = 9,780\,3 (1 + 0,005\,3 \sin^2\varphi) - 3 \cdot 10^{-6} \cdot z$, where φ is the latitude and *z* is the altitude.

^b An optional symbol for mass rate of flow is *q_m*.

^c An optional symbol for volume rate of flow is *q_v*.

Table 2 — List of letters and figures used as subscript

Subscript	Meaning
1	inlet
1'	inlet measuring section
2	outlet
2'	outlet measuring section
abs	absolute
amb	ambient
D	difference, datum
f	fluid in measuring pipes
G	guaranteed
H	pump total head
gr	combined motor/pump unit (overall)
m	mean
M	manometer
<i>n</i>	speed of rotation
<i>P</i>	power
<i>Q</i>	(volume) flow rate
sp	specified
T	translated, torque
u	useful
v	vapour (pressure)
<i>η</i>	efficiency
<i>x</i>	at any section

4 Guarantees

4.1 Subjects of guarantees

One guarantee point shall be defined by a guarantee flow Q_G and a guarantee head H_G .

The manufacturer/supplier guarantees that under the specified conditions and at the specified speed (or in some cases frequency and voltage) the measured $H(Q)$ curve will pass through a range of tolerance (see Table 10 and Figure 2), surrounding the guarantee point.

Other tolerance ranges (e.g. only given by positive tolerance factors) may be agreed upon in the contract.

In addition, one or more of the following quantities may be guaranteed under the specified conditions and at the specified speed:

- | | | |
|--|---|---|
| <ul style="list-style-type: none"> a) the pump efficiency, η_G, or in the case of overall pump driver unit, the combined efficiency, η_{grG}; b) the required net positive suction head (NPSHR) at the guarantee flow; | } | <p>at the flow rate which is defined in 6.4.2 and Figure 2.</p> |
|--|---|---|

By special agreement several guarantee points and the appropriate values of efficiency and required net positive suction head at reduced or increased flow rates may be guaranteed. The maximum power input may be guaranteed for the guarantee flow or for a range of operation. This, however, may require larger tolerance ranges to be agreed upon between the purchaser and manufacturer/supplier.

4.2 Other conditions of guarantee

Unless otherwise agreed, the following conditions shall apply to the guaranteed values.

- a) Unless the chemical and physical properties of the liquid being pumped are stated, the guarantee points shall apply to clean cold water (see 5.4.5.2).
- b) The relationship between the guarantee values under clean cold water conditions and the likely performance under other liquid conditions shall be agreed in the contract.
- c) Guarantees shall apply only to the pump as tested by the methods and in the test arrangements specified in this International Standard.
- d) The pump manufacturer/supplier shall not be responsible for the specification of the guarantee point.

5 Execution of tests

5.1 Subjects of tests

5.1.1 General

If not otherwise agreed between the manufacturer/supplier and the purchaser, the following shall apply:

- a) accuracy according to grade 2;
- b) tests shall be carried out on the test stand of the manufacturer's works;
- c) the NPSH test is not included.

Any deviations from this shall be agreed between the purchaser and manufacturer/supplier. This should be done as soon as possible, and should preferably form part of the contract.

Among others, such deviations may be:

- $\frac{3}{4}$ accuracy according to grade 1;

- ¾ no negative tolerance factors (see 4.1);
- ¾ tolerance factors corresponding to annex A;
- ¾ statistical evaluation of measurement results according to annex I;
- ¾ tests in a neutral laboratory or on site;
- ¾ deviations from the requirements concerning the installation of the pump and the measuring apparatus;
- ¾ simulated construction of pumps (e.g. several rotors in same casing);
- ¾ a requirement for the NPSH test.

Annex K shows a checklist of items where agreement between the purchaser and manufacturer/supplier is recommended.

5.1.2 Contractual tests — Fulfilment of the guarantee

The tests are intended to ascertain the performance of the pump and to compare this with the manufacturer's/supplier's guarantee.

The nominated guarantee for any quantity shall be deemed to have been met if, when tested according to this International Standard, the measured performance fails within the tolerance specified for the particular quantity (see clause 6).

When NPSHR is to be guaranteed, the type of test shall be specified (see 11.1.2).

When a number of identical pumps are to be purchased, the number of pumps to be tested shall be agreed between the purchaser and manufacturer/supplier.

5.1.3 Additional checks

During the test, it may be noted if the behaviour of the pump is satisfactory in respect of the temperature of packings and bearings, of leakage of air or water, of acoustic emission and of vibrations¹).

5.2 Organization of tests

5.2.1 General

Both, purchaser and manufacturer/supplier shall be entitled to witness these tests.

5.2.2 Location of tests

5.2.2.1 Works tests

Performance tests should preferably be carried out at the manufacturer's works, or at a place to be mutually agreed between the manufacturer/supplier and the purchaser.

5.2.2.2 Site tests

Special agreement is necessary for performance tests on site providing all the requirements of this International Standard can be satisfied. It is, however, recognised that the conditions at most sites often preclude full compliance with this International Standard. In these instances site performance tests may still be acceptable providing the parties have agreed how allowance is made for the inaccuracies which will inevitably result from departure from the specified requirement.

1) Special International Standards for pumps are under study in ISO/TC 115.

5.2.3 Date of testing

The date of testing shall be mutually agreed by the manufacturer/supplier and the purchaser.

5.2.4 Staff

Accurate measurements depend not only on the quality of the measuring instruments used but also on the ability and skill of the persons operating and reading the measuring devices during the tests. The staff entrusted with effecting the measurements shall be selected just as carefully as the instruments to be used in the test.

Specialists with adequate experience in measuring operations in general shall be charged with operating and reading complicated measuring apparatus. Reading simple measuring devices may be entrusted to such helpers who (upon prior instruction) can be assumed to effect the readings with proper care and the accuracy required.

A test supervisor possessing adequate experience in measuring operations shall be mutually appointed. Normally, when the test is carried out at the manufacturer's works, the test supervisor is a staff member of the pump manufacturer.

During the tests all persons charged with effecting the measurements are subordinated to the chief of tests, who conducts and supervises the measurements, reports on test conditions and the results of the tests and then drafts the test report. All questions arising in connection with the measurements and their execution are subject to his decision.

The parties concerned shall provide all assistance that the chief of tests considers necessary.

5.2.5 State of pump

When tests are not carried out in the manufacturer's works, opportunity shall be allowed for preliminary adjustments by both manufacturer and installer.

5.2.6 Test programme

The programme and procedure to be followed in the test shall be prepared by the test supervisor and submitted to both manufacturer/supplier and purchaser in ample time for consideration and agreement.

Only the guaranteed operational data (see 4.1) shall form the basis of the test, other data determined by measurement during the tests shall have merely an indicative (informative) function and it shall be so stated if they are included in the programme.

5.2.7 Testing equipment

When deciding on the measuring procedure, the measuring and recording apparatus required shall be specified at the same time.

The test supervisor shall be responsible for checking the correct installation of the apparatus and its proper functioning.

All of the measuring apparatus shall be covered by reports showing by calibration or by comparison with other ISO or IEC standards that it complies with the requirement of 6.2. These reports shall be presented if required.

Guidance for suitable period between calibrations of test instruments is given in annex E.

5.2.8 Records

All test records and record charts shall be initialled by the test supervisor and by the representatives of both the manufacturer/supplier and purchaser if present, each of whom shall be provided with a copy of all records and charts.

The evaluation of the test results shall be made as far as possible while the tests are in progress and, in any case, before the installation and instrumentation are dismantled in order that suspect measurements can be repeated without delay.

5.2.9 Test report

After scrutiny, the test results shall be summarized in a report which is signed by the test supervisor alone, or together, by him and representatives of the manufacturer/supplier and of the purchaser.

All parties specified in the contract shall receive a copy of the report.

The test report should contain the following information:

- a) place and date of acceptance test;
- b) manufacturer's name, type of pump, serial number, and possibly year of construction;
- c) impeller diameter, blade angle or other impeller identifications;
- d) guaranteed characteristics, operational conditions during the acceptance test;
- e) specification of the pump's driver;
- f) sketch of test arrangement, diameters of measuring sections, description of the test procedure and the measuring apparatus used including calibration data;
- g) readings;
- h) evaluation and analysis of test results;
- i) conclusions:
 - $\frac{3}{4}$ comparison of the test results and the guaranteed quantities,
 - $\frac{3}{4}$ determination of action taken in connection with any special agreements that were made,
 - $\frac{3}{4}$ recommendation whether the pump can be accepted or should be rejected and under what conditions (if the guarantees are not fully satisfied the final decision whether the pump can be accepted or not is up to the purchaser),
 - $\frac{3}{4}$ statements arising out of action taken in connection with any special agreements that were made.

A pump test sheet is given for guidance in annex J.

5.3 Test arrangements

5.3.1 General

The conditions necessary to ensure satisfactory measurement of the characteristics of operation are defined in this subclause, taking into account the accuracy required for tests of grades 1 and 2.

NOTE 1 The performance of a pump in a given test arrangement, however accurately measured, cannot be assumed to be a correspondingly accurate indication of its performance in another arrangement.

NOTE 2 Recommendations and general guidance about suitable pipe arrangements to ensure satisfactory measurements are given in clauses 7 and 8 and, if necessary, they can be used in conjunction with the International Standards on measurement of flow rates in closed conduits concerning the different methods (see clause 7).

5.3.2 Standard test arrangements

The best measuring conditions are obtained when, in the measuring sections, the flow has

- $\frac{3}{4}$ an axially symmetrical velocity distribution;
- $\frac{3}{4}$ a uniform static pressure distribution;
- $\frac{3}{4}$ freedom from swirl induced by the installation.

For grades 1 and 2, verification is not required as it is not possible, in practice, entirely to meet these requirements.

It is possible to prevent a very poor velocity distribution or swirl by avoiding any bend or a combination of bends, any expansion or any discontinuity in the transverse profile in the vicinity (less than four diameters) of the measuring section.

Generally the effect of the inlet flow conditions increases with the type number K of the pump. When $K > 1,2$ it is recommended to simulate the site conditions.

It is recommended that for standard test arrangements leading from reservoirs with a free surface or from large stilling vessels in a closed circuit, the inlet straight length L shall be determined by the expression: $L/D = K + 5$, where D is the pipe diameter. This is especially valid for grade 1 tests.

This expression is also valid for an arrangement that includes, at a distance L upstream, a simple right-angle bend that is not fitted with guide vanes. Under these conditions, flow straighteners are not necessary in the pipe between the bend and the pump. However, in a closed circuit where there is neither a reservoir nor a stilling vessel immediately upstream of the pump, it is necessary to ensure that the flow into the pump is free from swirl induced by the installation and has a normal symmetrical velocity distribution.

Significant swirl can be avoided by

- ¾ careful design of the test circuit upstream of the measuring section;
- ¾ judicious use of a flow straightener;
- ¾ suitable arrangement of the pressure tapings to minimize their influence on the measurement.

It is recommended not to install a throttle valve in the suction pipe (see 5.4.4). Nevertheless, if this cannot be avoided, for instance for cavitation tests, the straight pipe length between the valve and the pump inlet should be in conformity with the requirements of 11.2.2.

5.3.3 Simulated test arrangements

When from the reasons given above it is agreed to test a pump under simulated site conditions, it is important that at the inlet of the simulated circuit the flow should as far as possible be free from significant swirl induced by the installation and have a symmetrical velocity distribution. All necessary provisions shall be made to ensure these conditions are achieved.

If necessary, for grade 1 tests the velocity distribution of the flow into the simulated circuit shall be determined by careful Pitot tube traverses, in order to establish that the required flow characteristics exist. If not, the required characteristics can be obtained by the installation of suitable means, such as a flow straightener, adapted to correct the fault in the flow (swirl or asymmetry). Specifications of the most widely used types of flow straighteners can be found in ISO 7194. But care shall be taken to ensure that the conditions of test will not be affected by the pressure losses associated with some straightening devices.

5.3.4 Pumps tested with fittings

If specified in the contract, standard tests can be carried out on a combination of a pump and the following:

- a) associated fittings at the final site installation; or
- b) an exact reproduction thereof; or
- c) fittings introduced for testing purposes and taken as forming part of the pump itself.

The flow at the inlet and outlet of the whole combination shall comply with the requirements specified in 5.3.2.

Measurements shall be taken in accordance with 8.2.2.

5.3.5 Pumping installation under submerged conditions

Where a pump, or a combination of a pump and its fittings, is tested or installed in conditions where the standard pipe connection as described in 5.3.2 cannot be made owing to inaccessibility or submergence, measurements shall be taken in accordance with 8.2.3.

5.3.6 Borehole and deep-well pumps

Borehole and deep-well pumps cannot usually be tested with their complete lengths of delivery main and, consequently, the loss of head in the portions omitted and the power absorbed by any shafting therein, cannot be taken into account. The thrust bearing will be more lightly loaded during the test than it would be in the final installation. The measurements shall be taken in accordance with 8.2.3.

5.3.7 Self-priming pumps

In principle, the priming ability of self-priming pumps shall always be verified at the contractual static suction head with the attached inlet piping equivalent to that in the final installation. When the test cannot be carried out in the described manner, the test arrangement to be used shall be specified in the contract.

5.4 Test conditions

5.4.1 Test procedure

The duration of the test shall be sufficient to obtain consistent results regarding the degree of accuracy to be achieved.

All measurements shall be made under steady conditions of operation or unsteady within the limits given in Table 4.

A decision to make measurements when such conditions cannot be obtained shall be a matter of agreement between the parties concerned.

Verification of the guarantee point shall be obtained by recording at least three (grade 2 tests) or five (grade 1 tests) points of measurements closely and evenly grouped around the guarantee point, for example between $0,9 Q_G$ and $1,1 Q_G$.

Where, for special reasons, it is necessary to determine performance over a range of operating conditions, a sufficient number of measurement points shall be taken to establish the performance within the limits of uncertainty stated in 6.2.

If the driving power available during a test on a test stand is insufficient, and if the test has to be carried out at reduced speed of rotation, the test results shall be translated to the specified speed of rotation in accordance with 6.1.2.

5.4.2 Stability of operation

5.4.2.1 General remarks

For the purposes of this International Standard, the following shall be considered.

- a) Fluctuations: short-period changes in the measured value of a physical quantity about its mean value during the time that a single reading is being made.
- b) Variations: those changes in value which take place between one reading and the next.

5.4.2.2 Permissible fluctuations in readings and use of damping

5.4.2.2.1 Direct visual observation of the signals delivered by measuring systems

For each quantity to be measured, Table 3 gives the permissible amplitude of fluctuations.