



BSI Standards Publication

Heat recovery ventilators and energy recovery ventilators — Method of test for performance

Part 1: Development of metrics for evaluation of energy related performance

National foreword

This British Standard is the UK implementation of ISO 16494-1:2022+A1:2023. It supersedes BS ISO 16494-1:2022, which is withdrawn.

The start and finish of text introduced or altered by amendment is indicated in the text by tags. Tags indicating changes to ISO text carry the number of the ISO amendment. For example, text altered by ISO amendment 1 is indicated by A1 A1.

The UK participation in its preparation was entrusted to Technical Committee RHE/17, Testing of air conditioning units.

A list of organizations represented on this committee can be obtained on request to its committee manager.

Contractual and legal considerations

This publication has been prepared in good faith, however no representation, warranty, assurance or undertaking (express or implied) is or will be made, and no responsibility or liability is or will be accepted by BSI in relation to the adequacy, accuracy, completeness or reasonableness of this publication. All and any such responsibility and liability is expressly disclaimed to the full extent permitted by the law.

This publication is provided as is, and is to be used at the recipient's own risk.

The recipient is advised to consider seeking professional guidance with respect to its use of this publication.

This publication is not intended to constitute a contract. Users are responsible for its correct application.

© The British Standards Institution 2023
Published by BSI Standards Limited 2023

ISBN 978 0 539 24624 7

ICS 23.120; 27.080

Compliance with a British Standard cannot confer immunity from legal obligations.

This British Standard was published under the authority of the Standards Policy and Strategy Committee on 31 August 2022.

Amendments/corrigenda issued since publication

Date	Text affected
30 November 2023	Implementation of ISO amendment 1:2023

Heat recovery ventilators and energy recovery ventilators — Method of test for performance —

Part 1: Development of metrics for evaluation of energy related performance

*Ventilateurs-récupérateurs de chaleur et ventilateurs-récupérateurs
d'énergie — Méthode d'essai des performances —*

*Partie 1: Développement de paramètres pour l'évaluation des
performances énergétiques*





COPYRIGHT PROTECTED DOCUMENT

© ISO 2022

All rights reserved. Unless otherwise specified, or required in the context of its implementation, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
CP 401 • Ch. de Blandonnet 8
CH-1214 Vernier, Geneva
Phone: +41 22 749 01 11
Email: copyright@iso.org
Website: www.iso.org

Published in Switzerland

Contents

Page

Foreword	v
1 Scope	1
2 Normative references	1
3 Terms and definitions	1
4 Symbols and abbreviated terms	6
4.1 Symbols	6
4.2 Subscripts	7
5 General test requirements	8
5.1 Test apparatus	8
5.2 Installation	8
5.3 Static pressure	8
5.4 Temperature	8
5.5 Concentration	8
5.6 Power input	8
5.7 Instrument calibration	8
6 Airflow tests	9
6.1 General conditions	9
6.1.1 General	9
6.1.2 Temperature conditions	9
6.1.3 Speed control settings	9
6.1.4 Unit operating voltage and frequency	9
6.2 Ducted heat recovery ventilators and energy recovery ventilators	9
6.2.1 Airflows measured	9
6.2.2 Static pressure conditions	9
6.2.3 Airflow measurement methods for ducted heat recovery and energy recovery ventilators	11
6.3 Unducted heat recovery ventilators and energy recovery ventilators	12
6.3.1 Airflow measured	12
6.3.2 Static pressure conditions	12
6.3.3 Airflow measurement methods for unducted heat recovery and energy recovery ventilators	12
7 Tracer gas tests	12
7.1 General conditions	12
7.2 Temperature conditions	12
7.3 Preconditions	12
7.4 Airflow conditions	12
7.5 Unit operating voltage and frequency	12
7.6 Tracer gas measurement methods	12
8 Determination of efficiency	13
8.1 General conditions	13
8.2 Temperature and humidity conditions: inlets to ventilator	13
8.3 Preconditions	13
8.4 Airflow conditions	13
8.4.1 Required rating point	13
8.4.2 Alternate rating points	14
8.5 Static pressure conditions: ducted heat and energy recovery ventilators	14
8.6 Static pressure conditions: unducted heat and energy recovery ventilators	14
8.7 Unit operating voltage and frequency	14
8.8 Thermal performance measurement	14
9 Performance calculations	14
9.1 Performance calculations: ducted ventilators	14

9.2	Performance calculations: unducted ventilators.....	14
9.3	Unit exhaust air transfer ratio (UEATR)	15
9.4	Net supply airflow	15
9.4.1	Net supply airflow: ducted units.....	15
9.4.2	Net supply airflow: unducted units.....	15
9.5	Gross effectiveness, ε	16
9.6	Coefficient of energy (COE)	17
9.6.1	Coefficient of energy: ducted ventilators, $C_{\text{COE,ducted}}$	17
9.6.2	Coefficient of energy: unducted ventilators, $C_{\text{COE,unducted}}$	17
9.7	Effective work (EW)	18
10	Test results.....	19
Annex A	(informative) Airflow measurement methods for both ducted and unducted ventilators — Test equipment	20
Annex B	(normative) Decay method for measurement of net supply airflow	21
Annex C	(informative) Unit exhaust air transfer ratio measurement methods.....	23
Annex D	(informative) Thermal performance measurement	27
Annex E	(informative) Example data collection and reporting sheets	31
Annex F	(normative) Required instrument uncertainty	38
Annex G	(informative) Construction of plenums for connection to inlets or outlets not designed for connection of ductwork.....	39
Bibliography		40

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular, the different approval criteria needed for the different types of ISO documents should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see www.iso.org/directives).

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights. Details of any patent rights identified during the development of the document will be in the Introduction and/or on the ISO list of patent declarations received (see www.iso.org/patents).

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation of the voluntary nature of standards, the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the World Trade Organization (WTO) principles in the Technical Barriers to Trade (TBT), see www.iso.org/iso/foreword.html.

This document was prepared by Technical Committee ISO/TC 86, *Refrigeration and air-conditioning*, Subcommittee SC 6, *Testing and rating of air-conditioners and heat pumps*.

This first edition of ISO 16494-1 cancels and replaces the first edition (ISO 16494:2014), which has been technically revised.

The main changes are as follows:

- consistency with terms' definition between similar group of ISO standards (ERV and HRV);
- keep editorial rules of ISO/IEC Directives Part 2 (2021);
- general test requirements, chapter 5, was added;
- test condition, T8, was added in [Table 1](#);
- maximum variations of individual readings from specified test conditions in [Table F.2](#) was deleted.

Any feedback or questions on this document should be directed to the user's national standards body. A complete listing of these bodies can be found at www.iso.org/members.html.

Heat recovery ventilators and energy recovery ventilators — Method of test for performance —

Part 1:

Development of metrics for evaluation of energy related performance

1 Scope

This document specifies a method of testing the ventilation and energy related performance of heat recovery ventilators (HRVs) and energy recovery ventilators (ERVs) that do not contain any supplemental heating (except for defrost), cooling, humidification, or dehumidification components.

Exchanger types of HRVs and ERVs are

- a) fixed-plate exchangers (also known as recuperators),
- b) rotary exchangers, including heat wheels and total energy wheels (also known as regenerators), and
- c) heat pipe exchangers using a heat transfer medium, excluding those using mechanical pumping,

This document does not provide a method for measuring the response of exchangers to the formation of frost.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 3966, *Measurement of fluid flow in closed conduits — Velocity area method using Pitot static tubes*

ISO 5167 (all parts), *Measurement of fluid flow by means of pressure differential devices inserted in circular cross-section conduits running full*

ISO 5801, *Fans — Performance testing using standardized airways*

ISO 13253, *Ducted air-conditioners and air-to-air heat pumps — Testing and rating for performance*

ISO/IEC 17025:2017, *General requirements for the competence of testing and calibration laboratories*

3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- ISO Online browsing platform: available at <https://www.iso.org/obp>
- IEC Electropedia: available at <https://www.electropedia.org/>

3.1
coefficient of energy
COE

C_{COE}
total exchanged energy between the airstreams plus the *power value of moving air* (3.22), divided by the power input

Note 1 to entry: The formula for determining the coefficient of energy (C_{COE}) is given in 9.6.

3.2
duct

insulated or uninsulated closed passage for air that is installed as part of the ventilation system in lengths determined by the needs of application, and is separate, prior to installation from exterior terminations such as weather hoods

3.3
ducted ventilator

heat recovery ventilator or energy recovery ventilator which is intended for connection of ducts to one or more of the airflow inlets or outlets and intended to address a range of static pressure differentials from the duct(s)

3.4
effective work
EW

W_{EW}
total exchanged energy between the airstreams plus the power value of moving air minus the power input

Note 1 to entry: The formula for determining the effective work (W_{EW}) is given in 9.7.

Note 2 to entry: Effective work is expressed in W.

3.5
energy recovery ventilator
ERV

ventilator which is designed to transfer both heat and moisture between two isolated airstreams

3.6
entering exhaust air
exhaust air inlet
return airflow

RA
indoor air entering the ventilator

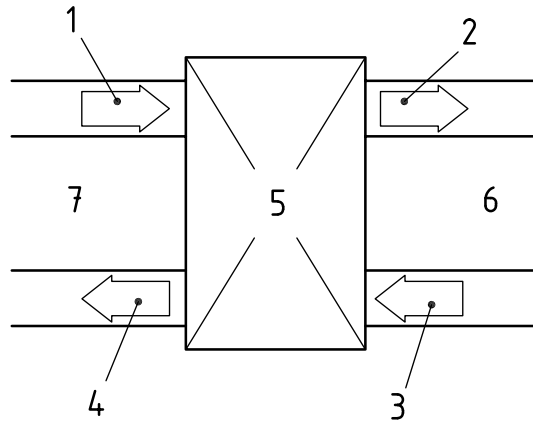
Note 1 to entry: $\overline{A_1}$ Indicated in Figure 1 as key 3. $\overline{A_1}$

3.7
entering supply air
supply air inlet
outdoor airflow

OA
outside air entering the ventilator

Note 1 to entry: $\overline{A_1}$ Indicated in Figure 1 as key 1. $\overline{A_1}$

A1

**Key**

- | | | | |
|---|--|---|--------------|
| 1 | entering supply air (OA) and/or station 1 | 5 | ventilator |
| 2 | leaving supply air (SA) and/or station 2 | 6 | indoor side |
| 3 | entering exhaust air (RA) and/or station 3 | 7 | outdoor side |
| 4 | leaving exhaust air (EA) and/or station 4 | | |

Figure 1 — Schematic numbering of airflows for heat and energy recovery ventilators A1**3.8****external static pressure difference**

external static pressure difference between inlet and outlet of an air stream or vi versa and is calculated as an absolute value

Note 1 to entry: The formula for absolute value is described in [6.2.2.1](#).

3.9**fixed-plate exchanger**

exchanger with multiple alternate airflow channels, separated by a heat or heat and water vapor transfer plate(s) and connected to supply and exhaust airstreams

3.10**fresh air mass flow rate**
 $\dot{m}_2$

supply-mass flowrate of dry air at station 2

3.11**gross effectiveness**

measured effectiveness, not adjusted for leakage, motor heat gain, or heat transfer through the unit casing

Note 1 to entry: The sensible, latent, or total gross effectiveness of an HRV or ERV, at equal airflows, is described in [9.5](#).

3.12**heat pipe exchanger**

exchanger with an array of finned and sealed tubes that are placed in side-by-side supply and exhaust airstreams, which may include an internal wick structure in each tube and filled with a heat transfer medium

Note 1 to entry: thermosiphon exchangers are a subset (or type) of heat pipe exchanger in which the heat transfer medium moves by gravitational forces only.

3.13**heat recovery ventilator****HRV**

ventilator which is designed to transfer only heat between two isolated airstreams

3.14

leaving exhaust air

exhaust air outlet

exhaust airflow

EA

indoor air after passing through the ventilator

Note 1 to entry: A_1 Indicated in [Figure 1](#) as key 4. A_1

3.15

leaving supply air

supply air outlet

supply airflow

SA

outside air after passing through the ventilator

Note 1 to entry: A_1 Indicated in [Figure 1](#) as key 2. A_1

3.16

maximum rated airflow

largest leaving supply and entering exhaust airflows, specified by the manufacturer, at which an airflow test is performed

Note 1 to entry: For ventilators with speed control devices, different maximum rated airflows may be defined for each speed control setting at which the test is performed.

3.17

minimum rated airflow

smallest leaving supply and entering exhaust airflows, specified by the manufacturer, at which an airflow test is performed

Note 1 to entry: For ventilators with speed control devices, different minimum rated airflows may be defined for each speed control setting at which the test is performed.

3.18

model-specific exterior termination system

weather hoods, fittings and through-wall penetrations designed by the ventilator manufacturer specifically for installation with a specific model of ventilator, that comprise the complete passageway connecting the ventilators outside air inlet and/or exhaust air outlet to the ventilator

3.19

net supply airflow

$Q_{2,\text{net}}$

portion of the leaving supply airflow that originated as entering supply airflow

Note 1 to entry: The net supply airflow is represented by the variable $Q_{2,\text{net}}$ measured in m^3/s .

Note 2 to entry: The formulae for determining net supply airflow are given in [9.4.1](#) (ducted units) and [9.4.2](#) (unducted units).

3.20

net supply airflow ratio

ratio determined by dividing net supply airflow by supply airflow

Note 1 to entry: Expressed as a percentage and described in [9.4.1](#) (see [Formula \(3\)](#)).

3.21**net supply mass flow rate** $\dot{m}_{2,\text{net}}$

portion of the supply mass airflow rate at station 2 that originated as supply mass flow rate at station 2, accounting for R_{UEATR}

Note 1 to entry: See [Formula \(9\)](#) and [Formula \(13\)](#)

3.22**power value of moving air** P_{vma}

rate of pressure energy and kinetic energy of the air delivered by the ventilator

Note 1 to entry: The formula that determines the power value of moving air is given in [9.6.1](#).

Note 2 to entry: Power value of moving air is expressed in W for P_{vma} (see [Formula \(10\)](#)).

3.23**rating points**

sets of supply and exhaust airflows, static pressures at inlets and outlets, and speed control setting, achieved during the airflow performance measurement, at which thermal performance tests (and exhaust air transfer tests, if applicable) are performed

3.24**rotary exchanger**

exchanger with porous discs, fabricated from materials with heat or heat and water vapour retention capacity, that are regenerated by collocated supply and exhaust airstreams

3.25**speed control device**

device incorporated into the ventilator which controls the speed of the fan

3.26**station**

location in the test apparatus at which conditions such as temperature, humidity, pressure, or airflows are measured

Note 1 to entry: $\langle A_1 \rangle$ Indicated in [Figure 1](#) as keys 1, 2, 3 and 4. $\langle A_1 \rangle$

3.27**standard air**

dry air with a density of $1,204 \text{ kg/m}^3$ and a dynamic viscosity of $1,824 7 \times 10^{-5} \text{ kg/(m}\cdot\text{s)}$

Note 1 to entry: These conditions approximate dry air at 20°C and $101,325 \text{ kPa}$ absolute.

3.28**static pressure differential**

static pressure at supply outlet less the static pressure at exhaust inlet

Note 1 to entry: a positive pressure differential occurs when the static pressure at *station* ([3.26](#)) 2 is higher than the static pressure at station 3. A negative pressure differential occurs when the static pressure at station 2 is lower than the static pressure at station 3.

3.29**thermal performance measurement**

test procedures which measure the temperature and humidity of the supply air when a ventilator is operating with the outside air and exhaust air at specific psychrometric conditions

3.30**unducted ventilator**

heat recovery ventilator or energy recovery ventilator which is not intended for connection of ducts to any of the airflow inlets or outlets except for model-specific exterior termination systems as defined in [3.18](#)

3.31**unit exhaust air transfer ratio****UEATR**
 R_{UEATR}

tracer gas concentration difference between the *leaving supply air* ([3.15](#)) and the *entering supply air* ([3.7](#)) divided by the tracer gas concentration difference between the *entering exhaust air* ([3.6](#)) and the *entering supply air* ([3.7](#)), at a specified airflow

Note 1 to entry: The formula for R_{UEATR} is given in [9.3](#).

3.32**ventilator**

self-contained unit that includes fans to move air through the heat/energy exchanger

4 Symbols and abbreviated terms**4.1 Symbols**

Symbol	Definition	Units
C_1	Tracer gas concentration at station 1	$\mu\text{mol/mol}$
C_2	Tracer gas concentration at station 2	$\mu\text{mol/mol}$
C_3	Tracer gas concentration at station 3	$\mu\text{mol/mol}$
C_{in}	Tracer gas concentration (indoor type)	$\mu\text{mol/mol}$
C_{out}	Tracer gas concentration (rooftop type)	$\mu\text{mol/mol}$
C_{back}	Tracer gas concentration (thru-wall type)	$\mu\text{mol/mol}$
$C_{\text{chamber},i,0}$	Tracer gas concentration in the test chamber at time zero under attempt i^{th}	$\mu\text{mol/mol}$
$C_{\text{chamber},i,t,j}$	Tracer gas concentration in the test chamber at attempt i^{th} under time t of j^{th}	$\mu\text{mol/mol}$
C_{COE}	Coefficient of energy (COE)	-
c_{p1}	Specific heat of dry air at station 1	$\text{kJ}/(\text{kg}\cdot\text{K})$
c_{p2}	Specific heat of dry air at station 2	$\text{kJ}/(\text{kg}\cdot\text{K})$
h_1	Enthalpy of the air at station 1	kJ/kg of dry air
h_2	Enthalpy of the air at station 2	kJ/kg of dry air
h_3	Enthalpy of the air at station 3	kJ/kg of dry air
$\dot{m}_2$	Mass flow rate of dry air at station 2	kg/s
$\dot{m}_{2,\text{net}}$	Net mass flow rate of dry air at station 2	kg/s
P_{aux}	Power input to any other electrical components in the ventilator	W
P_{em}	Power input to all electric motors in the ventilator	W
P_{in}	Power input to ventilator	W
P_{vma}	Power value of moving air	J/s or W
p_{si}	Static pressures at station i ($i=1,2,3,4$)	Pa
p_{vi}	Velocity pressure at station i ($i=1,2,3,4$)	Pa
Q	Airflows	m^3/s

Symbol	Definition	Units
Q_1	Average of the three calculated overall airflow rates with the unit under test in operation as described in B.2.1.1 and B.2.1.2 ; or supply airflow	m ³ /s
Q_2	Average of the three calculated natural airflow rates of the test chamber with the ventilator removed as described in B.2.2.1 and B.2.2.2 ; or supply airflow	m ³ /s
$Q_{1,2}$	Average of the three points with each three times calculated overall airflow rates with the unit under test in operation as described in B.2.1.1 and B.2.1.2	m ³ /s
$Q_{i,j}$	Airflow rate calculated using the data from a test at attempt i th under time t of j th as described in B.2.1.1 , B.2.1.2 , B.2.2.1 and B.2.2.2	m ³ /s
$Q_{2,\text{net}}$	Net supply airflow	m ³ /s
R_{NSAR}	Net supply airflow ratio (NSAR)	%
R_{UEATR}	Unit exhaust air transfer ratio (UEATR)	%
T_1	Temperature of the entering supply air at station 1 (dry bulb)	°C or K
T_2	Temperature of the leaving supply air at station 2 (dry bulb)	°C or K
T_3	Temperature of the entering exhaust air at station 3 (dry bulb)	°C or K
T_a	Ambient temperature	°C or K
T_{LAB}	Temperature lab ambient	°C or K
$T_{\text{LAB,AVE}}$	Temperature lab ambient, average	°C or K
$T_{\text{LAB,MAX}}$	Temperature lab ambient, maximum	°C or K
$T_{\text{WB},i}$	Ambient temperature at station i (wet bulb) ($i=1,2,3$)	°C or K
t	Elapsed time since the start of test unit operation	s
V_c	Air volume in the test chamber	m ³
v_2	Air velocity at PL.2 (See Figure G.1)	m/s
W_{EW}	Effective work	W
x	Dry bulb temperature (for sensible effectiveness); or absolute humidity ratio (for latent effectiveness); or total enthalpy (for total effectiveness).	°C kg water/kg dry air kJ/kg
v_s	Specific volume of the supply air (See Formula (10))	m ³ /kg
ε	Effectiveness	1
$\Delta p_{s,\text{ext}}$	External static pressure difference	Pa

4.2 Subscripts

Subscript		
a	ambient	
AVE	average	
BAR	barometric pressure	
chamber	test chamber	
I	in chamber	
i	i^{th} attempt of test	
j	j^{th} of test time	
o	in outdoor air	
LAB	lab ambient	
WB	wet bulb	