BS ISO 18195:2019
Incorporating corrigendum August 2019

BSI Standards Publication

Method for the justification of fire partitioning in water cooled nuclear power plants (NPP)

Documents
Document Sharing Hub

Full document details: BS ISO 18195:2019

National foreword

This British Standard is the UK implementation of ISO 18195:2019.

The UK participation in its preparation was entrusted to Technical Committee E/-, Engineering Sector Policy & Strategy Committee.

A list of organizations represented on this committee can be obtained on request to its secretary.

This publication does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

© The British Standards Institution 2019
Published by BSI Standards Limited 2019

ISBN 978 0 539 06138 3

ICS 27.120.20

Compliance with a British Standard cannot confer immunity from legal obligations.

This British Standard was published under the authority of the Standards Policy and Strategy Committee on 28 February 2019.

Amendments/corrigenda issued since publication

Date	Text affected
31 August 2019	Implementation of ISO corrected text 28 March 2019: Formatting corrections in subclause 5.4.5.4, Figure 13 corrected

Documents
Document Sharing Hub

Full document details: BS ISO 18195:2019

INTERNATIONAL STANDARD

ISO 18195

First edition
2019-02

Corrected version
2019-03

Method for the justification of fire partitioning in water cooled nuclear power plants (NPP)

Méthode de justification de l'efficacité de la sectorisation incendie des centrales nucléaires utilisant l'eau comme fluide caloporteur

Reference number
ISO 18195:2019(E)

Documents
Document Sharing Hub

© ISO 2019

Full document details: BS ISO 18195:2019

COPYRIGHT PROTECTED DOCUMENT

© ISO 2019

All rights reserved. Unless otherwise specified, or required in the context of its implementation, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
CP 401 • Ch. de Blandonnet 8
CH-1214 Vernier, Geneva
Phone: +41 22 749 01 11
Fax: +41 22 749 09 47
Email: copyright@iso.org
Website: www.iso.org

Published in Switzerland

© ISO 2019 – All rights reserved

Documents
Document Sharing Hub

Full document details: BS ISO 18195:2019

Contents

Page

Foreword ... **v**

Introduction ... **vi**

1 Scope ... **1**

2 Normative references ... **1**

3 Terms, definitions, symbols and abbreviated terms ... **1**
3.1 Terms and definitions ... 2
3.2 Symbols ... 4
3.3 Abbreviated terms ... 5

4 Method for justification of nuclear safety fire partitioning: global approach ... **5**
4.1 Objective of the method ... 5
4.1.1 The basis of design: standard fire resistance tests ... 5
4.1.2 Aim, limitations, and precautions ... 6
4.1.3 Minimum requirements concerning the qualification of the method practitioners ... 8
4.2 General principle of the method ... 8
4.3 Design of the partitioning: justification of the adequate performance of fire barriers ... 10
4.4 Fire barriers and structural elements ... 10
4.5 Overall flowchart (flowchart 1) ... 11

5 Determination of the design basis fire temperature curve (room fire curve) ... **12**
5.1 General considerations in room fire scenarios ... 12
5.1.1 Typical development stages of a compartment fire ... 12
5.2 Defining the design basis fire temperature curve for a room ... 13
5.3 Requirements concerning calculation tools ... 14
5.4 Assumptions and input data for numerical calculations ... 15
5.4.1 Fixed automatic fire fighting system (credited or not) ... 15
5.4.2 Modeling assumptions ... 16
5.4.3 Characteristics of a room ... 16
5.4.4 Nature of fuels ... 17
5.4.5 Fire scenarios ... 18
5.4.6 Recommended value for pyrolysis rates ... 23
5.5 Design basis fire temperature curve calculation process ... 23
5.5.1 Data input ... 23
5.5.2 Modelling of the fire volume and scenarios ... 23
5.5.3 Modelling options ... 23
5.6 Determination of the fire temperature curve ... 24

6 Determination of the performance of fire barriers (performance curve diagram) ... **26**
6.1 Principles ... 26
6.2 Characterization of the performance diagram: global methodology ... 26
6.3 Phase 1: analysis of the standard test ... 27
6.4 Phase 2 branch A: determination by calculation ... 28
6.4.1 Study approach ... 28
6.4.2 Selection of representative experimental curves ... 29
6.4.3 Calculation tools and choice of the modelling ... 29
6.4.4 Thermal properties of materials ... 30
6.4.5 Plotting performance curves from the reference curves ... 32
6.4.6 Plotting “steady state” curves ... 34
6.4.7 Plotting the performance diagram ... 34
6.5 Phase 2 BRANCH B: working out a new family system ... 34
6.5.1 Study approach for branch B ... 35
6.5.2 Experimental check (step 5B) ... 35
6.6 Phase 2 branch C: specific characterization tests ... 36
6.7 Alternative performance curves ... 37

© ISO 2019 – All rights reserved

AVA Documents
Document Sharing Hub

Full document details: BS ISO 18195:2019

6.8 Performance curve diagram ... 37
6.9 Validation of the models ... 37

7 Uncertainty and sensitivity ... 37
7.1 Use of average values (zone model vs. CFD model) ... 38
7.2 Uncertainties and sensitivities in fire temperature curve calculation ... 38
7.3 Uncertainties and sensitivities in the performance curve process ... 38

Annex A (informative) **Spreading criterion PFG/PFL (examples) ... 40**

Annex B (informative) **Value examples for fire scenarios ... 42**

Annex C (informative) **Loss of classification criteria : examples ... 51**

Annex D (informative) **Example of performance diagram of a cable fire-wrap ... 52**

Bibliography ... 65

© ISO 2019 – All rights reserved
Documents
Document Sharing Hub
Full document details: BS ISO 18195:2019

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular the different approval criteria needed for the different types of ISO documents should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see www.iso.org/directives).

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights. Details of any patent rights identified during the development of the document will be in the Introduction and/or on the ISO list of patent declarations received (see www.iso.org/patents).

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation on the voluntary nature of standards, the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the World Trade Organization (WTO) principles in the Technical Barriers to Trade (TBT) see the following URL: www.iso.org/iso/foreword.html.

This document was prepared by Technical Committee ISO/TC 85, *Nuclear energy, nuclear technologies, and radiological protection*, Subcommittee SC 6, *Reactor Technology*.

Any feedback or questions on this document should be directed to the user's national standards body. A complete listing of these bodies can be found at www.iso.org/members.html.

This corrected version of ISO 18195:2019 incorporates the following corrections:

— In 5.4.5.4, a few formatting corrections were made;

— In 6.4.7, Figure 13 has been corrected and the key modified accordingly.

© ISO 2019 – All rights reserved

Documents
Document Sharing Hub
Full document details: BS ISO 18195:2019

Introduction

This document is intended to provide a technical specification to verify the adequacy of the performance of fire partitions in nuclear power plants. The intended audience of this document are fire safety engineers and project designers. Nuclear authorities are also concerned considering that this method is to be used in the process of fire hazard nuclear safety demonstration. The method presented herein includes a combination of standardized testing and ad hoc testing with numerical and empirical calculations. Users of this document are expected to be appropriately qualified and competent in the fields of fire safety engineering, risk assessment and fire resistance standardization.

This document specifies a new methodology to Nuclear Power Plant (NPP) designers, fire safety professionals and nuclear safety authorities. This methodology aims to verify the adequacy of the performance of fire barriers in nuclear power plants in order to avoid fire propagation. This method is a potential tool for risk-informed, performance-based assessment.

NOTE This method is based on the EPRESSI method developed by EDF in collaboration with Efectis France fire safety laboratory in France for EPR reactors[39].

© ISO 2019 – All rights reserved
Documents
Document Sharing Hub
Full document details: BS ISO 18195:2019

Method for the justification of fire partitioning in water cooled nuclear power plants (NPP)

1 Scope

The document provides:

— guidelines for determining the thermal effects to consider on fire barriers inside a given room;

— guidelines for determining the global performance of the fire barriers based on standard test characterization;

— guidelines for assessing the need for additional tests to verify the robustness of the solution.

Requirements of applicable standards, numerical tools validation and verification (V&V), and the expected qualification of fire resistance laboratories are detailed.

The limitations of the method's applicability and scope are discussed.

The purpose and justification of this document is to describe a new methodology for the verification of the efficiency of fire barriers, which is initially based on a standardized fire resistance test.

The significance of this work relates to the fact that the present methodology will enhance the level of safety by providing more realism to hazards analysis in combination with standardized test data. It completes the standard ISO-fire rating required for justifying the performance.

The most relevant benefit of this method concerns the determination of the global performance of a barrier in a fire of extended duration compared to the classification given by the ISO-fire rating.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 12749-2, *Nuclear energy, nuclear technologies, and radiological protection — Vocabulary — Part 2: Radiological protection*

ISO 12749-3, *Nuclear energy, nuclear technologies, and radiological protection — Vocabulary — Part 3: Nuclear fuel cycle*

ISO 12749-4, *Nuclear energy, nuclear technologies, and radiological protection — Vocabulary — Part 4: Dosimetry for radiation processing*

ISO 12749-5, *Nuclear energy, nuclear technologies, and radiological protection — Vocabulary — Part 5: Nuclear reactors*

ISO 13943, *Fire safety — Vocabulary*

ISO/IEC 17025, *General requirements for the competence of testing and calibration laboratories*

3 Terms, definitions, symbols and abbreviated terms

For the purposes of this document, the terms and definitions given in ISO 13943, ISO 12749-2, ISO 12749-3, ISO 12749-4, and ISO 12749-5 and the following apply.

© ISO 2019 – All rights reserved

Documents
Document Sharing Hub
Full document details: BS ISO 18195:2019

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

— ISO Online browsing platform: available at https://www.iso.org/obp

— IEC Electropedia: available at http://www.electropedia.org/

3.1 Terms and definitions

3.1.1
credited combustible
part of the potential combustible material that will actually participate to the fire development

3.1.2
design basis fire
fire which may break out in any fire source of the plant and which has the severest consequences (duration, severity)

Note 1 to entry: For a given room, it is a fire taking into account all available fuel in this room liable to burn. Its characteristics are calculated taking into account the characteristics of the rooms and fuels.

3.1.3
fire volume
volume inside a building, composed or one or several rooms and designed to prevent the extension of a fire through its boundaries

Note 1 to entry: One of the means of preventing the extension of the fire is to keep it within a limited volume, either physically, by partitions opposing the fire propagation, either spatially, by boundaries associated with the remoteness of the components, with active protection systems (sprinklers), or with passive protection systems (structural features, cable wraps).

3.1.4
fire cell
fire volume (3.1.3) consisting of one or more rooms, bounded by separations guaranteeing that a fire occurring inside cannot extend to the outside or that one occurring on the outside cannot spread to the inside for a given period of time

Note 1 to entry: The boundaries of a fire cell may be either fire-resistant physical barriers, wall, ceiling and floor or *spatial separation* (3.1.15) through openings with a certain configuration and distance rules between combustible sources guaranteeing geographical separations with adjacent rooms and other fire areas. The non-propagation assumption has to be verified (by fire influence studies).

3.1.5
fire compartment
fire volume (3.1.3) consisting of one or more rooms, bounded by material *partitions* (3.1.10) whose fire resistance guarantees that a fire occurring inside cannot extend to the outside or that one occurring on the outside cannot spread to the inside for a given period of time

Note 1 to entry: All the partitions of a fire compartment shall be fire-resistant physical barriers, walls, ceilings, or floors.

3.1.6
fire resistance rating
time during which the fire *partitioning elements* (3.1.9) (partitions, walls, floors, doors, dampers, caulking of penetrations, enclosures of cable racks, etc.) can fulfil their assigned role, despite the effect of a standard fire

© ISO 2019 – All rights reserved
Documents
Document Sharing Hub
Full document details: BS ISO 18195:2019

3.1.7
low heat load threshold
LHLT
threshold which is introduced to avoid calculations in case of rooms that have too small quantity of combustible material and are neither PFL nor PFG

Note 1 to entry: See 5.4.5.3.

3.1.8
"neither PFG nor PFL" criterion
criterion that is met when the quantity of combustible material is not sufficient to generate a significant fire and does not present risks for spreading to secondary fire sources

Note 1 to entry: By extension, a room is said to be "neither PFG nor PFL" when the concentration of combustible masses in it is not enough to generate a widespread fire (with no necessity of further verification).

3.1.9
partitioning elements
features (partitions, fire walls, ceilings, floors, ducts, seals of openings such as doors, shutters, dampers, hatches as well as seals of cable bushings and piping sleeves) which make up a *partition* (3.1.10)

3.1.10
partition
set of *partitioning elements* (3.1.9) which fully bound the relevant area by *physical separation* (3.1.13)

3.1.11
possibility of a fire getting generalized
PFG criterion
criterion for a fire source when its burning is likely to result in flashover and a generalized fire

Note 1 to entry: By extension, a room is said to be PFG when a fire breaking out in an unfavourable part of the room may result in flashover and generalized fire in the whole room.

3.1.12
all possible fires remaining localized
PFL criterion
criterion for a fire source when its burning shall not result in flashover or propagate to other parts of the *room* (3.1.14)

Note 1 to entry: A fire meeting this criterion remains localised and goes out spontaneously. By extension, a room is said to be PFL when a fire breaking out at the most unfavourable part of the room cannot result in flashover nor propagate to other parts of the room; it remains localised and goes out spontaneously.

Note 2 to entry: The hypothesis of a fire source or room being PFL assumes a single fire source representation but the non-propagation to other fire sources inside or outside the room need a confirmation using a spread temperature threshold (STT).

3.1.13
physical separation
installation of two items of equipment in two distinct *rooms* (3.1.14) of which at least one is inside a *fire compartment* (3.1.5), or protection of one of them by an insulating thermal casing to prevent the simultaneous loss of both items of equipment due to a single fire

3.1.14
room
<common meaning> single volume identified by the user inside the building with no structural separation assumed inside

Note 1 to entry: Its boundaries may or may not be completely closed.

© ISO 2019 – All rights reserved

Documents
Document Sharing Hub
Full document details: BS ISO 18195:2019

3.1.15
spatial separation
installation of two items of equipment in different *rooms* (3.1.14) or at an adequate distance free of any fuel to prevent fire from spreading

3.1.16
spread temperature threshold
STT
threshold that is considered in the method to determine if there is a risk of spreading of a PFL fire source into a PFG fire source

Note 1 to entry: The STT applies to the hot gas layer (see 5.4.5.4).

3.1.17
standard time temperature curve
temperature-time curve used for the relevant fire resistance standard tests

Note 1 to entry: In the scope of document, this curve is defined according to ISO 834-1:1999, Figure 7. The curve follows the Formula $T = T_0 + 345 \log (8t + 1)$ with t the time (min) and T_0 the initial temperature.

3.2 Symbols

Symbol	Meaning	Unit
A	surface (structures)	m^2
Ao_i	surface of the vertical opening i of the room	m^2
AT	total surface of the walls of the room (excluding surface of openings)	m^2
β_1, β_2	pyrolysis rate coefficients	$kg \cdot s^{-1}$
α	growth factor (heat release rate)	$kJ \cdot s^{-3}$
D	equivalent diameter: $D = \sqrt{4S/\pi}$	m
Ho_i	maximum height of the vertical opening i of the room = distance between the top of the opening and the floor of the room	m
ΔH_C	heat of combustion of a fuel	$kJ \cdot kg^{-1}$
$K\beta$	product of the extinction coefficient of the flame K and a correction factor β	m^{-1}
L	length of the rack	m
M	mass of combustible cables	kg
$\dot{m}$	mass loss rate (= rate of pyrolysis)	$kg \cdot s^{-1}$
$\dot{m}_{max}$	maximum mass loss rate: $\dot{m}_{max} = \frac{\dot{Q}_{max}}{\Delta H_C}$	$kg \cdot s^{-1}$
n_{rack}	number of racks	
$\dot{Q}$	heat release rate	kW
$\dot{Q}_{max}$	maximum heat release rate of the fire source	kW
S	surface (liquid pool)	m
S_t	stoichiometric ratio of a fuel	g_{O2}/g_{fuel}
t	time	s
t_d	Time where the performance curve starts to decrease	s or h
T, θ	temperature	°C or K
T_0	initial ambient temperature	°C or K

© ISO 2019 – All rights reserved
Documents
Document Sharing Hub
Full document details: BS ISO 18195:2019

Symbol	Meaning	Unit
T_{cor}	correlated temperature gap estimated in the process of material behaviour modelling.	°C or K
$T_{num,i}$	calculated temperature at point "i" (i is an occurrence of experiment/calculation comparison : instant, location)	°C or K
$T_{exp,i}$	experimental temperature at point "i".	°C or K
T_{max}	Maximum temperature at time t_d for a performance curve	°C or K
ΔT_{local}	gap of temperature from initial temperature at a certain location (defined by the applied standard) during a fire resistance test	°C or K
$\Delta T_{average}$	gap of an average temperature (defined by the applied standard) from initial temperature during a fire resistance test	°C or K
$\theta_g(t)$	temperature condition at time t, following an increase law for material performance	°C
ε	emissivity: $\varepsilon_{material}$: emissivity of a material surface. $\varepsilon_{furnace}$: emissivity of a furnace surface	—
X_{O2}	oxygen ratio in the entering air	g_{O2}/g_{air}

3.3 Abbreviated terms

CFD	computational fluid dynamics
HRR	heat release rate
MLR	mass loss rate
MQH correlation	MacCaffrey - Quintiere - Harkleroad correlation
NPP	nuclear power plant
UL	underwriters laboratories

4 Method for justification of nuclear safety fire partitioning: global approach

4.1 Objective of the method

The present method is a tool made available for engineers to check whether the fire resistance performance of the fire partitioning elements in buildings is adequate to resist the design basis fire to which they could be exposed, independently of manual firefighting considerations.

As a prerequisite, prevention against the risks of fire in PWRs is based on the principle of separation of buildings into fire volumes, which are bounded by fire resistant walls. First, the fire protection design basis shall establish the minimum fire resistance rating of the fire partitioning elements.

NOTE Numerical values, empirical correlations or mathematical laws can be fixed by the document, recommended with possibility of change (rec.), or given as example (e.g.). If no indication is given, they are considered as fixed.

4.1.1 The basis of design: standard fire resistance tests

The fire resistance rating of fire partitioning elements is determined by a standard test, in accordance with the regulation and with the standardization.

For other products not covered by standard tests, such as fire resistant housings or enclosures, the fire resistance test may be carried out according to specific procedures. Regardless of the test method employed, the thermal stress applied to the product shall be that of the standard time/temperature curve.

© ISO 2019 – All rights reserved

Documents
Document Sharing Hub
Full document details: BS ISO 18195:2019

The fire resistance rating of a product is based on national, European or International standards or, when no standard applies, on plant designer specifications respecting the same performance criteria considered in similar standards.

— Thermal effects of the standard fire temperature curve.

— Measurement and qualitative systems for the performance criteria check.

— Temperatures: on elements, on exposed and unexposed surface or inside elements: ambient or surface.

— Electrical equipment functionality test system.

— Pilot flames or a layer of cotton for ignition verification.

— Fixed gauge tubes to check openings through the partitioning elements.

Furthermore, these tests require the use of standardized equipment and a description of its support and assembly. Extensions to the performance checks of different products are made on the basis of these references. Each of these criteria and measurements shall be taken into consideration during the analysis of the product in order to build its performance curve (see Clause 6).

NOTE The fire resistance rating of fire partitioning elements is determined by a standard test, in accordance with the regulation and with the standardization. For instance the rating may be given from the decision of European Commission 2000/367/CE and 2003/629/CE. Depending of the country, alternative standards could be used when needed by the Authority Having Jurisdiction.

The performance can concern:

— R: load-bearing capacity;

— E: integrity;

— I: insulation

— C: self-closing;

— S: smoke leakage;

— W: radiation;

— DH: smoke screen.

The rated time is given in minutes. For example, REI 120 refers to a structure which guaranties load-bearing capacity, integrity and insulation for 120 min. These tests are carried out and approvals delivered by a laboratory approved by the national authorities.

4.1.2 Aim, limitations, and precautions

4.1.2.1 Aim

The method applies to fire barriers qualified with a fire resistance standard.

The present methodology can be adapted to any other standard fire temperature curves and testing conditions, such as those specified by ASTM, UL or any national standardized curve used for qualification.

From European or international standardization (ISO 834 or EN 1363) the fire resistance test is based on a standard time/temperature fire temperature curve with a fast temperature rise, representative of

© ISO 2019 – All rights reserved
Documents
Document Sharing Hub
Full document details: BS ISO 18195:2019

flashover conditions in organic solid fires. The temperature increase is represented by the logarithmic curve, following Formula (1):

$$T - T_0 = 345 \ \log(8t + 1) \tag{1}$$

where

t is the time in min;

T_0 is initial ambient temperature (see Figure 1).

The current methodology extends the performance assessment of a fire resistant product to a longer duration compared to that of the rating assessment. The methodology set up remains within the framework of the fire resistance test, namely a flashover or similar in terms of temperature and pressure distribution.

Unlike the current method of verification of robustness of fire partition elements, it will be the responsibility of the operator to demonstrate that fire resistance tests are representative of operational conditions.

4.1.2.2 Limitations

The aim of the method does not cover certain fire scenarios. For example:

— a fire with a very small heat release rate, in case where the fire barriers includes components likely not to react (e.g.: intumescing elements) or to be activated (e.g.: thermal fuse). Note that additional tests performed at low temperature (see Euroclass "s" classification) may be performed to solve this issue. Of course very small fires are less challenging from a fire hazard point of view and specific demonstration may be proposed for those cases.

— a fire combined with severe pressure conditions (shock wave, blast, etc.): different standards are necessary to evaluate component performance under these conditions.

4.1.2.3 Precautions

Precautions include the following:

— a very fast growth capable of generating thermal shocks greater than those given by the conventional curve (mainly represented by a temperature rise time in °C/min): it can be for example assumed that, based on the recorded sampling time during ISO-fire tests, the maximum temperature rise is limited to 329 °C /min. This should be compared to the maximum temperature increase over 1 minute during the real scenario. Same approach may be performed for any other conventional curves (ASTM, Hydrocarbon, etc.). Nevertheless, this aspect is controlled by the method through the fire temperature curve slope considerations (see 4.2).

— a confined fire excessively ventilated and isolated with a fire load composed on material with high combustion heat is capable to produce very high temperatures (greater than those obtained with the conventional curve during the period tested) : fire behaviour of the partition element in such situation should be assessed using the adapted conventional temperature – time curve. Nevertheless this aspect is controlled by the method through the fire temperature curve maxima considerations (see 4.2).

Additional hose stream tests are sometimes required and are performed at the end of the fire tests for verifying the performance of the products with high-pressure water jet on the exposed phase (for example ASTM E2226[40]). The current methodology is based only on the fire behaviour of the product during the fire test period without taking into account the hose stream tests, which is consistent with the fire resistance ISO standards.

© ISO 2019 – All rights reserved

Documents
Document Sharing Hub
Full document details: BS ISO 18195:2019

The performance criteria defined for the standard fire resistance rating are also used for assessing performance in the current method. Any adaptation shall be justified.

NOTE The methodology described below is not intended to determine whether a qualification criterion is relevant or not.

4.1.3 Minimum requirements concerning the qualification of the method practitioners

The following method shall be applied by qualified and well-informed practitioners.

The first part of the method (see Clause 5) is appropriate for fire safety engineers with an adequate knowledge of fire safety science and the applicable codes. The organisation shall apply the principles of ISO 9001.

A fire safety laboratory is required for section on determining barrier performance (see Clause 6). As the method requires knowledge and experience not only in the application of standard fire tests, but also in more complex instrumentation processes and engineering models, the capability of the laboratory teams has to be confirmed.

The fire laboratory meet the requirements of ISO/IEC 17025 or an equivalent national alternative for the relevant fire tests.

4.2 General principle of the method

For one room, different design fire scenarios are defined. Each of them leads to one temperature-time curve. The design basis fire temperature curve of the room is a temperature/time curve equal or superior, in each plotted point, to any possible fire conditions concerning the room.

Fire resistance tests are carried out to assess the ability of a given fire barrier to resist the conventional fire (see Figure 1). They do not necessarily reflect its behaviour in a real fire where thermal stress may be, for instance, sharper but shorter or weaker but longer. The present methods consists of creating a set of time/temperature curves that represent the thermal stress a given fire barrier can successfully withstand. This set of curves constitutes the performance diagram of the given fire barrier.

© ISO 2019 – All rights reserved
Documents
Document Sharing Hub
Full document details: BS ISO 18195:2019

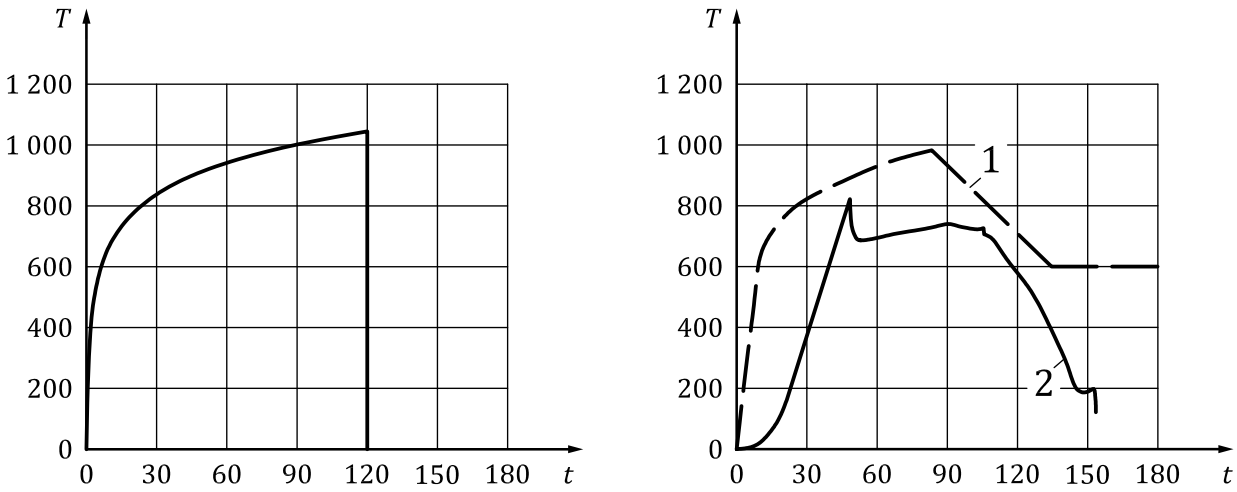

a) ISO 834 (2h rating) **b) Method application**

Key

t time in min

T temperature in °C

1 fire barrier performance curve

2 room fire curve

Figure 1 — ISO 834 versus method application

The method process consists of:

— setting up performance curves for each fire barrier (one or several curves constituting the fire performance diagram of the barrier);

— setting up the design basis fire temperature curve for each room;

— comparing the design basis fire temperature curve of a given room with the performance curves of the fire barriers in the room;

A fire barrier will be qualified for a given room only if all the following criteria are met by at least one performance curve belonging to the fire performance diagram:

— the maximum slope of the fire temperature curve is less than the maximum thermal gradient of the performance curve;

— the area delimited by the fire temperature curve is smaller than the area delimited by the fire resistance performance curve. Qualitatively, this means the heat of the fire is less than the heat the element can withstand;

— the maximum temperature of the fire temperature curve is less than the maximum temperature of the fire resistance performance curve.

Considering that the design basis fire temperature curve starts with the growth stage of the fire, which presents the maximum slope, at least one fire resistance performance curve of the equipment shall encompass the fire temperature curve of the room to fulfil these criteria (see Figure 2). If not, the equipment will not be validated for the room and a different strategy will be necessary: choice of an element with better fire resistance properties, addition of other means of protection, elimination of combustible loads in the room, etc.

NOTE 1 When comparing the curves, one can translate the design basis fire temperature curve on the time axis in order to demonstrate that it is below a fire resistance performance curve (see Figure 2). In those cases, one shall be careful to fulfil condition 1.

© ISO 2019 – All rights reserved

Documents
Document Sharing Hub
Full document details: BS ISO 18195:2019

NOTE 2 The design basis fire temperature curve starts at the temperature of the room in steady state. When the design basis fire temperature curve starts at a higher temperature than an available performance curve, the design basis fire temperature curve will be translated to the right before comparison. As a precaution, the translation will be at least 3 times the minimum translation necessary to ensure the design fire temperature curve start is bounded by the performance curve.

NOTE 3 The role of automatic extinguishing systems in the present method is detailed in 5.4.1 and flowcharts 1 (see Figure 3) and 2 (see Figure 7).

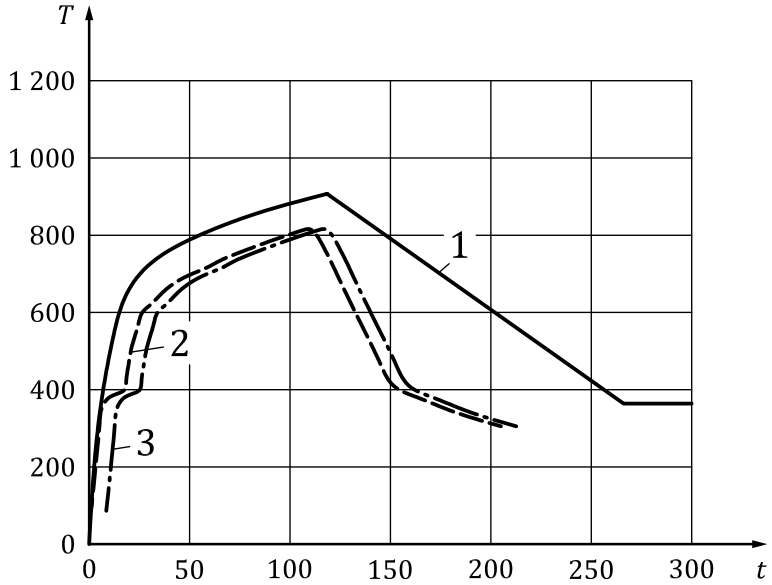

Key

t time in min

T temperature in °C

1 fire barrier performance curve (starting at 20 °C)

2 room fire curve (starting at 40 °C)

3 shifted room fire curve

Figure 2 — Performance curve versus fire temperature curve

4.3 Design of the partitioning: justification of the adequate performance of fire barriers

As previously said, the aim of the present method is to provide data to allow the verification of the adequate performance of the fire barriers, in order to design the fire partitioning of a NPP. Considering a separation between a room and another, the fire barriers will be correctly designed if a fire inside the one room does not affect or propagate to the second one. For each concerned fire barrier, this supposes that at least one performance curve from the performance curve diagram covers the design basis fire temperature curve of the room. In other cases a better performing fire barrier has to be found, or modifications adopted in the fire volume to reduce its design basis fire temperature curve profile.

4.4 Fire barriers and structural elements

The scope of the present method concerns the justification of partitions and partitioning elements as defined (see Clause 3). Nevertheless, structural element like walls, ceilings and floors may have their fire resistant rating obtained by calculation (e. g. Eurocodes 1 to 6[41][42][43][44][44][45][46][47] through ISO TS 24679) and not from tests. In those cases, the method described in Clause 6 can be prohibitively difficult to apply, due to the need for experimental tests. The scope of the method can be considered to exclude structural elements like concrete, whose performance may be verified by calculation, regardless of the time/temperature curve. Structural elements are generally over-rated regarding fire, especially concrete walls, floor, and ceilings in the nuclear island of NPP.

© ISO 2019 – All rights reserved
Documents
Document Sharing Hub
Full document details: BS ISO 18195:2019

4.5 Overall flowchart (flowchart 1)

An overall flowchart is given in Figure 3.

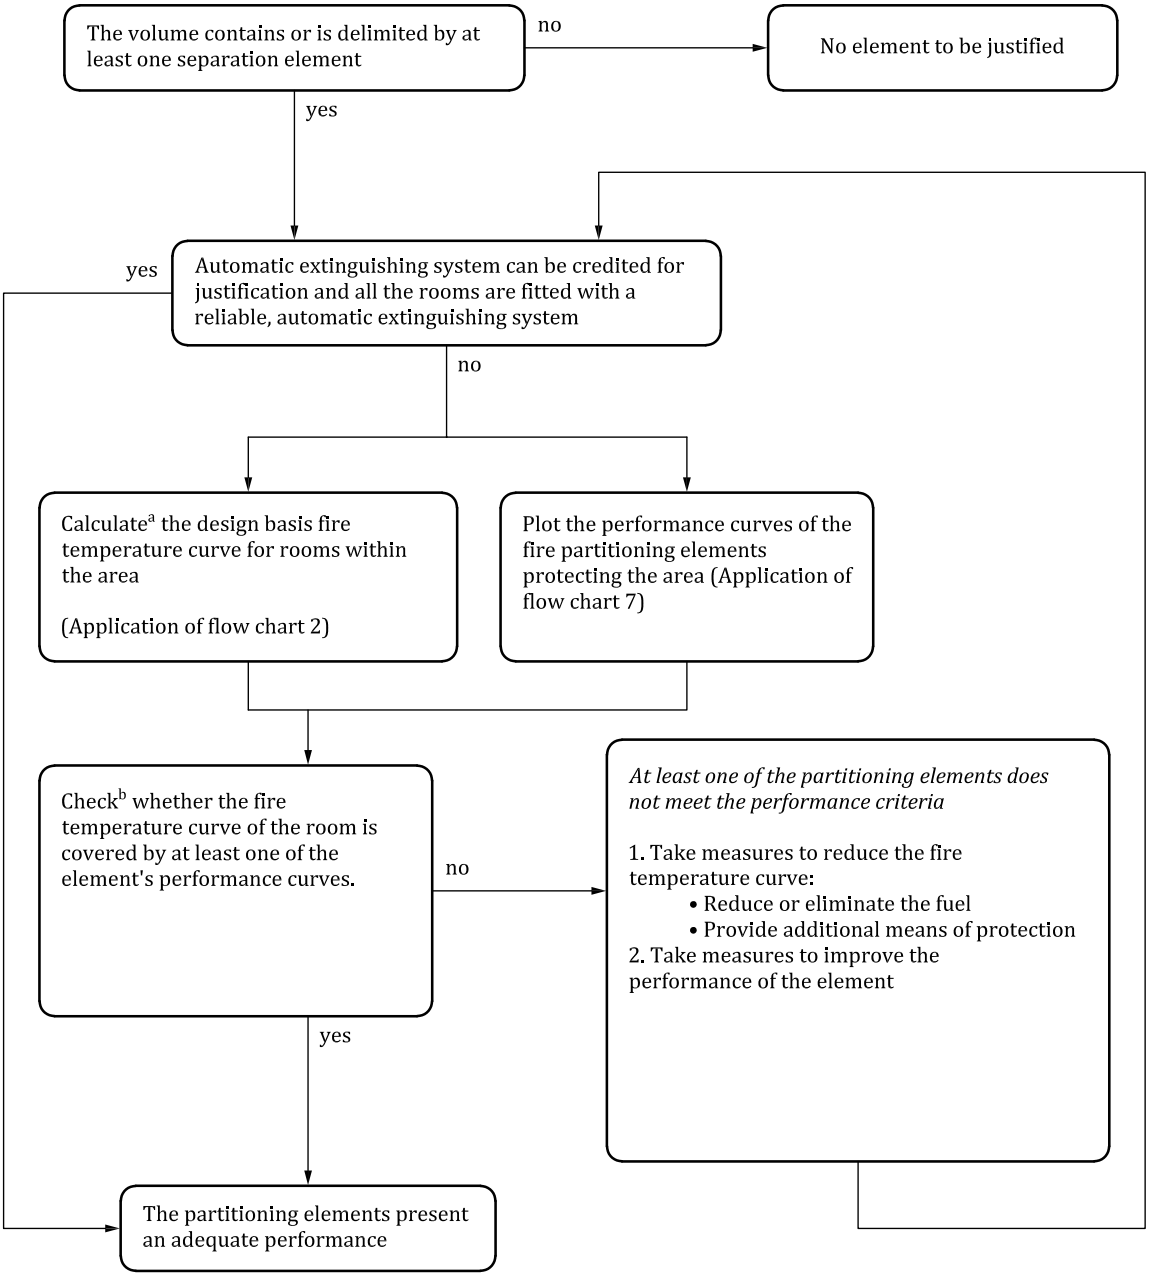

a For each room or for each room not fitted with a reliable, automatic extinguishing system when those systems can be used for the justification of partitioning (see 5.4.1).

b For each partitioning element in each room or for each room not fitted with a reliable, automatic extinguishing system, when those systems can be credited for the justification of partitioning (see 5.4.1).

Figure 3 — Flowchart 1

© ISO 2019 – All rights reserved

Documents
Document Sharing Hub
Full document details: BS ISO 18195:2019

5 Determination of the design basis fire temperature curve (room fire curve)

5.1 General considerations in room fire scenarios

The assessment of a fire scenario, from a design perspective, depends mainly on the characteristics of the room concerned and on the fire scenarios taken into account. The temperature profile of room fire can be assumed to follow the idealized curve similar to that shown in Figure 4.

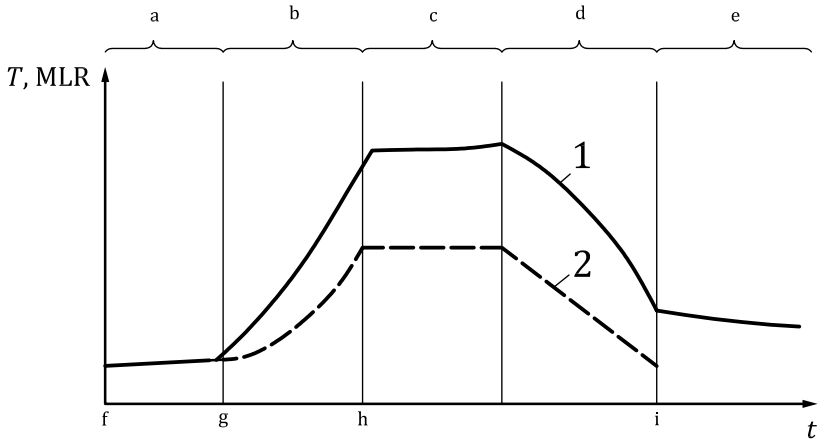

Key

t	time in min
T, MLR	temperature in °C or mass loss rate in kg/s
1	room temperature
2	mass loss rate (pyrolysis rate)
a	Stage 1 ignition
b	Stage 2 growth
c	Stage 3 fully developed (Fully developed fire is generally limited by ventilation rate (oxygen inlet))
d	Stage 4 decay
e	Smoldering, end.
f	Ignitiator.
g	Ignition.
h	Flashover.
i	Fuel exhausted.

Figure 4 — Typical stages of a room fire

5.1.1 Typical development stages of a compartment fire

5.1.1.1 Phase 1: ignition

Exposed to a heat source (initiator of the fire) the material will heat up, mainly by conduction from the exposed surface. Beyond a critical surface temperature, thermal degradation of the material will create a gas phase by pyrolysis. The mixture of combustible pyrolyzed gases with air leads to the formation of a flammable gas phase. The ignition may occur under the effect of an additional source (flame, incandescent particle) or directly by chemical oxidation reactions (spontaneous ignition).

© ISO 2019 – All rights reserved
Documents
Document Sharing Hub
Full document details: BS ISO 18195:2019

5.1.1.2 Phase 2: growth

The diffusion flame generated creates a thermal flux which contributes to its surface spread (start of the fire). The spreading rate of the flame depends on the chemical nature of the material, but is also greatly affected by physical and geometrical factors.

If the fire breaks out in a room, the temperature of this room rises gradually, even quite slowly in some cases, such as fire-resistant electric cables. At this step, the oxygen supply is sufficient to burn all the pyrolyzed gases. The fire is therefore said to be "fuel limited".

5.1.1.3 Phase 3: fully developed fire

The increase in ambient temperature induces a temperature rise and the pyrolysis of the various fuels present within the room, particularly those close to the ceiling. When a critical temperature is reached, flashover occurs, which consists of the simultaneous combustion of the majority of combustibles present.

In the event that flashover is not obtained, the fully developed fire would correspond to a stabilized rate of mass loss of the burning material (typical case for a pool fire, for instance)

At this stage, the fire may be limited by the oxygen supply to the room, in which case the fire is said to be "ventilation limited". This is frequently the case when flashover occurs.

5.1.1.4 Phase 4: decay

When most of the combustible material has been consumed (approximately 70 %[39]), the production of pyrolyzed gases becomes insufficient to maintain combustion, leading to the decay phase. This phase ends when all the credited combustibles have been consumed.

5.1.1.5 Phase 5: decay in the absence of combustion

The temperature of the room during this phase is only due to the thermal inertia of the walls and the room ventilation characteristics.

5.2 Defining the design basis fire temperature curve for a room

Inside any fire volume a fire scenario is calculated for each room. This calculation will give a fire temperature curve inside the room but also for the adjacent rooms (through openings). The overall design basis fire temperature curve assigned to a room is the curve that envelopes all of the different temperature curves obtained in the room, determined for each potential fire scenario in the fire volume. In this process, the possibility of spreading the fire from one room to another (i.e. ignition of the combustibles of the adjacent room) will be taken into account (see 5.4.5).

As an illustration, Figure 5 shows the temperature curves and design basis fire temperature curves in a volume posing four rooms in communication, coming from fire occurring in each room.

© ISO 2019 – All rights reserved

Documents
Document Sharing Hub
Full document details: BS ISO 18195:2019

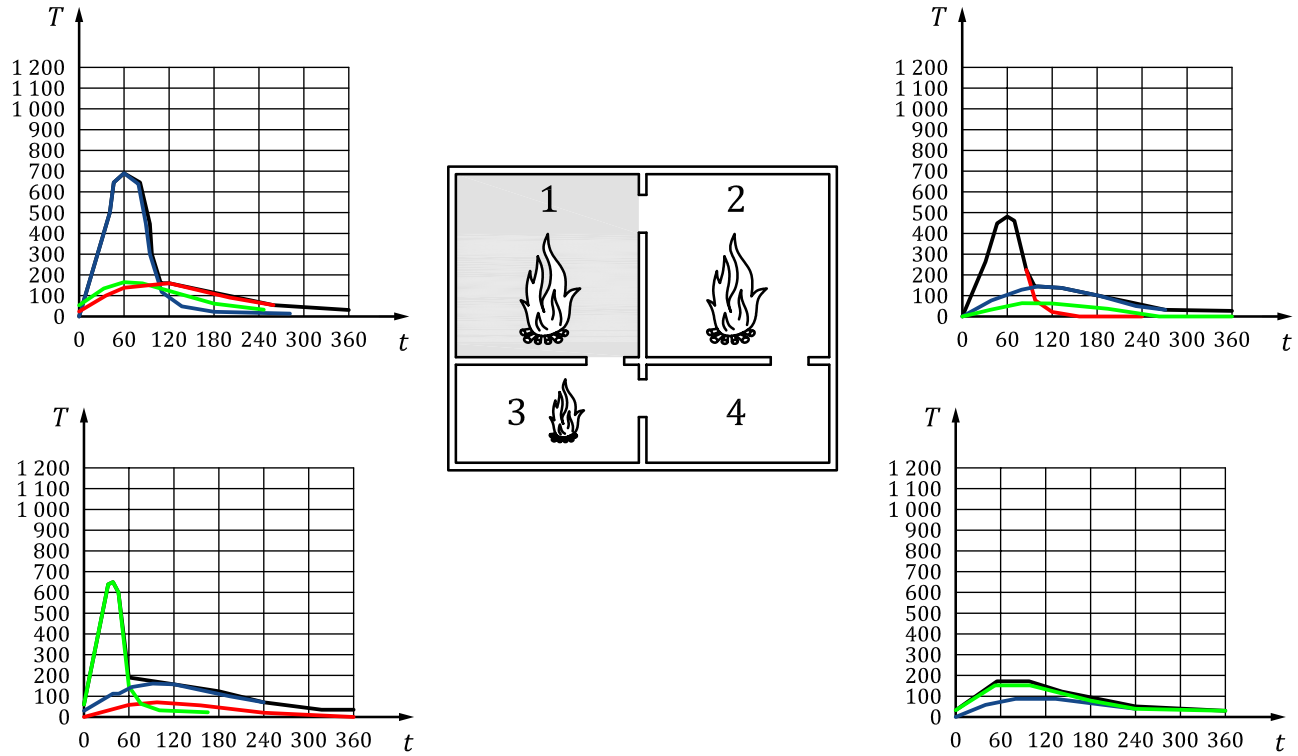

Key

t	time in min
T	temperature in °C
1	Room 1
2	Room 2
3	Room 3
4	Room 4 (no fire load)
———	Scenario 1 (fire in room 1)
———	Scenario 3 (fire in room 2)
———	Scenario 3 (fire in room 3)
———	Temperature curve of the room

Figure 5 — Design basis fire temperature curve construction

5.3 Requirements concerning calculation tools

The software used for simulating fire scenarios shall provide an adequate level of quality and qualification. Relevant standards for the validation and verification, such as ISO 16730-1, or other methods approved by the authority having jurisdiction, shall be taken into consideration. The validation domain of the software is a fundamental issue; comparison to full-scale tests representative of the various NPP is necessary. Software identified in an international V&V benchmark (e.g. References [48] or [74], [75] and [76]) is highly recommended.

Apart from the validation of the software, proficiency with its use is required. This means a precise description of the input parameters and no ambiguity on their correct use in a specific situation, in accordance with the way they were used during the validation process (see also 5.5.3). As the present method is part of a nuclear safety demonstration, the nuclear authority will generally have to approve the choice of software and its correct use by the designer. The use of relevant guidelines like References [77] and [78] is highly recommended.

© ISO 2019 – All rights reserved
Documents
Document Sharing Hub
Full document details: BS ISO 18195:2019

Three main categories of fire models are commonly encountered.

— Empirical correlation models: this category of models is based on pre-calculated curves or formulas (e.g. DSN 144[50], Compburn III[51], CDI[52], FDTs[53], FIVE-rev1 ([48]– vol 4), etc.). This category is characterised by quick and easy use, but poor flexibility and strong conservatism due to the need to cover a wide variety of situations.

— Zone models: These computer programs have been developed since the eighties (MAGIC[54][55][56], CFAST[57], COCOSYS[58], SYLVIA[58][59], etc.). They are generally based on a simplified one-dimensional calculation of the fluid behaviour, considering a homogeneous layer of smoke filled by the fire plumes and floating above a layer of fresher air. Gas circulation between rooms, heat exchange in the walls and target or ventilation systems, can then represented. This kind of fire model is more integrated than simplified fire models and gives a better estimate of the thermal conditions during the fire. They provide a mix between integrated fluid mechanics laws and experimental correlation which gives them a good global response, close to realistic conditions. They are limited in their ability to assess complex room geometry or thermal gradients.

— Computational Fluid Dynamics (CFD) fire models: This is the last generation of software used for fire prediction. Many of these computer programs appeared in the last fifteen years and remain the state of the art (FDS[61], JASMINE[62], OPEN FOAM[63], Code Saturne©[64], ISIS[65], etc.). There is a large discrepancy in the scope covered by each program, due to the fact that different approaches are employed for each. They are more dependent on the modelling choices made at the small scale for medium scale predictions and for that reason; some of them integrate real scale correlation correction factors (FDS). They provide more information on the local conditions but their qualification is more complex and their results are often considered more qualitative than quantitative. Of course, calculations are more onerous and take more time than zone or simplified fire models.

The present method has been developed for zone models, considering the fact that average values are necessary, and the number of simulations to perform may be significant. CFD code may also be used, but post-processing will be necessary to obtain applicable average values (see 7.1). In this process, principles given in Reference [61] (16.9.3 Layer Height and the Average Upper and Lower Layer Temperatures) are recommended. Algebraic model are not taken into account due to the fact that they would generally give overly conservative results and hardly deal with multi-room configurations.

Fire modelling is still an area of active research due to the inherent difficulties of the topic:

— Interaction between fluid mechanics, combustion including species and soot production, heat exchanges, pressure effects, etc.;

— Complex boundary conditions: structural components, ventilation, protection systems, extinction, etc.;

— Multiplicity of influent parameters, complexity of the configurations, complexity of fuel behaviours;

— Large scale and dynamic simulation, multiplicity of possible scenarios.

One of the main issues of a fire simulation is the hypothesis made on the mass loss rate of the combustible. In most cases, models cannot predict this quantity with sufficient accuracy, so fixed experimental full-scale data shall be used.

5.4 Assumptions and input data for numerical calculations

5.4.1 Fixed automatic fire fighting system (credited or not)

Fixed automatic fire fighting system may or may not be used to justify the partitioning efficiency. This depends on the authority having jurisdiction, and various standards (e.g. References [66], [67] and [68]) have different requirements on that issue. For that reason, the present methodology deals with both possibilities.

© ISO 2019 – All rights reserved

Documents
Document Sharing Hub
Full document details: BS ISO 18195:2019

In cases where the activation of a reliable automatic extinguishing system is assumed, the fire partitioning elements of the room will be considered sufficient (no calculation required). In those cases, the extinguishment system will be identified as important for nuclear safety (reinforced reliability, maintenance and quality policy). Consideration will be taken of the maximum delay of starting of the system to determine the minimal resistance rating of the fire barriers.

5.4.2 Modeling assumptions

Modelling assumptions concern hypotheses or approximations regarding the physical phenomena inherent to the model. They strongly depend on the nature of the fire model and its validation file.

Modelling assumptions shall be in accordance with those chosen during the validation process in similar situations, and shall guarantee a conservative prediction for the relevant parameters. If specific values are necessary for specific configurations, they shall have been clearly identified in the software documentation and the validation process and shall be clearly documented in the engineer's report.

For zone models, all of the oxygen in the fire volume can be assumed to contribute to combustion. Even if this value is upper bound since it is accepted that from a concentration of oxygen in the air of less than 10 %, the fire source loses its power and tend to go out, this assumption covers the risk of fire located closed to an opening or ventilation generally not taken into account by zone models.

Regardless of the specific model, it shall correctly represent the oxygen depletion and take it into account in the heat release rate calculation (see 5.4.5).

In general, combustion efficiency is assumed to be 100 % for zone models and CFD models with the exception of specific cases which have been validated for this parameter.

5.4.3 Characteristics of a room

5.4.3.1 Room shape:

A room is characterised by the following:

— its internal dimensions;

— the thermal properties of the walls and their thicknesses;

— the dimensions of the openings communicating with adjacent rooms.

For simplified or zone models, the room can be represented by a rectangular volume with three dimensions:

a) Length (m);

b) Width (depth) (m);

c) Height (m).

For non-rectangular rooms, the dimensions (length and width) should be as close as possible to dimensions defined in the civil engineering drawings whilst conserving the floor area of the room.

For fire model less limited in geometry (e.g. CFD), it will be preferable to take into account the real shape of the room.

When the room concerned communicates with another with no separation wall these two rooms should be combined to form an equivalent room.

© ISO 2019 – All rights reserved
Documents
Document Sharing Hub
Full document details: BS ISO 18195:2019