BS ISO 22762-3:2024

BSI Standards Publication

Elastomeric seismic-protection isolators

Part 3: Applications for buildings — Specifications

Documents
Document Sharing Hub

Full document details: BS ISO 22762-3:2024

National foreword

This British Standard is the UK implementation of ISO 22762-3:2024. It supersedes BS ISO 22762-3:2018, which is withdrawn.

The UK participation in its preparation was entrusted to Technical Committee PRI/73, Industrial rubber products.

A list of organizations represented on this committee can be obtained on request to its committee manager.

Contractual and legal considerations

This publication has been prepared in good faith, however no representation, warranty, assurance or undertaking (express or implied) is or will be made, and no responsibility or liability is or will be accepted by BSI in relation to the adequacy, accuracy, completeness or reasonableness of this publication. All and any such responsibility and liability is expressly disclaimed to the full extent permitted by the law.

This publication is provided as is, and is to be used at the recipient's own risk.

The recipient is advised to consider seeking professional guidance with respect to its use of this publication.

This publication is not intended to constitute a contract. Users are responsible for its correct application.

© The British Standards Institution 2024
Published by BSI Standards Limited 2024

ISBN 978 0 539 31424 3

ICS 83.140.99; 83.140.99; 91.120.25; 91.120.25

Compliance with a British Standard cannot confer immunity from legal obligations.

This British Standard was published under the authority of the Standards Policy and Strategy Committee on 30 September 2024.

Amendments/corrigenda issued since publication

Date	Text affected

Documents
Document Sharing Hub

Full document details: BS ISO 22762-3:2024

International Standard

ISO 22762-3

Fourth edition
2024-09

Elastomeric seismic-protection isolators —

Part 3: Applications for buildings — Specifications

Appareils d'appuis structuraux en élastomère pour protection sismique —

Partie 3: Applications pour bâtiments — Spécifications

Reference number
ISO 22762-3:2024(en)

© ISO 2024

Documents
Document Sharing Hub

Full document details: BS ISO 22762-3:2024

COPYRIGHT PROTECTED DOCUMENT

© ISO 2024

All rights reserved. Unless otherwise specified, or required in the context of its implementation, no part of this publication may be reproduced or utilized otherwise in any form or by any means, electronic or mechanical, including photocopying, or posting on the internet or an intranet, without prior written permission. Permission can be requested from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
CP 401 • Ch. de Blandonnet 8
CH-1214 Vernier, Geneva
Phone: +41 22 749 01 11
Email: copyright@iso.org
Website: www.iso.org

Published in Switzerland

Documents
Document Sharing Hub
Full document details: BS ISO 22762-3:2024

Contents

Page

Foreword ... **v**
Introduction ... **vi**
1 Scope ... **1**
2 Normative references ... **1**
3 Terms and definitions ... **1**
4 Symbols ... **3**
5 Classification ... **6**
5.1 General ... 6
5.2 Classification by construction ... 7
5.3 Classification by tolerance on shear properties ... 8
6 Requirement ... **8**
6.1 General ... 8
6.2 Type tests and routine tests ... 9
6.3 Functional requirements ... 10
6.4 Design compressive force and design shear displacement ... 10
6.5 Performance requirements ... 10
6.5.1 General ... 10
6.5.2 Compressive properties ... 11
6.5.3 Shear properties ... 12
6.5.4 Tensile properties ... 12
6.5.5 Dependences of shear properties ... 13
6.5.6 Dependences of compressive properties ... 14
6.5.7 Shear displacement capacity ... 15
6.5.8 Durability ... 15
6.6 Rubber material requirements ... 16
6.6.1 General ... 16
6.6.2 Tensile properties ... 16
6.6.3 Properties after ageing in air ... 16
6.6.4 Hardness ... 17
6.6.5 Ozone resistance ... 17
6.6.6 Other properties ... 17
6.7 Dimensional requirements ... 17
6.8 Requirements on steel used for flanges and reinforcing plates ... 18
6.9 Requirement on lead material for LRB ... 19
7 Design rules ... **19**
7.1 General ... 19
7.2 Shape factor ... 19
7.2.1 First shape factor ... 19
7.2.2 Second shape factor ... 20
7.3 Compression and shear properties ... 20
7.3.1 Compressive stiffness ... 20
7.3.2 Shear stiffness and equivalent damping ratio ... 20
7.4 Ultimate properties ... 21
7.4.1 Stability at zero displacement ... 21
7.4.2 Stability and failure under large shear displacements ... 22
7.4.3 Roll-out properties of elastomeric isolators with recessed or dowelled connections (Type III) ... 22
7.4.4 Tensile properties ... 23
7.5 Reinforcing steel plates ... 24
7.6 Connections ... 24
8 Manufacturing tolerances ... **24**
8.1 General ... 24

© ISO 2024 – All rights reserved

Documents
Document Sharing Hub
Full document details: BS ISO 22762-3:2024

8.2 Measuring instruments ... 25
8.3 Plan dimensions ... 25
8.3.1 Measurement method ... 25
8.3.2 Tolerances ... 25
8.4 Product height ... 26
8.4.1 Measurement method ... 26
8.4.2 Tolerances ... 27
8.5 Flatness ... 27
8.5.1 Measurement method ... 27
8.5.2 Tolerances ... 27
8.6 Horizontal offset ... 27
8.7 Plan dimensions of flanges ... 28
8.8 Flange thickness ... 28
8.9 Tolerances on positions of flange bolt holes ... 29

9 Marking and labelling ... 29
9.1 General ... 29
9.2 Information to be provided ... 29
9.3 Additional requirements ... 30
9.4 Marking and labelling examples ... 30

10 Test methods ... 30

11 Quality assurance ... 30

Annex A (normative) **Tensile stress in reinforcing steel plate ... 31**

Annex B (normative) **Determination of ultimate property diagram based on experimental results ... 33**

Annex C (informative) **Minimum recommended physical properties of rubber material ... 36**

Annex D (informative) **Effect of inner-hole diameter and second shape factor on shear properties ... 37**

Annex E (informative) **Determination of compressive properties of elastomeric isolators ... 40**

Annex F (informative) **Determination of shear properties of elastomeric isolators ... 43**

Annex G (informative) **Method of predicting buckling limit at large deformations ... 48**

Annex H (informative) **Design of fixing bolts and flanges ... 55**

Bibliography ... 58

© ISO 2024 – All rights reserved

Documents
Document Sharing Hub
Full document details: BS ISO 22762-3:2024

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular, the different approval criteria needed for the different types of ISO document should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see www.iso.org/directives).

ISO draws attention to the possibility that the implementation of this document may involve the use of (a) patent(s). ISO takes no position concerning the evidence, validity or applicability of any claimed patent rights in respect thereof. As of the date of publication of this document, ISO had not received notice of (a) patent(s) which may be required to implement this document. However, implementers are cautioned that this may not represent the latest information, which may be obtained from the patent database available at www.iso.org/patents. ISO shall not be held responsible for identifying any or all such patent rights.

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation of the voluntary nature of standards, the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the World Trade Organization (WTO) principles in the Technical Barriers to Trade (TBT), see www.iso.org/iso/foreword.html.

This document was prepared by Technical Committee ISO/TC 45, *Rubber and rubber products*, Subcommittee SC 4, *Products (other than hoses)*.

This fourth edition cancels and replaces the third edition (ISO 22762-3:2018), of which it constitutes a minor revision.

The changes are as follows:

— the relation of this document to ISO 22762-5 and ISO 22762-6 have been added in Introduction;

— the use of the terms "elastomeric isolators" and "seismic isolators have been made consistent throughout the document;

— the term "fracture" has been replaced by "break" throughout the document.

— the definition of some symbols in Table 1 have been changed to make use of terms consistent;

— the information in the Table 5 has been changed to be kept consistent with Table 4;

— reference to Annex B has been added in 7.1;

— information in B.1 has been changed to be kept consistent with Table 4;

— the information in Table D.1 has been updated;

— the information in E.1 has been updated;

— the reference in Bibliography has been updated.

A list of all parts in the ISO 22762 series can be found on the ISO website.

Any feedback or questions on this document should be directed to the user's national standards body. A complete listing of these bodies can be found at www.iso.org/members.html.

© ISO 2024 – All rights reserved

Documents
Document Sharing Hub
Full document details: BS ISO 22762-3:2024

Introduction

The ISO 22762 series includes two parts related to specifications for elastomeric isolators, i.e. ISO 22762-2 for bridges and ISO 22762-3 for buildings. This is because the elastomeric isolator requirements for bridges and buildings are quite different, although the basic concept of the two products is similar. Therefore, ISO 22762-2 and the relevant clauses in ISO 22762-1 are used when ISO 22762 (all parts) is applied to the design of bridge isolators whereas ISO 22762-3 and the relevant clauses of ISO 22762-1 are used when it is applied to building isolators.

The main differences to be noted between elastomeric isolators for bridges and elastomeric isolators for buildings are the following.

a) Elastomeric isolators for bridges are mainly square in shape and those for buildings are circular in shape.

b) Elastomeric isolators for bridges are designed to be used for both rotation and horizontal displacement, while elastomeric isolators for buildings are designed for horizontal displacement only.

c) Elastomeric isolators for bridges are designed to perform on a daily basis to accommodate length changes of bridges caused by temperature changes as well as during earthquakes, while elastomeric isolators for buildings are designed to perform only during earthquakes.

d) Elastomeric isolators for bridges are designed to withstand dynamic loads caused by vehicles on a daily basis as well as earthquakes, while elastomeric isolators for buildings are mainly designed to withstand dynamic loads caused by earthquakes only.

For structures other than buildings and bridges (e.g. tanks), the structural engineer uses either ISO 22762-2 or ISO 22762-3, depending on the requirements of the structure.

ISO/TS 22762-4 is the guidance for use of ISO 22762-3. ISO 22762-5 applies to specifications and test methods for sliding seismic-protection isolators which are not specified as elastomeric isolators. ISO 22762-6 applies to specifications and test methods for high-durability and high-performance elastomeric isolators. Three grades of requirements for each test item are introduced in ISO 22762-6.

© ISO 2024 – All rights reserved

Documents
Document Sharing Hub
Full document details: BS ISO 22762-3:2024

Elastomeric seismic-protection isolators —

Part 3: Applications for buildings — Specifications

1 Scope

This document specifies minimum requirements and test methods for elastomeric seismic elastomeric isolators used for buildings and the rubber material used in the manufacture of such elastomeric isolators.

It is applicable to elastomeric seismic elastomeric isolators used to provide buildings with protection from earthquake damage. The elastomeric isolators covered consist of alternate elastomeric layers and reinforcing steel plates. They are placed between a superstructure and its substructure to provide both flexibility for decoupling structural systems from ground motion, and damping capability to reduce deflection at the isolation interface and the transmission of energy from the ground into the structure at the isolation frequency.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 630 (all parts), *Structural steels*

ISO 22762-1:2024, *Elastomeric seismic-protection isolators — Part 1: Test methods*

3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

— ISO Online browsing platform: available at https://www.iso.org/obp/

— IEC Electropedia: available at https://www.electropedia.org/

3.1
breaking
rupture of *elastomeric isolator* (3.8) due to compression- (or tension-) shear loading

3.2
buckling
state when *elastomeric isolator* (3.8) lose their stability under compression-shear loading

3.3
compressive properties
K_v
compressive stiffness for all types of elastomeric isolator

© ISO 2024 – All rights reserved

Documents
Document Sharing Hub
Full document details: BS ISO 22762-3:2024

3.4
cover rubber
rubber wrapped around the outside of inner rubber and reinforcing steel plates before or after curing of elastomeric isolators for the purposes of protecting the inner rubber from deterioration due to oxygen, ozone and other natural elements and protecting the reinforcing plates from corrosion

3.5
design compressive stress
long-term compressive force on the *elastomeric isolator* (3.8) imposed by the structure

3.6
effective loaded area
area sustaining vertical load in *elastomeric isolator* (3.8), which corresponds to the area of reinforcing steel plates

3.7
effective width
<rectangular elastomeric isolator> the smaller of the two side lengths of inner rubber to which direction shear displacement is not restricted

3.8
elastomeric isolator
rubber bearing, for seismic isolation of buildings, bridges and other structures, which consists of multi-layered vulcanized rubber sheets and reinforcing steel plates

EXAMPLE High-damping rubber bearings, linear natural rubber bearings and lead rubber bearings.

3.9
first shape factor
ratio of effectively loaded area to free deformation area of one inner rubber layer between steel plates

3.10
high-damping rubber bearing
HDR
elastomeric isolator with relatively high damping properties obtained by special compounding of the rubber and the use of additives

3.11
inner rubber
rubber between multi-layered steel plates inside an *elastomeric isolator* (3.8)

3.12
lead rubber bearing
LRB
elastomeric isolator (3.8) whose *inner rubber* (3.11) with a lead plug or lead plugs press fitted into a hole or holes of the elastomeric isolator body to achieve damping properties

3.13
linear natural rubber bearing
LNR
elastomeric isolator (3.8) with linear shear force-displacement characteristics and relatively low damping properties, fabricated using natural rubber

Note 1 to entry: Any bearing with relatively low damping can be treated as an LNR bearing for the purposes of elastomeric isolator testing.

3.14
maximum compressive stress
peak stress acting briefly on *elastomeric isolator* (3.8) in compressive direction during an earthquake

© ISO 2024 – All rights reserved

Documents
Document Sharing Hub
Full document details: BS ISO 22762-3:2024

3.15
nominal compressive stress
long-term stress acting on *elastomeric isolators* (3.8) in compressive direction as recommended by the manufacturer for the elastomeric isolator, including the safety margin

3.16
roll-out
instability of an elastomeric isolator with either dowelled or recessed connection under shear deflection

3.17
routine test
test for quality control of the production elastomeric isolators during and after manufacturing

3.18
second shape factor
<circular elastomeric isolator> ratio of the diameter of the *inner rubber* (3.11) to the total thickness of the inner rubber

3.19
second shape factor
<rectangular or square elastomeric isolator> ratio of the effective width of the *inner rubber* (3.11) to the total thickness of the inner rubber

3.20
shear properties
comprehensive term that covers characteristics determined from elastomeric isolator tests:

— shear stiffness, K_h, for LNR;

— shear stiffness, K_h, and equivalent damping ratio, h_{eq}, for HDR and LRB;

— post-yield stiffness, K_d, and characteristic strength, Q_d, for LRB

3.21
standard value
value of elastomeric isolator property defined by manufacturer based on the results of type test

3.22
structural engineer
engineer who is in charge of designing the structure for seismically isolated buildings and is responsible for specifying the requirements for *elastomeric isolator* (3.8)

3.23
type test
test for verification either of material properties and elastomeric isolator performances during development of the product or that project design parameters are achieved

3.24
ultimate properties
properties at either buckling, breaking, or roll-out of an elastomeric isolator under compression-shear loading

3.25
ultimate property diagram
UPD
diagram giving the interaction curve of compressive stress and buckling strain or breaking strain of an elastomeric isolator

4 Symbols

For the purposes of this document, the symbols given in Table 1 apply.

© ISO 2024 – All rights reserved

Documents
Document Sharing Hub
Full document details: BS ISO 22762-3:2024

Table 1 — Symbols and descriptions

Symbol	Description
A	effective plan area; plan area of elastomeric isolator, excluding cover rubber portion
A_b	effective area of bolt
A_e	overlap area between the top and bottom elastomer area of elastomeric isolator
A_{free}	load-free area of elastomeric isolator
A_{load}	loaded area of elastomeric isolator
A_p	area of the lead plug for a lead rubber bearing
a	side length of square elastomeric isolator, excluding cover rubber thickness, or length in longitudinal direction of rectangular elastomeric isolator, excluding cover rubber thickness
a_e	length of the shorter side of the rectangular elastomeric isolator, including cover rubber thickness
a'	length in longitudinal direction of the rectangular elastomeric isolator, including cover rubber thickness
B	effective width for bending of flange
b	length in transverse direction of the rectangular elastomeric isolator, excluding cover rubber thickness
b'	length in transverse direction of the rectangular elastomeric isolator, including cover rubber thickness
c	distance from centre of bolt hole to effective flange section
D'	outer diameter of circular elastomeric isolator, including cover rubber
D_f	diameter of flange
d_i	inner diameter of reinforcing steel plate
d_k	diameter of bolt hole
d_0	outer diameter of reinforcing steel plate
E_{ap}	apparent Young's modulus of bonded rubber layer
E_c	apparent Young's modulus corrected, if necessary, by allowing for compressibility
$E_c{}^s$	apparent Young's modulus corrected for bulk compressibility depending on its shape factor (S_1)
E_∞	bulk modulus of rubber
E_0	Young's modulus of rubber
F_u	tensile force on elastomeric isolator by uplift
G	shear modulus
$G_{eq}(\gamma)$	equivalent linear shear modulus as a function of shear strain
H	height of elastomeric isolator, including mounting flange
H_n	height of elastomeric isolator, excluding mounting flange
h_{eq}	equivalent damping ratio
$h_{eq}(\gamma)$	equivalent damping ratio as a function of shear strain
K_d	post-yield stiffness (tangential stiffness after yielding of lead plug) of lead rubber bearing
K_h	shear stiffness
K_i	initial shear stiffness
K_p	shear stiffness of lead plug inserted in lead rubber bearing
K_r	shear stiffness of lead rubber bearing before inserting lead plug
K_t	tangential shear stiffness
K_v	compressive stiffness
L_f	length of one side of a rectangular flange
M	resistance to rotation
M_f	moment acting on bolt
M_r	moment acting on elastomeric isolator
n	number of rubber layers
n_b	number of fixing bolts

© ISO 2024 – All rights reserved

Documents
Document Sharing Hub
Full document details: BS ISO 22762-3:2024

Table 1 *(continued)*

Symbol	Description
P	compressive force
P_0	design compressive force in absence of seismic action effects
P_{max}	maximum compressive force including seismic action effects
P_{min}	minimum compressive force including seismic actions effects
P_{Tb}	tensile force at breaking of elastomeric isolator
Q	shear force
Q_b	shear force at breaking
Q_{buk}	shear force at buckling
Q_d	characteristic strength
Q_{r0}	shear force at roll-out
S_1	first shape factor
S_2	second shape factor
T	temperature
T_0	standard temperature, 23 °C or 27 °C; where specified tolerance is ±2 °C, T_0 is standard laboratory temperature
T_r	total rubber thickness, given by $T_r = n \times t_r$
t_r	thickness of one rubber layer
t_{r1}, t_{r2}	thickness of rubber layer laminated on each side of plate
t_s	thickness of one reinforcing steel plate
t_0	thickness of outside cover rubber
$U(\gamma)$	function giving ratio of characteristic strength to maximum shear force of a loop
v	loading velocity
W_d	energy dissipated per cycle
X	shear displacement
X_0	design shear displacement
X_b	shear displacement at breaking
X_{buk}	shear displacement at buckling
X_{r0}	shear displacement at roll-out
X_s	shear displacement due to quasi-static shear movement
X_{max}	maximum shear displacement
X_d	shear displacement due to dynamic shear movement
Y	compressive displacement
Z	section modulus of flange
α	coefficient of linear thermal expansion
γ	shear strain
γ_0	design shear strain
γ_a	upper limit of the total of design strains on elastomeric isolators
γ_b	shear strain at breaking
γ_c	local shear strain due to compressive force
γ_d	shear strain due to dynamic shear movement
γ_{max}	maximum design shear strain during earthquake
γ_r	local shear strain due to rotation
γ_s	shear strain due to quasi-static shear movement
γ_u	ultimate shear strain

© ISO 2024 – All rights reserved

Documents
Document Sharing Hub
Full document details: BS ISO 22762-3:2024

Table 1 *(continued)*

Symbol	Description
δ_H	horizontal offset of elastomeric isolator
δ_v	difference in elastomeric isolator height measured between two points at opposite extremes of the elastomeric isolator
ε	compressive strain of rubber
ε_{cr}	compressive creep strain
ε_T	tensile strain of elastomeric isolator
ε_{Tb}	tensile-breaking strain of elastomeric isolator
ε_{Ty}	tensile-yield strain of elastomeric isolator
ζ	ratio of total height of rubber and steel layers to total rubber height
θ	rotation angle of elastomeric isolator about the diameter of a circular bearing or about an axis through a rectangular bearing
θ_a	rotation angle of elastomeric isolator in the longitudinal direction (a)
θ_b	rotation angle of elastomeric isolator in the transverse direction (b)
λ	correction factor for calculation of stress in reinforcing steel plates
η	correction factor for calculation of critical stress
κ	correction factor for apparent Young's modulus according to hardness
$\Sigma\gamma$	total local shear strain
ρ_R	safety factor for roll-out
ρ_T	safety factor for tensile force
σ	compressive stress in elastomeric isolator
σ_0	design compressive stress
σ_B	tensile stress in bolt
σ_b	bending stress in flange
σ_{bf}	allowable bending stress in steel
σ_{cr}	critical compressive stress in elastomeric isolator
σ_f	allowable tensile stress in steel
σ_{max}	maximum compressive stress
σ_{min}	minimum compressive stress
σ_{nom}	for building: nominal long-term compressive stress recommended by manufacturer
σ_s	tensile stress in reinforcing steel plate
σ_{sa}	allowable tensile stress in steel plate
σ_{sy}	yield stress of steel for flanges and reinforcing steel plates
σ_{su}	tensile strength of steel for flanges and reinforcing steel plates
σ_t	tensile stress
σ_{te}	allowable tensile stress in elastomeric isolator
τ_B	shear stress in bolt
τ_f	allowable shear stress in steel
ϕ	factor for computation of buckling stability
ξ	factor for computation of critical stress

5 Classification

5.1 General

Elastomeric isolators are classified by construction, their ultimate properties and tolerances on their performance.

© ISO 2024 – All rights reserved

Documents
Document Sharing Hub
Full document details: BS ISO 22762-3:2024

5.2 Classification by construction

Elastomeric isolators are classified by construction, as shown in Table 2.

Other methods not listed in Table 2 may be used to fix flanges to the laminated rubber, if the resulting construction has adequate strength to resist the shear forces and bending moments due to shear deflection. Furthermore, such constructions shall be capable of resisting tension if the elastomeric isolator is designed for uplift.

Table 2 — Classification by construction

Type	Construction	Illustration
Type I	Mounting flanges are bolted to connecting flange plate, which are bonded to the laminated rubber. Cover rubber is added before curing of elastomeric isolator.	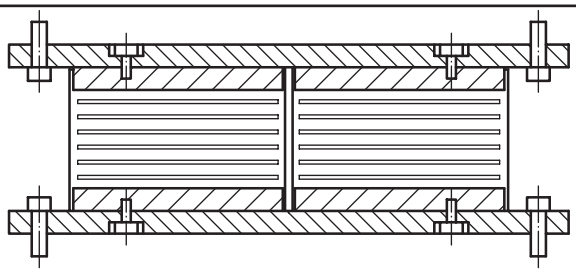
	Mounting flanges are bolted to connecting flange plate, which are bonded to the laminated rubber. Cover rubber is added after curing of elastomeric isolator.	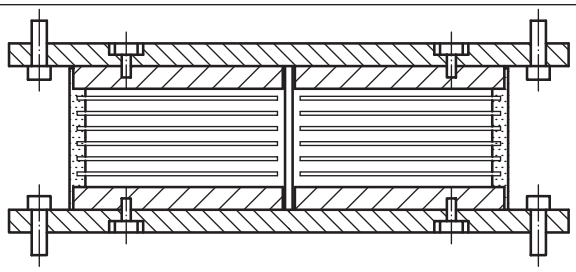
Type II	Mounting flanges are directly bonded to the laminated rubber.	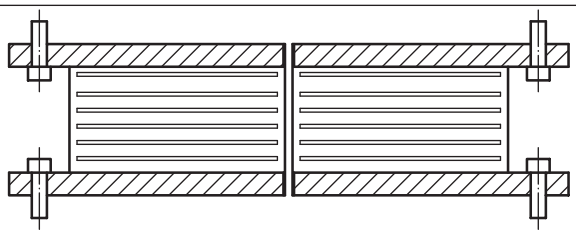
Type III	Elastomeric isolators without mounting flanges, connected to base by either recess rings or dowell pins.	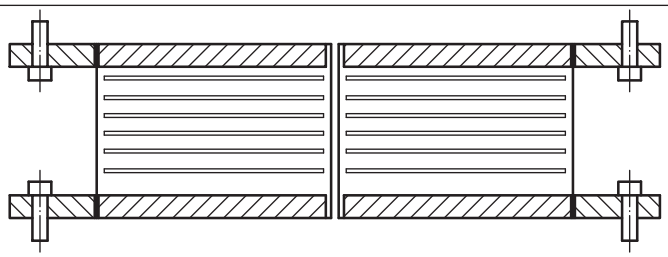 **Recess connection**
		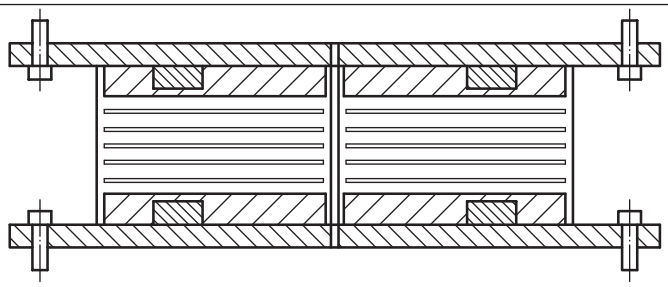 **Dowell connection**

© ISO 2024 – All rights reserved

Documents
Document Sharing Hub
Full document details: BS ISO 22762-3:2024

5.3 Classification by tolerance on shear properties

Elastomeric isolators are classified by tolerance on shear properties, as shown in Table 3.

Table 3 — Classification by tolerance of shear properties

Class	Individual	Global
S-A	±15 %	±10 %
S-B	±25 %	±20 %

6 Requirement

6.1 General

Elastomeric isolators for buildings and the materials used in manufacture shall meet the requirements specified in this clause. For test items (see Table 4) that have no specific required values, the manufacturer shall define the values and inform the purchaser prior to production.

The standard temperature for determining the properties of elastomeric isolators is 23 °C or 27 °C in accordance with prevailing International Standards. However, it is advisable to establish a range of working temperatures taking into consideration actual environmental temperatures and possible changes in temperatures at the work site where the elastomeric isolators are installed.

Table 4 — Test pieces for type test

Properties	Test item	Test piece	
		Scale	Minimum number
Compressive properties	Compressive stiffness	Full-scale only	3
Shear properties[a]	Shear stiffness Equivalent damping ratio Post-yield stiffness (for LRB) Characteristic strength (for LRB)	Full-scale only	3
Tensile properties	Tensile breaking strength Tensile yield strength	Scale B	3
Dependence of shear properties	Shear strain dependence[a]	Full-scale only	3
	Compressive stress dependence[a]	Full-scale only	3
	Frequency dependence	Scale A, STD, SBS	3
	Repeated loading dependence[a]	Scale B	3
	Temperature dependence	Scale A, STD, SBS	3
Dependence of compressive properties	Shear strain dependence	Scale B	3
	Compressive stress dependence		3

Scale A: Scaling such that, for a circular elastomeric isolator, diameter ≥150 mm, for a rectangular elastomeric isolator, side length ≥100 mm and, for both types, rubber layer thickness ≥1,5 mm and thickness of reinforcing steel plates ≥0,5 mm.

Scale B: Scaling such that, for a circular elastomeric isolator, diameter ≥500 mm, for a rectangular elastomeric isolator, side length ≥500 mm and, for both types, rubber layer thickness ≥1,5 mm and thickness of reinforcing steel plates ≥0,5 mm. Minimum scale factor 0,5.

STD: Standard test piece [see ISO 22762-1:2024, Tables 10 and 11].

SBS: Shear-block test piece specified in ISO 22762-1:2024, 5.8.3 With LRB, SBS shall only be used for ageing tests.

[a] If double-shear test configuration used, 3 tests involving 3 test-pieces shall be performed. The test pieces shall be paired such that the properties of individual test-pieces can be obtained.

[b] If double-shear test configuration used, 2 tests shall be performed.

© ISO 2024 – All rights reserved

Documents
Document Sharing Hub
Full document details: BS ISO 22762-3:2024

Table 4 *(continued)*

Properties	Test item	Test piece	
		Scale	Minimum number
Ultimate properties	Shear displacement capacity[b]	Scale B	3
Durability	Ageing	Scale A, STD, SBS	2
	Creep	Scale A	2

Scale A: Scaling such that, for a circular elastomeric isolator, diameter ≥150 mm, for a rectangular elastomeric isolator, side length ≥100 mm and, for both types, rubber layer thickness ≥1,5 mm and thickness of reinforcing steel plates ≥0,5 mm.

Scale B: Scaling such that, for a circular elastomeric isolator, diameter ≥500 mm, for a rectangular elastomeric isolator, side length ≥500 mm and, for both types, rubber layer thickness ≥1,5 mm and thickness of reinforcing steel plates ≥0,5 mm. Minimum scale factor 0,5.

STD: Standard test piece [see ISO 22762-1:2024, Tables 10 and 11].

SBS: Shear-block test piece specified in ISO 22762-1:2024, 5.8.3 With LRB, SBS shall only be used for ageing tests.

[a] If double-shear test configuration used, 3 tests involving 3 test-pieces shall be performed. The test pieces shall be paired such that the properties of individual test-pieces can be obtained.

[b] If double-shear test configuration used, 2 tests shall be performed.

Some of these properties may be determined using one of the standard test pieces detailed in ISO 22762-1:2024, Tables 10 and 11. The standard test pieces are used for non-specific product tests, such as testing in the development of new materials and products.

6.2 Type tests and routine tests

6.2.1 Testing to be carried out on elastomeric isolators is classified into “type tests” and “routine tests”.

6.2.2 Type tests shall be conducted either to ensure that project design parameters have been achieved (in which case the test results shall be submitted to the structural engineer for review prior to production) or to verify elastomeric isolator performance and material properties during development of the product. The test piece for each type test shall be full-scale or one of the options specified in Table 4. The test piece shall not have been subjected to any previous test programme. The tests shall be performed on test pieces not subjected to any scragging, unless the production elastomeric isolators are to be supplied after scragging. In that case, the test pieces shall be subjected to the same scragging procedure as the production elastomeric isolators.

6.2.3 Previous type test results may be substituted, provided the following conditions are met.

a) Elastomeric isolators are fabricated in a similar manner and from the same compound and adhesive.

b) All corresponding external and internal dimensions are within 10 % of each other. Flange plates are excluded.

c) First and second shape factors are equal to or larger than those in previous tests.

d) The test conditions, such as maximum and minimum vertical load applied in the ultimate property test (see 6.5.7), are more severe.

Routine tests are carried out during production for quality control. Sampling is allowed for routine testing for projects with agreement between structural engineer and manufacturer. Sampling shall be conducted randomly and cover not less than 20 % of the production of any elastomeric isolator design. For a given project, tests shall cover not less than four test pieces for each size and not less than 20 test pieces in total.

If elastomeric isolators are supplied after scragging, the routine test shall be performed on scragged elastomeric isolators.

© ISO 2024 – All rights reserved

Documents
Document Sharing Hub
Full document details: BS ISO 22762-3:2024

6.3 Functional requirements

Elastomeric isolators for buildings are designed and manufactured to have the performance characteristics required so that they deform in all directions with the proper stiffness (with damping, if required) during an earthquake.

In the application of elastomeric isolators, attention shall be paid to the following points.

a) The elastomeric isolators shall be installed horizontally between the structure and foundation.

b) Once installed, the elastomeric isolators shall not be subjected to a constant shear force.

c) When elastomeric isolators are to be installed under relatively flexible columns, the rotation at the top of the elastomeric isolator caused by bending deformation shall be carefully considered.

d) Exposed steel surfaces, such as the surfaces of mounting flanges, shall be properly painted or galvanized to prevent rusting.

e) Proper maintenance shall be carried out on installed elastomeric isolators to prevent any abnormalities such as distortion, cracks or rust occurring.

f) Fire protection of the elastomeric isolators may be required.

g) The seismic gap shall be maintained at all times.

6.4 Design compressive force and design shear displacement

6.4.1 The design stress and strain of an elastomeric isolator are defined by the following relationships with the design force and the displacement.

$$\sigma_0 = \frac{P_0}{A}, \sigma_{\max} = \frac{P_{\max}}{A}, \sigma_{\min} = \frac{P_{\min}}{A}$$

$$\gamma_0 = \frac{X_0}{T_r}, \gamma_{\max} = \frac{X_{\max}}{T_r}$$

6.4.2 The design compressive forces, P_0, and maximum and minimum compressive forces, respectively $P_{\max}$ and $P_{\min}$, and the design shear displacements X_0 and the maximum shear displacement $X_{\max}$ for an elastomeric isolator shall be provided by the structural engineer. If the P_0, $P_{\max}$, $P_{\min}$, X_0 and $X_{\max}$ are not known at the time of type test, the design stress and design strain to be used for testing can be determined as follows:

$$\sigma_0 = \sigma_{\text{nom}}, \sigma_{\max} = 2\sigma_{\text{nom}}$$

where σ_{nom}, $\sigma_{\min}$, γ_0 and $\gamma_{\max}$ are determined by the manufacturer.

6.5 Performance requirements

6.5.1 General

The elastomeric isolators shall be tested and the results recorded using the specified test methods. They shall satisfy all of the requirements listed below. The test items are summarized in Table 5, which indicates those type tests that are optional, where a material test piece may substitute an elastomeric isolator, and the tests to be performed as routine tests. The standard value obtained from the tests shall be reported. Double-shear configuration testing (see ISO 22762-1:2024, 6.2.2.2) can be employed with the approval of the structural engineer.

© ISO 2024 – All rights reserved

Documents
Document Sharing Hub
Full document details: BS ISO 22762-3:2024

Table 5 — Tests on elastomeric isolators

Property	Test item	Test method	Routine test	Type test
Compressive properties	Compressive stiffness	ISO 22762-1:2024, 6.2.1, method 2	X	X
Shear properties	Shear stiffness Equivalent damping ratio Post-yield stiffness (for LRB) Characteristic strength (for LRB)	ISO 22762-1:2024, 6.2.2	X	X
Tensile properties	Tensile breaking strength Tensile yield strength	ISO 22762-1:2024, 6.5	N/A	Opt.
Dependence of shear properties	Shear strain dependence	ISO 22762-1:2024, 6.3.1	N/A	X
	Compressive stress dependence	ISO 22762-1:2024, 6.3.2	N/A	X
	Frequency dependence	ISO 22762-1:2024, 6.3.3	N/A	X(m)
	Repeated loading dependence	ISO 22762-1:2024, 6.3.4	N/A	X
	Temperature dependence	ISO 22762-1:2024, 6.3.5 5.8	N/A	X(m)
Dependence of compressive properties	Shear strain dependence	ISO 22762-1:2024, 6.3.6	N/A	Opt.
	Compressive stress dependence	ISO 22762-1:2024, 6.3.7	N/A	Opt.
Ultimate properties	Shear displacement capacity	ISO 22762-1:2024, 6.4	N/A	X
	Ultimate property diagram (UPD)	ISO 22762-3:2024, Annex B	N/A	Opt.
Durability	Ageing	ISO 22762-1:2024, 6.6.1	N/A	X(m)
	Creep	ISO 22762-1:2024, 6.6.2	N/A	X

X: Test to be conducted with elastomeric isolators.
X(m): Test can be conducted either with elastomeric isolators or with shear-block test pieces.
N/A: Not applicable.
Opt.: Optional; the structural engineer can request that any optional test has to be carried out.

6.5.2 Compressive properties

6.5.2.1 General requirements

The compressive stiffness, K_v, shall be within ±30 % of the design value.

6.5.2.2 Test piece

The test piece shall be a full-scale elastomeric isolator for the type test and a production elastomeric isolator for the routine test.

6.5.2.3 Test condition

As specified in ISO 22762-1:2024, 6.2.1.5.2, method 2, cyclic loading with the design compressive stress σ_0 ±30 % shall be carried out for three cycles.

The compressive stiffness, K_v, shall be computed from the third cycle.

The standard test temperature, T_0, is 23 °C or 27 °C. If the test is carried out at a different temperature, the result shall be corrected to the value of the property at T_0 by an appropriate method.

© ISO 2024 – All rights reserved

Documents
Document Sharing Hub
Full document details: BS ISO 22762-3:2024

6.5.3 Shear properties

6.5.3.1 General requirements

The following properties shall be within the specified range of design value corresponding to the adopted tolerance class specified in 5.3.

The test items specified for each type of elastomeric isolator are shown in Table 6 (see Annex F). The properties measured for LRB may be selected from either L-1 or L-2, as given in Table 6.

Table 6 — Shear property test items

Elastomeric isolator type	Test item	
LNR	Shear stiffness, K_h	
HDR	Shear stiffness, Kh, equivalent damping ratio, h_{eq}	
LRB	L-1	Shear stiffness K_h, equivalent damping ratio h_{eq}
	L-2	Post-yield stiffness K_d, characteristic strength Q_d

6.5.3.2 Test piece

The test piece shall be a full-scale elastomeric isolator for the type test and a production elastomeric isolator for the routine test.

6.5.3.3 Test conditions

6.5.3.3.1 The test piece shall be loaded with the design compressive stress, σ_0.

6.5.3.3.2 The cyclic loading of the design shear strain, γ_0, or of the shear strain which corresponds to γ = 100 % shall be carried out for three cycles.

6.5.3.3.3 The required properties shall be computed from the third cycle.

If the test is performed at a frequency different from the design isolation frequency, the result shall be corrected to the design frequency or to 0,5 Hz by an appropriate method.

The standard test temperature is 23 °C or 27 °C. If the test is carried out at a different temperature, the result shall be corrected to the value of the property at T_0 by an appropriate method.

6.5.4 Tensile properties

6.5.4.1 General requirements

The tensile properties shall be within the specified range.

6.5.4.2 Test piece

The test piece shall be a full-scale elastomeric isolator or a scale model, as specified in Table 4.

6.5.4.3 Test conditions

The test conditions shall be as specified in ISO 22762-1:2024, 6.5.

© ISO 2024 – All rights reserved

Documents
Document Sharing Hub
Full document details: BS ISO 22762-3:2024

6.5.5 Dependences of shear properties

6.5.5.1 Shear strain dependence

6.5.5.1.1 General requirements

The change in each property over the range of test shear strains with respect to the value of the property at the design shear strain, γ_0 (or another reference strain, if employed in the shear property test in 6.5.3), shall be within the specified range.

6.5.5.1.2 Test piece

The test piece shall be a full-scale elastomeric isolator.

6.5.5.1.3 Test conditions

The shear properties shall be determined at strains between 50 % and the maximum shear strain, γ_{max}, at strain intervals of 50 %; the interval between the last two test strains shall be at least 50 %. The change in the property, normalized using the value corresponding to the design strain, shall be determined. Tests can also be performed at 10 % and 20 % shear strain.

6.5.5.2 Compressive stress dependence

6.5.5.2.1 General requirements

As the compressive stress varies, the change in the shear properties with respect to the value of the property at the design stress, σ_0, shall be within the specified range (see Annex D).

The test piece shall be a full-scale elastomeric isolator.

6.5.5.2.2 Test conditions

The shear strain amplitude shall be γ_0.

The shear properties shall be determined at 0, $0{,}5\sigma_0$, $1{,}0\sigma_0$, $1{,}5\sigma_0$, $2{,}0\sigma_0$ and the maximum tensile stress, if applicable, and the change in the property, normalized using the value corresponding to the design strain, shall be determined.

6.5.5.3 Frequency dependence

6.5.5.3.1 General requirements

The frequency dependence shall be within the specified range.

6.5.5.3.2 Test piece

The test piece shall be a full-scale elastomeric isolator, a scale model, a standard test piece or a shear-block test piece, as specified in Table 4.

6.5.5.3.3 Test conditions

The shear strain amplitude shall be γ_0.

Other test conditions shall be as specified in ISO 22762-1:2024, 6.3.3.

© ISO 2024 – All rights reserved

Documents
Document Sharing Hub
Full document details: BS ISO 22762-3:2024