

Information technology — Implementation and operation of customer premises cabling —

Part 3: Testing of optical fibre cabling

ICS 35.200; 33.180.10

National foreword

This British Standard is the UK implementation of ISO/IEC 14763-3:2006+A1:2009. It supersedes BS ISO/IEC 14763-3:2006 which is withdrawn.

The start and finish of text introduced or altered by amendment is indicated in the text by tags. Tags indicating changes to ISO/IEC text carry the number of the ISO/IEC amendment. For example, text altered by ISO/IEC amendment 1 is indicated by A1 A1.

The UK participation in its preparation was entrusted to Technical Committee TCT/7, Telecommunications — Installation requirements.

A list of organizations represented on this committee can be obtained on request to its secretary.

This publication does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

Compliance with a British Standard cannot confer immunity from legal obligations.

This British Standard was published under the authority of the Standards Policy and Strategy Committee on 31 July 2006

© BSI 2010

ISBN 978 0 580 63771 1

Amendments/corrigenda issued since publication

Date	Comments
30 June 2010	Implementation of ISO/IEC amendment 1:2009

INTERNATIONAL STANDARD

ISO/IEC 14763-3

First edition
2006-06

**Information technology –
Implementation and operation of
customer premises cabling –**

**Part 3:
Testing of optical fibre cabling**



Reference number
ISO/IEC 14763-3:2006(E)

CONTENTS

FOREWORD.....	7
INTRODUCTION.....	8
1 Scope.....	9
2 Normative references.....	9
3 Definitions and abbreviations	10
3.1 Definitions	10
3.2 Abbreviations.....	12
3.3 Symbols	12
4 Conformance	12
5 General requirements	13
5.1 Test system.....	13
5.2 Normalisation and calibration.....	13
5.3 Environmental conditions	13
5.3.1 Protection of transmission and terminal equipment.....	13
5.3.2 Contamination	14
5.3.3 Use of test equipment.....	14
5.3.4 Relevance of measurement.....	14
5.3.5 Treatment of marginal test results	14
5.4 Documentation	14
6 Test equipment.....	15
6.1 LSPM	15
6.1.1 General	15
6.1.2 Light sources	15
6.1.3 Power meters	15
6.1.4 Test system stability	15
6.2 OTDR.....	16
6.2.1 General	16
6.2.2 OTDR characterization using a launch cord only.....	16
6.2.3 OTDR characterization using a launch cord and a tail cord	16
6.3 Cabling interface adapters	18
6.3.1 Connecting hardware at test interfaces.....	18
6.3.2 Reference connector requirements.....	18
6.3.3 MMF test cords.....	18
6.3.4 SMF test cords	21
6.4 MMF launched modal distribution (LMD)	22
6.5 SMF launched modal distribution (LMD).....	22
7 Inspection equipment.....	23
7.1 Connecting hardware end-face	23
7.1.1 General	23
7.1.2 Optical, direct vision microscope.....	23
7.1.3 CCD microscope.....	23
8 Cabling under test.....	23
8.1 Channels and permanent links	23
8.1.1 General	23

8.1.2	Reference planes.....	24
8.1.3	Wavelength of measurement.....	25
8.1.4	Direction of measurement.....	25
9	Testing of installed cabling.....	25
9.1	Attenuation/insertion loss.....	25
9.1.1	LSPM	25
9.1.2	OTDR.....	30
9.2	Propagation delay.....	33
9.2.1	Test method	33
9.2.2	Treatment of results.....	33
9.3	Length.....	33
9.3.1	Test method	33
9.3.2	Measurement uncertainty.....	33
9.3.3	Treatment of results.....	34
10	Testing of cabling components within installed cabling	34
10.1	Attenuation/insertion loss (optical fibre cable)	34
10.1.1	Test method	34
10.1.2	Measurement uncertainty.....	34
10.1.3	Treatment of results.....	35
10.2	Attenuation/insertion loss (local and remote test interfaces)	35
10.2.1	Test method	35
10.2.2	Test system measurement uncertainty	36
10.2.3	Treatment of results.....	36
10.3	Insertion loss (connecting hardware).....	37
10.3.1	Test method	37
10.3.2	Treatment of results.....	38
10.4	Return loss (connecting hardware).....	38
10.4.1	Test method (in accordance with IEC 61300-3-6, method 2).....	38
10.4.2	Treatment of results.....	39
10.4.3	Measurement uncertainty.....	40
10.5	Optical fibre length	40
10.5.1	Test method	40
10.5.2	Measurement uncertainty.....	42
10.5.3	Treatment of results.....	42
10.6	Attenuation/insertion loss (cords).....	42
10.6.1	Test method	42
10.6.2	Treatment of results.....	43
10.7	Return loss (cords).....	43
11	Inspection of cabling and cabling components.....	43
11.1	Optical fibre continuity	43
11.2	Cabling polarity.....	44
11.3	Optical fibre cable length	44
11.4	Inspection of optical fibre end-faces.....	44
11.5	Optical fibre core size	44
Annex A (normative)	Launched modal distribution (LMD)	45
A.1	General.....	45
A.2	Description	45

A.3 Background on multimode launch conditions	45
A.4 Test source launch	45
A.4.1 General	45
A.4.2 Encircled flux	46
A.4.3 EF template example	46
A.4.4 EF target of the multimode launch condition for attenuation measurement	46
A.5 Adjustments to the raw near field data	47
A.6 Target launch and upper and lower tolerance bands for attenuation measurements of multimode optical fibre cabling	47
A.6.1 General	47
A.6.2 Limits on encircled flux	48
Annex B (normative) Visual inspection criteria for connectors	49
B.1 Connector end-face definitions	49
B.1.1 General	49
B.1.2 End-face zone definitions	49
B.1.3 Modified inspection criteria	49
B.2 Inspection of terminated optical fibre	50
B.2.1 General	50
B.2.2 Scratch and pit defects	50
B.2.3 Chip defects	50
B.2.4 Cracks	50
Annex C (informative) Optical time domain reflectometry	51
C.1 Operational capability	51
C.1.1 Effective characterization	51
C.1.2 Dynamic range	51
C.1.3 Pulse width	51
C.1.4 Integration or sample count	51
C.2 Limitations of OTDR capability	52
C.2.1 Minimum lengths of operation	52
C.2.2 Ghosting	53
C.2.3 Effective group index of refraction (IOR)	54
C.2.4 Scattering coefficient	54
Annex D (normative) Inspection and testing of test and field calibration cords	55
D.1 General requirements	55
D.2 Insertion loss (test and field calibration cord reference connections)	55
Annex E (informative) Three test cord reference method for link and channel attenuation	57
Annex F (informative) Quality planning	58
F.1 Inspection and test schedules	58
F.2 Stage 1 inspection and testing	58
F.3 Stage 2 testing	59
F.3.1 Basic test group	59
F.3.2 Extended test group	59
Annex G (informative) Examples of calculations of channel and permanent link limits	60
BIBLIOGRAPHY	62

Figure 1 – Document relationships	8
Figure 2 – The test system and the cabling under test	13
Figure 3 – OTDR characterization using a launch cord only.....	17
Figure 4 – OTDR characterization using a launch cord and a tail cord	17
Figure 5 – Test cord labelling and identification	19
Figure 6 – OTDR launch cord schematic	20
Figure 7 – Channels and permanent links in accordance with ISO/IEC 11801 and equivalent standards	24
Figure 8 – Channel and permanent link test configuration	24
Figure 9 – SSPM three test cord attenuation measurement of installed cabling	27
Figure 10 – SSPM one test cord attenuation measurement of installed cabling	28
Figure 11 – OTDR measurement of installed cabling (permanent link)	30
Figure 12 – OTDR measurement of installed cabling (channel)	31
Figure 13 – OTDR measurement of optical fibre attenuation	35
Figure 14 – OTDR measurement of connection insertion loss	37
Figure 15 – OTDR measurement of joint insertion loss	38
Figure 16 – OTDR measurement of return loss	39
Figure 17 – Determination of length using an OTDR	41
Figure 18 – OTDR characterization of a SMF permanent link containing a break	41
Figure 19 – OTDR characterization of an permanent link containing a macrobend.....	42
Figure 20 – Measurement of cord interface attenuation/insertion loss	43
Figure A.1 – Example of a characteristic MTF.....	46
Figure B.1 – Connector end-face region definitions.....	49
Figure B.2 – Polishing defects and cracks	50
Figure C.1 – OTDR characterization using different length launch cords	52
Figure C.2 – OTDR characterization showing ghost effects.....	53
Figure C.3 – OTDR characterization showing complex ghost effects	54
Figure D.1 – Measurement of field calibration cord interface attenuation/insertion loss.....	55
Figure E.1 – Example of cabling and test cord configuration with 3-jumper test method.....	57

Table 1 – MMF light source characteristics	15
Table 2 – SMF light source characteristics	15
Table 3 – Non-SC reference connector requirements.....	18
Table 4 – Connecting hardware insertion loss.....	29
Table A.1 – EF target for 50 µm core fibre at 850 nm (see Figure A.1).....	47
Table A.2 – EF target for 50 µm core fibre at 1 300 nm.....	47
Table A.3 – EF target for 62,5 µm fibre at 850 nm.....	47
Table A.4 – EF target for 62,5 µm core fibre at 1 300 nm.....	47
Table A.5 – EF requirements for 50 µm core fibre at 850 nm (For threshold = 0,08 dB).....	48
Table A.6 – EF requirements for 50 µm core fibre at 1 300 nm (For threshold = 0,12 dB).....	48
Table A.7 – EF requirements for 62,5 µm fibre cabling at 850 nm (For threshold = 0,10 dB)....	48
Table A.8 – EF requirements for 62,5 µm fibre cabling at 1 300 nm (For threshold = 0,15 dB).....	48
Table B.1 – Connector end-face regions.....	49
Table B.2 – Requirements for visual end-face inspection	50
Table C.1 – Default effective group IOR values	54
Table C.2 – Default scattering coefficient values.....	54

**INFORMATION TECHNOLOGY –
IMPLEMENTATION AND OPERATION OF
CUSTOMER PREMISES CABLING –**

Part 3: Testing of optical fibre cabling

FOREWORD

- 1) ISO (International Organization for Standardization) and IEC (International Electrotechnical Commission) form the specialized system for worldwide standardization. National bodies that are members of ISO or IEC participate in the development of International Standards. Their preparation is entrusted to technical committees; any ISO and IEC National Committee interested in the subject dealt with may participate in this preparatory work. International governmental and non-governmental organizations liaising with ISO and IEC also participate in this preparation.
- 2) In the field of information technology, ISO and IEC have established a joint technical committee, ISO/IEC JTC 1. Draft International Standards adopted by the joint technical committee are circulated to national bodies for voting. Publication as an International Standard requires approval by at least 75 % of the national bodies casting a vote.
- 3) All users should ensure that they have the latest edition of this publication.
- 4) No liability shall attach to IEC or ISO or its directors, employees, servants or agents including individual experts and members of their technical committees and IEC or ISO member bodies for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication of, use of, or reliance upon, this ISO/IEC publication or any other IEC, ISO or ISO/IEC publications.
- 5) Attention is drawn to the normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 6) Attention is drawn to the possibility that some of the elements of this International Standard may be the subject of patent rights. ISO and IEC shall not be held responsible for identifying any or all such patent rights.

ISO/IEC 14763-3 has been prepared by subcommittee 25: Interconnection of information technology equipment, of ISO/IEC joint technical committee 1: Information technology.

This International Standard replaces ISO/IEC TR 14763-3, first edition, published in 2000, and constitutes a technical revision.

This standard incorporates innovations and recent developments including guidance in the proper use of uni-directional and bi-directional OTDR testing, the three-jumper method as default test method, fibre end-face inspection and criteria for scratches, return loss values for SC and non-SC connectors and the normative use of reference connectors. However, the most substantial change is the application of the 2 parameters which are used to determine the two repeatable multimode launch conditions “modal power distribution” and “coupled power ratio”.

This International Standard has been approved by vote of the member bodies, and the voting results can be obtained from the address given on the title page.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

INTRODUCTION

This document is one of three prepared in support of International Standard ISO/IEC 11801.

Figure 1 below shows the inter-relationship between ISO/IEC 11801, these associated Technical Reports/Standards and other related standards.

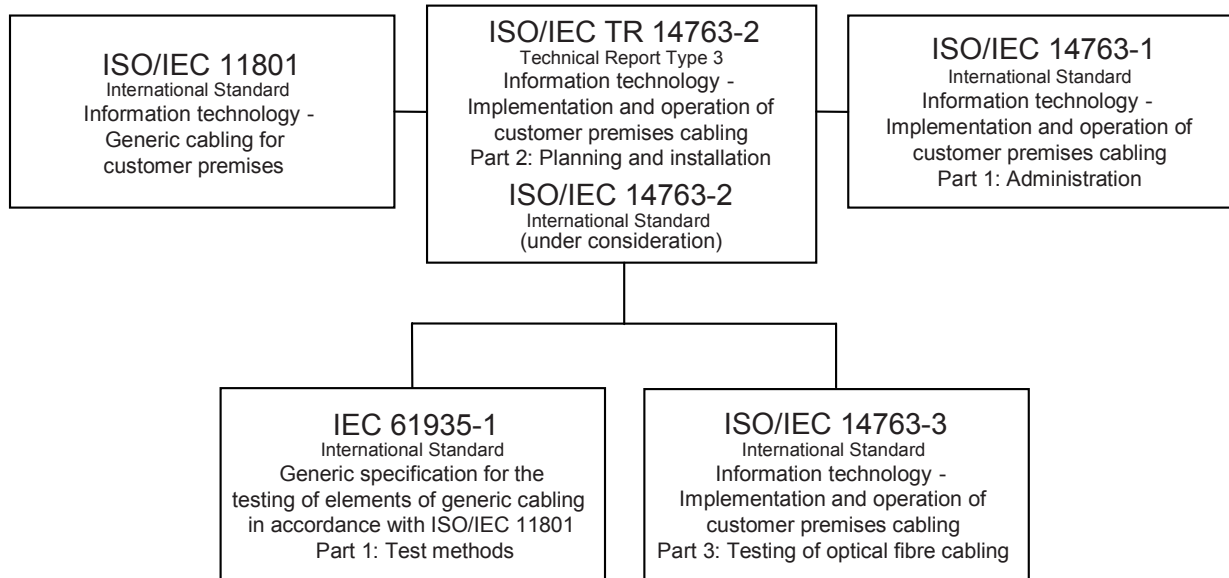


Figure 1 – Document relationships

Part 3 of ISO/IEC 14763 details inspection and test procedures for optical fibre cabling

- designed in accordance with ISO/IEC 11801 and equivalent standards and
- installed according to the requirements and recommendations of ISO/IEC 14763-2 (under consideration).

Users of this International Standard should be familiar with both ISO/IEC 11801 and ISO/IEC 14763-2.

The quality plan for each installation will define the acceptance tests and sampling levels selected for that installation. Requirements and recommendations for the development of a quality plan are described in ISO/IEC 14763-2 (under consideration).

INFORMATION TECHNOLOGY – IMPLEMENTATION AND OPERATION OF CUSTOMER PREMISES CABLING –

Part 3: Testing of optical fibre cabling

1 Scope

This part of ISO/IEC 14763 specifies systems and methods for the inspection and testing of optical fibre cabling designed in accordance with ISO/IEC 11801 or equivalent standards. The test methods refer to existing standards-based procedures where they exist.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO/IEC 11801, *Information technology – Generic cabling for customer premises*

ISO/IEC TR 14763-2, *Information technology – Implementation and operation of customer premises cabling – Part 2: Planning and installation*¹

IEC 60050-731, *International Electrotechnical Vocabulary – Chapter 731: Optical fibre communication*

A1 Text deleted **A1**

IEC 60793-1-45, *Optical fibres – Part 1-45: Measurement methods and test procedures – Mode field diameter*

IEC 60793-2-10, *Optical fibres – Part 2-10: Product specifications – Sectional specification for category A1 multimode fibres*

IEC 60793-2-50, *Optical fibres – Part 2-50: Product specifications – Sectional specification for class B single-mode fibres*

IEC 60825-2, *Safety of laser products – Part 2: Safety of optical fibre communication systems (OFCS)*

IEC 60874-14-1, *Connectors for optical fibres and cables – Part 14-1: Detail specification for fibre optic connector type SC/PC standard terminated to multimode fibre type A1a, A1b*

IEC 60874-14-2, *Connectors for optical fibres and cables – Part 14-2: Detail specification for fibre optic connector type SC/PC tuned terminated to single-mode fibre type B1*

IEC 60874-14-3, *Connectors for optical fibres and cables – Part 14-3: Detail specification for fibre optic adaptor (simplex) type SC for single-mode fibre*

IEC 60874-19, *Connectors for optical fibres and cables – Part 19: Sectional specification for fibre optic connector – Type SC-D(uplex)*

¹ ISO/IEC 14763-2 is planned to become an International Standard.

IEC 60874-19-1, *Connectors for optical fibres and cables – Part 19-1: Fibre optic patch cord connector type SC-PC (floating duplex) standard terminated on multimode fibre type A1a, A1b - Detail specification*

IEC 60874-19-2, *Connectors for optical fibres and cables – Part 19-2: Fibre optic adaptor (duplex) type SC for single-mode fibre connectors – Detail specification*

A1 IEC 61280-1-4, *Fibre optic communication subsystem test procedures – Part 1-4: General communication subsystems – Light source encircled flux measurement method*

IEC 61280-4-1, *Fibre optic communication subsystem test procedures – Part 4-1: Cable plant and links – Multimode fibre-optic cable plant attenuation measurement* **A1**

IEC 61300-3-1, *Fibre optic interconnecting devices and passive components – Basic test and measurement procedures – Part 3-1: Examinations and measurements – Visual examination*

IEC 61300-3-4, *Fibre optic interconnecting devices and passive components – Basic test and measurement procedures – Part 3-4: Examinations and measurements – Attenuation*

IEC 61300-3-6, *Fibre optic interconnecting devices and passive components – Basic test and measurement procedures – Part 3-6: Examinations and measurements – Return loss*

A1 Text deleted **A1**

A1 IEC/PAS 62614, *Fibre optics – Launch condition requirements for measuring multimode attenuation* **A1**

3 Definitions and abbreviations

3.1 Definitions

For the purposes of this document the following definitions apply in addition to those of ISO/IEC 11801 and IEC 60050-731.

3.1.1

adapter

device that enables interconnection between terminated optical fibre cables

3.1.2

cabling interface adapter

test cords and other components used to connect test equipment to the cabling under test

3.1.3

connection

mated device or combination of devices including terminations connecting two cables or cable elements

3.1.4

cable sheath

covering over the optical fibre or conductor assembly that may include one or more metallic members, strength members or jackets

A1 Text deleted **A1**

3.1.6

fail result

measured value which fails to meet the specified requirement and where the absolute value of the difference between the measured value and the specified requirement is greater than the stated measurement uncertainty

A1 3.1.7

field calibration cord

test cord used for referencing when using the three test cord reference test method **A1**

3.1.8

marginal result

measured value which differs from the specified requirement by an amount not exceeding the stated measurement uncertainty

3.1.9

multimode optical fibre (MMF)

optical fibre which supports multiple paths of light transmission

3.1.10

optical fibre

any filament made of dielectric materials that guides light

3.1.11

optical time domain reflectometer (OTDR)

instrument used to characterise optical fibre cabling by measuring the backscatter and reflection of injected light pulses as a function of time

3.1.12

pass result

measured value which meets the specified requirement and where the absolute value of the difference between the measured value and the specified requirement is greater than the stated measurement uncertainty

3.1.13

reference connector

tighter tolerances or selected connector component which is used for measuring purposes

NOTE The characteristics or selection procedures are given in the relevant connecting hardware specification.

[IEC 60874-1, 1.3.14, modified]

A1 Text deleted **A1**

3.1.15

sheath

see cable sheath

3.1.16

single-mode optical fibre (SMF)

optical fibre which supports only one mode of light transmission

3.1.17

test cord

cable assembly used either to connect test equipment to the cabling under test or as part of a test reference measurement

3.1.18

test operator

skilled person testing in accordance with instructions provided by the test system designer

3.1.19

test system

test equipment and cabling interface adapters necessary to undertake test/measurement in accordance with the requirements of this standard

A1 3.1.20

attenuation

reduction of optical power induced by transmission through a medium such as optical fibre; this is sometimes called insertion loss, L , and is given in dB as $L = 10 \log_{10}(P_{\text{in}}/P_{\text{out}})$, where P_{in} and P_{out} are the power, typically measured in mW, into and out of the cabling

3.1.21

encircled flux

EF

fraction of cumulative near-field power to the total output power as a function of radial distance from the optical centre of the core

3.1.22

OTDR dead zone

distance in which an OTDR cannot detect an event following a reflective event **A1**

3.2 Abbreviations

For the purposes of this document the following abbreviations apply in addition to those of ISO/IEC 11801 and IEC 60050-731.

APC Angled physical contact

A1 *Text deleted*

EF Encircled flux **A1**

IOR Index of refraction

LMD Launched modal distribution

LSA Least squares average

LSPM Light source and power meter

MMF Multimode optical fibre

A1 *Text deleted* **A1**

na not applicable

OTDR Optical time domain reflectometer

A1 *Text deleted* **A1**

SMF Single-mode optical fibre

3.3 Symbols

For the purposes of this document the following symbols apply.



Optical fibre connector (general)



Optical fibre connector on installed cabling



Optical fibre connector with reference termination



Joint

4 Conformance

To test installed cabling according to this International Standard:

- the general requirements of clauses 5 and 8 shall be met;
- the test equipment and test cords shall conform to the requirements of Clause 6;
- the test method, as appropriate, and treatment of results shall conform to Clauses 9 and 10;
- the test results shall be documented in accordance with 5.4;
- the requirements of IEC 60825-2 shall be met.

To inspect installed cabling according to this International Standard:

- the inspection equipment shall conform to the requirements of Clause 7;
- the inspection method, as appropriate, shall conform to Clause 11;
- the requirements of IEC 60825-2 shall be met.

Relevant national and local regulations covering safe working practices shall be observed.

5 General requirements

5.1 Test system

The test systems defined in this International Standard comprise local test equipment and remote test equipment (where required) together with cabling interface adapters which enable the connection of the test equipment to the cabling under test (see Figure 2).

The cabling interface adapters take the form of test cords together with any connecting hardware adapters that are required at the test interfaces.

The test system and, particularly the cabling interface adapters, affect the uncertainty of measurement for a given parameter.

Temporary index matching materials (gels and/or fluids) between the polished end faces of connectors shall not be used.

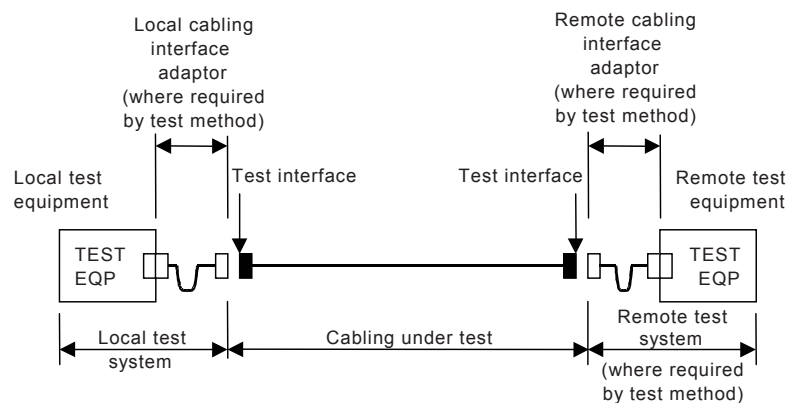


Figure 2 – The test system and the cabling under test

5.2 Normalisation and calibration

Normalisation processes are specified, where appropriate, to enable the test system to achieve the stated measurement uncertainty.

Test equipment should be calibrated using standardised procedures (e.g. IEC 61315 and IEC 61746), as appropriate.

The test operator shall have evidence, in the form of a valid calibration certificate, to support the use of the test equipment at the time the tests are undertaken.

5.3 Environmental conditions

5.3.1 Protection of transmission and terminal equipment

Transmission and terminal equipment shall be disconnected from the cabling under test before any testing or inspection according to this Standard is carried out.

5.3.2 Contamination

Dust, dirt and other contaminants at the interfaces to the cabling under test or at interfaces of the cabling interface adapter and at the interface to the test equipment may produce misleading results and in some cases damage the cabling under test.

Materials to clean the connections (such as 98 % reagent grade alcohol, appropriate cleaning solvents, lint-free wipes and clean compressed air) shall be available and used in accordance with suppliers' instructions.

Any connecting hardware adapters used together with all connector end-faces on the test cords comprising the cabling interface adapter and the cabling under test shall be cleaned according to the instructions provided by the manufacturer of the connectors. Cleaning shall be repeated every time a test cord is connected to the cabling or component under test.

Connections should be inspected with a microscope after cleaning, to verify that they are uncontaminated.

5.3.3 Use of test equipment

External effects (for example, environmental, electromagnetic or physical) can affect the test equipment and thereby influence the measured results. Test equipment shall be operated as per manufacturer's specifications.

5.3.4 Relevance of measurement

Measurements shall either

- a) be made under environmental conditions which are representative of the intended operational environment,
- b) have correction factors applied to the measured results in accordance with manufacturers' specifications in order to reflect the intended operating environment, or
- c) be documented as being performed under non-representative conditions.

5.3.5 Treatment of marginal test results

Marginal results may be treated in a number of ways including

- a) verification of the normalisation of the test system,
- b) acceptance of all marginal results,
- c) repetition of the measurement using a test system with improved measurement uncertainty.

Further guidance for the treatment of marginal results is found in ISO/IEC 14763-2.

5.4 Documentation

The documentation for each parameter shall include

- a) identification and details of the parameter,
- b) whether channel or permanent link is being tested,
- c) test equipment:
 - 1) type and manufacturer;
 - 2) serial number and calibration status;
 - 3) nominal wavelength,
- A1 d) optical fibre cabling details (fibre core size/MFD; fibre type, e.g. A1a, A1b, A1a.2, B1.1, B1.3) A1
- e) details of the cabling connector type(s),
- f) the configuration of the cabling test equipment during the test,

- g) the measured result,
- h) the applicable requirements,
- i) details of the reference numbers and direction of test,
- j) the date of the test (the time may also be recorded),
- k) the test operator,
- l) the calculated measurement uncertainty of the test system.

6 Test equipment

6.1 LSPM

6.1.1 General

Derived from IEC 61280-4-1, IEC 61280-4-2 and IEC 61300-3-4, the following has been adapted to the requirements of ISO/IEC 11801 for link and channel attenuation measurements with an LSPM.

6.1.2 Light sources

Light sources for testing multimode optical fibre (MMF) cabling and components shall conform to the spectral characteristics of Table 1.

Table 1 – MMF light source characteristics

Centre wavelength nm
850 ± 30
1 300 ± 30

Light sources for testing single-mode optical fibre (SMF) shall conform to the spectral characteristics of Table 2.

Table 2 – SMF light source characteristics

Centre wavelength nm
1 310 ± 30
1 550 ± 30

6.1.3 Power meters

The equipment shall be capable of measuring relative or absolute optical power (such as an optical power meter) and shall be designed in such a way as to make power measurements independent of modal distribution. The equipment shall enable optical power measurements to be recorded to at least one significant digit in the decimal place (for example, –14,3 dBm, 10,1 mW).

- A1** When the test set-up (LSPM) is used for a link or channel attenuation, the measurement uncertainty shall not be greater than ±0,02 dB.

When the test set-up (LSPM) is used for a field check of the reference connectors by measuring the attenuation, the measurement uncertainty should be <0,02 dB.

NOTE It is therefore recommended to use a power meter with a power resolution of at least 2 decimal places. **A1**

If the power meter consists of an optoelectronic detector with a demountable adapter then the adapter shall be fitted to the meter in accordance with the instructions provided by the supplier of the power meter.

6.1.4 Test system stability

The stability of the light source contributes directly to measurement variability. A light source shall be used in such a way that any variation in output power from the normalised values (see 5.2) shall be as specified in ISO/IEC 14763-2.

A power meter with adequate equipment temperature stability and optical power linearity to meet the desired measurement uncertainty shall be used.

NOTE Non-linearity between the measured and incident optical power may cause measurement errors. Also, equipment with internal waveguides may exhibit measurement variability with varying modal conditions.

6.2 OTDR

6.2.1 General

OTDR equipment for testing multimode optical fibre (MMF) cabling and components shall conform to the central wavelengths of Table 1.

OTDR equipment for testing single-mode optical fibre (SMF) shall conform to the central wavelengths of Table 2.

See Annex C for further information on optical fibre time domain reflectometry.

6.2.2 OTDR characterization using a launch cord only

Characterization of cabling using an OTDR with a launch cord only

- produces a characterization of the form shown in Figure 3,
 - NOTE There may not be a remote interface reflection if the far end of the optical fibre is broken or terminated with an angled interface.
 - SMF may not produce a remote interface reflection if the optical fibre is broken,
 - APC connectors may not produce a discernable reflective event,
- does not provide any continuity measurement for the cabling under test,
- provides information about the general quality of the local interface to the cabling under test, the quality of the installed cable and any embedded joints within the cabling under test,
- does not allow any quantitative measurement of the local interface to the cabling under test unless the scattering characteristics of the optical fibre within the launch cord are the same as those of the optical fibre under test,
- does not allow any quantitative measurement of embedded connecting hardware joints within the cabling under test unless the scattering characteristics of the optical fibres on either side of the embedded connecting hardware are identical or unless measurements are taken in each direction,
- cannot be used for measurement of the channel or link (see 8.1) attenuation/insertion loss as it does not provide optical attenuation measurement for the remote connector and therefore cannot provide an optical attenuation measurement for the channel or permanent link under test.

6.2.3 OTDR characterization using a launch cord and a tail cord

Characterization of cabling using an OTDR using a launch cord and a tail cord

- produces an unidirectional characterization of the form shown in Figure 4 (two traces need to be combined and evaluated),
- provides a continuity measurement for the cabling under test,
- provides information about the general quality of both the local and remote interface to the cabling under test, the quality of the installed cable and any embedded connecting hardware,
- provides quantitative measurement of the local and remote interfaces to the cabling under test using measurements taken in each direction,
- provides quantitative measurement of the channel or link (see 8.1) attenuation when the measurement is taken in one direction provided that

- the channel or link only contains a single fixed cable and terminating connectors,
- the scattering characteristics of the optical fibre within the launch and tail cords are the same,
- provides quantitative attenuation measurement of the channel, or link embedded connecting hardware (see 8.1) when the measurement is taken from two directions provided that
 - attenuation measurements of permanent links, channel or embedded connecting hardware are derived by averaging the associated bi-directional test results,
 - the distance between embedded connecting hardware is not less than the dead zone of the OTDR.

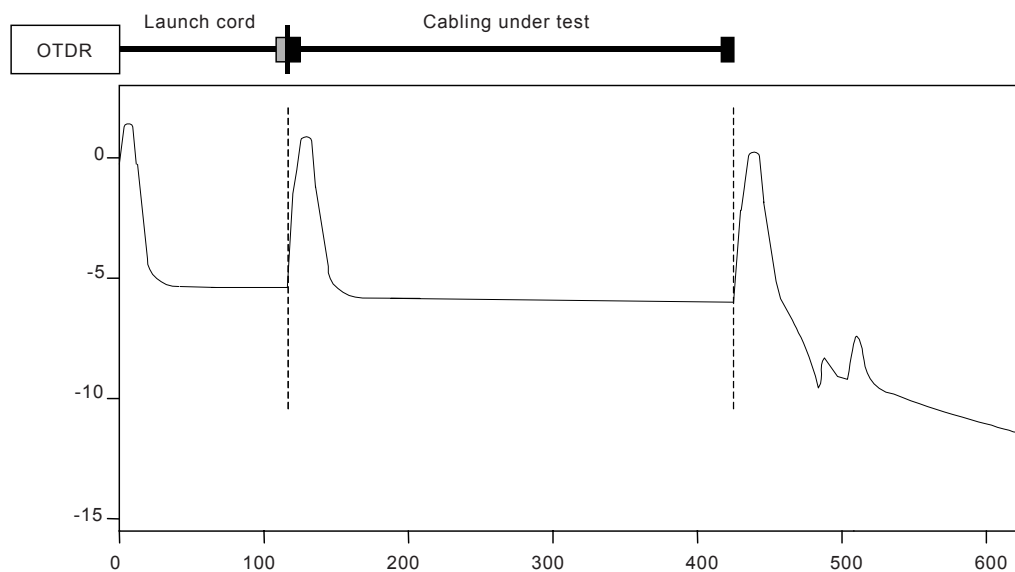


Figure 3 – OTDR characterization using a launch cord only

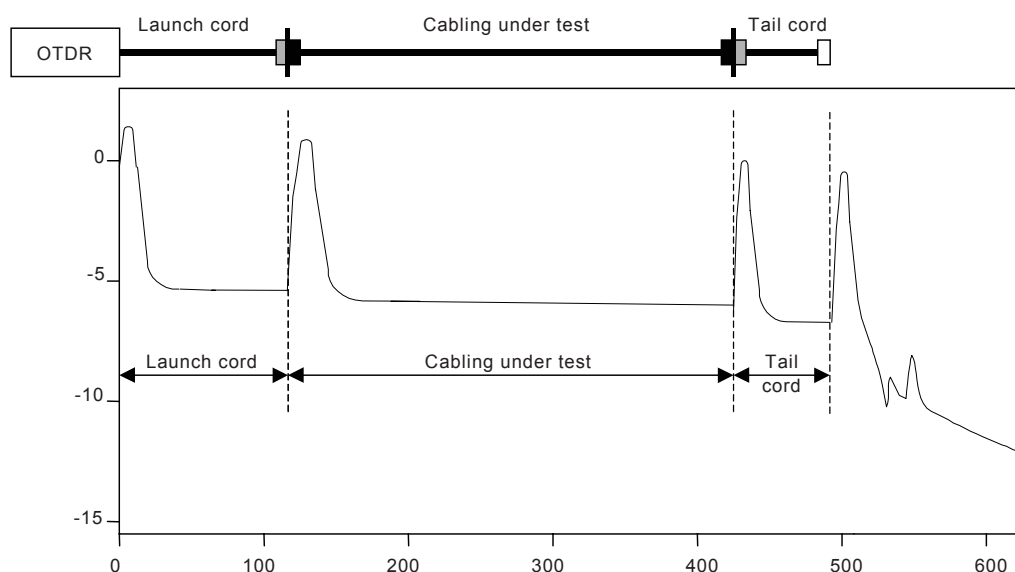


Figure 4 – OTDR characterization using a launch cord and a tail cord

6.3 Cabling interface adapters

6.3.1 Connecting hardware at test interfaces

The connecting hardware to be connected to the cabling under test (i.e. launch cords and tail cords) together with the hardware that terminates the field calibration cords and any connecting hardware adapters used as part of the test methods specified by this international Standard shall

- have the same product specification as the hardware terminating the cabling under test,
- have a controlled end face for radius, dome offset and fibre position,
 - for the duplex SC connector for MMF as specified in IEC 60874-19-1,
 - for the simplex SC connector for SMF as specified in IEC 60874-14-2,
- be of the same product as defined by the supplier where IEC specifications do not guarantee interoperability (the only interfaces specified to be interoperable are IEC 60874-14 and IEC 60874-19),
- where used, connecting hardware adapters shall be reference adapters in accordance with the relevant IEC product specification,
 - for SC MMF (duplex) as specified in IEC 60874-19-2,
 - for SC SMF (simplex) as specified in IEC 60874-14-3.

The inspection and testing of test cords and connecting hardware adapters shall be done in accordance with Annex D prior to any normalisation process being undertaken.

6.3.2 Reference connector requirements

The requirements for multimode SC reference connectors are given in IEC 60874-19-1. The requirements for single-mode SC reference connectors are given in IEC 60874-14-1.

The requirements for reference connectors of other (non-SC) cylindrical and rectangular styles are given in Table 3.

Table 3 – Non-SC reference connector requirements

	Cylindrical connector styles		Rectangular connector styles	
	MMF	SMF	MMF	SMF
Eccentricity of core centre to ferrule outer diameter	<1 µm	<0,3 µm	na	na
True position of the fibre core	na	na	<1 µm	<0,3 µm
Exit angle	≤0,2 °	≤0,2 °	≤0,2 °	≤0,2 °
Accuracy of ferrule diameter	±0,5 µm	±0,5 µm	na	na
Attenuation between 2 reference connectors	≤0,10 dB	≤0,20 dB	≤0,10 dB	≤0,20 dB

A1 When the test set-up (LSPM) is also used for a link or channel attenuation the measurement uncertainty should be <0,2 dB.

When the test set-up (LSPM) is used for a field check of the reference connectors by measuring the attenuation, the measurement uncertainty should be <0,02 dB.

NOTE It is therefore recommended to use a power meter with a power resolution of at least 2 decimal places. **A1**

6.3.3 MMF test cords

6.3.3.1 General

Each test cord shall

- contain optical fibre of the same nominal characteristics (core/cladding diameters, numerical aperture) as the optical fibre under test,
- be labelled by having a unique identifier with each connector labelled as indicated in Figure 5.