

DIN EN 61158-3-2

ICS 35.100.20; 35.160; 35.240.50

Ersatzvermerk
siehe unten**Industrielle Kommunikationsnetze –
Feldbusse –****Teil 3-2: Dienstfestlegungen des Data Link Layer (Sicherheitsschicht) –
Typ 2-Elemente (IEC 61158-3-2:2007);
Englische Fassung EN 61158-3-2:2008, nur auf CD-ROM**Industrial communication networks –
Fieldbus specifications –Part 3-2: Data-link layer service definition – Type 2 elements (IEC 61158-3-2:2007);
English version EN 61158-3-2:2008, only on CD-ROMRéseaux de communication industriels –
Spécifications des bus de terrain –Partie 3-2: Définition des services des couches de liaison de données – Eléments de
type 2 (CEI 61158-3-2:2007); Version anglais EN 61158-3-2:2008, seulement en
CD-ROM**Ersatzvermerk**

Mit DIN EN 61158-3-1:2008-09, DIN EN 61158-3-3:2008-09, DIN EN 61158-3-4:2008-09,
DIN EN 61158-3-7:2008-09, DIN EN 61158-3-8:2008-09, DIN EN 61158-3-11:2008-09,
DIN EN 61158-3-12:2008-09, DIN EN 61158-3-13:2008-09, DIN EN 61158-3-14:2008-09,
DIN EN 61158-3-16:2008-09, DIN EN 61158-3-17:2008-09, DIN EN 61158-3-18:2008-09 und
DIN EN 61158-3-19:2008-09 Ersatz für DIN EN 61158-3:2005-05
Siehe jedoch Beginn der Gültigkeit

Gesamtumfang 49 Seiten

DKE Deutsche Kommission Elektrotechnik Elektronik Informationstechnik im DIN und VDE

Beginn der Gültigkeit

Die von CENELEC am 2008-02-01 angenommene EN 61158-3-2 gilt als DIN-Norm ab 2008-09-01.

Daneben darf DIN EN 61158-3:2005-05 noch bis 2011-02-01 angewendet werden.

Nationales Vorwort

Mit DIN EN 61158-3-1:2008-09, DIN EN 61158-3-3:2008-09, DIN EN 61158-3-4:2008-09, DIN EN 61158-3-7:2008-09, DIN EN 61158-3-8:2008-09, DIN EN 61158-3-11:2008-09, DIN EN 61158-3-12:2008-09, DIN EN 61158-3-13:2008-09, DIN EN 61158-3-14:2008-09, DIN EN 61158-3-16:2008-09, DIN EN 61158-3-17:2008-09, DIN EN 61158-3-18:2008-09 und DIN EN 61158-3-19:2008-09 Ersatz für DIN EN 61158-3:2005-05.

Vorausgegangener Norm-Entwurf: E DIN EN 61158-300:2006-11.

Für diese Norm ist das nationale Arbeitsgremium K 956 „Feldbus“ der DKE Deutsche Kommission Elektrotechnik Elektronik Informationstechnik im DIN und VDE (www.dke.de) zuständig.

Die enthaltene IEC-Publikation wurde vom SC 65C „Industrial networks“ erarbeitet.

Das IEC-Komitee hat entschieden, dass der Inhalt dieser Publikation bis zu dem Datum (maintenance result date) unverändert bleiben soll, das auf der IEC-Website unter „<http://webstore.iec.ch>“ zu dieser Publikation angegeben ist. Zu diesem Zeitpunkt wird entsprechend der Entscheidung des Komitees die Publikation

- bestätigt,
- zurückgezogen,
- durch eine Folgeausgabe ersetzt oder
- geändert.

Für den Fall einer undatierten Verweisung im normativen Text (Verweisung auf eine Norm ohne Angabe des Ausgabedatums und ohne Hinweis auf eine Abschnittsnummer, eine Tabelle, ein Bild usw.) bezieht sich die Verweisung auf die jeweils neueste gültige Ausgabe der in Bezug genommenen Norm.

Für den Fall einer datierten Verweisung im normativen Text bezieht sich die Verweisung immer auf die in Bezug genommene Ausgabe der Norm.

Der Zusammenhang der zitierten Normen mit den entsprechenden Deutschen Normen ergibt sich, soweit ein Zusammenhang besteht, grundsätzlich über die Nummer der entsprechenden IEC-Publikation. Beispiel: IEC 60068 ist als Europäische Norm EN 60068 durch CENELEC übernommen und als DIN EN 60068 ins Deutsche Normenwerk aufgenommen.

Einführung

Ein Feldbus ist ein digitaler serieller Datenbus für die Kommunikation zwischen Geräten der industriellen Automatisierungstechnik wie beispielsweise Messeinrichtungen, Stellgliedern, Reglern und speicherprogrammierbaren Steuerungen. Die Normen der Reihe DIN EN 61158 legen eine Anzahl von Feldbus-Protokolltypen fest.

Die vorliegende Norm legt die nach außen sichtbaren Dienste fest, die durch den Data Link Layer des Typs 2 (ControlNet, DeviceNet) zur Verfügung gestellt werden.

Änderungen

Gegenüber DIN EN 61158-3:2005-05 wurden folgende Änderungen vorgenommen:

- a) Streichung des Typ 6-Feldbusses und des Platzhalters für einen Data Link Layer des Typ 5-Feldbusses wegen zu geringer Marktbedeutung;
- b) Hinzufügung von weiteren Feldbustypen;
- c) Aufteilung in mehrere Teile, jeweils als 3-1, 3-2, ..., 3-19 benummert.

Frühere Ausgaben

DIN V 19245-1: 1988-01
DIN 19245-1: 1991-04
DIN 19245-2: 1991-04
DIN EN 50170-1: 1997-07
DIN EN 50170-2: 1997-07
DIN EN 50170-3: 1997-07
DIN EN 50254: 1999-07
DIN EN 50170/A1: 2002-11
DIN EN 50170/A2: 2000-08
DIN EN 50170/A3: 2002-11
DIN EN 61158-3: 2005-05

– Leerseite –

Deutsche Fassung

Industrielle Kommunikationsnetze –
Feldbusse –
Teil 3-2: Dienstfestlegungen des Data Link Layer (Sicherheitsschicht) –
Typ 2-Elemente
(IEC 61158-3-2:2007)

Industrial communication networks –
Fieldbus specifications –
Part 3-2: Data-link layer service definition –
Type 2 elements
(IEC 61158-3-2:2007)

Réseaux de communication industriels –
Spécifications des bus de terrain –
Partie 3-2: Définition des services des couches
de liaison de données – Éléments de type 2
(CEI 61158-3-2:2007)

Diese Europäische Norm wurde von CENELEC am 2008-02-01 angenommen. Die CENELEC-Mitglieder sind gehalten, die CEN/CENELEC-Geschäftsordnung zu erfüllen, in der die Bedingungen festgelegt sind, unter denen dieser Europäischen Norm ohne jede Änderung der Status einer nationalen Norm zu geben ist.

Auf dem letzten Stand befindliche Listen dieser nationalen Normen mit ihren bibliographischen Angaben sind beim Zentralsekretariat oder bei jedem CENELEC-Mitglied auf Anfrage erhältlich.

Diese Europäische Norm besteht in drei offiziellen Fassungen (Deutsch, Englisch, Französisch). Eine Fassung in einer anderen Sprache, die von einem CENELEC-Mitglied in eigener Verantwortung durch Übersetzung in seine Landessprache gemacht und dem Zentralsekretariat mitgeteilt worden ist, hat den gleichen Status wie die offiziellen Fassungen.

CENELEC-Mitglieder sind die nationalen elektrotechnischen Komitees von Belgien, Bulgarien, Dänemark, Deutschland, Estland, Finnland, Frankreich, Griechenland, Irland, Island, Italien, Lettland, Litauen, Luxemburg, Malta, den Niederlanden, Norwegen, Österreich, Polen, Portugal, Rumänien, Schweden, der Schweiz, der Slowakei, Slowenien, Spanien, der Tschechischen Republik, Ungarn, dem Vereinigten Königreich und Zypern.

CENELEC

Europäisches Komitee für Elektrotechnische Normung
European Committee for Electrotechnical Standardization
Comité Européen de Normalisation Electrotechnique

Zentralsekretariat: rue de Stassart 35, B-1050 Brüssel

© 2008 CENELEC – Alle Rechte der Verwertung, gleich in welcher Form und in welchem Verfahren, sind weltweit den Mitgliedern von CENELEC vorbehalten.

Ref. Nr. EN 61158-3-2:2008 D

Vorwort

Der Text des Schriftstücks 65C/473/FDIS, zukünftige 1. Ausgabe von IEC 61158-3-2, ausgearbeitet von dem SC 65C „Industrial networks“ des IEC/TC 65 „Industrial-process measurement, control and automation“, wurde der IEC-CENELEC Parallelen Abstimmung unterworfen und von CENELEC am 2008-02-01 als EN 61158-3-2 angenommen.

Dieser und die weiteren Teile der Normenreihe EN 61158-3 ersetzen EN 61158-3:2004.

Gegenüber EN 61158-3:2004 wurden die folgenden Änderungen durchgeführt:

- Streichung des Typ 6-Feldbusses und des Platzhalters für einen Data Link Layer des Typ 5-Feldbusses wegen zu geringer Marktbedeutung;
- Hinzufügung von weiteren Feldbustypen;
- Aufteilung in mehrere Teile, jeweils als 3-1, 3-2, ..., 3-19 benummert.

Nachstehende Daten wurden festgelegt:

- spätestes Datum, zu dem die EN auf nationaler Ebene durch Veröffentlichung einer identischen nationalen Norm oder durch Anerkennung übernommen werden muss (dop): 2008-11-01
- spätestes Datum, zu dem nationale Normen, die der EN entgegenstehen, zurückgezogen werden müssen (dow): 2011-02-01

ANMERKUNG Die Anwendung einiger der aufgeführten Protokolltypen wird durch die Inhaber der Rechte an geistigem Eigentum hieran eingeschränkt. Die Zusage zur begrenzten Freigabe ihrer Rechte an geistigem Eigentum durch die Inhaber erlaubt in jedem Fall die Anwendung eines bestimmten Data Link Layer-Protokolls zusammen mit einem Physical Layer- und einem Application Layer-Protokoll in Typzusammenstellungen, die in der Normenreihe EN 61784 angegeben sind. Die Anwendung der verschiedenen Protokolltypen in anderen Zusammenstellungen erfordert möglicherweise die Erlaubnis des jeweiligen Inhabers der Rechte an dem entsprechenden geistigen Eigentum.

Der Anhang ZA wurde von CENELEC hinzugefügt.

Anerkennungsnotiz

Der Text der Internationalen Norm IEC 61158-3-2:2007 wurde von CENELEC ohne irgendeine Abänderung als Europäische Norm angenommen.

In der offiziellen Fassung sind unter „Literaturhinweise“ zu den aufgelisteten Normen die nachstehenden Anmerkungen einzutragen:

- | | | |
|---------------|-----------|---|
| IEC 61158-2 | ANMERKUNG | Harmonisiert als EN 61158-2:2008 (nicht modifiziert). |
| IEC 61158-4-2 | ANMERKUNG | Harmonisiert als EN 61158-4-2:2008 (nicht modifiziert). |
| IEC 61158-5-2 | ANMERKUNG | Harmonisiert als EN 61158-5-2:2008 (nicht modifiziert). |
| IEC 61158-6-2 | ANMERKUNG | Harmonisiert als EN 61158-6-2:2008 (nicht modifiziert). |
| IEC 61784-1 | ANMERKUNG | Harmonisiert als EN 61784-1:2008 (nicht modifiziert). |
| IEC 61784-2 | ANMERKUNG | Harmonisiert als EN 61784-2:2008 (nicht modifiziert). |

CONTENTS

INTRODUCTION	5
1 Scope	6
1.1 Overview	6
1.2 Specifications	6
1.3 Conformance	6
2 Normative references	7
3 Terms, definitions, symbols, abbreviations and conventions	7
3.1 Reference model terms and definitions	7
3.2 Service convention terms and definitions	9
3.3 Common data-link service terms and definitions	10
3.4 Additional Type 2 data-link specific definitions	11
3.5 Common symbols and abbreviations	14
3.6 Additional Type 2 symbols and abbreviations	14
3.7 Common conventions	14
4 Connection-mode and connectionless-mode data-link service	15
4.1 Overview	15
4.2 Facilities of the data-link service	19
4.3 Model of the data-link service	20
4.4 Sequence of primitives	22
4.5 Connection-mode data transfer	24
4.6 Connectionless-mode data transfer	26
4.7 Queue maintenance	29
4.8 Tag filter	31
5 DL-management Services	32
5.1 Sequence of primitives	32
5.2 Link synchronization	33
5.3 Synchronized parameter change	33
5.4 Event reports	35
5.5 Bad FCS	37
5.6 Current moderator	37
5.7 Enable moderator	38
5.8 Power-up and online	39
5.9 Listen only	40
5.10 Time distribution	41
Bibliography	43
INDEX	44
Annex ZA (normative) Normative references to international publications with their corresponding European publications	46
Figure 1 – Relationships of DLSAPs, DLSAP-addresses and group DL-addresses	10
Figure 2 – NUT structure	16
Figure 3 – Medium access during scheduled time	17
Figure 4 – Medium access during unscheduled time	18
Figure 5 – Queue model for the peer and multipoint DLS, DLSAPs and their DLCEPs	19

Figure 6 – Queue model of a multipoint DLS between a sending DLS-user and one or more receiving DLS-users	21
Figure 7 – DLS primitive time-sequence diagram	23
Figure 8 – State transition diagram for sequences of DLS primitives at one DLSAP	24
Figure 9 – Sequence of primitives for a successful connection-mode transfer	26
Figure 10 – Sequence of primitives for an unsuccessful connection-mode transfer	26
Figure 11 – Sequence of primitives for a successful connectionless-mode transfer	29
Figure 12 – Sequence of primitives for an unsuccessful connectionless-mode transfer	29
Figure 13 – Sequence of primitives for a queue maintenance request	31
Figure 14 – Sequence of primitives for a tag filter request	32
Figure 15 – Sequence of primitives for a local link synchronization	33
Figure 16 – Sequence of primitives for a DLM-get/set parameters request	35
Figure 17 – Sequence of primitives for a DLM-tMinus change request	35
Figure 18 – Sequence of primitives for a DLM-event indication	37
Figure 19 – Sequence of primitives for a DLM-bad-FCS indication	37
Figure 20 – Sequence of primitives for a DLM-current-moderator indication	38
Figure 21 – Sequence of primitives for a DLM-enable-moderator request	39
Figure 22 – Sequence of primitives for a DLM-power-up indication	40
Figure 23 – Sequence of primitives for a DLM-online request	40
Figure 24 – Sequence of primitives for a DLM-listen-only request	40
 Table 1 – Summary of connection-mode and connectionless-mode primitives and parameters	23
Table 2 – DL-connection-mode transfer primitives and parameters	25
Table 3 – DL-connectionless-mode transfer primitives and parameters	27
Table 4 – Fixed tag services available to the DLS-user	28
Table 5 – DL-queue maintenance primitives and parameters	30
Table 6 – DL-connectionless-mode tag filter primitives and parameters	31
Table 7 – Summary of DL-management primitives and parameters	32
Table 8 – Link synchronization primitives and parameters	33
Table 9 – Synchronized parameter change primitives and parameters	34
Table 10 – DLMS-configuration-data	35
Table 11 – Event report primitives and parameters	36
Table 12 – DLMS events being reported	36
Table 13 – Bad FCS primitives and parameters	37
Table 14 – Current moderator primitives and parameters	38
Table 15 – Enable moderator primitives and parameters	38
Table 16 – Power-up and online primitives and parameters	39
Table 17 – Listen-only primitives and parameters	40
Table 18 – DLMS time and time quality parameters	41
Table 19 – Time distribution source quality	42

INTRODUCTION

This standard is one of a series produced to facilitate the interconnection of automation system components. It is related to other standards in the set as defined by the “three-layer” fieldbus reference model described in IEC/TR 61158-1.

Throughout the set of fieldbus standards, the term “service” refers to the abstract capability provided by one layer of the OSI Basic Reference Model to the layer immediately above. Thus, the data-link layer service defined in this standard is a conceptual architectural service, independent of administrative and implementation divisions.

INDUSTRIAL COMMUNICATION NETWORKS – FIELDBUS SPECIFICATIONS –

Part 3-2: Data-link layer service definition – Type 2 elements

1 Scope

1.1 Overview

This part of IEC 61158 provides common elements for basic time-critical messaging communications between devices in an automation environment. The term “time-critical” is used to represent the presence of a time-window, within which one or more specified actions are required to be completed with some defined level of certainty. Failure to complete specified actions within the time window risks failure of the applications requesting the actions, with attendant risk to equipment, plant and possibly human life.

This standard defines in an abstract way the externally visible service provided by the Type 2 fieldbus data-link layer in terms of

- a) the primitive actions and events of the service;
- b) the parameters associated with each primitive action and event, and the form which they take; and
- c) the interrelationship between these actions and events, and their valid sequences.

The purpose of this standard is to define the services provided to:

- the Type 2 fieldbus application layer at the boundary between the application and data-link layers of the fieldbus reference model;
- systems management at the boundary between the data-link layer and systems management of the fieldbus reference model.

Type 2 DL-service provides both a connected and a connectionless subset of those services specified in ISO/IEC 8886.

1.2 Specifications

The principal objective of this standard is to specify the characteristics of conceptual data-link layer services suitable for time-critical communications and thus supplement the OSI Basic Reference Model in guiding the development of data-link protocols for time-critical communications. A secondary objective is to provide migration paths from previously-existing industrial communications protocols.

This specification may be used as the basis for formal DL-Programming-Interfaces. Nevertheless, it is not a formal programming interface, and any such interface will need to address implementation issues not covered by this specification, including:

- a) the sizes and octet ordering of various multi-octet service parameters;
- b) the correlation of paired request and confirm, or indication and response, primitives.

1.3 Conformance

This standard does not specify individual implementations or products, nor does it constrain the implementations of data-link entities within industrial automation systems.

There is no conformance of equipment to this data-link layer service definition standard. Instead, conformance is achieved through implementation of the corresponding data-link protocol that fulfills the Type 1 data-link layer services defined in this standard.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO/IEC 7498-1, *Information technology – Open Systems Interconnection – Basic Reference Model: The Basic Model*

ISO/IEC 7498-3, *Information technology – Open Systems Interconnection – Basic Reference Model: Naming and addressing*

ISO/IEC 8886, *Information technology – Open Systems Interconnection – Data link service definition*

ISO/IEC 10731:1994, *Information technology – Open Systems Interconnection – Basic Reference Model – Conventions for the definition of OSI services*

3 Terms, definitions, symbols, abbreviations and conventions

For the purposes of this document, the following terms, definitions, symbols, abbreviations and conventions apply.

3.1 Reference model terms and definitions

This standard is based in part on the concepts developed in ISO/IEC 7498-1 and ISO/IEC 7498-3, and makes use of the following terms defined therein:

3.1.1 DL-address	[ISO/IEC 7498-3]
3.1.2 DL-address-mapping	[ISO/IEC 7498-1]
3.1.3 called-DL-address	[ISO/IEC 7498-3]
3.1.4 calling-DL-address	[ISO/IEC 7498-3]
3.1.5 centralized multi-end-point-connection	[ISO/IEC 7498-1]
3.1.6 DL-connection	[ISO/IEC 7498-1]
3.1.7 DL-connection-end-point	[ISO/IEC 7498-1]
3.1.8 DL-connection-end-point-identifier	[ISO/IEC 7498-1]
3.1.9 DL-connection-mode transmission	[ISO/IEC 7498-1]
3.1.10 DL-connectionless-mode transmission	[ISO/IEC 7498-1]
3.1.11 correspondent (N)-entities	[ISO/IEC 7498-1]
correspondent DL-entities (N=2)	
correspondent Ph-entities (N=1)	
3.1.12 DL-duplex-transmission	[ISO/IEC 7498-1]

3.1.13	(N)-entity DL-entity (N=2) Ph-entity (N=1)	[ISO/IEC 7498-1]
3.1.14	DL-facility	[ISO/IEC 7498-1]
3.1.15	flow control	[ISO/IEC 7498-1]
3.1.16	(N)-layer DL-layer (N=2) Ph-layer (N=1)	[ISO/IEC 7498-1]
3.1.17	layer-management	[ISO/IEC 7498-1]
3.1.18	DL-local-view	[ISO/IEC 7498-3]
3.1.19	DL-name	[ISO/IEC 7498-3]
3.1.20	naming-(addressing)-domain	[ISO/IEC 7498-3]
3.1.21	peer-entities	[ISO/IEC 7498-1]
3.1.22	primitive name	[ISO/IEC 7498-3]
3.1.23	DL-protocol	[ISO/IEC 7498-1]
3.1.24	DL-protocol-connection-identifier	[ISO/IEC 7498-1]
3.1.25	DL-protocol-data-unit	[ISO/IEC 7498-1]
3.1.26	DL-relay	[ISO/IEC 7498-1]
3.1.27	reset	[ISO/IEC 7498-1]
3.1.28	responding-DL-address	[ISO/IEC 7498-3]
3.1.29	routing	[ISO/IEC 7498-1]
3.1.30	segmenting	[ISO/IEC 7498-1]
3.1.31	(N)-service DL-service (N=2) Ph-service (N=1)	[ISO/IEC 7498-1]
3.1.32	(N)-service-access-point DL-service-access-point (N=2) Ph-service-access-point (N=1)	[ISO/IEC 7498-1]
3.1.33	DL-service-access-point-address	[ISO/IEC 7498-3]
3.1.34	DL-service-connection-identifier	[ISO/IEC 7498-1]
3.1.35	DL-service-data-unit	[ISO/IEC 7498-1]
3.1.36	DL-simplex-transmission	[ISO/IEC 7498-1]
3.1.37	DL-subsystem	[ISO/IEC 7498-1]
3.1.38	systems-management	[ISO/IEC 7498-1]
3.1.39	DLS-user-data	[ISO/IEC 7498-1]

3.2 Service convention terms and definitions

This standard also makes use of the following terms defined in ISO/IEC 10731 as they apply to the data-link layer:

- 3.2.1 acceptor
- 3.2.2 asymmetrical service
- 3.2.3 confirm (primitive);
requestor.deliver (primitive)
- 3.2.4 deliver (primitive)
- 3.2.5 DL-confirmed-facility
- 3.2.6 DL-facility
- 3.2.7 DL-local-view
- 3.2.8 DL-mandatory-facility
- 3.2.9 DL-non-confirmed-facility
- 3.2.10 DL-provider-initiated-facility
- 3.2.11 DL-provider-optional-facility
- 3.2.12 DL-service-primitive;
primitive
- 3.2.13 DL-service-provider
- 3.2.14 DL-service-user
- 3.2.15 DLS-user-optional-facility
- 3.2.16 indication (primitive);
acceptor.deliver (primitive)
- 3.2.17 multi-peer
- 3.2.18 request (primitive);
requestor.submit (primitive)
- 3.2.19 requestor
- 3.2.20 response (primitive);
acceptor.submit (primitive)
- 3.2.21 submit (primitive)
- 3.2.22 symmetrical service

3.3 Common data-link service terms and definitions

NOTE Many definitions are common to more than one protocol Type; they are not necessarily used by all protocol Types.

3.3.1

DL-segment, link, local link


single DL-subnetwork in which any of the connected DLEs may communicate directly, without any intervening DL-relaying, whenever all of those DLEs that are participating in an instance of communication are simultaneously attentive to the DL-subnetwork during the period(s) of attempted communication

3.3.2

DLSAP

distinctive point at which DL-services are provided by a single DL-entity to a single higher-layer entity

NOTE This definition, derived from ISO/IEC 7498-1, is repeated here to facilitate understanding of the critical distinction between DLSAPs and their DL-addresses.

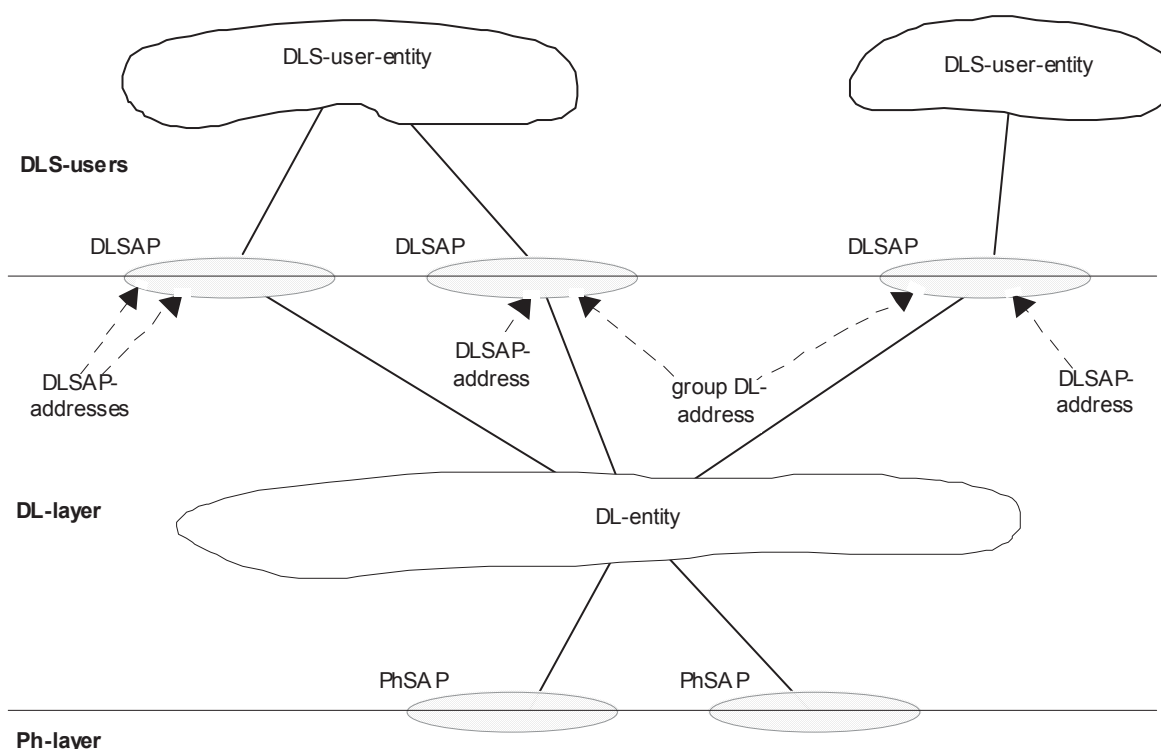

NOTE 1 DLSAPs and PhSAPs are depicted as ovals spanning the boundary between two adjacent layers.

NOTE 2 DL-addresses are depicted as designating small gaps (points of access) in the DLL portion of a DLSAP.

NOTE 3 A single DL-entity may have multiple DLSAP-addresses and group DL-addresses associated with a single DLSAP.

Figure 1 – Relationships of DLSAPs, DLSAP-addresses and group DL-addresses

3.3.3

DL(SAP)-address

either an individual DLSAP-address, designating a single DLSAP of a single DLS-user, or a group DL-address potentially designating multiple DLSAPs, each of a single DLS-user

NOTE This terminology is chosen because ISO/IEC 7498-3 does not permit the use of the term DLSAP-address to designate more than a single DLSAP at a single DLS-user.

3.3.4

(individual) DLSAP-address

DL-address that designates only one DLSAP within the extended link

NOTE A single DL-entity may have multiple DLSAP-addresses associated with a single DLSAP.

3.3.5

extended link

DL-subnetwork, consisting of the maximal set of links interconnected by DL-relays, sharing a single DL-name (DL-address) space, in which any of the connected DL-entities may communicate, one with another, either directly or with the assistance of one or more of those intervening DL-relay entities

NOTE An extended link may be composed of just a single link.

3.3.6

frame

denigrated synonym for DLPDU

3.3.7

group DL-address

DL-address that potentially designates more than one DLSAP within the extended link

NOTE A single DL-entity may have multiple group DL-addresses associated with a single DLSAP. A single DL-entity also may have a single group DL-address associated with more than one DLSAP.

3.3.8

node

single DL-entity as it appears on one local link

3.3.9

receiving DLS-user

DL-service user that acts as a recipient of DLS-user-data

NOTE A DL-service user can be concurrently both a sending and receiving DLS-user.

3.3.10

sending DLS-user

DL-service user that acts as a source of DLS-user-data

3.4 Additional Type 2 data-link specific definitions

3.4.1

application

function or data structure for which data is subscribed or published

3.4.2

behavior

indication of how the object responds to particular events. Its description includes the relationship between attribute values and services

3.4.3

bridge, DL-router

DL-relay entity which performs selective store-and-forward and routing functions to connect two or more separate DL-subnetworks (links) to form a unified DL-subnetwork (the extended link)

3.4.4

cyclic

term used to describe events which repeat in a regular and repetitive manner