

DIN EN 61968-13

ICS 35.200

**Integration von Anwendungen in Anlagen der Elektrizitätsversorgung –
Systemschnittstellen für Netzführung –
Teil 13: RDF-Austauschformat des CIM-Modells für Verteilnetze
(IEC 61968-13:2008);
Englische Fassung EN 61968-13:2008**

Application integration at electric utilities –
System interfaces for distribution management –
Part 13: CIM RDF Model exchange format for distribution (IEC 61968-13:2008);
English version EN 61968-13:2008

Intégration d'applications pour les services électriques –
Système d'interfaces pour la gestion de la distribution –
Partie 13: Format d'échange du modèle CIM RDF pour la distribution
(CEI 61968-13:2008);
Version anglaise EN 61968-13:2008

Gesamtumfang 60 Seiten

DKE Deutsche Kommission Elektrotechnik Elektronik Informationstechnik im DIN und VDE

Beginn der Gültigkeit

Die von CENELEC am 2008-09-01 angenommene EN 61968-13 gilt als DIN-Norm ab 2009-02-01.

Nationales Vorwort

Vorausgegangener Norm-Entwurf: E DIN EN 61968-13:2007-04.

Für diese Norm ist das nationale Arbeitsgremium K 952 „Netzleittechnik“ der DKE Deutsche Kommission Elektrotechnik Elektronik Informationstechnik im DIN und VDE (www.dke.de) zuständig.

Die enthaltene IEC-Publikation wurde vom TC 57 „Power systems management and associated information exchange“ erarbeitet.

Das IEC-Komitee hat entschieden, dass der Inhalt dieser Publikation bis zu dem Datum (maintenance result date) unverändert bleiben soll, das auf der IEC-Website unter „<http://webstore.iec.ch>“ zu dieser Publikation angegeben ist. Zu diesem Zeitpunkt wird entsprechend der Entscheidung des Komitees die Publikation

- bestätigt,
- zurückgezogen,
- durch eine Folgeausgabe ersetzt oder
- geändert.

Da sich die Benutzer der vorliegenden Norm der englischen Sprache als Fachsprache bedienen, wird die Englische Fassung der EN 61968-13 veröffentlicht. Für die meisten der verwendeten Begriffe existieren keine gebräuchlichen deutschen Benennungen, da sich die deutschen Anwender in der Regel ebenfalls der englischen Benennungen bedienen. Diese Norm steht nicht in unmittelbarem Zusammenhang mit Rechtsvorschriften und ist nicht als Sicherheitsnorm anzusehen.

Das Präsidium des DIN hat mit Präsidialbeschluss 1/2004 festgelegt, dass DIN-Normen, deren Inhalt sich auf internationale Arbeitsergebnisse der Informationsverarbeitung gründet, unter bestimmten Bedingungen allein in englischer Sprache veröffentlicht werden dürfen. Diese Bedingungen sind für die vorliegende Norm erfüllt.

Für den Fall einer undatierten Verweisung im normativen Text (Verweisung auf eine Norm ohne Angabe des Ausgabedatums und ohne Hinweis auf eine Abschnittsnummer, eine Tabelle, ein Bild usw.) bezieht sich die Verweisung auf die jeweils neueste gültige Ausgabe der in Bezug genommenen Norm.

Für den Fall einer datierten Verweisung im normativen Text bezieht sich die Verweisung immer auf die in Bezug genommene Ausgabe der Norm.

Der Zusammenhang der zitierten Normen mit den entsprechenden Deutschen Normen ergibt sich, soweit ein Zusammenhang besteht, grundsätzlich über die Nummer der entsprechenden IEC-Publikation. Beispiel: IEC 60068 ist als EN 60068 als Europäische Norm durch CENELEC übernommen und als DIN EN 60068 ins Deutsche Normenwerk aufgenommen.

**Application integration at electric utilities –
System interfaces for distribution management –
Part 13: CIM RDF Model exchange format for distribution
(IEC 61968-13:2008)**

Intégration d'applications
pour les services électriques –
Système d'interfaces pour la gestion
de la distribution –
Partie 13: Format d'échange du modèle
CIM RDF pour la distribution
(CEI 61968-13:2008)

Integration von Anwendungen
in Anlagen der Elektrizitätsversorgung –
Systemschnittstellen für Netzführung –
Teil 13: RDF-Austauschformat
des CIM-Modells für Verteilnetze
(IEC 61968-13:2008)

This European Standard was approved by CENELEC on 2008-09-01. CENELEC members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration.

Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the Central Secretariat or to any CENELEC member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CENELEC member into its own language and notified to the Central Secretariat has the same status as the official versions.

CENELEC members are the national electrotechnical committees of Austria, Belgium, Bulgaria, Cyprus, the Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, the Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and the United Kingdom.

CENELEC

European Committee for Electrotechnical Standardization
Comité Européen de Normalisation Electrotechnique
Europäisches Komitee für Elektrotechnische Normung

Central Secretariat: rue de Stassart 35, B - 1050 Brussels

Foreword

The text of document 57/930/FDIS, future edition 1 of IEC 61968-13, prepared by IEC TC 57, Power systems management and associated information exchange, was submitted to the IEC-CENELEC parallel vote and was approved by CENELEC as EN 61968-13 on 2008-09-01.

The following dates were fixed:

- latest date by which the EN has to be implemented
at national level by publication of an identical
national standard or by endorsement (dop) 2009-06-01
- latest date by which the national standards conflicting
with the EN have to be withdrawn (dow) 2011-09-01

Annex ZA has been added by CENELEC.

Endorsement notice

The text of the International Standard IEC 61968-13:2008 was approved by CENELEC as a European Standard without any modification.

CONTENTS

INTRODUCTION.....	5
1 Scope	6
2 Normative references	7
3 Future standards documents related to this part	8
4 CIM RDF describing distribution networks	8
5 Issues related to partial-phase devices modeling.....	9
5.1 General.....	9
5.2 Impedances of unbalanced and partial phase devices	9
5.3 Switches	9
5.4 Partial phase continuity in radial networks.....	9
6 CIM classes used and corresponding RDF	10
6.1 General.....	10
6.2 BaseVoltage and VoltageLevel.....	10
6.3 Containment hierarchy roots	11
6.4 HV/MV substation.....	11
6.5 MV/MV substation.....	11
6.6 MV/LV substation	12
6.7 Junction	12
6.8 Switch).....	13
6.9 Bay	13
6.10 BusbarSection	14
6.11 PowerTransformer	15
6.12 MV/MV transformer.....	16
6.13 Line.....	16
6.14 ACLineSegment.....	18
6.15 WireArrangement.....	18
6.16 Compensator	20
6.17 StaticVarCompensator	20
6.18 EquivalentLoad.....	21
6.19 Using CustomerLoad, GeneratingUnit and SynchronousMachine to model Distributed Energy Resource	22
6.20 GeneratingUnit	23
6.21 SynchronousMachine.....	23
6.22 HostControlArea	24
6.23 SubControlArea	24
7 Adequation between IEC 61968-3 (CDPSM) and IEC 61968-4	24
8 Adequation between CDPSM and CPSM	25
Annex A (informative) CIM XML Document from Langdale	26
Annex B (informative) Comparison between CIM RDF and CIM XSD (ISO ITC Working Group Architecture)	29
Annex C (informative) Key discussion points on CIM RDF and CIM XSD (ISO ITC Working Group Architecture)	31
Annex D (informative) Conclusions and recommendations (ISO ITC Working Group Architecture).....	32
Annex E (informative) Example of a European distribution network described through CIM RDF	33

Annex F (informative) Example of a North American distribution network 41

Annex G (informative) Comparison between CDPSM and CPSM.....43

Bibliography 57

Annex ZA (normative) Normative references to international publications
with their corresponding European publications.....58

Figure 1 – XML-based DMS network data configuration 7

Figure 2 – Connectivity of BusbarSection 14

Figure E.1 – European distribution network example 34

Figure F.1 – North American distribution network example.....42

Table 1 – Header of NetworkDataSet message type 24

Table 2 – Message Payload of NetworkDataSet message type 25

INTRODUCTION

The IEC 61968 series of standards is intended to facilitate inter-application integration as opposed to intra-application integration. Intra-application integration is aimed at programs in the same application system, usually communicating with each other using middleware that is embedded in their underlying runtime environment, and tends to be optimized for close, real-time, synchronous connections and interactive request/reply or conversation communication models. IEC 61968, by contrast, is intended to support the inter-application integration of a utility enterprise that needs to connect disparate applications that are already built or new (legacy or purchased applications), each supported by dissimilar runtime environments. Therefore, these interface standards are relevant to loosely coupled applications with more heterogeneity in languages, operating systems, protocols and management tools. This series of standards is intended to support applications that need to exchange data every few seconds, minutes, or hours rather than waiting for a nightly batch run. This series of standards, which are intended to be implemented with middleware services that exchange messages among applications, will complement, not replace utility data warehouses, database gateways, and operational stores.

As used in IEC 61968, a DMS consists of various distributed application components for the utility to manage electrical distribution networks. These capabilities include monitoring and control of equipment for power delivery, management processes to ensure system reliability, voltage management, demand-side management, outage management, work management, automated mapping and facilities management. Standards interfaces are defined for each class of applications identified in the Interface Reference Model (IRM), which is described in IEC 61968-1.

APPLICATION INTEGRATION AT ELECTRIC UTILITIES – SYSTEM INTERFACES FOR DISTRIBUTION MANAGEMENT –

Part 13: CIM RDF Model exchange format for distribution

1 Scope

This part of IEC 61968 specifies the format and rules for exchanging modeling information based upon the CIM (Common Information Model) and related to distribution network data.

The intention of this part of IEC 61968 is to allow the exchange of instance data in bulk. Thus, the imported network model data should be sufficient to allow performing network connectivity analysis, including network tracing, outage analysis, load flow calculations, etc. This part could be used for synchronizing geographical information system databases with remote control system databases.

This part is closely linked to IEC 61970-452 Energy Management System Application Program Interface (EMS-API) CIM Network applications model exchange specification. Thus, this document has been written in order to reduce its maintenance. It describes only differences with IEC 61970-452. Nevertheless, as IEC 61970-452 is a future international standard, this part still has duplicate information with IEC 61970-452, in order to be more understandable.

It uses the CIM RDF¹⁾ Schema presented in IEC 61970-501 as the meta-model framework for constructing XML²⁾ documents containing power system modeling information. The syntax of these documents is called CIM XML format. Model exchange by file transfer serves many useful purposes, specially when some applications need to have the complete network model defined. Though the format can be used for general CIM-based information exchange, in this part of IEC 61968, specific profiles (or subsets) of the CIM are identified in order to address particular exchange requirements.

Given the CIM RDF Schema described in IEC 61970-501, a DMS power system model can be converted for export as an XML document, see Figure 1. This document is referred to as a CIM XML document. All of the tags (resource descriptions) used in the CIM XML document are supplied by the CIM RDF schema. The resulting CIM XML model exchange document can be parsed and the information imported into a foreign system. This part of IEC 61968 is aligned to CIM Model version 11, CPSM 3.0 profile.

1) RDF: Resource Description Framework.

2) XML: eXtensible Markup Language.

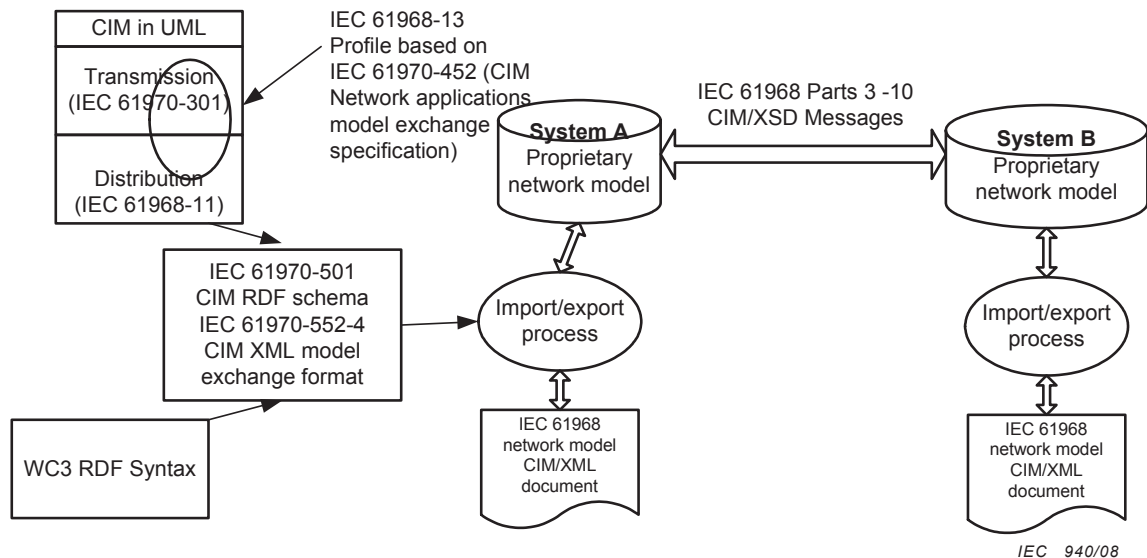


Figure 1 – XML-based DMS network data configuration

Similar to using any programming language, implementers have many choices when creating a CIM XML document. The RDF syntax itself can be used in several ways to achieve the same basic result. The way one approaches the CIM RDF Schema can yield various forms when producing a CIM XML document. The following clauses discuss the style guidelines for producing a CIM XML document. Such guideline rules are important to communicate and follow when producing these documents because they simplify and facilitate the software written to unambiguously interpret the model information.

Some comparisons have been made between CIM RDF and CIM XSD. Annexes A, B, C and D are extracted from articles and documents discussing CIM RDF and CIM XSD. A distribution management system can use only a CIM XSD message types architecture, but CIM RDF has three advantages:

- A UML model is a graph model and RDF helps to describe the graph model. XSD describes a hierarchical model which suits the message type approach.
- RDF is more readable and understandable by people working in the electrotechnical field.
- It is a basic requirement to build ontologies.

If required, tools would ensure the compatibility between CIM-RDF and, for instance, IEC 61968-4 and IEC 61968-3 message types concerning distribution network model representation.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 61968-1, *Application integration at electric utilities – System interfaces for distribution management – Part 1: Interface architecture and general requirements*

IEC 61968-3, *Application integration at electric utilities – System interfaces for distribution management – Part 3: Interface for network operations*

IEC 61968-4, *Application integration at electric utilities – System interfaces for distribution management – Part 4: Interfaces for records and asset management*

IEC 61970-301, *Energy management system application program interface (EMS-API) – Part 301: Common Information Model (CIM) base*

IEC 61970-501, *Energy management system application program interface (EMS-API) – Part 501: Common Information Model Resource Description Framework (CIM RDF) schema*

3 Future standards documents related to this part

The following documents are taken into account even if they have not been published as FDIS yet.

Extensions to CIM for Distribution: IEC 61968-11.

This document is used during interoperability tests: IEC 61970-452.

IEC 61970-552-4, *EMS-API – Part 552-4: CIM XML Model Exchange Format*.

4 CIM RDF describing distribution networks

In this part of the IEC 61968 standard, the object is to describe a CIM RDF model for the Distribution networks. It has the same objective as the NERC Common Power System Model (CPSM) Profile that has been agreed to at the Transmission level (reference: <http://www.w3.org/TR/2004/REC-rdf-primer-20040210> subclause 6.5, and IEC 61970-452). At the distribution level, several kinds of application exist such as Network Operation, Asset Management, Customer Information, Network Planning, Work Management, etc. Efforts on standardization of these applications are conducted at the IEC through the Technical Committee 57. For more information, refer to <http://www.cimuser.org> web site.

Electric utilities use power system models for a number of different purposes. For example, power system simulations are developed for planning and security analysis. An operational power system model may consist of thousands of classes of information. In addition to using these models in-house, applications inside an individual utility need to exchange system modelling information, both for planning and operational purposes (e.g. coordinating transmission and distribution networks and ensuring reliable operations). However, individual utilities use different software packages for these purposes. As a result, the system models are stored in different formats, making exchange among these models difficult. The exchange of model data is difficult and requires specific interface development for data exchange between each pair of applications. Consequently, the individual utilities recognize the need to agree on common definitions of the power system entities and relationships to facilitate the future data exchange requirements.

The CIM defines most of objects inside an electric utility as classes and attributes, as well as the relationships among them. The CIM uses these object classes, their attributes and relationships to support the integration of independently developed applications among vendor specific DMS applications. CIM represents a canonical data model to support data exchange between each part of a DMS system such as asset management, distribution planning, etc.

Based on the NERC CPSM Profile for the transmission network, this part of IEC 61968 proposes a CIM-RDF profile for modelling Distribution networks. This part of IEC 61968 defines a CDPSM profile (Common Distribution Power System Model). IEC 61968-13 will mention the differences between this part of IEC 61968 and CPSM profile when they occur.

The data intended for initial configuration of distribution network applications includes the applications such as distribution load flow calculation, dynamic network coloring, stability studies due to the impact of Distributed Energy Resources on Distribution Networks, Distribution remote control system data management, exchange of data between TSO (Transmission System Operator) and DSO (Distribution System Operator), etc.

Consequently, the proposal is mainly based on IEC 61970-301, without, at the present time, the Asset classes found in IEC 61968-11. In the future, assetType attribute of Asset class will be used instead of PsrType if CIM IEC 61968-11 is normalized and incorporated officially in the CIM. In this part of IEC 61968, class Location is defined in the IEC 61968-11 packages.

This part of IEC 61968 is valid for three-phase balanced and unbalanced distribution networks. It is described as a single phase network and may have single- or two-phase components such as single-phase laterals and transformers³⁾. However, some users may find it convenient to restrict the proposed profile to include only the subset of three-phase balanced networks and exclude support for single phase components. In the Clauses which follow, the term “partial-phase devices” is used to describe components having less than three phases.

5 Issues related to partial-phase devices modeling

5.1 General

The IEC 61970-301 standard already has support for partial phase conducting devices through the phase-code attribute which may be a combination of any or all of the letters A, B, C, and N. In general, one can think of a partial phase conducting device as being the same as a full 3-phase device with some of the phases missing.

5.2 Impedances of unbalanced and partial phase devices

IEC 61970-301 specifies impedance of conducting devices in terms of the real and reactive positive and zero sequence impedance. Unfortunately, this is only valid for perfectly symmetric three-phase networks where all 3 phases have the same value of self-impedance and the same mutual impedance value.

The impedance of unbalanced 3-phase conducting devices such as AC line segments shall be specified as a three by three complex matrix where the diagonal terms specify the self impedance of each phase and the off-diagonal terms specify the mutual impedance between each phase pair. These values can be computed using Carson’s equations based on the geometric mean radius, the linear resistance and the geometric arrangement of the three phases on the pole. IEC 61970-301 provides all the parameters necessary in the Conductor and WireArrangement classes. For 2-phase devices, the impedance matrix is two by two and for single-phase devices, it is a complex scalar specifying the self impedance of the single phase conductor.

5.3 Switches

IEC 61970-301 allows only two states for a switch device, i.e. open and closed. Thus for a 3-phase switch, it suggests that all three phases of the switch always operate together and it does not support the situation where, for example, phase A of the switch is open while phases B and C are closed. Of course, a single-phase switch may be open or closed.

5.4 Partial phase continuity in radial networks

Many distribution networks are operated radially, meaning that there is only one path for power to be supplied to any conducting device. For all phases of a device in a radial network to be properly energized, all devices upstream shall have the same phases present. (For example, it is not possible to energize all the phases of a three phase device via a partial phase upstream device.)

However, this requirement is not enforced in this part of IEC 61968. Rather, it is up to the importing DMS to check if this requirement is satisfied throughout the network.

³⁾ The USA radial electric distribution system is typically unbalanced. The main distribution feeder is three-phased with single-phased tapped load. The model exchange format should support a three-phased, unbalanced model to support, as an example, unbalanced load flow calculations.

6 CIM classes used and corresponding RDF

6.1 General

There is a large variety of voltage combinations in a substation. In addition, substations may generally contain one, two or more voltage levels. The applications needing such “substation type” information will deduce the substation type from the voltage levels it contains.

In general, substations may contain one, two or more voltage levels, the substation type will be deduced by analyzing the voltage levels a substation contains. The class PSRType can be used to distinguish these different substations. Class Location can be used to define the absolute position of a Substation.

Annex E gives a complete example of a Distribution Network Data represented through CIM-RDF. It should be pointed out that this complete example has been successfully tested during CIM interoperability tests conducted by EPRI in 2004, 2005, and 2006.

From the standpoint of a data producer (exporter), the document describes a minimum subset of CIM classes and class data which must be present in an XML formatted data file to comply with CDPSM Minimum Data Requirements. From the standpoint of a data recipient (importer), the document describes a subset of the CIM that an importer could reasonably expect to receive in an XML data file designed to be compliant with the CDPSM Minimum Data Requirements (see IEC 61970-501).

6.2 BaseVoltage and VoltageLevel

For every operating voltage found in the network, a BaseVoltage is created. An ACLineSegment is associated to a BaseVoltage. A TransformerWinding is associated to a BaseVoltage. PowerTransformer should be contained in a Substation.

Every Substation is associated with one or more VoltageLevel-s, each of which is in turn associated with the corresponding BaseVoltage.

All the objects of the network, except ACLineSegment, PowerTransformer and Transformer Winding should be contained within a VoltageLevel.

```

<cim:BaseVoltage rdf:ID="BaseVoltage_1">
  <cim:BaseVoltage.nominalVoltage>63</cim:BaseVoltage.nominalVoltage>
</cim:BaseVoltage>

<cim:BaseVoltage rdf:ID="BaseVoltage_2">
  <cim:BaseVoltage.nominalVoltage>42</cim:BaseVoltage.nominalVoltage>
</cim:BaseVoltage>

<cim:VoltageLevel rdf:ID="VL_1">
  <cim:Naming.name>NOD10S61</cim:Naming.name>
  <cim:VoltageLevel.MemberOf_Substation rdf:resource="#Substation_1"/>
  <cim:VoltageLevel.BaseVoltage rdf:resource="#BaseVoltage_1"/>
</cim:VoltageLevel>

<cim:VoltageLevel rdf:ID="VL_2">
  <cim:Naming.name>NOD10S62</cim:Naming.name>
  <cim:VoltageLevel.MemberOf_Substation rdf:resource="#Substation_1"/>
  <cim:VoltageLevel.BaseVoltage rdf:resource="#BaseVoltage_2"/>
</cim:VoltageLevel>

```

6.3 Containment hierarchy roots

The CPSM 2.0 profile of base CIM defines HostControlArea to be at the root of containment hierarchy. In contrast, this specification defines HV/MV Substation as the root of the containment hierarchy.

6.4 HV/MV substation

The containment hierarchy begins by HV/MV Substation.

```

<cim:Substation rdf:ID="Substation_1">
  <cim:Naming.name>AIGÜE_HVMV</cim:Naming.name>
  <cim:Substation.PSRType rdf:resource="#PSRType_1">
</cim:Substation>

<cim:PSRType rdf:ID="PSRType_1">
  <cim:Naming.name>HV/MV Substation</cim:Naming.name>
</cim:PSRType>

<cim:Location rdf:ID="Location_1">
  <cim:Location.PowerSystemResource rdf:resource="#Substation_1">
</cim:Location>

<cim:GmlPosition rdf:ID="CP_1">
  <cim:GmlPosition.xPosition>910700</cim:GmlPosition.xPosition>
  <cim:GmlPosition.yPosition>66270</cim:GmlPosition.yPosition>
  <cim:Location rdf:resource="#Location_1">
</cim:GmlPosition>

```

6.5 MV/MV substation

```

<cim:Substation rdf:ID="Substation_2">
  <cim:Naming.name>AIGÜE_MVMV</cim:Naming.name>
  <cim:Substation.PSRType rdf:resource="#PSRType_2">
</cim:Substation>

<cim:PSRType rdf:ID="PSRType_2">
  <cim:Naming.name>MV/MV Substation</cim:Naming.name>
</cim:PSRType>

<cim:Location rdf:ID="Location_2">
  <cim:Location.PowerSystemResource rdf:resource="#Substation_2">
</cim:Location>

<cim:GmlPosition rdf:ID="CP_1">
  <cim:GmlPosition.xPosition>910700</cim:GmlPosition.xPosition>
  <cim:GmlPosition.yPosition>66270</cim:GmlPosition.yPosition>
  <cim:Location rdf:resource="#Location_2">
</cim:GmlPosition>

```

6.6 MV/LV substation

```
<cim:Substation rdf:ID="Substation_205">
  <cim:Naming.name>AIGUE_MVLV</cim:Naming.name>
  <cim:Substation.PSRTType rdf:resource="#PSRTType_3">
</cim:Substation>

<cim:PSRTType rdf:ID="PSRTType_3">
  <cim:Naming.name>MV/LV Substation </cim:Naming.name>
</cim:PSRTType>

<cim:Location rdf:ID="Location_3">
  <cim:Location.PowerSystemResource rdf:resource="#Substation_3">
</cim:Location>

<cim:GmlPosition rdf:ID="CP_1" >
  <cim:GmlPosition.xPosition>910700</cim:GmlPosition.xPosition>
  <cim:GmlPosition.yPosition>66270</cim:GmlPosition.yPosition>
  <cim:Location rdf:resource="#Location_3">
</cim:GmlPosition>
```

If HV/LV Substation and LV/LV Substation have to be modeled, they will follow the same principles as above.

In IEC 61968-13, all conducting equipment shall be a member of either a substation or of a feeder. Normally, all substation equipment is housed in a physical enclosure such as a building or a fenced area. A feeder is generally outside a physical enclosure and consists of a collection, or connected set, of AC line segments, switches, transformers (which may or may not be considered as a substation), etc. See further discussion of the feeder container object under "Line" later in this document.

In addition, IEC 61968-13 shall support generalized equipment containers to group a set of connected conducting devices – for example the CompositeSwitch device of IEC 61970-301.

6.7 Junction

In the CIM, devices are connected to each other by connecting a terminal of a device to a common ConnectivityNode. A connectivity node may have any number of terminals connected to it.

In a Distribution network, most ConnectivityNodes are contained in substations. However, in some cases (e.g. a tapped distribution line), ConnectivityNodes may be located on lines which are outside of substations. IEC 61970-301 defines the Junction class to indicate such connectivity nodes. In this case, the ConnectivityNode and the Junction shall be located in a virtual Substation.

However, a typical distribution network generally has many connectivity nodes outside of substations along a feeder. Since these connectivity nodes serve no purpose other than to connect two or more devices, it is generally not necessary to also specify them as a Junction.

6.8 Switch⁴⁾

Switches are contained either by VoltageLevel or by Bay. If Switches are contained by VoltageLevel, Bay is not required. The abstract Switch is used only when we do not know the detailed class.

IEC 61968-13 supports the following kinds of Switch devices:

Breaker (exists in CPSM): able to interrupt fault currents greater than normal load currents.

LoadBreakSwitch (exists in CPSM): able to interrupt normal load currents only.

Disconnecter (exists in CPSM): no current interrupt capability.

Fuse (does not exist in CPSM): able to interrupt fault currents.

Jumper (does not exist in CPSM).

GroundDisconnecter (does not exist in CPSM).

```
<cim:BaseVoltage rdf:ID="BaseVoltage_1">
  <cim:BaseVoltage.nominalVoltage>63</cim:BaseVoltage.nominalVoltage>
</cim:BaseVoltage>

<cim:VoltageLevel rdf:ID="VL_1">
  <cim:Naming.name>NOD10S61</cim:Naming.name>
  <cim:VoltageLevel.MemberOf_Substation rdf:resource="#Substation_1"/>
  <cim:VoltageLevel.BaseVoltage rdf:resource="#BaseVoltage_1"/>
</cim:VoltageLevel>

<cim:Substation rdf:ID="Substation_10">
  <cim:Naming.name>AIGUE_HVMV</cim:Naming.name>
  <cim:Substation.PSRTType rdf:resource="#PSRTType_1">
</cim:Substation>

<cimBreaker rdf:ID="Switch_1">
  <cim:Naming.name>73109J0001</cim:Naming.name>
  <cim:Switch.normalOpen>false</cim:Switch.normalOpen>
  <cim:Equipment.MemberOf_EquipmentContainer rdf:resource="#VL_1">
</cim:Breaker>

<cim:Location rdf:ID="Location_5">
  <cim:Location.PowerSystemResource rdf:resource="#Substation_1">
</cim:Location>

<cim:GmlPosition rdf:ID="CP_1">
  <cim:GmlPosition.xPosition>909255.1</cim:GmlPosition.xPosition>
  <cim:GmlPosition.yPosition>56999</cim:GmlPosition.yPosition>
  <cim:Location rdf:resource="#Location_5">
</cim:GmlPosition>
```

6.9 Bay

IEC 61970-301 supports the Bay object as a collection or container of a set of switch devices and connectivity nodes inside a substation. Generally, a substation will contain several, usually identical, bays containing connectivity nodes for incoming or outgoing lines (feeders). Outgoing and incoming feeders are distinguished by the class PSRTType. (PSRTType and Location are not mandatory).

⁴⁾ This should be forbidden, as switch is an abstract class.

This data is not mandatory. If Switches are contained by VoltageLevel, Bay is not required.

```
<cim:BaseVoltage rdf:ID="BaseVoltage_1">
  <cim:BaseVoltage.nominalVoltage>63</cim:BaseVoltage.nominalVoltage>
</cim:BaseVoltage>

<cim:VoltageLevel rdf:ID="VL_1">
  <cim:Naming.name>NOD10S61</cim:Naming.name>
  <cim:VoltageLevel.MemberOf_Substation rdf:resource="#Substation_1"/>
  <cim:VoltageLevel.BaseVoltage rdf:resource="#BaseVoltage_1"/>
</cim:VoltageLevel>

<cim:Substation rdf:ID="Substation_10">
  <cim:Naming.name>AIGUE_HVMV</cim:Naming.name>
  <cim:Substation.PSRTtype rdf:resource="#PSRTtype_1">
</cim:Substation>

<cim:Bay rdf:ID="Bay_1">
  <cim:Naming.name>AIGUEC0601</cim:Naming.name>
  <cim:Bay.MemberOf_Substation rdf:resource="#VL_1">
  <cim:PowerSystemResource.PSRTtype rdf:resource="#PSRTtype_5">
</cim:Bay>

<cim:PSRTtype rdf:ID="PSRTtype_5">
  <cim:Naming.name>OUTGOING FEEDER</cim:Naming.name>
</cim:PSRTtype>

<cim:Breaker rdf:ID="Breaker_1">
  <cim:Naming.name>AIGUEC0601</cim:Naming.name>
  <cim:Switch.normalOpen>false</cim:Switch.normalOpen>
  <cim:Equipment.MemberOf_EquipmentContainer rdf:resource="#Bay_1">
</cim:Breaker>

<cim:Location rdf:ID="Location_6">
  <cim:Location.PowerSystemResource rdf:resource="#Bay_1">
</cim:Location>

<cim:GmlPosition rdf:ID="CP_1">
  <cim:GmlPosition.xPosition>910696</cim:GmlPosition.xPosition>
  <cim:GmlPosition.yPosition>66272</cim:GmlPosition.yPosition>
  <cim:Location rdf:resource="#Location_6">
</cim:GmlPosition>
```

6.10 BusbarSection

Figure 2 describes the connectivity of a BusbarSection which has only one Terminal.

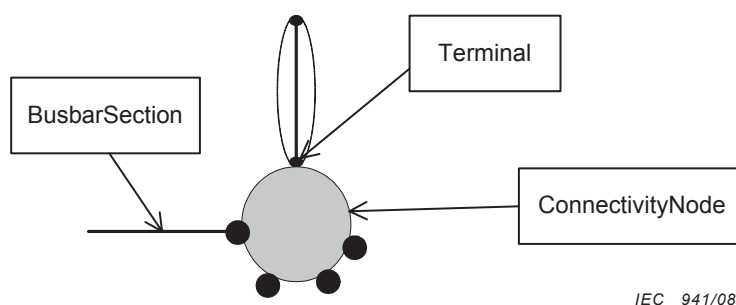


Figure 2 – Connectivity of BusbarSection

```

<cim:BaseVoltage rdf:ID="BaseVoltage_1">
  <cim:BaseVoltage.nominalVoltage>63</cim:BaseVoltage.nominalVoltage>
</cim:BaseVoltage>

<cim:VoltageLevel rdf:ID="VL_1">
  <cim:Naming.name>NOD10S61</cim:Naming.name>
  <cim:VoltageLevel.MemberOf_Substation rdf:resource="#Substation_1"/>
  <cim:VoltageLevel.BaseVoltage rdf:resource="#BaseVoltage_1"/>
</cim:VoltageLevel>

<cim:Substation rdf:ID="Substation_10">
  <cim:Naming.name>AIGUE_HVMV</cim:Naming.name>
  <cim:Substation.PSRTtype rdf:resource="#PSRTtype_1">
</cim:Substation>

<cim:BusbarSection rdf:ID="BusbarSection_1">
  <cim:Naming.name>AIGUEB0001</cim:Naming.name>
  <cim:Equipment.MemberOf_EquipmentContainer rdf:resource="#VL_1">
</cim:BusbarSection>
<cim:Terminal rdf:ID="Terminal_1">
  <cim:Terminal.ConductingEquipment rdf:resource="#BusbarSection_1"/>
  <cim:Terminal.ConnectivityNode rdf:resource="#CN_1"/>
</cim:Terminal>

<cim:ConnectivityNode rdf:ID="CN_1">
  <cim:ConnectivityNode.MemberOf_EquipmentContainer rdf:resource="#Substation_1">
</cim:ConnectivityNode>

<cim:Location rdf:ID="Location_7">
  <cim:Location.PowerSystemResource rdf:resource="#BusbarSection_1">
</cim:Location>

<cim:GmlPosition rdf:ID="CP_1">
  <cim:GmlPosition.xPosition>910720</cim:GmlPosition.xPosition>
  <cim:GmlPosition.yPosition>66290</cim:GmlPosition.yPosition>
  <cim:Location rdf:resource="#Location_7">
</cim:GmlPosition>

```

6.11 PowerTransformer

IEC 61968-13 supports transformer objects and their tap changers exactly as defined in IEC 61970-301.

While an Autotransformer in reality does not have two distinct windings, it is acceptable in IEC 61968-13 to model it as having two windings similar to conventional transformers in order to define the voltage ratio. However, in distribution systems, line voltage regulators are sometimes used to compensate for line voltage drop. Line voltage regulators frequently are Autotransformers which have a nominal 1:1 voltage ratio, but generally operate at slightly off-nominal taps to provide a voltage boost. There is a special problem defining the leakage impedance of such devices since at nominal tap position, the leakage impedance is essentially zero. Therefore for autotransformers with a nominal 1:1 voltage ratio, the leakage impedance shall be defined with the tap at maximum tap position.

There are dozens of distribution transformer winding configurations which cannot be simply transformed into Y-Y equivalents as is commonly done for balanced transmission modeling. Therefore, more information is needed than is provided below in order to accurately model many transformer types. However, comprehensive transformer modeling would push the size and detail of the profile beyond practical usability. Depending on the need, Kersting IEEE models could be used as a guide to an appropriate level of transformer detail to extend this profile.

The associations for PowerTransformer containment are:

Substation -> PowerTransformer -> TransformerWinding

The TransformerWinding -> BaseVoltage link should be used. The model needs only BaseVoltage instances that correspond to TransformerWinding's voltage levels.

```

<cim:BaseVoltage rdf:ID="BaseVoltage_2">
  <cim:BaseVoltage.nominalVoltage>42</cim:BaseVoltage.nominalVoltage>
</cim:BaseVoltage>

<cim:BaseVoltage rdf:ID="BaseVoltage_3">
  <cim:BaseVoltage.nominalVoltage>20</cim:BaseVoltage.nominalVoltage>
</cim:BaseVoltage>

<cim:PowerTransformer rdf:ID="PowerTransformer_1">
  <cim:Naming.name>AIGUEY0001</cim:Naming.name>
  <cim:PowerTransformer.MemberOf_Substation rdf:resource="#SubStation_1">
</cim:PowerTransformer>

<cim:TransformerWinding rdf:ID="TransformerWinding_1">
  <cim:TransformerWinding.MemberOf_PowerTransformer rdf:resource="#PowerTransformer_1">
  <cim:ConductingEquipment.BaseVoltage rdf:resource="#BaseVoltage_2"/>
  <cim:TransformerWinding.windingType rdf:resource="http://iec.ch/TC57/2005/CIM-schema-cim10#WindingType.primary"/>
  <cim:TransformerWinding.ratedKV>42</cim:TransformerWinding.ratedKV>
  <cim:TransformerWinding.ratedMVA>20</cim:TransformerWinding.ratedMVA>
  <cim:TransformerWinding.r>0.068</cim:TransformerWinding.r>
  <cim:TransformerWinding.x>1.89</cim:TransformerWinding.x>
  <cim:TransformerWinding.g>29</cim:TransformerWinding.g>
  <cim:TransformerWinding.shortTermMVA>22</cim:TransformerWinding.shortTermMVA >
</cim:TransformerWinding>

<cim:TransformerWinding rdf:ID="TransformerWinding_2">
  <cim:TransformerWinding.MemberOf_PowerTransformer rdf:resource="#PowerTransformer_1">
  <cim:ConductingEquipment.BaseVoltage rdf:resource="#BaseVoltage_3"/>
  <cim:TransformerWinding.windingType rdf:resource="http://iec.ch/TC57/2005/CIM-schema-cim10#WindingType.secondary"/>
  <cim:TransformerWinding.ratedKV>20</cim:TransformerWinding.ratedKV>
  <cim:TransformerWinding.ratedMVA>20</cim:TransformerWinding.ratedMVA>
  <cim:TransformerWinding.r>0.08 </cim:TransformerWinding.r>
  <cim:TransformerWinding.x>1.2</cim:TransformerWinding.x>
  <cim:TransformerWinding.g>29</cim:TransformerWinding.g>
  <cim:TransformerWinding.shortTermMVA>22</cim:TransformerWinding.shortTermMVA >
</cim:TransformerWinding>

<cim:Location rdf:ID="Location_8">
  <cim:Location.PowerSystemResource rdf:resource="#PowerTransformer_1">
</cim:Location>

<cim:GmlPosition rdf:ID="CP_1">
  <cim:GmlPosition.xPosition>910720</cim:GmlPosition.xPosition>
  <cim:GmlPosition.yPosition>66290</cim:GmlPosition.yPosition>
  <cim:Location rdf:resource="#Location_8">
</cim:GmlPosition>

```

6.12 MV/MV transformer

A MV/MV transformer or auto-transformer is a PowerTransformer as described above.

6.13 Line

In IEC 61970-301, a line is a conductor connecting nodes usually in two different substations. However, IEC 61970-301 also allows for the modeling of a tapped line connecting more than two substations, but it imposes the requirement that the tap junction be contained in a “dummy” or collapsed (or fictitious) substation.

In distribution networks, it is more common to use the term “feeder” instead of the term “line”. A feeder can be considered as a tapped line having, in general, several ACLineSegments, junctions or taps. In addition, a feeder may also contain switch devices, MV/LV distribution transformers, capacitors, line voltage regulators. Because of this potentially large number of junctions, it is considered impractical to insist that all such devices and junctions be contained in a substation. Instead, it is sufficient to indicate them as members of a feeder only. However, it is also acceptable to model feeder devices, such as an MV/LV transformer and related switches, to be contained in a distribution substation which, in turn, is a member of a feeder. A Substation cannot be a member of a feeder or a line. If there is a Substation, it is necessary to split the feeder or the line into two different feeders or lines.