

DIN EN ISO 10439-3

ICS 23.140; 75.180.01

Mit DIN EN ISO
10439-1:2015-05,
DIN EN ISO 10439-2:2015-05
und
DIN EN ISO 10439-4:2015-05
Ersatz für
DIN EN ISO 10439:2004-02

**Erdöl-, petrochemische und Erdgasindustrie –
Axial- und Radialkompressoren und Expanderkompressoren –
Teil 3: Radialkompressoren mit integrierter Getriebeeinheit
(ISO 10439-3:2015);
Englische Fassung EN ISO 10439-3:2015**

Petroleum, petrochemical and natural gas industries –
Axial and centrifugal compressors and expander-compressors –
Part 3: Integrally geared centrifugal compressors (ISO 10439-3:2015);
English version EN ISO 10439-3:2015

Industries du pétrole, de la pétrochimie et du gaz naturel –
Compresseurs axiaux et centrifuges et compresseurs-détenteurs –
Partie 3: Compresseurs centrifuges et axiaux à multiplicateur intégré (ISO 10439-3:2015),
Version anglaise EN ISO 10439-3:2015

Gesamtumfang 78 Seiten

DIN-Normenausschuss Erdöl- und Erdgasgewinnung (NÖG)
DIN-Normenausschuss Maschinenbau (NAM)

Nationales Vorwort

Dieses Dokument (EN ISO 10439-3:2014) wurde vom Technischen Komitee ISO/TC 118 „Compressors and pneumatic tools, machines and equipment“, Sub committee SC 1 / Working group WG 1 „Joint TC 118/SC 1 — TC 67/SC 6 WG: Turbo compressors/expanders for petroleum, chemical and gas industry services“ in Zusammenarbeit mit dem Technischen Komitee CEN/TC 12 „Materialien, Ausrüstungen und Offshore-Bauwerke für die Erdöl-, petrochemische und Erdgasindustrie“ (Sekretariat: AFNOR, Frankreich) erarbeitet.

Für Deutschland hat hieran der Arbeitskreis NA 109-00-01-06 AK „Verfahrenstechnische Anlagen und Ausrüstungen“ im DIN-Normenausschuss Erdöl- und Erdgasgewinnung (NÖG) mitgearbeitet.

Diese europäische Norm enthält unter Berücksichtigung des DIN-Präsidialbeschlusses 1/2004 nur die englische Originalfassung der ISO Norm.

Diese Norm enthält neben den gesetzlichen Einheiten auch die Einheiten „°F“, „ft“, „in (inch)“, „lb (pound)“, „NPS“, und „r/min“ die in Deutschland nicht zugelassen sind. Es wird ausdrücklich darauf hingewiesen, dass die Anwendung dieser Einheiten im nationalen amtlichen und geschäftlichen Verkehr aufgrund des Gesetzes über Einheiten im Messwesen nicht zulässig ist. Die Angabe dieser Einheiten(en) dient lediglich als Hilfe im amtlichen und geschäftlichen Verkehr (z. B.) bei Einfuhr und Ausfuhr mit solchen Staaten, die diese Einheit(en) anwenden.

Umrechnung:

Nicht-SI-Einheit	SI-Einheit	Umrechnung	
°F	°C	°C	= (5/9) (°F-32)
ft	m	1 ft	= 0,304 8 m
in (inch)	mm	1 inch	= 25,4 mm
lb (pound)	kg	1 lb	= 0,453 592 37 kg
NPS	DN	1 NPS	= DN 25
r/min	min ⁻¹	1 r/min	= 1 min ⁻¹

Für die in diesem Dokument zitierten Internationalen Normen wird im Folgenden auf die entsprechenden Deutschen Normen hingewiesen:

ISO 10439-1 siehe DIN EN ISO 10439-1

Änderungen

Gegenüber DIN EN ISO 10439:2004-02 wurden folgende Änderungen vorgenommen:

- a) DIN EN ISO 10439:2004-02 wird überarbeitet in 4 separaten Teilen der Reihe DIN EN ISO 10439 (Teil 1 bis Teil 4) veröffentlicht.

Frühere Ausgaben

DIN EN ISO 10439: 2004-02

Nationaler Anhang NA (informativ)

Begriffe und Abkürzungen

Die Benummerung der folgenden Begriffe und Abkürzungen sind identisch mit der Benummerung in der englischen Fassung.

3 Begriffe und Abkürzungen

Für die Anwendung dieses Dokuments gelten die Begriffe und Abkürzungen nach ISO 10439-1.

ANMERKUNG Eine Querschnittsdarstellung eines Kompressors mit integrierter Getriebeeinheit, die Angaben zur Nomenklatur enthält, ist in Anhang C inbegriffen.

Nationaler Anhang NB (informativ)

Literaturhinweise

DIN EN ISO 10439-1, *Erdöl-, petrochemische und Erdgasindustrie — Axial- und Radialkompressoren und Expanderkompressoren — Teil 1: Allgemeine Anforderungen*

English Version

Petroleum, petrochemical and natural gas industries —
Axial and centrifugal compressors and expander-compressors —
Part 3: Integrally geared centrifugal compressors
(ISO 10439-3:2015)

Industries du pétrole, de la pétrochimie et du gaz naturel —
Compresseurs axiaux et centrifuges et
compresseurs-détenteurs —
Partie 3: Compresseurs centrifuges et axiaux à
multiplicateur intégré
(ISO 10439-3:2015)

Erdöl-, petrochemische und Erdgasindustrie —
Axial- und Radialkompressoren und
Expanderkompressoren für Sonderanwendungen zur
Handhabung von Gas oder Prozessluft —
Teil 3: Radialkompressoren mit integrierter Getriebeeinheit
(ISO 10439-3:2015)

This European Standard was approved by CEN on 8 November 2014.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the CEN-CENELEC Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the CEN-CENELEC Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

CEN-CENELEC Management Centre: Avenue Marnix 17, B-1000 Brussels

Foreword

This document (EN ISO 10439-3:2015) has been prepared by Technical Committee ISO/TC 118 "Compressors and pneumatic tools, machines and equipment" in collaboration with Technical Committee CEN/TC 12 "Materials, equipment and offshore structures for petroleum, petrochemical and natural gas industries" the secretariat of which is held by AFNOR.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by August 2015, and conflicting national standards shall be withdrawn at the latest by August 2015.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. CEN [and/or CENELEC] shall not be held responsible for identifying any or all such patent rights.

This document supersedes EN ISO 10439:2002.

According to the CEN-CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Bulgaria, Croatia, Cyprus, Czech Republic, Denmark, Estonia, Finland, Former Yugoslav Republic of Macedonia, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland, Turkey and the United Kingdom.

Endorsement notice

The text of ISO 10439-3:2015 has been approved by CEN as EN ISO 10439-3:2015 without any modification.

Contents

Page

Foreword	v
Introduction	vi
1 Scope	1
2 Normative references	1
3 Terms, abbreviated terms, and definitions	1
4 General	2
4.1 Dimensions and units	2
4.2 Statutory requirements	2
4.3 Unit responsibility	2
4.4 Basic design	2
4.4.1 Performance	2
4.5 Materials	2
4.6 Casings	2
4.6.1 Pressure-containing casings	2
4.6.2 Casing repair	3
4.6.3 Material inspection of pressure-containing parts	3
4.6.4 Pressure casing connections	3
4.6.5 Casing support structure	3
4.6.6 External forces and moments	3
4.6.7 Variable inlet and/or diffuser guide vanes	4
4.7 Rotating elements	4
4.8 Dynamics	4
4.9 Bearings and bearing housings	5
4.9.1 General	5
4.9.2 Hydrodynamic radial bearings	5
4.9.3 Hydrodynamic thrust bearings	5
4.9.4 Bearing housings	6
4.10 Shaft end seals	6
4.11 Integral gearing	6
4.12 Nameplates and rotation arrows	10
5 Accessories	10
5.1 Drivers	10
5.2 Couplings and guards	10
5.3 Lubrication and sealing systems	10
5.4 Mounting plates	10
5.5 Controls and instrumentation	11
5.6 Piping and appurtenances	12
5.6.1 General	12
5.6.2 Process piping and accessories	12
5.7 Special tools	12
6 Inspection, testing, and preparation for shipment	12
6.1 General	12
6.2 Inspection	12
6.2.1 Gear contact checks	13
6.3 Testing	13
6.3.1 Mechanical running test	13
6.3.2 Assembled compressor gas leakage test	15
6.3.3 * Optional tests	15
6.4 Preparation for shipment	16
7 Supplier's data	16
7.1 General	16
7.2 Proposals	16

7.3 Contract data	16
Annex A (normative) Datasheets	17
Annex B (informative) Vendor (Supplier) data and drawing requirements (VDDR)	30
Annex C (informative) Nomenclature	40
Annex D (informative) Typical materials for integrally geared compressors	43
Annex E (informative) Inspector's checklist	59
Annex F (informative) External forces and moments	64
Annex G (normative) Rating formulae for integral gearing	65
Bibliography	68

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

The procedures used to develop this document and those intended for its further maintenance are described in the ISO/IEC Directives, Part 1. In particular the different approval criteria needed for the different types of ISO documents should be noted. This document was drafted in accordance with the editorial rules of the ISO/IEC Directives, Part 2 (see www.iso.org/directives).

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights. Details of any patent rights identified during the development of the document will be in the Introduction and/or on the ISO list of patent declarations received (see www.iso.org/patents).

Any trade name used in this document is information given for the convenience of users and does not constitute an endorsement.

For an explanation on the meaning of ISO specific terms and expressions related to conformity assessment, as well as information about ISO's adherence to the WTO principles in the Technical Barriers to Trade (TBT), see the following URL: [Foreword - Supplementary information](#)

The committee responsible for this document is ISO/TC 118, *Compressors and pneumatic tools, machines and equipment*, Subcommittee SC 1, *Process compressors*.

This first edition, together with ISO 10439-1, ISO 10439-2, and ISO 10439-4, replaces ISO 10439:2002.

ISO 10439 consists of the following parts, under the general title *Petroleum, petrochemical and natural gas industries — Axial and centrifugal compressors and expander-compressors*:

- *Part 1: General requirements*
- *Part 2: Non-integrally geared centrifugal and axial compressors*
- *Part 3: Integrally geared centrifugal compressors*
- *Part 4: Expander-compressors*

Introduction

This International Standard is based on the 7th edition of the American Petroleum Institute standard API 617.

Users of this International Standard should be aware that further or differing requirements might be needed for individual applications. This International Standard is not intended to inhibit a supplier from offering or the purchaser from accepting alternative equipment or engineering solutions for the individual application. This can be particularly appropriate where there is innovative or developing technology. Where an alternative is offered, the supplier should identify any variations from this International Standard and provide details.

A asterisk (*) at the beginning of the paragraph of a clause or subclause indicates that either a decision is required or further information is to be provided by the purchaser. This information should be indicated on data sheets or stated in the enquiry or purchase order (see examples in [Annex A](#), ISO 10439-2:2015, Annex A, and ISO 10439-4:2015, Annex A).

This International Standard includes the following annexes:

- [Annex A](#): Datasheets
- [Annex B](#): Vendor (Supplier) data and drawing requirements (VDDR)
- [Annex C](#): Nomenclature
- [Annex D](#): Typical materials for integrally geared compressors
- [Annex E](#): Inspector's checklist
- [Annex F](#): External forces and moments
- [Annex G](#): Rating formulae for integral gearing

[Annex A](#) and [Annex G](#) form a normative part of this part of ISO 10439. [Annexes B](#) to [F](#) are for information only.

In this International Standard, where practical, US customary units are included in parentheses for information.

Petroleum, petrochemical and natural gas industries — Axial and centrifugal compressors and expander- compressors —

Part 3: Integrally geared centrifugal compressors

1 Scope

This part of ISO 10439 specifies minimum requirements and gives recommendations for axial compressors, single-shaft and integrally geared process centrifugal compressors, and expander-compressors for special purpose applications that handle gas or process air in the petroleum, petrochemical, and natural gas industries. This part of ISO 10439 specifies integrally geared centrifugal compressors in conjunction with ISO 10439-1.

NOTE 1 See API 672 for packaged plant instrument air compressors.

NOTE 2 Expander stages are sometimes provided on these machines.

2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 5389, *Turbocompressors — Performance test code*

ISO 8068, *Lubricants, industrial oils and related products (class L) — Family T (Turbines) — Specification for lubricating oils for turbines*

ISO 10439-1, *Petroleum, petrochemical and natural gas industries — Axial and centrifugal compressors and expander-compressors — Part 1: General requirements*

API 670, *Machinery protection systems*

AGMA 2015-1-A01, *Accuracy classification system — Tangential measurements for cylindrical gears*

AGMA 2101-D04, *Fundamental rating factors and calculation methods for involute spur and helical gear teeth*

ASME PTC 10-1997, *Performance test code on compressors and exhausters*

3 Terms, abbreviated terms, and definitions

For the purposes of this document, the terms, abbreviated terms, and definitions given in ISO 10439-1 apply.

NOTE A cross-section showing nomenclature of an integrally geared centrifugal compressor is included in [Annex C](#).

4 General

4.1 Dimensions and units

The dimensional and unit requirements shall be in accordance with ISO 10439-1.

4.2 Statutory requirements

The statutory requirements shall be in accordance with ISO 10439-1.

4.3 Unit responsibility

The unit responsibilities shall be in accordance with ISO 10439-1.

4.4 Basic design

4.4.1 Performance

4.4.1.1 The sectional head-capacity characteristic curve of each compressor section shall rise continuously from the rated point to predicted surge. The compressor, without the use of a bypass, shall be suitable for continuous operation at any capacity at least 10 % greater than the predicted surge capacity shown in the proposal.

4.4.1.2 Unless otherwise specified, the design lubricant shall be hydrocarbon oil of viscosity Grade 32 with an FZG load stage of 5, in accordance with ISO 8068. Viscosity Grade 46 with an FZG load stage of 5 can be used as a design lubricant, with the purchaser's approval. Oils with extreme pressure (EP) additives shall not be used.

NOTE Typical oil used in refineries and chemical plants has an FZG of 5 or higher. Requiring a higher FZG by design can require the need for special oil for this equipment.

4.5 Materials

Materials shall be in accordance with ISO 10439-1:2015, 4.5.

NOTE Refer to [Annex D](#) for typical materials.

4.6 Casings

Casings shall be in accordance with ISO 10439-1:2015, 4.6 and [4.6.1](#) to [4.6.6](#).

4.6.1 Pressure-containing casings

4.6.1.1 * The maximum allowable working pressure of each pressure casing shall be at least equal to the specified relief valve set pressure for that casing. The purchaser will specify the relief valve set pressure(s) for final discharge pressure and intermediate casing pressures, if applicable.

NOTE If only one relief valve pressure is specified, its set pressure does not usually apply to the intermediate pressure.

4.6.1.1.1 When a relief valve set pressure is not specified, each pressure casing shall be rated for at least 125 % of the maximum specified discharge pressure (gauge) of that pressure casing as determined by the supplier. System protection shall be furnished by the purchaser.

4.6.1.2 Socket-head or spanner-type bolting shall not be used externally unless specifically approved by the purchaser. For limited space locations, integrally flanged fasteners might be required.

4.6.2 Casing repair

Casings repairs shall be in accordance with ISO 10439-1:2015, 4.6.2.

4.6.3 Material inspection of pressure-containing parts

Casing material inspection of pressure-containing parts shall be in accordance with ISO 10439-1:2015, 4.6.3.

4.6.4 Pressure casing connections

Pressure casing connections shall be in accordance with ISO 10439-1:2015, 4.6.4 and [4.6.4.1](#) and [4.6.4.2](#).

4.6.4.1 Main process connections

Main process connections shall be in accordance with ISO 10439-1:2015, 4.6.4.2.

4.6.4.2 Auxiliary connections

4.6.4.2.1 If flanged or machined and studded openings are impractical, threaded connections can be used where they do not come in contact with flammable or toxic gas, with the purchaser's approval as follows:

- a) on non-weldable materials, such as cast iron;
- b) where essential for maintenance (disassembly and assembly).

These threaded openings shall be as specified in ISO 10439-1:2015, 4.6.4.3.8.

4.6.4.2.2 Auxiliary connections shall be at least DN 20 (NPS 3/4-in). See [4.11.1.7](#) to [4.11.1.8](#) and [Table 1](#) for auxiliary gearbox connections.

NOTE See ISO 10439-1:2015, 4.6.4.1.3 for allowable connection sizes.

4.6.4.2.3 Threaded connections for pipe sizes DN 20 (NPS 3/4-in) to DN 40 (NPS 1-1/2-in) size are permissible with the approval of the purchaser.

NOTE See ISO 10439-1:2015, 4.6.4.1.3 for allowable connection sizes.

4.6.5 Casing support structure

The mounting of the pressure casing (volute) to the gearbox shall be in accordance with ISO 10439-1:2015, 4.4.1.7. Bolting used to mount pressure casings shall be in accordance with ISO 10439-1:2015, 4.6.1.7.

4.6.6 External forces and moments

4.6.6.1 The supplier shall furnish the allowable forces and moments for each main process nozzle which has a customer connection in tabular form with the proposal. If nozzle loadings are not furnished, they shall be no less than NEMA SM23.

NOTE 1 Forces and moments allowed on integrally geared compressors are generally less than those allowed in ISO 10439-2 compressors (see [Annex F](#)).

NOTE 2 Piping system design needs to be rigorous in order to avoid piping expansion joints.

4.6.6.2 Pressure casing and supports shall be designed to have sufficient strength and rigidity to avoid adversely affecting impeller running clearances, gear contact pattern, seals, bearings, and coupling alignment.

4.6.7 Variable inlet and/or diffuser guide vanes

4.6.7.1 * Adjustable guide vanes shall be provided when specified or required by the supplier to meet specified operating conditions.

4.6.7.2 When provided, adjustable inlet guide vanes and operating mechanisms shall be suitable for all specified operating conditions, as well as start-up, shutdown, trip-out, settling-out, and momentary surge.

4.6.7.2.1 Guide vanes shall be mounted in replaceable bushings. Vanes can be positioned in the housing by replaceable permanently sealed rolling element bearings, if approved by the purchaser.

4.6.7.2.2 When adjustable guide vanes are used for toxic, flammable, or explosive process gas, then the linkage passing through the casing or enclosure shall be sealed to prevent leakage.

4.6.7.2.3 The inlet guide vanes shall be located sufficiently close to the eye of the impeller to be effective.

4.6.7.2.4 The vane foils shall have an aerodynamically smooth surface, especially where the shank enters the gas stream through the housing. A cantilevered design in lieu of a centre-supported vane design is preferred.

4.6.7.2.5 The vanes shall be designed such that the vanes will tend to open on loss of the control signal.

4.6.7.2.6 A vane control system consisting of a valve positioner with direct driven local position indicator shall be provided that will be visible during operation of the machine.

4.6.7.2.7 * Additional components to the vane control system in 4.6.7.2.6 shall be as specified.

4.6.7.3 * If specified, the actuation shaft seal shall be buffered using a barrier gas.

4.7 Rotating elements

4.7.1 Each impeller and shaft shall be clearly marked with a unique identification number. This number shall be on an accessible area that is not prone to maintenance damage.

4.7.2 Unless other shaft protection is approved by the purchaser, renewable components shall be furnished at close clearance points. Sleeves, spacers, or bushings shall be made of materials that are corrosion-resistant in the specified service (see ISO 10439-1:2015, 4.5.1.6 for limitations).

4.7.2.1 Shaft sleeves shall be provided under shaft end seals. Sleeves shall be treated to resist wear and sealed to prevent gas leakage between the shaft and sleeve.

4.7.3 Thrust loads from impellers and gears shall be absorbed by individual thrust bearings on pinions or transmitted to the bull gear thrust bearing by means of thrust rider rings fixed to the pinions and bull gear. All specified operating conditions and start-up conditions shall be evaluated for residual thrust loads.

NOTE Balance pistons are normally not used. Thrust balancing can be achieved by helix thrust force direction of the gearing and offsetting impeller aerodynamic thrust forces.

4.7.4 Impeller requirements shall be in accordance with ISO 10439-1:2015, 4.7.10.

4.8 Dynamics

Dynamics requirements shall be in accordance with ISO 10439-1.

4.8.1 For equipment covered in this part of ISO 14039, a lateral analysis shall be carried out for each shaft. For the bull gear, this shall consist only of an undamped critical speed map.

4.9 Bearings and bearing housings

Bearings and bearing housings shall be in accordance with 4.9.1 to 4.9.4 and ISO 10439-1:2015, 4.9.

4.9.1 General

4.9.1.1 Unless otherwise specified, radial and thrust bearings shall be of the hydrodynamic fluid film type.

4.9.1.2 Unless otherwise specified, thrust bearings and radial bearings shall be fitted with bearing-metal temperature sensors installed in accordance with API 670.

4.9.1.2.1 As design criteria, bearing metal temperatures shall not exceed 100 °C (212 °F) at specified operating conditions with a maximum oil inlet temperature of 50 °C (120 °F).

4.9.1.2.2 In the event the design criteria in 4.9.1.2.1 cannot be met, the purchaser and the supplier shall agree on acceptable bearing metal temperatures.

4.9.2 Hydrodynamic radial bearings

4.9.2.1 Sleeve or pad radial bearings shall be used and shall be split for ease of assembly. The use of non-split designs requires the purchaser's approval. The bearings shall be precision bored with steel, copper, cupro-nickel, or bronze-backed babbitted liners, pads, or shells. The bearings shall be equipped with anti-rotation pins and shall be positively secured in the axial direction.

4.9.2.2 * If specified, tilting pad bearing pads shall be copper-alloy backed.

4.9.2.3 * Unless otherwise specified, the liners, pads, or shells shall be in axially split housings. The bearing design shall not require removal of the coupling hub to permit replacement of the bearing liners, pads, or shells unless approved by the purchaser.

4.9.3 Hydrodynamic thrust bearings

4.9.3.1 Thrust bearings can be fixed-geometry (e.g. tapered-land) or tilting-pad type, steel-backed and babbitted, arranged for continuous pressurized lubrication to each side.

NOTE See 4.7.3 for thrust rider rings.

4.9.3.2 If specified, bearings shall be tilting pad on one or both sides.

4.9.3.3 Hydrodynamic thrust bearings shall be selected at no more than 50% of the bearing manufacturer's ultimate load rating. In sizing thrust bearings, consider the following for each specified application:

- a) the shaft speed;
- b) the temperature of the bearing babbitt;
- c) the deflection of the bearing pad;
- d) the minimum oil film thickness;
- e) the feed rate, viscosity, and supply conditions of the oil over the specified allowable oil supply condition range;

- f) the design configuration of the bearing;
- g) the babbitt or other bearing surface material alloy and pad material;
- h) the turbulence of the oil film;
- i) load changes due to process changes over the specified operating range.

NOTE See ISO 10439-1:2015, 3.1.60 for a definition of ultimate load rating for hydrodynamic thrust bearings.

4.9.3.4 Thrust bearings shall be sized for continuous operation under the most adverse specified operating conditions. Calculations of the thrust forces shall include, but shall not be limited to, the following factors:

- a) seal maximum design internal clearances and twice the maximum design internal clearances;
- b) pressurized rotor diameter step changes;
- c) stage maximum differential pressures;
- d) specified extreme variations in inlet, interstage, and discharge pressures;
- e) the maximum thrust force that can be transmitted to the compressor thrust bearing by other equipment in the train (i.e. couplings, gears, or a motor without a thrust bearing);
- f) the maximum thrust force from the sleeve bearing type drive if the motor or generator is directly connected.

4.9.4 Bearing housings

4.9.4.1 The term bearing housing refers to all bearing enclosures including the gearbox.

4.9.4.2 Bearing housings for pressure-lubricated hydrodynamic bearings shall be arranged to minimize foaming. The drain system shall be adequate to maintain the oil and foam level below shaft seals.

4.9.4.3 Oil reservoirs and housings that enclose moving lubricated parts (such as bearings and shaft seals), highly polished parts, instruments, and control elements shall be designed to minimize contamination by moisture, dust, and other foreign matter during periods of operation and idleness.

4.9.4.4 Provision shall be made in the bearing housings for the probes specified in 5.5.7.1.

4.10 Shaft end seals

4.10.1 Process seals and seal systems shall be in accordance with ISO 10439-1:2015, 4.10.

NOTE 1 Typical cross sections of various seal systems are given in ISO 10439-1:2015, Annex B.

NOTE 2 Equipment covered in this part can be available with any of the shaft end seal types covered in ISO 10439-1 or additional hybrid types are available.

4.10.2 * The purchaser shall specify the type of shaft end seal(s) to be provided and all operating conditions including start-up, shutdown, and settling-out conditions.

4.11 Integral gearing

4.11.1 The supplier shall dowel or key the gearbox to the mounting plate to maintain alignment.

NOTE Integrally geared compressors are fixed to the mounting plate and are not to be moved for alignment (to avoid distortion of the gearbox).

4.11.1.1 To the maximum extent practical, gearboxes shall be designed with internal oil passages to minimize external piping. External piping connections shall conform to the requirements of ISO 10439-1:2015, 4.6.4.3.

4.11.1.2 The design of internal piping and tubing shall achieve proper support and protection to prevent damage from vibration or from shipment, operation, and maintenance. Cantilevered piping in excess of 10 pipe diameters shall include reinforcing gussets in two planes at all pipe-to-flange connections.

4.11.1.3 The gearbox shall be designed to permit rapid drainage of lube oil and to minimize oil foaming (which could lead to excessive heating of the oil). For gears with pitch line velocities of more than 125 m/s (25 000 ft/min), consideration should be given to design features such as windage baffles, false bottoms, adequate sump depth, and an additional full-size drain connection.

4.11.1.4 A removable and gasketed inspection cover or covers shall be provided in the gearbox to permit direct visual inspection of the full-face width of the pinion(s) and gear. The inspection opening or openings shall be at least one-half the width of the gear face.

4.11.1.5 Permanent coatings or paint shall not be applied to the interior of the casing, unless the purchaser approves in advance the material and method of application.

4.11.1.6 A single lube-oil supply connection is preferred.

4.11.1.7 A single lube-oil drain connection from the gear casing is preferred. The minimum drainpipe size shall be sized to be no more than half full and shall be based on the total inlet flow to the gear casing, as shown in [Table 1](#).

Table 1 — Drain pipe sizes

Inlet flow rate		Minimum drain size ^a	
Litres per minute	US Gallons per minute	Millimetres	Inch
74	19	50	2
176	46	75	3
370	97	100	4
1 146	302	150	6
^a Nominal pipe size.			

4.11.1.8 Gearboxes shall be provided with a plugged or flanged-and-blinded purge gas connection.

4.11.2 Gearbox split lines shall use a metal-to-metal joint. Adequate sealing shall be provided with a suitable joint compound or groove-type seals. Gaskets (including string type) shall not be used on the gearbox split lines.

4.11.3 Gear rating

4.11.3.1 When a gearbox has a gear mesh with a ratio of 7:1 or greater, all of the gearing in that gearbox shall be rated in accordance with [Annex G](#). All other gear sets shall be rated per API 613.

4.11.3.2 The rated power of the gearing shall not be less than the driver nameplate rating multiplied by the driver service factor. When there are multiple pinions, the power rating of the gear sets shall not be less than the following:

- a) 110 % of the maximum power transmitted by the gear set.
- b) The maximum power of the driver (including service factor) prorated between all the gear sets, based on normal power demands. If the maximum transmitted torque occurs at a continuous operating speed other than the maximum continuous speed, this torque and its corresponding speed shall be the basis for sizing the gear set.

4.11.3.3 The power rating based upon both pitting resistance and bending strength shall be calculated for each member of each gear set in the unit. The pinion and bull gear teeth can have different ratings due to differences in material properties, geometry factors, and number of cycles under load. The lowest of the four ratings (pinion bending, pinion pitting, bull gear bending, bull gear pitting) shall be used as the gear rating (see [Annex G](#)). Wherever possible, gear sets shall be designed such that failure will occur due to pitting rather than bending (i.e. wear out before breaking).

NOTE Higher gear ratios require a large number of teeth; therefore, it might not be possible to provide tooth design (which will fail in pitting rather than bending) without compromising other aspects of the gear design (i.e. higher pitchline velocities).

4.11.3.4 Gearing shall be designed and manufactured to meet the requirements of AGMA 2015-1-A01, accuracy Grade 4.

NOTE For equivalent loading conditions, gearing produced to higher quality levels will always result in longer service life and reduced bearing loads.

4.11.3.5 The manufacturer shall provide documentation showing that the required quality levels in [4.11.3.4](#) have been met.

4.11.3.6 The pinion face width to working pitch diameter ratio (L/d ratio) shall be limited based on pinion tooth hardness, as follows:

4.11.3.6.1 For pinion hardness equal to or less than 38 Rc (BHN 354), L/d shall be limited to 2,0 maximum.

4.11.3.6.2 For pinion hardness equal to or greater than 58 Rc (BHN 615), L/d shall be limited to 1,6 maximum.

4.11.3.6.3 For pinion hardness between 38 and 58 Rc (BHN 354 and BHN 615), L/d shall be limited to $L/d = 2,76 - 0,02 \times H$ (see [Figure 1](#)), where H is the hardness in Rockwell C.

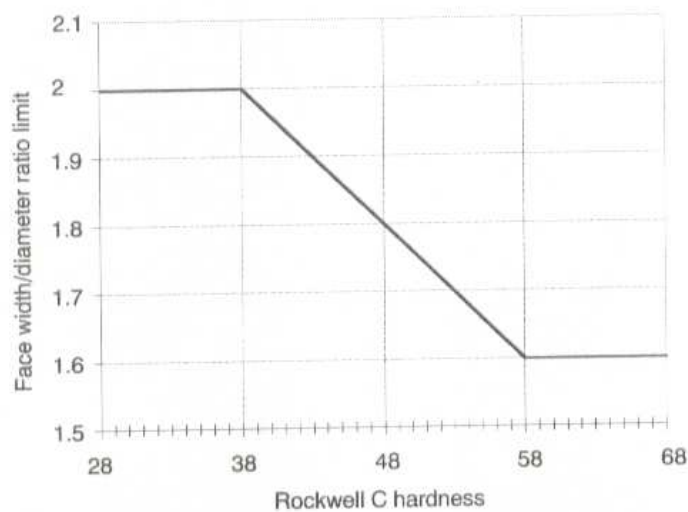


Figure 1 — Face width limit

4.11.3.7 The material used for gearing shall meet the specifications for AGMA 2101 Grade 2 material, as a minimum. If a superior grade of material is used, credit for the better material shall not be taken in the gear rating.

4.11.3.8 The tooth portion of pinions shall be integral with their shafts.

4.11.3.9 The bull gear can be integral with or separate from its shaft. Separate shafts shall be assembled into the bull gear with an interference fit suitable for all torque requirements including pulsations.

4.11.3.10 Shafts shall be made of one-piece, heat-treated steel that is suitably machined. Shafts that have a finished diameter larger than 200 mm (8 in) shall be forged steel. Shafts that have a finished diameter of 200 mm (8 in) or less shall be forged steel or hot rolled barstock, providing such barstock meets all quality and heat treatment criteria established for shaft forgings.

4.11.3.11 Gearboxes shall not require a break-in period.

4.11.3.12 The gearing shall be designed to withstand all internal and external loads inherent to geared, rotating machinery systems to the limit of the installed driver.

4.11.3.13 The unplated tooth surface on loaded faces of completed gears shall have a finish, as measured along the pitch line, of 0,8 μm (32 μin) Ra or better.

4.11.3.14 Hunting tooth combinations are preferred. To achieve this, it can be necessary for the manufacturer to adjust the exact gear ratio. If such adjustment is impractical, the purchaser and the supplier shall negotiate a solution. At least one mesh shall be hunting tooth.

NOTE A hunting tooth combination is preferred because the intent is for every tooth on a pinion to mesh with as many teeth as possible on the mating gear before the same teeth mesh again or repeat. However, with multiple pinion units, a hunting tooth combination is not as critical because the gear wheel meshes with multiple pinions and is, therefore, not as susceptible to the problems of non-hunting tooth designs.

4.11.3.15 Each gear and each pinion shall be supported between two bearings. Overhung designs are not permitted.

4.12 Nameplates and rotation arrows

4.12.1 Nameplates and rotation arrows shall be in accordance with 4.12.2 and 4.12.3 and ISO 10439-1:2015, 4.12.

4.12.2 The following data shall be clearly stamped or engraved on the nameplate(s):

- a) supplier's name;
- b) serial number;
- c) size, type, and model;
- d) rated capacity;
- e) rated power;
- f) gear ratio;
- g) rated input speed or speed range for variable speed driver;
- h) purchaser item number;
- i) maximum allowable working pressure of each pressure-containing casing;
- j) maximum and minimum allowable working temperature of each pressure-containing casing;
- k) hydrostatic test pressure for each pressure-containing casing;
- l) maximum sealing pressure of each pressure-containing casing.

NOTE Normally, multiple nameplates are provided.

4.12.3 Rotation arrows shall be cast-in or attached for the bull gear rotation at a readily visible location.

NOTE See ISO 10439-1:2015, 4.12.

5 Accessories

Accessories shall be in accordance with ISO 10439-1:2015, Clause 5.

5.1 Drivers

Drivers shall be in accordance with ISO 10439-1:2015, 5.1.

5.2 Couplings and guards

Couplings and guards shall be in accordance with ISO 10439-1:2015, 5.2.

5.3 Lubrication and sealing systems

Lubrication and sealing systems shall be in accordance with ISO 10439-1:2015, 5.3.

5.4 Mounting plates

Mounting plates shall be in accordance with ISO 10439-1:2015, 5.4.

5.4.1 * If specified or approved by the purchaser, the oil reservoir shall be integral with the baseplate.

5.4.2 * If specified, the baseplate shall have a series of machined mounting pads suitable for mating to field-installed soleplates to facilitate installation.

NOTE See API RP 686 2nd edition, Annex C, Figure C.1.

5.4.3 * If specified, when machined mounting pads as indicated in 5.4.2 have been specified, the supplier shall also supply the soleplates needed for field installation.

5.5 Controls and instrumentation

5.5.1 Controls and instrumentation shall be in accordance with ISO 10439-1:2015, 5.5.

5.5.2 Control systems

5.5.2.1 * For a constant-speed centrifugal compressor, the control signal shall actuate either a purchaser-furnished control valve in the compressor inlet piping or the adjustable inlet guide vanes or variable diffuser vanes furnished by the supplier as an integral part of the compressor, as specified.

5.5.2.2 If adjustable inlet guide vanes or variable diffuser vanes are specified, the supplier shall also furnish a guide-vane positioner compatible with the type of control signal specified by the purchaser.

5.5.2.3 * If specified, the guide vane positioner shall include a local manual override. A direct-driven vane position indicator that will be visible during operation of the machine shall be provided.

5.5.3 Instrument and control panels, when supplied, shall be in accordance with ISO 10439-1:2015, 5.5.3.

5.5.4 Instrumentation, when supplied, shall be in accordance with ISO 10439-1:2015, 5.5.4.

5.5.5 Alarms and shutdowns, when supplied, shall be in accordance with ISO 10439-1:2015, 5.5.5.

5.5.6 Electrical systems, when supplied, shall be in accordance with ISO 10439-1:2015, 5.5.6.

5.5.7 Vibration, position, and bearing temperature.

5.5.7.1 Unless otherwise specified, the following transducers shall be provided: two radial-vibration probes adjacent to each radial bearing, two axial-position probes for each shaft equipped with a thrust bearing, and a one-event-per-revolution probe for each shaft.

5.5.7.2 Vibration and axial position transducers shall be supplied, installed, and calibrated in accordance with API 670.

5.5.7.3 * If specified, radial shaft vibration and axial position monitors shall be supplied and calibrated in accordance with API 670.

5.5.7.4 Two bearing temperature sensors shall be supplied, installed, and calibrated for each radial and thrust bearing in accordance with API 670.

NOTE The second sensor can be used as a spare.

5.5.7.5 * The purchaser shall specify the type of temperature sensors required per API 670.

5.5.7.6 * If specified, a bearing temperature monitor shall be supplied and calibrated in accordance with API 670.

5.5.7.7 * If specified, an accelerometer shall be supplied, installed at the shaft on the gearbox, and calibrated in accordance with API 670.

NOTE Commercially available accelerometers that have hazardous area certifications have difficulty reaching high gear mesh frequencies.

5.5.7.8 * If specified, an accelerometer monitor shall be supplied, installed, and calibrated in accordance with API 670.

5.6 Piping and appurtenances

5.6.1 General

Piping and appurtenances furnished shall be in accordance with 5.6.1.1 to 5.6.2.3 and ISO 10439-1:2015, 5.6.

5.6.1.1 When a baseplate has been specified, the supplier shall furnish all piping systems, including mounted appurtenances, located within its confines. The piping shall terminate with flanged connections at the edge of the baseplate. The purchaser will furnish only interconnecting piping between equipment groupings and off base facilities.

NOTE The oil reservoir and oil system can be combined in the baseplate (see 5.4.1).

5.6.1.2 * If specified, a liquid injection manifold shall be supplied. It shall include a throttle valve, an armoured flow meter, a check valve, a pressure indicator, and a block valve for each injection point.

5.6.2 Process piping and accessories

5.6.2.1 Unless otherwise specified, process piping, if furnished, shall be in accordance with ISO 10438-1, ISO 10438-2, and ISO 10438-4.

NOTE API 614 5th edition is identical to ISO 10438 (all parts):2007.

5.6.2.2 * If specified, the purchaser shall furnish piping specifications for supplier furnished process piping.

5.6.2.3 * If specified, the supplier shall provide process gas heat exchangers in accordance with purchaser-provided specifications.

NOTE 1 Refer to ISO 10438-1 for process heat exchanger requirements.

NOTE 2 API 614 5th edition is identical to ISO 10438 (all parts):2007.

5.7 Special tools

Special tools shall be in accordance with ISO 10439-1:2015, 5.7.

6 Inspection, testing, and preparation for shipment

6.1 General

General requirements for inspection, testing, and preparation for shipment shall be in accordance with ISO 10439-1:2015, 6.1. Also refer to Annex E for inspector's checklist.

6.2 Inspection

Requirements for inspection shall be in accordance with 6.2.1.1 to 6.2.1.2 and ISO 10439-1:2015, 6.2.

6.2.1 Gear contact checks

6.2.1.1 Each set of installed gears shall be checked for contact in the job gearbox at the supplier's shop.

6.2.1.2 A thin coating of colour transfer material (such as Prussian blue) shall be applied at three locations, 120 degrees apart, to four or more teeth of the dry degreased gear. (Layout dye shall not be used for the assembly contact check.) With the gear held firmly, the coated teeth shall be rotated through the mesh with a moderate drag torque applied in a direction that will cause the teeth to contact on the normally loaded faces. The colour transfer shall show evidence of contact distributed across each helix, as prescribed by the supplier. Prior to the contact tests, the supplier shall make available to the purchaser a contact drawing or supplier engineering specification that defines the acceptable contact. The results of the contact check shall be preserved by lifting the contrasting colours from a tooth by applying and peeling off a strip of clear adhesive tape and then applying the tape to a notated sheet of white paper. The drawing or specification and the results of the contact checks shall be preserved for at least 20 years and shall be available to the purchaser on request.

NOTE Unmodified leads generally show about 80 % contact across the tooth length.

6.3 Testing

In addition to the requirements of ISO 10439-1:2015, 6.3, the compressor shall be tested in accordance with 6.3.1 and 6.3.2. Other tests that can be specified are described in 6.3.3.

6.3.1 Mechanical running test

6.3.1.1 The requirements of 6.3.1.1.1 to 6.3.1.1.5 shall be met before the mechanical running test is performed.

6.3.1.1.1 The contract shaft seals and bearings shall be used in the machine for the mechanical running test.

6.3.1.1.2 Compressors covered in this part generally do not use oil-injected seals or seal-oil systems. When these are specified, testing shall be as agreed between user and supplier.

NOTE For guidance, see ISO 10439-1:2015, 6.3.2.

6.3.1.1.3 Oil viscosity, pressures, temperatures, and filtration shall be within the range of operating values recommended in the supplier's operating instructions for the specific unit being tested. Overall oil flow rates for each oil supply line shall be measured.

6.3.1.1.4 Following the mechanical running test, the requirements of ISO 10439-1:2015, 6.3.5.10 shall be met, as well as the requirements of 6.3.1.4.1 and 6.3.1.4.2.

NOTE API 614 5th edition is identical to ISO 10438 (all parts):2007.

6.3.1.1.5 Facilities shall be installed to prevent the entrance of oil into the compressor during the mechanical running test. These facilities shall be in operation throughout the test.

6.3.1.2 The mechanical running test of the equipment shall be conducted as specified in 6.3.1.2.1 to 6.3.1.2.4.

NOTE Testing with the contract coupling(s) is preferred.

6.3.1.2.1 The equipment shall be accelerated to the maximum continuous speed and run until bearings, lube-oil temperatures, and shaft vibrations have stabilized.

NOTE Operating equipment at or near-critical speeds is normally avoided.

6.3.1.2.2 For variable speed machines, the speed shall be increased to trip speed and the equipment shall be run for a minimum of 15 min.

6.3.1.2.3 The speed shall be reduced to the maximum continuous speed, and the equipment shall be run for 4 h continuous operation.

6.3.1.2.4 The following seal flow data shall be taken during the mechanical running test to ensure that the seals are installed and operating properly:

- a) for single dry gas seals, flow in the vent line from each seal shall be measured;
- b) for tandem dry gas seals, flow in the primary and secondary vent line from each seal shall be measured;
- c) for double dry gas seals, the total seal gas flow to each seal shall be measured.

NOTE 1 Seal performance at contract conditions is normally determined in separate tests by the seal manufacturer (see ISO 10439-1:2015, 4.10 for the requirements).

NOTE 2 Flow in the vents of single or tandem seals can include buffer or separation gas in addition to process gas leakage through the seal.

6.3.1.3 During the mechanical running test, the requirements of 6.3.1.3.1 to 6.3.1.3.7 shall be met.

6.3.1.3.1 During the mechanical running test, the mechanical operation of all equipment being tested and the operation of the test instrumentation shall be satisfactory. The equipment measured unfiltered vibration shall not exceed the limits of ISO 10439-1:2015, 4.8.8.8 and shall be recorded at the operating speed. Any other test acceptance criteria shall be agreed and stated in the test agenda.

6.3.1.3.2 Casing vibration shall not exceed an overall level of 4 Gs peak at gear mesh frequency.

6.3.1.3.3 While the equipment is operating at maximum continuous speed or other speeds, vibration data shall be acquired to determine amplitudes at frequencies other than synchronous. This data shall cover a frequency range from 0,25 times to 8 times the maximum continuous speed. If the amplitude of any discrete, nonsynchronous vibration exceeds 20 % of the allowable vibration as defined in ISO 10439-1:2015, 4.8.8.8, the purchaser and the supplier shall agree on the requirements for any additional testing and on the equipment acceptability.

6.3.1.3.4 The mechanical running test shall verify that lateral critical speeds below running speed conform to the requirements of ISO 10439-1:2015, 4.8.2.

6.3.1.3.5 * If specified, shop verification of the unbalanced response analysis shall be performed in accordance with ISO 10439-1:2015, 4.8.3.

6.3.1.3.6 * If specified, all real-time vibration data as agreed by the purchaser and the supplier shall be recorded and a copy provided to the purchaser.

6.3.1.3.7 * If specified, the user can bring in vibration equipment to record baseline readings.

6.3.1.4 Following the mechanical running test, the requirements of ISO 10439-1:2015, 6.3.7.2 shall be met, as well as the requirements of 6.3.1.4.1 and 6.3.1.4.2.

6.3.1.4.1 The tooth mesh shall be inspected for proper contact and for surface damage resulting from the test.

6.3.1.4.2 Spare rotor sets ordered to permit concurrent manufacture shall also be given a mechanical running test in accordance with the requirements of this standard. Complete spare set shall be run as unit