IEC 60034-18-32

Edition 2.0 2022-01
COMMENTED VERSION

INTERNATIONAL STANDARD

colour inside

Rotating electrical machines –
Part 18-32: Functional evaluation of insulation systems (Type II) –
Electrical endurance qualification procedures for form-wound windings

IEC 60034-18-32:2022-01 CMV(en)

Documents
Document Sharing Hub

Full document details: IEC 60034-18-32 2022 CMV

THIS PUBLICATION IS COPYRIGHT PROTECTED
Copyright © 2022 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

IEC Secretariat
3, rue de Varembé
CH-1211 Geneva 20
Switzerland

Tel.: +41 22 919 02 11
info@iec.ch
www.iec.ch

About the IEC
The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications
The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigendum or an amendment might have been published.

IEC publications search - webstore.iec.ch/advsearchform
The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee, …). It also gives information on projects, replaced and withdrawn publications.

IEC Just Published - webstore.iec.ch/justpublished
Stay up to date on all new IEC publications. Just Published details all new publications released. Available online and once a month by email.

IEC Customer Service Centre - webstore.iec.ch/csc
If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: sales@iec.ch.

IEC Products & Services Portal - products.iec.ch
Discover our powerful search engine and read freely all the publications previews. With a subscription you will always have access to up to date content tailored to your needs.

Electropedia - www.electropedia.org
The world's leading online dictionary on electrotechnology, containing more than 22 300 terminological entries in English and French, with equivalent terms in 19 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.

Documents
Document Sharing Hub

Full document details: IEC 60034-18-32 2022 CMV

IEC 60034-18-32

Edition 2.0 2022-01
COMMENTED VERSION

INTERNATIONAL STANDARD

colour inside

Rotating electrical machines –
Part 18-32: Functional evaluation of insulation systems (Type II) – Electrical endurance qualification procedures for form-wound windings

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

ICS 29.160.01

ISBN 978-2-8322-1073-3

Warning! Make sure that you obtained this publication from an authorized distributor.

® Registered trademark of the International Electrotechnical Commission

Documents
Document Sharing Hub

Full document details: IEC 60034-18-32 2022 CMV

CONTENTS

FOREWORD 5
INTRODUCTION 7

1 Scope 8
2 Normative references 8
3 Terms and definitions 9
4 General considerations 10
4.1 Relationship to IEC 60034-18-1 10
4.2 Selection and designation of test procedures 10
4.3 Reference insulation system 11
4.4 Test procedures ~~(IEC 61251)~~ 11
4.4.1 General 11
4.4.2 Electrical ageing of the mainwall insulation 11
4.4.3 Electrical ageing of the stress control system 11
4.4.4 Electrical ageing of the turn insulation 12
4.5 Extent of tests 12
4.5.1 Full evaluation of the mainwall insulation 12
4.5.2 Reduced evaluation of the mainwall insulation 12
4.5.3 Evaluation of the stress control system 12
5 Test objects 13
5.1 Construction of test objects 13
~~5.2 Number of turns~~ .....
5.2 Number of test specimens 13
5.3 Initial quality control tests 13
6 Electrical ageing 14
6.1 General 14
6.2 Voltage levels and intended test lives of the mainwall insulation 14
6.3 Test temperatures during electrical endurance testing of the mainwall insulation 14
6.3.1 Electrical ageing at room temperature 14
6.3.2 Electrical ageing at elevated temperature 14
6.3.3 Ageing procedure for the mainwall insulation 14
~~6.4 Ageing procedure for the turn insulation~~ .....
6.4 Maintenance of stress ~~grading~~ control coatings 15
7 Diagnostic sub-cycle 15
7.1 General 15
7.2 Voltage test~~s~~ of the mainwall insulation 15
~~7.2.1 Mainwall insulation test~~ .....
~~7.2.2 Turn insulation impulse test~~ .....
~~7.2.3 Turn insulation power frequency test~~ .....
7.3 Other diagnostic tests 16
8 Failures of the mainwall insulation 16
8.1 Failure location and verification 16
8.2 Failed specimen observations 16
~~8.3 Dimensional measurements~~ .....

AVA Documents
Document Sharing Hub

9 Functional evaluation of the mainwall data 17
9.1 General 17
9.2 Full evaluation (same voltage level and same expected service life) 17
9.3 Reduced evaluation (same voltage level and same expected service life) 21
9.4 Recommended data to be recorded 23
9.5 Determining qualification for performances different to the reference system 24
9.5.1 Overview 24
9.5.2 Case B: Qualification for the same phase to phase voltage and a different expected service life 24
9.5.3 Case C: Qualification for different voltage level and same expected service life 25
9.5.4 Case D: Qualification for different voltage level and different expected service life 26
9.5.5 Non-linearity of regression lines 27
Annex A (normative) Reference life line for mainwall insulation in the absence of a manufacturer's reference life line 28
Annex B (informative) 29
B.1 Electrical ageing of the conductive slot coating 29
B.2 Electrical ageing of the stress control coating 29
B.3 Test objects 29
B.4 Evaluation of the stress control system 29
B.5 Ageing procedure for the conductive slot and stress control coating 30
B.5.1 General 30
B.5.2 Arrangement of temperature control by heater plates 30
B.5.3 Heating by means of an oven 30
B.5.4 Test parameter 30
B.6 Qualification of the stress control system 31
B.6.1 General 31
B.6.2 Test procedure 31
B.6.3 Test pass criteria 31
B.7 Examples of deterioration marks at the stress control system 32
~~Bibliography~~ .....
List of comments 34

Figure 1 – Comparison of ageing data from candidate (C) and reference (R) insulation systems showing qualification 19
Figure 2 – Comparison of ageing data from candidate and reference insulation systems showing failure to qualify 21
Figure 3 – Comparison of reduced evaluation test data from four separate candidate systems with that from the reference system 23
Figure 4 – Candidate system qualified for the same voltage level and different expected service life 25
Figure 5 – Candidate system qualified for a higher voltage level and the same expected service life 26
Figure 6 – Candidate system qualified for a different service life and different voltage level from the reference 27
Figure A.1 – Reference lifeline for mainwall insulation 28
Figure B.1 – Application of heater elements to a stator bar 30
Figure B.2 – Typical deterioration mark at the conductive slot coating 32

AVA Documents
Document Sharing Hub
Full document details: IEC 60034-18-32 2022 CMV

~~Table 1 – Test procedure designations .....~~
Table 1 – Conditions for qualification of candidate system 24
Table B.1 – Phase to ground test voltages and test temperatures 31

Documents
Document Sharing Hub
Full document details: IEC 60034-18-32 2022 CMV

INTERNATIONAL ELECTROTECHNICAL COMMISSION

ROTATING ELECTRICAL MACHINES –

Part 18-32: Functional evaluation of insulation systems (Type II) – ~~Test~~ Electrical endurance qualification procedures for form-wound windings ~~– Evaluation by electrical endurance~~ 1

FOREWORD

1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
6) All users should ensure that they have the latest edition of this publication.
7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

This commented version (CMV) of the official standard IEC 60034-18-32:2022 edition 2.0 allows the user to identify the changes made to the previous IEC 60034-18-32:2010 edition 1.0. Futhermore, comments from IEC TC 2 experts are provided to explain the reasons of the most relevant changes.

A vertical bar appears in the margin wherever a change has been made. Additions are in green text, deletions are in strikethrough red text. Experts' comments are identified by a blue-background number. Mouse over a number to display a pop-up note with the comment.

This publication contains the CMV and the official standard. The full list of comments is available at the end of the CMV.

Documents
Document Sharing Hub

Full document details: IEC 60034-18-32 2022 CMV

IEC 60034-18-32 has been prepared by IEC technical committee 2: Rotating machinery. It is an International Standard.

This second edition cancels and replaces the first edition published in 2010. This edition constitutes a technical revision.

This edition includes the following significant technical changes with respect to the previous edition:

a) Title modified.
b) Simplification of clauses.
c) Reduction in the number of test procedures.
d) Inclusion of full bars and coils as test objects.
e) A new clause dealing with failures and failure criteria.

The text of this International Standard is based on the following documents:

Draft	Report on voting
2/2068/FDIS	2/2075/RVD

Full information on the voting for its approval can be found in the report on voting indicated in the above table.

The language used for the development of this International Standard is English.

A list of all parts in the IEC 60034 series, published under the general title *Rotating electrical machines*, can be found on the IEC website.

This document was drafted in accordance with ISO/IEC Directives, Part 2, and developed in accordance with ISO/IEC Directives, Part 1 and ISO/IEC Directives, IEC Supplement, available at www.iec.ch/members_experts/refdocs. The main document types developed by IEC are described in greater detail at www.iec.ch/standardsdev/publications.

The committee has decided that the contents of this document will remain unchanged until the stability date indicated on the IEC website under webstore.iec.ch in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.

Documents
Document Sharing Hub

Full document details: IEC 60034-18-32 2022 CMV

INTRODUCTION

IEC 60034-18-1 presents general principles for the evaluation of insulation systems used in rotating electrical machines.

This document deals exclusively with insulation systems for form-wound windings (Type II) and concentrates on electrical functional evaluation.

In IEC 60034-18-42, tests are described for qualification of Type II insulation systems in voltage-source converter operation. These insulation systems are generally used in rotating machines which have form-wound windings, mostly rated above 700 V r.m.s. The two standards IEC 60034-18-41 and IEC 60034-18-42 separate the systems into those which are not expected to experience partial discharge activity within specified conditions in their service lives (Type I), and those which are expected to experience and withstand partial discharge activity in any part of the insulation system throughout their service lives (Type II).

Documents
Document Sharing Hub

Full document details: IEC 60034-18-32 2022 CMV

ROTATING ELECTRICAL MACHINES –

Part 18-32: Functional evaluation of insulation systems (Type II) – ~~Test~~ Electrical endurance qualification procedures for form-wound windings ~~– Evaluation by electrical endurance~~

1 Scope

This part of IEC 60034-18 describes ~~test~~ qualification procedures for the evaluation of electrical endurance of insulation systems for use in ~~a.c. or d.c.~~ rotating electrical machines using form-wound windings energized with sinusoidal power frequency voltage. The test procedures for the main wall insulation are comparative in nature, such that the performance of a candidate insulation system is compared to that of a reference insulation system with proven service experience. ~~The test procedures are principally directed at the insulation systems in air-cooled machines but may also be used for evaluating parts of the insulation systems in hydrogen cooled machines. Note that the qualification procedures of inverter duty insulation systems for form-wound windings can be found in IEC 60034-18-42.~~ If no reference system is available, the diagram in Annex A is available for use. The qualification procedures of inverter duty insulation system for form-wound windings can be found in IEC 60034-18-42 or IEC 60034-18-41. A new and informative test procedure for the stress control system is introduced and defined in Annex B. **2**

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60034-1, *Rotating electrical machines – Part 1: Rating and performance*

IEC 60034-15:2009, *Rotating electrical machines – Part 15: Impulse voltage withstand levels of form-wound stator coils for rotating a.c. machines*

IEC 60034-18-1:2010, *Rotating electrical machines – Part 18-1: Functional evaluation of insulation systems – General guidelines*

IEC TS 60034-18-33:2010, *Rotating electrical machines – Part 18-33: Functional evaluation of insulation systems – Test procedures for form-wound windings – Multifactor evaluation by endurance under simultaneous thermal and electrical stresses*

IEC 60034-18-41, *Rotating electrical machines – Part 18-41: Partial discharge free electrical insulation systems (Type I) used in rotating electrical machines fed from voltage converters – Qualification and quality control tests*

IEC 60034-18-42:2017, *Rotating electrical machines – Part 18-42: Partial discharge resistant electrical insulation systems (Type II) used in rotating electrical machines fed from voltage converters – Qualification tests*
IEC 60034-18-42:2017/AMD1:2020

IEC 60034-27-1, *Rotating electrical machines – Part 27-1: Off-line partial discharge measurements on the winding insulation*

Documents
Document Sharing Hub

Full document details: IEC 60034-18-32 2022 CMV

IEC 60034-27-3, *Rotating electrical machines – Part 27-3: Dielectric dissipation factor measurement on stator winding insulation of rotating electrical machines*

IEC 60216-4-1, *Electrical insulating materials – Thermal endurance properties – Part 4-1: Ageing ovens – Single-chamber ovens*

IEC 62539, *Guide for the statistical analysis of electrical insulation breakdown data*

3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at http://www.electropedia.org/
- ISO Online browsing platform: available at http://www.iso.org/obp

3.1
mainwall insulation
main electrical insulation that separates the conductors from the earthed stator/rotor core in motor and generator windings

3.2
~~turn~~ strand insulation
electrical insulation that covers each conductor in coils/bars

3.3
~~interturn~~ turn insulation
electrical insulation that separates the conductor turns from each other in coils/bars

~~**3.4**~~
~~**corona protection material**~~
~~material which is used to coat a stator coil/bar within the slot portion of the stator core to avoid slot discharges~~

~~**3.5**~~
~~**stress grading material**~~
~~material generally having a non-linear resistivity characteristic, applied to the endwindings of stators to reduce the maximum surface electrical stress~~

3.4
conductive slot coating
conductive paint or tape layer in intimate contact with the mainwall insulation in the slot portion of the coil side, often called semi-conductive coating

Note 1 to entry: The purpose is to prevent partial discharge from occurring between the coil/bar and the stator core.

3.5
stress control coating
paint or tape on the surface of the mainwall insulation that extends beyond the conductive slot coating in high-voltage stator bars and coils

Note 1 to entry: The purpose of the coating is to prevent surface discharges near the slot exit or in the end winding area.

Documents
Document Sharing Hub

Full document details: IEC 60034-18-32 2022 CMV

3.6
stress control system
generic name for the combination of the conductive slot coating and stress control coating in high-voltage stator bars and coils 3

3.7
confidence interval
range of values so defined that there is a specified probability that the value of a parameter (voltage, stress or time) lies within it

3.8
test temperature
temperature of the outer surface of the bar/coil at the straight part of the bar/coil measured with an appropriate selected and placed sensor

4 General considerations

4.1 Relationship to IEC 60034-18-1

The principles of IEC 60034-18-1 should be followed, unless the recommendations of this document indicate otherwise.

4.2 Selection and designation of test procedures

One or more of the procedures in this document should be suitable for the majority of evaluations. Evaluation is usually performed by the manufacturer of the machine/coils or by a third-party laboratory. It is the manufacturer's responsibility to justify the most suitable procedure ~~in Table 1~~ on the basis of past experience and knowledge of the insulation systems to be compared.

~~The test procedure should be selected from Table 1 and designated by IEC 60034-18-32 procedure N, where N is the designation given in the Table 1. Subclauses 4.3, 4.4 and 4.5 give guidance on how to select the test procedure.~~

~~**Table 1 – Test procedure designations**~~

~~Designation of test procedure N~~	~~Applied ageing voltage~~		~~Diagnostic tests~~		
	~~Mainwall insulation (6.3)~~	~~Interturn insulation (6.4)~~	~~Mainwall insulation (7.2.1)~~	~~Interturn insulation (7.2.2 or 7.2.3)~~	~~Stress grading (7.3)~~
~~AA~~	~~Constant~~	~~None~~	~~Not required (A)~~	~~No test (A)~~	~~Optional (D)~~
~~CA~~	~~Constant~~	~~None~~	~~Other test (C)~~	~~No test (A)~~	~~Optional (D)~~
~~AB~~	~~Constant~~	~~Yes~~	~~Not required (A)~~	~~Impulse test (B)~~	~~Optional (D)~~
~~NOTE 1 The meaning of the letters of the diagnostic test are as follows: A – No test; B – Impulse test; C – Other test (such as dissipation factor and partial discharge tests); D – Visual observation.~~ ~~NOTE 2 Where a diagnostic test is not required on the mainwall insulation, the ageing voltage acts simultaneously as the diagnostic factor.~~					

~~All the above tests are carried out at room temperature. However, if they are to be performed at any other temperature (see 6.2.2), the designation of the test procedure shall include the Celsius temperature in brackets, e.g. AA(190). Each of the procedures may be used for the full evaluation according to 4.5.1 or for the reduced evaluation according to 4.5.2.~~

~~Procedure AA is the preferred choice if the manufacturer has no past experience or knowledge of the candidate system and the behaviour of the mainwall insulation is defined.~~ 4

AVA Documents
Document Sharing Hub

Following test procedures are described:

- Mainwall insulation
- Turn insulation only with the main insulation test
- Conductive slot coating (Annex B)
- Stress control coating (Annex B)
- Mainwall insulation, where voltage level and/or life time differs from the reference system

4.3 Reference insulation system

A reference insulation system should be tested using a test procedure equivalent to that used for the candidate system (see IEC 60034-18-1). The reference insulation system should have service experience at not less than 75 % of the intended maximum rated voltage of the candidate system. When extrapolation of the insulation thickness is used, information such as "different insulation thickness at same electrical field stress levels by obtaining equal or similar breakdown time" should be provided showing the correlation between electrical lifetime and electrical stress for the different insulation thicknesses. If no reference insulation system is available the diagram in Annex A shall be used as criterion.

4.4 Test procedures ~~(IEC 61251)~~

4.4.1 General

Electrical ageing tests are usually performed at fixed voltage levels until failure (mainwall insulation) or in combination with elevated temperature until signs of deterioration occur (conductive slot coating system). Statistical evaluation of the results of testing should be performed according to IEC 62539.

4.4.2 Electrical ageing of the mainwall insulation

From such tests, characteristic times to failure at each voltage level are obtained. The results for both the candidate system and the reference system should be reported on a graph, as shown by the example in Figure 1, and compared. There is no proven physical basis for extrapolation of this characteristic to the service voltage level $U_N/\sqrt{3}$, where U_N is the r.m.s. rated phase to phase voltage. ~~Statistical evaluation of the results of testing should be performed according to IEC 62539.~~

In service, electrical ageing of the mainwall insulation is primarily caused by continuous electrical stress at power frequency. In addition, the insulation is required to withstand transient overvoltage arising from switching surges or inverter supply. The ability of the mainwall insulation to withstand transient overvoltage from converter supplies may be demonstrated by the system's performance using IEC 60034-18-42.

This document describes ~~voltage~~ electrical ageing of the mainwall insulation, carried out at power frequency or ~~at a frequency up to 10 times greater~~ higher. In order to keep acceleration of ageing in a linear progression, a maximum of 10 times of the power frequencies is appropriate. Latest experiences with the application of IEC 60034-18-42 show that a frequency of up to 1 000 Hz can be used as well. Care shall be taken that the dielectric losses do not increase the temperature of the insulation beyond the service temperature to avoid additional thermal ageing effects. (IEC TS 60034-18-33:2010, Table 1).

4.4.3 Electrical ageing of the stress control system

In order to allow a full qualification of the entire insulation system Annex B describes methods to qualify the conductive slot coating and stress control coating. 5

Documents
Document Sharing Hub

Full document details: IEC 60034-18-32 2022 CMV

4.4.4 Electrical ageing of the turn insulation

~~Electrical ageing of the turn insulation can arise due to the steady-state stress applied across the mainwall insulation. This could be particularly significant at the edges of the conductors where the electrical stress reaches a maximum.~~

~~Where multiturn coils or bars are used, the power frequency voltage between turns is sufficiently low that ageing due to this electric stress is not of major significance. However, steep-fronted surges on the winding caused by switching and other disturbances can generate sufficient stress between turns for ageing to take place. Since the waveforms and frequency of occurrence are variable and dependent upon circuit parameters, this International Standard recommends that, for comparison purposes, electrical ageing of the turn insulation be performed using IEC 60034-18-42.~~

In normal direct-on-line operation of rotating machines the turn insulation is subjected to a stress significantly below the partial discharge inception voltage. Continuous electrical ageing is then not taking place and turn insulation qualification is therefore excluded from this document. Withstand against transient overvoltage should be tested according to IEC 60034-15.

In converter fed or other types of special operation the turn insulation may continuously be subjected to a stress above the partial discharge inception voltage. Electrical ageing should then be performed according to IEC 60034-18-42. **6**

4.5 Extent of tests

4.5.1 Full evaluation of the mainwall insulation

The extent of the electrical functional tests will depend upon the purpose of the evaluation. A full evaluation will be needed where there are substantial differences ~~in the compositions of~~ from the reference ~~and candidate systems~~ system according to IEC 60034-18-1.

4.5.2 Reduced evaluation of the mainwall insulation

There are situations when it will be sufficient to carry out reduced evaluation using the minimum number of test specimens and the middle voltage level ~~from~~ used in the ~~range of~~ reference tests.

Comparison of a candidate insulation system to a reference system, where there are no intended or only minor differences in composition or manufacturing procedures (so-called minor changes, see IEC 60034-18-1), may be carried out using only one voltage level but with the recommended minimum number of test specimens (see 5.2). Reduced evaluation is allowed only if the rated voltages are the same for both systems.

~~An example of a minor change might be the sourcing of the same material from a different supplier or a change of pulping process. An example of a minor processing change might be the installation of a new controller or new pipework in a vacuum pressure impregnation (VPI) process. It should be emphasized that a minor change is one which is not expected to have a significant effect on the insulation system. It is the responsibility of the manufacturer to justify the use of the reduced qualification procedure~~

4.5.3 Evaluation of the stress control system

Annex B defines tests and criteria to evaluate conductive slot coating and stress control coating.

Documents
Document Sharing Hub

Full document details: IEC 60034-18-32 2022 CMV

5 Test objects

5.1 Construction of test objects

Test objects should preferably be complete bars or coils made to normal design, material and manufacturing ~~standards~~ procedures. Alternatively, they may be constructed to represent the configuration of the finished winding component to be evaluated and be subjected to the full normal or intended manufacturing processes. When using separate coils or bars as models, creepage distances and any necessary voltage grading are to be appropriate to the stresses applied during testing. A ground electrode should extend the full slot length of the model and ~~encircle~~ cover at least the ~~entire circumference~~ two wide sides of the coil cross-section.

~~The sample preparation and test procedures described in IEC 60034-18-42 may be used for qualifying stress grading systems applied to endwinding insulation.~~

Slot models for GVPI systems shall be made from rigid steel plates, not having any other component inserted than in the actual system present and having a length equal to that of the longest actual stator.

Test bars should be designed not to generate flashover between the end of stress control coating and the end of the conductor of the test bar. For reducing excessive electrical stress on the surface of test bars/coils by applying high voltage and/or high frequency, special treatment, for example extending stress control coating length, can be applied for evaluating the mainwall insulation. See also B.5. 7

~~**5.2 Number of turns**~~

~~For the turn insulation, it is generally necessary to use complete coils in order to include the effects of shaping and conductor reinforcement. The number of turns and the thickness of the turn insulation should be such that when the test voltage chosen in accordance with 6.1 is applied, the turn dielectric stress is not less than the highest that would be imposed by applying the appropriate test voltage to any design of coil for which the insulation system can be used.~~

~~Where a power frequency voltage is to be applied between the turns, the coil should be wound with two parallel conductors, each insulated with turn insulation, or the coil has to be cut in the end windings. When using VPI coils, the cut-through and separation of the conductors in this area have to be done before impregnation. If the test procedure chosen (see 4.2) does not apply a power frequency voltage between the turns, the test object can be a multiturn coil wound in the normal manner with a single (or stranded) conductor.~~ 8

5.2 Number of test specimens

An adequate number of test specimens shall be aged at each test voltage level in order to obtain statistical confidence. This number should not be less than ~~five~~ six bars or three coils for the qualification of the mainwall insulation per each test voltage level. 9

5.3 Initial quality control tests

~~Before starting the first ageing sub-cycle,~~ The following quality control tests shall be performed:

– visual inspection of the test specimens;
– ~~high-voltage tests~~ voltage withstand test according to IEC 60034-1;
– dissipation factor ~~test or/~~and partial discharge test according to IEC 60034-27-3 and IEC 60034-27-1 respectively.

Documents
Document Sharing Hub
Full document details: IEC 60034-18-32 2022 CMV

6 Electrical ageing

6.1 General

It is not practicable to design a single test method that simulates all the interactions between the various insulation components. For example, to obtain a life curve for the mainwall insulation system by applying overvoltage would subject the conductive slot coating to excessive stress. Qualification has therefore been divided into separate test procedures. The primary aim is to establish the lifetime curve of the mainwall insulation from which the expected lives may be estimated. The second aim is to establish that the conductive slot coating and the stress control coating is suitable for service. **10**

6.2 Voltage levels and intended test lives of the mainwall insulation

For full evaluation as described in 4.5.1, at least three power frequency voltages should be selected so that the intended mean time to failure at the highest voltage is about 100 h, and at the lowest voltage ~~above~~ around 5 000 h. For reduced evaluation, where only one voltage level is required (see 4.5.2), the voltage level should be chosen so that the intended mean time to failure is about 1 000 h. The alternating voltage applied to the test objects should be maintained within ± 3 %.

6.3 Test temperatures during electrical endurance testing of the mainwall insulation

6.3.1 Electrical ageing at room temperature

Electrical ageing is preferably carried out in air at room temperature at voltages and/or frequencies higher than those in the steady-state operating conditions, in order to accelerate the effects of electrical stress.

6.3.2 Electrical ageing at elevated temperature

~~Any appropriate means of heating may be used when the electrical ageing tests are performed at elevated temperatures.~~ If the endurance testing is to be performed at elevated temperatures, then either external heating plates or oven heating are permitted (see also Clause B.5). Note that these two methods may not produce the same results. The temperature rise due to the applied electrical stress can affect the results, especially when using increased frequency, and shall be recorded. If thermal ageing does occur, the testing should follow the procedures in IEC 60034-18-33 for multifactor testing.

NOTE Electrical ageing of the mainwall insulation under power frequency and elevated temperature up to service temperature may lead generally to longer time to failure values compared to tests at room temperature at same electrical stress levels.

6.3.3 Ageing procedure for the mainwall insulation

The electrical stress is applied between the stator core or the ~~outer conductive layer~~ mock up / slot electrode on the surface of the test specimen and the conductors. If the test object is a multiturn coil, both the mainwall insulation and partly the turn insulation are aged by the electrical stress during this period. However this procedure does not qualify the turn- to turn insulation. For test procedures with sub-cycles (Clause 7), the duration of these sub-cycles should be such that approximately ten sub-cycles are performed on a test specimen having a median life. Higher than power frequency is allowed to shorten the test times ~~but experience has shown that the maximum acceptable acceleration factor is 10 times the power frequency~~. Latest experiences with the application of IEC 60034-18-42 show that a frequency of up to 1 000 Hz can be used as shown in 4.4.2. Care should be taken that the dielectric losses do not increase the temperature of the insulation ~~so much that the results are affected~~ beyond the service temperature to avoid additional thermal ageing effects. (IEC TS 60034-18-33:2010, Table 1). This is especially important at elevated temperatures. The same frequency should be used for the candidate and reference insulation system. Increased frequency test results may only be used for direct comparison if the lives of the systems are affected similarly by the increase of frequency.

AVA Documents
Document Sharing Hub

~~**6.4 Ageing procedure for the turn insulation**~~

~~Ageing of the turn insulation due to repetitive transient over-voltages is evaluated according to procedure AB in Table 1. The mainwall insulation ageing sub-cycle is followed by a turn insulation ageing sub-cycle consisting of the application of a power frequency voltage between turns for 10 min. This voltage shall be~~

$$\frac{1{,}5 \times U_N}{n}$$

~~where where U_N is the rated voltage of the insulation in kV and n is the number of turns, but not less than $0{,}3 \times U_N$.~~

~~The temperature rise due to the applied electrical stress can affect the results, especially when using increased frequency and should be recorded. Increased frequency test results may only be used for direct comparison if the lives of the systems are affected similarly by the increase in frequency.~~ **11**

6.4 Maintenance of stress ~~grading~~ control coatings

A stress ~~grading~~ control coating is usually applied to the outer surface of the coil or bar beyond the earthed ~~semi-~~conductive slot coating. ~~The stress grading coating may take the form of paints or tapes or a combination of the two.~~ During the electrical endurance test of the main insulation, deterioration may occur which does not result in insulation failure. Remedial action to the stress grading material and forced air cooling are permitted during the progress of the voltage endurance test on the basis that it is the mainwall insulation that is being tested rather than the stress grading system.

7 Diagnostic sub-cycle

7.1 General

No diagnostic tests are required for the qualification of the mainwall insulation but may be performed optionally.

Following each ageing sub-cycle, a diagnostic sub-cycle can be performed. Failure of any part of the test specimen during a diagnostic test constitutes failure of the whole system and shall be reported as such. The appropriate voltage tests are selected according to the chosen test procedure as per 4.2.

7.2 Voltage test~~s~~ of the mainwall insulation

If a diagnostic test on the mainwall insulation is performed it shall be done with a power frequency AC withstand test according to IEC 60034-15. Alternatively, a lighting impulse voltage withstand test according to IEC 60034-15 may be used.

~~**7.2.1 Mainwall insulation test**~~

~~The diagnostic test on the mainwall insulation consists of three successive applications of a 1,2/50 µs impulse voltage with a peak value of $U_p = (4\ U_N + 5\ \text{kV})$. Alternatively, a mainwall power frequency test according to 4.4 of IEC 60034-15 may be used. In this case, an r.m.s. voltage of $(2\ U_N + 1\ \text{kV})$ is applied for 1 min between coil terminals and earth. The applied r.m.s. voltage is then increased at the rate of 1 kV/s up to $2\ (2\ U_N + 1\ \text{kV})$, and then immediately reduced at a rate of at least 1 kV/s to zero.~~

Documents
Document Sharing Hub
Full document details: IEC 60034-18-32 2022 CMV

~~**7.2.2 Turn insulation impulse test**~~

~~For test objects comprising multiturn coils wound with a single or stranded conductor the diagnostic test of the turn insulation is carried out by an impulse voltage test. The amplitude (peak) shall be given by the formula $U'_p = 0{,}65\ (4\ U_N + 5\ \text{kV})$, where U_N is the rated voltage in kV (see IEC 60034-15). The number of impulses to be applied is at least 5.~~

~~**7.2.3 Turn insulation power frequency test**~~

~~For test objects comprising parallel isolated conductors a power frequency voltage of an appropriate magnitude shall be applied between the turns for 1 min. Voltage of an appropriate magnitude should be higher or equal to the highest ageing voltage.~~ **11**

7.3 Other diagnostic tests

Optional diagnostic measurements may be performed for information or to determine end of test life. These may replace the voltage tests. Factors such as insulation resistance, ~~loss tangent, and~~ dielectric dissipation factor, partial discharges and impulse test on the turn-to-turn insulation are examples. An end-point criterion may be established for each diagnostic test, with suitable justification reported.

~~For the stress grading system, there are no electrical tests defined for diagnostic purposes but it may be useful to record the condition of the material, viewed with the unaided eye, in regard to colour and surface imperfections, such as blistering and cracking.~~

8 Failures of the mainwall insulation

8.1 Failure location and verification

Failure of a specimen occurs when any electrical breakdown of the mainwall insulation occurs. This will result in the over-current detection system interrupting current to the high voltage transformer. Failure of the insulation should be verified by re-applying voltage gradually from zero. A specimen insulation failure will prevent the reapplication of the full test voltage. Locating the failure site is desirable and may be undertaken by seeing arcing or heating at the failure site as the voltage is raised. Care shall be taken as locating the failure in applying voltage the local failure area may be additionally damaged and the analysis of the breakdown channel might be more difficult or even impossible. When specimen failure has been verified, the failed sample should be isolated to allow testing to continue on the remaining samples.

Breakdown under stress control coating is acceptable, if only one breakdown of all tested bars/coils at this location occurs. If there is more than one bar or coil affected with a breakdown under the stress control coating, the number of bars or coils needs to be increased to get statistically enough values for the lifetime of the mainwall insulation away from the stress control coating. It is recommended in such a case to review design and manufacturing process for this particular area. **12**

8.2 Failed specimen observations

Each failed specimen should be examined to ensure that the failure is valid for statistical interpretation. This may require some specimen dissection in the area around the insulation puncture to identify the failure location and its probable cause.

~~**8.3 Dimensional measurements**~~

~~The thickness of the insulation wall (mainwall plus turn plus strand) shall be determined at or near the voltage endurance failure site.~~

Documents
Document Sharing Hub

Full document details: IEC 60034-18-32 2022 CMV

9 Functional evaluation of the mainwall data

9.1 General

The evaluation of the test data should follow the guidelines set out below. Under the assumption of a Weibull distribution, the appropriate statistical analysis should be applied to calculate the significance of the candidate sample life with regard to that of the reference sample (see IEC 62539). In order to avoid introducing new ageing phenomena the maximum test voltage shall not exceed 4 times U_N.

The general rule is that the candidate insulation system is considered to be qualified if the 90 % confidence interval of the used probability distribution of the breakdown time falls above or within that obtained from the reference system (see IEC 60034-18-1).

If the reference line, given in Annex A, is used, an interpretation of results is mandatory. An example of evalution and interpretation is given in IEC 60034-18-42.

9.2 Full evaluation (same voltage level and same expected service life)

Electrical endurance graphs of the candidate and the reference system are plotted as a log-log representation of the time to failure (t), as a function of the ratio of test voltage (U_t) and rated voltage (U_N), where U_N is the rated voltage of the reference system and the candidate system. The candidate system is qualified if:

a) the upper 90 % confidence limit of the candidate system exceeds the upper 90 % confidence limit of the reference system over the range of reference system test voltages, or

b) the lower 90 % confidence limit of the candidate system exceeds or is equal to the lower 90 % confidence limit of the reference system at the lowest test voltage and the ~~slope of the~~ regression line of the mean values of the candidate system ~~is steeper~~ has a more gentle slope than that of the reference system.

Ageing results for a candidate system which satisfies condition b) are shown in Figure 1. An example of a candidate system which fails to qualify in respect of either condition a) or b) is shown in Figure 2.

The slope of a modern insulation system for instance containing nano particles may change and case B (Table 1) shall be used for qualification.

Documents
Document Sharing Hub
Full document details: IEC 60034-18-32 2022 CMV

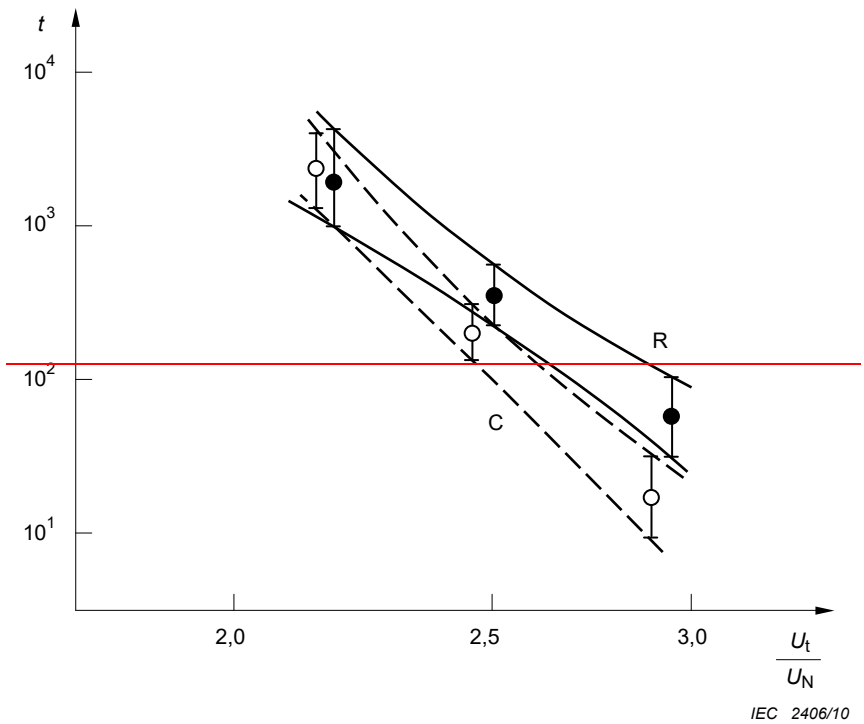

~~**Key**~~

~~R ageing data from the reference insulation system (R) showing the 90 % confidence limits~~

~~C ageing data from the candidate insulation system (C) showing the 90 % confidence limits~~

~~*t* time in hours~~

~~U_t/U_N ratio of test voltage to rated voltage~~

Documents
Document Sharing Hub
Full document details: IEC 60034-18-32 2022 CMV

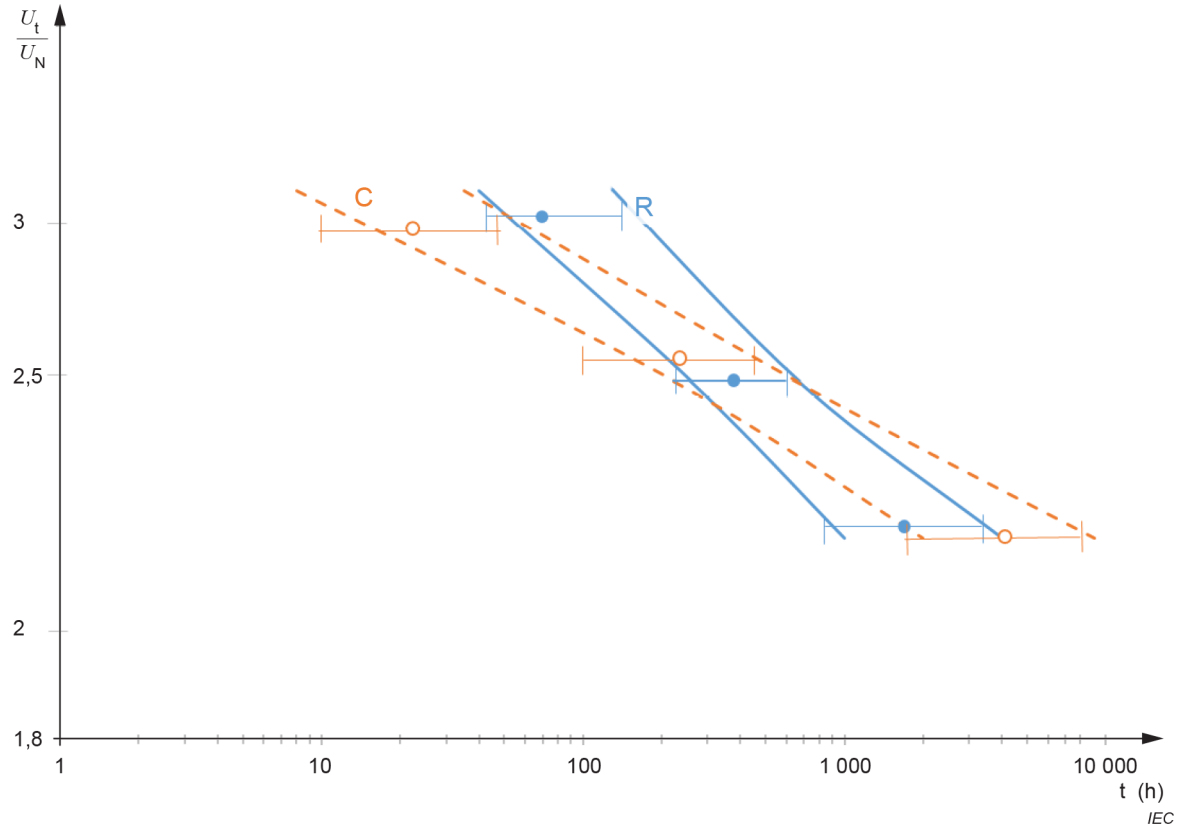

Key

R ageing data from the reference insulation system (R) showing the 90 % confidence limits

C ageing data from the candidate insulation system (C) showing the 90 % confidence limits

t time in hours

U_t/U_N ratio of test voltage to rated voltage

NOTE Abscissa and ordinate are logarithmic based scales. 13

Figure 1 – Comparison of ageing data from candidate (C) and reference (R) insulation systems showing qualification

Documents
Document Sharing Hub
Full document details: IEC 60034-18-32 2022 CMV

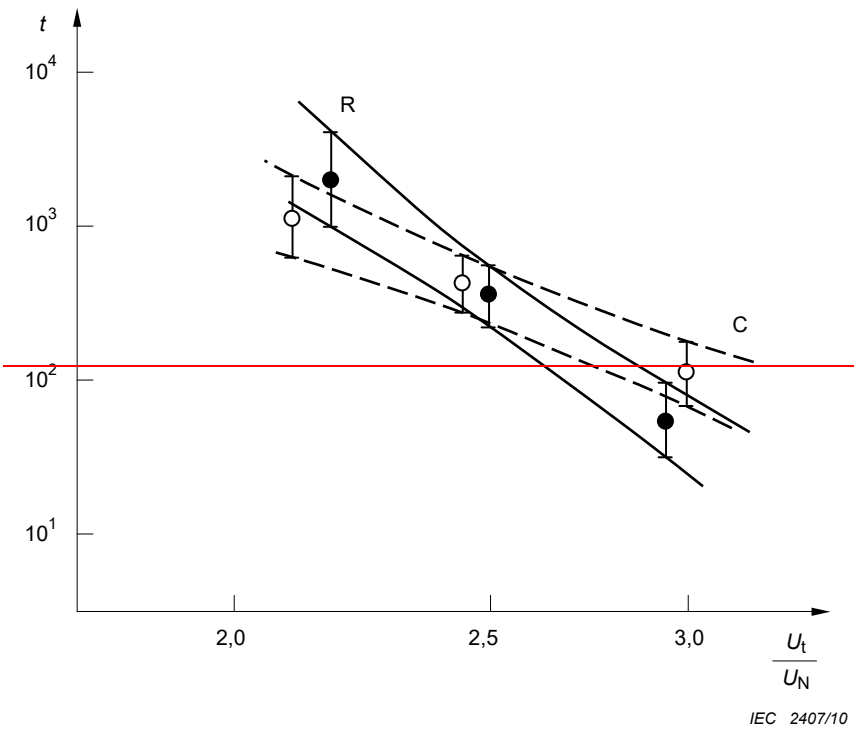

~~**Key**~~

~~R ageing data from the reference insulation system (R) showing the 90 % confidence limits~~

~~C ageing data from the candidate insulation system (C) showing the 90 % confidence limits~~

~~*t* time in hours~~

~~U_t/U_N ratio of test voltage to rated voltage~~

Documents
Document Sharing Hub
Full document details: IEC 60034-18-32 2022 CMV

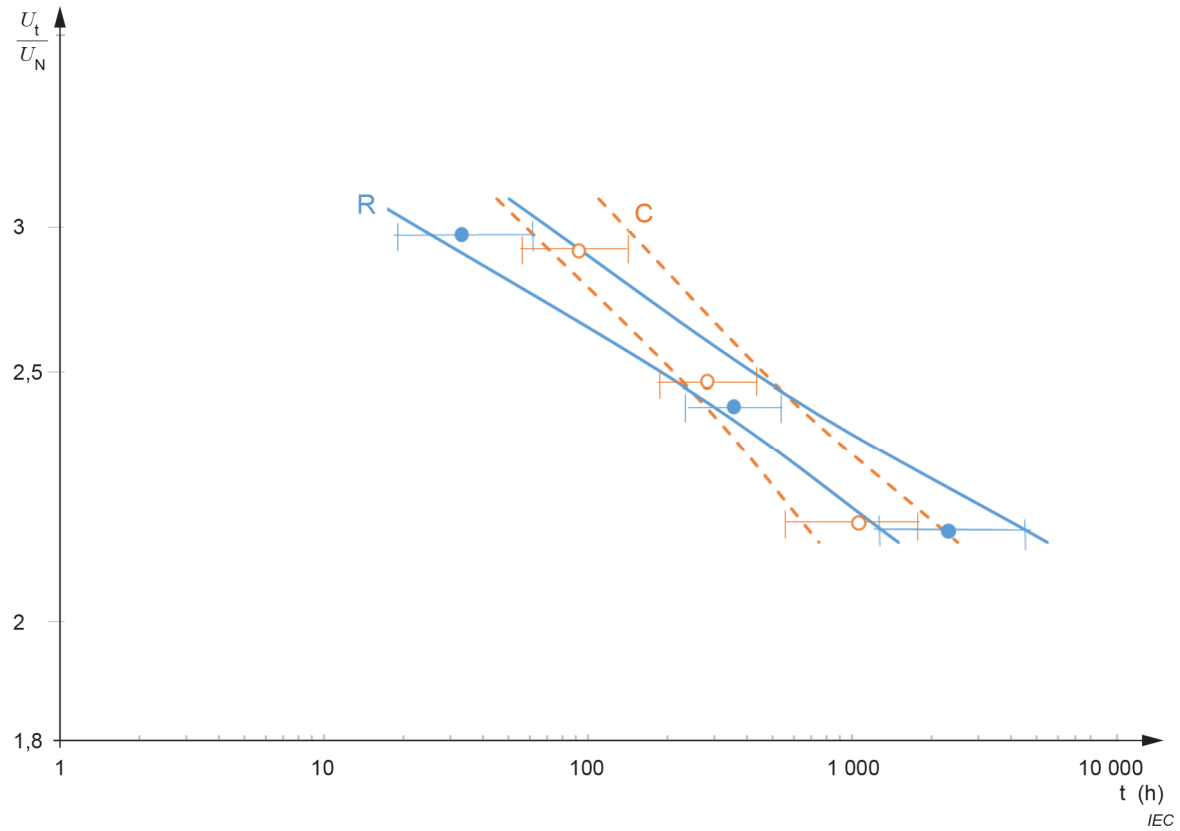

Key

R ageing data from the reference insulation system (R) showing the 90 % confidence limits

C ageing data from the candidate insulation system (C) showing the 90 % confidence limits

t time in hours

U_t/U_N ratio of test voltage to rated voltage

NOTE Abscissa and ordinate are logarithmic based scales.

Figure 2 – Comparison of ageing data from candidate and reference insulation systems showing failure to qualify

9.3 Reduced evaluation (same voltage level and same expected service life)

For reduced evaluation using a single voltage (see 4.5.2), the basis of analysis shall be as shown in Figure 3, where the 90 % tolerance of the 63 % quantile of the ageing results for the candidate system is compared with the 90 % confidence limits of the reference ageing line at the same quantile. If a partial overlap occurs within the voltage range of the ageing tests on the reference system, as shown by candidate system B, it is qualified. Qualification is not achieved in the case of candidate system A because the measurement is outside the voltage range used to produce the reference system ageing line. Nor is qualification achieved in the case of candidate system C since no overlap occurs. Candidate system D is qualified because the results exceed those of the reference system.

Documents
Document Sharing Hub
Full document details: IEC 60034-18-32 2022 CMV

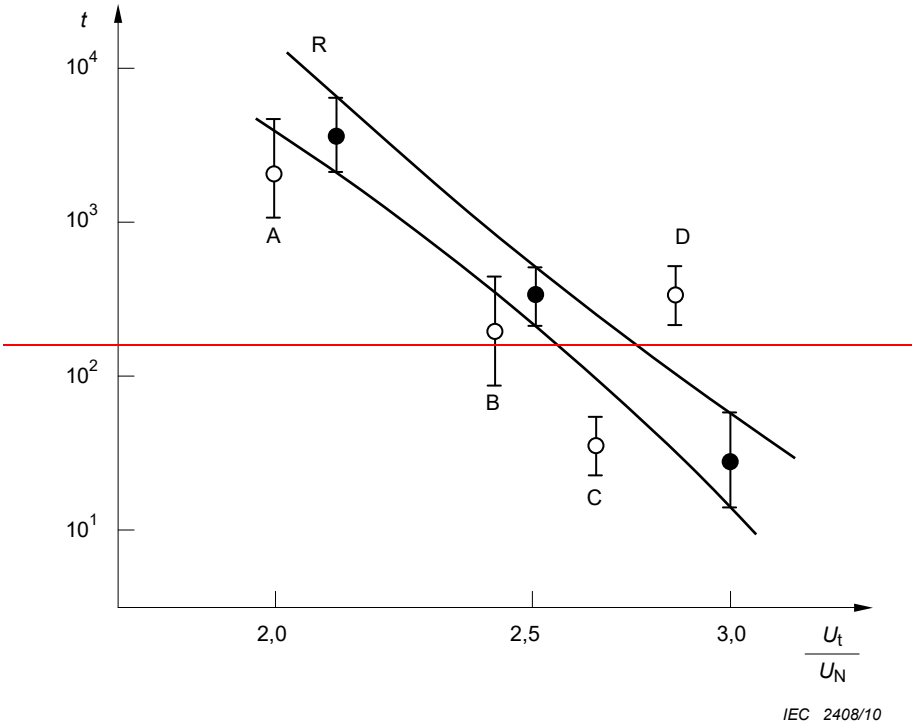

~~**Key**~~

~~R ageing data from the reference insulation system showing the 90 % confidence limits~~

~~A ageing results for candidate system A (not qualified)~~

~~B ageing results for candidate system B (qualified)~~

~~C ageing results for candidate system C (not qualified)~~

~~D ageing results for candidate system D (qualified)~~

~~*t* time in hours~~

~~U_t/U_N ratio of test voltage to rated voltage~~

Documents
Document Sharing Hub
Full document details: IEC 60034-18-32 2022 CMV

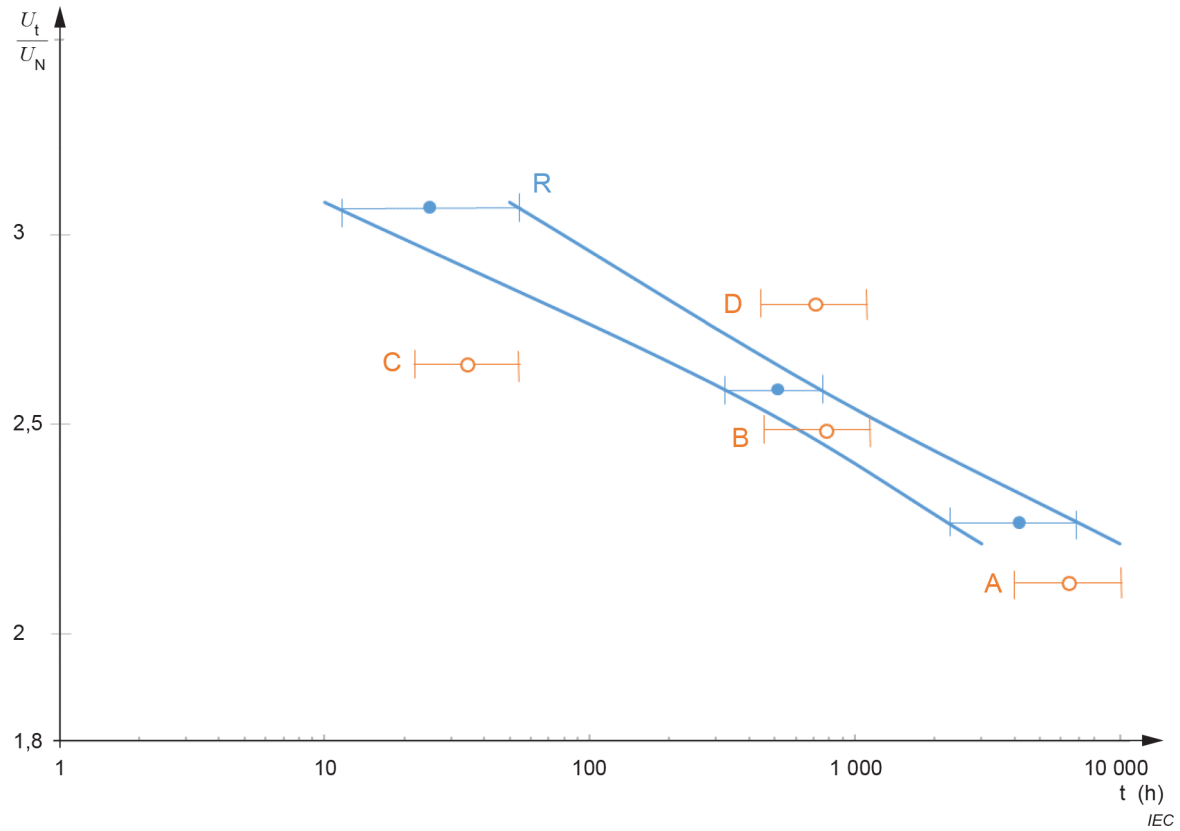

Key

R ageing data from the reference insulation system showing the 90 % confidence limits

A ageing results for candidate system A (not qualified)

B ageing results for candidate system B (qualified)

C ageing results for candidate system C (not qualified)

D ageing results for candidate system D (qualified)

t time in hours

U_t/U_N ratio of test voltage to rated voltage

NOTE Abscissa and ordinate are logarithmic based scales. 13

Figure 3 – Comparison of reduced evaluation test data from four separate candidate systems with that from the reference system

9.4 Recommended data to be recorded

The following items are suggested for inclusion in test records.

- Ambient temperature and humidity in the test area, if the specimens are tested at room temperature
- Applied voltage, expressed in equivalent r.m.s.
- Frequency of applied voltage in Hertz
- Total endurance time of each sample
- Results of any preliminary or intermediate diagnostic tests or measurements
- Observations of failure locations
- Observations on the nature of failure or of stress-grading damage
- Voltage endurance test temperature, i.e., the temperature of the thermocouples embedded in the heater plates

AVA Documents
Document Sharing Hub
Full document details: IEC 60034-18-32 2022 CMV

- Minimum and maximum test voltage and test temperature during the test

It will also be desirable to include other information, such as the nature of the samples, the nature of the electrodes and the nature of the stress-grading material.

9.5 Determining qualification for performances different to the reference system

9.5.1 Overview

The first step is to define the expected service life and rated voltage of the candidate system, then to compare the performance of reference and candidate systems with respect to the qualification criteria given in Table 1. Caution is recommended when qualifying a candidate system for a different voltage and/or service life, because of the assumptions implicit in the approach.

Before proceeding with the evaluation by comparison, it shall be established that the regression lines of the candidate and reference systems fit the data well (it is recommended that the correlation coefficient ≥ 0,98 according IEC 62539) and there is no indication of any change of ageing mechanism within the range of test voltage. If either of the regression lines is non-linear, refer to 9.5.5, where a simple test of linearity is described.

Table 1 – Conditions for qualification of candidate system

	Performance relative to reference system		Test voltage	Qualification criteria
Case	Voltage level	Expected service life		
A	Same	Same	Same	See 9.2
B	Same	Different	Same	Following the appropriate adjustments to the candidate system confidence limits (see description in the text for each case): 1. Confidence interval of candidate system shall overlap or exceed the confidence interval of the reference system. 2. The candidate system shows continually improving performance, i.e., the slope of its regression line is smaller than or equal to the slope of reference system regression line.
C	Different	Same	Different	
D	Different	Different	Different	

In comparing voltage level in relation to life time it is also possible to increase the field strength by either using thinner main insulation at same voltage or increase the voltage level by maintaining the same thickness. Care shall be taken with increased electrical field strength as also the corona system is subject to higher stresses. 14

9.5.2 Case B: Qualification for the same phase to phase voltage and a different expected service life

To qualify the candidate system for the same phase to phase voltage and a different expected service life (Table 1, Case B), the candidate system and reference system are tested using the same test voltage levels.

The candidate confidence limits at each voltage level are shifted on the horizontal axis by an amount equal to the agreed-upon change in service life, within the range $X_R/20$ to $20X_R$, where X_R is the life of the reference system at each voltage level. The candidate system is qualified if its shifted confidence intervals is above the reference interval or if the confidence interval is overlapping than the slope of the candidate system shall be lower or equal to the reference system.

Documents
Document Sharing Hub
Full document details: IEC 60034-18-32 2022 CMV

Figure 4 shows an example of a candidate system assessed for qualification for the same voltage level, and an expected service life double that of the reference system. When the full candidate system line is decreased by a factor of 2, the 90 % confidence limits overlap those of the reference. For simplicity, the shift on the horizontal axis is shown for only the confidence limits at a single voltage level, U_1.

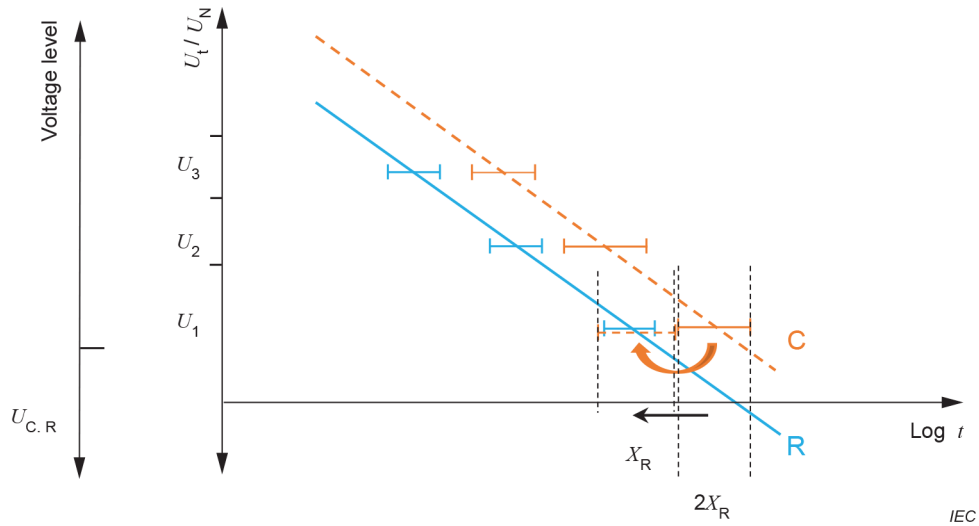

Key

R ageing data from the reference insulation system showing the 90 % confidence limits

C ageing results for candidate system (qualified)

t time in hours

U_t/U_N ratio of test voltage to rated voltage

Figure 4 – Candidate system qualified for the same voltage level and different expected service life

If the candidate system regression line crosses that of the reference system within the range of measurement, it is qualified for a higher service life at $U_{C, R}$ only if it demonstrates improved performance compared to the reference system at $U_{C, R}$ by the required life interval. 15

9.5.3 Case C: Qualification for different voltage level and same expected service life

To qualify a candidate system for a different voltage level and the same expected service life (Table 1, Case C), the candidate system is tested using the voltage levels, which are appropriate to its intended voltage in operation.

The candidate confidence limits at each voltage level are shifted on the vertical axis by an amount equal to the agreed upon change in voltage level. The candidate system is qualified if its shifted confidence interval overlaps or exceeds that of the reference system or the candidate system shows continually improving performance, i.e., the slope of its regression line is lower or equal to the slope of reference system regression line.

Figure 5 shows an example of a candidate system assessed for qualification for the same expected service life at a 15 % higher voltage level, where the confidence interval for the candidate tested is shifted back to the voltage level of the reference. When the vertical axis shift is completed, the confidence intervals overlap or exceed those of the reference system, whereas $U_{C, R}$ is the voltage level of the reference system and $U_{C+15\ \%}$ is the intended voltage level of the candidate.

Documents
Document Sharing Hub
Full document details: IEC 60034-18-32 2022 CMV