

INTERNATIONAL STANDARD

NORME INTERNATIONALE

**Hydraulic turbines, storage pumps and pump-turbines –
Model acceptance tests**

**Turbines hydrauliques, pompes d'accumulation et pompes-turbines –
Essais de réception sur modèle**



THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2019 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

Droits de reproduction réservés. Sauf indication contraire, aucune partie de cette publication ne peut être reproduite ni utilisée sous quelque forme que ce soit et par aucun procédé, électronique ou mécanique, y compris la photocopie et les microfilms, sans l'accord écrit de l'IEC ou du Comité national de l'IEC du pays du demandeur. Si vous avez des questions sur le copyright de l'IEC ou si vous désirez obtenir des droits supplémentaires sur cette publication, utilisez les coordonnées ci-après ou contactez le Comité national de l'IEC de votre pays de résidence.

IEC Central Office
3, rue de Varembe
CH-1211 Geneva 20
Switzerland

Tel.: +41 22 919 02 11
info@iec.ch
www.iec.ch

About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigendum or an amendment might have been published.

IEC publications search - webstore.iec.ch/advsearchform

The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee,...). It also gives information on projects, replaced and withdrawn publications.

IEC Just Published - webstore.iec.ch/justpublished

Stay up to date on all new IEC publications. Just Published details all new publications released. Available online and once a month by email.

IEC Customer Service Centre - webstore.iec.ch/csc

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: sales@iec.ch.

Electropedia - www.electropedia.org

The world's leading online dictionary on electrotechnology, containing more than 22 000 terminological entries in English and French, with equivalent terms in 16 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.

IEC Glossary - std.iec.ch/glossary

67 000 electrotechnical terminology entries in English and French extracted from the Terms and Definitions clause of IEC publications issued since 2002. Some entries have been collected from earlier publications of IEC TC 37, 77, 86 and CISPR.

A propos de l'IEC

La Commission Electrotechnique Internationale (IEC) est la première organisation mondiale qui élabore et publie des Normes internationales pour tout ce qui a trait à l'électricité, à l'électronique et aux technologies apparentées.

A propos des publications IEC

Le contenu technique des publications IEC est constamment revu. Veuillez vous assurer que vous possédez l'édition la plus récente, un corrigendum ou amendement peut avoir été publié.

Recherche de publications IEC -

webstore.iec.ch/advsearchform

La recherche avancée permet de trouver des publications IEC en utilisant différents critères (numéro de référence, texte, comité d'études,...). Elle donne aussi des informations sur les projets et les publications remplacées ou retirées.

IEC Just Published - webstore.iec.ch/justpublished

Restez informé sur les nouvelles publications IEC. Just Published détaille les nouvelles publications parues. Disponible en ligne et une fois par mois par email.

Service Clients - webstore.iec.ch/csc

Si vous désirez nous donner des commentaires sur cette publication ou si vous avez des questions contactez-nous: sales@iec.ch.

Electropedia - www.electropedia.org

Le premier dictionnaire d'électrotechnologie en ligne au monde, avec plus de 22 000 articles terminologiques en anglais et en français, ainsi que les termes équivalents dans 16 langues additionnelles. Egalement appelé Vocabulaire Electrotechnique International (IEV) en ligne.

Glossaire IEC - std.iec.ch/glossary

67 000 entrées terminologiques électrotechniques, en anglais et en français, extraites des articles Termes et Définitions des publications IEC parues depuis 2002. Plus certaines entrées antérieures extraites des publications des CE 37, 77, 86 et CISPR de l'IEC.

INTERNATIONAL STANDARD

NORME INTERNATIONALE

**Hydraulic turbines, storage pumps and pump-turbines –
Model acceptance tests**

**Turbines hydrauliques, pompes d'accumulation et pompes-turbines –
Essais de réception sur modèle**

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

COMMISSION
ELECTROTECHNIQUE
INTERNATIONALE

ICS 27.140

ISBN 978-2-8322-6659-5

**Warning! Make sure that you obtained this publication from an authorized distributor.
Attention! Veuillez vous assurer que vous avez obtenu cette publication via un distributeur agréé.**

CONTENTS

FOREWORD.....	13
1 Scope.....	15
2 Normative references	17
3 Terms, definitions, symbols and units	18
3.1 General.....	18
3.2 General terminology.....	18
3.3 Units.....	20
3.4 Definition of terms, symbols and units.....	20
3.4.1 List of terms and definitions by topic.....	20
3.4.2 Subscripts and symbols	21
3.4.3 Geometric terms	23
3.4.4 Physical quantities and properties	25
3.4.5 Discharge, velocity and speed terms	26
3.4.6 Pressure terms	27
3.4.7 Specific energy terms	27
3.4.8 Height and head terms	30
3.4.9 Power and torque terms.....	32
3.4.10 Efficiency terms.....	34
3.4.11 General terms relating to fluctuating quantities	35
3.4.12 Fluid dynamics and scaling terms ^{a)}	37
3.4.13 Dimensionless terms	38
3.4.14 Terms relating to additional performance data	39
4 Nature and extent of guarantees related to hydraulic performance	40
4.1 General.....	40
4.1.1 Design data and coordination	40
4.1.2 Definition of the hydraulic performance guarantees	40
4.1.3 Guarantees of correlated quantities	41
4.1.4 Form of guarantees	41
4.2 Main hydraulic performance guarantees verifiable by model test.....	41
4.2.1 Guaranteed quantities for any machine.....	41
4.2.2 Specific application.....	42
4.3 Guarantees not verifiable by model test	43
4.3.1 Guarantees on cavitation erosion	43
4.3.2 Guarantees on maximum momentary overspeed and maximum momentary pressure rise	44
4.3.3 Guarantees covering noise and vibration	44
4.4 Additional performance data	44
5 Execution of tests	45
5.1 Requirements of test installation and model.....	45
5.1.1 Choice of laboratory	45
5.1.2 Test installation	45
5.1.3 Model requirements	46
5.2 Dimensional check of model and prototype	49
5.2.1 General	49
5.2.2 Explanation of terms used for model and prototype.....	49
5.2.3 Purpose of dimensional checks.....	49
5.2.4 General rules.....	50

5.2.5	Procedure.....	51
5.2.6	Application for different types of machines.....	52
5.2.7	Methods	52
5.2.8	Accuracy of measurements.....	61
5.2.9	Dimensions of model and prototype to be checked	62
5.2.10	Permissible maximum deviations in geometrical similarity between prototype and model for turbines, pumps and pump-turbines	66
5.2.11	Surface waviness and roughness.....	71
5.3	Hydraulic similitude.....	74
5.3.1	Theoretical basic requirements and similitude numbers	74
5.3.2	Conditions for hydraulic similitude as used in this document.....	74
5.3.3	Similitude requirements for various types of model tests.....	75
5.3.4	Reynolds similitude.....	76
5.3.5	Froude similitude	77
5.3.6	Other similitude conditions.....	80
5.4	Test conditions	81
5.4.1	Determination of test conditions.....	81
5.4.2	Minimum values for model size and test conditions to be fulfilled	82
5.4.3	Stability and fluctuations during measurements	83
5.4.4	Adjustment of the operating point	83
5.5	Test procedures.....	83
5.5.1	Organization of tests.....	83
5.5.2	Inspections and calibrations	86
5.5.3	Execution of tests	88
5.5.4	Faults and repetition of tests	93
5.5.5	Final test report	94
5.6	Introduction to the methods of measurement.....	95
5.6.1	General	95
5.6.2	Measurements related to the main hydraulic performance guarantees	95
5.6.3	Measurements related to additional data	97
5.6.4	Acquisition and processing of data	97
5.7	Physical properties	97
5.7.1	General	97
5.7.2	Acceleration due to gravity	97
5.7.3	Physical properties of water.....	98
5.7.4	Physical conditions of atmosphere.....	104
5.7.5	Density of mercury.....	104
6	Main hydraulic performances: methods of measurement and results.....	105
6.1	Data acquisition and data processing.....	105
6.1.1	Overview	105
6.1.2	General requirements	105
6.1.3	Data acquisition.....	105
6.1.4	Component requirements.....	107
6.1.5	Check of the data acquisition system.....	110
6.2	Discharge measurement	112
6.2.1	General	112
6.2.2	Choice of the method of measurement.....	112
6.2.3	Accuracy of measurement	113
6.2.4	Primary methods	114

6.2.5	Secondary methods	115
6.3	Pressure measurement	118
6.3.1	General	118
6.3.2	Choice of pressure-measuring section	119
6.3.3	Pressure taps and connecting lines	119
6.3.4	Apparatus for pressure measurement	121
6.3.5	Calibration of pressure measurement apparatus	128
6.3.6	Vacuum measurements	129
6.3.7	Uncertainty in pressure measurements	129
6.4	Free water level measurement (see also ISO 4373)	129
6.4.1	General	129
6.4.2	Choice of water level measuring sections	130
6.4.3	Number of measuring points in a measuring section	130
6.4.4	Measuring methods	130
6.4.5	Uncertainty in free water level measurement	131
6.5	Determination of E and $NPSE$	132
6.5.1	General	132
6.5.2	Determination of the specific hydraulic energy E	133
6.5.3	Simplified formulae for E	135
6.5.4	Determination of the net positive suction-specific energy $NPSE$	142
6.6	Shaft torque measurement	144
6.6.1	General	144
6.6.2	Methods of torque measurement	144
6.6.3	Methods of absorbing/generating power	145
6.6.4	Layout of arrangement	145
6.6.5	Checking of system	150
6.6.6	Calibration	150
6.6.7	Uncertainty in torque measurement (at a confidence level of 95 %)	151
6.7	Rotational speed measurement	152
6.7.1	General	152
6.7.2	Methods of speed measurement	152
6.7.3	Checking	152
6.7.4	Uncertainty of measurement	152
6.8	Computation and presentation of test results	153
6.8.1	General	153
6.8.2	Power, discharge and efficiency in the guarantee range	158
6.8.3	Computation of steady-state runaway speed and discharge	171
6.9	Error analysis	176
6.9.1	Definitions	176
6.9.2	Determination of uncertainties in model tests	178
6.10	Comparison with guarantees	182
6.10.1	General	182
6.10.2	Interpolation curve and total uncertainty bandwidth	183
6.10.3	Power, discharge and/or specific hydraulic energy and efficiency in the guarantee range	184
6.10.4	Runaway speed and discharge	188
6.10.5	Cavitation guarantees	189
7	Additional performance data – Methods of measurement and results	191
7.1	Introduction to additional data measurement	191

7.1.1	General	191
7.1.2	Test conditions and test procedures	192
7.1.3	Uncertainty in measurements	192
7.1.4	Model to prototype conversion	192
7.2	Fluctuating quantities	193
7.2.1	Data acquisition and processing for measurement of fluctuating quantities	193
7.2.2	Pressure fluctuations	197
7.2.3	Shaft torque fluctuations	213
7.3	Axial and radial thrust	214
7.3.1	General	214
7.3.2	Hydraulic axial thrust	215
7.3.3	Radial thrust	223
7.4	Hydraulic loads on control components	226
7.4.1	General	226
7.4.2	Guide vane torque	227
7.4.3	Runner blade torque	233
7.4.4	Pelton needle force and deflector torque	237
7.5	Testing in an extended operating range	241
7.5.1	General	241
7.5.2	Four quadrants	241
7.5.3	Operating modes (see Figure 116)	243
7.5.4	Scope of tests	244
7.5.5	Methods of testing in the extended operating range	246
7.6	Differential pressure measurement in view of prototype index test	248
7.6.1	General	248
7.6.2	Purpose of test	249
7.6.3	Execution of test	249
7.6.4	Analysis of test results	249
7.6.5	Transposition to prototype conditions	250
7.6.6	Uncertainty	250
Annex A (informative)	Dimensionless terms	251
Annex B (normative)	Physical properties, data	253
Annex C (informative)	Summarized test and calculation procedure	261
C.1	General	261
C.2	Agreements to be reached prior to testing	261
C.3	Model, test facility and instrumentation	262
C.3.1	Model manufacture and dimensional checks	262
C.3.2	Test facility instrumentation and data acquisition system	262
C.4	Tests and calculation of the model values	262
C.4.1	Test types	262
C.4.2	Measurement of the main quantities during the test	263
C.4.3	Uncertainty of the measured quantities	263
C.4.4	Calculation of the quantities related to the main hydraulic performance	263
C.4.5	Calculation of the dimensionless factors or coefficients and of the Thoma number	263
C.4.6	Determination of δ_{ref} for the transposition of efficiency	264
C.4.7	Calculation of efficiency and power coefficients referred to Re_M^*	264

C.4.8	Correction of the model-measured values taking into account the influence of cavitation	264
C.5	Calculation of prototype quantities	264
C.6	Plotting of model or prototype results	264
C.7	Comparison with the guarantees	265
C.8	Final protocol	265
C.9	Final test report	265
Annex D (normative)	The scale effect on hydraulic efficiency for reaction machines	266
D.1	Basic statements and assumptions	266
D.2	Efficiency transposition formulae	266
D.2.1	Derivation of the general formula for efficiency transposition	266
D.2.2	Amount of relative scalable losses in the range of guaranteed efficiencies	267
D.2.3	Determination of the effect of scaling on the efficiency of the model	269
D.2.4	Determination of the formula for the transposition of efficiency from model to prototype	271
Annex E (informative)	Comparison of the hydraulic efficiency transposition methods of IEC 60193 and IEC 62097 for reaction machines	273
E.1	IEC 60193 transposition method	273
E.1.1	Applications	273
E.1.2	Limitations	273
E.2	IEC 62097 transposition method	274
E.2.1	Applications	274
E.2.2	Limitations	274
Annex F (normative)	Computation of the prototype runaway characteristics taking into account friction and windage losses of the unit	275
Annex G (informative)	Example of determination of the best smooth curve: method of separate segments	276
G.1	General	276
G.2	Principle of the method	276
G.3	Choice of the minimum width of the intervals	278
G.4	Determination of the intervals	278
Annex H (informative)	Examples of analysis of sources of error and uncertainty evaluation	279
H.1	General	279
H.2	Example of analysis of sources of error and of uncertainty evaluation in the measurement of a physical quantity	279
H.2.1	General	279
H.2.2	Errors arising during calibration	280
H.2.3	Errors arising during the tests	281
H.3	Example of calculation of uncertainty due to systematic errors in the determination of the specific hydraulic energy, mechanical runner/impeller power and hydraulic efficiency	281
H.3.1	General	281
H.3.2	Discharge	282
H.3.3	Pressure	282
H.3.4	Specific hydraulic energy	282
H.3.5	Power	283
H.3.6	Hydraulic efficiency	283
H.4	Example of calculation of uncertainty due to systematic errors in the determination of the net positive suction specific energy	284

H.4.1	General	284
H.4.2	Discharge	284
H.4.3	Pressure	284
H.4.4	Net positive suction specific energy	284
Annex I (normative)	The scale effect on hydraulic efficiency for Pelton turbines	286
I.1	General	286
I.2	Similarity considerations	286
I.3	Transposition formula	288
Annex J (normative)	Analysis of random errors for a test at constant operating conditions	289
J.1	General	289
J.2	Standard deviation	289
J.3	Confidence levels	290
J.4	Student's <i>t</i> distribution	290
J.5	Maximum permissible value of uncertainty due to random errors	291
J.6	Example of calculation	292
Annex K (normative)	Calculation of plant Thoma number σ_{pl}	293
K.1	Definition of σ_{pl} , <i>NPSE</i> and <i>NPSH</i>	293
K.2	Data needed to calculate σ_{plc}	294
Annex L (informative)	Flux diagram of specific hydraulic energy, flow and power	296
Annex M (informative)	Synchronous and asynchronous components of pressure signals	299
Annex N (informative)	Natural frequency of the hydraulic system	301
Annex O (informative)	Calculation of axial force components	302
O.1	General	302
O.2	Calculating the force acting on the runner crown (F_2)	302
O.2.1	General	302
O.2.2	Pressure specific energy losses due to seal clearance	302
O.2.3	Pressure specific energy losses through the centrifugal zones between the stationary and rotating parts	304
O.2.4	Pressure specific energy losses in a pressure relief/equilibrium pipe	305
O.2.5	Additional specific energy losses	306
O.3	Calculating the force acting on the runner band (F_3)	307
Bibliography		308
Figure 1–	Schematic representation of a hydraulic machine	22
Figure 2 –	Guide vane opening and angle	22
Figure 3 –	Reference diameter and bucket width	24
Figure 4 –	Determination of σ_0 and σ_1 for typical cavitation curves	29
Figure 5 –	Reference level of machine	31
Figure 6 –	Flux diagram for power and discharge	33
Figure 7 –	Illustration of some definitions related to oscillating quantities	36
Figure 8 –	Procedure for dimensional checks, comparison of results "steel to steel" and application of tolerances for model and prototype	51
Figure 9 –	Example of spiral case and distributor dimensions to be checked	54
Figure 10 –	Example of draft tube dimensions to be checked	54

Figure 11 – Example of the dimensions to be checked on a bulb unit.....	55
Figure 12 – Example of the dimensions to be checked on the runner/impeller of a radial flow machine	56
Figure 13 – Runner/impeller of radial flow machine: examples of locations for blade profile measuring sections for templates or measuring points for CMM	57
Figure 14 – Runner/impeller of radial flow machine: check of outlet width and blade profiles by means of templates as illustrated on a Francis runner	57
Figure 15 – Runner/impeller of radial flow machine: check of inlet and outlet widths between blades (example of a pump-turbine runner).....	58
Figure 16 – Runner/impeller of axial flow machine: example of locations for blade profile measuring sections for templates or measuring points for CMM	58
Figure 17 – Runner/impeller of axial flow machine: definition of blade adjustment and of blade profile tolerances.....	58
Figure 18 – Pelton turbine: example of dimensions to be checked on the distributor and the housing of vertical and horizontal shaft machines	59
Figure 19 – Pelton turbine: example of dimensions to be checked on the buckets and nozzles	60
Figure 20 – Definition of waviness and surface roughness	72
Figure 21 – Low specific hydraulic energy turbine example of recommended maximum surface roughness values on the runner blades (pressure side and suction side).....	73
Figure 22 – Relation between the setting level z_f of a Francis turbine and the cavitation reference level z_c	78
Figure 23 – Dependence of σ values on level z for model and prototype	78
Figure 24 – Acceleration due to gravity g ($m \cdot s^{-2}$)	98
Figure 25 – Density of distilled water ρ_{wd} ($kg \cdot m^{-3}$)	101
Figure 26 – Time multiplexing data acquisition system.....	106
Figure 27 – Bus operated data acquisition system	107
Figure 28 – Time delay	108
Figure 29 – Typical low-pass filter attenuation characteristics	109
Figure 30 – Different measurement chains and their recommended checkpoints	111
Figure 31 – Examples of pressure taps	120
Figure 32 – Types of pressure manifolds: a) with separate connecting lines to manifold and b) with ring manifold.....	121
Figure 33 – Examples of experimental setup of liquid column manometers	123
Figure 34 – Dead weight manometer with compensation by pressure or force transducer (example of experimental set-up)	126
Figure 35 – Pressure weighbeam (example of experimental set-up).....	127
Figure 36 – Stilling well.....	130
Figure 37 – Point and hook gauges.....	131
Figure 38 – Example showing main elevations, heights and reference levels of the test rig and model machine.....	134
Figure 39 – Determination of specific hydraulic energy through differential pressure measuring instrument	137
Figure 40 – Determination of specific hydraulic energy of the machine through separate measurement of gauge pressures	138
Figure 41 – Determination of specific hydraulic energy of the machine through separate measurement of pressures by water column manometers.....	139

Figure 42 – Pelton turbines with vertical axis: determination of specific hydraulic energy of the machine	140
Figure 43 – Pelton turbines with horizontal axis: determination of specific hydraulic energy of the machine	141
Figure 44 – Low-head machines: determination of specific hydraulic energy of the machine using free water levels	142
Figure 45 – Determination of net positive suction energy <i>NPSE</i> and net positive suction head <i>NPSH</i>	143
Figure 46 – Balance arrangement	146
Figure 47 – Balance arrangement with gear	147
Figure 48 – Balance arrangement with two separate frames	147
Figure 49 – Arrangement with machine bearings and seals not in balance	147
Figure 50 – Arrangement with lower bearing and seal not in balance	148
Figure 51 – Arrangement with intermediate bearing and seal not in balance	148
Figure 52 – Arrangement using a torquemeter	148
Figure 53 – Arrangement using a torquemeter with machine bearings and seals in balance	149
Figure 54 – Arrangement using a torquemeter with machine bearings and seals not in balance	149
Figure 55 – Choosing the appropriate transposition method	153
Figure 56 – Single-regulated (Francis) model turbine: performance hill diagram (discharge factor versus speed factor)	155
Figure 57 – Single-regulated (Francis) model turbine: performance hill diagram (energy coefficient versus discharge coefficient)	155
Figure 58 – Double-regulated (Kaplan) model turbine: performance hill diagram	156
Figure 59 – Single-regulated (radial) model pump: performance diagram	156
Figure 60 – Double-regulated model pump: performance diagram	157
Figure 61 – Pelton model turbine: performance hill diagram (example for a six-nozzle machine)	157
Figure 62 – Single-regulated (radial) model pump-turbine: general four-quadrant diagram	158
Figure 63 – Reaction machines: procedure for calculating test results in view of comparison with guarantees	159
Figure 64 – Single-regulated turbine: three-dimensional surface of hydraulic efficiency and curves of performance at E_{nD} constant	161
Figure 65 – Single-regulated pump: performance curves	162
Figure 66 – Double-regulated turbine: performance curves at E_{nD} constant	163
Figure 67 – Double-regulated pump: performance curves at E_{nD} constant	164
Figure 68 – Non-regulated turbine: performance curves	165
Figure 69 – Non-regulated pump: performance curves	166
Figure 70 – Efficiency curve correction in order to take into account cavitation influence (e.g. tubular machines at overload operation)	167
Figure 71 – Francis model turbine: cavitation curves	167
Figure 72 – Model pump: cavitation curves	167
Figure 73 – Francis model turbine cavitation curves: examples of limits for application of transposition formula	169
Figure 74 – Runaway curves for a single-regulated turbine (Francis)	172

Figure 75 – Runaway curves for a single-regulated turbine (six-nozzle Pelton)	172
Figure 76 – Runaway speed determined by extrapolation: example for a single-regulated turbine (Francis).....	172
Figure 77 – Influence of Thoma number on runaway speed and discharge of a single-regulated turbine (Francis).....	173
Figure 78 – Influence of the Thoma number on runaway speed and discharge of a double-regulated turbine (Kaplan).....	174
Figure 79 – Influence of the Thoma number on the off-cam runaway curves of a double-regulated turbine (Kaplan).....	174
Figure 80 – Example of calibration curve	178
Figure 81 – Single-regulated machine.....	184
Figure 82 – Double-regulated machine	184
Figure 83 – Single-regulated turbine: comparison between guarantees and measurements	185
Figure 84 – Non-regulated turbine: comparison between guarantees and measurements	186
Figure 85 – Non-regulated pump: comparison between guarantees and measurements	187
Figure 86 – Francis turbine runaway speed and discharge curves: comparison between guarantees and measurements	189
Figure 87 – Model turbine cavitation curve and comparison with the guarantee on the influence of the cavitation on the efficiency.....	190
Figure 88 – Typical data acquisition system.....	194
Figure 89 – Frequency response of analogue anti-aliasing filter	195
Figure 90 – Suggested locations of transducers.....	200
Figure 91 – Pump diagram with exploration paths	202
Figure 92 – Turbine hill-chart with exploration paths	203
Figure 93 – Normal pump mode operation of an $n_{QE} = 0,102$ pump-turbine model	205
Figure 94 – Zero discharge operation (10 % guide vane opening) of an $n_{QE} = 0,102$ pump-turbine model	205
Figure 95 – Part load operation of an $n_{QE} = 0,321$ Francis turbine model: $Q_{nD}/Q_{nDopt} = 0,719$	206
Figure 96 – Higher part load operation of an $n_{QE} = 0,226$ Francis turbine model: $Q_{nD}/Q_{nDopt} = 0,764$	207
Figure 97 – Full load operation of an $n_{QE} = 0,173$ Francis turbine model: $Q_{nD}/Q_{nDopt} = 1,218$	208
Figure 98 – Example of waterfall diagram of pressure fluctuations in the draft tube of a Francis turbine, transducer p_1	209
Figure 99 – Example of summarized diagram of pressure fluctuations in the draft tube of a Francis turbine, transducer p_2	210
Figure 100 – Interaction of the external system with sources of pressure fluctuations from the hydraulic machine	211
Figure 101 – Definition of coordinate system	214
Figure 102 – Individual elements of axial force acting on a radial machine.....	216
Figure 103 – Typical testing arrangement for axial thrust measurement	218
Figure 104 – Typical calibration arrangement for axial thrust measurement	219

Figure 105 – Axial force factor versus discharge factor at different constant specific hydraulic energies in pump mode.....	221
Figure 106 – Axial force factor versus speed factor measured at different guide vane openings in the four quadrants of a pump-turbine	221
Figure 107 – Typical arrangements for radial thrust measurement (horizontal or vertical shaft)	224
Figure 108 – Design examples for torque measuring guide vanes	228
Figure 109 – Guide vane torque factor versus guide vane angle measured at different constant specific hydraulic energies in turbine mode.....	230
Figure 110 – Guide vane torque factor versus guide vane angle measured at different constant specific hydraulic energies in pump mode.....	231
Figure 111 – Guide vane torque factor versus speed factor measured at different constant guide vane angles in the four quadrants of a pump-turbine	231
Figure 112 – Example for runner blade torque measuring arrangement using telemetry.....	234
Figure 113 – Performance and hydraulic runner blade torque characteristics of an axial turbine measured at one constant runner blade angle β and various constant guide vane angles α	236
Figure 114 – Pelton needle force factor as a function of relative needle stroke	240
Figure 115 – Example of four quadrants operation of a radial-type pump-turbine	242
Figure 116 – Chart illustrating the various operating modes.....	244
Figure 117 – S-shape characteristics in turbine brake mode	247
Figure 118 – Characteristic of a pump with positive slope range in a limited discharge range	247
Figure 119 – Example of graphical representation of index test data.....	250
Figure D.1 – Efficiency change in hydraulically similar operating conditions A and B having different Re values	267
Figure D.2 – Variation of relative scalable losses	268
Figure D.3 – Transposition curve for model efficiency using best efficiency point.....	270
Figure D.4 – Efficiency increase from constant Re_{M*} to constant Re_P	271
Figure D.5 – Efficiency increase from different Re_M to constant Re_P	272
Figure F.1 – Single-regulated turbine: determination of the maximum runaway speed of the prototype taking into account the friction and windage losses of the unit	275
Figure G.1 – Principle of the method of separate segments	277
Figure G.2 – Example of determination of intervals	277
Figure I.1 – Influence of Froude number	287
Figure I.2 – Influence of Weber number	288
Figure I.3 – Influence of Reynolds number	288
Figure K.1 – Definition for determination of net positive suction energy, $NPSE$, and net positive suction head, $NPSH$, of a prototype machine ($E_{LS} \neq 0$).....	293
Figure L.1 – Turbine	296
Figure L.2 – Pump	297
Figure M.1 – a) Representation of asynchronous pressure pulsation and location of pressure transducers, and b) synchronous and c) asynchronous parts of the pressure signal.....	300
Figure O.1 – Crown seal clearance	304
Figure O.2 – Crown radius	305
Figure O.3 – Pressure relief pipe	306

Figure O.4 – Runner band seal	307
Table 1 – Permissible maximum deviations	68
Table 2 – Maximum recommended prototype surface roughness R_a	73
Table 3 – Similitude numbers	74
Table 4 – Similitude requirements for various types of model tests	76
Table 5 – Minimum values for model size and test parameters	82
Table 6 – Coefficients of the Herbst and Roegenier formula	100
Table 7 – Minimum test specific hydraulic energy	102
Table 8 – Nomenclature for Figure 46 to Figure 54	146
Table 9 – Variables defining the operating point of a machine	154
Table 10 – Summary of errors that determine total measurement uncertainty	179
Table 11 – Definition of individual force elements of axial thrust	217
Table 12 – Non-hydraulic forces influencing radial thrust measurement	225
Table 13 – Definition of quadrants and operating modes	242
Table B.1 – Acceleration due to gravity g ($\text{m}\cdot\text{s}^{-2}$)	253
Table B.2 – Density of distilled water ρ_{Wd} ($\text{kg}\cdot\text{m}^{-3}$) (1 of 2)	254
Table B.3 – Kinematic viscosity of distilled water ν ($\text{m}^2\cdot\text{s}^{-1}$)	256
Table B.4 – Vapour pressure of distilled water p_{Va} (Pa)	257
Table B.5 – Density of dry air ρ_a ($\text{kg}\cdot\text{m}^{-3}$)	258
Table B.6 – Ambient pressure p_{amb} (Pa)	259
Table B.7 – Density of mercury ρ_{Hg} ($\text{kg}\cdot\text{m}^{-3}$)	260
Table D.1 – V_{ref} values	269
Table I.1 – Numerical data for surface tension σ^*	287
Table J.1 – Confidence levels	290
Table J.2 – Values of Student's t	291
Table J.3 – Computation of the estimated standard deviation and the uncertainty for eight observations	292
Table K.1 – Summary of calculated σ_{plc} values and other relevant data	295

INTERNATIONAL ELECTROTECHNICAL COMMISSION

**HYDRAULIC TURBINES, STORAGE PUMPS AND PUMP-TURBINES –
MODEL ACCEPTANCE TESTS**

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as “IEC Publication(s)”). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

International Standard IEC 60193 has been prepared by IEC technical committee 4: Hydraulic turbines.

This third edition cancels and replaces the second edition published in 1999. This edition constitutes a technical revision.

This edition includes the following significant technical changes with respect to the previous edition:

- a) update to methods/measuring tools currently used for checking dimensions on both model and prototype;
- b) update to requirements of accuracy in the dimensional check procedure as a result of new technology;

- c) merging of tables/sections with redundant information in dimension check in 5.2;
- d) update to methods of measuring discharge;
- e) update to pressure fluctuation methods and terminology;
- f) specification of measuring times for accurate pressure fluctuation analyses in the model;
- g) redefine definition for the transposition of pressure fluctuations to prototype;
- h) update to surface waviness requirements in prototype;
- i) redefining methods/references in clause on cavitation nuclei content (5.7.3.2.2);
- j) update to 7.3 and review of methods on radial thrust measurements;
- k) update to 7.4 (Hydraulic loads on control components);
- l) update and develop methodology in 7.5 for testing in the extended operating range;
- m) update to 7.6 concerning index testing;
- n) update to methods for measuring roughness;
- o) updates to references;
- p) updates to figures;
- q) revision of sigma definition;
- r) reference to new method of transposition in accordance with IEC 62097.

The text of this International Standard is based on the following documents:

FDIS	Report on voting
4/371/FDIS	4/373/RVD

Full information on the voting for the approval of this International Standard can be found in the report on voting indicated in the above table.

This document has been drafted in accordance with the ISO/IEC Directives, Part 2.

The committee has decided that the contents of this document will remain unchanged until the stability date indicated on the IEC website under "<http://webstore.iec.ch>" in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

HYDRAULIC TURBINES, STORAGE PUMPS AND PUMP-TURBINES – MODEL ACCEPTANCE TESTS

1 Scope

This document applies to laboratory models of any type of impulse or reaction hydraulic turbine, storage pump or pump-turbine.

This document applies to models of prototype machines either with unit power greater than 5 MW or with reference diameter greater than 3 m. Full application of the procedures herein prescribed is not generally justified for machines with smaller power and size. Nevertheless, this document may be used for such machines by agreement between the purchaser and the supplier.

In this document, the term "turbine" includes a pump-turbine operating as a turbine and the term "pump" includes a pump-turbine operating as a pump.

This document excludes all matters of purely commercial interest, except those inextricably bound up with the conduct of the tests.

This document is concerned with neither the structural details of the machines nor the mechanical properties of their components, so long as these do not affect model performance or the relationship between model and prototype performances.

This document covers the arrangements for model acceptance tests to be performed on hydraulic turbines, storage pumps and pump-turbines to determine if the main hydraulic performance contract guarantees (see 4.2) have been satisfied.

It contains the rules governing test conduct and prescribes measures to be taken if any phase of the tests is disputed.

The main objectives of this document are:

- to define the terms and quantities used;
- to specify methods of testing and of measuring the quantities involved, in order to ascertain the hydraulic performance of the model;
- to specify the methods of computation of results and of comparison with guarantees;
- to determine if the contract guarantees that fall within the scope of this document have been fulfilled;
- to define the extent, content and structure of the final report.

The guarantees can be given in one of the following ways:

- guarantees for prototype hydraulic performance, computed from model test results considering scale effects;
- guarantees for model hydraulic performance.

Moreover, additional performance data (see 4.4) can be needed for the design or the operation of the prototype of the hydraulic machine. Contrary to the requirements of Clauses 4 to 6 related to main hydraulic performance, the information of these additional data given in Clause 7 is considered only as recommendation or guidance to the user (see 7.1).

It is particularly recommended that model acceptance tests be performed if the expected field conditions for acceptance tests (see IEC 60041:1991) would not allow the verification of guarantees given for the prototype machine.

A transposition method taking into account the model and prototype wall surface roughness for the performance conversion on pump-turbines, Francis turbines, and axial machines is described in IEC 62097. This method requires model and prototype surface roughness data and takes into account the shift in η_{ED} , Q_{ED} and P_{ED} factors for determining the transposition of efficiency between model and prototype. However, in the case of Francis machines with semi-spiral casing and axial machines, the transposition method has not been fully validated due to a lack of data. In addition, IEC 62097 does not apply to storage pumps, Pelton turbines, and Dériaz. Therefore, for these and otherwise specifically agreed upon cases where hydraulically smooth flow conditions are assumed on the model and the prototype, the transposition formula and procedure given in Annex D and Annex I can be applied. Applications and limitations of both this document and IEC 62097 transposition methods are discussed in Annex E.

The method for performance conversion from model to prototype needs to be clearly defined in the main hydraulic performance contract.

This document may also be applied to model tests for other purposes, i.e. comparative tests and research and development work.

If model acceptance tests have been performed, field tests can be limited to index tests (see IEC 60041:1991).

If a contradiction is found between this document and any other document, this document prevails.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 62097:2009, *Hydraulic machines, radial and axial – Performance conversion method from model to prototype*

ISO 2186:2007, *Fluid flow in closed conduits – Connections for pressure signal transmissions between primary and secondary elements*

ISO 2533:1975, *Standard atmosphere*

ISO 4185:1980, *Measurement of liquid flow in closed conduits – Weighing method*

ISO 4287:1997, *Geometrical Product Specifications (GPS) – Surface texture: Profile method – terms, definitions and surface texture parameters*

ISO 8316:1987, *Measurement of liquid flow in closed conduits – Method by collection of the liquid in a volumetric tank*

3 Terms, definitions, symbols and units

3.1 General

For the purposes of this document, the following common terms, definitions, symbols and units apply. Specialized terms are explained where they appear.

Clarification of any term, definition or unit of measure in question shall be agreed to in writing by the contracting parties in advance of the test.

For the purposes of this document, the following terms and definitions apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <http://www.electropedia.org/>
- ISO Online browsing platform: available at <http://www.iso.org/obp>

3.2 General terminology

3.2.1

point

value established by one or more consecutive sets of readings and/or recordings at unchanged operating condition and settings, sufficient to calculate the performance of the machine at this operating condition and these settings

3.2.2

test

collection of points and results adequate to establish the performance of the machine over a specified range of operating conditions

3.2.3

hydraulic performance

all performance parameters attributable to the machine owing to hydrodynamic effects

3.2.4

main hydraulic performance data

subset of the hydraulic performance parameters, i.e. power, discharge and/or specific hydraulic energy, efficiency, steady-state runaway speed and/or discharge

Note 1 to entry: The influence of cavitation shall be considered.

3.2.5

additional data

subset of hydraulic performance data which can be determined for information on the model (see 4.4)

Note 1 to entry: However, the prediction of the corresponding prototype data is less accurate than that achievable for the main hydraulic performance data, owing to application of approximate similarity rules.

3.2.6

guarantee

specified performance data contractually agreed to

3.2.7**measurand**

quantity subjected to measurement

3.2.8**transducer**

measuring device, which provides an output quantity with a given relationship to the input quantity

3.2.9**transducer with digitized output**

measuring device with built-in electronics to give a digitized output (e.g. serial port RS 232)

3.2.10**multiplexer (MUX)**

device for switching two or more signals in order to share the same analogue-to-digital converter, frequency counter or cabling facilities

3.2.11**analogue-to-digital converter (A/D converter)**

device that translates continuous analogue signals into discrete digital signals

3.2.12**counter**

device that measures frequency, time period or number of pulses

3.2.13**voltage-to-frequency converter (V/F converter)**

device that translates with a given relationship voltage levels into frequency

3.2.14**aliasing**

when sampling analogue signals with a sampling rate less than twice that of the frequency of the highest frequency signal or noise component ("Nyquist rate"), the sampling process will produce spurious low frequency signals (aliases) that cannot be distinguished from the original signal

3.2.15**computer interface**

communication port that enables the computer to control and communicate with other compatible devices

3.3 Units

The International System of Units (SI, see ISO 80000-4) has been used throughout this document.

All terms are given in SI base units or derived coherent units¹. The basic equations are valid using these units. This has to be taken into account if other than coherent SI units are used for certain data (e.g. kilowatt instead of watt for power, kilopascal or bar instead of pascal for pressure, min^{-1} instead of s^{-1} for rotational speed, etc.). Temperatures may be given in degrees Celsius since absolute temperatures (in kelvins) are rarely required.

Any other system of units may be used, but only if agreed in writing by the contracting parties.

3.4 Definition of terms, symbols and units

3.4.1 List of terms and definitions by topic

Subclause	Title
3.4.2	Subscripts and symbols
3.4.3	Geometric terms
3.4.4	Physical quantities and properties
3.4.5	Discharge, velocity and speed terms
3.4.6	Pressure terms
3.4.7	Specific energy terms
3.4.8	Height and head terms
3.4.9	Power and torque terms
3.4.10	Efficiency terms
3.4.11	General terms relating to fluctuating quantities
3.4.12	Fluid dynamic and scaling terms
3.4.13	Dimensionless terms
3.4.14	Terms relating to additional performance data

¹ $\text{N} = \text{kg} \cdot \text{m} \cdot \text{s}^{-2}$ $\text{Pa} = \text{kg} \cdot \text{m}^{-1} \cdot \text{s}^{-2}$ $\text{J} = \text{kg} \cdot \text{m}^2 \cdot \text{s}^{-2}$ $\text{W} = \text{kg} \cdot \text{m}^2 \cdot \text{s}^{-3}$

3.4.2 Subscripts and symbols

Subclause	Term	Definition	Subscript or symbol
3.4.2.1	High-pressure ^{a)} reference section	The high-pressure section of the machine to which the performance guarantees refer (see Figure 1)	1
3.4.2.2	Low-pressure ^{a)} reference section	The low-pressure section of the machine to which the performance guarantees refer (see Figure 1)	2
3.4.2.3	High-pressure measuring sections	High-pressure sections of the machine used for measurement Note 1 to entry: Whenever possible, these sections should coincide with section 1; otherwise the measured values shall be adjusted to section 1 (see 6.5.2.1.3)	1', 1''.
3.4.2.4	Low-pressure measuring sections	Low-pressure sections of the machine used for measurement Note 1 to entry: Whenever possible, these sections should coincide with section 2; otherwise, the measured values shall be adjusted to section 2 (see 6.5.2.1.3)	2', 2''.
3.4.2.5	Specified	Subscript denoting values of quantities such as rotational speed, discharge etc. for which other quantities are guaranteed	sp
3.4.2.6	Maximum/minimum	Subscript denoting maximum or minimum values of any term	max min
3.4.2.7	Limits	Contractually defined values: – not to be exceeded – to be reached	$\frac{///}{\square}$ — or $///$
3.4.2.8	Prototype	Subscript denoting values related to the full-size machine	P
3.4.2.9	Model	Subscript denoting values related to the model	M
3.4.2.10	Model at constant Reynolds number	Subscript denoting values related to a model and referred to a constant value of Reynolds number	M*
3.4.2.11	Reference	Subscript denoting values related to a specified reference condition	ref
3.4.2.12	Optimum	Subscript denoting the best efficiency point	opt
3.4.2.13	Ambient	Subscript referring to surrounding atmospheric conditions	amb
3.4.2.14	Plant	Subscript denoting values related to the operating conditions of the prototype in the plant	pl
3.4.2.15	Runaway	Subscript referring to runaway conditions	R
3.4.2.16	Runner blade	Subscript referring to the runner blade of a machine.	B
3.4.2.17	Pelton deflector	Subscript referring to the Pelton deflector of a machine.	D
3.4.2.18	Guide vane	Subscript referring to the guide vane of a machine.	G
3.4.2.19	Pelton needle	Subscript referring to the Pelton needle of a machine	N
3.4.2.20	Axial	Subscript referring to a component of force or torque	a
3.4.2.21	Radial	Subscript referring to a component of force or torque	r
3.4.2.22	Cartesian coordinates	Subscript referring to machine coordinates	x, y, z
3.4.2.23	Theoretical value	Subscript referring to theoretical value	th
3.4.2.24	Hydraulic	Subscript referring to hydraulic value	h

^{a)} The terms "high-pressure" and "low-pressure" define the two sides of the machine irrespective of the flow direction and therefore are independent of the mode of operation of the machine.


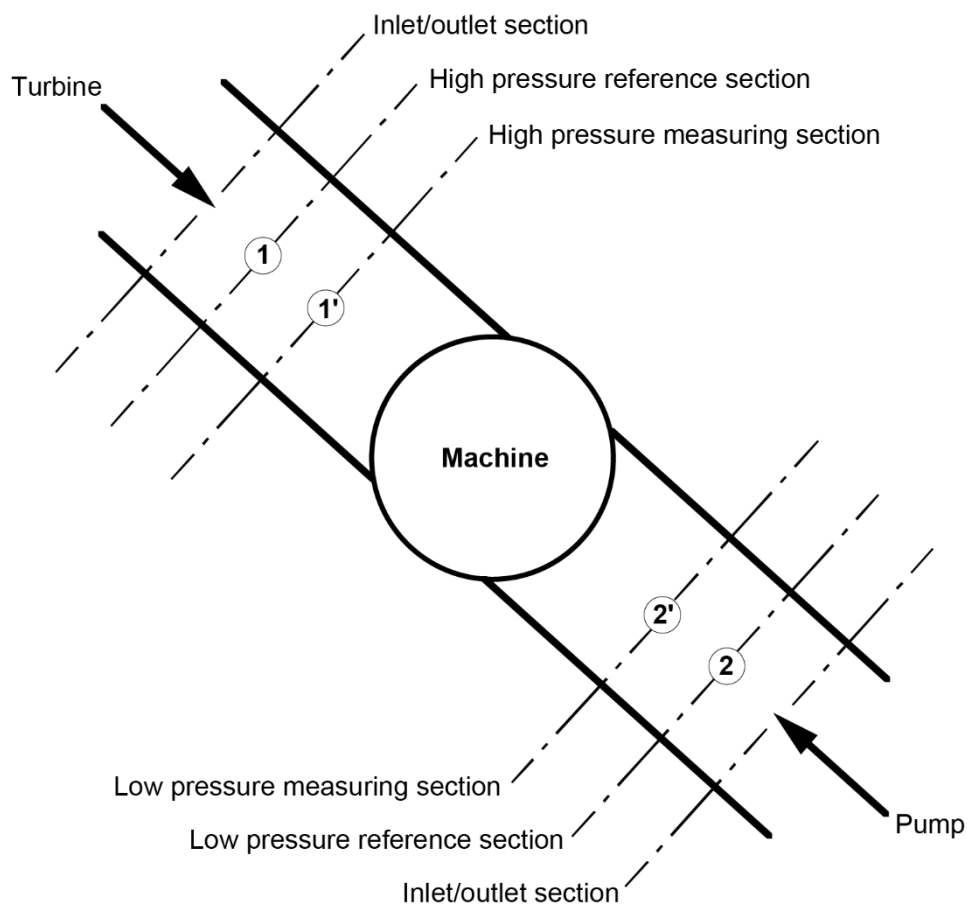


Figure 1– Schematic representation of a hydraulic machine

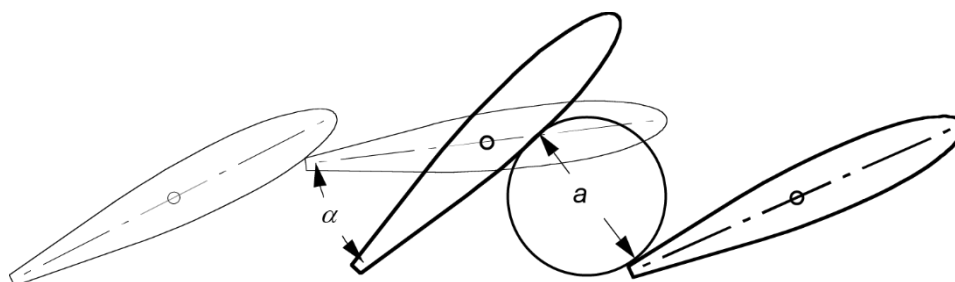


Closed position: $\alpha = 0^\circ$ or $a = 0$ mm

Figure 2 – Guide vane opening and angle

3.4.3 Geometric terms

Subclause	Term	Definition	Symbol	Unit
3.4.3.1	Area	Net cross-sectional surface normal to general flow direction	A	m ²
3.4.3.2	Surface area	Total area of a surface (of the runner, flow passages, etc.)	S	m ²
3.4.3.3	Guide vane opening	Average shortest distance between adjacent guide vanes (at a specified section if necessary) (see Figure 2)	a	m
3.4.3.4	Guide vane angle	Average vane angle measured from closed position (see Figure 2)	α	°
3.4.3.5	Needle stroke (impulse turbine)	Average needle stroke measured from closed position	s	m
3.4.3.6	Runner/impeller blade angle	Average runner/impeller blade setting measured from a reference position	β	°
3.4.3.7	Reference diameter	Reference diameter of the hydraulic machine (see Figure 3)	D	m
3.4.3.8	Runner outlet/impeller inlet width	Average shortest distance between two adjacent blades of runner/impeller (see Figure 14 and Figure 15)	a_1, a_2	m
3.4.3.9	Bucket width	Inside maximum width of runner bucket of a Pelton turbine (see Figure 3)	B	m
3.4.3.10	Length scale ratio	The ratio of representative prototype to model lengths; in normal cases this is the reference diameter of the machine Note 1 to entry: In cases where it is difficult to verify this reference, then another significant length may be taken	λ_L	-
3.4.3.11	Level	Elevation of a point in the system above the specified reference datum (usually mean sea level)	z	m
3.4.3.12	Length	Relevant linear size of a component of the machine	L	m
3.4.3.13	Arithmetic roughness	Arithmetic mean deviation of the assessment profile	Ra	µm

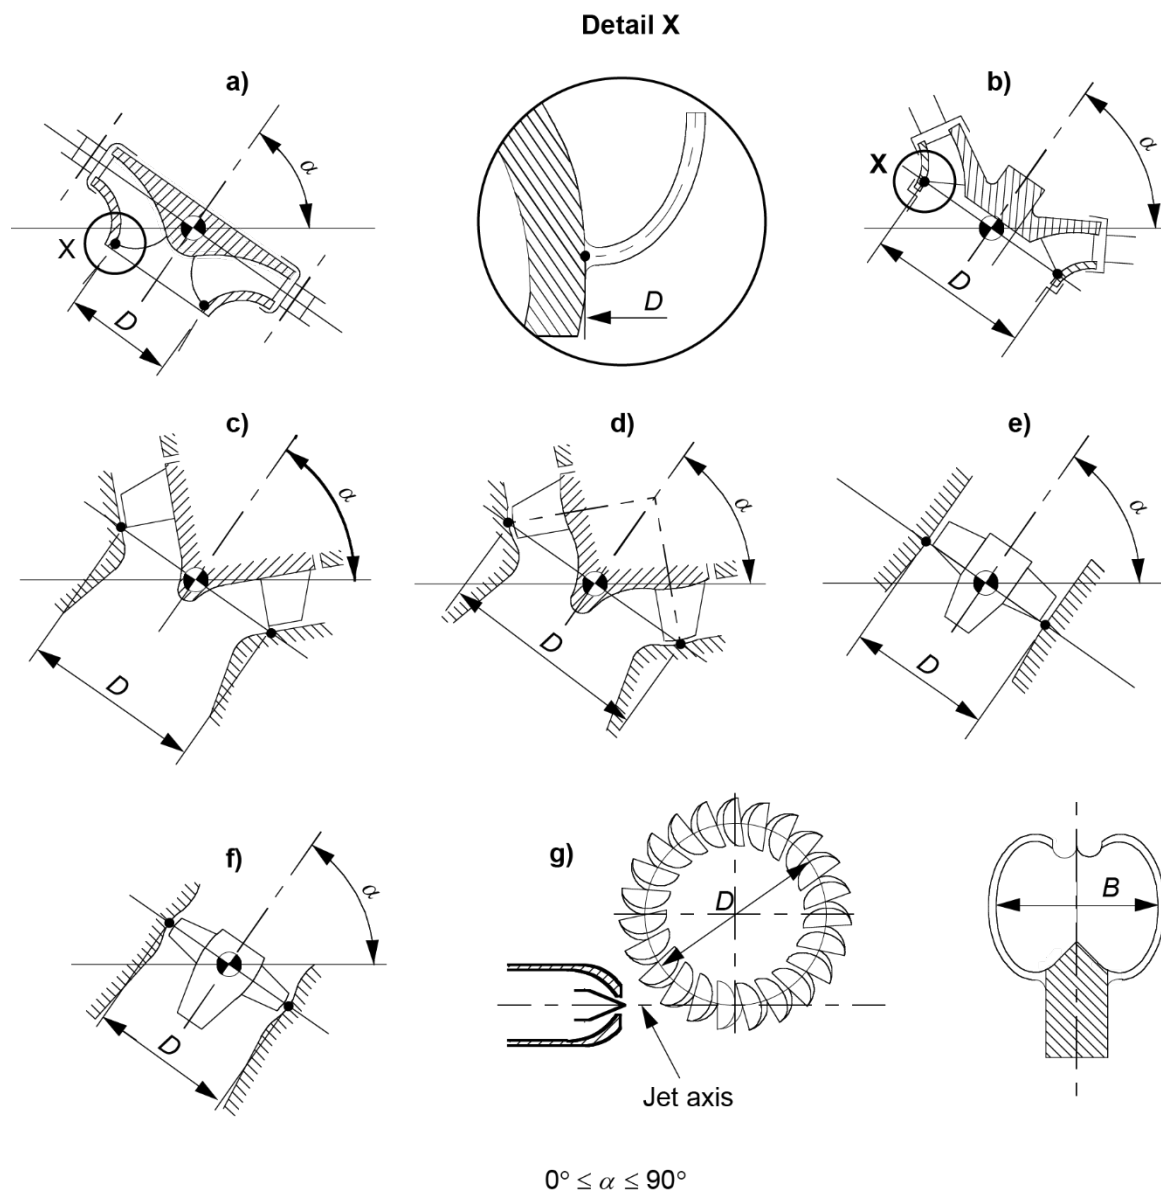

- a) Radial machines, such as Francis turbines, radial (centrifugal) pumps and pump-turbines; for multistage machines: low-pressure stage.
- b) Diagonal (mixed-flow, semi-axial, Dériaz) machines with fixed runner/impeller blades and with runner/impeller band.
- c) Diagonal (mixed-flow, semi-axial, Dériaz) machines with fixed runner/impeller blades, without runner/impeller band.
- d) Diagonal (mixed-flow, semi-axial, Dériaz) machines with adjustable runner/impeller blades.
- e) Axial machines, such as propeller turbines, tubular turbines², axial pumps and pump-turbines with fixed runner/impeller blades.
- f) Axial machines, such as Kaplan turbines, tubular turbines², axial pumps and pump-turbines with adjustable runner/impeller blades.
- g) Pelton turbines.

Figure 3 – Reference diameter and bucket width

² The term "tubular turbines" includes bulb, pit, rim generator and S-type units.

3.4.4 Physical quantities and properties

Subclause	Term	Definition	Symbol	Unit
3.4.4.1	Acceleration due to gravity	Local value of gravitational acceleration at the place of testing (see 5.7.2); theoretical values as a function of altitude and latitude are given in Table B.1	g	$\text{m}\cdot\text{s}^{-2}$
3.4.4.2	Temperature	Thermodynamic (kelvin) Degree Celsius $\theta = \Theta - 273,15$	Θ θ	K °C
3.4.4.3	Volume	Quantity of three-dimensional space an object/substance occupies	V	m^3
3.4.4.4	Density	Mass per unit volume a) Density of water ρ is commonly used instead of ρ_w b) Density of distilled water Values for distilled water ρ_{wd} are given in 5.7.3.1.3 and in Table B.2 c) Density of air Values for air are given in 5.7.4.1 and in Table B.5 d) Density of mercury Values for mercury are given in 5.7.5 and in Table B.7	ρ, ρ_w, ρ_{wa} ρ_{wd} ρ_a ρ_{Hg}	$\text{kg}\cdot\text{m}^{-3}$
3.4.4.5	Vapour pressure (absolute)	Absolute partial pressure of saturated vapour in a medium where liquid and gaseous phases of a body are in thermodynamic balance Note 1 to entry: The vapour pressure depends only on the temperature. Values for distilled water are given in 5.7.3.4 and in Table B.4	p_{va}	Pa
3.4.4.6	Dynamic viscosity	A quantity characterizing the mechanical behaviour of a fluid (see ISO 80000-4)	μ	$\text{Pa}\cdot\text{s}$
3.4.4.7	Kinematic viscosity	Ratio of the dynamic viscosity to the density of a fluid Note 1 to entry: Values for distilled water as a function of temperature are given in 5.7.3.3 and in Table B.3	ν	$\text{m}^2\cdot\text{s}^{-1}$
3.4.4.8	Surface tension	A quantity characterizing the mechanical behaviour of the interface between two fluids (see ISO 80000-4)	σ^*	$\text{J}\cdot\text{m}^{-2}$

3.4.5 Discharge, velocity and speed terms

Subclause	Term	Definition	Symbol	Unit
3.4.5.1	Discharge	Volume of water per unit time passing through any section in the system	Q	$\text{m}^3 \cdot \text{s}^{-1}$
3.4.5.2	Mass flow rate	Mass of water flowing through any section of the system per unit time. Both ρ and Q shall be determined at the same section and at the conditions existing in that section Note 1 to entry: The mass flow rate is constant between two sections if no water is added or removed	(ρQ)	$\text{kg} \cdot \text{s}^{-1}$
3.4.5.3	Measured discharge	Volume of water per unit time flowing through any measuring section, e.g. 1' (see 3.4.2.3 and 3.4.2.4)	Q_1 , or Q_2	$\text{m}^3 \cdot \text{s}^{-1}$
3.4.5.4	Discharge at reference section	Volume of water per unit time flowing through the reference section 1 or 2	Q_1 or Q_2	$\text{m}^3 \cdot \text{s}^{-1}$
3.4.5.5	Corrected discharge at reference section	Volume of water per unit time flowing through the reference section referred to the ambient condition (see 3.4.6.2), e.g. $Q_{1c} = (\rho Q)_1 / \rho_{\text{amb}}$ Note 1 to entry: Given the normal conditions of a model test, Q_{1c} may be assumed equal to Q_1	Q_{1c} or Q_{2c}	$\text{m}^3 \cdot \text{s}^{-1}$
3.4.5.6	Discharge at steady-state runaway speed	Discharge at n_R (see 3.4.5.12)	Q_R	$\text{m}^3 \cdot \text{s}^{-1}$
3.4.5.7	No-load turbine discharge	Turbine discharge at zero mechanical power at specified speed (usually synchronous) and specified specific hydraulic energy	Q_o	$\text{m}^3 \cdot \text{s}^{-1}$
3.4.5.8	Leakage discharge	Volumetric loss as illustrated in Figure 6	q	$\text{m}^3 \cdot \text{s}^{-1}$
3.4.5.9	Mean velocity	Discharge Q divided by area A of the cross-section	v	$\text{m} \cdot \text{s}^{-1}$
3.4.5.10	Peripheral velocity	Speed at the reference diameter: $u = \pi D n$	u	$\text{m} \cdot \text{s}^{-1}$
3.4.5.11	Rotational speed	Number of revolutions per unit time	n	s^{-1}
3.4.5.12	Steady-state runaway speed	The steady-state rotational speed at zero mechanical power at specified hydraulic conditions and specified guide vane/blade/needle opening	n_R	s^{-1}
3.4.5.13	Maximum steady-state runaway speed	The highest value of steady-state runaway speed at specified hydraulic conditions (for the prototype, see detailed definition in IEC 60041:1991, 2.3.4.15)	$n_{R\text{max}}$	s^{-1}

3.4.6 Pressure terms

Subclause	Term	Definition	Symbol	Unit
3.4.6.1	Absolute pressure	The static pressure of a fluid measured with reference to a perfect vacuum	p_{abs}	Pa
3.4.6.2	Ambient pressure	The absolute pressure of the ambient air (see 5.7.4.2) Note 1 to entry: Values for standard atmosphere are given as a function of elevation in Table B.6	p_{amb}	Pa
3.4.6.3	Gauge pressure	The difference between the absolute static pressure of a fluid at the reference level of the pressure measuring instrument and the ambient pressure at the place and time of measurement: $p = p_{\text{abs}} - p_{\text{amb}}$	p	Pa
3.4.6.4	Differential pressure	The difference in pressure between two points or sections of measurement	Δp	Pa


3.4.7 Specific energy terms

In the International System of Units, mass (kg) is one of the base quantities. The energy per unit mass, known as "specific energy", is used in this document as a primary term instead of the energy per local unit weight which is called "head", and was exclusively used in previous publications.

The latter term ("head") has the disadvantage that weight is a force which depends on the local value of acceleration due to gravity g , which changes mainly with latitude but also with altitude. Nevertheless, the term "head" will still remain in use because it is very common. Therefore, both related energy terms are listed, the specific energy terms in this subclause and head terms in 3.4.8. They differ only by the factor g , which is the local value of acceleration due to gravity.

Subclause	Term	Definition	Symbol	Unit
3.4.7.1	Specific hydraulic energy of machine	The energy per unit mass of water available between the high and low-pressure reference sections 1 and 2 of the machine, taking into account the influence of compressibility (see 6.5) $E = \frac{p_{\text{abs1}} - p_{\text{abs2}}}{\bar{\rho}} + \frac{v_1^2 - v_2^2}{2} + g(z_1 - z_2)$ with $\bar{\rho} = (\rho_1 + \rho_2)/2$ and assuming $g = g_1 = g_2$ Note 1 to entry: The value of ρ_1 and ρ_2 can be calculated from p_{abs1} and p_{abs2} respectively, taking into account θ_1 or θ_2 for both values, given the negligible influence of the difference of the temperature on ρ	E	$\text{J} \cdot \text{kg}^{-1}$
3.4.7.2	Zero-discharge (shut-off) specific hydraulic energy of the pump	The specific energy of water for a pump at specified speed and specified guide vane and impeller blade settings with high-pressure side shut off	E_0	$\text{J} \cdot \text{kg}^{-1}$
3.4.7.3	Specific kinetic energy	The specific energy of water in motion: $E_k = \frac{v^2}{2}$	E_k	$\text{J} \cdot \text{kg}^{-1}$

Subclause	Term	Definition	Symbol	Unit
3.4.7.4	Suction specific potential energy of the machine	Potential energy per unit mass of water at section 2 corresponding to the difference between the reference level of the machine (see 3.4.8.5) and the piezometric level at section 2: $E_s = g(z_r - z_{2'}) = g(z_r - z_2) - \frac{p_{abs2} - p_{amb}}{\rho_2}$ (see Figure 45)	E_s	J·kg ⁻¹
3.4.7.5	Net positive suction specific energy	Absolute energy per unit mass of water at section 2 minus the specific energy due to the vapour pressure p_{va} referred to the reference level of the machine: $NPSE = \frac{p_{abs2} - p_{va}}{\rho_2} + \frac{v_2^2}{2} - g(z_r - z_2)$ $= -E_s + \frac{p_{amb} - p_{va}}{\rho_2} + \frac{v_2^2}{2}$ (see Figure 45)	$NPSE$	J·kg ⁻¹
3.4.7.6	Thoma number	Dimensionless term indicating the conditions of cavitation under which the machine operates Note 1 to entry: It is expressed as the ratio of net positive suction specific energy $NPSE$ to a specific hydraulic energy E (see 3.4.13.9)	σ	-
3.4.7.7	Cavitation coefficient	Dimensionless term indicating the conditions of cavitation under which the machine operates Note 1 to entry: It is expressed as the ratio of net positive suction specific energy $NPSE$ to $n^2 D^2$ (see 3.4.13.10)	σ_{nD}	-
3.4.7.8	Thoma number zero	The lowest value of the Thoma number for which a chosen performance parameter (usually efficiency) remains unchanged as compared to its values at high Thoma number Note 1 to entry: In some cases, the shape of the cavitation curve $\eta_h(\sigma)$ is such that the Thoma number zero is difficult to define (see Figure 4)	σ_0	-
3.4.7.9	Thoma number one	The value of the Thoma number for which a drop of one percentage point in efficiency is obtained compared with the efficiency at Thoma number zero Note 1 to entry: In some cases, the shape of the cavitation curve is such that the Thoma number one is difficult to define (see Figure 4)	σ_1	-
3.4.7.10	Defined Thoma number	The value of the Thoma number associated with a defined onset of cavitation, e.g. a specified performance loss	σ_d	-
3.4.7.11	Incipient Thoma number	The value of the Thoma number associated with the beginning of visible runner/impeller cavitation usually detected by observation (see Figure 4)	σ_i	-
3.4.7.12	Plant Thoma number	The value of the Thoma number at the operating conditions of the prototype (see Annex K)	σ_{pl}	-
3.4.7.13	Specific hydraulic energy loss	The specific hydraulic energy dissipated between any two sections	E_L	J·kg ⁻¹

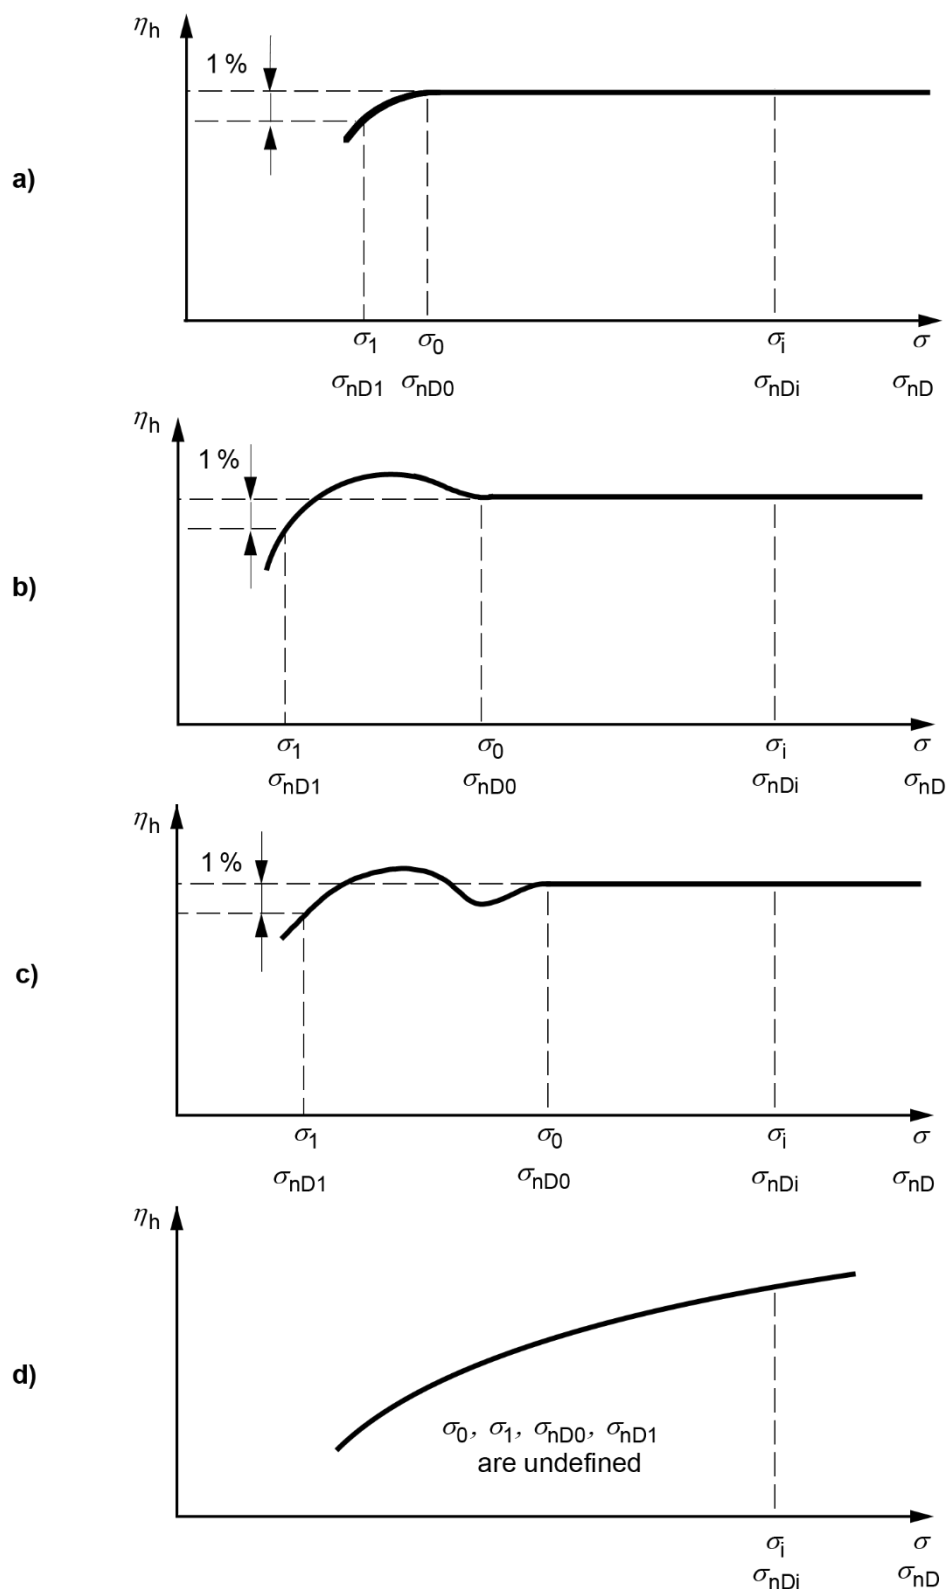


- a) Monotonic change in efficiency (for example, for a Francis turbine in the region of optimum efficiency)
 b) Efficiency overshoot (for example, for a Francis turbine at full-load operation)
 c) Efficiency oscillation, (for example, Francis turbine with inlet cavitation at full-load operation)
 d) Monotonic decrease in efficiency (for example, tubular turbine)

Figure 4 – Determination of σ_0 and σ_1 for typical cavitation curves

3.4.8 Height and head terms

Subclause	Term	Definition	Symbol	Unit
3.4.8.1	Turbine or pump head	Specific energy per local unit weight of water at any section $H = \frac{E}{g}$	H	m
3.4.8.2	Zero discharge (shut-off) head of pump	Specific energy per local unit weight of water for a pump at specified speed and specified guide vane and impeller blade settings with high-pressure side shut off $H_0 = \frac{E_0}{g}$	H_0	m
3.4.8.3	Suction height	Specific energy per local unit weight of water at section 2 corresponding to the difference between the reference level of the machine (see 3.4.8.5) and the piezometric level at section 2 $Z_s = \frac{E_s}{g}$	Z_s	m
3.4.8.4	Net positive suction head	Specific energy per local unit weight of water at section 2 minus the specific energy due to the vapour pressure p_{va} referred to the reference level of the machine (see Figure 45) $NPSH = \frac{NPSE}{g}$	$NPSH$	m
3.4.8.5	Reference level of the machine	Elevation of a point of the machine taken as reference for the setting of the machine (see Figure 5)	z_r	m
3.4.8.6	Cavitation reference level	Elevation of a point of the machine taken as reference for cavitation evaluation during model tests (see 5.3.5.2)	z_c	m
3.4.8.7	Reference level of the pressure measuring instrument	Elevation of a pressure measuring device (see Figure 38)	z_M	m
3.4.8.8	Reference height of pressure measuring instrument	Distance between the reference levels of the machine and the instrument (see Figure 38) $Z_{rM} = z_r - z_M$	Z_{rM}	m

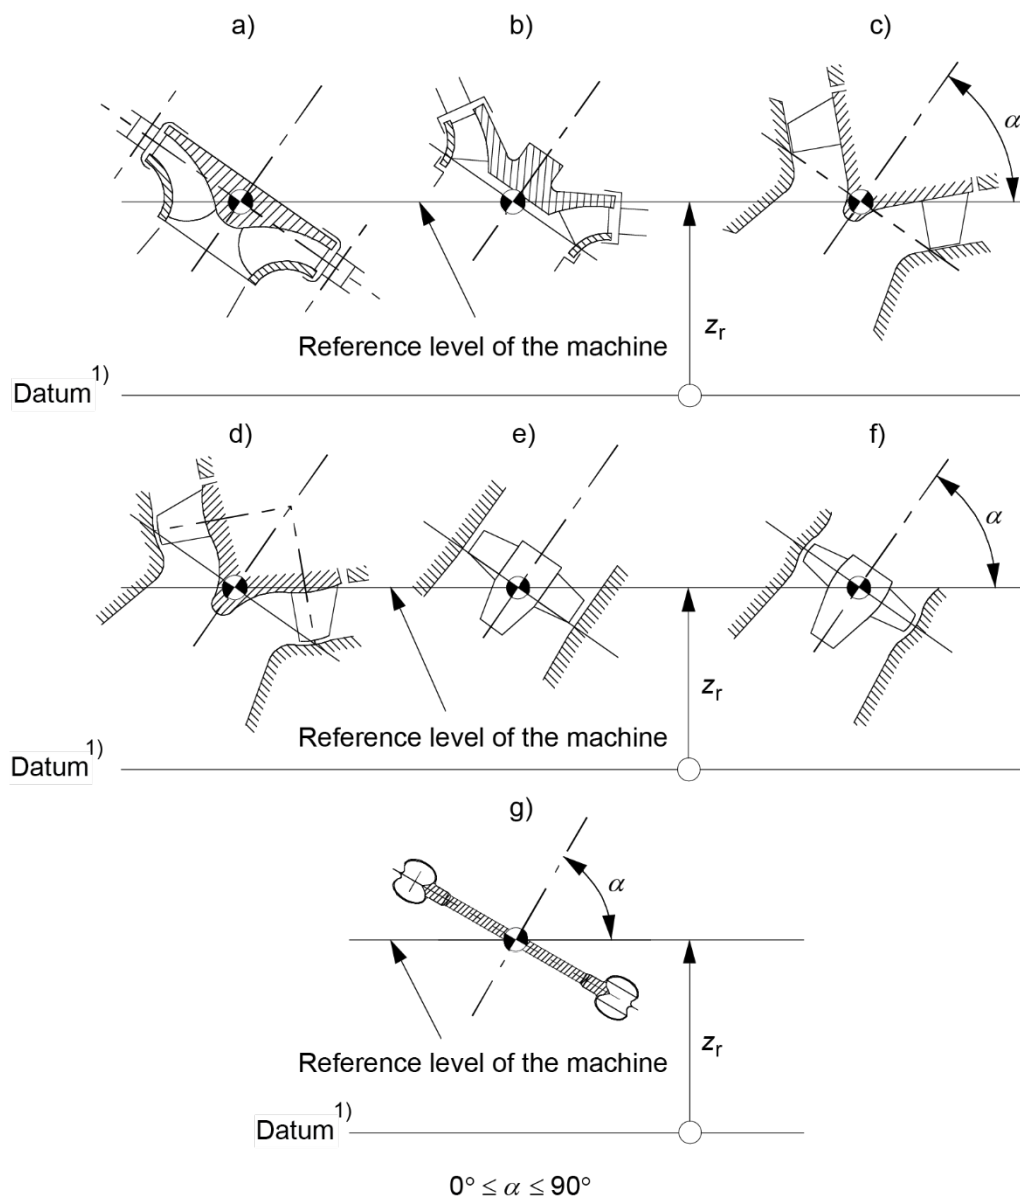

¹⁾ See 3.4.3.11


- a) Radial machines, such as Francis turbines, radial (centrifugal) pumps and pump-turbines; for multistage machines: low-pressure stage
- b) Diagonal (mixed-flow, semi-axial, Dériaz) machines with fixed runner/impeller blades and with runner/impeller band
- c) Diagonal (mixed-flow, semi-axial, Dériaz) machines with fixed runner/impeller blades, without runner/impeller band
- d) Diagonal (mixed-flow, semi-axial, Dériaz) machines with adjustable runner/impeller blades
- e) Axial machines, such as propeller turbines, tubular turbines³, axial pumps and pump-turbines with fixed runner/impeller blades
- f) Axial machines, such as Kaplan turbines, tubular turbines³, axial pumps and pump-turbines with adjustable runner/impeller blades
- g) Pelton turbines

Figure 5 – Reference level of machine

³ The term "tubular turbines" includes bulb, pit, rim generator and S-type units.

3.4.9 Power and torque terms

Subclause	Term	Definition	Symbol	Unit
3.4.9.1	Hydraulic power	The hydraulic power available for producing power (turbine) or imparted to the water (pump) $P_h = E(\rho Q)_1$	P_h	W
3.4.9.2	Mechanical power of the machine (power)	The mechanical power delivered by the turbine shaft or to the pump shaft, assigning to the hydraulic machine the mechanical losses of the relevant bearings and shaft seals (see Figure 6)	P	W
3.4.9.3	Mechanical power of runner(s)/impeller(s)	Mechanical power transmitted through the coupling of the runner(s)/impeller(s) and the shaft (see Figure 6)	P_m	W
3.4.9.4	Mechanical power losses	Mechanical power dissipated in guide bearings, thrust bearings and shaft seals of the hydraulic machine (see Figure 6)	P_{Lm}	W
3.4.9.5	Zero discharge (shut-off) power of the pump	Pump power at specified speed and at specified guide vane and impeller settings with high-pressure side shut-off	P_0	W
3.4.9.6	Shaft torque	Torque applied to the shaft of the hydraulic machine and corresponding to the mechanical power of the machine (see 3.4.9.2)	T	N·m
3.4.9.7	Runner/impeller torque	Torque transmitted through the coupling of the runner/impeller and the shaft and corresponding to the mechanical power of runner/impeller (see 3.4.9.3)	T_m	N·m
3.4.9.8	Friction torque	Friction torque in guide bearings, thrust bearings and shaft seals of the hydraulic machine (see 3.4.9.4)	T_{Lm}	N·m

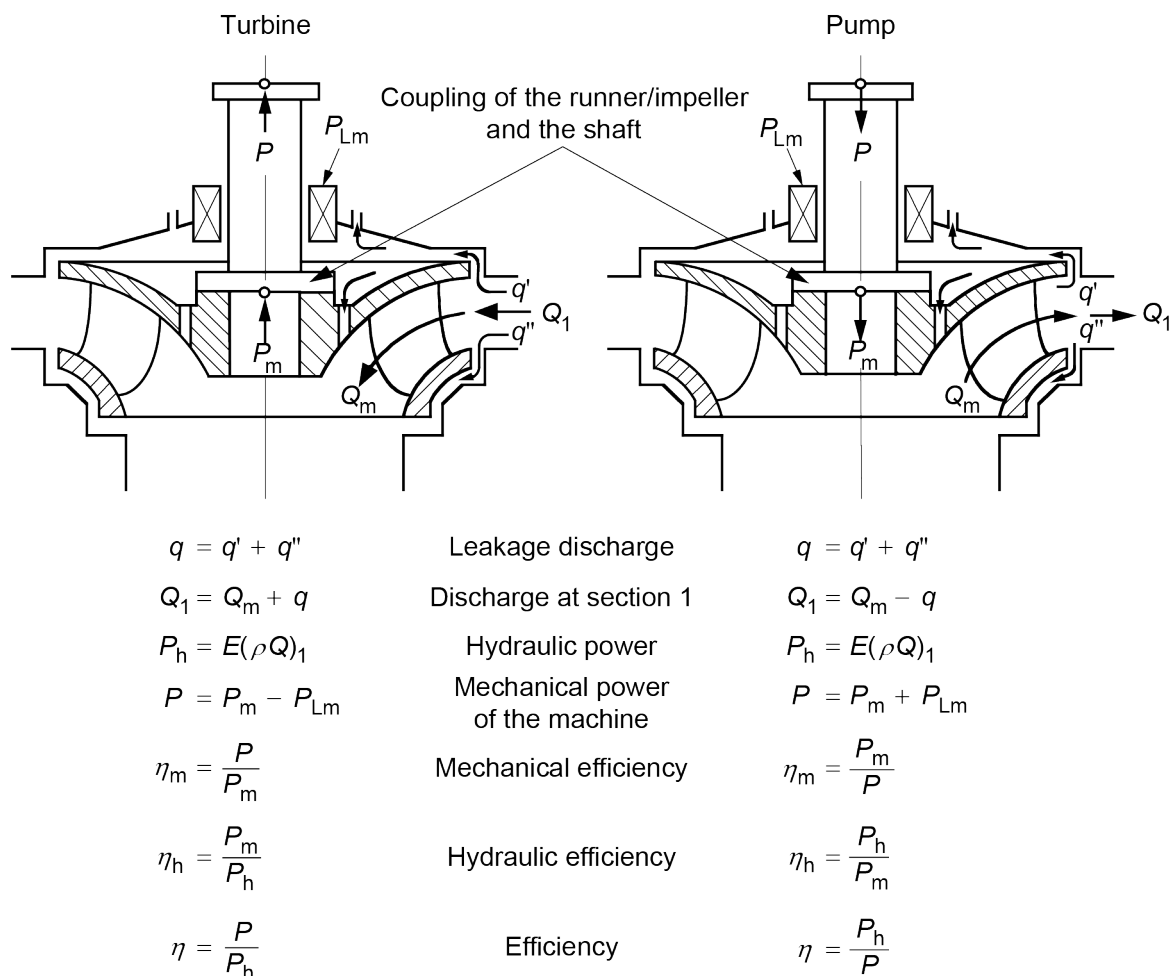

NOTES

- The formulae ignore the compressibility of the water.
- For detailed analysis of internal losses, refer to Annex L.
- The disk friction losses and leakage losses (volumetric losses) are considered as hydraulic losses in the formula for hydraulic efficiency. The disk friction losses are the friction losses of the outer surfaces of the runner/impeller not in contact with the flow Q_m passing the runner/impeller blades.

Figure 6 – Flux diagram for power and discharge

3.4.10 Efficiency terms


Subclause	Term	Definition	Symbol	Unit
3.4.10.1	Hydraulic efficiency	a) Turbine: ratio of mechanical power of runner to the hydraulic power $\eta_h = \frac{P_m}{P_h}$ b) Pump: ratio of hydraulic power to the mechanical power of the impeller $\eta_h = \frac{P_h}{P_m}$ See Figure 6	η_h	-
3.4.10.2	Mechanical efficiency	a) Turbine: ratio of mechanical power of the machine to the runner $\eta_m = \frac{P}{P_m}$ b) Pump: ratio of mechanical power of the impeller to the machine $\eta_m = \frac{P_m}{P}$ See Figure 6	η_m	-
3.4.10.3	Efficiency	a) Turbine: ratio of mechanical power of the machine to the hydraulic power $\eta = \frac{P}{P_h} = \eta_h \cdot \eta_m$ b) Pump: ratio of hydraulic power to the power of the machine $\eta = \frac{P_h}{P} = \eta_h \cdot \eta_m$ See Figure 6	η	-
3.4.10.4	Weighted average efficiency	Calculated from the formula $\eta_w = \frac{w_1\eta_1 + w_2\eta_2 + w_3\eta_3 + \dots}{w_1 + w_2 + w_3 + \dots}$ where $\eta_1, \eta_2, \eta_3, \dots$ are the values of efficiency at specified operating conditions and $w_1, w_2, w_3 \dots$ are their agreed weighting factors respectively	η_w	-

3.4.11 General terms relating to fluctuating quantities

IEC 60994 provides a reference for terms relating to fluctuating quantities. Terms relevant to this document, some of which are illustrated in Figure 7, are listed below:

Subclause	Term	Definition	Symbol	IEC 60994:1991 reference
3.4.11.1	Discrete quantity	Quantity represented by a sequence of its momentary values	X	
3.4.11.2	Discrete quantity n	Value of the quantity n	X_n	
3.4.11.3	Number of samples	Total number of discrete quantities	N	
3.4.11.4	Number of samples in a time window	Total number of discrete quantities used in the time window duration	N_w	
3.4.11.5	Mean value	The algebraic sum of the discrete quantities divided by the number of samples $\bar{X} = \frac{1}{N} \sum_{n=1}^N X_n$	$\bar{X}$	2.3.3.1
3.4.11.6	Fluctuation of quantity	Oscillatory variation of a quantity X referred to its mean value during a time interval Δt previously selected	$\tilde{X}(t)$	2.3.1.5
3.4.11.7	Maximum value	The maximum value in a chosen time interval	$X_{\max}$	
3.4.11.8	Minimum value	The minimum value in a chosen time interval	$X_{\min}$	
3.4.11.9	Standard deviation (effective value referred to the mean)	The root-mean-square value of the deviation of a set of numbers from the mean value $\tilde{X}_{\text{eff}} = \sqrt{\frac{1}{N} \sum_{n=1}^N (X_n - \bar{X})^2}$	$\tilde{X}_{\text{eff}}$	2.3.3.2
3.4.11.10	Root-mean-square value	The square root of the mean value squared $X_{\text{rms}} = \sqrt{\frac{1}{N} \sum_{n=1}^N X_n^2}$	X_{rms}	2.3.3.3
3.4.11.11	Peak-to-peak value	The difference between the maximum and minimum values $\Delta X_{\text{pp}} = X_{\max} - X_{\min}$	ΔX_{pp}	2.3.2.11
3.4.11.12	Peak-to-peak value with a 97 % confidence interval	The difference between the maximum and minimum values of a signal is determined using a probability distribution function for a given probability value (e.g. 97 %) Note 1 to entry: This function is estimated by applying statistical counting. The signal values outside of the corresponding confidence interval are excluded.	$\Delta X_{\text{pp}, 97 \%}$	
3.4.11.13	Amplitude	Maximum value of a sinusoidal quantity $X(t)$ $A = \frac{1}{2} \Delta X_{\text{pp}}$	A	2.3.2.10
3.4.11.14	Time	Physical quantity	t	2.3.2.3
3.4.11.15	Sampling time interval	Time interval between two consecutive samples.	Δt	
3.4.11.16	Frequency	The reciprocal of period s^{-1} (Hz)	f	2.3.2.4
3.4.11.17	Sampling frequency (sampling rate)	Inverse of the sampling time interval $f_s = \frac{1}{\Delta t}$	f_s	

Subclause	Term	Definition	Symbol	IEC 60994:1991 reference
3.4.11.18	Time window duration	Selected time window for frequency analyses by Fourier transform methods $t_w = N_w \Delta t$	t_w	
3.4.11.19	Frequency resolution	Frequency interval between two consecutive values in the discrete Fourier transform $\Delta f = 1/t_w = f_s/N$	Δf	
3.4.11.20	Signal recording time (Acquisition time)	Period of time during which a signal from a transducer is recorded (in seconds).	t_r	2.3.4.14

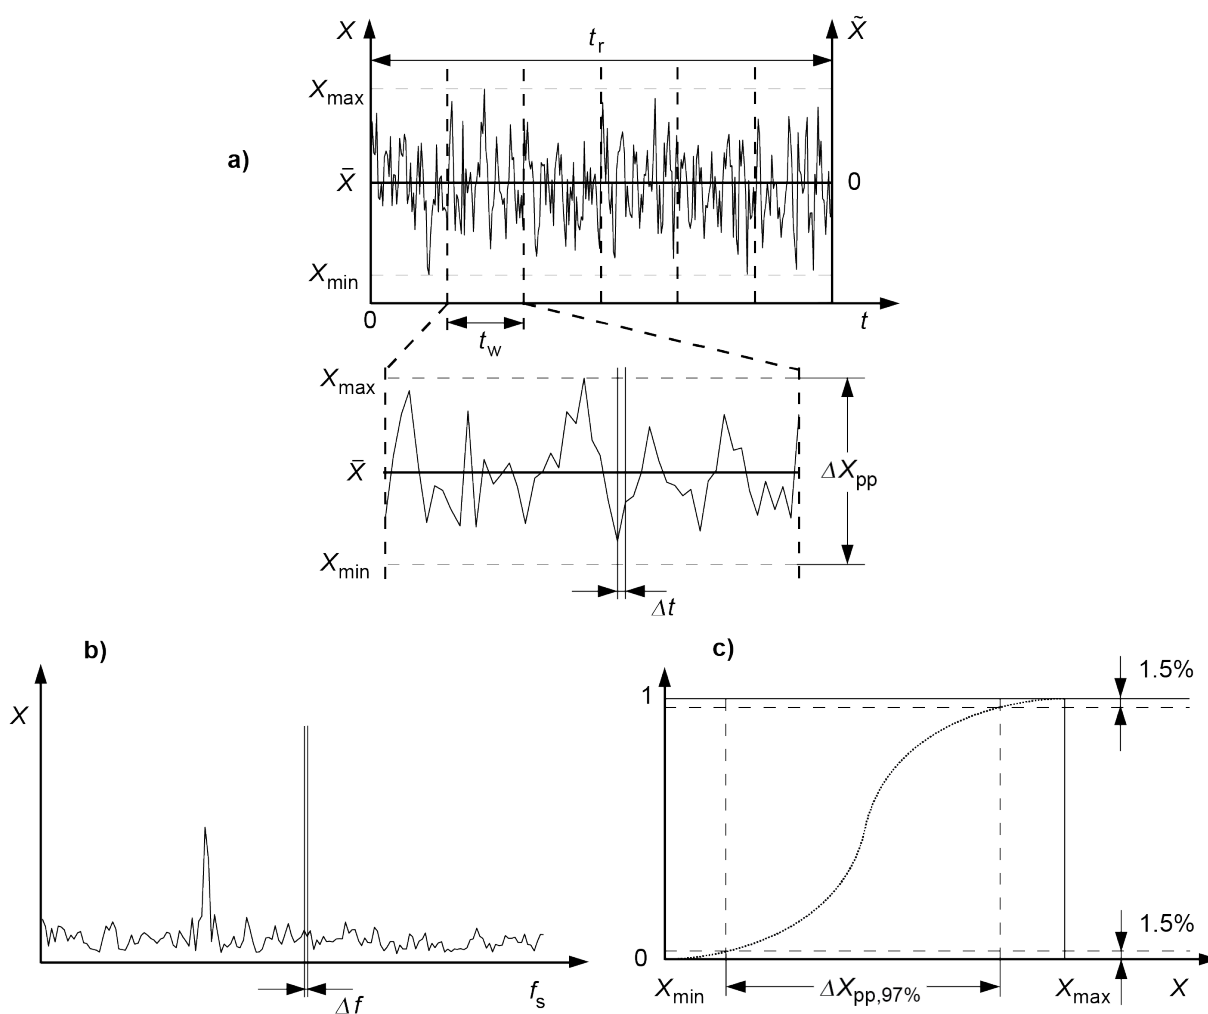

- a) A pressure fluctuation signal over a defined signal recording time (t_r). A minimum of 5 window time lengths (t_w) shall be included in each signal record time duration (see 7.2.1.2.4).
- b) The signal transformed into the frequency domain using Fourier analysis. The frequency resolution (Δf) required for each analysis is determined by the speed of rotation of the machine (see 7.2.1.2.4).
- c) Using probability distribution, each measure point from Figure 7 a) is cumulated and extreme deviations from the mean fluctuation are removed. A 97 % interval of confidence is illustrated in this figure.

Figure 7 – Illustration of some definitions related to oscillating quantities

3.4.12 Fluid dynamics and scaling terms^{a)}

Subclause	Term	Definition	Symbol	Unit
3.4.12.1	Reynolds number	Ratio of inertia forces to viscous forces (see 5.3.1): a) Reaction machines $Re = \frac{uD}{\nu}$ b) Impulse turbines $\frac{uB}{\nu}$	Re	-
3.4.12.2	Reference Reynolds number	The value $Re = 7 \times 10^6$	Re_{ref}	
3.4.12.3	Froude number ^{b)}	Square root of the ratio of inertia forces to gravity forces (see 5.3.1): a) Reaction machines $Fr = \left[\frac{E}{gD} \right]^{1/2}$ b) Impulse turbines $\left[\frac{E}{gB} \right]^{1/2}$	Fr	-
3.4.12.4	Weber number ^{b)}	Ratio of inertia forces to surface tension forces $We = \left[\frac{\rho L v^2}{\sigma^*} \right]^{1/2}$ (see 5.3.1)	We	-
3.4.12.5	Reference loss distribution coefficient	Ratio of relative scalable loss to relative total loss for reference Reynolds number for the point of optimum hydraulic efficiency $V_{ref} = \frac{\delta_{ref}}{1 - \eta_{hM opt}}$ Note 1 to entry: See Table D.1 for the values corresponding to the different types of reaction machines	V_{ref}	-
3.4.12.6	Relative scalable loss	Loss in efficiency due to scale effects related to the Reynolds number	δ	-
3.4.12.7	Reference relative scalable loss	Loss in efficiency due to scale effects at the reference Reynolds number (see Annex D) $\delta_{ref} = V_{ref} (1 - \eta_{h ref})$	δ_{ref}	-
3.4.12.8	Relative non-scalable loss	Loss in efficiency that cannot be attributed to scale effects (see Annex D) $\delta_{ns} = (1 - \eta_h) - \delta$	δ_{ns}	-
3.4.12.9	Relative total loss	Sum of scalable and non-scalable losses (see Annex D) $1 - \eta_h = \delta + \delta_{ns}$		-
3.4.12.10	Difference of hydraulic efficiency	Difference between the values of hydraulic efficiency at two hydraulically similar operating points measured at different Reynolds numbers (see 5.3.2)	$\Delta \eta_h$	-
a) See ISO 80000-11.				
b) Other definitions of these numbers can be found in relevant scientific works.				

3.4.13 Dimensionless terms

Machine performance may be characterized by dimensionless terms based on $E = 1$, $D = 1$ and $\rho = 1$ or on $n = 1$, $D = 1$ and $\rho = 1$.

The units are: H (m); D (m); E ($\text{J} \cdot \text{kg}^{-1}$); n (s^{-1}); ρ ($\text{kg} \cdot \text{m}^{-3}$); T ($\text{N} \cdot \text{m}$); P (W); Q ($\text{m}^3 \cdot \text{s}^{-1}$).

The relations of these dimensionless terms to other existing definitions are given in Annex A.

Subclause	Term	Definition	Symbol	Relations
3.4.13.1	Speed factor	$\frac{nD}{E^{0,5}}$	n_{ED}	$= \frac{1}{E_{nD}^{0,5}}$
3.4.13.2	Discharge factor	$\frac{Q_1}{D^2 E^{0,5}}$	Q_{ED}	$= \frac{Q_{nD}}{E_{nD}^{0,5}}$
3.4.13.3	Torque factor	$\frac{T_m}{\rho_1 D^3 E}$	T_{ED}	$= \frac{T_{nD}}{E_{nD}} = \frac{P_{ED}}{2\pi n_{ED}}$
3.4.13.4	Power factor ¹⁾	$\frac{P_m}{\rho_1 D^2 E^{1,5}}$	P_{ED}	$= Q_{ED} \eta_{hT}$ (turbine) $= \frac{Q_{ED}}{\eta_{hP}}$ (pump) $= \frac{P_{nD}}{E_{nD}^{1,5}} = P_{nD} n_{ED}^3$ $= 2\pi n_{ED} T_{ED}$
3.4.13.5	Energy coefficient	$\frac{E}{n^2 D^2}$	E_{nD}	$= \frac{1}{n_{ED}^2}$
3.4.13.6	Discharge coefficient	$\frac{Q_1}{n D^3}$	Q_{nD}	$= \frac{Q_{ED}}{n_{ED}} = Q_{ED} E_{nD}^{0,5}$
3.4.13.7	Torque coefficient	$\frac{T_m}{\rho_1 n^2 D^5}$	T_{nD}	$= \frac{T_{ED}}{n_{ED}^2} = T_{ED} E_{nD} = \frac{P_{nD}}{2\pi}$
3.4.13.8	Power coefficient ^{a)}	$\frac{P_m}{\rho_1 n^3 D^5}$	P_{nD}	$= E_{nD} Q_{nD} \eta_{hT}$ (turbine) $= \frac{E_{nD} Q_{nD}}{\eta_{hP}}$ (pump) $= \frac{P_{ED}}{n_{ED}^3} = P_{ED} E_{nD}^{1,5} = 2\pi T_{nD}$
3.4.13.9	Thoma number	$\frac{NPSE}{E}$	σ	$= \frac{Q_{nD}}{E_{nD}} = \sigma_{nD} n_{ED}^2$
3.4.13.10	Cavitation coefficient	$\frac{NPSE}{n^2 D^2}$	σ_{nD}	$= \sigma E_{nD} = \frac{\sigma}{n_{ED}^2}$
3.4.13.11	Specific speed	$\frac{n Q^{0,5}}{E^{0,75}}$	N_{QE}	$= n_{ED} Q_{ED}^{0,5} = \frac{Q_{nD}^{0,5}}{E_{nD}^{0,75}}$
a) Reference is made to the mechanical power of the runner/impeller, usually measured on the model.				

3.4.14 Terms relating to additional performance data

For presentation and analysis of additional performance data such as pressure and torque fluctuations, hydraulic thrust, and hydraulic loads on control components, it is recommended to use dimensionless terms as defined hereafter and in 7.2.2 to 7.4. They are identified by the symbol of the measured quantity with subscripts denoting the machine component and the quantities taken as unity; for instance, $T_{G,ED}$ will denote the guide vane torque factor, i.e. the torque acting on the guide vanes based on specific hydraulic energy of the machine and reference diameter equal to unity.

The symbols used to define the measurements are listed below:

Subclause	Term	Definition	Symbol	Unit
3.4.14.1	Force	Influence tending to produce motion or stress on a machine component	F	N
3.4.14.2	Moment	Magnitude of a turning effect produced by a force acting at a perpendicular distance to a given point	M	N·m
3.4.14.3	Pressure	The force per unit area	p	Pa
3.4.14.4	Torque	The axial component of the moment	T	N·m

The dimensionless terms relating to additional performance data are listed below:

Subclause	Term	Definition	Symbol	Unit
3.4.14.5	Torque factor	$T_{ED} = \frac{T}{\rho D^3 E}$	T_{ED}	-
3.4.14.6	Torque coefficient	$T_{nD} = \frac{T}{\rho n^2 D^5}$	T_{nD}	-
3.4.14.7	Force factor	$F_{ED} = \frac{F}{\rho D^2 E}$	F_{ED}	-
3.4.14.8	Force coefficient	$F_{nD} = \frac{F}{\rho n^2 D^4}$	F_{nD}	-
3.4.14.9	Pressure fluctuation factor	$\tilde{p}_E = \frac{\tilde{p}}{\rho E}$	$\tilde{p}_E$	-
3.4.14.10	Pressure fluctuation coefficient	$\tilde{p}_{nD} = \frac{\tilde{p}}{\rho n^2 D^2}$	$\tilde{p}_{nD}$	-

4 Nature and extent of guarantees related to hydraulic performance

4.1 General

4.1.1 Design data and coordination

The purchaser shall be responsible for specifying the data on which guarantees are based including, for example, reference sections, water levels, specific hydraulic energies (see 3.4.7.1), and specific hydraulic energy losses. The purchaser is also responsible for coordinating efforts to determine interactions between the waterways and the electrical and mechanical parts of the machine.

The purchaser shall arrange for the machine supplier to be provided with data, accurate and sufficient in detail, to cover the following:

- operating water levels in all reservoirs;
- hydraulic losses of each part of the water conduit from intake to outlet;
- design drawings of water conduits associated with the hydraulic machine including valves and gates;
- any information relevant to the water flow in the conduit, such as any results of model tests of the conduits;
- in the case of rehabilitation of existing machines, particular attention is to be paid to the limitations imposed by the existing equipment (for example openings, surface roughness, generator limitations, etc.).

Attention shall be paid to flow conditions at the model inlet and outlet (see 5.1.2.4 and 5.1.3.3). In most cases, it will be sufficient to extend the model just beyond the high and low-pressure reference sections. These sections shall be included for the model tests in order to conform to this document. If the prototype installation is such that there is reason to believe that the total flow pattern through the waterways is not fully represented by the model, the contract shall specify the steps to be taken, which may include specifying the extent of the water passages to be modelled. In some other cases, the validity of the approach conditions shall have been verified by the purchaser through the test of a partial model of the plant prior to the test of the model machine.

4.1.2 Definition of the hydraulic performance guarantees

A contract for both regulated⁴ and non-regulated prototype machines shall contain, as a minimum, guarantees covering power, discharge and/or specific hydraulic energy, efficiency, maximum momentary overspeed and maximum/minimum momentary pressure and maximum steady-state runaway speed (reverse runaway speed for a pump), as well as guarantees related to cavitation.

For a pump, the guarantee may also cover the maximum specific hydraulic energy (head) and the power at zero discharge, the latter with the impeller rotating in water and/or air at the specified speed.

The guarantees shall be given for one or more operating points (see 4.2.2). These points belong to performance curves of the machine, which are usually submitted by the supplier. In some cases (e.g. small hydro), a table may be sufficient.

⁴ "Regulated" as used in this document refers to the control of the discharge through variations of guide vane opening, needle stroke and/or runner/impeller blade angle.

The current state of the art permits the verification of some of these prototype guarantees by model test (see 4.2), while others cannot be verified by model tests (see 4.3). Moreover, additional data may be obtained from the model as an indication of the expected prototype operation (see 4.4).

4.1.3 Guarantees of correlated quantities

It is recommended that the contract does not fix more than one guarantee for correlated quantities; for example in the case of a regulated turbine, efficiency shall be guaranteed versus either discharge or power, but not both.

4.1.4 Form of guarantees

Either of the following two forms of guarantees may be applied when the performance of a prototype machine is to be accepted on the basis of a model test:

- a) Guarantees for the hydraulic performance of the prototype, computed from model test results with allowance for scale effect. For reaction machines, the scale effect is to be taken into account in accordance with 6.8 and Annex D. For impulse turbines, when it is agreed in the contract, the scale effect should be taken into account in accordance with Annex I.
- b) Guarantees for the hydraulic performance of the model referred to a Reynolds number (Reynolds, Froude and Weber numbers for impulse turbines) to be specified in the contract.

In each case, the similitude requirements of 5.3 shall be met.

4.2 Main hydraulic performance guarantees verifiable by model test

4.2.1 Guaranteed quantities for any machine

4.2.1.1 Power

The term power usually refers to the mechanical power of the runner/impeller (see 3.4.9.3). When the mechanical power of the machine (see 3.4.9.2) is guaranteed for the prototype, the mechanical power losses (see 3.4.9.4) are to be taken into account.

4.2.1.2 Discharge and/or specific hydraulic energy

This refers either to the discharge at the reference section (see 3.4.5.4), obtained when operating under specified specific hydraulic energies, or to the specific hydraulic energy obtained when operating with specified discharges.

4.2.1.3 Efficiency

The term efficiency refers to the hydraulic efficiency (see 3.4.10.1) unless otherwise specified. When the prototype efficiency (see 3.4.10.3) is guaranteed, the mechanical power losses (see 3.4.9.4) or the mechanical efficiency (see 3.4.10.2) is to be taken into account.

In reaction machines, the relationship between model and prototype hydraulic efficiencies shall be considered, as explained in Annex D. The currently accepted convention is to apply this relationship to the entire range of guaranteed efficiencies.

4.2.1.4 Steady-state runaway speed and/or discharge

A guarantee for maximum steady-state runaway speed (see 3.4.5.12) or for the reverse runaway speed in case of pumps is required. An additional guarantee for maximum discharge under runaway conditions may be required.

The no-load discharge for turbine operation shall be determined as part of the characteristic runaway-curve (see Figure 56).

4.2.1.5 Influence of cavitation on hydraulic performance

The contract shall clearly state the hydraulic conditions (specific hydraulic energies and net positive suction specific energies) for which the hydraulic performances are to be guaranteed.

The guarantees of the hydraulic performance of the prototype shall include the influence of cavitation. According to current engineering practice, this influence is determined by the model tests performed in accordance with 5.3.5.2, 5.5.3.6, 6.8.2.3.8 and 6.8.3.2.

The application of the efficiency transposition formula due to the Reynolds number is limited to the range of σ values specified in 6.8.2.4.2. The contract shall specify the procedure to be used if σ_{pl} falls outside this range.

In some cases, the contract may contain an additional clause on cavitation specifying that the measured value of the Thoma number chosen as criterion (σ_d) shall be lower than the plant Thoma number σ_{pl} by a margin (see 6.10.5). The criterion and the margin shall be specified in the contract.

4.2.2 Specific application

4.2.2.1 Regulated turbine (see 6.10.3.1.2)

Guarantee	Criteria
Power	Power to be reached at one or more specified specific hydraulic energies
Discharge	Discharge to be reached at one or more specified specific hydraulic energies
Efficiency	Guarantees may be required for one or more specified specific hydraulic energies as follows: – at one or more specified powers or discharges; or – as weighted average efficiency ^{a)} over a specified range of powers or discharges
Runaway speed	Guaranteed steady-state runaway speed not to be exceeded when operating under maximum or any other specified specific hydraulic energy. In the case of double-regulated machines, it shall be stated if the guarantee refers to the condition in which the optimum relationship between guide vane opening and runner blade angle is maintained (on-cam condition) or/and to the maximum runaway speed occurring in the worst possible off-cam condition
Cavitation	Guarantees as outlined in 4.2.1.5 may be required for one or more specified specific hydraulic energies, discharges or powers, usually for the corresponding minimum σ_{pl} value
^{a)} Weighted efficiencies and a series of individual efficiencies shall not be guaranteed simultaneously	

4.2.2.2 Non-regulated turbine (see 6.10.3.1.3)

Guarantee	Criteria
Power	Power to be reached and power not to be exceeded over a specified range of specific hydraulic energies ^{a)}
Discharge	Discharge to be reached and/or not to be exceeded over a specified range of specific hydraulic energies. This guarantee is usually replaced by the corresponding power guarantee
Efficiency	Guarantees may be required for one or more specified specific hydraulic energies as follows: – at one or more specified specific hydraulic energies; or – as a weighted average efficiency^{b)} over a specified range of specific hydraulic energies
Runaway speed	Guaranteed steady-state runaway speed not to be exceeded when operating under maximum specific hydraulic energy
Cavitation	Guarantees as outlined in 4.2.1.5 may be required for one or more specified specific hydraulic energies, usually for the corresponding minimum σ_{pl} value
a) For the contractual limits of the power corresponding to the specified specific hydraulic energies, see 6.10.3.1.3.	
b) Weighted efficiencies and a series of individual efficiencies shall not be guaranteed simultaneously.	

4.2.2.3 Non-regulated/regulated pump (see 6.10.3.1.4)

Guarantee	Criteria
Power	Power not to be exceeded over a specified range of specific hydraulic energies or discharge
Discharge and/or specific hydraulic energy	Discharge over a specified range of specific hydraulic energies or specific energies over a specified range of discharges, including values to be reached and/or not to be exceeded
Efficiency	Guarantees may be required for one or more specified specific hydraulic energies or discharges as follows: – at one or more specified specific hydraulic energies or discharges; or – as a weighted average efficiency^{a)} over a specified range of specific hydraulic energies or discharges
Runaway speed	Guaranteed maximum steady-state reverse runaway speed not to be exceeded when operating under maximum specified specific hydraulic energy. In the case of double-regulated machines, it shall be stated if the guarantee is referred to the condition in which the optimum relationship between guide vane opening and impeller blade angle is maintained (on-cam condition) or/and to the maximum runaway speed occurring in the worst possible off-cam condition
Cavitation	Guarantees as outlined in 4.2.1.5 may be required for one or more specified specific hydraulic energies, discharges or powers, usually for the corresponding minimum σ_{pl} value
a) Weighted efficiencies and a series of individual efficiencies shall not be guaranteed simultaneously	

4.3 Guarantees not verifiable by model test**4.3.1 Guarantees on cavitation erosion**

The amount of cavitation pitting is to be guaranteed for the prototype only. Evaluation of this guarantee on the prototype shall be carried out in accordance with the recommendations of the IEC 60609 series.

The model test may reveal some of the potential areas of cavitation erosion by visual inspection during the tests (see 5.5.3.6).

4.3.2 Guarantees on maximum momentary overspeed and maximum momentary pressure rise

Momentary overspeed (including momentary runaway speed) and pressure depend primarily upon water conduit geometry (penstock length, surge tank, etc.), the inertia of the rotating part of the unit and the operating law of the guide vanes. They can therefore not be determined directly by a dynamic test on the model which does not reproduce either the full extent of the applicable waterways, the inertia of the unit or the characteristics of the speed governor. Nevertheless, the steady-state model test data, transferred to the prototype, provide values enabling calculation of the transient phenomena with sufficient accuracy.

4.3.3 Guarantees covering noise and vibration

Determination of prototype noise and vibration by model tests lies outside the scope of this document. This document should be used only as a guide for the modelling of the hydraulic sources of these phenomena (i.e. through determination of the pressure fluctuations or other dynamic loads).

4.4 Additional performance data

Additional data may be obtained from the model:

- pressure fluctuations (see 7.2.2);
- shaft torque fluctuations (see 7.2.3);
- hydraulic thrust, both radial and axial (see 7.3);
- hydraulic torque on guide vanes and adjustable runner/impeller blades or hydraulic forces on needles and deflectors over the full operating range (see 7.4);
- characteristics in four quadrant operation including power and specific hydraulic energy at zero discharge (shut-off conditions) of a pump with impeller rotating in water or air (see 7.5);
- differential pressure measurements in view of prototype index tests (see 7.6);
- cam relationship for optimum performance in the case of double-regulated machines (relation between guide vane and runner/impeller blade openings) (see 6.8).

It may also be specified to determine other additional data, such as velocity or pressure distribution in various components of the machine, etc.

5 Execution of tests

5.1 Requirements of test installation and model

5.1.1 Choice of laboratory

Any laboratory satisfying the criteria set out in this document concerning general layout, capacity and quality of instrumentation should be deemed suitable. An independent laboratory is sometimes preferable, particularly when comparative tests are required with models from different manufacturers.

5.1.2 Test installation

5.1.2.1 General characteristics of the test circuit

The test circuit shall be such that when cavitation appears in the model, it shall not occur elsewhere to an extent whereby it affects the stability or the satisfactory operation of the installation or of the model performance measurement.

Any entrained gas bubbles in the model shall not affect the functioning of instrumentation, particularly the flow measuring device and the pressure measurement lines.

The circuit shall be designed in such a manner that no leakage or addition of water may occur between the flow measuring instrument and the model. These criteria should be easily verifiable.

5.1.2.2 Capacity of the test installation

The capacity of the test installation (i.e. power, pressure, specific hydraulic energy, discharge and *NPSE*) shall be such that the minimum values for model size and the required test conditions as listed in 5.4.2 can be met.

The operation shall be stable and steady without surging or fluctuating effects (see 5.4.3).

5.1.2.3 Condition of the water

The test water shall be clean, clear and free of any solid material in suspension and any chemical impurities which may have an influence on the water properties such as viscosity and vapour pressure. Free gas and air bubbles should be removed as far as possible before testing (see 5.3.5.2 for recommended level).

The gas content (see 5.7.3.2), including both entrained and dissolved gas, of the water used in the test rig, should be recorded for the test, especially with respect to repeatability of cavitation test results and for comparison purposes.

Experience in closed circuits indicates that dissolved air may produce nuclei in the water and the nuclei content plays a major role in travelling cavitation, e.g. gas bubbles moving through the flow (see 5.3.6.2 for nuclei influence on cavitation). Therefore, this may influence the cavitation pattern and the resulting cavitation characteristics (see 5.3.5 and 5.3.6.2).

Thoma similitude should be fulfilled by using an appropriate specific hydraulic energy or/and nuclei content.

The water temperature should be within the range of 8 °C and 35 °C and not vary more than 5 °C per day. Large differences between the water temperature and the ambient temperature of instruments should be avoided, as they could influence the accuracy of the measurements.

5.1.2.4 Flow conditions given by the installation

At the model inlet, the test installation shall ensure favourable hydraulic conditions free from vortices, undue turbulence and unsteadiness.

At the model outlet, the flow pattern should not be influenced by the layout of the test facility.

5.1.2.5 Measuring instruments

The measuring equipment used to determine the main parameters shall satisfy the specified conditions of this document.

The traceability of each instrument to a recognized national or international standard shall be ensured. All instruments, especially discharge and torque, should be calibrated *in situ*. Some calibrations can be performed prior to installation on the test rig e.g. calibration of the measuring instruments for guide vane and blade torque, and dynamic instruments.

The measuring instruments should be such that a parallel reading, independent of the data acquisition system, is possible in order to permit an easy verification.

The instrument temperature shall be verified to be within the allowable specification of the manufacturer.

5.1.3 Model requirements

5.1.3.1 Model size

The minimum values for model size are prescribed in 5.4.2.

Normally, models shall be as large as practical but never less than the values stated. The same model should be used for all tests related to main hydraulic performance guarantees and influence of cavitation (see 4.2). Comparative model tests shall be performed with models of the same size.

5.1.3.2 Layout and mechanical design of the model

The layout and mechanical design of the model shall comply with the specified items of testing. The following points shall be rigorously considered:

- deformations due to loading under the chosen test specific hydraulic energy shall be minimized by appropriate design and choice of material;
- moveable elements used to vary machine geometry (runner/impeller blades, guide vanes, nozzles) shall be capable of repeating and maintaining a set position;
- bearing system, shaft and stationary parts shall have sufficient rigidity to avoid contact in the labyrinth during normal operation. Blade tip and seal labyrinth clearances of less than 0,15 mm are not recommended for mechanical reasons;
- hydraulically smooth surfaces of the water passages are recommended;

- in addition to general requirements for surface conditions, great care should be given to the proper matching of joints in order to avoid any local flow separation;
- materials should be chosen to avoid oxidation and electrochemical corrosion. The water passage surfaces should remain in good condition for the test duration;
- provision shall be made for easy cleaning or repairing of water passages;
- a transparent cone or windows should be provided for observation of the flow in the runner/impeller and in the adjacent portion of the draft tube (at the low-pressure stage in case of a multistage machine);
- wherever shaft seals and shaft bearings are required to be a part of the model (e.g. multistage machines) when comparative model tests are performed, these parts are to be of identical design;
- for comparative tests of the same model, but with different runners/impellers, provisions shall be made that all runners/impellers can be tested with the same clearances and thrust balancing provisions;
- where additional data have to be measured (such as pressure fluctuations, guide vane torque, velocity distribution) the model shall permit easy installation and checks of the corresponding measuring equipment;
- when it is required to proceed to an optimization or modification of the individual component (e.g. stay vanes, guide vanes, draft tube, etc.), the model shall permit easy installation of various configurations;
- if any non-homology exists (e.g. differences in runner band/crown thickness, seal design, etc.), any analytical procedures adopted to account for these differences shall be mutually agreed.

5.1.3.3 Extent of model

The position of reference sections and the extent of the water passages from inlet to outlet to be included in the model (at least the part between the high-pressure and low-pressure reference sections) shall be clearly defined in the contract (see Figure 1 and as an example Figure 44).

All the water passages influencing the performance of the prototype, i.e. inflow and outflow conditions, should as far as possible be included in the model.

Especially for low specific hydraulic energy turbines, it is recommended that the model extends from the prototype inlet to the outlet section of the draft tube.

Upstream or downstream gate slots are not required, unless they are located between the measuring or reference sections of the machine. Information on the influence of these parts on the hydraulic behaviour of the machine may be obtained from tests in addition to the model acceptance tests.

5.1.3.4 Geometric similarity of model and prototype

5.1.3.4.1 General requirements

A basic requirement for determining prototype performance from model tests is to have geometrical similarity (homology) between model and prototype. Therefore, it is necessary to compare on both machines the geometrical dimensions and the surface finish of all components in contact with the flow.

The geometric similarity between model and prototype is to be checked in accordance with 5.2.

The model shall be geometrically similar (homologous) to the prototype in all wetted parts within the limits defined in 5.1.3.3. This also includes details that may have a measurable influence on the performance (see 5.2.9.3). However, in particular cases where some minor deviations from the similarity cannot be avoided, an agreement shall be reached to determine if the results are to be corrected.

On the prototype, any non-homology or deviations that may occur during manufacturing or installation should be evaluated and corrective measures shall be mutually agreed to reduce the influence on hydraulic performance.

All abrupt changes should be corrected. It is recommended to use at least a ratio of 1:10 to correct the transition area.

On the prototype, in addition to general requirements for surface conditions, great care should be given to the proper matching of joints for all components in contact with the flow in order to avoid any local flow disturbances.

In the case of acceptance tests on both model and prototype, the same measuring sections should be used if possible. If not possible, an agreement shall be reached to determine if the results are to be corrected.

For comparative model tests, all models should rotate in the same direction.

5.1.3.4.2 Multistage machines

Normally, the model test should be performed with the same number of stages as the prototype.

For a prototype with four or more stages, in exceptional cases, the model may be tested with a reduced number of stages, for instance a three-stage model for a four-stage prototype.

5.1.3.4.3 Labyrinth seals and thrust balancing provisions

For mechanical reasons, it may not be possible or desirable (especially for large scale ratios) for the shaft and runner/impeller seal clearances and the thrust balancing provision to be either geometrically similar or hydraulically equivalent between the model and the prototype. In such cases, seal leakage losses and thrust coefficient will differ between model and prototype. The differences shall either be negligible or be accurately estimated so that the hydraulic efficiency and the thrust of the prototype can be computed. For the evaluation of the impact on hydraulic efficiency, the transposition formulas provided by IEC 62097 can be used.

An agreement should be reached before the tests concerning the monitoring and measuring of leakage discharge q (see Figure 6) and whether or not it should be taken into account in determining machine performance.