

CONSOLIDATED VERSION

VERSION CONSOLIDÉE



GROUP SAFETY PUBLICATION
PUBLICATION GROUPEE DE SÉCURITÉ

**Tests on electric and optical fibre cables under fire conditions –
Part 1-2: Test for vertical flame propagation for a single insulated wire or cable –
Procedure for 1 kW pre-mixed flame**

**Essais des câbles électriques et à fibres optiques soumis au feu –
Partie 1-2: Essai de propagation verticale de la flamme sur conducteur ou câble
isolé – Procédure pour flamme à prémélange de 1 kW**



THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2015 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

Droits de reproduction réservés. Sauf indication contraire, aucune partie de cette publication ne peut être reproduite ni utilisée sous quelque forme que ce soit et par aucun procédé, électronique ou mécanique, y compris la photocopie et les microfilms, sans l'accord écrit de l'IEC ou du Comité national de l'IEC du pays du demandeur. Si vous avez des questions sur le copyright de l'IEC ou si vous désirez obtenir des droits supplémentaires sur cette publication, utilisez les coordonnées ci-après ou contactez le Comité national de l'IEC de votre pays de résidence.

IEC Central Office
3, rue de Varembe
CH-1211 Geneva 20
Switzerland

Tel.: +41 22 919 02 11
Fax: +41 22 919 03 00
info@iec.ch
www.iec.ch

About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigenda or an amendment might have been published.

IEC Catalogue - webstore.iec.ch/catalogue

The stand-alone application for consulting the entire bibliographical information on IEC International Standards, Technical Specifications, Technical Reports and other documents. Available for PC, Mac OS, Android Tablets and iPad.

IEC publications search - www.iec.ch/searchpub

The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee,...). It also gives information on projects, replaced and withdrawn publications.

IEC Just Published - webstore.iec.ch/justpublished

Stay up to date on all new IEC publications. Just Published details all new publications released. Available online and also once a month by email.

Electropedia - www.electropedia.org

The world's leading online dictionary of electronic and electrical terms containing more than 30 000 terms and definitions in English and French, with equivalent terms in 15 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.

IEC Glossary - std.iec.ch/glossary

More than 60 000 electrotechnical terminology entries in English and French extracted from the Terms and Definitions clause of IEC publications issued since 2002. Some entries have been collected from earlier publications of IEC TC 37, 77, 86 and CISPR.

IEC Customer Service Centre - webstore.iec.ch/csc

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: csc@iec.ch.

A propos de l'IEC

La Commission Electrotechnique Internationale (IEC) est la première organisation mondiale qui élabore et publie des Normes internationales pour tout ce qui a trait à l'électricité, à l'électronique et aux technologies apparentées.

A propos des publications IEC

Le contenu technique des publications IEC est constamment revu. Veuillez vous assurer que vous possédez l'édition la plus récente, un corrigendum ou amendement peut avoir été publié.

Catalogue IEC - webstore.iec.ch/catalogue

Application autonome pour consulter tous les renseignements bibliographiques sur les Normes internationales, Spécifications techniques, Rapports techniques et autres documents de l'IEC. Disponible pour PC, Mac OS, tablettes Android et iPad.

Recherche de publications IEC - www.iec.ch/searchpub

La recherche avancée permet de trouver des publications IEC en utilisant différents critères (numéro de référence, texte, comité d'études,...). Elle donne aussi des informations sur les projets et les publications remplacées ou retirées.

IEC Just Published - webstore.iec.ch/justpublished

Restez informé sur les nouvelles publications IEC. Just Published détaille les nouvelles publications parues. Disponible en ligne et aussi une fois par mois par email.

Electropedia - www.electropedia.org

Le premier dictionnaire en ligne de termes électroniques et électriques. Il contient plus de 30 000 termes et définitions en anglais et en français, ainsi que les termes équivalents dans 15 langues additionnelles. Egalement appelé Vocabulaire Electrotechnique International (IEV) en ligne.

Glossaire IEC - std.iec.ch/glossary

Plus de 60 000 entrées terminologiques électrotechniques, en anglais et en français, extraites des articles Termes et Définitions des publications IEC parues depuis 2002. Plus certaines entrées antérieures extraites des publications des CE 37, 77, 86 et CISPR de l'IEC.

Service Clients - webstore.iec.ch/csc

Si vous désirez nous donner des commentaires sur cette publication ou si vous avez des questions contactez-nous: csc@iec.ch.

CONSOLIDATED VERSION

VERSION CONSOLIDÉE



GROUP SAFETY PUBLICATION
PUBLICATION GROUPEE DE SÉCURITÉ

**Tests on electric and optical fibre cables under fire conditions –
Part 1-2: Test for vertical flame propagation for a single insulated wire or cable –
Procedure for 1 kW pre-mixed flame**

**Essais des câbles électriques et à fibres optiques soumis au feu –
Partie 1-2: Essai de propagation verticale de la flamme sur conducteur ou câble
isolé – Procédure pour flamme à prémélange de 1 kW**

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

COMMISSION
ELECTROTECHNIQUE
INTERNATIONALE

ICS 13.220.40; 29.020; 29.060.20

ISBN 978-2-8322-2831-9

**Warning! Make sure that you obtained this publication from an authorized distributor.
Attention! Veuillez vous assurer que vous avez obtenu cette publication via un distributeur agréé.**

REDLINE VERSION

VERSION REDLINE



GROUP SAFETY PUBLICATION
PUBLICATION GROUPÉE DE SÉCURITÉ

**Tests on electric and optical fibre cables under fire conditions –
Part 1-2: Test for vertical flame propagation for a single insulated wire or cable –
Procedure for 1 kW pre-mixed flame**

**Essais des câbles électriques et à fibres optiques soumis au feu –
Partie 1-2: Essai de propagation verticale de la flamme sur conducteur ou câble
isolé – Procédure pour flamme à prémélange de 1 kW**

CONTENTS

FOREWORD	3
1 Scope	5
2 Normative references	5
3 Terms and definitions	5
4 Test apparatus	6
5 Procedure	6
5.1 Sample	6
5.2 Conditioning	6
5.3 Positioning of test piece	6
5.4 Flame application	6
6 Evaluation of test results	7
Annex A (informative) Recommended performance requirements	11
Bibliography	12
 Figure 1 – Arrangement of test piece in test apparatus	8
Figure 2 – Application of flame to test piece	10
Table 1 – Time for flame application	7

INTERNATIONAL ELECTROTECHNICAL COMMISSION

TESTS ON ELECTRIC AND OPTICAL FIBRE CABLES UNDER FIRE CONDITIONS –

Part 1-2: Test for vertical flame propagation for a single insulated wire or cable – Procedure for 1 kW pre-mixed flame

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as “IEC Publication(s)”). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

DISCLAIMER

This Consolidated version is not an official IEC Standard and has been prepared for user convenience. Only the current versions of the standard and its amendment(s) are to be considered the official documents.

This Consolidated version of IEC 60332-1-2 bears the edition number 1.1. It consists of the first edition (2004-07) [documents 20/697/FDIS and 20/711/RVD] and its amendment 1 (2015-07) [documents 20/1591/FDIS and 20/1598/RVD]. The technical content is identical to the base edition and its amendment.

In this Redline version, a vertical line in the margin shows where the technical content is modified by amendment 1. Additions and deletions are displayed in red, with deletions being struck through. A separate Final version with all changes accepted is available in this publication.

International Standard IEC 60332-1-2 has been prepared by IEC technical committee 20: Electric cables.

It has the status of a group safety publication in accordance with IEC Guide 104.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

IEC 60332 consists of the following parts, under the general title *Tests on electric and optical fibre cables under fire conditions*:

Part 1-1: Test for vertical flame propagation for a single insulated wire or cable – Apparatus

Part 1-2: Test for vertical flame propagation for a single insulated wire or cable – Procedure for 1kW pre-mixed flame

Part 1-3: Test for vertical flame propagation for a single insulated wire or cable – Procedure for determination of flaming droplets/particles

Part 2-1: Test for vertical flame propagation for a single small insulated wire or cable – Apparatus

Part 2-2: Test for vertical flame propagation for a single small insulated wire or cable - Procedure for diffusion flame

The committee has decided that the contents of the base publication and its amendment will remain unchanged until the stability date indicated on the IEC web site under "<http://webstore.iec.ch>" in the data related to the specific publication. At this date, the publication will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.

TESTS ON ELECTRIC AND OPTICAL FIBRE CABLES UNDER FIRE CONDITIONS –

Part 1-2: Test for vertical flame propagation for a single insulated wire or cable – Procedure for 1 kW pre-mixed flame

1 Scope

This part of IEC 60332 specifies the procedure for testing the resistance to vertical flame propagation for a single vertical electrical insulated conductor or cable, or optical fibre cable, under fire conditions. The apparatus is given in IEC 60332-1-1.

NOTE 1 Testing to IEC 60332-1-2 may be performed simultaneously with that to IEC 60332-1-3 if required.

Recommended requirements for performance are given in Annex A.

IEC 60332-1-2 specifies the use of a 1 kW pre-mixed flame and is for general use, except that the procedure specified may not be suitable for the testing of small single insulated conductors or cables of less than 0,5 mm² total cross-section because the conductor melts before the test is completed, or for the testing of small optical fibre cables because the cable is broken before the test is completed. In these cases, the procedure given in IEC 60332-2-2 is recommended.

NOTE 2 Since the use of insulated conductor or cable which retards flame propagation and complies with the recommended requirements of this standard is not sufficient by itself to prevent propagation of fire under all conditions of installation, it is recommended that wherever the risk of propagation is high, for example in long vertical runs of bunches of cables, special installation precautions should also be taken. It cannot be assumed that because the sample of cable complies with the performance requirements recommended in this standard, that a bunch of cables will behave in a similar manner. (See IEC 60332-3 series.)

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60332-1-1, *Tests on electric and optical fibre cables under fire conditions – Part 1-1: Test for vertical flame propagation for a single insulated wire or cable – Apparatus*

IEC 60695-4, *Fire hazard testing – Part 4: Terminology concerning fire tests*

IEC 60811-203, *Electric and optical fibre cables – Test methods for non-metallic materials – Part 203: General tests – Measurement of overall dimensions*

IEC Guide 104, *The preparation of safety publications and the use of basic safety publications and group safety publications*

3 Terms and definitions

For the purposes of this document, the following terms and definitions apply. The definitions are taken from IEC 60695-4.

3.1

ignition source

source of energy that initiates combustion

~~[IEC 60695-4:1993, definition 2.76 SOURCE: ISO 13943:2008, 1.489]~~

3.2

char

carbonaceous residue resulting from pyrolysis or incomplete combustion

~~[IEC 60695-4:1993, definition 2.12 SOURCE: ISO 13943:2008, 4.38]~~

4 Test apparatus

The apparatus specified in IEC 60332-1-1 shall be used.

5 Procedure

5.1 Sample

The test sample shall be a piece of single insulated conductor or cable (600 ± 25) mm long.

The test sample diameter shall be measured using the method given in IEC 60811-203. The measurement shall be made at each of three places, separated by at least 100 mm.

The average of the three values obtained shall be rounded to obtain the overall diameter. If the calculation gives 5 or more for the second decimal figure, raise the first to the next number; thus, for example, 5,75 is rounded to 5,8. If the calculation gives 4 or less for the second decimal figure, maintain the first number; thus, for example, 5,74 is rounded to 5,7.

The overall diameter obtained shall be used for the selection of the time for flame application.

5.2 Conditioning

Before testing, all test pieces shall be conditioned at (23 ± 5) °C for not less than 16 h at a relative humidity of (50 ± 20) %.

In the case of a single insulated conductor or cable with a finish of paint or lacquer, this conditioning shall follow an initial period where the test piece shall be kept at a temperature of (60 ± 2) °C for 4 h.

5.3 Positioning of test piece

The test piece shall be straightened and secured to two horizontal supports by means of a suitable size of copper wire, in a vertical position in the centre of the metal ~~screen enclosure~~, as described in ~~4.2 of~~ IEC 60332-1-1, so that the distance between the bottom of the upper support and the top of the lower support is (550 ± 5) mm. In addition, the test piece shall be positioned so that the bottom of the specimen is approximately 50 mm from the base of the ~~screen enclosure~~ (see Figure 1).

The vertical axis of the test piece shall be arranged centrally within the ~~screen enclosure~~ (i.e. 150 mm from each side and 225 mm from the rear).

5.4 Flame application

Safety warning

Precautions shall be taken to safeguard personnel against the following when conducting tests:

- a) the risk of fire or explosion;

- b) the inhalation of smoke and/or noxious products, particularly when halogenated materials are burned;
- c) harmful residues.

5.4.1 Positioning of flame

~~One~~ A burner, as described in ~~4.3 of~~ IEC 60332-1-1, shall be ignited and the ~~recommended~~ flow rates of gas and air adjusted ~~to the specified values~~. The burner shall be positioned so that the tip of the ~~inner~~ blue cone impinges on the surface of the test piece at a distance of (475 ± 5) mm from the lower edge of the upper horizontal support, whilst the burner is at an angle of $(45 \pm 2)^\circ$ to the vertical axis of the test piece (see Figure 2). ~~The burner position shall be fixed throughout the flame application time.~~

For flat-form cables, the flame impingement shall be on the middle of the flat side of the cable.

In case of an electrical insulated conductor or cable, should the test piece move significantly during the test so as to render the result invalid, the test piece shall be held straight by the attachment of a load of approximately 5 N/mm^2 of conductor area to the lower part of the sample so that the distance between the point where the load is attached and the lower edge of the top support measures (550 ± 5) mm. In such cases, the test piece shall not be secured to the lower support.

5.4.2 Test duration

The flame shall be applied continuously for the period of time corresponding to the diameter shown in Table 1.

Table 1 – Time for flame application

Overall diameter of test piece ^a mm	Time for flame application ^b s
$D \leq 25$	60 ± 2
$25 < D \leq 50$	120 ± 2
$50 < D \leq 75$	240 ± 2
$D > 75$	480 ± 2
^a Where non-circular cables (for example, flat-form constructions) are to be tested, the circumference shall be measured and used to calculate an equivalent diameter, as if the cable were circular. For non-circular cables in which the major to minor axis ratio is less than 3, the nominal minor axis shall be used as the overall diameter (D). For non-circular cables in which the major to minor axis ratio lies between 3 and 16, the overall diameter (D) shall be taken as the sum of the major and minor axis divided by 3,14 (π). For cables in which the major to minor axis ratio exceeds 16, the test criteria shall be given in the product standard or, if not, agreed between manufacturer and purchaser.	
^b For flat cables having a ratio of major to minor axis greater than 17:1, the flame application time remains under consideration.	

At the end of the specified ~~test duration~~ flame application time, the burner shall be removed and the flame of the burner extinguished.

6 Evaluation of test results


After all burning has ceased, the test piece shall be wiped clean.

All soot shall be ignored if, when wiped off, the original surface is undamaged. Softening or any deformation of the non-metallic materials shall also be ignored. The distance from the lower edge of the top support to the upper onset of charring and the distance from the lower edge of the top support to the lower onset of charring shall be measured to the nearest millimetre.

The onset of char shall be determined as follows.

Press against the cable surface with a sharp object, for example, a knife blade. Where the surface changes from a resilient to a brittle (crumbling) surface indicates the onset of charring.

Dimensions in millimetres

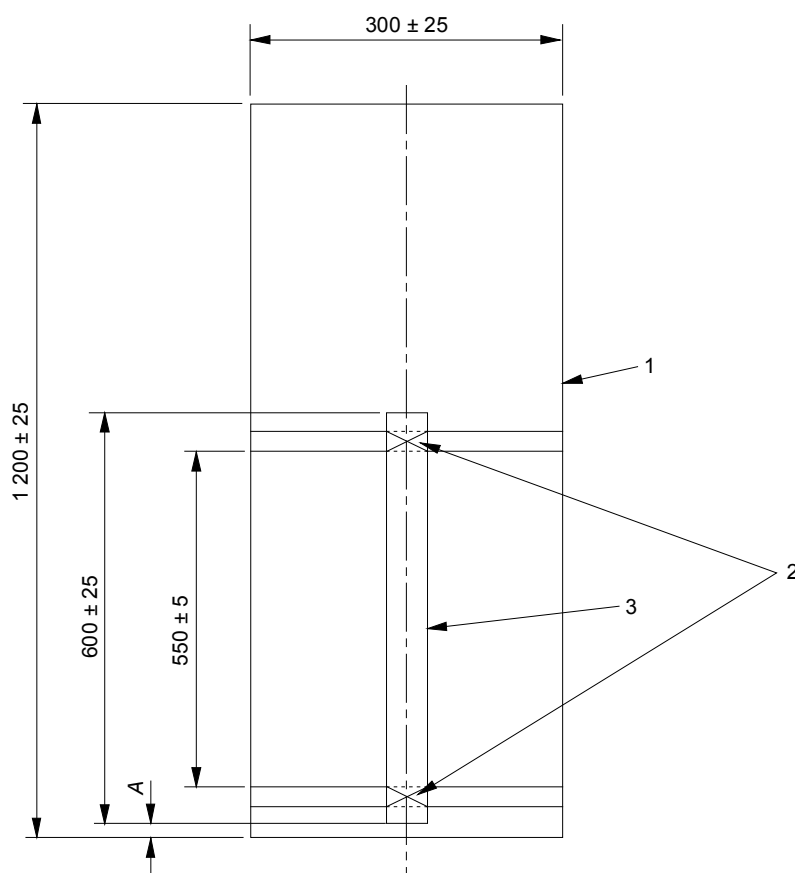

IEC 1000/04


Key

- 1 metallic screen metal enclosure
- 2 support arm and copper wire fixing
- 3 test piece


Distance A: Length from base of screen enclosure to bottom of test piece = 50 mm (approximately)

Figure 1 – Arrangement of test piece in test apparatus

Dimensions in millimetres

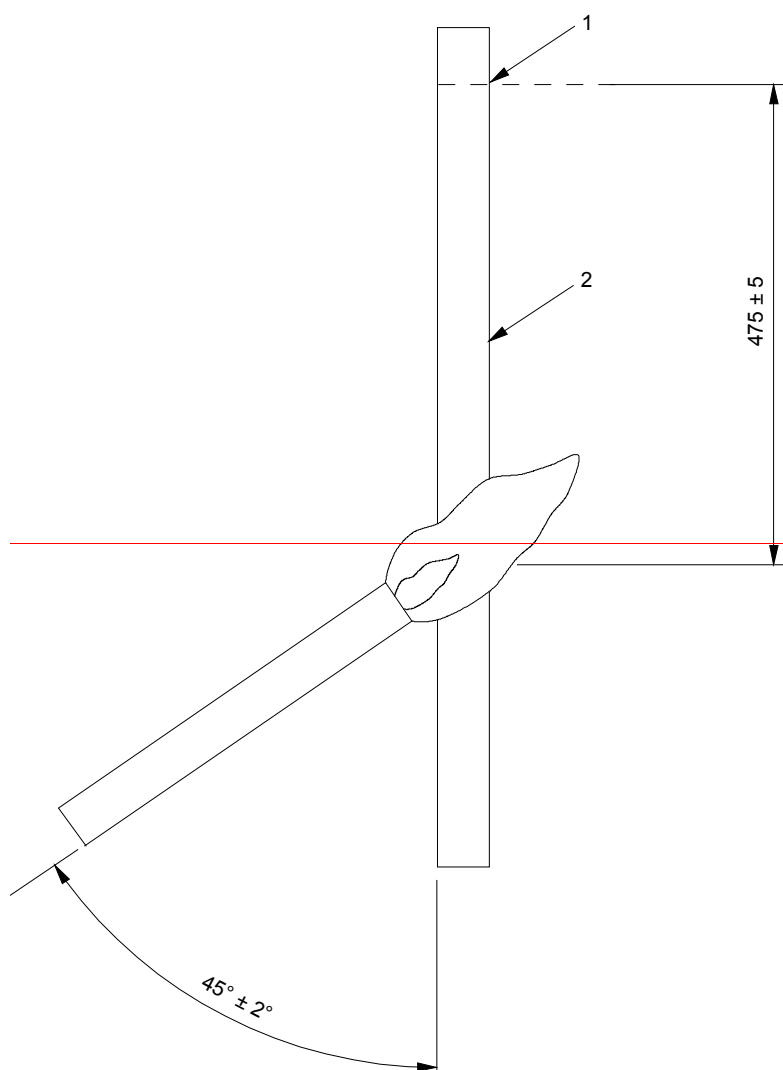

IEC 1001/04

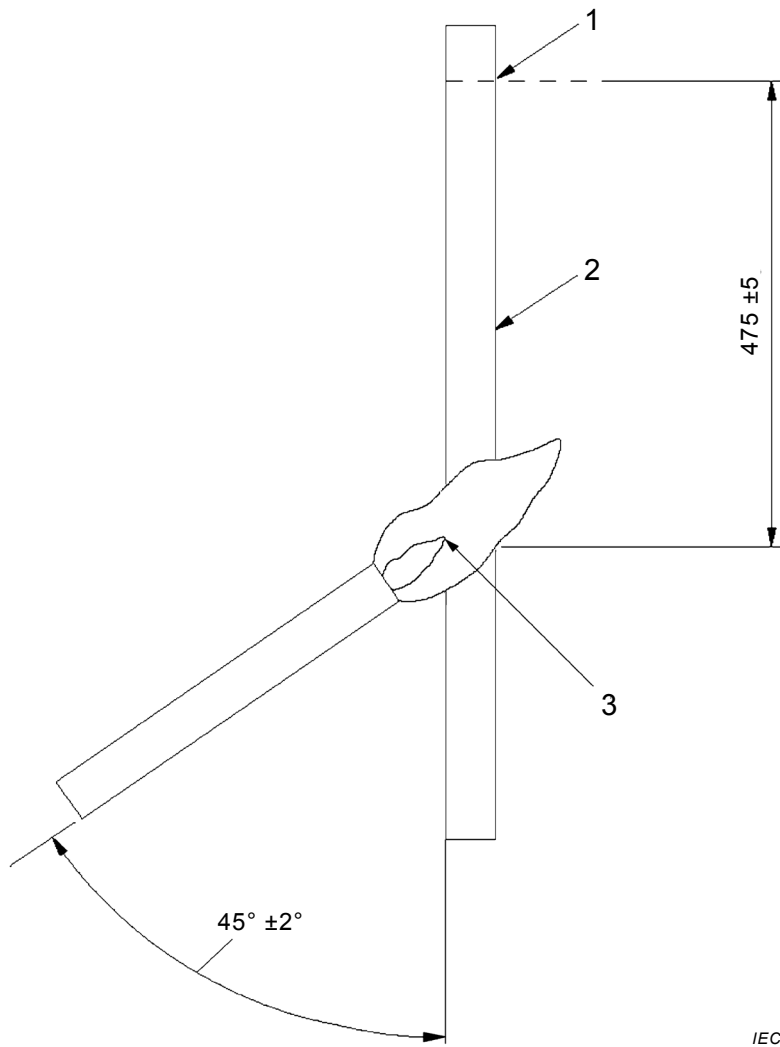

IEC

Key

- 1 lower edge of top support
- 2 test piece
- 3 position of impingement of blue cone

Figure 2 – Application of flame to test piece

Annex A (informative)

Recommended performance requirements

The performance requirements for a particular type or class of insulated conductor or cable should preferably be given in the individual cable standard. In the absence of any given requirement it is recommended that those given below should be taken as a minimum acceptable level.

The single insulated conductor or cable shall pass the test if the distance between the lower edge of the top support and the onset of charring is greater than 50 mm.

In addition, a failure shall be recorded if charring extends downwards to a point greater than 540 mm from the lower edge of the top support.

If a failure is recorded, two more tests shall be carried out. If both tests result in passes, the single insulated conductor or cable shall be deemed to have passed the test.

Bibliography

IEC 60332-1-3, *Tests on electric and optical fibre cables under fire conditions – Part 1-3: Test for vertical flame propagation for a single small insulated conductor or cable – Procedure for determination of flaming droplets/particles*

IEC 60332-2-2, *Tests on electric and optical fibre cables under fire conditions – Part 2-2: Test for vertical flame propagation for a single small insulated conductor or cable – Procedure for diffusion flame*

IEC 60332-3 (all parts), *Tests on electric cables under fire conditions – Test for vertical flame spread of vertically-mounted bunched wires or cables*

ISO 13943, *Fire safety – Vocabulary*
