

INTERNATIONAL STANDARD



Optical fibre cables –

Part 4-20: Sectional specification – Aerial optical cables along electrical power lines – Family specification for ADSS (all dielectric self-supported) optical cables



THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2018 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

IEC Central Office
3, rue de Varembe
CH-1211 Geneva 20
Switzerland

Tel.: +41 22 919 02 11
info@iec.ch
www.iec.ch

About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigenda or an amendment might have been published.

IEC Catalogue - webstore.iec.ch/catalogue

The stand-alone application for consulting the entire bibliographical information on IEC International Standards, Technical Specifications, Technical Reports and other documents. Available for PC, Mac OS, Android Tablets and iPad.

IEC publications search - webstore.iec.ch/advsearchform

The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee,...). It also gives information on projects, replaced and withdrawn publications.

IEC Just Published - webstore.iec.ch/justpublished

Stay up to date on all new IEC publications. Just Published details all new publications released. Available online and also once a month by email.

Electropedia - www.electropedia.org

The world's leading online dictionary of electronic and electrical terms containing 21 000 terms and definitions in English and French, with equivalent terms in 16 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.

IEC Glossary - std.iec.ch/glossary

67 000 electrotechnical terminology entries in English and French extracted from the Terms and Definitions clause of IEC publications issued since 2002. Some entries have been collected from earlier publications of IEC TC 37, 77, 86 and CISPR.

IEC Customer Service Centre - webstore.iec.ch/csc

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: sales@iec.ch.



IEC 60794-4-20

Edition 2.0 2018-08
REDLINE VERSION

INTERNATIONAL STANDARD



Optical fibre cables –

Part 4-20: Sectional specification – Aerial optical cables along electrical power lines – Family specification for ADSS (all dielectric self-supported) optical cables

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

ICS 33.180.10

ISBN 978-2-8322-6009-8

Warning! Make sure that you obtained this publication from an authorized distributor.

CONTENTS

FOREWORD.....	5
1 Scope.....	7
2 Normative references	7
3 Terms, definitions and abbreviated terms	8
4 Optical fibres	10
General.....	
Attenuation	
Attenuation coefficient.....	
Attenuation discontinuities.....	
Cut-off wavelength of cabled fibre	
Fibre colouring.....	
Polarisation mode dispersion (PMD).....	
5 Cable elements	11
6 Optical fibre cable constructions	11
6.1 General.....	11
Optical unit	
6.2 Cable protection elements	11
7 Main requirements for installation and operating conditions	12
8 Cable design considerations	12
9 Cable tests	13
9.1 General.....	13
Classification of tests	
Type tests.....	
Factory acceptance tests	
Routine tests	
9.2 Tensile performance.....	14
9.2.1 General	14
9.2.2 Family requirement	15
9.2.3 Test conditions	15
9.3 Sheave test.....	15
9.3.1 General	15
9.3.2 Family requirement	16
9.3.3 Test conditions	16
Installation capability.....	
9.4 Repeated bending.....	16
9.4.1 General	16
9.4.2 Family requirements.....	16
9.4.3 Test conditions	16
9.5 Impact	17
9.5.1 General	17
9.5.2 Family requirements.....	17
9.5.3 Test conditions	17
9.6 Crush.....	17
9.6.1 General	17
9.6.2 Test requirements.....	17

9.6.3	Test conditions	17
Kink		
9.7	Torsion	18
9.7.1	General	18
9.7.2	Test requirements	18
Vibration testing		
9.8	Aeolian vibration test.....	18
9.8.1	General	18
9.8.2	Family requirements.....	18
9.8.3	Test conditions	18
9.8.4	Parameters to be reported.....	18
9.9	Low frequency vibration test (galloping test)	19
9.9.1	General	19
9.9.2	Family requirements.....	19
9.9.3	Test conditions	19
9.10	Temperature cycling	20
9.10.1	General	20
9.10.2	Family requirements.....	20
9.10.3	Test conditions	20
9.11	Water penetration	20
9.12	Weathering resistance Cable UV resistance.....	21
9.13	Tracking and erosion resistance test.....	21
9.14	Creep behaviour	21
9.15	Fitting compatibility	22
Factory acceptance tests		
Routine tests		
10	Quality assurance.....	23
Annex A (informative) Packaging and marking.....		24
Annex B (informative) Installation considerations for ADSS cables.....		25
Annex C (informative) Electrical test (tracking)		27
C.1	General.....	27
C.2	Option C1 C2 – Sheath material qualification	27
C.2.1	Overview	27
C.2.2	Test arrangements	27
C.2.3	Test procedure.....	28
C.2.4	Requirements	28
Option C2 – Example of test for Sahara desert conditions		
C.3	Option C3 – Pollution level and tracking resistance	31
C.3.1	Overview	31
C.3.2	Test setup.....	31
C.3.3	Test method.....	33
C.3.4	Overview of pollution model and electrical test.....	34
Annex D (informative) All dielectric self-supported (ADSS) cables to be used in overhead power lines (blank detail specification)		36
Bibliography		38

~~Figure – Draft of test equipment~~

~~Figure – Test chamber~~



Documents

Document Sharing Hub

Figure B.1 – Example of different span lengths allowed for the same cable, depending on sag variation	26
Figure C.1 – Electric scheme for the test	31
Figure C.2 – Foils of the electrodes	32
Figure C.3 – Nozzle	32
Figure C.4 – Details for the spraying	33
Figure C.5 – Pollution model Distributed element model with dry band arc gap	34
Figure C.6 – Basic circuit for arcing test Thevenin equivalent circuit	35
Table 1 – Cable design characteristics	13
Table 2 – Optional parameters (if required by customer)	13
Table C.1 – R_{eq} and C_{eq} values for different pollution index values	33
Table D.1 – Blank detail specification	36

INTERNATIONAL ELECTROTECHNICAL COMMISSION

OPTICAL FIBRE CABLES –

Part 4-20: Sectional specification – Aerial optical cables along electrical power lines – Family specification for ADSS (all dielectric self-supported) optical cables

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

This redline version of the official IEC Standard allows the user to identify the changes made to the previous edition. A vertical bar appears in the margin wherever a change has been made. Additions are in green text, deletions are in strikethrough red text.

International Standard IEC 60794-4-20 has been prepared by subcommittee 86A: Fibres and cables, of IEC technical committee 86: Fibre optics.

This second edition cancels and replaces the first edition published in 2012 and constitutes a technical revision.

This edition includes the following significant technical changes with respect to the previous edition:

- a) this document has been streamlined by cross-referencing IEC 60794-1-1, IEC 60794-4 (all parts) and IEC 60794-1-2;
- b) reference to the MICE table has been deleted;
- c) the example of test method for particular environment in Annex C has been deleted;

The text of this International Standard is based on the following documents:

FDIS	Report on voting
86A/1867/FDIS	86A/1876/RVD

Full information on the voting for the approval of this International Standard can be found in the report on voting indicated in the above table.

This document has been drafted in accordance with the ISO/IEC Directives, Part 2.

A list of all the parts in the IEC 60794 series, published under the general title *Optical fibre cables*, can be found on the IEC website.

The committee has decided that the contents of this document will remain unchanged until the stability date indicated on the IEC website under "<http://webstore.iec.ch>" in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.

OPTICAL FIBRE CABLES –

Part 4-20: Sectional specification – Aerial optical cables along electrical power lines – Family specification for ADSS (all dielectric self-supported) optical cables

1 Scope

This part of IEC 60794-4, which is a family specification, covers optical telecommunication cables, commonly with single-mode fibres¹ ~~to be~~ used primarily in overhead power lines applications. The cables ~~may~~ can also be used in other overhead utility networks, such as for telephony or TV services. Requirements of the sectional specification IEC 60794-4 for aerial optical cables along electrical power lines are applicable to cables covered by this document.

This document covers the construction, mechanical, electrical, and optical performance, installation guidelines, acceptance criteria, test requirements, environmental considerations, and accessories compatibility for an all dielectric, self-supporting fibre optic (ADSS) cable. This document provides construction and performance requirements that ensure, within the guidelines of this document, that the ~~required mechanical capabilities~~ integrity of the cable components ~~and maintenance of optical fibre integrity and optical transmissions are proper~~ as well as optical fibre mechanical reliability and transmission parameters are maintained.

The ADSS cable consists of single mode optical fibres contained in one or more protective dielectric fibre optic units surrounded by or attached to suitable dielectric strength members and sheaths. The cable does not contain metallic components. An ADSS cable is designed to meet the optical and mechanical requirements under different ~~types of~~ installation, operating and environmental conditions and loadings, as described in Annex B.

This document excludes any "lashed" or "wrapped" OPAC cables included in IEC 60794-4. Figure 8 aerial cables are also excluded; they are specified in IEC 60794-3-20.

~~Cables intended for installation in conformity with ISO/IEC 24702 and related standards may require the specification of additional tests to ensure their suitability in the applicable environments defined by the mechanical, ingress, climatic and chemical, and electromagnetic (MICE) classification. These tests are outside of the scope of IEC 60794 cable specifications, and MICE criteria are not part of the requirements for IEC 60794 specifications. The MICE tests may be the same as, similar to, or substantially different from, the tests required by IEC 60794 specifications. Cables manufactured per IEC 60794 specifications may or may not meet the MICE criteria. For supplemental discussion, see IEC/TR 62362.~~

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

~~IEC 60304, Standard colours for insulation for low-frequency cables and wires~~

~~IEC 60793-1-40, Optical fibres – Part 1-40: Measurement methods and test procedures – Attenuation~~

¹ In some particular situations in the electrical industry, short overhead links can be also designed with multimode fibres.

~~IEC 60793-1-44, Optical fibres – Part 1-44: Measurement methods and test procedures – Cut-off wavelength~~

~~IEC 60793-1-48, Optical fibres – Part 1-48: Measurement methods and test procedures – Polarization mode dispersion~~

IEC 60793-2, Optical fibres – Part 2: Product specifications – General

IEC 60793-2-50, Optical fibres – Part 2-50: Product specifications – Sectional specification for class B single-mode fibres

IEC 60794-1-1, Optical fibre cables – Part 1: Generic specification – General

~~IEC 60794-1-2, Optical fibre cables – Part 1-2: Generic specification – Basic optical cable test procedures^{2,3}~~

IEC 60794-1-21:2015, Optical fibre cables – Part 1-21: Generic specification – Basic optical cable test procedures – Mechanical test methods

IEC 60794-1-22, Optical fibre cables – Part 1-22: Generic specification – Basic optical cable test procedures – Environmental test methods

~~IEC 60794-1-23, Optical fibre cables – Part 1-23: Generic specification – Basic optical cable test procedures – Cable element test methods~~

IEC 60794-4, Optical fibre cables – Part 4: Sectional Specification – Aerial optical cables along electrical power lines

~~IEC 61395, Overhead electrical conductors – Creep test procedures for stranded conductors~~

ISO 9001, Quality management systems – Requirements

3 Terms, definitions and abbreviated terms

For the purposes of this document, the terms, definitions and abbreviated terms given in IEC 60794-1-1 and IEC 60794-4, ~~as well as the following~~, apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <http://www.electropedia.org/>
- ISO Online browsing platform: available at <http://www.iso.org/obp>

3.1

~~maximum allowable tension~~

~~MAT~~

~~maximum tensile load that may be applied to the cable without detriment to the performance requirements (optical performance, fibre durability) due to fibre strain~~

² ~~This document has been withdrawn, but can still be purchased, if necessary. Until IEC 60794-1-21 will be available, the tests stated in Clause 9 have to be taken from IEC 60794-1-2.~~

³ ~~This standard will be replaced by IEC 60794-1-21, Optical fibre cables – Part 1-21: Generic specification – Basic optical cable test procedures – Mechanical test methods (see also Bibliography), as soon as it will be available.~~

~~Note 1 to entry: Due to installation codes the MAT value is sometimes restricted to be less than 60 % of the breaking tension of the cable.~~

3.2

maximum operation tension

MOT

~~tensile load that can be applied to the cable either permanently or for a long term without producing any strain to the fibres~~

~~Note 1 to entry: This condition should correspond to the tension with no ice and no gale wind at average mean temperatures throughout the year, assumed to be between 16 °C and 20 °C.~~

3.3

zero strain margin

~~tensile load that the cable can sustain without strain on fibres due to cable elongation~~

3.4

breaking tension

~~tensile load that will produce physical rupture of the cable~~

~~Note 1 to entry: There is no optical consideration related to this parameter.~~

~~Note 2 to entry: The breaking tension should be calculated. The design model shall be validated; the cables do not need to be tested.~~

3.5

maximum installation tension

MIT

~~maximum load that should be applied during the installation procedure~~

~~Note 1 to entry: The maximum installation tension refers mainly to the final adjust of sag (also called sagging load), and the same tension limit can be used for the deployment of the cable (also called stringing load).~~

~~Note 2 to entry: This is a recommended value aimed at avoiding tension values higher than MAT during operational life due to wind, ice or temperature changes.~~

3.6

ADSS

~~all dielectric self-supported cable~~

~~dielectric cable that is capable of enduring aerial installation and providing long term service, without any external tensile support~~

3.7

OPAC

~~optical attached cable~~

~~dielectric, not self-supported, optical attached cable~~

~~Note 1 to entry: OPACs can be used with one of the following attachment methods:~~

- ~~• wrapped: known as an all dielectric (wrap): using special machinery, a lightweight flexible non-metallic cable is wrapped helically around either the earth wire or the phase conductor;~~
- ~~• lashed: non-metallic cables are installed longitudinally alongside the earth wire, the phase conductor or on a separate support cable (on a pole route) and are held in position with a binder or adhesive cord;~~
- ~~• spiral attached: similar to the lashed cables except that the method of attachment involves the use of special preformed spiral attachment clips.~~

~~Note 2 to entry: OPAC cable designs are not covered by this specification.~~

3.8 **~~cable fittings and dampers~~**

3.8.1 **~~suspension cable fitting~~**

~~device to hold up the cable in intermediate support points along an aerial line, where the cable is under tension at both sides of the fitting~~

3.8.2 **~~dead end cable fitting~~**

~~device designed to terminate an installation run, isolate a splice location or maintenance coil, provide slack span locations, or provide for extreme angle turns, where the cable is under tensional load on one side of the fitting and tension free on the other~~

3.8.2 **~~dampers~~**

~~device attached to a cable in order to suppress or minimize vibrations due to wind~~

4 Optical fibres

~~4.1 General~~

Single mode optical fibres shall be used that meet the requirements of IEC 60793-2-50. ~~In this clause only the main characteristics are mentioned.~~ Other types of fibre can be agreed upon between the customer and the supplier; such fibre shall conform to IEC 60793-2. The cabled fibre shall conform to IEC 60794-4.

~~Fibres other than those specified above can be used, if mutually agreed between the customer and supplier. In this case, fibre characteristics and attenuation criteria for mechanical tests shall be specified in the detail specification.~~

~~4.2 Attenuation~~

~~4.2.1 Attenuation coefficient~~

~~The requirements for the uncabled fibres shall be according to IEC 60793-2-50.~~

~~Unless other values are agreed between supplier and customer, the maximum attenuation coefficient of the cabled fibres shall be 0,35 dB/km when measured at 1 310 nm and/or 0,25 dB/km at 1 550 nm.~~

~~Different values from those stated above can be agreed between customer and supplier.~~

~~The attenuation coefficient shall be measured in accordance with IEC 60793-1-40.~~

~~4.2.2 Attenuation discontinuities~~

~~The local attenuation shall not have point discontinuities in excess of 0,10 dB.~~

~~The test method used to verify the functional requirements shall be in accordance with IEC 60793-1-40.~~

~~4.3 Cut-off wavelength of cabled fibre~~

~~The cabled fibre cut-off wavelength λ_{cc} shall be lower than the operational wavelength when measured in accordance with IEC 60793-1-44.~~

4.4 — Fibre colouring

~~The primary coated fibres shall be coloured for identification. The coloured coating shall be readily identifiable throughout the lifetime of the cable and shall be at a reasonable match to the requirements stated on IEC 60304. If required, the colouring shall permit sufficient light to be transmitted through the primary coating to allow local light injection and detection.~~

4.5 — Polarisation mode dispersion (PMD)

~~PMD shall meet the values indicated in IEC 60793-2-50. The measurement procedure shall be in accordance with IEC 60793-1-48.~~

5 Cable elements

Refer to the relevant parts of the sectional specification IEC 60794-4; ~~the following requirements apply specifically to ADSS cables.~~

~~The material(s) used for a cable element shall be selected to be compatible with the other elements in contact with it.~~

~~Optical elements (cable elements containing optical fibres) and each fibre within a cable element shall be uniquely identified, for example, by colours, by a positional scheme, by markings or as agreed between customer and manufacturer.~~

~~For loose tube construction, one or more primary coated fibres or optical elements are packaged, loosely in a tube construction, with a suitable water blocking system. The plastic tube may be reinforced with a composite wall.~~

~~If required by the customer, the suitability of the tube shall be determined by an evaluation of its kink resistance in accordance with IEC 60794-1-23, Method G7.~~

~~When used, optical fibre ribbons should comply with the requirements stated in IEC 60794-3.~~

6 Optical fibre cable constructions

6.1 General

The construction and characteristics of cable elements shall conform to IEC 60794-4. The cable shall not contain any metallic material.

6.2 — Optical unit

~~Optical unit elements as described in Clause 5 may be laid up as follows:~~

~~Single optical unit in the cable centre, which may contain one or more optical elements:~~

- ~~a) number of loose tubes using helical or SZ stranding configurations around a central element of reinforced plastic, epoxy glass, or other dielectric material. Ribbon elements may be laid up by stacking two or more elements inside the loose tubes;~~
- ~~b) configuration based on a channelled dielectric rod, containing units such as ribbons or plastic tubes, which may contain one or more optical elements.~~

6.2 Cable protection elements

In addition to the optical unit, the cable construction may consist of the following.

- a) The outer sheath shall be a weather-resistant type material. In certain conditions, it shall be necessary to consider the use of a tracking-resistant sheath.

- b) An ADSS cable shall contain self-supported systems that are integral to the cable. The purpose of the support system is to ensure that the cable meets the optical requirements under specified installation conditions, temperatures, and environmental loading for its whole operating design life. ~~This standard excludes any "lashed" or "wrapped" OPAC cables.~~
- c) The basic annular construction may have strength yarns (e.g. aramid yarns) or other dielectric strands or ~~a channelled~~ dielectric rods as a support structure. ~~In addition, other cable elements, such as central members, may be load bearing.~~ A single central dielectric shaft, channelled to accommodate the optical elements, is also accepted.
- ~~d) Fibre strain allowance.~~
- ~~ed)~~ The cable shall be designed such that fibre strain does not exceed the limit allowed by the cable manufacturer under design tension limits of the cable (MAT). Maximum allowable fibre strain under MAT condition ~~will generally be a function of the proof test level and strength and fatigue parameters of the optical fibre, 0,33 % is specified for fibre proof tested to 1 %~~ shall be $\leq 0,2 \%$ for 0,69 GPa proof-tested fibres.
- ~~f) A water blocking material shall be used to prevent water penetration to the optical units and to the cable core. The material shall be easily removed without the use of materials considered to be hazardous or dangerous. Water swell able blocking materials can also be used.~~

~~When used in the cable construction, the filling compound shall not flow at temperatures lower than the maximum specified operation temperature of cable.~~

~~NOTE In some countries, a special requirement of shotgun resistance can be specified for aerial cables. ADSS covered by this standard are not designed for this condition.~~

~~Cables with reinforced textile protection, could still meet the dielectric condition, but the increase in diameter and weight would require a significant enhancement of the tensile performance of the cable.~~

NOTE In some countries, a special requirement of shotgun resistance can be specified for aerial cables. ADSS cables covered by this document are not designed for such a condition. Cables with reinforced textile protection could still meet the dielectric condition, but the increase in diameter and weight would make necessary a significant enhancement of the tensile performance of the cable.

7 Main requirements for installation and operating conditions

Operating conditions are particularly important for ADSS cables.

Installation and operating conditions shall be agreed between the customer and the supplier. For the ADSS cable, a detailed study of the field conditions and ~~an important amount~~ a certain level of technical support by the supplier or third-party expert should precede the agreement. Annex B provides a general view of such considerations.

The type of fittings and hardware used to attach the ADSS to the structures shall be approved between the customer and the supplier. Their compatibility ~~has to be checked according to 9.11 and the supplier or the customer fittings' specification~~ shall be verified in accordance with 9.15 and the fittings product specification.

8 Cable design considerations

Table 1 is a summary of cable characteristics which may be of importance as specifications to both the customer and the supplier. Table 2 includes optional engineering parameters relevant for the design and installation of the overhead line with an ADSS cable. Other characteristics may be mutually agreed upon by both the customer and the supplier. A complete blank specification is shown in Annex D.

Table 1 – Cable design characteristics

Ref.	Characteristics	Units
4	Number and type of fibres	NA
-	Modularity of cable core (fibres per tube)	NA
6	Detailed description of cable design construction	NA
-	Overall cable diameter	mm
	Cable weight	kg/km
9.2	MAT (maximum allowable tension)	kN
9-10	Allowable temperature for storage, installation and operation	°C
9.3	Minimum bending diameter during installation	mm
9.4	Minimum bending radius diameter installed	mm

Table 2 – Optional parameters (if required by customer)

Ref.	Characteristics	Units
9.13	MIT, maximum installation (or sagging) load	kN
-	Modulus of elasticity	MPa
-	Coefficient of thermal expansion	10 ⁻⁶ /°C
9.2	Fibre strain at MAT load	%
Annex B	Zero strain margin	kN
9.9	Creep behaviour	mm
	Maximum Sag at MOT and MAT	m
	Environmental loading conditions – Reference to local or regional installation code	NA
	Recommended span and sag under MAT limit	m/%
C.3	Maximum ADSS cable space potential exposure (generally specified for a low-pollution environment unless specified otherwise by the customer)	kV

9 Cable tests

9.1 General

~~The parameters specified in this standard may be affected by measurement uncertainty arising either from measurement errors or calibration errors due to the lack of suitable standards. Acceptance criteria shall be interpreted with respect to this consideration. For some of the parameters specified in this standard, the objective is no change in attenuation.~~

~~These parameters may be affected by measurement uncertainty arising either from measurement errors or calibration errors due to a lack of suitable standards. Acceptance criteria shall be interpreted with respect to this consideration. The total uncertainty of measurement for this standard shall be ≤0,05 dB for attenuation or 0,05 dB/km for attenuation coefficient.~~

~~Any measured value within this range, either positive or negative, shall be considered as “no change in attenuation”. By agreement between customer and supplier, minor deviation from this limit may be accepted at some low frequency, e.g. less than 10 % of the fibres. However, for mechanical tests no deviation in excess of 0,15 dB shall be accepted.~~

In mechanical tests, the general optical criteria is no change in attenuation, as described in IEC 60794-1-1 and IEC 60794-4.

In some environmental and installation tests, some increase is accepted. These are the sheave test, the aeolian vibration test and the galloping test.

The number of fibres tested shall be representative of the cable design according to fibre sampling indicated IEC 60794-1-1. Different sampling can be agreed between the customer and the supplier.

The tests applicable for aerial cables are listed below. The minimum acceptance criteria for the different designs of cables shall be indicated in the product specification.

~~The specimens for the tests shall be taken from the supplier in advance to the tests.~~

9.2 — Classification of tests

9.2.1 — Type tests

~~Tests required to be carried out before supplying a cable covered by this standard on a general commercial basis in order to demonstrate satisfactory performance characteristics to meet the intended application. These tests shall be carried out on a cable length which meets the requirements of the relevant routine tests. These tests are of such a nature that, after they have been made, they need not to be repeated unless significant changes are made in the cable material, design or type of manufacturing process which might change the performance characteristics.~~

~~A full type verification of a cable design includes all tests and characteristics specified in this standard. Tests to be repeated shall be agreed between the customer and the supplier.~~

9.2.2 — Factory acceptance tests

~~Tests made on samples of completed cable, or components taken from a completed cable to verify that the finished product meets the design specifications. Scope and incidence of sample tests, if required, shall be agreed between the customer and the supplier.~~

~~Failure of a test specimen to comply with any one of the requirements of this standard shall constitute grounds for rejection of the lot represented by the specimen. If any lot is so rejected, the supplier shall have the right to test, only once, all individual drums of cables in the lot and submit those which meet the requirements for acceptance.~~

9.2.3 — Routine tests

~~Tests made on all production cable lengths to demonstrate their integrity.~~

~~Failure of a test specimen to comply with any one of the requirements of this standard shall constitute grounds for rejection of the lot represented by the specimen. If any lot is so rejected, the supplier shall have the right to test, only once, all individual drums of cables in the lot and submit those which meet the requirements for acceptance.~~

9.2 Tensile performance

9.2.1 General

~~The tensile performance of the cable is verified with the test methods in 9.2.1 and 9.2.2. The cable manufacturer shall specify the MOT and the MAT for the ADSS design. Both tests shall be evaluated on the same cable sample, subjecting in a first step, the sample to the MOT test, releasing the load to zero tension and then applying the MAT test.~~

~~9.3.2 Maximum allowed tension (MAT)~~

~~The cable shall be terminated with suitable dead end fittings adequate to the type of cable and tested following Methods E1A and E1B, indicated in IEC 60794-1-2.~~

~~A minimum length of 50 m of cable shall be loaded until the specified MAT is applied and sustain this load level for 1 h. Under this load, the strain in the fibre should not be higher than 0,33 % for fibres proof tested at 1 % strain. The attenuation increase shall not exceed 0,15 dB at 1 550 nm.~~

The cable should be tested in accordance with IEC 60794-1-21, method E1. Under this test, the cables shall meet the specified MAT value.

9.2.2 Family requirement

Loaded with MAT, no change in attenuation at 1 550 nm shall be measured, and the strain in the fibre shall be ≤ 0.2 % for 0,69 GPa proof-tested fibres. Other values can be agreed between the customer and the supplier.

NOTE Strain limit values for fibres with different proof test values are under study.

9.2.3 Test conditions

- Test set in a straight path in accordance with Figure 1 of IEC 60794-1-21:2015 (no drums or pulleys allowed).
- The cable shall be terminated with adequate dead-end fittings.
- Sample length of 25 m minimum.
- MAT is sustained for 1 h.
- The fibres shall be loop-back spliced so that a minimum of 100 m of fibre are under test.

9.4 Installation capability

~~9.4.1 General~~

~~Compatibility of ADSS design and hardware with common installation conditions and practices shall be demonstrated by evaluation of the following tests.~~

9.3 Sheave test

9.3.1 General

~~The test shall be performed to verify that the installation of the cables will not damage or degrade their performance. The cable shall be tested in accordance with Method E18, procedure 3 or 4 of IEC 60794-1-2.~~

~~The sheave test shall be performed on a sample cable of a minimum length of 9 m. Dead end fittings shall be clamped a minimum of 3 m apart. The optical fibres shall be connected to each other by means of fusion or equally reliable splices. The test length of optical fibre shall be a minimum of 100 m long.~~

~~The cable shall be pulled at one dead end at the maximum stringing tension (MIT) specified by the ADSS cable manufacturer. The method of attachment, although not rigid, shall limit the amount of twist that could occur at the lead end. A dynamometer and a swivel shall be installed between the yoke and the other dead end.~~

~~A 2 m minimum length of the ADSS test sample shall be pulled 40 times forward and backward through the sheave (20 times in each direction).~~

~~The diameter of the sheave for the angle of pull shall be no smaller than the manufacturer's minimum bend diameter for the ADSS cable under test. A minimum diameter of 40 × the outside diameter of the cable is recommended. Before the first pull, the beginning, midpoint, and end of the length shall be marked. After the test is completed, the attenuation shall be measured and the ADSS cable shall be removed in the tested section, and the cable shall be visually examined for any damage. The ADSS cable may be dissected to observe for any signs of damage to the inner structure.~~

The cable shall be tested in accordance with method E18B of IEC 60794-1-21.

9.3.2 Family requirement

Maximum permanent increase in attenuation: 0,10 dB at 1 550 nm.

No physical damage in cable elements.

9.3.3 Test conditions

~~● Procedure 3 or 4 of E18 of IEC 60794-1-2.~~

- Method E18B of IEC 60794-1-21, procedure 1 or 2.
- Tension level applied during test: maximum stringing load (or MIT).
- Length of the cable: 9 m minimum. Length bent under tension: 2 m.
- The cable should be terminated with the recommended dead-end fittings.
- The fibres shall be loop-back spliced so that a minimum of 100 m of fibre are under test.
- Diameter (D) of roller/cylinders $\leq \geq$ manufacturer's minimum bend diameter (approximately $\leq \geq 40$ times cable outside diameter is recommended).
- Bending angle: $45^\circ \pm 15^\circ$.
- Moving speed: $1 \text{ m/s} \leq \text{speed} \leq 10 \text{ m/s}$.
- Number of complete moving cycles: 20.

9.4 Repeated bending

9.4.1 General

The cable shall be tested in accordance with the method specified in IEC 60794-1-21, Method E6.

9.4.2 Family requirements

Under visual examination without magnification, there shall be no damage to the sheath or cable elements. There shall be no change in attenuation ~~increase greater to 0,05 dB~~ at 1 550 nm after the completion of the test.

9.4.3 Test conditions

- Bending radius: 20 d.
- Number of cycles: 25.
- ~~● Load: Adequate to assure uniform contact with the mandrel~~
- ~~● Duration of cycle: Approximately 2 s~~

Particular conditions may be agreed between ~~manufacturer~~ the customer and the supplier.

9.5 Impact

9.5.1 General

The cable construction shall be tested in accordance with the method specified in IEC 60794-1-21, method E4, ~~without physical damage on the cable elements or attenuation increase greater to 0,05 dB after the completion of the test.~~

9.5.2 Family requirements

Under visual examination without magnification, there shall be no damage to the sheath or to the cable elements. The imprint of the striking surface on the sheath is not considered mechanical damage.

~~The increase in attenuation shall be $\leq 0,05$ dB at 1 550 nm.~~

There shall be no change in attenuation at 1 550 nm.

9.5.3 Test conditions

- Striking surface radius: ~~10 mm or~~ 300 mm.
- Impact energy: 10 J ~~with striking surface radius of 300 mm or 3J with surface radius of 10 mm.~~
- Number of impacts: three, each in a different place spaced not less than 500 mm apart.

NOTE these values are for general purpose use. Particular requirement could be included in product specification.

9.6 Crush

9.6.1 General

The cable shall be tested in accordance with IEC 60794-1-21, method E3, without physical damage or change in attenuation ~~increase greater than 0,05 dB.~~

9.6.2 Test requirements

Under visual examination, there shall be no damage to the sheath or to the cable elements. The imprint of the plate or mandrel on the sheath is not considered mechanical damage.

• Family requirements

Long term ≥ 10 min. ~~Attenuation increase $\leq 0,05$ dB;~~ No change in attenuation (prior to release of load)

Short term ≥ 1 min. ~~Attenuation increase $\leq 0,05$ dB;~~ No change in attenuation (after test)

9.6.3 Test conditions

- Load (plate/plate): 2,2 kN for short-term load, 1,1 kN for long-term load.
- Duration of load: 1 min of short-term load, followed by 10 min of long-term load.
- Number of tests: 3.
- Spacing between test places: 500 mm.

NOTE These values are for general purpose use. Particular requirements can be included in a product specification.

~~9.4.6 Kink~~

~~The cable shall be tested in accordance with the method specified in IEC 60794-1-2, Method E10, without physical damage on the cable elements.~~

~~The minimum diameter shall be agreed between the customer and the supplier.~~

9.7 Torsion

9.7.1 General

The cable shall be tested in accordance with IEC 60794-1-21, method E7.

~~• Family requirements~~

~~The variation on attenuation after the test shall be no greater than 0,05 dB at 1 550 nm.~~

~~• Test conditions~~

~~— Length under test: 2 m~~

~~— Number of turns: One half turn (through 180°) over the length of 2 m in each direction~~

~~— Number of cycles: 10~~

9.7.2 Test requirements

Under visual examination without magnification, there shall be no damage to the sheath or to the cable elements.

No change on attenuation after the test at 1 550 nm.

~~9.5 Vibration testing~~

9.8 Aeolian vibration test

9.8.1 General

The resistance of the cable to aeolian vibration shall be tested in accordance with method E19 of IEC 60794-1-21.

9.8.2 Family requirements

Under visual examination without magnification, there shall be no damage to the sheath or to the cable elements. The variation on attenuation after the test shall be no greater than 0,10 dB at 1 550 nm.

9.8.3 Test conditions

~~— Number of cycles: 100 000 000~~

~~— Frequency of vibration: 60 Hz $\pm$ 10 Hz, or the calculated values for specific operation conditions, requested by the customer~~

~~— Tension applied: 40 % of MAT~~

The cable should be terminated with the recommended dead-end and suspension fittings.

9.8.4 Parameters to be reported

- Length of spans.
- Length of cable and fibres tested.
- Vibration mode/characteristics maintained during the test.
- Characteristics of measuring equipment.
- Ambient temperature and humidity during the test.
- Mass/unit length and diameter of the cable.

9.9 Low frequency vibration test (galloping test)

9.9.1 General

The resistance of the cable to low frequency vibration ~~will~~ shall be tested in accordance with IEC 60794-1-21, method E26 ~~as soon as this test method will be available~~⁴. This test applies for ADSS cables to be installed in areas where ice build-up and/or strong winds are envisaged.

9.9.2 Family requirements

~~The attenuation at 1 550 nm shall be less than or equal to 1,0 dB/km~~

Permanent or temporary increase in attenuation at 1 550 nm shall be $\leq 0,10$ dB.

The sheath shall have no cracks or splits.

9.9.3 Test conditions

- ~~— Number of cycles: 100 000~~
- ~~— Peak to peak antinode amplitude/loop length ratio: 1/25~~
- ~~— Tension: The cable should be tensioned to a level that permits induced galloping in the defined amplitude; 5 % to 10 % of MAT is an adequate tension level.~~
- ~~— The overall span between dead end assemblies should be a minimum of 35 m. The end abutments are used to load and maintain tension in the fibre optic cable. The test section is contained between the two intermediate abutments. End and intermediate abutments need not be separate units if the combined unit affords sufficient space for the apparatus specified below. The fibre optic cable to be tested should be a sufficient length beyond the intermediate abutments to allow removal of the cable outer coverings and to allow access to the optical fibres. The test sample shall be terminated at both ends prior to tensioning in such a way that the optical fibres cannot move relative to the cable. A dynamometer, load cell, calibrated beam, or other device should be used to measure cable tension. Some means should be provided to maintain constant tension to allow for temperature fluctuations during the testing. However, some tension fluctuations are expected from the galloping activity itself.~~
- ~~— A suitable suspension assembly shall be located approximately midway between the two dead end assemblies. It shall be supported at a height such that the static sag angle of the cable to horizontal does not exceed 1°.~~
- ~~— Means shall be provided for measuring and monitoring the mid-loop (antinode), single loop galloping amplitude. A suitable shaker shall be used to excite the cable in the vertical plane. The shaker armature shall be securely fastened to the cable in the vertical plane.~~
- ~~— The test length (i.e., between dead end assemblies) of the optical fibre shall be a minimum of 100 m. To achieve this length several fibres may be spliced together. At least one fibre shall be tested from each buffer tube or fibre bundle. Splices should be made so the optical equipment can be located at the same end. Optical measurements shall be made using a light source with a nominal wavelength of 1 550 nm for single-mode fibres and a nominal wavelength of 1 300 nm for multimode fibres. The source shall be split into two signals. One signal shall be connected to an optical power meter and shall act as a reference. The other signal shall be connected to a free end of the test fibre. The returning signal shall be connected to a second optical power meter. All optical connections and splices shall remain intact through the entire test duration.~~
- ~~— An initial optical measurement shall be taken when the span is pre-tensioned to approximately 5 % of maximum installation tension prior to final tensioning to maximum installation tension. The difference between the two signals for the initial measurement provides a reference level. The change in this difference during the test~~

⁴ ~~Test method E26 is planned to be specified in IEC 60794-1-21 (under consideration).~~

~~shall indicate the change in attenuation of the test fibre. The signals may be output on a strip chart recorder for a continuous hardcopy record.~~

- ~~— The cable shall be subjected to a minimum of 100 000 galloping cycles. The test frequency shall be the single loop resonant frequency. The minimum peak-to-peak antinode amplitude/loop length ratio shall be maintained at a value of 1/25, as measured in the active span.~~
- ~~— Mechanical and optical data shall be read and recorded approximately every 2 000 cycles.~~
- ~~— The optical power meters shall be continuously monitored beginning at least 1 h before the test and ending at least 2 h after the test.~~

The final optical measurement shall be taken at least 2 h after the completion of the vibration test. A section of cable from the location of the hardware support shall be loaded to the ~~MOT~~ MAT, and the attenuation shall comply with ~~4.2.1~~ 9.2.1.

9.10 Temperature cycling

9.10.1 General

The cable shall be tested in accordance with the method specified in IEC 60794-1-22, method F1, one-cycle procedure with the temperature limits, in accordance with operation limits in the product specification, or combined test procedure if different storage limits are specified.

9.10.2 Family requirements

For T_A and T_B (T_{A1} and T_{B1} in combined test), there shall be no change in attenuation (~~$\leq 0,05$ dB/km~~) from the reference room temperature measurement when measured in the 1 550 nm region or at the operational wavelength when specified by the user. T_{A1} and T_{B1} temperature levels are only required during the last cycle.

For T_{A2} and T_{B2} , the change in attenuation coefficient shall be $\leq 0,15$ dB/km during the last cycle from the reference room temperature measurement.

On completion of the test, there shall be no change in attenuation (~~$\leq 0,05$ dB/km~~). The measurement shall be made in the 1 550 nm region.

9.10.3 Test conditions

- Sample length: finished cable length of at least 500 m.
- High temperature, T_B for one-cycle procedure (T_{B1} for combined test): +60 °C.
- High temperature, T_{B2} : +70 °C (only for combined test).
- Low temperature, T_A for one-cycle procedure (T_{A1} for combined test): -20 °C.
- Low temperature, T_{A2} : -40 °C (only for combined test).
- Rate of heating: sufficiently slow so that the effect of changing the temperature does not cause temperature shock or 40 °C/h if not specified.
- t_1 : enough time to get temperature stability in the sample.
- Number of cycles: 2. Additional cycles may be required depending on user requirements.
- Temperature values may vary depending on user requirements.

9.11 Water penetration

The cable shall be tested in accordance with IEC 60794-1-22, method F5B for jelly filled cables or F5C for all-dry cables.

No water shall be detected at the unsealed end of the sample during and at the end of the test.

9.12 ~~Weathering-resistance~~ Cable UV resistance

The outer sheath shall be made of UV-stabilized weather-resistant material in accordance with IEC 60794-1-22, method F14. ~~In certain conditions it shall be necessary to consider the use of a tracking-resistant sheath.~~

Further requirements are under consideration.

9.13 Tracking and erosion resistance test

Dielectric cables installed on power lines are exposed to electrical fields. The magnitude of this field space potential **exposure** depends on the line voltage, tower design, conductor configuration, and installation location for the ADSS. Together with specific environmental conditions, especially desert or highly polluted areas close to the sea, this can lead to electrical degradation (e.g. dry-band arcing), which can cause severe damage to the outer cable sheath and finally can cause a total cable failure. The sensitivity to electrical degradation depends on a combination of the space potential, the cable, environment, and sheath material used. In areas with higher space potentials or poor environmental conditions, track resistant sheath materials may be essential to alleviate the risk to product life.

Experience has shown that the formerly used > 12 kV space potential transition point for using track resistant sheath materials may be too high depending on the environmental conditions. Under certain environmental conditions as mentioned above, tracking-resistant sheaths may be needed with space potentials down to 4 kV. Even with tracking-resistant sheath materials, special consideration about the feasibility of ADSS applications is required for levels higher than 20 kV.

Tracking-resistant sheath materials shall be used in the following field conditions:

- a) power lines with an operation voltage of 150 kV or higher;
- b) power lines producing space potential of 4 kV or higher in salty or polluted areas.

If the ADSS cable is **to be** used in telecommunication poles or low-voltage distribution lines, track-resistant requirements can be waived.

~~Three~~ **Two** current options for evaluating the quality of track-resistant sheath materials are given in Annex C ~~as follows~~:

- 1) salt fog method: evaluates cable in a wet condition (continuous salt water spray);
- ~~2) alternating wet drying cycles in either normal or desert conditions.~~
- 32)** alternating wet dry cycles with different current levels to reflect different degrees of resistivity resulting from varying degrees of regional environmental conditions.

Other test conditions may be needed to evaluate ADSS tracking resistance for specific environments.

9.14 Creep ~~behaviour~~

~~Creep behaviour is engineering information, not a specification. The cable is tested in accordance with IEC 61395, and the applied load should be MOT, the maximal operational tension.~~

There is no pass/fail criterion for creep. This parameter is an engineering guidance to the behaviour of the cable during its working life. The cable creep behaviour should be determined using a test method agreed between the customer and the supplier. Suitable tests are IEC 60794-1-21, method E32 or found in IEC 61395.

9.15 Fitting compatibility

The type of fittings shall be approved between the customer and the supplier, and their compatibility ~~has to~~ shall be verified as follows.

- Dead-end fittings shall be used during the MAT test (9.2), with a maximum of 3 mm of displacement between the fitting and the cable during and after the test. ~~(Under consideration.)~~ There should be no change in attenuation.
- A cable sample with dead-end fittings shall stand 24 h at a temperature of $60\text{ °C} \pm 2\text{ °C}$ and controlled RH of $85\% \pm 5\%$, under ~~MAT~~ MIT load, with a maximum displacement of 3 mm between each fitting and cable. ~~(Under consideration.)~~ There should be no change in attenuation.
- Suspension fitting shall be used during vibration tests (9.8 and 9.9) with no damage to the cable during the test. There should be no change in attenuation. Vibration dampers can also be qualified during this test.
- Following the completed testing, the hardware fittings shall be removed and the cable's outer sheath inspected. There shall be no splits or tears in the ~~other~~ outer sheath.

Sample for verification of the temperature and humidity condition shall be long enough to accept a dead-end fixture and a connection length at both ends; at least 10 m is recommended. The complete setup should be exposed at the indicated temperature and humidity

NOTE The use of vibration dampers is not compulsory but is an installation option.

~~10 Factory acceptance tests~~

~~Sample tests and factory acceptance tests shall be carried out according to the quality plan of the supplier and, if required, in the presence of the customer or their representative.~~

~~Additional tests may be agreed between customer and supplier. The test methods and requirements are given in this standard.~~

~~Typical tests:~~

- ~~— Visual inspection of the cable elements~~
- ~~— Diameter of cable~~
- ~~— Weight of cable~~
- ~~— Optical fibre attenuation coefficient at 1 550 nm or other agreed operational wavelength~~
- ~~— Maximal allowed tension MAT — during product qualification or requalification, or as directed by customers for type test approval~~
- ~~— Maximal operational tension MOT — during product qualification or requalification, or as directed by customers for type test approval.~~

~~11 Routine tests~~

~~Routine tests shall be carried out on all manufactured cables and in accordance with the quality plan of the supplier.~~

~~Additional tests may be agreed between customer and supplier. The test methods and requirements are given by this standard.~~

~~Typical tests are the following:~~

- ~~— inspection of incoming raw materials according to the manufacturer's quality plan;~~
- ~~— optical fibre attenuation coefficient at operational wavelength;~~
- ~~— quality of cable surface;~~
- ~~— diameter of cable.~~

10 Quality assurance

It is the responsibility of the manufacturer to establish quality assurance by quality control procedures which ensure that the product meets the requirements of this document. When the purchaser wishes to specify acceptance tests to other quality procedures, it is essential that an agreement is reached between the customer and the supplier at the time of ordering.

The supplier shall establish, introduce and maintain a quality management system in accordance with ISO 9001 or equivalent.

Annex A provides recommendations for packaging and marking.

Annex A (informative)

Packaging and marking

The cable should be tightly and uniformly wound onto reel(s) in layers. Reel lengths may be either standard length or specified length. Standard lengths are reel lengths normally provided by a supplier. This length will be defined by the supplier. Specified lengths are reel lengths that are specified by the customer. A tolerance of $\pm 2,0$ % should be maintained for specified lengths and standard lengths.

Reels ~~should~~ **may** be either wooden non-returnable or steel returnable type. Unless specified otherwise by the customer, the supplier will determine the size and type reel that will withstand normal shipping, handling, storage and stringing operations without damage to the cable.

The reel and inside flanges ~~should~~ **shall** be manufactured in a manner that damage will not occur to the cable during shipping, handling, storage and stringing.

The cable should be adequately protected against mechanical damage and solar heating.

Reel numbers should be identified in a clear and legible manner on the outside of each flange on two opposite locations.

Each reel should be tagged with a shipping tag. Tags should be weather-resistant. All essential information, such as the supplier's name, cable size and number of fibres, order number, reel number, cable number, cable lengths, and gross, tare, and net weight should appear legibly on the tags. The tags should clearly indicate ~~the type of~~ cable in the description.

The cable ends should be securely fastened to prevent the cable from becoming loose during shipment. The inner end of the cable ~~should~~ **shall** be accessible for connection to optical measuring equipment. This length of cable ~~should~~ **shall** be securely fastened and protected during shipment.

A seal should be applied to each end of the cable to prevent the entrance of moisture into the optical fibres or the escape of filling compound during shipment and storage.

Each reel should be marked on the outside flange to indicate the direction the reel should be rolled during shipment in order to prevent loosening of the cable on the reel.

Annex B (informative)

Installation considerations for ADSS cables

In most cases, for underground application cables, the maximum mechanical stress (due to tension, torsion, compression, etc.) occurs during the installation process. During the rest of its operative life, the cable, if properly installed, will suffer stress eventually or just a residual permanent value.

On the contrary, aerial cables will be during the working life permanently under the installation tension and can be periodically subjected to higher tensions due to variable environmental conditions.

In aerial applications, in order to guarantee a long working life for the cable, it is not enough only to perform a careful installation procedure and test the fibres at the end of the job. It is necessary to know the environmental conditions and weather cycles in the location and from that information select or design the cable.

The combination of all these parameters in a field condition define the tensile strength required in the cable, and a detailed engineering study is carried out that takes into consideration several parameters affecting the required strength of the cable, span, sag, temperature, wind speed, ice formation, which are all considered for the design of an aerial power line. Some additional considerations have to be made to ensure the selected cable is adequate.

- 1) In conductor cables, the mechanical strength is proportional to cable size, which is part of the electrical design of the line. Therefore, the physical design of the link necessarily takes into account the cable mechanical resistance. As the ADSS has no electrical function and it is frequently installed in existing power lines, its mechanical analysis is independent and the lack of information could lead to an over-design or under-design of the cable.
- 2) The reference parameter in metallic cables is the breaking load. Under critical conditions, the cable can be under short-term stress close to that limit without intrinsic damage. In a similar situation for an ADSS, the fibres could be broken. Since it is not the integrity of the cable but fibres the first concern in a telecommunication link, breaking strength is not the selected parameter to specify an ADSS cable. In order to protect fibre integrity, the reference should be the ~~maximal allowed load~~ maximum allowed tension (MAT).
- 3) Breaking load is not a parameter in the optical/mechanical performance of an ADSS cable. In some countries, the breaking strength of aerial cables is a regulation as an installation requirement.
- 4) The MAT is the key specification values for cable performance; it ~~shall~~ should be matched with the critical stress situations (wind, heavy ice, temperature) that, although not frequent, are expected to be present in the area.
- 5) The elasticity module and the coefficient of linear expansion ~~and creep behaviour~~ are engineering data. These values should be provided by the manufacturer to be used for tension/sag calculations, if requested by customer, or sag/tension tables should be provided.
- 6) Maximum installation tension (MIT) is a recommended value to be considered in the sagging process in order to avoid exceeding MAT when the expected wind and/or ice arise. It can also serve as limit load while stringing the cable along the power line. To prevent permanent strain in the fibres, it is advisable that MIT is lower to the zero strain margin value.
- 7) Maximum span distance, minimum or maximum sag can be recommended for particular installation cases only after the detailed engineering study (see Figure B.1).

- 8) The placement of the ADSS cable relative to the power conductor and its associated voltage affects the space potential the ADSS cable is exposed to. Compatibility with this space potential ~~shall~~ should be considered.
- 9) When transmission lines are being deployed, it is important that the customer provide details on the ADSS cable and power line conductor configuration along with applicable pollution considerations so the ADSS cables' space potential exposure can be determined.

For information on necessary installation procedures and safety issues for personnel and equipment when installing or maintaining ADSS cables on overhead power lines, see IEC TR 62263.

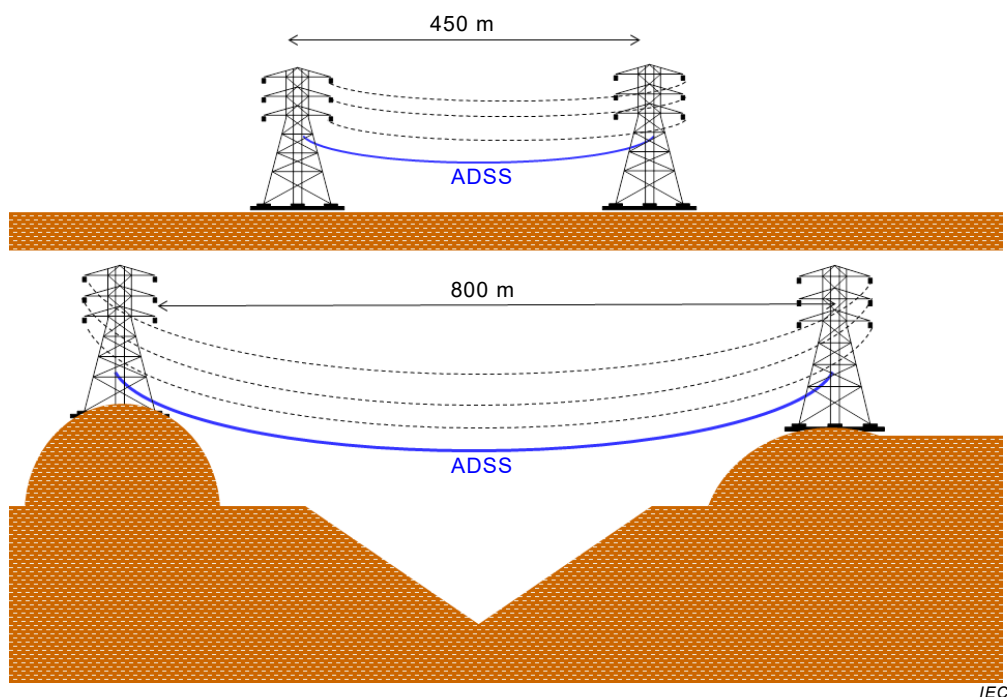


Figure B.1 – Example of different span lengths allowed for the same cable, depending on sag variation

Annex C (informative)

Electrical test (tracking)

C.1 General

~~If the cable sheath is affected by electrical erosion due to various conditions,~~ Electrical erosion arises if cable sheath is affected by several conditions. There is no universal test method for its evaluation. ~~However, 3 possibilities (options)~~ Two options are described in Annex C.

Option ~~C1~~ C2 is a well-established way to control a sheath material referred to a specification. It is very useful to the industry for material qualification, although it has no correlation to cable behaviour in the field. The test method of option C3 establishes a means of testing cable to different pollution levels at different space potentials, based on the pollution model described in C.3.4.

~~Option C2 is an example of test method for particular environment.~~

~~Option C3 correlates the result of the test to different pollution conditions.~~

C.2 Option ~~C1~~ C2 – Sheath material qualification

C.2.1 Overview

The objective of this test is to demonstrate the resistance of the cable sheath to erosion and tracking under combined electrical and mechanical stresses, while exposed to humid (salt fog) conditions.

C.2.2 Test arrangements

A length of cable ~~shall~~ should be taken from a production run and sealed at each end against moisture ingress before being supported horizontally inside a salt fog chamber between two anchor points. This will enable it to be tensioned mechanically to a level that represents the value of operation conditions for the cable. The earth termination shall be identical to that proposed by the supplier for use in service adjacent to a support tower and may consist, for example, of spiral-wrap gripping wires together with any suitable mechanical or electrical stress-relieving accessories. This design of the high-voltage termination shall be at the discretion of the supplier.

The gauge length between terminations ~~shall~~ should be great enough to avoid flashovers from taking place during the salt fog test, and a length of 25 mm/kV is usually adequate. The separation between electrode terminations should be 40 mm ~~at least~~ as minimum. The cable should be tensioned with such means so that any creep of the cable material during the test does not result in a major reduction in tension. At suitable intervals during the test, for example every 100 h, the tension should be checked, and if it has changed ~~by~~ more than 10 % of the initial value, it should be adjusted to fall within range again.

A conduction fog shall be produced within the chamber by the use of a suitable number of atomizing nozzles similar to the design shown in Figure 18 of IEC 60060-1:2010 ~~Bi 11~~. A useful guide is to have one nozzle for each 2 m³ of chamber volume. The salt solution to the nozzle shall be prepared dissolving 10,0 kg ± 0,5 kg NaCl in 1 000 l of distilled and de-ionized water. The droplet size should be in the range of 5 µm to 20 µm, and the flow rate of this solution in the chamber should be 0,4 l/h ± 0,1 l/h for each cubic metre of chamber volume. This generally requires an injection of dry air at a pressure of 3,3 bar to the nozzles. The nozzles shall be distributed evenly around the chamber to give a homogeneous fog density,