© IEC 2020

INTERNATIONAL ELECTROTECHNICAL COMMISSION

COMMISSION ÉLECTROTECHNIQUE INTERNATIONALE

_____

IEC 61000-4-11
Edition 3.0 2020-01

ELECTROMAGNETIC COMPATIBILITY (EMC) –

Part 4-11: Testing and measurement techniques – Voltage dips, short interruptions and voltage variations immunity tests for equipment with input current up to 16 A per phase

IEC 61000-4-11
Édition 3.0 2020-01

COMPATIBILITE ELECTROMAGNETIQUE (CEM) –

Partie 4-11: Techniques d'essai et de mesure – Essais d'immunité aux creux de tension, coupures brèves et variations de tension pour les appareils à courant d'entrée inférieur ou égal à 16 A par phase

CORRIGENDUM 1

Corrections to the French version appear after the English text.

Les corrections à la version française sont données après le texte anglais.

5.3 Voltage variations

Replace the heading with the following new heading:

5.3 Voltage variations (optional)

Figure 2 – Short interruption

Replace Figure 2 with the following new figure:

IEC 61000-4-11:2020-01/COR1:2020-05(en-fr)

Documents
Document Sharing Hub

Full document details: IEC 61000-4-11-2020 cor1-2020

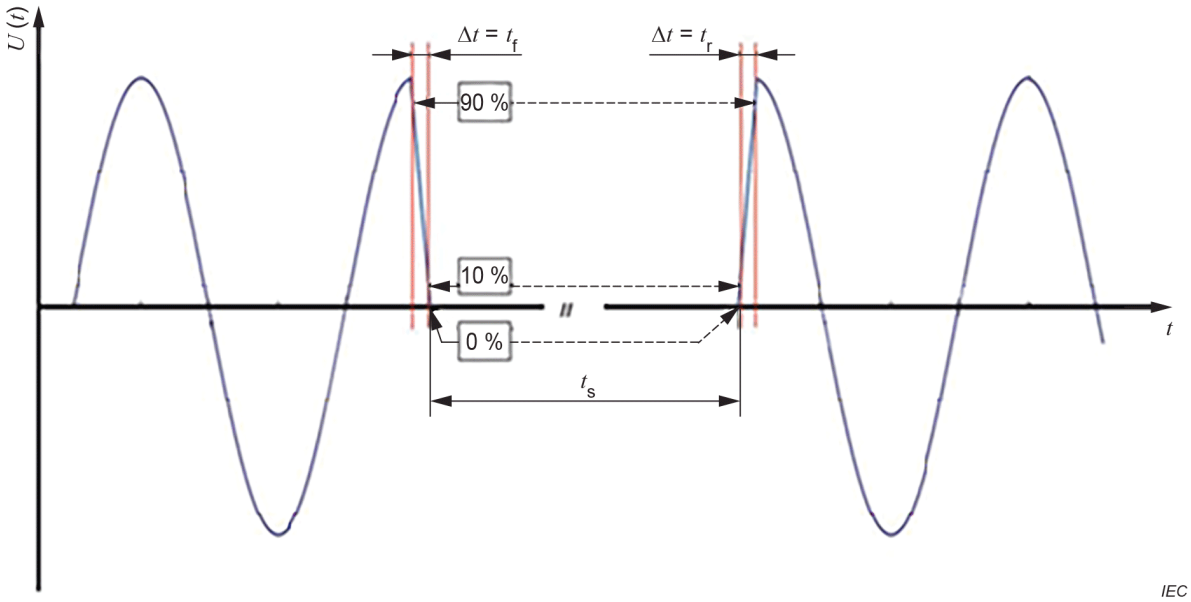

Table 4 – Generator specifications

Replace the text of the sixth row with the following new text:

Voltage rise (and fall) time t_r (and t_f), see Figure 1b), Figure 2 and Figure 3, during abrupt change, generator loaded with 100 Ω resistive load	Between 1 µs and 5 µs

8.3.2 Voltage dips and short interruptions

Replace, in the sixth paragraph,

"See Figure 5b)."

with:

"See Figure 5."

Documents
Document Sharing Hub
Full document details: IEC 61000-4-11-2020 cor1-2020