

INTERNATIONAL STANDARD



**Terrestrial photovoltaic (PV) modules – Design qualification and type approval –
Part 1-4: Special requirements for testing of thin-film $\text{Cu}(\text{In,Ga})(\text{S,Se})_2$ based
photovoltaic (PV) modules**



THIS PUBLICATION IS COPYRIGHT PROTECTED

Copyright © 2021 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

IEC Central Office
3, rue de Varembe
CH-1211 Geneva 20
Switzerland

Tel.: +41 22 919 02 11
info@iec.ch
www.iec.ch

About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigendum or an amendment might have been published.

IEC publications search - webstore.iec.ch/advsearchform

The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee, ...). It also gives information on projects, replaced and withdrawn publications.

IEC Just Published - webstore.iec.ch/justpublished

Stay up to date on all new IEC publications. Just Published details all new publications released. Available online and once a month by email.

IEC Customer Service Centre - webstore.iec.ch/csc

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: sales@iec.ch.

IEC online collection - oc.iec.ch

Discover our powerful search engine and read freely all the publications previews. With a subscription you will always have access to up to date content tailored to your needs.

Electropedia - www.electropedia.org

The world's leading online dictionary on electrotechnology, containing more than 22 000 terminological entries in English and French, with equivalent terms in 18 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.



IEC 61215-1-4

Edition 2.0 2021-02
REDLINE VERSION

INTERNATIONAL STANDARD



**Terrestrial photovoltaic (PV) modules – Design qualification and type approval –
Part 1-4: Special requirements for testing of thin-film Cu(In,Ga)(S,Se)_2 based
photovoltaic (PV) modules**

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

ICS 27.160

ISBN 978-2-8322-9489-5

Warning! Make sure that you obtained this publication from an authorized distributor.

CONTENTS

FOREWORD	4
1 Scope and object	6
2 Normative references	7
3 Terms and definitions	7
4 Test samples	7
5 Marking and documentation	7
6 Testing	7
7 Pass criteria	7
8 Major visual defects	7
9 Report	7
10 Modifications	7
11 Test flow and procedures	8
11.1 Visual inspection (MQT 01)	8
11.2 Maximum power determination (MQT 02)	8
11.3 Insulation test (MQT 03)	8
11.4 Measurement of temperature coefficients (MQT 04)	8
11.5 Measurement of nominal module operating temperature (NMOT) (MQT 05) Placeholder section, formerly NMOT	8
11.6 Performance at STC (MQT 06.1) and NMOT (MQT 06.2)	8
11.7 Performance at low irradiance (MQT 07)	8
11.8 Outdoor exposure test (MQT 08)	8
11.9 Hot-spot endurance test (MQT 09)	8
11.9.1 Purpose	8
11.9.2 Hot-spot effect	8
11.9.3 Classification of cell interconnection	9
11.9.4 Apparatus	9
11.9.5 Procedure	9
11.9.6 Final measurements	9
11.9.7 Requirements	9
11.10 UV preconditioning test (MQT 10)	9
11.11 Thermal cycling test (MQT 11)	9
11.12 Humidity-freeze test (MQT 12)	9
11.13 Damp heat test (MQT 13)	11
11.13.1 Procedure	11
11.14 Robustness of terminations test (MQT 14)	12
11.15 Wet leakage current test (MQT 15)	12
11.16 Static mechanical load test (MQT 16)	12
11.17 Hail test (MQT 17)	12
11.18 Bypass diode testing (MQT 18)	12
11.19 Stabilization (MQT 19)	12
11.19.1 Criterion definition for stabilization	12
11.19.2 Light induced stabilization procedures	12
11.19.3 Other stabilization procedures	12
11.19.4 Initial stabilization (MQT 19.1)	12
11.19.5 Final stabilization (MQT 19.2)	12

11.20	Cyclic (dynamic) mechanical load test (MQT 20).....	13
11.21	Potential induced degradation test (MQT 21)	13
11.22	Bending test (MQT 22).....	14
Figure 1	– Current flow using MQT 11 Method B.....	10
Figure 2	– Current flow using MQT 12 Method B.....	11
Figure 3	– Electrical connections for MQT 21 Method B, positive system voltage.....	14
Figure 4	– Electrical connections for MQT 21 Method B, negative system voltage.....	14

INTERNATIONAL ELECTROTECHNICAL COMMISSION

**TERRESTRIAL PHOTOVOLTAIC (PV) MODULES –
DESIGN QUALIFICATION AND TYPE APPROVAL –****Part 1-4: Special requirements for testing of thin-film
Cu(In,Ga)(S,Se)₂ based photovoltaic (PV) modules**

FOREWORD

- 1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as “IEC Publication(s)”). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
- 2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
- 3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this publication.
- 7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
- 8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
- 9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

This redline version of the official IEC Standard allows the user to identify the changes made to the previous edition IEC 61215-1-4:2016. A vertical bar appears in the margin wherever a change has been made. Additions are in green text, deletions are in strikethrough red text.

International Standard IEC 61215-1-4 has been prepared by IEC technical committee 82: Solar photovoltaic energy systems.

This second edition cancels and replaces the first edition of IEC 61215-1-4, issued in 2016, and constitutes a technical revision.

This edition includes the following significant technical changes with respect to the previous edition:

- a) A cyclic (dynamic) mechanical load test (MQT 20) added.
- b) A test for detection of potential-induced degradation (MQT 21) added.
- c) A bending test (MQT 22) for flexible modules added.

Informative Annex A of 61215-1:2021 explains the background and reasoning behind some of the more substantial changes that were made in the IEC 61215 series in progressing from edition 1 to edition 2.

The text of this standard is based on the following documents:

FDIS	Report on voting
82/1827/FDIS	82/1852/RVD

Full information on the voting for the approval of this International Standard can be found in the report on voting indicated in the above table.

This document has been drafted in accordance with the ISO/IEC Directives, Part 2.

This standard is to be read in conjunction with IEC 61215-1:2021 and IEC 61215-2:2021.

A list of all parts in the IEC 61215 series, published under the general title *Terrestrial photovoltaic (PV) modules – Design qualification and type approval*, can be found on the IEC website.

The committee has decided that the contents of this document will remain unchanged until the stability date indicated on the IEC website under "<http://webstore.iec.ch>" in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

IMPORTANT – The "colour inside" logo on the cover page of this document indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.

TERRESTRIAL PHOTOVOLTAIC (PV) MODULES – DESIGN QUALIFICATION AND TYPE APPROVAL –

Part 1-4: Special requirements for testing of thin-film Cu(In,Ga)(S,Se)₂ based photovoltaic (PV) modules

1 ~~Scope and object~~

~~This part of IEC 61215 lays down IEC requirements for the design qualification and type approval of terrestrial photovoltaic modules suitable for long-term operation in general open-air climates, as defined in IEC 60721-2-1.~~

This document lays down requirements for the design qualification of terrestrial photovoltaic modules suitable for long-term operation in open-air climates. The useful service life of modules so qualified will depend on their design, their environment and the conditions under which they are operated. Test results are not construed as a quantitative prediction of module lifetime.

In climates where 98th percentile operating temperatures exceed 70 °C, users are recommended to consider testing to higher temperature test conditions as described in IEC TS 63126. Users desiring qualification of PV products with lesser lifetime expectations are recommended to consider testing designed for PV in consumer electronics, as described in IEC 63163 (under development). Users wishing to gain confidence that the characteristics tested in IEC 61215 appear consistently in a manufactured product may wish to utilize IEC 62941 regarding quality systems in PV manufacturing.

This document is intended to apply to all thin-film Cu(In,Ga)(S,Se)₂ based terrestrial flat plate modules. As such it addresses special requirements for testing of this technology supplementing IEC 61215-1:2016/2021 and IEC 61215-2:2016/2021 requirements for testing.

This document does not apply to modules used with concentrated sunlight although it may be utilized for low concentrator modules (1 to 3 suns). For low concentration modules, all tests are performed using the irradiance, current, voltage and power levels expected at the design concentration.

~~The object of this test sequence is to determine the electrical and thermal characteristics of the module and to show, as far as possible within reasonable constraints of cost and time, that the module is capable of withstanding prolonged exposure in climates described in the scope. The actual lifetime expectancy of modules so qualified will depend on their design, their environment and the conditions under which they are operated.~~

The object of this test sequence is to determine the electrical characteristics of the module and to show, as far as possible within reasonable constraints of cost and time, that the module is capable of withstanding prolonged exposure outdoors. Accelerated test conditions are empirically based on those necessary to reproduce selected observed field failures and are applied equally across module types. Acceleration factors may vary with product design and thus not all degradation mechanisms may manifest. Further general information on accelerated test methods including definitions of terms may be found in IEC 62506.

Some long-term degradation mechanisms can only reasonably be detected via component testing, due to long times required to produce the failure and necessity of stress conditions that are expensive to produce over large areas. Component tests that have reached a sufficient level of maturity to set pass/fail criteria with high confidence are incorporated into the IEC 61215 series via addition to Table 1 in IEC 61215-1. In contrast, the tests procedures described in this series, in IEC 61215-2, are performed on modules.

This document defines PV technology dependent modifications to the testing procedures and requirements per IEC 61215-1:20162021 and IEC 61215-2:20162021.

2 Normative references

The normative references of IEC 61215-1:20162021 and IEC 61215-2:20162021 are applicable without modifications.

3 Terms and definitions

This clause of IEC 61215-1:20162021 is applicable without modifications.

4 Test samples

This clause of IEC 61215-1:20162021 is applicable without modifications.

5 Marking and documentation

This clause of IEC 61215-1:20162021 is applicable without modifications.

6 Testing

This clause of IEC 61215-1:20162021 is applicable with the following modifications:

Special care has to be taken for stabilizing the power output of the module using MQT 19 procedure with specific requirements stated in 11.19 below.

7 Pass criteria

This clause of IEC 61215-1:20162021 is applicable with the following modifications.

The maximum allowable value of reproducibility is set to $r = 2,0 \%$.

The maximum allowable value of measurement uncertainty is set to $m_1 = 4,0 \%$ for modules containing single-junction cells, and $m_1 = 5,0 \%$ for modules containing multi-junction cells.

8 Major visual defects

This clause of IEC 61215-1:20162021 is applicable without modifications.

9 Report

This clause of IEC 61215-1:20162021 is applicable without modifications.

10 Modifications

This clause of IEC 61215-1:20162021 is applicable without modifications.

11 Test flow and procedures

The test flow from IEC 61215-1:20162021 is applicable.

11.1 Visual inspection (MQT 01)

This test of IEC 61215-2:20162021 is applicable without modifications.

11.2 Maximum power determination (MQT 02)

This test of IEC 61215-2:20162021 is applicable without modifications.

11.3 Insulation test (MQT 03)

This test of IEC 61215-2:20162021 is applicable without modifications.

11.4 Measurement of temperature coefficients (MQT 04)

This test of IEC 61215-2:20162021 is applicable without modifications.

11.5 ~~Measurement of nominal module operating temperature (NMOT) (MQT 05)~~ Placeholder section, formerly NMOT

~~This test of IEC 61215-2:2016 is applicable without modifications.~~

This subclause of IEC 61215-2:2021 does not require technology-specific modifications.

11.6 Performance at STC (MQT 06.1) ~~and NMOT (MQT 06.2)~~

This test of IEC 61215-2:20162021 is applicable without modifications.

11.7 Performance at low irradiance (MQT 07)

This test of IEC 61215-2:20162021 is applicable without modifications.

11.8 Outdoor exposure test (MQT 08)

This test of IEC 61215-2:20162021 is applicable without modifications.

11.9 Hot-spot endurance test (MQT 09)

This test of IEC 61215-2:20162021 is applicable with the following modifications:

Cu(In,Ga)(S,Se)₂ thin-film modules may exhibit performance changes with extended time in storage without light exposure (the “dark soak” effect). In order to minimize the influence of this dark soak effect, limit the time delay between the outdoor exposure or stabilization and the hot spot procedure to within 2 to 3 days. During the first hour after the hot-spot procedure is complete, no additional heating or light beyond room ambient shall be applied. If the time delay is to exceed 1 h, the modules are to be stored in the dark at ≤ 25 °C.

11.9.1 Purpose

This subclause of IEC 61215-2:20162021, test MQT 09, is applicable without modifications.

11.9.2 Hot-spot effect

This subclause of IEC 61215-2:20162021, test MQT 09, is applicable without modifications.

11.9.3 Classification of cell interconnection

This subclause of IEC 61215-2:2016/2021, test MQT 09, is applicable without modifications.

11.9.4 Apparatus

This subclause of IEC 61215-2:2016/2021, test MQT 09, is applicable without modifications.

11.9.5 Procedure

MQT 09.2 of IEC 61215-2:2016/2021 shall be performed for any monolithically integrated (MLI) module design.

If the module is constructed by interconnection of cell-like substructures, MQT 09.1 of IEC 61215-2:2016/2021 may be applicable.

11.9.6 Final measurements

This subclause of IEC 61215-2:2016/2021, test MQT 09, is applicable without modifications.

11.9.7 Requirements

This subclause of IEC 61215-2:2016/2021, test MQT 09, is applicable without modifications.

11.10 UV preconditioning test (MQT 10)

This test of IEC 61215-2:2016/2021 is applicable without modifications.

11.11 Thermal cycling test (MQT 11)

This test of IEC 61215-2:2016/2021 is applicable with the following modifications:

~~The technology specific current which needs to be applied according to MQT 11 of IEC 61215-2:2016 shall be equal to $0,1 \times$ STC peak power current.~~

MQT 11 of IEC 61215-2:2021 can be conducted according to the following methods:

Method A) Perform MQT 11 as defined in IEC 61215-2:2021, with the technology specific current equal to $0,1 \times$ STC peak power current. If $0,1 \times$ STC peak power current is less than 100 mA, then 100 mA may be applied instead.

Method B) Perform MQT 11 as defined in IEC 61215-2:2021 with the following modifications:

During the thermal cycling test, set the continuous current flow during the heat up cycle to the technology specified current noted below at temperature from 0 °C to 85 °C. Maintain current flow during high temperature dwell and cool down cycle until the module temperature is below 0 °C. As necessary, adjust the chamber temperature to maintain module temperature below 85 °C.

The technology specific current which needs to be applied according to MQT11 of IEC 61215-2 shall be a forward bias current of $0,1 \times$ STC peak power current to $0,3 \times$ STC peak power current. If $0,1 \times$ STC peak power current is less than 100 mA, then 100 mA may be applied instead.

The current flow applied during Method B is shown superimposed on the temperature cycle in Figure 1.

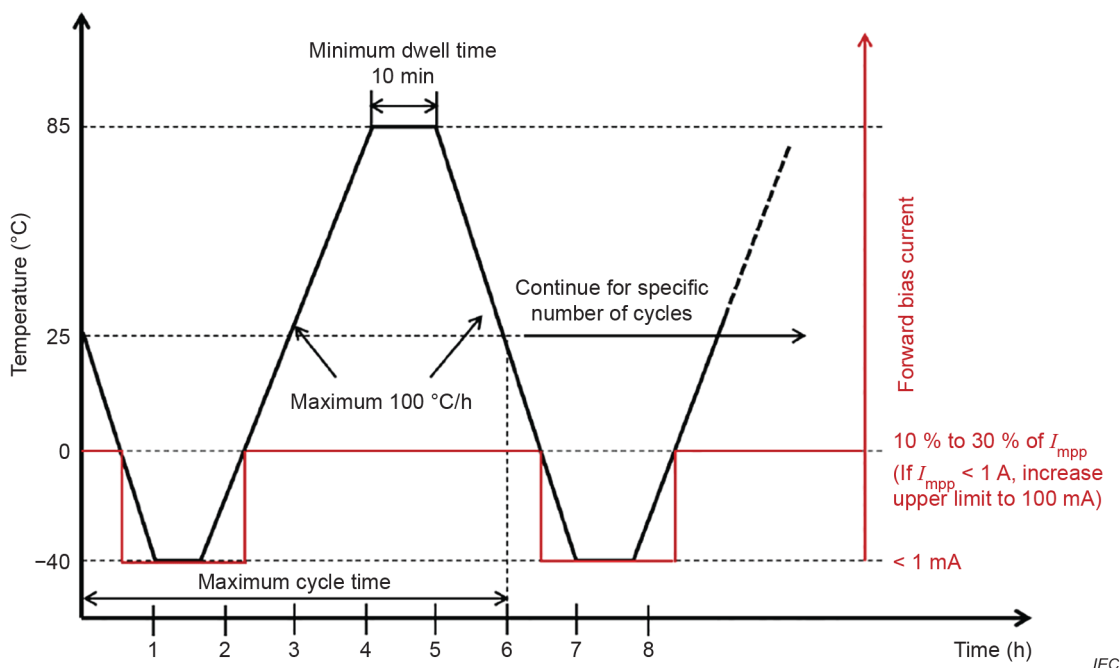


Figure 1 – Current flow using MQT 11 Method B

11.12 Humidity-freeze test (MQT 12)

This test of IEC 61215-2:2016/2021 is applicable ~~without~~ with the following modifications:

MQT 12 of IEC 61215-2:2021 can be conducted according to the following methods:

Method A) Perform MQT 12 as defined in IEC 61215-2:2021.

Method B) Perform MQT 12 as defined in IEC 61215-2:2021 with the following modifications:

During the humidity freeze test, set the continuous current flow during the heat up cycle to the technology specified current noted below at temperature from 0 °C to 85 °C. Maintain current flow during high temperature dwell and cool down cycle until module temperature has reached 0 °C. As necessary, adjust the chamber temperature to maintain module temperature below 85 °C.

The technology specific current which needs to be applied according to MQT12 of IEC 61215-2 in Method B shall be a forward bias current of $0,1 \times \text{STC peak power current}$ to $0,3 \times \text{STC peak power current}$, with a minimum of 100 mA.

The current flow applied during Method B is shown superimposed on the humidity-freeze cycle in Figure 2.

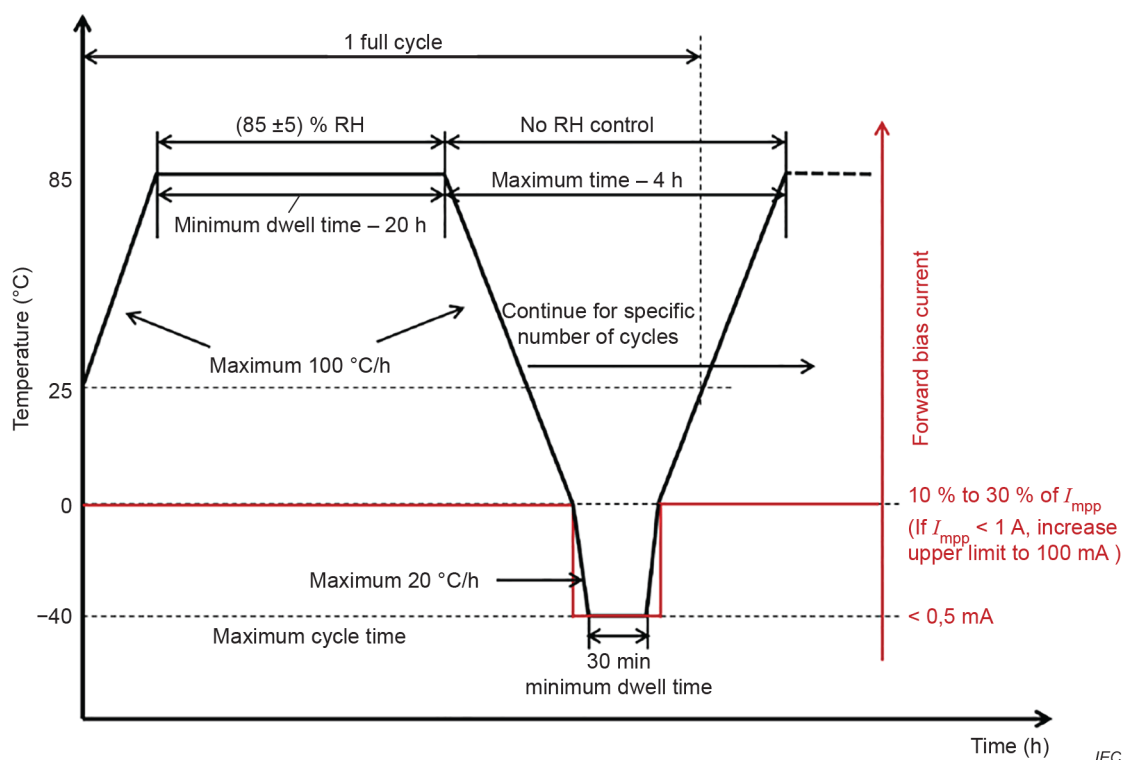


Figure 2 – Current flow using MQT 12 Method B

11.13 Damp heat test (MQT 13)

This test of IEC 61215-2:20162021 is applicable with the following modifications:

MQT 13 of IEC 61215-2:20162021 can be conducted according to the following methods:

Method A) Perform MQT 13 as defined in IEC 61215-2:20162021.

Method B) Perform MQT 13 as defined in IEC 61215-2:20162021 with applied forward bias:

11.13.1 Procedure

- Attach a suitable temperature sensor (see apparatus requirements of MQT 11) to the front or back surface of the module(s) near the middle. If more than one module of the same type are tested simultaneously, it will suffice to monitor the temperature of one representative sample.
- Connect the temperature-monitoring equipment to the temperature sensor(s). Connect each module individually to the appropriate voltage supply by connecting the positive terminal of the module to the positive terminal of the power supply and the second terminal accordingly. During the damp-heat set the applied voltage to $V_{mpp} \pm 5\%$ at STC taken from the data-sheet and limit the current of the power supply to less than 25 % of I_{sc} at STC.
- Throughout the test monitor the module's applied voltage and current. Report I - V trend. If current limit is reached, applied voltage can drop below $V_{mpp} \pm 5\%$ at STC.
- Set chamber temperature to achieve a module temperature of $85\text{ °C} \pm 2\text{ °C}$.
- During cooling phase to ambient temperature (25 °C or less), the specified applied voltage shall be maintained and shall be switched off when the module temperature reaches $25\text{ °C} \pm 5\text{ °C}$.

11.14 Robustness of terminations~~-test~~ (MQT 14)

This test of IEC 61215-2:20162021 is applicable without modifications.

11.15 Wet leakage current test (MQT 15)

This test of IEC 61215-2:20162021 is applicable without modifications.

11.16 Static mechanical load test (MQT 16)

This test of IEC 61215-2:20162021 is applicable without modifications.

11.17 Hail test (MQT 17)

This test of IEC 61215-2:20162021 is applicable without modifications.

11.18 Bypass diode testing (MQT 18)

This test of IEC 61215-2:20162021 is applicable without modifications.

11.19 Stabilization (MQT 19)

This test of IEC 61215-2:20162021 is applicable with the following modifications:

11.19.1 Criterion definition for stabilization

For the definition of stabilization as per MQT 19 of IEC 61215-2:20162021, $x = 0,02$ shall be used.

Any kind of storage shall be done at temperature below 25 °C to avoid thermally activated processes affecting MQT 06.1 of IEC 61215-2:20162021 measurement.

11.19.2 Light induced stabilization procedures

This test of IEC 61215-2:20162021 is applicable without modifications.

11.19.3 Other stabilization procedures

This test of IEC 61215-2:20162021 is applicable without modifications.

11.19.4 Initial stabilization (MQT 19.1)

Initial stabilization is performed on all modules.

To fulfil MQT 19 requirements using light exposure, a minimum of two intervals each of at least 10 kWh/m² are required. After this preconditioning all of the test modules shall be measured for STC power (MQT 06.1 of IEC 61215-2:20162021).

If stabilization is performed outdoors in general no module temperature limits apply. The outdoor stabilization shall be proven at least with one module using the indoor method following the validation procedure from MQT 19 of IEC 61215-2:20162021.

The minimum and maximum module temperatures observed during outdoor light exposure stabilization verification while the irradiance level is above 500 W/m² shall be the minimum and maximum allowable module temperatures for all modules. If the module temperature falls outside of these limits the new module temperature range has to be re-verified.

Output power determination shall be performed after a minimum cooling time of 30 min and maximum 60 min.

A validated alternative procedure can be used in accordance to MQT 19 of IEC 61215-2:20162021.

11.19.5 Final stabilization (MQT 19.2)

Final stabilization is performed on all modules after the test sequences to prove fulfilment of Gate No. 2 requirement of IEC 61215-1:20162021.

To fulfil MQT 19 requirements a minimum of two intervals of at least 10 kWh/m² each are required.

If stabilization is performed outdoors in general no module temperature limits apply. The outdoor stabilization shall be proven at least with one module using the indoor method following MQT 19 of IEC 61215-2:20162021.

The minimum and maximum module temperatures observed during outdoor light exposure stabilization verification while the irradiance level is above 500 W/m² shall be the minimum and maximum allowable module temperatures for all modules. If the module temperature falls outside of these limits the new module temperature range has to be re-verified.

For modules that have been subjected to potential induced degradation (PID) stress (MQT 21), the maximum exposure limit after reaching stabilization shall not be exceeded. The light soak shall terminate no more than 20 kWh/m² after the stabilization criterion is met.

Output power determination shall be performed after a minimum cooling time of 30 min and maximum 60 min.

A validated alternative procedure can be used in accordance to MQT 19 of IEC 61215-2:20162021.

11.20 Cyclic (dynamic) mechanical load test (MQT 20)

This test of IEC 61215-2:2021 is applicable without modifications.

11.21 Potential induced degradation test (MQT 21)

This test of IEC 61215-2:2021 is applicable with the following modifications:

MQT 21 of IEC 61215-2:2021 can be conducted according to either Method A or Method B below.

Method A) Perform MQT 21 as defined in IEC 61215-2:2021.

Method B) Perform MQT 21 as defined in IEC 61215-2:2021 with applied forward bias by adding the following steps to 4.21.4 "Procedure" in 61215-2:2021:

- a) Prior to the test, connect each module individually to the appropriate voltage supply. Proper lead connection is illustrated in Figure 3 and Figure 4.

In the positive system voltage configuration, the power supply for application of forward bias current is isolated by an isolation transformer and one DC terminal of the forward biasing power supply is connected to the system voltage terminal of the power supply for application of the system voltage bias (see Figure 3).

In the negative system voltage configuration, system voltage is applied to the normally grounded module frame, grounding, or mounting points and the power source for forward