IEC 62651

Edition 1.0 2013-04

INTERNATIONAL STANDARD

NORME INTERNATIONALE

Nuclear power plants – Instrumentation important to safety – Thermocouples: characteristics and test methods

Centrales nucléaires de puissance – Instrumentation importante pour la sûreté – Thermocouples: caractéristiques et méthodes d'essai

IEC 62651:2013

Documents
Document Sharing Hub

Full document details: IEC 62651 2013

THIS PUBLICATION IS COPYRIGHT PROTECTED
Copyright © 2013 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester.
If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

Droits de reproduction réservés. Sauf indication contraire, aucune partie de cette publication ne peut être reproduite ni utilisée sous quelque forme que ce soit et par aucun procédé, électronique ou mécanique, y compris la photocopie et les microfilms, sans l'accord écrit de la CEI ou du Comité national de la CEI du pays du demandeur.
Si vous avez des questions sur le copyright de la CEI ou si vous désirez obtenir des droits supplémentaires sur cette publication, utilisez les coordonnées ci-après ou contactez le Comité national de la CEI de votre pays de résidence.

IEC Central Office
3, rue de Varembé
CH-1211 Geneva 20
Switzerland

Tel.: +41 22 919 02 11
Fax: +41 22 919 03 00
info@iec.ch
www.iec.ch

About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigenda or an amendment might have been published.

Useful links:

IEC publications search - www.iec.ch/searchpub

The advanced search enables you to find IEC publications by a variety of criteria (reference number, text, technical committee,…).
It also gives information on projects, replaced and withdrawn publications.

IEC Just Published - webstore.iec.ch/justpublished

Stay up to date on all new IEC publications. Just Published details all new publications released. Available on-line and also once a month by email.

Electropedia - www.electropedia.org

The world's leading online dictionary of electronic and electrical terms containing more than 30 000 terms and definitions in English and French, with equivalent terms in additional languages. Also known as the International Electrotechnical Vocabulary (IEV) on-line.

Customer Service Centre - webstore.iec.ch/csc

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: csc@iec.ch.

A propos de la CEI

La Commission Electrotechnique Internationale (CEI) est la première organisation mondiale qui élabore et publie des Normes internationales pour tout ce qui a trait à l'électricité, à l'électronique et aux technologies apparentées.

A propos des publications CEI

Le contenu technique des publications de la CEI est constamment revu. Veuillez vous assurer que vous possédez l'édition la plus récente, un corrigendum ou amendement peut avoir été publié.

Liens utiles:

Recherche de publications CEI - www.iec.ch/searchpub

La recherche avancée vous permet de trouver des publications CEI en utilisant différents critères (numéro de référence, texte, comité d'études,…).
Elle donne aussi des informations sur les projets et les publications remplacées ou retirées.

Just Published CEI - webstore.iec.ch/justpublished

Restez informé sur les nouvelles publications de la CEI. Just Published détaille les nouvelles publications parues. Disponible en ligne et aussi une fois par mois par email.

Electropedia - www.electropedia.org

Le premier dictionnaire en ligne au monde de termes électroniques et électriques. Il contient plus de 30 000 termes et définitions en anglais et en français, ainsi que les termes équivalents dans les langues additionnelles. Egalement appelé Vocabulaire Electrotechnique International (VEI) en ligne.

Service Clients - webstore.iec.ch/csc

Si vous désirez nous donner des commentaires sur cette publication ou si vous avez des questions contactez-nous: csc@iec.ch.

Documents
Document Sharing Hub

Full document details: IEC 62651 2013

IEC 62651

Edition 1.0 2013-04

INTERNATIONAL STANDARD

NORME INTERNATIONALE

Nuclear power plants – Instrumentation important to safety – Thermocouples: characteristics and test methods

Centrales nucléaires de puissance – Instrumentation importante pour la sûreté – Thermocouples: caractéristiques et méthodes d'essai

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

COMMISSION
ELECTROTECHNIQUE
INTERNATIONALE

PRICE CODE
CODE PRIX V

ICS 27.120.20

ISBN 978-2-83220-754-3

Warning! Make sure that you obtained this publication from an authorized distributor.
Attention! Veuillez vous assurer que vous avez obtenu cette publication via un distributeur agréé.

® Registered trademark of the International Electrotechnical Commission
Marque déposée de la Commission Electrotechnique Internationale

Documents
Document Sharing Hub

Full document details: IEC 62651 2013

CONTENTS

FOREWORD 4
INTRODUCTION 6
1 Scope 8
2 Normative references 8
3 Terms and definitions 8
4 List of abbreviations 11
5 Principle of a thermocouple 11
5.1 General 11
5.2 Types of thermocouples for nuclear applications 13
5.2.1 General 13
5.2.2 Type K 13
5.2.3 Type T 13
5.2.4 Type J 13
5.2.5 Type N 13
5.2.6 Type E 13
5.2.7 Type C 13
5.2.8 Noble metal thermocouples (Type S,R,B) 14
6 Technology of thermocouple assemblies 14
6.1 Thermocouple assembly 14
6.1.1 General 14
6.1.2 Direct contact 15
6.1.3 Direct immersion 15
6.1.4 Thermowell mounted 15
6.2 Performance 15
6.2.1 Accuracy 15
6.2.2 Range of measurement 15
6.2.3 Response time 15
6.2.4 Reliability 15
6.3 Design and construction requirements 16
6.3.1 General 16
6.3.2 Reference junctions 16
6.3.3 Construction principles 16
6.3.4 Materials 17
6.3.5 Insulation resistance (ungrounded thermocouple) 18
6.3.6 Interchangeability – Replacement 18
6.4 Installation of thermocouple assembly 18
6.4.1 Installation requirements 18
6.4.2 Installation in a thermowell 19
6.4.3 Connections 19
6.5 Operational features of thermocouples 20
6.5.1 General considerations on the use of thermocouples 20
6.5.2 Ambient conditions (normal and accident operations) 21
6.5.3 Metallurgical inhomogeneities 21
6.5.4 Corrosion 21
6.5.5 Thermocouple stability 21
6.5.6 Cold working phenomena 22

Documents
Document Sharing Hub
Full document details: IEC 62651 2013

7 Tests 22
7.1 General 22
7.2 Performance tests and pre-production testing 22
7.2.1 General 22
7.2.2 Calibration 23
7.2.3 Response time 23
7.2.4 Electrical insulation resistance tests 23
7.3 Qualification tests (type tests) 23
7.3.1 General 23
7.3.2 Repeatability (thermal shock) 24
7.3.3 Vibration 25
7.3.4 Steam test or high pressure hydraulic test 25
7.3.5 Thermal cycling 26
7.3.6 Harsh environmental conditions qualification 26
7.4 Production tests 26
7.4.1 Manufacturing factors 26
7.4.2 Examination 27
7.4.3 Identification 28
8 Technical information required 28
Bibliography 30

Figure 1 – Schematic diagram of a thermocouple 11
Figure 2 – Electrical structures of a thermocouple 14
Figure 3 – Installation of a thermocouple in a thermowell 19

Table 1 – List of thermocouples and their use in an NPP 12
Table 2 – Example of vibration test requirements 25

Documents
Document Sharing Hub
Full document details: IEC 62651 2013

INTERNATIONAL ELECTROTECHNICAL COMMISSION

NUCLEAR POWER PLANTS – INSTRUMENTATION IMPORTANT TO SAFETY – THERMOCOUPLES: CHARACTERISTICS AND TEST METHODS

FOREWORD

1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
6) All users should ensure that they have the latest edition of this publication.
7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

International Standard IEC 62651 has been prepared by subcommittee 45A: Instrumentation and control of nuclear facilities, of IEC technical committee 45: Nuclear instrumentation.

The text of this standard is based on the following documents:

FDIS	Report on voting
45A/904/FDIS	45A/920/RVD

Full information on the voting for the approval of this standard can be found in the report on voting indicated in the above table.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

AVA Documents Document Sharing Hub

Full document details: IEC 62651 2013

The committee has decided that the contents of this publication will remain unchanged until the stability date indicated on the IEC web site under "http://webstore.iec.ch" in the data related to the specific publication. At this date, the publication will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

Documents
Document Sharing Hub

Full document details: IEC 62651 2013

INTRODUCTION

a) Technical background, main issues and organisation of the Standard

This IEC standard specifically focuses on thermocouple characteristics and test methods.It is intended that the Standard be used by operators of NPPs (utilities), systems evaluators, designers and by licensors.

b) Situation of the current Standard in the structure of the IEC SC 45A standard series

IEC 62651 is the third level SC 45A document tackling the generic issue of design and qualification of thermocouples. It provides the technical background to the nature and use of thermocouples. It provides information on the choice of thermocouple type in relation to the nuclear power applications of concern. It describes the method of use of thermocouples in nuclear reactors. It gives detailed type test and manufacturing test requirements.

IEC 62651 is to be read in association with IEC 60737 which is the appropriate IEC SC 45A document which provides guidance on temperature sensors for reactor applications in general, and with IEC 60780 for equipment qualification. Other IEC standards of general application to thermocouples are given in the normative references of clause 2, and IAEA documents and background information are referenced in the bibliography.

For more details on the structure of the IEC SC 45A standard series, see item d) of this introduction.

c) Recommendations and limitations regarding the application of the Standard

It is important to note that this Standard establishes no additional functional requirements for safety systems.

Aspects for which special recommendations have been provided in this Standard are:

- the types of thermocouple suitable for nuclear reactor applications;
- the normal mounting arrangements;
- the use of hot or cold reference junctions and of compensating cable;
- the mechanical and metallurgical aspects to be considered;
- the use and types of cold-end seals;
- installation;
- testing.

To ensure that the Standard will continue to be relevant in future years, the emphasis has been placed on issues of principle, rather than specific technologies.

d) Description of the structure of the IEC SC 45A standard series and relationships with other IEC documents and other bodies documents (IAEA, ISO)

The top-level document of the IEC SC 45A standard series is IEC 61513. It provides general requirements for I&C systems and equipment that are used to perform functions important to safety in NPPs. IEC 61513 structures the IEC SC 45A standard series.

IEC 61513 refers directly to other IEC SC 45A standards for general topics related to categorization of functions and classification of systems, qualification, separation of systems, defence against common cause failure, software aspects of computer-based systems, hardware aspects of computer-based systems, and control room design. The standards

AVA Documents
Document Sharing Hub

Full document details: IEC 62651 2013

referenced directly at this second level should be considered together with IEC 61513 as a consistent document set.

At a third level, IEC SC 45A standards not directly referenced by IEC 61513 are standards related to specific equipment, technical methods, or specific activities. Usually these documents, which make reference to second-level documents for general topics, can be used on their own.

A fourth level extending the IEC SC 45A standard series, corresponds to the Technical Reports which are not normative.

IEC 61513 has adopted a presentation format similar to the basic safety publication IEC 61508 with an overall safety life-cycle framework and a system life-cycle framework. Regarding nuclear safety, it provides the interpretation of the general requirements of IEC 61508-1, IEC 61508-2 and IEC 61508-4, for the nuclear application sector, regarding nuclear safety. In this framework IEC 60880 and IEC 62138 correspond to IEC 61508-3 for the nuclear application sector. IEC 61513 refers to ISO as well as to IAEA GS-R-3 and IAEA GS-G-3.1 for topics related to quality assurance (QA).

The IEC SC 45A standards series consistently implements and details the principles and basic safety aspects provided in the IAEA code on the safety of NPPs and in the IAEA safety series, in particular the IAEA Safety Standard SSR 2/1, establishing safety requirements related to the design of Nuclear Power Plants, and the Safety Guide NS-G-1.3 dealing with instrumentation and control systems important to safety in Nuclear Power Plants. The terminology and definitions used by SC 45A standards are consistent with those used by the IAEA.

NOTE It is assumed that for the design of I&C systems in NPPs that implement conventional safety functions (e.g. to address worker safety, asset protection, chemical hazards, process energy hazards) international or national standards would be applied, that are based on the requirements of a Standard such as IEC 61508.

Documents
Document Sharing Hub
Full document details: IEC 62651 2013

NUCLEAR POWER PLANTS – INSTRUMENTATION IMPORTANT TO SAFETY – THERMOCOUPLES: CHARACTERISTICS AND TEST METHODS

1 Scope

This International Standard describes the requirements for thermocouples suitable for nuclear power plant (NPP) applications. Thermocouples are widely used in NPPs with other temperature measurement devices such as Resistance Temperature Detectors (RTDs). They are simple and robust and have some specific characteristics (range of measurement and maximum temperature) which make them uniquely suitable for some measurements.

The requirements given in this standard for thermocouples include design, materials, manufacturing, testing, calibration, procurement, and inspection.

The scope of this standard does not cover the design, material selection, and construction of the thermowell, the guide tube, the extension cable, and the temperature transmitter or bridge which may be associated with the thermocouple.

2 Normative references

The following documents, in whole or in part, are normatively referenced in this document and are indispensable for its application. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 60584-1:1995, *Thermocouples – Part 1: Reference tables*

IEC 60584-2:1982, *Thermocouples – Part 2: Tolerances*
Amendment 1:1989

IEC 60584-3:2007, *Thermocouples – Part 3: Extension and compensating cables – Tolerances and identification system*

IEC 60737:2010, *Nuclear power plants – Instrumentation important to safety – Temperature sensors (in-core and primary coolant circuit) – Characteristics and test methods*

IEC 60780, *Nuclear power plants – Electrical equipment of the safety system – Qualification*

IEC 60980, *Recommended practices for seismic qualification of electrical equipment of the safety system for nuclear generating stations*

IEC 61513, *Nuclear power plants – Instrumentation and control important to safety – General requirements for systems*

IEC 61515:1995, *Mineral insulated thermocouple cables and thermocouples*

3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

AVA Documents
Document Sharing Hub

Full document details: IEC 62651 2013

3.1
accuracy of measurement
closeness of the agreement between the result of a measurement and the conventionally true value of the measurand

Note 1 to entry: "Accuracy" is a qualitative concept.

Note 2 to entry: The term precision should not be used for "accuracy".

[SOURCE: IEC 60050-394:2007, 394-40-35]

3.2
calibration
set of operations that establish, under specified conditions, the relationship between values of quantities indicated by measuring instrument or measuring system, or values represented by a material measure or a reference material, and the corresponding values realized by standards

[SOURCE: IEC 60050-394:2007, 394-40-43]

3.3
reference junction
junction of the thermocouple which is at a known (reference) temperature to which the measuring temperature is compared

Note 1 to entry: The reference junction is also called the cold junction.

[SOURCE: IEC 60584-1:1995, definition 2.4]

3.4
drift
variation in sensor or instrument channel output that may occur between calibrations that cannot be related to changes in the process variable or environmental conditions

[SOURCE: IEC 62385:2007, definition 3.7]

3.5
measurement junction
the metal-to-metal junction of the thermocouple located where the temperature is measured. The second junction is located at a reference temperature

Note 1 to entry: The measurement junction is also called the hot junction.

3.6
performance monitoring
process of demonstrating that an installed instrument channel continues to perform its intended function of monitoring the process variable with the expected accuracy, response time, and stability

[SOURCE: IEC 62385:2007, definition 3.13]

3.7
response time
the period of time necessary for a component to achieve a specified output state from the time that it receives a signal requiring it to assume that output state

[SOURCE: IAEA Safety Glossary, edition 2007]

Documents
Document Sharing Hub
Full document details: IEC 62651 2013

3.8
extension and compensating cables
cables used for the electrical connection between the open ends of a thermocouple and the reference junction in those installations where the conductors of the thermocouple are not directly connected to the reference junction. The thermoelectric properties of extension and compensating cables must be close to the properties of the corresponding thermocouple

[SOURCE: IEC 60584-3:2007, definition 3.1]

3.9
extension cables
cables manufactured from conductors having the same nominal composition as those of the corresponding thermocouple. They are designated by the letter "X" following the designation of the thermocouple, for example "JX"

[SOURCE: IEC 60584-3:2007, definition 3.1.1]

3.10
compensating cables
cables manufactured from conductors having a composition different from the corresponding thermocouple. They are designated by the letter "C" following the designation of the thermocouple, for example "KC". In some cases different tolerances apply for the same thermocouple type over different temperature ranges. These are distinguished by additional letters such as, for example, KCA and KCB

[SOURCE: IEC 60584-3:2007, definition 3.1.2]

3.11
thermocouple
pair of conductors of dissimilar materials joined at one end and forming part of an arrangement using the thermoelectric effect for temperature measurement

[SOURCE: IEC 60584-2:1982, definition 2.2]

3.12
thermocouple assembly
an assembly used for temperature measurement, comprising a double set of junctions (hot and cold junctions), cables, connections and an electronic system measuring very low voltages

3.13
thermowell
protective jacket for RTDs, thermocouples and other temperature sensors. The thermowell is also used to facilitate replacement of the temperature sensor

[SOURCE: IEC 62385:2007, definition 3.19]

3.14
time constant
in the case of a first order system, the time required for the output signal of a system to reach 63,2 % of its final variation after a step change of its input signal. If the system is not a first order system, the term "time constant" is not appropriate. For a system of a higher order, the term "response time" should be used

[SOURCE: IEC 62385:2007, definition 3.20]

AVA Documents
Document Sharing Hub

Full document details: IEC 62651 2013

3.15
thermoelectric (Seebeck) effect
the thermoelectric effect is the production of an electromotive force EMF due to the difference of temperature between two junctions of different metals or alloys forming part of the same circuit

[SOURCE: IEC 60584-2, definition 2.1]

4 List of abbreviations


EMF Electromotive Force
HELB High Energy Line Break
LOCA Lost Of Coolant Accident
NPP Nuclear Power Plant
QA Quality Assurance
RTD Resistance Temperature Detector

5 Principle of a thermocouple

5.1 General

When two wires made from dissimilar metals are joined together (by welding or at terminals) at both ends, a small voltage appears on the loop depending on the temperature difference between the two ends as shown on Figure 1. This phenomenon is known as the Seebeck effect. It is the basic principle of a thermocouple used for temperature measurement.

The metal forming one wire is electrically positive compared to the other.

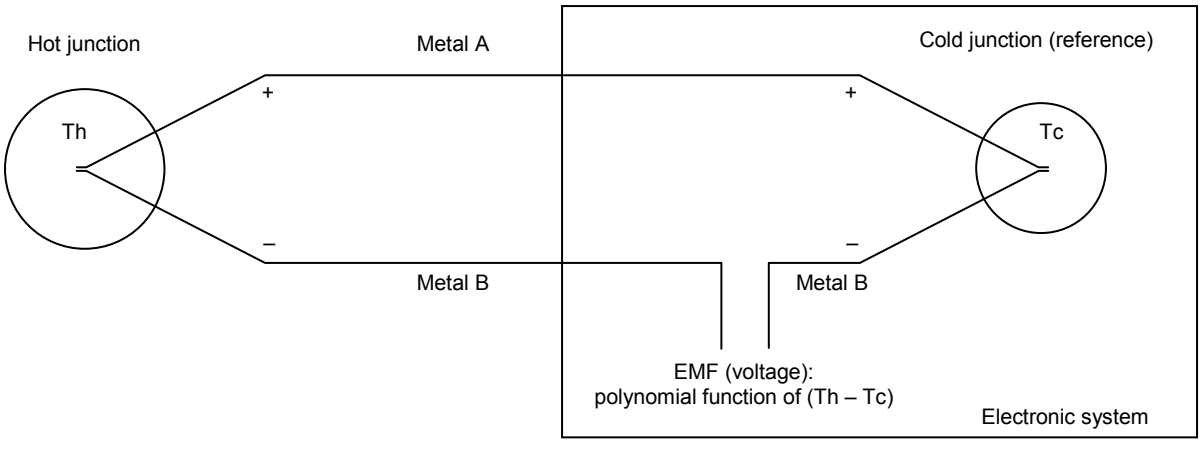

Key

Th temperature of hot junction

Tc temperature of cold junction

Figure 1 – Schematic diagram of a thermocouple

The measuring end is called the hot junction and the other end at a reference temperature is called the cold junction. An electronic system measures the voltage and converts it to give the temperature by comparison with the reference temperature measured by another principle. The relationship between the thermocouple EMF signal and the process temperature is a

AVA Documents Document Sharing Hub
Full document details: IEC 62651 2013

polynomial combination whose coefficients are given by Table 1 of IEC 60584-1:1995. The typical voltage generated by type K thermocouple is about 40 μV/°C from a source with the impedance of the loop resistance of the metals.

The EMF, and therefore the sensitivity and the range of measurement, depend on the nature of the metals. Although many combinations of metals are possible, only specific ones are selected, defining a limited range of types of thermocouple. Each type of thermocouple is defined according to three tolerance classes: Class 1, 2 or 3. Each class corresponds to a tolerance and an associated range where the tolerance is valid.

IEC 60584-2 gives detailed requirements about the classes of tolerance.

IEC 61515 gives general requirements regarding mineral insulated thermocouples and cables.

The environmental conditions in an NPP imply that only some types of thermocouples are recommended.

Table 1 gives the most common thermocouple types. The given temperature range corresponds to the superposition of the three classes of tolerances as described in IEC 60584-2.

Table 1 – List of thermocouples and their use in an NPP

Type	Positive Metal/Alloy	Negative Metal/Alloy	Typical temperature range °C	Example of application
K	Nickel – Chromium	Nickel – Aluminium	–200 to +1 150	Primary circuit PWR
T	Copper	Copper – Nickel	–200 to +350	Not in neutron flux
J	Iron	Copper – Nickel	–40 to +750	Not in neutron flux
N	Nickel – Chromium- Silicon	Nickel – Silicon	–200 to +1 200	Fuel temperature
E	Nickel – Chromium	Copper – Nickel	–200 to +750	Not in neutron flux
C	Tungsten – Rhenium (5 %)	Tungsten – Rhenium (26 %)	0 to +2 300	Not in neutron flux
R	Platinum – Rhodium (13 %)	Platinum	0 to +1 700	Not in neutron flux
S	Platinum – Rhodium (10 %)	Platinum	0 to +1 700	Not in neutron flux
B	Platinum – Rhodium (30 %)	Platinum Rhodium (6 %)	+600 to +1 820	Not in neutron flux

Some other types of thermocouples based on Molybdenum – Niobium (MoNb) or their alloys may be considered for high performance applications.

The categories (T, J, E, C, R, S, B) are described in 5.2 for information only.

Only K, N and E types are generally used for nuclear applications, in accordance with the limitations on exposure to neutron flux of Table 1.

Documents
Document Sharing Hub
Full document details: IEC 62651 2013

5.2 Types of thermocouples for nuclear applications

5.2.1 General

For nuclear applications, and specifically for measurement on and in the primary coolant circuit of reactors, thermocouples with a robust design and a high quality shall be used. They are protected within a metal sheath and insulated with a mineral material.

Thermocouples are used on water reactors for measurement of fuel channel outlet temperature, which is particularly important in beyond design basis conditions. They may be used in travelling fuel channel probes on water-cooled reactors, often for calibration purposes. They are used on gas cooled reactors for measurements of fuel temperature, and fuel channel outlet temperature, which are needed for reactor protection and for control, and are also used for measurement of moderator and core support structural temperature.

More details are given in IEC 60737.

5.2.2 Type K

Type K thermocouple is the most widely used thermocouple. Its voltage output signal curve is virtually linear against the temperature and has a good sensitivity. Type K thermocouples can be used in temperatures up to 1 150 °C and, for short periods, up to 1 250 °C depending on sheath material and diameter.

5.2.3 Type T

This thermocouple is not very commonly used. Its temperature range is limited to –200 °C up to +350 °C. It is used in moist or negative temperature conditions because of its resistance to corrosion and the greater homogeneity of the component wires that reduce errors due to temperature gradients.

5.2.4 Type J

Type J Thermocouple has a limited temperature range: –40 °C to +750 °C. Its sensitivity increases up to 55 μV/°C and its output signal can be changed by the contamination of the iron. It is not recommended for nuclear applications.

5.2.5 Type N

This thermocouple has a good thermoelectric stability. It has an excellent oxidation resistance at high temperature. It is well adapted for accurate measurements in air, up to 1 200 °C. In vacuum or controlled atmosphere, it can withstand 1 300 °C depending on sheath materials and diameter

N thermocouples are more stable than noble metal thermocouples (S or B) under radiation conditions, but they are less stable at high temperature without radiation. Their drift depends on the sheath material and the temperature. Under certains conditions Type K are more stable than type N.

5.2.6 Type E

Thanks to its high sensitivity, the type E thermocouple is mainly used for cryogenic measurements. As it is non-magnetic, it can be preferred for some specific applications.

5.2.7 Type C

The type C thermocouple is mainly used for high temperature measurements, specifically for nuclear applications not subject to neutron flux.

Documents
Document Sharing Hub
Full document details: IEC 62651 2013

5.2.8 Noble metal thermocouples (Type S,R,B)

The noble metal thermocouples are dedicated to high temperature measurements (over 1 500 °C). Pure platinum and platinum/rhodium alloys develop smaller voltages than junctions with common metal. These thermocouple become active and are not recommended for nuclear applications.

6 Technology of thermocouple assemblies

6.1 Thermocouple assembly

6.1.1 General

A thermocouple is a sensitive element which delivers a small electric signal in direct relation with the temperature. It can be used in association with mechanical and electrical components (thermowell, cables, junction box), to position, protect and connect it to an electronic device for signal processing. The set of these components is the thermocouple assembly. This standard refers to the thermocouple assemblies and their use in an NPP.

The basic structure of a thermocouple used in NPP is a mineral insulated cable with the thermocouple junction at the end of the cable. Two structures are possible:

- Insulated or ungrounded structure when the thermocouple is not electrically connected to the sheath.
- Grounded structure when the thermocouple is in direct contact with the envelope of the sheath.

Figure 2 shows the two possible structures of a thermocouple

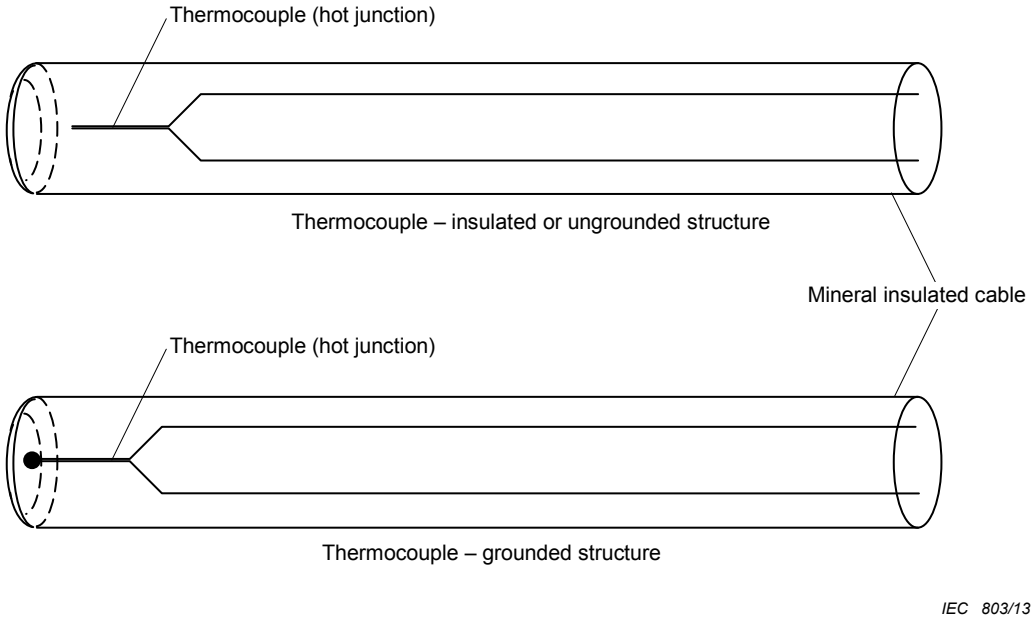


Figure 2 – Electrical structures of a thermocouple

Depending on the nature of the substance whose temperature is measured (gas, liquid, solid) and the conditions of measurement (fixed, flow rate, electrical conditions), the mechanical arrangement of the thermocouple will differ according to:

- direct contact with the component;

Documents
Document Sharing Hub
Full document details: IEC 62651 2013

- direct immersion;
- protected in a metallic support (thermowell) .

6.1.2 Direct contact

The end of the thermocouple is welded or fixed on the metallic surface of the component. This is for example the typical arrangement for the incore thermocouple for the measurement of in-core temperature on the surface of the fuel element.

6.1.3 Direct immersion

The thermocouple is in direct contact with the fluid of which the temperature is measured.

6.1.4 Thermowell mounted

In the case of the measurement of the temperature of a fluid in a circuit, the thermocouple is generally inserted in a protective support called the thermowell.

The use of a thermowell makes any replacement of the thermocouple easier.

The mechanical contact of the end of the thermocouple with the envelope of the thermowell is important regarding the accuracy and the response time.

6.2 Performance

6.2.1 Accuracy

The accuracy of a thermocouple depends on the characteristics of the materials themselves and the accuracy of the cold junction temperature measurement. IEC 60584-2 specifies the amount by which the measurements may deviate from ideal behaviour for each type of thermocouple. Three classes of tolerance are defined in Table 1 of IEC 60584-2:1982. The class of tolerance of a thermocouple depends on the manufacturing process.

6.2.2 Range of measurement

The range of measurement is given by the type of the thermocouple as indicated above. The range differs according to the class of tolerance as indicated in IEC 60584-2.

6.2.3 Response time

The response time of a thermocouple assembly depends on its structure including the thermowell.

The response time of a thermocouple depends on the diameter of the wires, the mass of materials around the junction and its efficiency in transferring heat from its outer surfaces to the wire sensing element. A thermocouple can be shaped in order to reduce the thermal inertia and to shorten the response time.

For NPP applications, the response time requirement shall be specified according to the functions to be performed.

6.2.4 Reliability

The reliability requirement of thermocouples used for safety functions are defined from reliability requirements of the safety system. Experience of carefully manufactured thermocouples provided with high Quality Assurance and Quality Control requirements for NPP applications is that their reliability is high. Thermocouples operated in safety systems should have their design lives defined. For thermocouples whose design life is less than the

AVA Documents
Document Sharing Hub
Full document details: IEC 62651 2013

design life of the NPP or the safety system, then arrangement shall be made for these thermocouples to be replaced or re-assessed before their design life is reached.

6.3 Design and construction requirements

6.3.1 General

The thermocouple and its associated devices shall meet the requirements described in this standard and in IEC 60737. Safety or other requirements for the application shall be determined according to national and international requirements and practice, including IEC 61513.

6.3.2 Reference junctions

A thermocouple is a differential device giving an electric signal related to the difference of temperature between the hot junction (to be measured) and the cold junction (reference). The cold junction is typically not kept at a known temperature but rather the temperature is measured at the cold junction and this measurement is used to perform the cold junction temperature compensation to obtain the actual process temperature at the measurement junction.

6.3.3 Construction principles

Thermocouples can be supplied in different internal constructions, which depend on the manufacture, qualification requirements, and applications. For thermocouples being used in an NPP, the design and structure of the thermocouple should consider the environmental conditions in which the sensor is being used under normal operating and under design basis accident conditions, as well as the qualification tests specified by the user. The use of a flexible mineral-insulated cable between the thermocouple and the connector is commonly adopted, and the user may also adopt any other construction. A variation of this design may include a rigid exterior sheath over the mineral-insulated cable between the thermocouple and the connector, this sheath being welded to the connector.

Thermocouples can be manufactured with various forms depending on the conditions of the measurement.

Three types of thermocouple are commonly used:

- Simple thermocouple: The wires are not protected and separate from each other, the hot junction is directly fastened or soldered onto the surface of the component. This type is not normally used in NPPs.
- Thermocouple with a grounded hot junction: The wires are isolated from each other (except at the junction itself) and inserted in a metallic protective sheath. The hot junction is electrically connected to the protective sheath.
- Thermocouple with an isolated hot junction (i.e. ungrounded): The wires are isolated from each other (except at the junction itself) and inserted in a protective sheath. The hot junction is electrically isolated from the protective sheath.

The methods of manufacture of the measuring junction are:

- exposed junction – the thermocouple is made with the junction extended beyond the end of the sheath and insulant and remaining unprotected, such arrangements are not normally used;
- grounded junction – the conductors are welded to the end cap, which is welded to the sheath to form the closure;
- ungrounded or isolated junction – the thermocouple is formed and the hot junction located at a controlled position from the sheath closure end cap.

Protecting the measuring junction with a sheath has the following advantages:

Documents
Document Sharing Hub
Full document details: IEC 62651 2013

- The conductors are protected from the environmental conditions.
- The insulant is protected from moisture.
- The conductors are not subject to mechanical damage.

The ungrounded or insulated junction also has the following advantages:

- Differential expansion between conductors and sheath will not cause stress on the conductors.
- The thermocouple is protected from earth faults.
- The signal interference problems of earthed thermocouples can be eliminated.

6.3.4 Materials

6.3.4.1 Thermocouple wires

The wires used for thermocouples shall be carefully identified and documented. The size of conductor is a compromise. It should balance:

- mechanical strength;
- an allowance for oxidation;
- minimum loop resistance;
- reduction of thermal conduction from the hot junction;
- reduction of radiation;
- the time taken to reach thermal equilibrium.

6.3.4.2 Cable construction

Matched thermocouple conductors are surrounded by a mineral insulation, held in a metal tube. This is then reduced by drawing, swageing, or rolling, which also compacts the insulant and removes voids.

Depending on the type of the measurement needed, the design of the cable can differ significantly.

The method of construction and the quality checks employed shall be sufficient to ensure that the geometry of the thermocouple is adequately controlled. This includes wire spacing, symmetry, position of the junction, and the absence of voids in the insulant.

The characteristics of the cable include:

- quality of the insulant of the highest grade of magnesia;
- standard outside diameters of cables;
- capacity of passing a specific pressure test;
- sheath materials like chromium-nickel alloy where fuel temperature is measured, of the same composition as the fuel element sheath.

6.3.4.3 Seals and adhesives

Sheathed thermocouples (see 6.3.3) shall be hermetically sealed. The connector may or may not be an integral part of the thermocouple assembly. Thermocouples used in a harsh environment, such as in high-temperature and/or radiation areas, shall be designed without organic material. The use of mineral material is recommended. The leak tightness of the insulating termination shall be tested according to an adequate and proven procedure. Commonly suggested seals of the connector are glass-to-metal or ceramic-to-metal, which should have less than 10^{-8} cm^3/s leak rate when tested with helium at an atmospheric differential pressure.

AVA Documents Document Sharing Hub

Full document details: IEC 62651 2013

All cements, adhesives, or seals used internally in the device shall be capable of withstanding the service conditions without functional deterioration and without emitting gases. All non-metallic materials, when used for seals, protective finishes, and so forth, shall be moisture and flame-resistant. These non-metallic materials shall not support fungus growth and shall not be adversely affected by the ambient environments specified in the performance requirements of this standard.

6.3.4.4 Sheath closure

The sheath closure at the measuring junction should be an end cap of the same material, welded onto the sheath, using argon-arc methods. This also allows filling the end void with insulant before the sheath is closed. For sizes below 1,5 mm, plasma-arc welding may be used, with no end cap fitted and closure done by heating the sheath metal with the measuring junction pointing downwards so that it can flow to form a cast end.

6.3.4.5 Reference (cold end) seal

To prevent ingress of moisture, a seal is needed at the cold end of the thermocouple, by a seal pot fixed to the sheath by brazing, welding or crimping. Before attaching the seal pot to the sheath, flexible wires fitted with insulating sleeves are brazed to the thermocouple conductors. The joints should be arranged about halfway along within the seal pot. This is filled with a sealing compound suitable for sealing up to 105 °C. The seals shall be tested for effectiveness after completion.

6.3.5 Insulation resistance (ungrounded thermocouple)

The insulation resistance is a parameter that gives information regarding the tightness of the sheath.

The insulation resistance of an ungrounded thermocouple depends on the diameter of the cable sheath, the temperature, the quality and purity and moisture content of the insulant.

The insulation resistance and the voltage to use for the resistance measurement shall be given by the manufacturer at ambient temperature and operation temperature. The insulation resistance should be in the range of at least 100 MΩ to 1 000 MΩ and the voltage for the measurement in the range 50 V to 500 V, depending on the diameter of the sheath.

Typically, the insulation resistance decreases by two orders of magnitude between the ambient temperature and 200 °C, and this needs to be considered in design.

6.3.6 Interchangeability – Replacement

Every sensor produced under the same specification shall be interchangeable with any other of the same type, within the tolerances.

The handling of thermocouples when removed from the reactor circuit and any radiation hazards that may be involved should be considered in any design.

6.4 Installation of thermocouple assembly

6.4.1 Installation requirements

Errors can be introduced because of installation conditions. The following precautions should be observed:

- any action that might cause cold working should be avoided;
- installation should note the manufacturer's specified minimum bending radius for the cable;
- severe bending or flexing of the wires should be avoided;

AVA Documents Document Sharing Hub

Full document details: IEC 62651 2013