


IEEE Recommended Practice for Field Testing Electric Submersible Pump Cable



IEEE Std 1017-1985

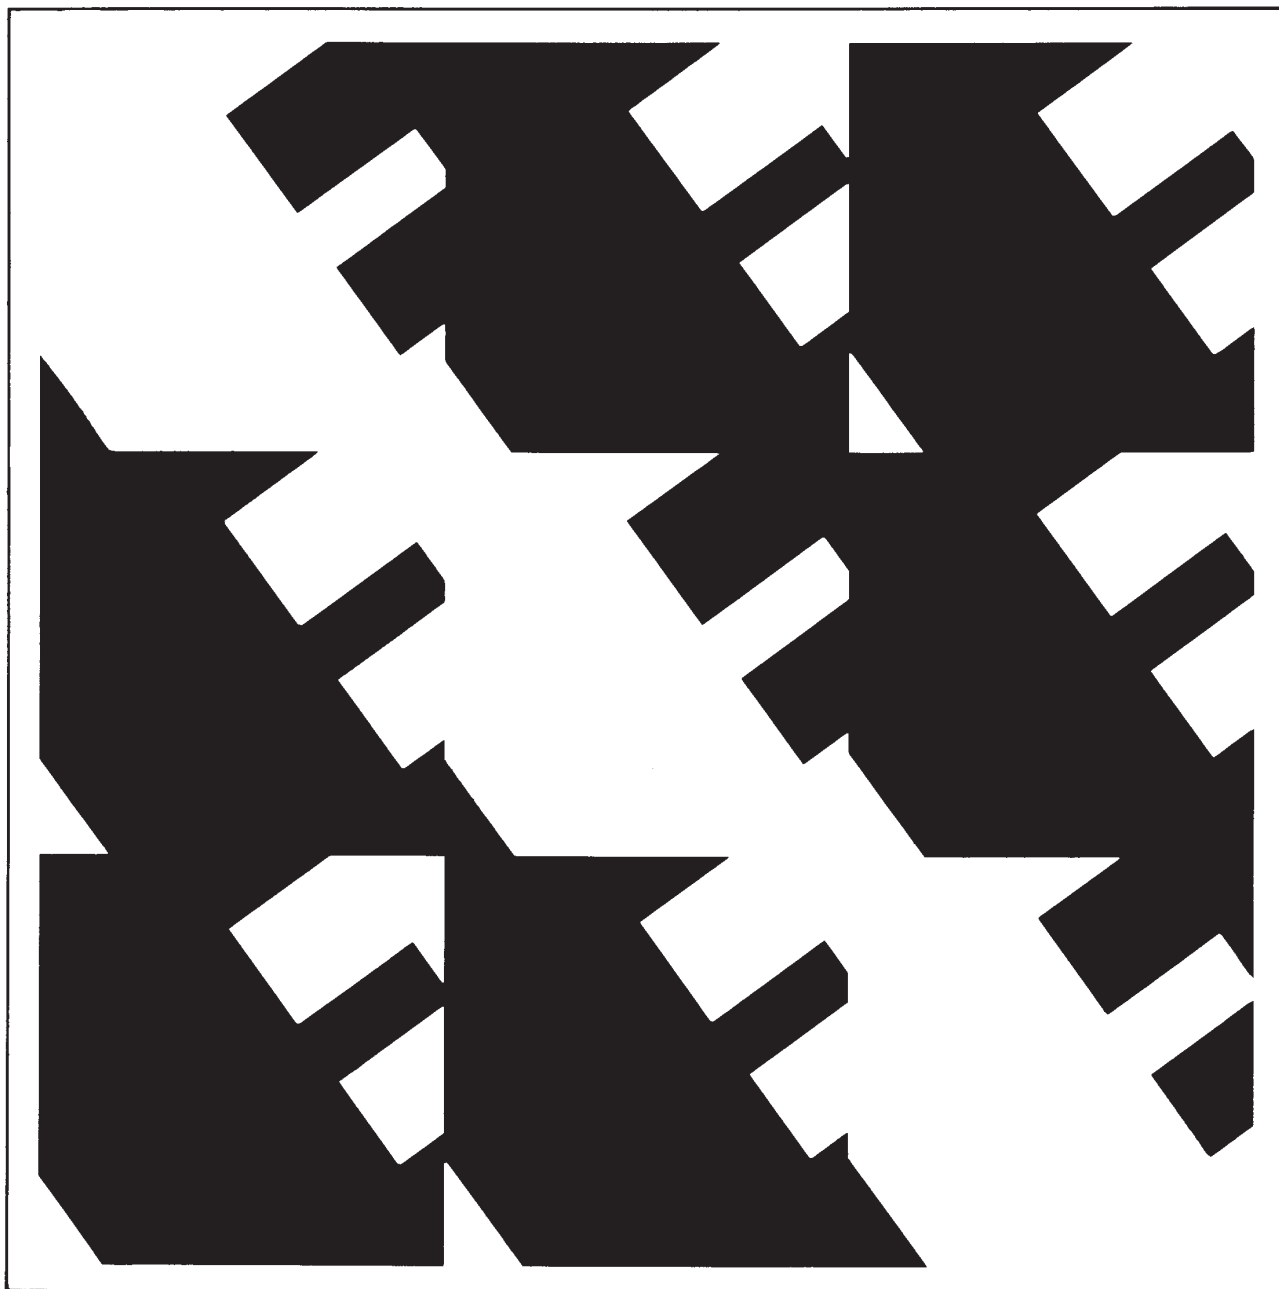

Published by The Institute of Electrical and Electronics Engineers, Inc 345 East 47th Street, New York, NY 10017, USA

December 18, 1984

SH09779

IEEE Recommended Practice for Field Testing Electric Submersible Pump Cable

Sponsor

**Petroleum and Chemical Industry Committee of the
IEEE Industry Applications Society**

Approved June 14, 1984

IEEE Standards Board

Approved September 18, 1985

American National Standards Institute

©Copyright 1984 by

**The Institute of Electrical and Electronics Engineers, Inc
345 East 47th Street, New York, NY 10017, USA**

*No part of this publication may be reproduced in any form,
in an electronic retrieval system or otherwise,
without the prior written permission of the publisher.*

IEEE Standards documents are developed within the Technical Committees of the IEEE Societies and the Standards Coordinating Committees of the IEEE Standards Board. Members of the committees serve voluntarily and without compensation. They are not necessarily members of the Institute. The standards developed within IEEE represent a consensus of the broad expertise on the subject within the Institute as well as those activities outside of IEEE which have expressed an interest in participating in the development of the standard.

Use of an IEEE Standard is wholly voluntary. The existence of an IEEE Standard does not imply that there are no other ways to produce, test, measure, purchase, market, or provide other goods and services related to the scope of the IEEE Standard. Furthermore, the viewpoint expressed at the time a standard is approved and issued is subject to change brought about through developments in the state of the art and comments received from users of the standard. Every IEEE Standard is subjected to review at least once every five years for revision or reaffirmation. When a document is more than five years old, and has not been reaffirmed, it is reasonable to conclude that its contents, although still of some value, do not wholly reflect the present state of the art. Users are cautioned to check to determine that they have the latest edition of any IEEE Standard.

Comments for revision of IEEE Standards are welcome from any interested party, regardless of membership affiliation with IEEE. Suggestions for changes in documents should be in the form of a proposed change of text, together with appropriate supporting comments.

Interpretations: Occasionally questions may arise regarding the meaning of portions of standards as they relate to specific applications. When the need for interpretations is brought to the attention of IEEE, the Institute will initiate action to prepare appropriate responses. Since IEEE Standards represent a consensus of all concerned interests, it is important to ensure that any interpretation has also received the concurrence of a balance of interests. For this reason IEEE and the members of its technical committees are not able to provide an instant response to interpretation requests except in those cases where the matter has previously received formal consideration.

Comments on standards and requests for interpretations should be addressed to:

Secretary, IEEE Standards Board
345 East 47th Street
New York, NY 10017
USA

Foreword

(This Foreword is not a part of IEEE Std 1017–1985, IEEE Recommended Practice for Field Testing Electric Submersible Pump Cable.)

This recommended practice, under the jurisdiction of the IEEE Industry Applications Society, Petroleum and Chemical Industry Committee, may be used by anyone desiring to do so and is presented as minimum criteria for construction of this class submersible cable. It is not intended to restrict innovation or to limit development of improvements in cable design. Every effort has been made to assure the accuracy and reliability of the data contained herein; however, the Committee makes no representation, warranty, or guarantee in connection with the publication of this specification and hereby expressly disclaims any liability or responsibility for loss or damage resulting from its use, for any violation of any federal, state, or municipal regulation with which it may conflict, or for the infringement of any patent resulting from the use of this document.

At the time this recommended practice was approved the Downhole Working Group of the Petroleum and Chemical Industry Committee had the following membership:

M. O. Durham, *Chairman*

Joseph E. Vandevier, *Secretary*

Rolf Beer
Lynn Boyer

J. D. Hunt
Steve Nelson

Frank Vatalero
Olin Willis

At the time this recommended practice was approved, the Petroleum and Chemical Industry Committee of the IEEE Industry Applications Society had the following membership:

R. M. Jackson, *Chairman*

R. J. Fritz, *Vice Chairman*

D. C. Azbill, *Secretary*

J. A. Adkison
S. P. Axe
W. Beard
V. Burkhardt
J. D. Campbell
A. J. Chapman
B. J. Comingore
E. T. Crimmins
J. B. Dwyer
H. B. Dygert
B. E. Ewers
E. F. Fagan
F. P. Gertson
B. E. Gilman
D. Grant
G. R. Griffith

R. A. Hazlewood
H. N. Hickok
F. P. Hogan
J. W. Kilgore
P. M. Kinney
J. C. Lacour
W. H. Levers
J. J. Mares
B. McDaniel
E. F. Merrill
R. W. Mills
W. Moser
R. L. Nailen
K. Nicholas
M. R. Ogden
T. P. Pearson

B. M. Polkinghorn
G. D. Rock
E. Saavedra
F. D. Shaw
J. D. Shible
W. A. Short
H. Sibley
H. D. Slief
A. W. Smith
E. E. Smith
T. B. Smith
J. A. Stewart
P. O. Teter
E. B. Turner
A. L. Verheil
W. E. Withers

When the IEEE Standards Board approved this standard on June 14, 1984, it had the following membership:

James H. Beall, *Chairman*

John E. May, *Vice Chairman*

Sava I. Sherr, *Secretary*

J. J. Archambault
John T. Boettger
J. V. Bonucchi
Rene Castenschiold
Edward J. Cohen
Len S. Corey
Donald C. Fleckenstein
Jay Forster

Daniel L. Goldberg
Donald N. Heirman
Irvin N. Howell
Jack Kinn
Joseph L. Koepfinger^{*}
Irving Kolodny
George Konomos
R. F. Lawrence

Donald T. Michael^{*}
John P. Riganati
Frank L. Rose
Robert W. Seelbach
Jay A. Stewart
Clifford O. Swanson
W. B. Wilkens
Charles J. Wylie

^{*}Member emeritus