


IEEE Recommended Practice for Utility Interconnection of Small Wind Energy Conversion Systems



ANSI/IEEE Std 1021-1988

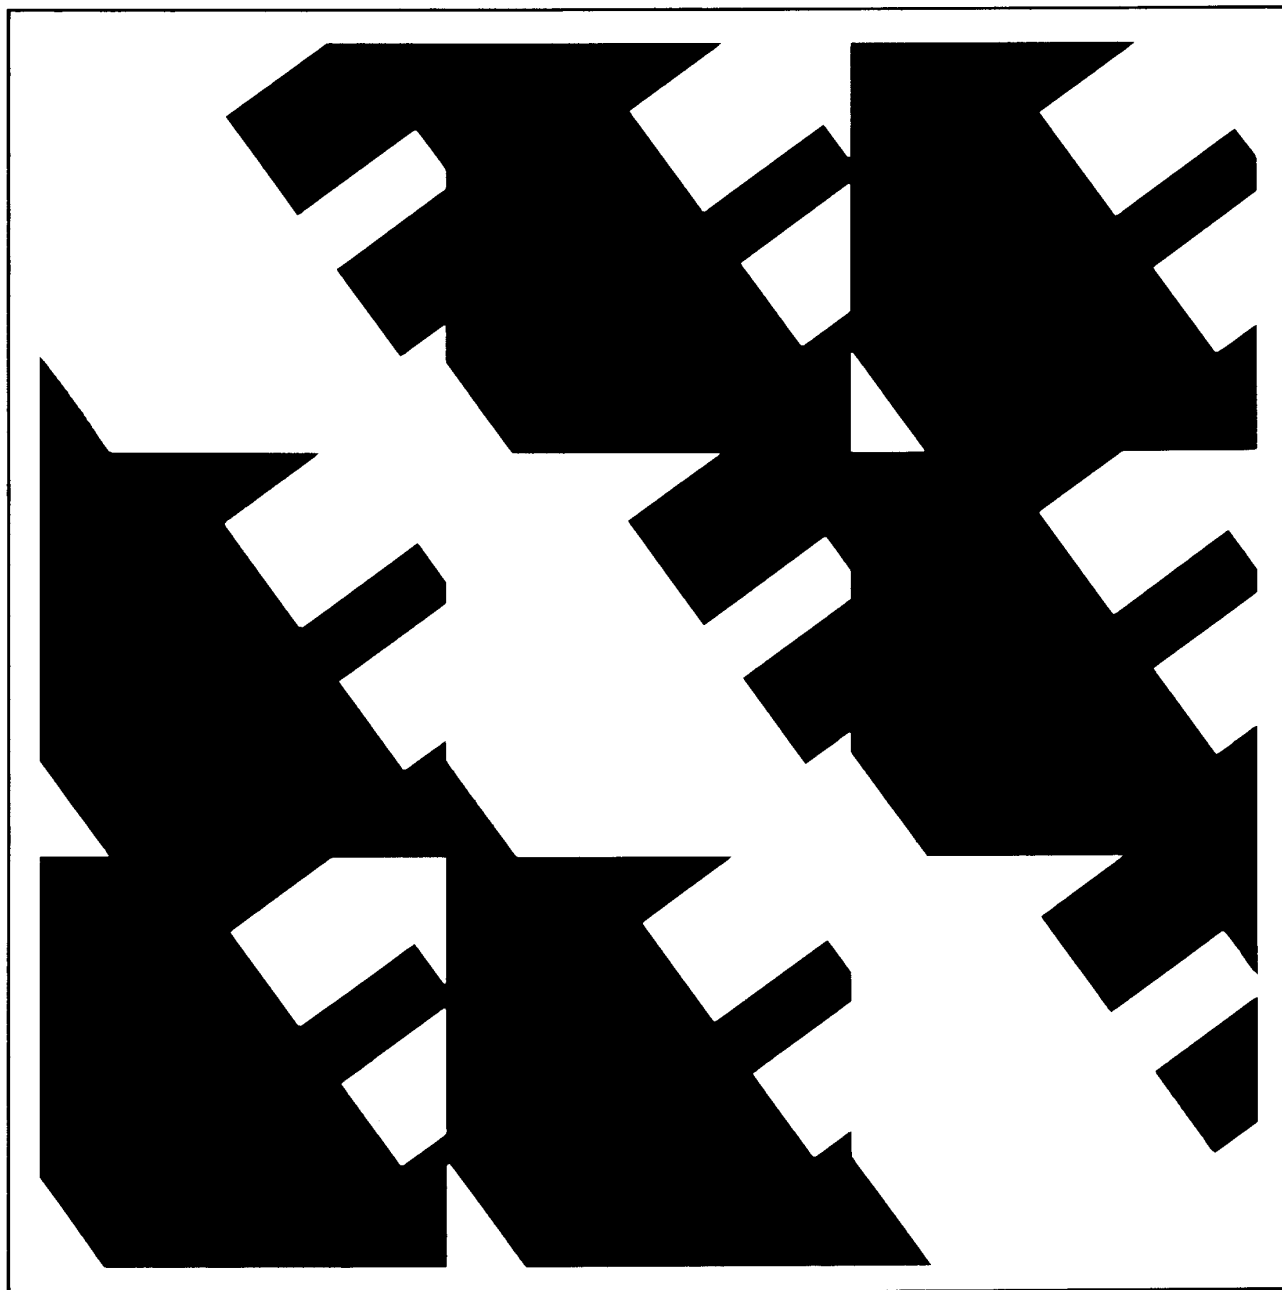

Published by The Institute of Electrical and Electronics Engineers, Inc. 345 East 47th Street, New York, NY 10017, USA

November 30, 1987

SH11551

An American National Standard
**IEEE Recommended Practice for
Utility Interconnection of
Small Wind Energy Conversion Systems**

Sponsor
**IEEE Standards Coordinating Committee 23,
Dispersed Storage and Generation**

Approved December 11, 1986

IEEE Standards Board

Approved May 18, 1987

American National Standards Institute

© Copyright 1987 by

**The Institute of Electrical and Electronics Engineers, Inc
345 East 47th Street, New York, NY 10017, USA**

*No part of this publication may be reproduced in any form,
in an electronic retrieval system or otherwise,
without the prior written permission of the publisher.*

IEEE Standards documents are developed within the Technical Committees of the IEEE Societies and the Standards Coordinating Committees of the IEEE Standards Board. Members of the committees serve voluntarily and without compensation. They are not necessarily members of the Institute. The standards developed within IEEE represent a consensus of the broad expertise on the subject within the Institute as well as those activities outside of IEEE which have expressed an interest in participating in the development of the standard.

Use of an IEEE Standard is wholly voluntary. The existence of an IEEE Standard does not imply that there are no other ways to produce, test, measure, purchase, market, or provide other goods and services related to the scope of the IEEE Standard. Furthermore, the viewpoint expressed at the time a standard is approved and issued is subject to change brought about through developments in the state of the art and comments received from users of the standard. Every IEEE Standard is subjected to review at least once every five years for revision or reaffirmation. When a document is more than five years old, and has not been reaffirmed, it is reasonable to conclude that its contents, although still of some value, do not wholly reflect the present state of the art. Users are cautioned to check to determine that they have the latest edition of any IEEE Standard.

Comments for revision of IEEE Standards are welcome from any interested party, regardless of membership affiliation with IEEE. Suggestions for changes in documents should be in the form of a proposed change of text, together with appropriate supporting comments.

Interpretations: Occasionally questions may arise regarding the meaning of portions of standards as they relate to specific applications. When the need for interpretations is brought to the attention of IEEE, the Institute will initiate action to prepare appropriate responses. Since IEEE Standards represent a consensus of all concerned interests, it is important to ensure that any interpretation has also received the concurrence of a balance of interests. For this reason IEEE and the members of its technical committees are not able to provide an instant response to interpretation requests except in those cases where the matter has previously received formal consideration.

Comments on standards and requests for interpretations should be addressed to:

Secretary, IEEE Standards Board
345 East 47th Street
New York, NY 10017
USA

Foreword

(This Foreword is not a part of ANSI/IEEE Std 1021-1988, IEEE Recommended Practice for Utility Interconnection of Small Wind Energy Conversion Systems.)

This recommended practice was prepared by a working group comprised of both IEEE and ASTM members. The ASTM draft document, which was revised by the working group, was originally prepared by the electric subsystem standards subcommittee of the American Wind Energy Association.

The principle value of this recommended practice will be realized if it fosters a better understanding of responsibilities and requirements among those involved with interconnecting a small wind energy conversion system (SWECS) with an electric utility.

At the time this recommended practice was approved the members of the working group of the Standards Coordinating Committee on Dispersed Storage and Generation of the IEEE Standards Board were as follows:

R. J. Fernandez, *Chairman*

J. C. Appleyard
W. S. Bollmeier, II
D. C. Dawson*
P. Duks

H. Meyer
R. Noun*
L. H. Solderholm
R. Wein

* Past members

At the time this recommended practice was approved the members of the Standards Coordinating Committee on Dispersed Storage and Generation (SCC 23) of the IEEE Standards Board were as follows:

C. H. Griffin, *Chairman*

R. W. Beckwith
W. S. Bollmeier, II
R. Castenschiold
D. C. Dawson
R. DeBlasio*
R. W. Dempsey
P. Duks
W. E. Feero
R. J. Fernandez
N. R. Friedman

J. H. Galloway
K. H. Hoffman
G. Johnson
G. Jones
E. C. Kern, Jr
J. L. Koepfinger
T. J. Kolenda
R. L. Linden
P. Longrigg

H. Meyer
J. Miller
W. J. Moylan
G. L. Park
A. Pivec
H. B. Puttgen
D. T. Rizy
D. W. Selby*
J. Stevens
S. J. Wells

* Alternate

The following persons were on the balloting committee that approved this document for submission to the IEEE Standards Board:

R. W. Beckwith
W. S. Bollmeier, II
R. Castenschiold
D. C. Dawson
R. W. Dempsey
P. Duks
W. E. Feero
R. J. Fernandez
N. R. Friedman

J. H. Galloway
C. H. Griffin
K. H. Hoffman
G. Jones
E. C. Kern, Jr
J. L. Koepfinger
T. J. Kolenda
R. L. Linden
P. Longrigg

H. Meyer
J. Miller
W. J. Moylan
G. L. Park
A. Pivec
H. B. Puttgen
D. T. Rizy
J. Stevens
S. J. Wells