


ISA–RP92.0.02, Part II–1998



Installation, Operation, and Maintenance of Toxic Gas-Detection Instruments: Hydrogen Sulfide

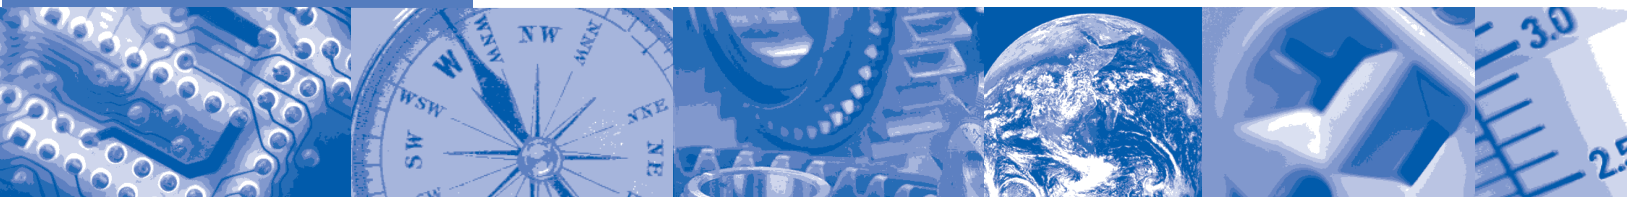

ISA–The Instrumentation,
Systems, and
Automation Society

Approved 15 April 1998



Documents

Document Sharing Hub

ISA–RP92.0.02, Part II–1998

Installation, Operation, and Maintenance of Toxic Gas Detection Instruments: Hydrogen Sulfide

ISBN: 1-55617-679-1

Copyright © 1998 by the Instrument Society of America. All rights reserved. Printed in the United States of America. No part of this publication may be reproduced, stored in a retrieval system, or transmitted in any form or by any means (electronic, mechanical, photocopying, recording, or otherwise), without the prior written permission of the publisher.

ISA

67 Alexander Drive

P.O. Box 12277

Research Triangle Park, North Carolina 27709

Preface

This preface, as well as all footnotes and annexes, is included for informational purposes and is not part of ISA-RP92.0.02, Part II-1998.

This Recommended Practice has been prepared as part of the service of ISA, the international society for measurement and control, toward a goal of uniformity in the field of instrumentation. To be of real value, this document should not be static but should be subject to periodic review. Toward this end, the Society welcomes all comments and criticisms and asks that they be addressed to the Secretary, Standards and Practices Board; ISA; 67 Alexander Drive; P. O. Box 12277; Research Triangle Park, NC 27709; Telephone (919) 990-9227; Fax (919) 549-8288; Internet: INFO@ISA.ORG.

The ISA Standards and Practices Department is aware of the growing need for attention to the metric system of units in general, and the International System of Units (SI) in particular, in the preparation of instrumentation standards, recommended practices, and technical reports. The Department is further aware of the benefits to USA users of ISA standards of incorporating suitable references to the SI (and the metric system) in their business and professional dealings with other countries. Toward this end, this Department will endeavor to introduce SI-acceptable metric units in all new and revised standards, recommended practices, and technical reports to the greatest extent possible. *Standard for Use of the International System of Units (SI): The Modern Metric System*, published by the American Society for Testing & Materials as IEEE/ASTM SI 10-97, and future revisions, will be the reference guide for definitions, symbols, abbreviations, and conversion factors.

It is the policy of the ISA to encourage and welcome the participation of all concerned individuals and interests in the development of ISA Standards, Recommended Practices, and Technical Reports. Participation in the ISA standards-making process by an individual in no way constitutes endorsement by the employer of that individual, of the ISA, or of any of the Standards, Recommended Practices, and Technical Reports that ISA develops.

CAUTION—ISA ADHERES TO THE POLICY OF THE AMERICAN NATIONAL STANDARDS INSTITUTE WITH REGARD TO PATENTS. IF ISA IS INFORMED OF AN EXISTING PATENT THAT IS REQUIRED FOR USE OF THE RECOMMENDED PRACTICE, IT WILL REQUIRE THE OWNER OF THE PATENT TO EITHER GRANT A ROYALTY-FREE LICENSE FOR USE OF THE PATENT BY USERS COMPLYING WITH THE RECOMMENDED PRACTICE OR A LICENSE ON REASONABLE TERMS AND CONDITIONS THAT ARE FREE FROM UNFAIR DISCRIMINATION.

EVEN IF ISA IS UNAWARE OF ANY PATENT COVERING THIS RECOMMENDED PRACTICE, THE USER IS CAUTIONED THAT IMPLEMENTATION OF THE RECOMMENDED PRACTICE MAY REQUIRE USE OF TECHNIQUES, PROCESSES, OR MATERIALS COVERED BY PATENT RIGHTS. ISA TAKES NO POSITION ON THE EXISTENCE OR VALIDITY OF ANY PATENT RIGHTS THAT MAY BE INVOLVED IN IMPLEMENTING THE RECOMMENDED PRACTICE. ISA IS NOT RESPONSIBLE FOR IDENTIFYING ALL PATENTS THAT MAY REQUIRE A

LICENSE BEFORE IMPLEMENTATION OF THE RECOMMENDED PRACTICE OR FOR INVESTIGATING THE VALIDITY OR SCOPE OF ANY PATENTS BROUGHT TO ITS ATTENTION. THE USER SHOULD CAREFULLY INVESTIGATE RELEVANT PATENTS BEFORE USING THE RECOMMENDED PRACTICE FOR THE USER'S INTENDED APPLICATION.

HOWEVER, ISA ASKS THAT ANYONE REVIEWING THIS RECOMMENDED PRACTICE WHO IS AWARE OF ANY PATENTS THAT MAY IMPACT IMPLEMENTATION OF THE RECOMMENDED PRACTICE NOTIFY THE ISA STANDARDS AND PRACTICES DEPARTMENT OF THE PATENT AND ITS OWNER.

THE USER'S ATTENTION IS CALLED TO THE POSSIBILITY THAT COMPLIANCE WITH THIS RECOMMENDED PRACTICE MAY REQUIRE USE OF AN INVENTION COVERED BY PATENT RIGHTS. BY PUBLICATION OF THIS RECOMMENDED PRACTICE, NO POSITION IS TAKEN WITH RESPECT TO THE VALIDITY OF THIS CLAIM OR OF ANY PATENT RIGHTS IN CONNECTION THEREWITH. THE PATENT HOLDER HAS, HOWEVER, FILED A STATEMENT OF WILLINGNESS TO GRANT A LICENSE UNDER THESE RIGHTS ON REASONABLE AND NONDISCRIMINATORY TERMS AND CONDITIONS TO APPLICANTS DESIRING TO OBTAIN SUCH A LICENSE. DETAILS MAY BE OBTAINED FROM ISA.

The following people served as members of ISA Committee SP92:

NAME	COMPANY
J. Thomason, Chairman	OMNI Industrial Systems, Inc.
D. Bishop, Managing Director	Chevron Production Technology
W. Alexander	Mine Safety Appliances Company
D. Alpha	Detcon, Inc.
K. Burden	Sensidyne, Inc.
J. Chang	Motorola SPS
M. Coppler	AMETEK
T. Donkin	Enmet Corporation
C. Groppetti	Detector Electronics Corporation
B. Henderson	Chevron USA, Inc.
S. Hildebrand	Exxon Company USA
B. Holcom	Gas Tech, Inc.
K. Johnson	KWJ Engineering, Inc.
A. Maynard	Crowcon Detection Instruments, Inc.
R. Mease	City of St. Johns
* F. McGowan	Factory Mutual Research Corporation
D. Mohla	Union Carbide Chemicals & Plastics
G. Naujoks	Keithley Instruments
* B. Northam	Munro Electronics
R. Novack	Ametek, Inc.
M. Schaeffer	Control Instruments Corporation
W. Shao	Canadian Standards Association
A. Spataru	The Adept Group, Inc.
M. Stryker	NCASI

P. Stupay
D. Wagner
R. Warburton

Keithley Instruments
Industrial Scientific Corporation
Industrial Scientific Corporation

* One vote per company

This Recommended Practice was approved for publication by the ISA Standards and Practices Board on April 15, 1998.

NAME

R. Webb, Vice President
H. Baumann
D. Bishop
P. Brett
W. Calder III
M. Cohen
H. Dammeyer
W. Holland
H. Hopkins
A. Iverson
K. Lindner
V. Maggioli
T. McAvinew
A. McCauley, Jr.
G. McFarland
E. Montgomery
D. Rapley
R. Reimer
J. Rennie
W. Weidman
J. Weiss
J. Whetstone
M. Widmeyer
H. Wiegler
C. Williams
G. Wood
M. Zielinski

COMPANY

Altran Corporation
H. D. Baumann, Inc.
Chevron Production Technology
Honeywell Inc.
Calder Enterprises
Senior Flexonics Inc.
Ohio State University
Southern Company
(Retired)
Ivy Optiks
Endress + Hauser GmbH
Feltronics Corporation
Instrumentation and Control Engineering LLC
Chagrin Valley Controls, Inc.
Honeywell Inc.
Fluor Daniel, Inc.
VECO Rapley, Inc.
Rockwell Automation
Factory Mutual Research Corporation
Parsons Energy and Chemical Group
Electric Power Research Institute
National Institute of Standards & Technology
Carnegie-Mellon University
Canus Corporation
Eastman Kodak Company
Graeme Wood Consulting
Fisher-Rosemount Systems Inc.

Contents

1 Purpose.....	9
2 Scope	9
3 General requirements.....	9
4 Unpacking.....	10
5 Storage.....	10
6 User record keeping	11
7 Maintenance	11
8 Preparing instruments for use.....	11
9 Installation of stationary instruments.....	12
9.1 Installation in hazardous (classified) locations	12
9.2 Detector head locations	12
10 Equipment checkout procedures.....	14
10.1 Portable instruments	14
10.2 Stationary instruments	14
11 General considerations	15
11.1 General.....	15
11.2 Atypical mixtures	16
11.3 Desensitizing agents	17
11.4 Entering atmospheres potentially containing toxic gases.....	17
11.5 Use of appropriate accessories.....	17
11.6 Electromagnetic interference (EMI).....	18
11.7 Maintenance schedule	18
12 Operational checks.....	18
13 Maintenance procedures.....	19
13.1 General	19
13.2 Preliminary checkout.....	19
13.3 Detector head.....	20
13.4 Flow system	21
13.5 Readout devices	21
13.6 Alarms	21
13.7 Calibration test	22

14 External power supply systems	23
14.1 General	23
14.2 AC supplies	23
14.3 DC supplies.....	23
Annex A—Environmental and application checklist for toxic gas detectors (typical) (Informative)	25
Annex B—Instrument maintenance record for toxic gas detectors (typical) (Informative)	27
Annex C—Reference publications (Informative)	29

1 Purpose

ISA-RP92.0.02, Part II, establishes user criteria for the installation, operation, and maintenance of toxic gas detection instruments.

Its companion standard, ISA-S92.0.01, Part I, "Performance Requirements for Toxic Gas Detection Instruments," has been prepared to provide minimum requirements for the performance of toxic gas detection instruments.

2 Scope

2.1 This recommended practice applies to all toxic gas detection instruments that satisfy the performance requirements in ISA-S92.0.01, Part I.

2.2 Refer to Clause 3 of ANSI/ISA-S92.0.01, Part I, for definitions of terms as used herein.

2.3 References useful in the installation, operation, and maintenance of toxic gas detection instruments are listed in Annex C. These references are not considered to be part of this document except for those specific sections of documents referenced elsewhere in this Recommended Practice.

3 General requirements

To assure that the instrument is suitable for the application and is compatible with its operating environment:

- a) the user should provide the potential supplier with detailed information on the conditions that exist in the area(s) in which the instrument is to be used;
- b) the instrument must meet the requirements of the applicable regulating agency having jurisdiction; and
- c) the instrument must be compatible with the environmental conditions, e.g., relative humidity, temperature, atmospheric contaminants, etc., in which the instrument is to operate. A typical "Environmental and Application Checklist" is included as Annex A and is intended to aid users in properly specifying requirements for their specific applications.

4 Unpacking

4.1 Unpack the shipping carton(s) and determine whether the order is complete "as received." Check for main assembly, accessories, spare parts, and instruction manual. Understanding the manufacturer's instruction manual is of vital importance to the future operation and maintenance of the toxic gas detection instrument.

4.2 In the event of shipment damage, or for purposes of future correspondence, record the following:

- a) user's purchase order number and manufacturer's order number, and their respective dates;
- b) carrier waybill number and date received in case of transit claim; and
- c) instrument serial number and user identification (ID) number, if assigned.

5 Storage

5.1 When storing toxic gas detection instruments, leave them in their original containers or provide suitable protective covers.

5.2 Select a location that is in accordance with the manufacturer's recommendations. Store toxic gas detection instruments where environmental conditions (temperature, humidity, etc.) are within the manufacturer's storage specifications.

5.3 Before storage, inspect the instruments and remove any internal batteries that could cause corrosion. If the instruments have rechargeable or "permanent" batteries, consult the manufacturer's instructions for battery maintenance during this period.

5.4 Prepare toxic gas detection instruments for long-term storage per the manufacturer's instruction manual.

6 User record keeping

It is recommended that the user:

- a) assign an equipment identification (control) number to each instrument; and

- b) maintain complete records including periodic performance, calibration, and maintenance checks (see Annex B).

7 Maintenance

7.1 To maintain the reliability of toxic gas detection instruments, it is recommended that the user assign responsibility for their initial inspection and subsequent use, including maintenance, to a specific qualified individual or group.

7.2 It is important that the Checkout Procedures (refer to Clause 10) be performed by qualified personnel trained in the operation, maintenance, and repair of toxic gas detection instruments, and that the personnel responsible for maintenance be defined clearly.

7.3 The user should establish responsibility for obtaining the gas mixture recommended by the instrument manufacturer for calibrating and testing.

7.4 It is recommended that when instruments are first put into use, the calibration be checked on a routine basis as prescribed by the manufacturer, but at least monthly. If experience shows minimal calibration deviation, then the period between calibration checks may be extended. Likewise, if routine checks indicate an increasing need for calibration, the period should be shortened, and the cause should be investigated and the manufacturer consulted.

8 Preparing instruments for use

8.1 Read and understand the manufacturer-provided instruction manual. Particular attention should be paid to the locations and functions of all controls and readout devices.

8.2 A calibration test of the type described in 13.7 is recommended before the initial use of any toxic gas detection instrument.

9 Installation of stationary instruments

It is extremely important that the equipment manufacturer-provided instruction manual be read thoroughly and followed completely.