
**Glass in building — Glass products for
structural sealant glazing —**

**Part 1:
Supported and unsupported monolithic
and multiple glazing**

*Verre dans la construction — Produits verriers pour vitrage extérieur
collé —*

*Partie 1: Vitrages monolithiques ou multiples, supportés ou non
supportés*



Reference number
ISO 28278-1:2011(E)

AVA Documents
Document Sharing Hub
© ISO 2011



COPYRIGHT PROTECTED DOCUMENT

© ISO 2011

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either ISO at the address below or ISO's member body in the country of the requester.

ISO copyright office
Case postale 56 • CH-1211 Geneva 20
Tel. + 41 22 749 01 11
Fax + 41 22 749 09 47
E-mail copyright@iso.org
Web www.iso.org

Published in Switzerland

Contents

Page

Foreword	iv
1 Scope	1
2 Normative references	1
3 Terms and definitions	2
4 Symbols and abbreviated terms	6
5 Principle	8
6 Required characteristics of glass products	10
6.1 Appropriate glass products	10
6.2 Dimensional tolerances	11
6.3 Glass shapes	12
6.4 Corners, notches and holes	12
7 Verification of the suitability of glass products for use in SSG systems when exposed to ultra-violet (UV) radiation.....	13
7.1 General	13
7.2 Insulating glass unit (IGU)	13
7.3 Laminated glass or monolithic glass — Situation 3 (see Figure 3)	15
7.4 Assessment of the adhesion between the sealant and the glass	15
8 Design.....	16
8.1 Calculation of the thickness of the glass.....	16
8.2 Calculation of the height of the outer sealant of the IGU for supported and unsupported glazing	16
8.3 Calculation of the height of the outer sealant of the IGU for unsupported glazing	20
Annex A (informative) Assembly requirement.....	21
Annex B (normative) Structural and/or ultra-violet (UV) -resistant sealant (for use with structural sealant glazing and/or IGUs with exposed seals)	26
Annex C (normative) Evaluation of tests results.....	42
Annex D (normative) Shear at 23 °C — Test method	46
Annex E (normative) Factory production control (FPC) requirements for sealants.....	48
Annex F (normative) Outer seal of an IGU — Category differentiation.....	53
Annex G (normative) Formation of bubbles.....	56
Annex H (informative) Sealing, structural bonding and UV resistance schematic illustrations	57
Annex I (normative) Initial testing of the bonding of sealant to a non-glass substrate	60
Bibliography.....	62

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

International Standards are drafted in accordance with the rules given in the ISO/IEC Directives, Part 2.

The main task of technical committees is to prepare International Standards. Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

Attention is drawn to the possibility that some of the elements of this document may be the subject of patent rights. ISO shall not be held responsible for identifying any or all such patent rights.

ISO 28728-1 was prepared by Technical Committee ISO/TC 160, *Glass in building*, Subcommittee SC 2, *Use considerations*.

ISO 28728 consists of the following parts, under the general title *Glass in building — Glass products for structural sealant glazing*:

- *Part 1: Supported and unsupported monolithic and multiple glazing*
- *Part 2: Assembly rules*

Glass in building — Glass products for structural sealant glazing —

Part 1: Supported and unsupported monolithic and multiple glazing

1 Scope

This part of ISO 28728 specifies requirements for the suitability of supported and unsupported glass products (see Figure 1) for use in the structural sealant glazing (SSG) technique. Regarding glass products, this part of ISO 28728 constitutes a supplement to the requirements specified in the corresponding ISO standards with regard to verifying suitability for use in SSG systems.

Only soda lime silicate glass is taken into consideration in this part of ISO 28728.

The glass products are installed and bonded into the support under controlled environmental conditions, as described in ISO 28728-2.

Plastic glazing is excluded from the scope of this part of ISO 28728.

The structural, weatherproofing and sealant and outer seal of insulating glass unit (IGU) products, which are commonly used in structural glazing applications, are those based on organo-siloxane, “silicone” polymers, and recommended for use by the sealant manufacturer. Where there is a risk of earthquake, the sealant design may not be sufficient to resist the loads, and complementary arrangements may be necessary.

This part of ISO 28728 does not preclude the use of other sealant types where these can demonstrate suitability for service according to this part of ISO 28728 and when used following the recommendations of the sealant manufacturer.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO 527-3:1995, *Plastics — Determination of tensile properties — Part 3: Test conditions for films and sheets*

ISO 868:2003, *Plastics and ebonite — Determination of indentation hardness by means of a durometer (Shore hardness)*

ISO 1183-1:2004, *Plastics — Methods for determining the density of non-cellular plastics — Part 1: Immersion method, liquid pycnometer method and titration method*

ISO 3231:1993, *Paints and varnishes — Determination of resistance to humid atmospheres containing sulfur dioxide*

ISO 7389, *Building construction — Jointing products — Determination of elastic recovery of sealants*

ISO 9227:2006, *Corrosion tests in artificial atmospheres — Salt spray tests*

ISO 10563:2005, *Building construction — Sealants — Determination of change in mass and volume*

ISO 11358-2, *Plastics — Thermogravimetry (TG) of polymers — Part 2: Determination of activation energy*

ISO 11600, *Building construction — Jointing products — Classification and requirements for sealants*

ISO 12543 (all parts), *Glass in building — Laminated glass and laminated safety glass*

ISO 16269-6, *Statistical interpretation of data — Part 6: Determination of statistical tolerance intervals*

ISO 20492 (all parts), *Glass in buildings — Insulating glass*

ISO 28278-2:2010, *Glass in building — Glass products for structural sealant glazing — Part 2: Assembly rules*

ASTM C 1184:2000, *Standard Specification for Structural Silicone Sealants*

ASTM C 1265:2005, *Standard Test Method for Determining the Tensile Properties of an Insulating Glass Edge Seal for Structural Glazing Applications*

3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

NOTE Figure 1 is included only as an aid to explaining the terminology used in this International Standard. The components indicated in broken and dotted lines are covered by other technical specifications such as ETAG 002 or standards concerned with curtain wall façades.

3.1 structural sealant glazing SSG

assembly in which glass products are fixed to the structural seal frame by means of a sealant that has been shown to be capable of withstanding the load actions applied to the glass products of the structural seal frame

3.2 anchorage

anchorage of the structural seal support frame on the framework

NOTE See (1) in Figure 1.

3.3 backer rod

pre-formed continuous strip that limits the section and height of a fillet of weather sealant

NOTE See (2) in Figure 1.

3.4 hermetic seal bite


dimension of the second barrier of the hermetic seal measured parallel to the glass unit at the panel level

NOTE See (3) in Figure 1.

3.5 façade framework

members to which the structural seal support frame is connected and which transmit the loads to the building

NOTE See (4) in Figure 1.

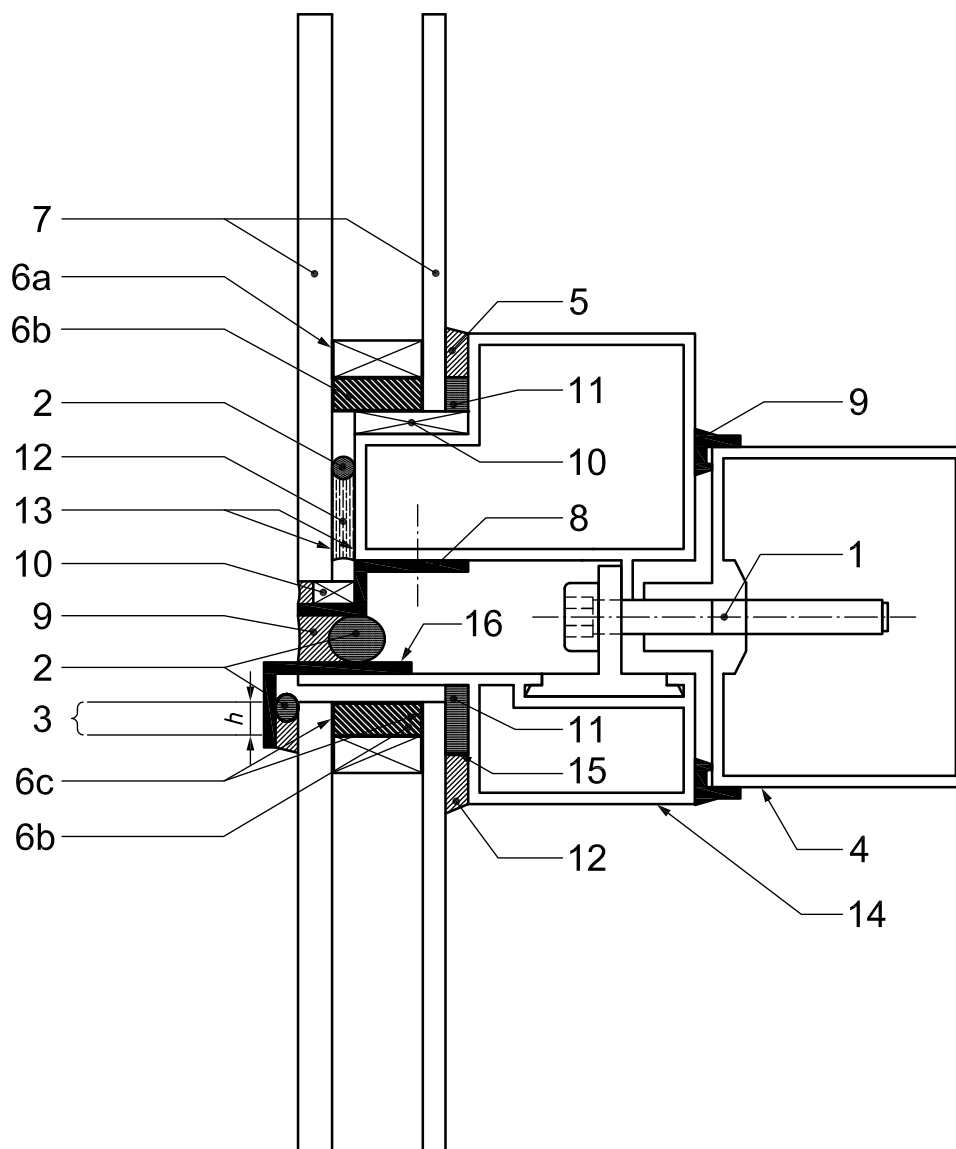

Key

- | | | | |
|----|-----------------------------|----|----------------------------------|
| 1 | anchorage | 8 | self-weight mechanical support |
| 2 | backer rod | 9 | weather seal |
| 3 | height of the outer seal | 10 | setting blocks |
| 4 | façade framework | 11 | adhesive spacer |
| 5 | finishing material | 12 | structural seal |
| 6 | hermetic seal | 13 | structural seal adhesion surface |
| 6a | (inner seal) | 14 | structural seal support frame |
| 6b | (outer seal) | 15 | anti-adhesive film |
| 6c | outer seal adhesion surface | 16 | retaining device |
| 7 | glass unit | | |

Figure 1 — Terminology

3.6
finishing material
elastomeric sealant extruded into the joint, of sufficient cross-section as to constitute a barrier to air and water when cured, or a pre-extruded gasket with a fin of sufficient cross-section

NOTE See (5) in Figure 1 and (4) in Figure 3.

3.7
outer seal
sealant intended to ensure a hermetic seal, providing a barrier to water and vapour penetration, and light, around the edge of an insulating unit whilst remaining compliant with displacements caused by wind or other loads

NOTE 1 The hermetic seal is called “structural” (see 3.14) when it also has the supplementary function of adequately transmitting to the seal support frame the forces applied to the glass.

NOTE 2 See (6b) in Figure 1 and (3) in Figure 3.

3.8
glass unit
element consisting of a single glass pane (monolithic or laminated) or an insulating glass unit (IGU) specified for use in SSG

NOTE 1 The IGU may be one of two types: a unit with aligned edges for which the two panes have the same nominal dimensions, or a unit with stepped edges for which the two panes have different dimensions.

NOTE 2 See Figure 2 and (7) in Figure 1.

3.9
insulating glass unit
IGU
pre-assembled unit comprising panes of glass that are sealed at the edges and separated by dehydrated space(s), intended for use in buildings

3.10
self-weight mechanical support
element situated beneath the bottom edge of the glass unit that transmits the weight of the latter to the structural seal support frame

NOTE See (8) in Figure 1.

3.11
weather seal
fillet of sealant or weather fin of adequate cross-section constituting a barrier to air and water

NOTE See (9) in Figure 1.

3.12
setting blocks
bearing elements situated between the self-weight mechanical support and the bottom edge of a glass unit used to position the glass unit in the structural seal support frame and to avoid a permanent shear load

NOTE See (10) in Figure 1.

3.13
adhesive spacer
continuous pre-formed strip defining the cross-section of the fillet of sealant and used to align the glass relative to the structural seal support frame

NOTE See (11) in Figure 1.

3.14**structural seal**

joint of elastic structural sealant extruded between glass element or glass and framework which is, when cured, of adequate transverse cross-section as to transfer appropriate forces applied on the glass to the structural seal support frame

NOTE See (12) in Figure 1 and (5) in Figure 3.

3.15**structural seal adhesion surface**

continuous surface of the glass or structural seal support frame to which the structural sealant bonds

NOTE See (13) in Figure 1 and (6) in Figure 3.

3.16**structural seal support frame**

metallic element to which the glass product is bonded

NOTE See (14) in Figure 1.

3.17**anti-adhesive film**

film at the interface between two materials, used to prevent them bonding together

NOTE See (15) in Figure 1.

3.18**retaining device**

piece intended to hold the glass product in place and therefore reduce any danger that may result in the event of a structural seal failure

NOTE See (16) in Figure 1.

3.19**cohesive failure****cohesive rupture**

rupture in a body of the sealant

3.20**adhesive failure****adhesive rupture**

rupture at the interface between the sealant and the substrate

3.21**initial cure**

stage in the curing where the sealant has appropriate cohesive strength to resist different levels of action

3.22**creep factor**

shear design stress under permanent static load

3.23**initial type testing**

determination of the performance of a product (characteristics, durability), on the basis of either actual tests or other procedures

NOTE Other procedures include conventional, standardized, tabulated or generally accepted values, standardized or recognized calculation methods, and test reports when made available, in accordance with this International Standard.

3.24

test report

document that covers the results of tests undertaken on a representative sample of the product from production or on a prototype design of the product

3.25

product description

document that details the relevant parameters for defining a product that complies with its relevant standard

NOTE It includes specific reference(s) to characteristics that are modified by the production process and by raw materials.

3.26

significant change


variation in performance beyond the permitted tolerance for the characteristic

4 Symbols

a	length of the smaller dimension of the glass	m
A_g	glass area	m ²
b	breadth of IGU air space	mm
b_w	width of the bead	mm
c	height of sealant necessary for structural purposes: $c = (0,5p \cdot a) / (\sigma \beta)$	mm
e_i	initial glass thickness per test piece for L_o	mm
E_o	modulus (tangent or secant)	kPa
F	relevant combined load for wind, snow and self-weight	Pa
F_s	shear force	Pa
$F_{t,i}$	tensile loading	Pa
F_{mean}	average breaking force	Pa
h	height of structural sealant	mm
h_o	height of sealant as specified in ISO 20492-2	mm
h_u	height of the outer seal of the unsupported IGU	mm
K_o	tangent stiffness at the origin	kPa
K_{sec}	rigidity modulus/secant stiffness	kPa
K_x	stiffness of the sample at x % elongation in the initial state	kPa
K_y	stiffness of the sample at y % elongation after conditioning	kPa
L	length of the loaded test piece	mm
L_o	initial length of the test piece	mm
l_s	vertical length of the outer seal	mm
l_b	length of the bead	mm
m	number of observations per test piece	—
n	number of test pieces per test for the temperature concerned	—
p	relevant combined load of the wind, snow, climatic effects and self-weight	kPa
P_u	weight of the unsupported IGU	kPa

R_{des}	design resistance	kPa
$R_{u,5}$	characteristic force giving 75 % confidence that 95 % of the test results will be higher than this	kPa
r	distance between structural seal and glass edge	mm
r_o	step between both glass components	mm
s	standard deviation of the series	—
s_{min}	minimum dimension of glass	m
s_{max}	maximum dimension of glass	m
t_1	minimum glass thickness of the outermost component of an IGU	mm
t_2	minimum glass thickness of the innermost component of an IGU	mm
t	time	—
u_c	displacement under compression	mm
u_{ij}	displacement under tension or compression	mm
w	width of structural sealant	mm
X	breaking stress	kPa
X_i	value of the breaking stress of test piece i , either under tension or shear	kPa
$\bar{x}$	average breaking stress, either under tension or shear	kPa
$\bar{x}_o$	average breaking stress, either under tension or shear, in the initial state	kPa
$\bar{x}_c$	average breaking stress, either under tension or shear, after conditioning or ageing	kPa
$\bar{x}_{\text{tear}}$	average tear breaking strength	kPa
ΔH	maximum difference in altitude between production transport and assembly at site	m
σ	allowable stress of the sealant	MPa
β	coefficient depending on relative thickness of insulating glass panes	—
τ	shear stress	kPa
$\tau_{\alpha\beta}$	eccentricity of 5 % with 75 % confidence	—
Γ_{∞}	shear design stress value declared by the sealant manufacturer	kPa
Γ_{des}	shear design stress under dynamic load	kPa
σ_{des}	design stress	kPa
σ_{ij}	tensile stress at the tensile displacement u_{ij}	kPa
γ_c	safety factor	—


5 Principle

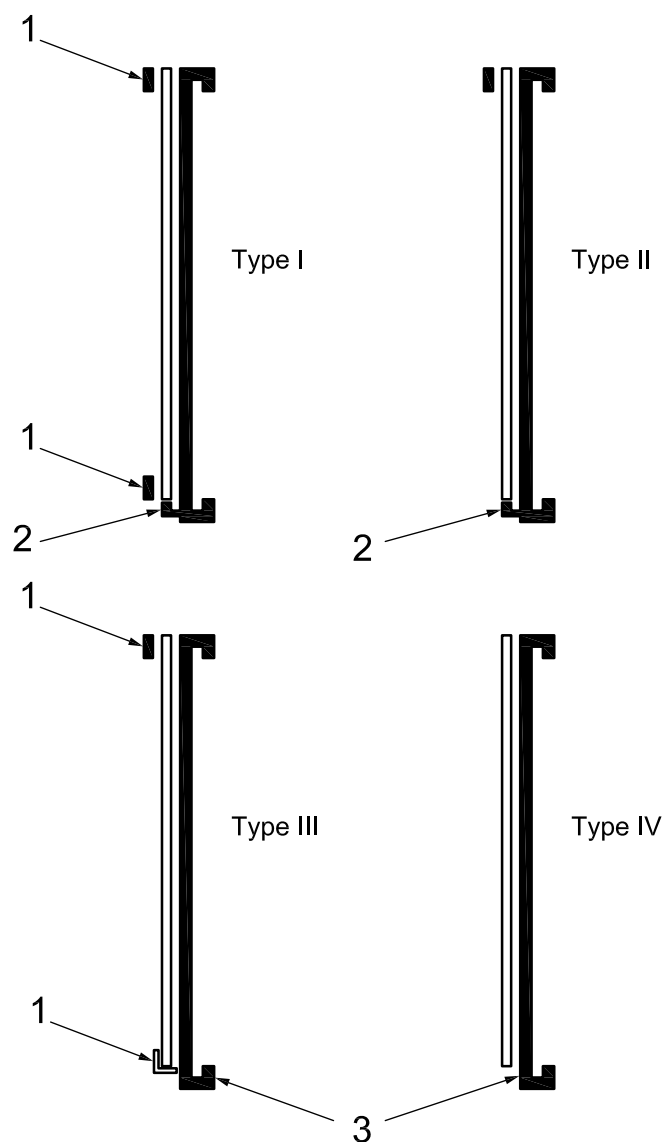

Key

- 1 retaining device
- 2 mechanical self-weight support
- 3 structural sealant support frame

Figure 2 — Schematic examples of the different types of SSG system

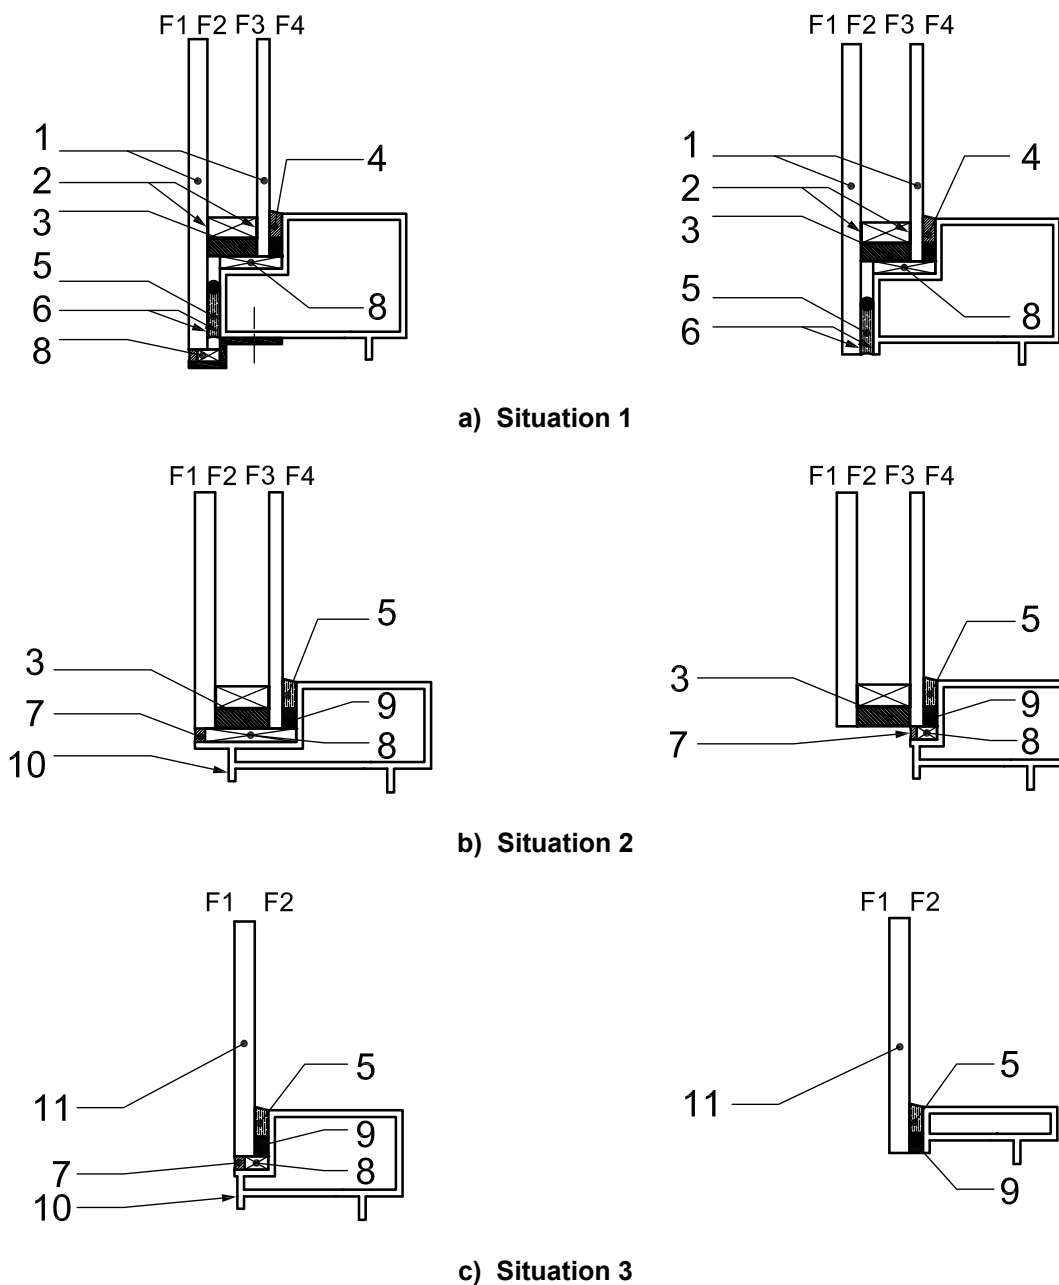**Key**

- | | |
|------------------------------------|----------------------------------|
| 1 insulating glass unit | 9 adhesive spacer |
| 2 inner seal | 10 structural seal support frame |
| 3 outer seal | 11 laminated or monolithic glass |
| 4 finishing material | F1 face 1 |
| 5 structural seal | F2 face 2 |
| 6 structural seal adhesion surface | F3 face 3 |
| 7 weather seal | F4 face 4 |
| 8 setting block | |

NOTE The section drawings above are examples of structural sealant glazing system types II and IV.

Figure 3 — Principle

SITUATION 1

The SSG seal is applied on face 2 of the insulating glass unit (IGU). The outer IGU sealant has no structural function and therefore only contributes to the resistance of the unit against the ingress of water (vapour and liquid), and air. Depending on the type and construction of the IGU sealant, any leakage of gas from the unit will be minimised. The SSG seal must have good adhesion to the glass and steel surfaces to withstand the mechanical stresses that result from the exposure of the IGU to the climatic elements and in particular the effects of solar radiation.

SITUATION 2

The SSG seal is applied on face 4 of the IGU. The outer IGU sealant has a structural function as well as having to maintain the integrity and performance of the IGU. Any stress or loads applied to the outer glass will be transferred to the IGU sealant.

SITUATION 3

The SSG seal is applied on face 2 of the laminated or monolithic glass unit. The sealant has a structural function and any loads applied to the glass will be transferred to it.

6 Required characteristics of glass products

6.1 Appropriate glass products

This part of ISO 28278 only allows the use of the following glass products.

6.1.1 Float glass

Until an ISO standard is published, the following standards may apply:

- EN 572-2;
- JIS R 3202;
- ASTM C 1036.

6.1.2 Polished wired glass

Until an ISO standard is published, the following standards may apply:

- EN 572-3;
- JIS R 3204.

6.1.3 Drawn sheet glass

Until an ISO standard is published, the following standard may apply:

- EN 572-4.

6.1.4 Patterned glass

Until an ISO standard is published, the following standards may apply:

- EN 572-5;
- JIS R 3203.

6.1.5 Coated glass

The following standards may apply:

- EN 1096;
- ASTM C 1376;
- JIS R 3221.

6.1.6 IGU

Until ISO 20492 (all parts) is published, the following standards may apply:

- EN 1279;
- ASTM E 2190;
- ASTM C 1249;
- JIS R 3209.

6.1.7 Heat strengthened soda lime silicate glass

The following standards may apply:

- EN 1863;
- ASTM C 1048;
- JIS R 3222.

6.1.8 Thermally toughened soda lime silicate safety glass

The following standards may apply:

- EN 12150;
- ASTM C 1048;
- JIS R 3206.

6.1.9 Heat soak tested thermally toughened soda lime silicate safety glass

The following standard may apply:

- EN 14179.

6.1.10 Laminated glass and laminated safety glass

The following standard may apply:

ISO 12543 (all parts).

6.2 Dimensional tolerances

The tolerances for the different glass products can be found in the appropriate glass standards listed in 6.1.

6.2.1 Glass shapes — Curved glass

Curved glass shall be considered to be flat for the purposes of calculating the products of the IGU seals and glass thickness if the height of the glass at the centre of curve is $\leq 1/100$ of the length of the curved side.

6.3 Corners, notches and holes

For annealed glass, corners [Figure 4 a)], notches [Figure 4 b)] and holes [Figure 4 c)] for annealed glass are not considered in this part of ISO 28278.

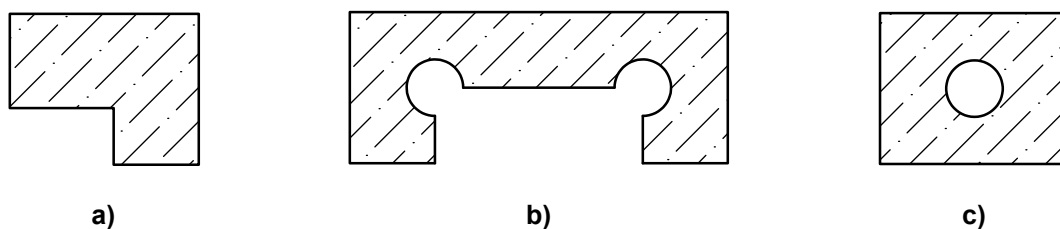


Figure 4 — Corner, notch and hole

For toughened and heat strengthened glass, corners [Figure 4 a)], notches [Figure 4 b)] and holes [Figure 4 c)] are described in the following standards:

- EN 1863;
- EN 12150;
- EN 14179.

In the case of IGUs, any angles cut in the glass forming the corner of the IGU shall not be less than 15° (Figure 5).

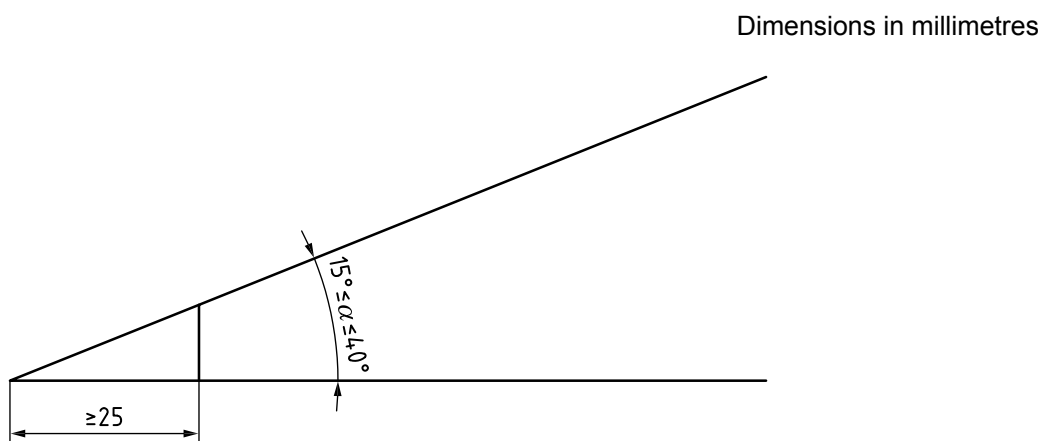


Figure 5 — Angle of IGUs

7 Verification of the suitability of glass products for use in SSG systems when exposed to ultraviolet (UV) radiation

7.1 General

The conformance of the glass product is determined by its capacity to resist the stresses specified in this clause and by fulfilling the requirements regarding mechanical resistance and stability, reaction and resistance to fire, hygiene, health, environment, safety, protection against noise, energy economy and heat retention, and durability as a function of the situation and of the type of glass (see Scope).

7.2 IGU

ASTM C 1401-02, 22.5 may apply.

7.2.1 Situation 1 (see Figure 3)

In Situation 1 the outer seal of the IGU has no structural seal function.

Regarding the IGU itself:

Suitability for use of the IGU is determined in accordance with ISO 20492 (all parts). However, the requirements of ISO 20492-4 should be amended as follows.

Outer seal:

a) The assessment tests of ISO 20492-4 should be amended as follows:

- 1) Exposure to heat: test conditions of ISO 20492-4 should be replaced by those in B.2.3.3, class T3 –100 °C.
- 2) Exposure to UV: test conditions of ISO 20492-4 should be replaced by the Exposure to UV test and specifications as defined in Annex F and B.2.7 of this part of ISO 28278.

or

b) The test methods and specifications of B.2.2, B.2.3 and B.2.4 of this part of ISO 28278 are applicable.

or

c) A structural sealant as defined in ISO 28278-2 can be used for the outer seal of the IGU in Situation 1, Figure 3.

The test report of ISO 20492 should be amended accordingly.

7.2.2 Situation 2 (see Figure 3)

The outer seal of the IGU has a structural function and shall satisfy the following:

- a) Suitability for use of the IGU is determined in accordance with ISO 20492.
- b) The outer seal of the IGU shall satisfy the test methods and specifications of B.2.2, B.2.3 and B.2.4 of this International Standard.
- c) The test report in ISO 20492-4, D.6 should be amended accordingly.

EN 1279-4, D.6 may apply.

7.2.3 Coated glass

7.2.3.1 Adhesion of coatings to glass surfaces and adhesion of coatings to interlayer used for laminated glass products

The adhesion of coatings to glass surfaces and adhesion of coatings to the interlayer used for laminating glass products should be performed in conformity with Annex D of ISO 20492-4:2010. In the case of the outer seal, it should be amended as follows:

7.2.3.1.1 Bonding — Outer seal without structural function

Assessment tests in conformity with Annex D and Clause 6 of ISO 20492-4 shall be carried out but amended as follows:

- a) Heat exposure test, 5.1.3.2 of ISO 20492-4 performed in conformity with B.2.3.3, class T3 –100 °C.
 - 1) UV exposure test, 5.1.3.4 of ISO 20492-4 performed in conformity with B.2.7.
 - 2) The test report referred to in ISO 20492-4, D.6 should be amended accordingly.
- or
- b) The tests methods and specifications of B.2.2, B.2.3 and B.2.4 of this International Standard are applicable.

The test report referred to in ISO 20492-4, D.6, should be amended accordingly.

EN 1279-4:2003, D.6 may apply.

7.2.3.1.2 Bonding — Outer seal with structural function

Assessment tests in conformity with B.2.2, B.2.3 (only apply if not performed on clear glass) and B.2.4 of this part of ISO 28728 shall be carried out.

Provided the structural sealant is specifically developed and recommended by the sealant manufacturer for use in this application, the test report referred to in ISO 20492-4:2010 should be amended accordingly.

Annex D of EN 1279-4 may also apply.

7.2.3.2 Substitution of the coated glass when the coating at the edge does not require removal

First, proceed in accordance with 5.2.3 of ISO 20492-4:2010, but then carry out assessment tests in accordance with Annex D and Clause 5 amended as follows:

- Heat exposure test, 5.1.3.2 of ISO 20492-4:2010 (5.1.3.2 of EN 1279-4:2003) performed in conformity with Annex B of this part of ISO 28728.
- UV exposure test, 5.1.3.4 of ISO 20492-4, performed in conformity with Annex B of this part of ISO 28728.

Subclauses 4.2.3 and 5.1.3.4 of EN 1279-4:2003 may also apply.

The rules of extrapolation in EN 1096-2, Annex F are also applicable.

7.2.4 Possibility of substituting the outer IGU seal

First, proceed in accordance with 5.2.2 of ISO 20492-4:2010.

Subclause 4.2.2 of EN 1279-4:2003 may also apply.

Then, produce a test report that takes into account the performance of the outer seal versus its functional requirements regarding UV resistance only or UV resistance and/or structural function in conformity with B.2.2, B.2.3 and B.2.4 of this part of ISO 28728.

7.2.5 Further requirements for the outer IGU seal when in an unsupported case

In addition to the requirements specified in 7.2.1 to 7.2.4, the outer seal shall meet the following supplementary requirement:

- the mechanical properties of the outer seal shall comply with the specification corresponding to Creep Grade C1 of B.2.3.8 of this part of ISO 28728 (Displacement under permanent load).

7.2.6 Case for a façade glazed between 0° and 30° from the vertical (towards the outside) and between 0° and 7° from the horizontal

The requirements described in 7.2.5 are applicable.

7.3 Laminated glass or monolithic glass — Situation 3 (see Figure 3)

The monolithic glass shall comply with 6.1.1.

The laminated glass or laminated safety glass shall comply with the definition of laminated glass or laminated safety glass according to 6.1.10.

Each component of the laminated glass shall be supported.

7.4 Assessment of the adhesion between the sealant and the glass

7.4.1 Float glass

When the tests according to B.2.3 and B.2.4 required by this part of ISO 28728 are performed on float glass in accordance with 6.1.1, the adherence between glass and structural sealant can be extrapolated to the following glass types:

- heat strengthened soda lime silicate glass conforming with 6.1.7;
- thermally toughened soda lime silicate safety glass conforming with 6.1.8 or 6.1.9, except enamelled glass (see 7.4.3).

7.4.2 Coated glass

When tests according to B.2.3 and B.2.4 of this part of ISO 28728 are performed on one of the following glass substrates that have been coated, the adhesion between coated glass and structural sealant can be extrapolated for the rest of the glass substrates in this list:

- basic soda lime silicate glass products conforming with 6.1.1;
- heat strengthened soda lime silicate glass conforming with 6.1.7;
- thermally toughened soda lime silicate safety glass conforming with 6.1.8 or 6.1.9.

NOTE When the tests in B.2.3 and B.2.4 are performed on one identified coating, the test can apply to other coatings in accordance with Annex F of EN 1096-2.

7.4.3 Enamelled glass

When the tests according to B.2.3 and B.2.4 are performed for one delivery, the dynamic tensile/peel test on structural sealant in Annex A of ISO 28278-2:2010 is required in order to extrapolate the assessment of the adhesion to other deliveries.

NOTE See 22.4 Spandrel of ASTM C 1401-02.

7.4.4 Patterned glass

When the tests according to B.2.3 and B.2.4 are performed for one type of patterned glass, the dynamic tensile/peel test on structural sealant in Annex A of ISO 28278-2:2010 is required in order to extrapolate the assessment of the adhesion to other deliveries.

8 Design

8.1 Calculation of the thickness of the glass

The thickness of the glass is calculated in accordance with national regulations.

The glass product (thickness and types of glass components) shall ensure the resistance against wind, snow, permanent load, and other mechanical, (quasi-)static action.

The current method of determining mechanical resistance in the country of destination shall be applied, as long as no International Standard is applicable for the design of the construction or building site concerned.

8.2 Calculation of the height of the outer sealant of the IGU for supported and unsupported glazing

8.2.1 Supported IGU

8.2.1.1 Flush edge unit

The outer seal of the IGU has a structural function (see Figure 6).


The height, h , of the outer seal is given by Equation (1):

$$h = c \geq \frac{0,5 \cdot F \cdot s_{\min}}{\sigma \cdot \beta} \quad (1)$$

NOTE Minimum 6 mm.

where

- h is the height of the outer seal barrier (mm);
- c is the height of sealant necessary for structural purposes: $c = (0,5 p \cdot a) / (\sigma \cdot \beta)$ (mm);
- σ is the allowable stress of the sealant (MPa);
- β is the coefficient depending on the relative thickness of the components (Figure 7);
- $s_{\min}$ is minimum dimension of glass, (mm).

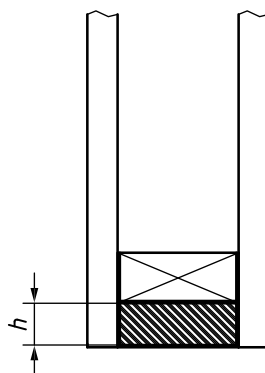**Key**

h height of the outer seal barrier (mm)

Figure 6 — Height of the outer seal of the IGU, with a structural function


P shall be determined, for the combined loading from wind, snow and self-weight, in accordance with national standards dealing with these actions.

In CEN-member countries, wind load shall be determined according to EN 1991-1-4, and snow load shall be determined according to EN 1991-1-3. In non-CEN-member countries, the national standard may apply.

For units whose diameter or short span is < 500 mm and those with non-rectangular shapes, the climatic effect shall be taken into account.

In the United States of America, ASTM E 1300 should be used to determine glass or fabricated glass product thicknesses (ASTM C 1401-02, 22.1).

For small units and non-rectangular shapes, the climatic effect shall be taken into account.

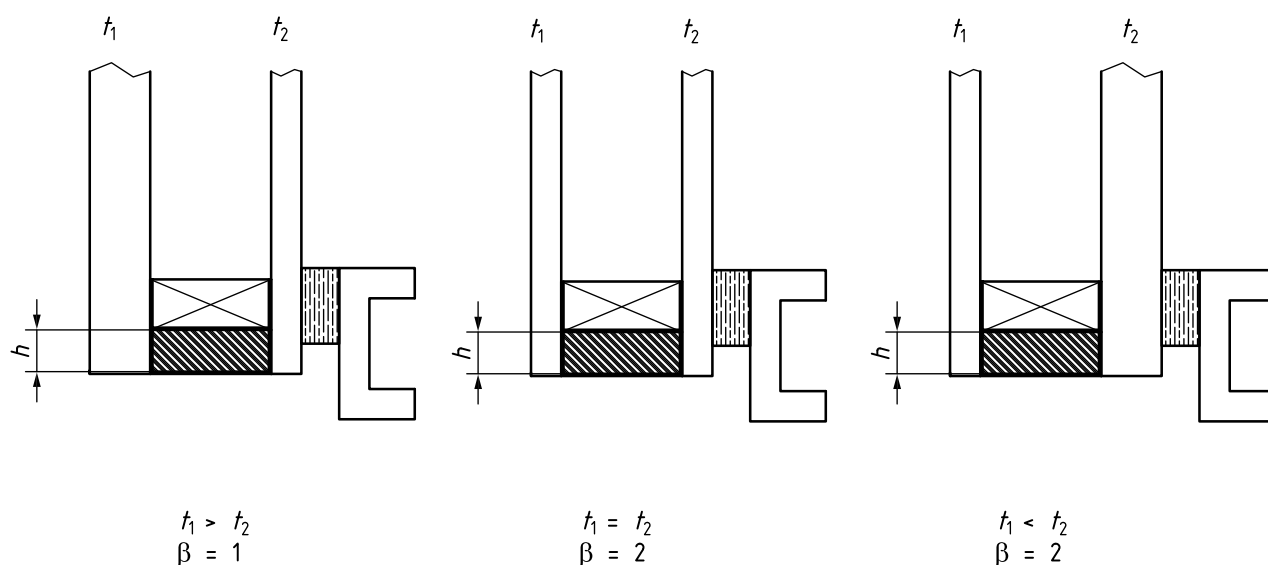**Key**

h height of the outer seal barrier (mm)

t_1 minimum glass thickness of the outermost component of an IGU (mm)

t_2 minimum glass thickness of the innermost component of an IGU (mm)

β coefficient depending on the relative thickness of the components (Figure 7)

NOTE β can be evaluated according the following document: Structural mechanics behaviour of insulating glass units, May 1986 by the Glass Research and Testing Laboratory.

Figure 7 — Coefficient β as a function of the relative thickness of the glass components