

INTERNATIONAL STANDARD

ISO
9826

First edition
1992-09-15

Measurement of liquid flow in open channels — Parshall and SANIIRI flumes

*Mesure de débit des liquides dans les canaux découverts — Canaux
jaugeurs Parshall et SANIIRI*



Reference number
ISO 9826:1992(E)
Documents
Document Sharing Hub

Foreword

ISO (the International Organization for Standardization) is a worldwide federation of national standards bodies (ISO member bodies). The work of preparing International Standards is normally carried out through ISO technical committees. Each member body interested in a subject for which a technical committee has been established has the right to be represented on that committee. International organizations, governmental and non-governmental, in liaison with ISO, also take part in the work. ISO collaborates closely with the International Electrotechnical Commission (IEC) on all matters of electrotechnical standardization.

Draft International Standards adopted by the technical committees are circulated to the member bodies for voting. Publication as an International Standard requires approval by at least 75 % of the member bodies casting a vote.

International Standard ISO 9826 was prepared by Technical Committee ISO/TC 113, *Measurement of liquid flow in open channels*, Sub-Committee SC 2, *Notches, weirs and flumes*.

© ISO 1992

All rights reserved. No part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from the publisher.

International Organization for Standardization
Case Postale 56 • CH-1211 Genève 20 • Switzerland

Printed in Switzerland

Measurement of liquid flow in open channels — Parshall and SANIIRI flumes

1 Scope

This International Standard specifies methods of liquid flow measurement in open channels (particularly in irrigation canals) under steady or slowly varying flow conditions, using Parshall and SANIIRI flumes.

These flumes are designed to operate under both free-flow and submergence conditions.

2 Normative reference

The following standard contains provisions which, through reference in this text, constitute provisions of this International Standard. At the time of publication, the edition indicated was valid. All standards are subject to revision, and parties to agreements based on this International Standard are encouraged to investigate the possibility of applying the most recent edition of the standard indicated below. Members of IEC and ISO maintain registers of currently valid International Standards.

ISO 772:1988, *Liquid flow measurement in open channels — Vocabulary and symbols*.

3 Definitions and symbols

For the purposes of this International Standard, the definitions and symbols given in ISO 772 and the following definitions apply.

3.1 Parshall flume: Measuring flume having a converging entrance section with a level floor, a short throat section with a floor inclined downwards at a gradient of 3:8, and a diverging exit section with a floor inclined upwards at a gradient of 1:6.

3.2 SANIIRI flume: Measuring flume with a converging entrance section having a level floor with a vertical drop at its downstream end and perpendicular walls to join it to the downstream channel.

4 Selection of flume type

4.1 The choice as to whether a Parshall or a SANIIRI flume should be used depends on several factors such as the range of discharge to be measured, the head available, the modular limit and the maximum submergence ratio, the channel or canal characteristics, the amount of head loss which can be allowed through the flume, the possibility of deepening the bed and providing a drop therein, the accuracy of measurement required, whether or not the flow carries sediment, the operating conditions that necessitate the use of either stationary or portable flumes, and economic considerations.

4.2 Parshall flumes have a rectangular cross-section and a wide range of throat widths varying from very small (0,025 4 m) to large (15 m and greater).

Medium-sized Parshall flumes, with throat widths between about 0,15 m and about 2,5m, which are suitable for measuring discharges in the range from 0,001 5 m³/s to 4,0 m³/s are those most commonly used for flow measurements; they are thus recommended in this International Standard as “standard structures”.

Large Parshall flumes with throat widths between about 3 m and about 15 m, the design of which varies depending on the size of the flume, are suitable for measuring discharges in the range from 0,75 m³/s to 93 m³/s.

One of the most desirable features of the Parshall flume is that it operates satisfactorily at high submergence ratios with low head loss, this makes it especially suitable for flow measurements in channels having small bed slopes. However, the complicated design of this flume (see figure 1) offsets somewhat the advantages that it offers.

4.3 SANIIRI flumes are rectangular in cross-section, level-floored and have an exit cross-sectional width between 0,3 m and 1,0 m. They are suitable for measuring discharges in the range from 0,03 m³/s and 2,0 m³/s.

SANIIRI flumes are simple in design and construction, with the exception that a small fall at the downstream end of the floor (see figure 3) of the flume has to be provided.

5 Installation

5.1 Selection of site

5.1.1 The flume shall be located in a straight section of the channel, avoiding local obstructions, and roughness or unevenness of the bed.

5.1.2 A preliminary study shall be made of the physical and hydraulic features of the proposed site, to check that it conforms (or may be constructed or modified to conform) with the requirements necessary for discharge measurement by the flume. Particular attention shall be paid to the following features in selecting the site:

- a) the adequacy of the length of channel of regular cross-section and slope available;
- b) the uniformity of the existing velocity distribution;
- c) the conditions downstream (including influences such as tides, control structures, etc.);
- d) the impermeability of the ground on which the structure is to be founded and the necessity for piling, grouting or other means of controlling seepage;
- e) the stability of the banks or side slopes of the channel, and the necessity for trimming and/or revetment;
- f) the necessity for flood banks, to confine the maximum discharge to the channel and the backwater caused by the installation of the flume;
- g) the effect of wind on the flow over the flume, especially when the flume is wide and the head is small and when the prevailing wind is in a direction transverse to the direction of flow;
- h) aquatic weed growth;

i) sediment transported by the flow.

5.1.3 If the site does not possess the characteristics necessary for satisfactory discharge measurements, it shall not be used unless suitable improvements are practicable.

5.2 Installation conditions

5.2.1 General requirements

The complete measuring installation consists of an approach channel, a flume structure and a downstream channel. The condition of each of these three components affects the overall accuracy of the measurements. In addition, features such as the surface finish of the flume, the cross-sectional shape of the channel and the channel roughness shall be taken into consideration.

5.2.2 Approach channel

5.2.2.1 The approach channel shall comply with the following requirements.

- a) It shall be straight and uniform and have a constant slope for a length equal to five to ten times the water surface width at maximum flow.
- b) The bed slope shall be such as to ensure sub-critical flow with a Froude number Fr of less than 0,5 (or 0,7), where:

$$Fr = \frac{Q_{\max}}{A\sqrt{gh_{\max}}}$$

where

$Q_{\max}$ is the maximum discharge;

A is the cross-sectional area of the channel;

$h_{\max}$ is the maximum water depth.

5.2.2.2 The flow conditions and the symmetry of the velocity distribution in the approach channel shall be checked by inspection and measurement using, for example, current-meters, floats, velocity rods or dye.

NOTE 1 A complete assessment of the velocity distribution may be made by using a current-meter.

5.2.3 Flume structure

5.2.3.1 The structure shall be rigid and watertight and capable of withstanding flood-flow conditions without damage from outflanking or from downstream erosion. The axis shall be in line with the direction of flow in the upstream channel, and the geometry shall conform with the dimensions given in clause 8 or clause 9 as appropriate.

5.2.3.2 The surfaces of the flume, particularly those of the entrance section and throat, shall be smooth. The flume may be constructed of concrete with a smooth cement finish or may be surfaced with a smooth non-corrodible material. In laboratory installations, the finish shall be equivalent to that of rolled sheet metal or planed, sanded and painted timber. The surface finish is of particular importance within the prismatic part of the throat, but the requirements may be relaxed beyond a distance along the profile $0,5h_{\max}$ upstream and downstream of the throat proper.

5.2.3.3 To minimize uncertainty in the discharge measurement, the following tolerances shall be satisfied in construction:

- a) on the bottom width b of the throat: 0,2 % of b with an absolute maximum of 0,01 m;
- b) on point deviations from a plane surface in the throat: 0,1 % of l ;
- c) on the width between vertical surfaces in the throat: 0,2 % of this width with a maximum of 0,01 m;
- d) on the average longitudinal and transverse slopes of the base of the throat: 0,1 %;
- e) on the slope of inclined surfaces in the throat: 0,1 %;
- f) on the length of the throat: 1 % of l ;
- g) on point deviations from a plane surface in the entrance transition to the throat: 0,1 % of l ;
- h) on point deviations from a plane surface in the exit transition from the throat: 0,3 % of l ;
- i) on deviations from a plane or curve on other vertical or inclined surfaces: 1 %;
- j) on deviation from a plane of the bed of the lined approach channel: 0,1 % of L .

The structure shall be measured on completion of construction, and average values of relevant dimensions and their standard deviations at 95 % confidence limits shall be computed. The average

values of dimensions shall be used for computation of the discharge and their standard deviations shall be used to obtain the overall uncertainty in the determination of discharge.

5.2.4 Downstream of the structure

The flow conditions downstream of the structure are important in that they control the tail-water level which may influence the operation of the flume. The flume shall be so designed that it cannot become drowned under normal operating conditions except for a limited period of time, e.g. during floods. The construction of a flume in a river or stream may alter the flow conditions upstream and downstream of the structure. This may result in the accumulation of river bed material further downstream which, in time, may cause the normal water level to rise sufficiently to drown the flume, particularly at low rates of flow. Any such accumulation of material shall be removed before it becomes excessive.

6 Maintenance — General requirements

6.1 Maintenance of the measuring structure and the approach channel is important to secure accurate measurements.

It is essential that, as far as practicable, the approach channel to flumes be kept clean and free from silt and vegetation for the minimum distance specified in 5.2.2.1.

6.2 The float well, the connecting pipe and the inlet from the approach channel shall be kept clean and free from deposits. The throat and the curved entry to a flume shall be kept clean and free from algal growths.

7 Measurement of head(s)

General methods and devices for measurement of head(s), and details of the design and functional requirements of stilling wells and details of the zero setting of a water-level measuring device are specified in ISO 4373. Requirements on head measurements for particular types of flume are dealt with in clauses 8 and 9.

8 Parshall flumes

8.1 Description

Parshall flumes have a rectangular cross-section and consist of a converging entrance section, a throat and a diverging exit section (see figure 1).

The floor of the entrance section shall be truly level both longitudinally and laterally. The side walls shall be vertical and disposed at a constant angle of con-

vergence of $11^\circ 19'$ or shall have a 1:5 contraction in plan with respect to the flume axis.

The side walls of the throat shall be parallel in plan. The floor shall be inclined downwards with a gradient of 3:8; this applies to flumes of all sizes. The line of intersection of the entrance section floor with the throat floor is known as the crest of the flume. The elevation of the crest above the throat invert is referred to as the height of the flume crest h_{p1} .

The side walls of the exit section shall be vertical and disposed at a constant angle of divergence of $9^\circ 28'$ or shall have a 1:6 expansion in plan with respect to the flume axis. The floor shall be inclined upwards with a reverse gradient of 1:6; this applies to flumes of all sizes.

To ensure a smooth entry of the flow into the flume and to prevent surface disturbance at the exit of the flume, the entrance and exit cross-sections shall be connected to the natural channel banks or the artificial channel side slopes by means of vertical wing walls disposed at 45° to the flume axis or curved in plan with a radius $R \geq 2h_{\max}$ (see figure 1). For smaller sizes of flumes with throat widths less than 0,5 m, the wing walls may be placed at right angles to the flume axis.

Parshall flumes may be constructed of wood, stone, concrete, reinforced concrete, or any other material depending on the prevailing conditions. Small Parshall flumes may be built of sheet metal and used as portable structures. Flumes made of reinforced concrete may be prefabricated for assembly in the field.

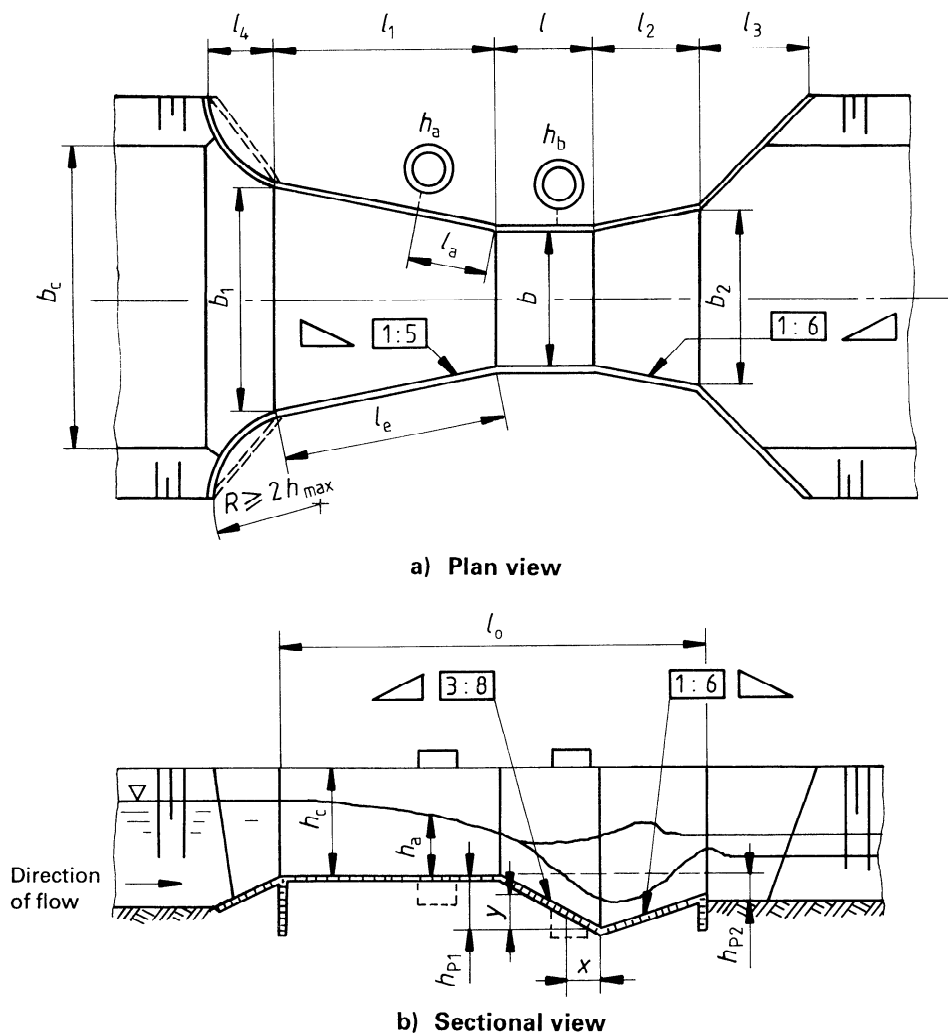


Figure 1 — Parshall flume