



ISO/IEC TS 29125

Edition 1.2 2024-10
CONSOLIDATED VERSION

INTERNATIONAL STANDARD



**Information technology – Telecommunications cabling requirements for remote
powering of terminal equipment**





THIS PUBLICATION IS COPYRIGHT PROTECTED
Copyright © 2024 ISO/IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about ISO/IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

IEC Secretariat
3, rue de Varembe
CH-1211 Geneva 20
Switzerland

Tel.: +41 22 919 02 11
info@iec.ch
www.iec.ch

About the IEC

The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications

The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigendum or an amendment might have been published.

IEC publications search - webstore.iec.ch/advsearchform

The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee, ...). It also gives information on projects, replaced and withdrawn publications.

IEC Just Published - webstore.iec.ch/justpublished

Stay up to date on all new IEC publications. Just Published details all new publications released. Available online and once a month by email.

IEC Customer Service Centre - webstore.iec.ch/csc

If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: sales@iec.ch.

IEC Products & Services Portal - products.iec.ch

Discover our powerful search engine and read freely all the publications previews, graphical symbols and the glossary. With a subscription you will always have access to up to date content tailored to your needs.

Electropedia - www.electropedia.org

The world's leading online dictionary on electrotechnology, containing more than 22 500 terminological entries in English and French, with equivalent terms in 25 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.



ISO/IEC TS 29125

Edition 1.2 2024-10
CONSOLIDATED VERSION

INTERNATIONAL STANDARD



**Information technology – Telecommunications cabling requirements for remote
powering of terminal equipment**

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

ICS 35.200

ISBN 978-2-8322-9971-5

Warning! Make sure that you obtained this publication from an authorized distributor.

AVA Documents
Document Sharing Hub

CONTENTS

FOREWORD.....	5
INTRODUCTION.....	7
INTRODUCTION to Amendment 1	7
INTRODUCTION to Amendment 2	7
1 Scope	8
2 Normative references	8
3 Terms, definitions and abbreviated terms	9
3.1 Terms and definitions.....	9
3.2 Abbreviated terms.....	9
4 Conformance	10
5 Cabling selection and performance	10
6 Installation conditions	10
6.1 General.....	10
6.2 Ambient temperature.....	10
6.3 Temperature rise and current capacity	11
6.4 Factors affecting temperature increase	13
6.4.1 General	13
6.4.2 Installation near equipment.....	13
6.4.3 Cable count within a bundle.....	13
6.4.4 Reducing temperature increase	15
6.4.5 Cable bundle suspended in air.....	21
6.4.6 Administration.....	21
7 Remote power delivery over balanced cabling	21
7.1 4-pair balanced cabling	21
7.2 1-pair balanced cabling	23
8 Connecting hardware	24
8.1 General.....	24
8.2 4-pair balanced cabling	24
8.3 1-pair balanced cabling	25
Annex A (informative) Mitigation considerations for installed cabling.....	26
A.1 General.....	26
A.2 Minimum cabling class	26
A.3 Bundle size and location	26
A.4 Mitigation options.....	26
Annex B (informative) Modelling temperature rise for cable types, bundle sizes and installation conditions	27
B.1 Model basics.....	27
B.2 Power dissipated (P).....	27
B.3 Temperature difference from ambient temperature to bundle surface (ΔT_U).....	28
B.3.1 Model equations	28
B.3.2 Typical values for constant ρ_U	28
B.4 Temperature difference from bundle surface to bundle centre (ΔT_{th}).....	28
B.4.1 Model equations	28
B.4.2 Typical values for constant ρ_{th}	28
B.5 Temperature variation within the bundle ($\Delta T(x)$)	29

B.6	Alternative presentation of the model	29
B.7	Adaptation model used to derive temperature rise vs. cables in a bundle	29
B.8	Calculations	30
B.9	Example.....	30
B.10	Coefficients for air and conduit.....	31
Annex C (informative)	Transmission parameters related to remote powering.....	33
C.1	DC loop resistance.....	33
C.1.1	4-pair cabling.....	33
C.1.2	1-pair cabling.....	33
C.2	DC resistance unbalance (within pair).....	34
C.2.1	General	34
C.2.2	4-pair cabling.....	34
C.2.3	1-pair cabling.....	34
C.3	DC resistance unbalance (pair to pair)	34
Annex D (informative)	Illustrations of heating of various bundle sizes and configurations	36
D.1	Limiting cable bundle size	36
D.2	Separating into smaller bundles	37
Annex E (informative)	Test protocol	38
E.1	Background.....	38
E.2	Test set-up	38
Annex F (informative)	Detailed test procedure	41
F.1	General.....	41
F.2	Test set-up	41
F.2.1	Thermocouple placement.....	41
F.2.2	Measurement of cable bundle in air	42
F.2.3	Measurement of cable bundle in conduit.....	43
Bibliography		45

Figure 3 – Temperature rise for a 0,57 mm conductor diameter 1-pair cable versus current for different bundle sizes in air	18
Figure 4 – Temperature rise for a 0,57 mm conductor diameter 1-pair cable versus current for different bundle sizes in conduit.....	19
Figure 6 – Temperature rise for a 1,02 mm conductor diameter 1-pair cable versus current for different bundle sizes in air	20
Figure 7 – Temperature rise for a 1,02 mm conductor diameter 1-pair cable versus current for different bundle sizes in conduit.....	21
Figure 1 – Examples of end point powering systems using signal pairs (top) and spare pairs (bottom)	22
Figure 2 – Examples of mid-span powering systems	23
Figure 5 – Single pair remote powering using signal pairs.....	24
Figure B.1 – Temperature rise profile.....	27
Figure D.1 – 91-cable bundle	36
Figure D.2 – Three bundles of 37 cables.....	36
Figure D.3 – Three bundles of 37 cables with separation	37
Figure E.1 – 37-cable bundle and temperature location.....	38
Figure E.2 – "Perfect bundle" and thermocouple configuration	39

Figure E.3 – 4-pair cabling conductor configuration	39
Figure E.4 – 1-pair cabling conductor configuration	39
Figure F.1 – Placement of thermocouple	41
Figure F.2 – Securing of the thermocouple	42
Figure F.3 – Test set-up for cable bundles in air	43
Figure F.4 – Test set-up for cable bundles in conduit	44
Table 1 – Maximum current per conductor versus temperature rise in a 37 4-pair cable bundle in air and conduit (all 4 pairs energized)	11
Table 5 – Maximum current per conductor versus temperature rise in a 37 1-pair cable bundle in air and conduit	12
Table 2 – Calculated worst case current per conductor versus temperature rise in a bundle of 37 4-pair cables (all pairs energized)	12
Table 6 – Calculated worst case current per conductor versus temperature rise in a bundle of 37 1-pair cables of different conductor diameters in air and conduit	13
Table 3 – Temperature rise versus 4-pair cable bundle size (500 mA per conductor)	14
Table 7 – Temperature rise versus 1-pair cable bundle size (1 000 mA per conductor)	15
Table 4 – Temperature rise for a type of 4-pair cable versus the number of energized pairs in a 37-cable bundle (500 mA per conductor)	17
Table 8 – Temperature rise for a 0,57 mm conductor diameter 1-pair cable versus current for different bundle sizes in air	17
Table 9 – Temperature rise for a 0,57 mm conductor diameter 1-pair cable versus current for different bundle sizes in conduit	18
Table 10 – Temperature rise for a 1,02 mm conductor diameter 1-pair cable versus current for different bundle sizes in air	19
Table 11 – Temperature rise for a 1,02 mm conductor diameter 1-pair cable versus current for different bundle sizes in conduit	20
Table B.1 – Bundling coefficients for different types of 4-pair cables and cords (all 4 pairs energized) in air and conduit	31
Table B.2 – DC resistance and bundling coefficients for 1-pair cables of different conductor diameters (all conductors energized) in air and conduit	32
Table C.1 – Maximum DC loop resistance of channels	33
Table C.4 – Maximum DC loop resistance of 1-pair channels	33
Table C.2 – DC resistance unbalance of 4-pair cables, connecting hardware and channels	34
Table C.3 – DC resistance unbalance (pair to pair)	35

INFORMATION TECHNOLOGY –

TELECOMMUNICATIONS CABLING REQUIREMENTS FOR REMOTE POWERING OF TERMINAL EQUIPMENT

FOREWORD

- 1) ISO (the International Organization for Standardization) and IEC (the International Electrotechnical Commission) form the specialized system for worldwide standardization. National bodies that are members of ISO or IEC participate in the development of International Standards through technical committees established by the respective organization to deal with particular fields of technical activity. ISO and IEC technical committees collaborate in fields of mutual interest. Other international organizations, governmental and non-governmental, in liaison with ISO and IEC, also take part in the work.
- 2) The formal decisions or agreements of IEC and ISO on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC and ISO National bodies.
- 3) IEC and ISO documents have the form of recommendations for international use and are accepted by IEC and ISO National bodies in that sense. While all reasonable efforts are made to ensure that the technical content of IEC and ISO documents is accurate, IEC and ISO cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
- 4) In order to promote international uniformity, IEC and ISO National bodies undertake to apply IEC and ISO documents transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC and ISO document and the corresponding national or regional publication shall be clearly indicated in the latter.
- 5) IEC and ISO do not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC and ISO marks of conformity. IEC and ISO are not responsible for any services carried out by independent certification bodies.
- 6) All users should ensure that they have the latest edition of this document.
- 7) No liability shall attach to IEC and ISO or their directors, employees, servants or agents including individual experts and members of its technical committees and IEC and ISO National bodies for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this ISO/IEC document or any other IEC and ISO documents.
- 8) Attention is drawn to the Normative references cited in this document. Use of the referenced publications is indispensable for the correct application of this document.
- 9) IEC and ISO draw attention to the possibility that the implementation of this document may involve the use of (a) patent(s). IEC and ISO take no position concerning the evidence, validity or applicability of any claimed patent rights in respect thereof. As of the date of publication of this document, IEC and ISO had not received notice of (a) patent(s), which may be required to implement this document. However, implementers are cautioned that this may not represent the latest information, which may be obtained from the patent database available at <https://patents.iec.ch> and www.iso.org/patents. IEC and ISO shall not be held responsible for identifying any or all such patent rights.

This consolidated version of the official IEC Standard and its amendments has been prepared for user convenience.

ISO/IEC TS 29125 edition 1.2 contains the first edition (2017-04), its amendment 1 (2020-05) [documents JTC1-SC25/2919/DTS and JTC1-SC25/2945/RVDTS] and its amendment 2 (2024-10) [documents JTC1-SC25/3272/DTS and JTC1-SC25/3289/RVDTS].

In this Redline version, a vertical line in the margin shows where the technical content is modified by amendments 1 and 2. Additions are in green text, deletions are in strikethrough red text. A separate Final version with all changes accepted is available in this publication.

The main task of the joint technical committee is to prepare International Standards. In exceptional circumstances, the joint technical committee may propose the publication of a Technical Specification when

- the required support cannot be obtained for the publication of an International Standard, despite repeated efforts, or
- when the subject is still under technical development or where, for any other reason, there is the future but not immediate possibility of an agreement on an International Standard.

Technical Specifications are subject to review within three years of publication to decide whether they can be transformed into International Standards.

ISO/IEC TS 29125, which is a Technical Specification, has been prepared by subcommittee 25: Interconnection of information technology equipment, of ISO/IEC joint technical committee 1: Information technology.

This first edition constitutes a technical revision.

This edition includes the following significant technical changes with respect to the previous edition:

- a) extension of the current per conductor from 300 mA to 500 mA;
- b) provision of additional details of installation conditions that were not described in ISO/IEC TR 29125:2010;
- c) inclusion of guidelines for cords;
- d) inclusion of a model to calculate temperature rise in different bundle sizes.

This Technical Specification has been approved by vote of the member bodies, and the voting results may be obtained from the address given on the second title page.

This publication has been drafted in accordance with the ISO/IEC Directives, Part 2.

IMPORTANT – The 'colour inside' logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.

INTRODUCTION

This document specifies the use of generic balanced cabling for customer premises, as specified in the ISO/IEC 11801 series, for remote powering of terminal equipment. It provides guidance on new cabling installations and renovations. The customer premises may encompass one or more buildings or may be within a building that contains more than one organization. The cabling may be installed prior to the selection of remote powering equipment or powered terminal equipment.

ISO/IEC 11801-1 specifies a structure and performance requirements for cabling subsystems that support a wide range of applications. They provide appropriate equipment interfaces to the cabling infrastructure in equipment rooms, telecommunications rooms and work areas.

A growing number of organizations employ equipment at locations that require the provision of remote powering. This document was created to provide supplementary information to ISO/IEC 11801-1 to implement remote powering over generic balanced cabling as specified in ISO/IEC 11801-1.

This document provides additional guidance for remote powering on the use of balanced cabling systems as specified in ISO/IEC 11801-1 and guidance on different installation conditions that require special considerations:

- information to bring together all the considerations about remote powering in a single document;
- guidance on wire diameter and bundling on heating;
- guidance on mating and un-mating of connectors that convey remote power.

This document does not include requirements from national or local safety standards and regulations.

This document was developed based on a number of contributions describing remote powering over telecommunications cabling under different installation conditions. The relevant safety standards and regulations, application standard, and equipment manufacturers give guidance on factors that should be taken into account during design of the generic balanced cabling that supports the distribution of remote powering.

This document extends the current per conductor specified in ISO/IEC TR 29125:2010 from 300 mA to 500 mA. This document covers additional details of installation conditions that are not described in ISO/IEC TR 29125:2010. This document includes guidelines for cords. This document addresses the use of generic balanced single pair cabling for customer premises, to be specified in future amendments of the ISO/IEC 11801 series, for remote powering of terminal equipment. This document uses measurements and empirical models to estimate the thermal performance of single pair cable bundles of various conductor diameters.

INTRODUCTION to Amendment 1

This amendment incorporates changes necessary to include remote powering using single pair cabling.

INTRODUCTION to Amendment 2

This amendment incorporates changes necessary to extend the current for remote powering using single pair cabling up to 2 000 mA.

INFORMATION TECHNOLOGY –**TELECOMMUNICATIONS CABLING REQUIREMENTS
FOR REMOTE POWERING OF TERMINAL EQUIPMENT****1 Scope**

This document

- a) addresses the support of safety extra low voltage (SELV) and limited power source (LPS) applications that provide remote power over:
 - 4-pair balanced cabling in accordance with the reference implementations of ISO/IEC 11801 series standards using currents per conductor of up to 500 mA;
 - 1-pair balanced cabling using currents per conductor of up to 2 000 mA;and targets the support of applications that provide remote power over balanced cabling to terminal equipment,
- b) covers the transmission and electrical parameters needed to support remote power over balanced cabling,
- c) covers various installation scenarios and how these may impact the capability of balanced cabling to support remote powering,
- d) specifies design and configuration of cabling as specified in ISO/IEC 11801-1.

NOTE SELV requirements specify a maximum voltage of 60 V DC and LPS is understood in the applications referenced to be up to 100 W supplied within ~~4-pair~~ cabling.

This document includes a mathematical model to predict the behaviour of different bundle sizes, various cabling constructions, and installation conditions for different current capacities.

Safety (e.g. electrical safety and protection and fire) and electromagnetic compatibility (EMC) requirements are outside the scope of this document, and are covered by other standards and regulations. However, information given by this document can be of assistance.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

ISO/IEC 11801-1, *Information technology – Generic cabling for customer premises – Part 1: General requirements*

ISO/IEC 14763-2, *Information technology – Implementation and operation of customer premises cabling – Part 2: Planning and installation*

ISO/IEC TR 24746, *Information technology – Generic cabling for customer premises – Mid-span DTE power insertion*

3 Terms, definitions and abbreviated terms

3.1 Terms and definitions

For the purposes of this document, the terms and definitions given in ISO/IEC 11801-1, ISO/IEC 14763-2 and the following apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at <http://www.electropedia.org/>
- ISO Online browsing platform: available at <http://www.iso.org/obp>

3.1.1

power source equipment

equipment that provides power

3.1.2

cable bundle

several cables tied together or in contact with one another in a parallel configuration for at least 1 m, with the cross-section profile of the arrangement basically circular

3.1.3

conductor

element intended to carry electric current

[SOURCE IEC 60050-151:2001, 151-12-05, modified – The 3 Notes have been deleted.]

3.1.4

current carrying capacity

maximum current a cable circuit (one or several conductors) can support resulting in a specified increase of temperature of the conductor beyond the ambient temperature, not exceeding the maximum allowed operating temperature of the cable

[SOURCE: IEC 61156-1:2007/AMD1:2009, 3.24, modified – "increase of temperature" has replaced "increase of the surface temperature".]

3.1.5

remote powering

supply of power to application specific equipment via balanced cabling

3.1.6

temperature rise

difference in temperature between the initial temperature of the conductor without power and the final temperature of the powered conductor at steady state

3.2 Abbreviated terms

EMC	electromagnetic compatibility
FD	floor distributor
HVAC	heating, ventilation and air conditioning
PTZ	pan, tilt, zoom
WAP	wireless access point

4 Conformance

For cabling to comply with this document, the following applies:

- a) the design of the cabling shall comply with the relevant cabling design standard of the ISO/IEC 11801 series;
- b) the installation shall comply with ISO/IEC 14763-2 as amended by the additional requirements of this document.

5 Cabling selection and performance

Cabling for remote powering ~~should~~ can be implemented using 4-pair and 1-pair balanced cabling.

This cabling will be used simultaneously to support signal transmission and remote power feeding for the terminal equipment. This document assumes the use of balanced cabling components specified in the reference implementation clause of the relevant design standards of the ISO/IEC 11801 series.

The transmission parameters of balanced cables related to remote powering can be found in Annex C.

6 Installation conditions

6.1 General

Cabling may be installed in different types of continuous and non-continuous pathway systems as described in ISO/IEC 14763-2. The installation of a cable within the pathway systems should take into account the specified operating temperature of the cable. Due to the Joule effect, each energized conductor has a temperature rise. Larger cable bundles have more heat generation and therefore the temperature rise is worse than smaller cable bundles.

The cable bundle size is limited by the current capacity in 6.3 and the induced temperature rise that results in an operating temperature of the cable, not to exceed its temperature rating.

The following guidelines for pathway selection and installation should be considered:

- a) installation design including the type of pathways selected, the pathway fill factor, whether the pathway is sealed at both ends,
- b) the pathway environment and whether the pathway goes through thermally insulated areas, in which case the type of insulation will be a significant factor. For optimal thermal performance, pathway design should avoid any insulated areas,
- c) thermal aspects of the entire pathway (e.g. open tray, closed tray, ventilated, non-ventilated, plastic conduit, metal conduit, fire barriers) should be taken into account.

6.2 Ambient temperature

Different segments of a link can have different ambient temperatures, which can influence the amount of remote power that can be delivered. Therefore the ambient temperature in different length segments of a link or channel has a direct impact on the operating temperature of the cable used for the link or channel and can limit the capability of the cable for remote power delivery to powered terminal equipment. The worst case installed cabling condition with respect to the maximum ambient temperature shall be used to determine the maximum operating temperature for a link or channel when subject to remote powering.

6.3 Temperature rise and current capacity

When remote power is applied to balanced cabling, the temperature of the cabling will rise due to resistive heat generation (Joule effect) in the conductors. Depending on cable construction and installed cabling conditions, the heat generated will be dissipated into the surrounding environment until a steady state is reached with the temperature of the cable bundle (operating temperature) higher than the ambient temperature of the surrounding environment. The maximum temperature of any cable shall not exceed the temperature rating of the cable. The standards in the ISO/IEC 11801 series ~~require this temperature to be 60 °C (minimum)~~ specify this temperature up to 60 °C in MICE C₁ environments and 70 °C in MICE C₂ and C₃ environments.

Temperature rise in the cable will lead to an increase in insertion loss as indicated in the reference implementations of the ISO/IEC 11801 series standards and should be taken into account when selecting cables and using them in links or channels. The maximum length of the channel or link should be reduced based on the maximum temperature of the cable using the de-rating factors in ISO/IEC 11801-1.

The maximum current per conductor for different temperature rise in a bundle of 37 cables of 4-pair Category 5 cables with solid conductors, and 37 cords of 4-pair 0,40 mm stranded cords with all pairs energized is shown in Table 1.

The maximum current per conductor for different temperature rise in a bundle of 37 cables of 1-pair cables with 0,57 mm diameter conductors, and 37 cords of 1-pair 0,40 mm cords with all pairs energized is shown in Table 5.

Annex B provides an engineering model that may be used for specific cable types, cable constructions, and installation conditions to derive the bundle size for a particular current per conductor. Clause B.7 describes a simplified version of the engineering model in Annex B and was used to derive the worst case values in Tables 1, ~~2, 3 and 4~~ to 9 based on constants calculated from measurements of typical cables for each cable category or conductor diameter. The measurement procedures used to determine the constants are detailed in Annex F.

Table 1 – Maximum current per conductor versus temperature rise in a 37 4-pair cable bundle in air and conduit ~~(all 4 pairs energized)~~

Temperature rise °C	Current per conductor 0,4 mm cords mA		Current per conductor Category 5 cables mA	
	air	conduit	air	conduit
5	278	223	341	287
7,5	340	273	418	351
10	393	315	482	406
12,5	439	352	539	453
15	481	386	591	497
17,5	520	417	638	537
20	556	446	682	574

Temperature rise above 10 °C shown in grey background is not recommended.

NOTE These values are based on conductor temperature measurement of typical cables and cords.

**Table 5 – Maximum current per conductor versus temperature rise
in a 37 1-pair cable bundle in air and conduit**

Temperature rise K	Current per conductor					
	0,57 mm wire diameter		0,40 mm stranded wire diameter (cords)		1,02 mm stranded wire diameter (cords)	
	mA		mA		mA	
	air	conduit	air	conduit	air	conduit
5	866	738	608	518	1 550	1 320
7,5	1 061	904	744	634	1 900	1 620
10	1 225	1 044	860	732	2 190	1 870
12,5	1 370	1 167	961	819	-	2 090
15	1 501	1 278	1 053	897	-	-
17,5	1 621	1 381	1 137	969	-	-
20	1 733	1 476	1 216	1 036	-	-

Temperature rise above 10 K shown in grey background is not recommended for cables installed in an environment that can reach 50 °C.

NOTE 1 These values are based on conductor temperature measurement of typical cables and cords.

NOTE 2 Currents above 2 000 mA are for information only.

Table 2 shows current capacity for different categories of 4-pair cable, independent of construction, for a given temperature rise. Table 6 shows current capacity for 1-pair cables of conductor diameters of cable, independent of construction, for a given temperature rise.

**Table 2 – Calculated worst case current per conductor versus temperature
rise in a bundle of 37 4-pair cables (all pairs energized)**

ΔT	0,4 mm cords mA		Category 5 cables mA		Category 6 cables mA		Category 6 _A cables mA		Category 7 cables mA		Category 7 _A cables mA	
	air	cond- uit	air	cond- uit	air	cond- uit	air	cond- uit	air	cond- uit	air	cond- uit
2	175	141	215	181	246	207	267	229	267	229	324	264
4	248	199	305	256	348	293	378	324	378	324	459	373
6	304	244	373	314	427	359	463	397	463	397	562	457
8	351	282	431	363	493	414	535	459	535	459	649	528
10	393	315	482	406	551	463	598	513	598	513	725	590
12	430	345	528	444	604	507	655	562	655	562	795	646
14	465	373	571	480	652	548	708	607	708	607	858	698
16	497	399	610	513	697	586	756	649	756	649	918	746
18	527	423	647	544	740	622	802	688	802	688	973	792
20	556	446	682	574	780	655	846	725	846	725	1026	835

Temperature rise above 10 °C shown in grey background is not recommended

The values in this table are based on the implicit DC resistance derived from the insertion loss of the various categories of cable. Manufacturers' and/or suppliers' specifications give information relating to a specific cable.

NOTE The current per conductor for each category is dependent on the cable construction.

Table 6 – Calculated worst case current per conductor versus temperature rise in a bundle of 37 1-pair cables of different conductor diameters in air and conduit

ΔT	0,40 mm diameter		0,51 mm diameter		0,57 mm diameter		0,65 mm diameter		0,81 mm diameter		1,02 mm diameter	
	mA		mA		mA		mA		mA		mA	
°C	air	conduit	air	conduit	air	conduit	air	conduit	air	conduit	air	conduit
2	384	327	490	417	548	466	624	532	779	663	981	835
4	543	463	693	590	775	660	883	753	1 101	938	1 387	1 181
6	666	567	849	723	949	808	1 082	922	1 349	1 149	1 699	1 446
8	769	655	981	835	1 096	933	1 249	1 065	1 558	1 327	1 962	1 670
10	860	732	1 096	934	1 225	1 044	1 397	1 190	1 742	1 484	2 194	1 867
12	942	802	1 201	1 023	1 342	1 143	1 530	1 304	1 908	1 625	2 403	2 046
14	1 017	867	1 297	1 105	1 450	1 235	1 653	1 409	2 061	1 755	2 596	2 210
16	1 087	926	1 387	1 181	1 550	1 320	1 767	1 506	2 203	1 877	2 775	2 362
18	1 153	983	1 471	1 253	1 644	1 400	1 874	1 597	2 337	1 991	2 943	2 506
20	1 216	1 036	1 551	1 321	1 733	1 476	1 976	1 684	2 463	2 098	3 102	2 641
Temperature rise above 10 °C shown in grey background is not recommended.												
The values in this table are based on the implicit DC resistance derived from the insertion loss of the various conductor diameters of cable. Manufacturers' and/or suppliers' specifications give information relating to a specific cable.												
NOTE 1 The current per conductor for each 1-pair cable is also dependent on the cable construction.												
NOTE 2 Currents above 2 000 mA are for information only.												

6.4 Factors affecting temperature increase

6.4.1 General

The steady state temperature for the conductor of any power carrying cable is reached when the generation of heat within the cable (Joule effect) is equal to the heat dissipated into the environment, be it the open atmosphere, trays, ducts or other cables which can also be power carrying cables.

6.4.2 Installation near equipment

Ambient temperature near equipment will be higher and also installation of telecommunications cables and cords in hot aisles will lead to higher ambient temperature around the patch cord bundle.

6.4.3 Cable count within a bundle

This document uses 37-cable bundles as the basis for developing the temperature rise and current per conductor with all pairs energized. For other cases (e.g. where bundle count exceeds 37 cables), the guidelines provided in 6.4 can be used. ~~Refer to Table 3 to determine the maximum temperature rise using 500 mA per conductor for cable bundles of different count.~~

Refer to Table 7 to determine the maximum temperature rise using 2 000 mA per conductor for 1-pair cable bundles of different count.

NOTE The temperature rise of one cable is lower than that of a 7-cable bundle shown in all tables.

Table 3 – Temperature rise versus 4-pair cable bundle size (500 mA per conductor)

Number of cables	Temperature rise °C											
	0,4 mm cords		Cat 5 cables		Cat 6 cables		Cat 6 _A cables		Cat 7 cables		Cat 7 _A cables	
	air	cond-uit	air	cond-uit	air	cond-uit	air	cond-uit	air	cond-uit	air	cond-uit
1	1,9	3,1	1,1	1,7	0,8	1,3	0,7	1,1	0,7	1,1	0,6	0,9
7	5,7	9,1	3,5	5,2	2,6	4,0	2,3	3,3	2,3	3,3	1,7	2,6
19	10,5	16,5	6,7	9,7	5,1	7,4	4,4	6,1	4,4	6,1	3,1	4,7
24	12,2	19,1	7,9	11,3	6,0	8,7	5,1	7,1	5,1	7,1	3,6	5,5
37	16,2	25,1	10,7	15,2	8,2	11,6	7,0	9,5	7,0	9,5	4,7	7,2
48	19,3	29,8	13,0	18,2	10,0	14,0	8,5	11,4	8,5	11,4	5,7	8,5
52	20,3	31,4	13,8	19,3	10,6	14,8	9,0	12,0	9,0	12,0	6,0	9,0
61	22,7	34,9	15,5	21,6	12,0	16,6	10,1	13,4	10,1	13,4	6,7	10,0
64	23,5	36,1	16,1	22,4	12,4	17,1	10,5	13,9	10,5	13,9	6,9	10,3
74	26,0	39,8	17,9	24,9	13,9	19,1	11,7	15,4	11,7	15,4	7,7	11,3
91	30,1	45,9	21,0	29,0	16,4	22,2	13,8	17,9	13,8	17,9	8,9	13,1
<p>Temperature rise above 10 °C shown in grey background is not recommended.</p> <p>The values in this table are based on the implicit DC resistance derived from the insertion loss of the various categories of cable. Manufacturers' and/or suppliers' specifications give information relating to a specific cable.</p> <p>NOTE 1 The temperature rise (°C) is based upon a current of 500 mA per conductor, for all pairs in all cables in the bundle.</p> <p>NOTE 2 The current per conductor for each category is dependent on the cable construction.</p>												

**Table 7 – Temperature rise versus 1-pair cable bundle size
(1 000 mA per conductor)**

Number of cables	Temperature rise													
	°C													
	0,32 mm diameter		0,40 mm diameter		0,51 mm diameter		0,57 mm diameter		0,65 mm diameter		0,81 mm diameter		1,02 mm diameter	
	mA		mA		mA		mA		mA		mA		mA	
	air	conduit	air	conduit	air	conduit	air	conduit	air	conduit	air	conduit	air	conduit
1	2,9	4,4	1,9	2,8	1,1	1,7	0,9	1,4	0,7	1,1	0,5	0,7	0,3	0,4
7	8,2	11,9	5,2	7,6	3,2	4,7	2,6	3,8	2,0	2,9	1,3	1,9	0,8	1,2
19	14,3	20,2	9,2	12,9	5,6	8,0	4,5	6,4	3,5	4,9	2,2	3,2	1,4	2,0
24	16,4	23,0	10,5	14,7	6,4	9,0	5,2	7,2	4,0	5,6	2,6	3,6	1,6	2,3
37	21,1	29,1	13,5	18,6	8,3	11,5	6,7	9,2	5,1	7,1	3,3	4,5	2,1	2,9
48	24,7	33,6	15,8	21,5	9,7	13,2	7,8	10,6	6,0	8,1	3,9	5,2	2,4	3,3
52	25,9	35,2	16,6	22,5	10,2	13,8	8,2	11,1	6,3	8,5	4,0	5,5	2,5	3,5
61	28,6	38,5	18,3	24,6	11,3	15,1	9,0	12,1	6,9	9,3	4,5	6,0	2,8	3,8
64	29,4	39,5	18,8	25,3	11,6	15,6	9,3	12,5	7,1	9,6	4,6	6,2	2,9	3,9
74	32,2	42,9	20,6	27,5	12,7	16,9	10,2	13,5	7,8	10,4	5,0	6,7	3,2	4,2
91	36,7	48,4	23,5	31,0	14,5	19,0	11,6	15,2	8,9	11,7	5,7	7,5	3,6	4,8
Temperature rise above 10 °C shown in grey background is not recommended.														
The values in this table are based on the implicit DC resistance of the various conductor diameters of cable. Manufacturers' and/or suppliers' specifications give information relating to a specific cable.														
NOTE 1 The temperature rise (°C) is based upon a current of 1 000 mA per conductor, for all cables in the bundle.														
NOTE 2 The current per conductor for each conductor diameter is also dependent on the cable construction.														

6.4.4 Reducing temperature increase

Minimizing the cabling temperature rise is recommended, as it

- reduces the impact on the transmission performance (e.g. insertion loss) of the cabling,
- reduces the HVAC loading within the premises,
- allows operation in higher ambient temperatures without exceeding the cable temperature rating,
- reduces the overall cost of delivering remote power by minimizing the resistive heating loss (power dissipated in the cabling).

The temperature rise can be reduced by minimizing the heat generation and maximizing the heat dissipation. Examples of how this can be achieved include:

- using higher category cable (for 4-pair cables),
- selecting a larger conductor size which decreases per unit length DC resistance,
- improving thermal dissipation by selecting cable with
 - improved heat transfer coefficient between materials within the cable,
 - improved heat transfer coefficient between cable sheath and air,
 - screen or other additional metallic elements,
 - solid insulation,

- a larger diameter,
- reducing the number of energized pairs,
- reducing the number of cables per bundle and avoiding tight cable bundles,
- selection of applications and devices that use lower current.

NOTE Manufacturers' and/or suppliers' specifications give information relating to a specific cable.

Mixing power-carrying cabling with unpowered cabling in bundles is also recommended as a practice to minimize heat rise.

If bundling is necessary, separate large bundles into smaller bundles, as described in Annex D. Other mitigation considerations are described in Annex A. Otherwise avoid bundling cables to minimize temperature rise.

Table 4 shows the effect of energizing the number of pairs within a 37-cable bundle for different 4-pair cable categories.

Table 8 shows the effect of energizing the number of pairs within a 37-cable bundle for different 1-pair cable constructions in air. Figure 3 shows this data in graphical form.

Table 9 shows the effect of energizing the number of pairs within a 37-cable bundle for different 1-pair cable constructions in conduit. Figure 4 shows this data in graphical form.

The recommendation of ISO/IEC 14763-2 for 4-pair cable bundles of no more than 24 is further reinforced for remote powering due to:

- 1) installation factors,
- 2) possible high ambient temperature,
- 3) the use of 0,4 mm conductor diameter cords,
- 4) higher currents up to 500 mA per conductor with all 4 pairs energized.

Table 4 – Temperature rise for a type of 4-pair cable versus the number of energized pairs in a 37-cable bundle (500 mA per conductor)

No. of energized pairs	ΔT (°C/K)											
	0,4 mm cords		Cat 5 cables		Cat 6 cables		Cat 6 _A cables		Cat 7 cables		Cat 7 _A cables	
	air	cond-uit	air	cond-uit	air	cond-uit	air	cond-uit	air	cond-uit	air	cond-uit
24	5,2	8,4	3,2	4,7	2,4	3,6	2,0	3,0	2,0	3,0	1,5	2,4
48	7,9	12,5	5,0	7,2	3,7	5,5	3,2	4,6	3,2	4,6	2,3	3,6
96	12,2	19,1	7,9	11,3	6,0	8,7	5,1	7,1	5,1	7,1	3,6	5,5
144	15,9	24,7	10,5	14,9	8,0	11,4	6,8	9,3	6,8	9,3	4,7	7,0
148	16,2	25,1	10,7	15,2	8,2	11,6	7,0	9,5	7,0	9,5	4,7	7,2
Temperature rise above 10 °C shown in grey background is not recommended.												
The values in this table are based on the implicit DC resistance derived from the insertion loss of the various categories of cable. Manufacturers' and/or suppliers' specifications give information relating to a specific cable.												
NOTE 1 The temperature rise (°C/K) is based upon a current of 500 mA on each energized conductor												
NOTE 2 The current per conductor for each category is dependent on the cable construction.												

Table 8 – Temperature rise for a 0,57 mm conductor diameter 1-pair cable versus current for different bundle sizes in air

Bundle size	Current									
	mA									
	200	400	600	800	1 000	1 200	1 400	1 600	1 800	2 000
	ΔT									
	K									
7	0,1	0,4	0,9	1,7	2,6	3,7	5,1	6,6	8,4	10,3
19	0,2	0,7	1,6	2,9	4,5	6,5	8,8	11,5	14,6	18,0
37	0,3	1,1	2,4	4,3	6,7	9,6	13,0	17,0	21,6	26,6
61	0,4	1,4	3,2	5,8	9,0	13,0	17,7	23,1	29,2	36,0
91	0,5	1,9	4,2	7,4	11,6	16,7	22,7	29,6	37,5	46,3
Temperature rise above 10 K shown in grey background is not recommended for cables installed in an environment that can reach 50 °C.										
The values in this table are based on the DC resistance of the cable conductors. Manufacturers' and/or suppliers' specifications give information relating to a specific cable.										
NOTE The temperature rise for a particular cable is also dependent on the cable construction.										

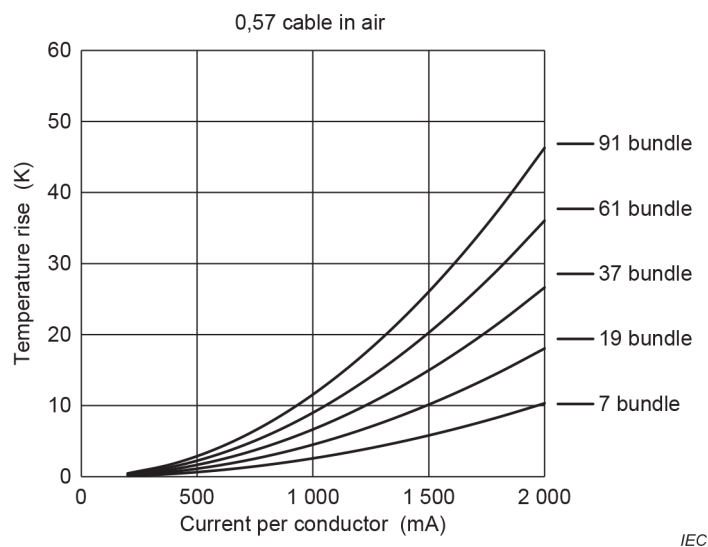


**Figure 3 – Temperature rise for a 0,57 mm conductor diameter
1-pair cable versus current for different bundle sizes in air**

**Table 9 – Temperature rise for a 0,57 mm conductor diameter
1-pair cable versus current for different bundle sizes in conduit**

Bundle size	Current mA									
	200	400	600	800	1 000	1 200	1 400	1 600	1 800	2 000
	ΔT K									
7	0,2	0,6	1,4	2,4	3,8	5,3	7,2	9,3	11,7	14,5
19	0,3	1,0	2,3	4,1	6,4	9,0	12,0	15,5	19,5	24,0
37	0,4	1,5	3,3	5,9	9,2	12,8	17,0	22,0	27,6	33,8
61	0,5	1,9	4,4	7,8	12,1	16,8	22,2	28,6	35,7	43,7
91	0,6	2,4	5,5	9,8	15,2	20,9	27,6	35,3	44,1	53,8
<p>Temperature rise above 10 K shown in grey background is not recommended for cables installed in an environment that can reach 50 °C.</p> <p>The values in this table are based on the DC resistance of the cable conductors. Manufacturers' and/or suppliers' specifications give information relating to a specific cable.</p> <p>NOTE The temperature rise for a particular cable is also dependent on the cable construction.</p>										

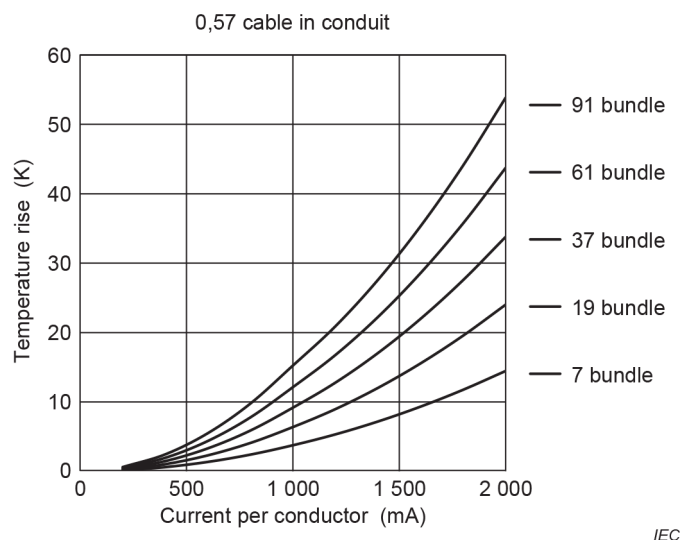


Figure 4 – Temperature rise for a 0,57 mm conductor diameter 1-pair cable versus current for different bundle sizes in conduit

Table 10 shows the temperature rise for a 1,02 mm conductor diameter 1-pair cable versus current for different bundle sizes in air. Figure 6 shows these data in graphical form.

Table 11 shows the temperature rise for a 1,02 mm conductor diameter 1-pair cable versus current for different bundle sizes in conduit. Figure 7 shows these data in graphical form.

Table 10 – Temperature rise for a 1,02 mm conductor diameter 1-pair cable versus current for different bundle sizes in air

Bundle size	Current									
	mA									
	200	400	600	800	1 000	1 200	1 400	1 600	1 800	2 000
	ΔT K									
7	0,1	0,2	0,3	0,5	0,8	1,1	1,5	1,9	2,4	3,0
19	0,3	0,4	0,6	1,0	1,4	1,9	2,6	3,3	4,1	5,0
37	0,5	0,7	1,0	1,5	2,1	2,8	3,7	4,7	5,8	7,1
61	0,7	1,0	1,4	2,0	2,8	3,8	4,9	6,2	7,6	9,3
91	1,1	1,4	1,9	2,7	3,6	4,8	6,1	7,7	9,5	11,5
Temperature rise above 10 K shown in grey background is not recommended for cables installed in an environment that can reach 50 °C.										
The values in this table are based on the DC resistance of the cable conductors. Manufacturers' and/or suppliers' specifications give information relating to a specific cable.										
NOTE The temperature rise for a particular cable is also dependent on the cable construction.										

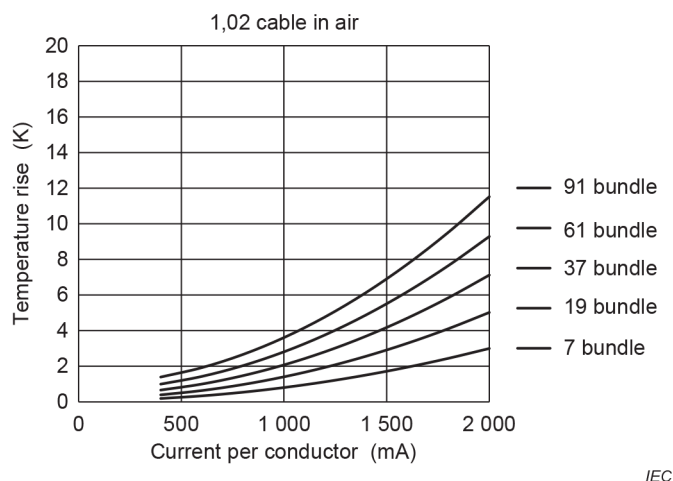


**Figure 6 – Temperature rise for a 1,02 mm conductor diameter
1-pair cable versus current for different bundle sizes in air**

**Table 11 – Temperature rise for a 1,02 mm conductor diameter
1-pair cable versus current for different bundle sizes in conduit**

Bundle size	Current mA									
	200	400	600	800	1 000	1 200	1 400	1 600	1 800	2 000
	ΔT K									
7	0,1	0,2	0,5	0,8	1,2	1,7	2,2	2,9	3,7	4,5
19	0,2	0,4	0,8	1,3	2,0	2,8	3,8	4,9	6,1	7,5
37	0,4	0,7	1,2	1,9	2,9	4,0	5,3	6,9	8,6	10,6
61	0,6	1,0	1,7	2,6	3,8	5,2	6,9	8,9	11,2	13,7
91	0,9	1,4	2,2	3,3	4,8	6,5	8,6	11,0	13,8	16,8

Temperature rise above 10 K shown in grey background is not recommended for cables installed in an environment that can reach 50 °C.

The values in this table are based on the DC resistance of the cable conductors. Manufacturers' and/or suppliers' specifications give information relating to a specific cable.

NOTE The temperature rise for a particular cable is also dependent on the cable construction.

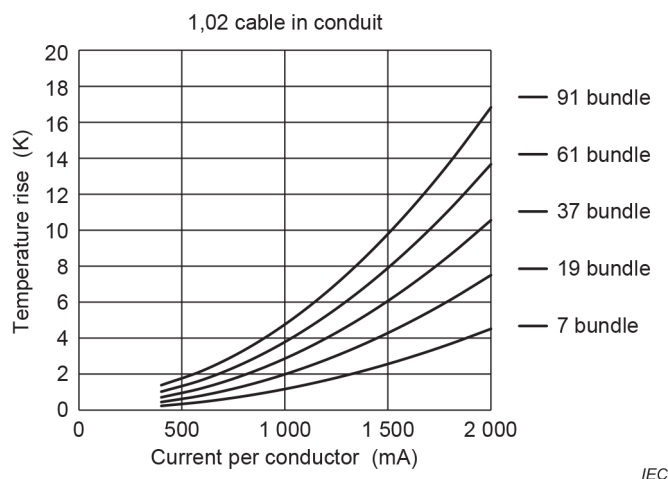


Figure 7 – Temperature rise for a 1,02 mm conductor diameter 1-pair cable versus current for different bundle sizes in conduit

6.4.5 Cable bundle suspended in air

The maximum ambient temperature of 50 °C is possible in certain environments and operating conditions. To allow for this ambient temperature and limit the temperature rise to 10 °C, for the minimum Category 5 cables supporting 500 mA per conductor, it is necessary to limit the bundle size to a smaller number than 100 cables.

6.4.6 Administration

The administration system as described in ISO/IEC 14763-2 can be used to select the channels in a bundle to use to supply power optimally. For example, the administration system can be used to record the powering details of the cables used for remote powering. An AIM system as specified in ISO/IEC 18598 can be designed to use bundle records and issue alerts when a bundle exceeds its thermal capacity.

7 Remote power delivery over balanced cabling

7.1 4-pair balanced cabling

Figure 1 shows examples of specified transmission paths used in generic balanced cabling. The channel is the transmission path between equipment such as a LAN switch or hub and the terminal equipment. The channel does not include the connections at the data source equipment and the terminal equipment. The channel, the permanent link or the CP link shall meet the transmission requirements specified in the design standards.

Remote power may be provided to terminal equipment via balanced cabling equipment interfaces. Remote power may be introduced to the balanced cabling channel at the FD using spare pairs, if available, or by remote power supplied over the phantom circuit of data pairs from the power sourcing equipment, as shown in Figure 1.

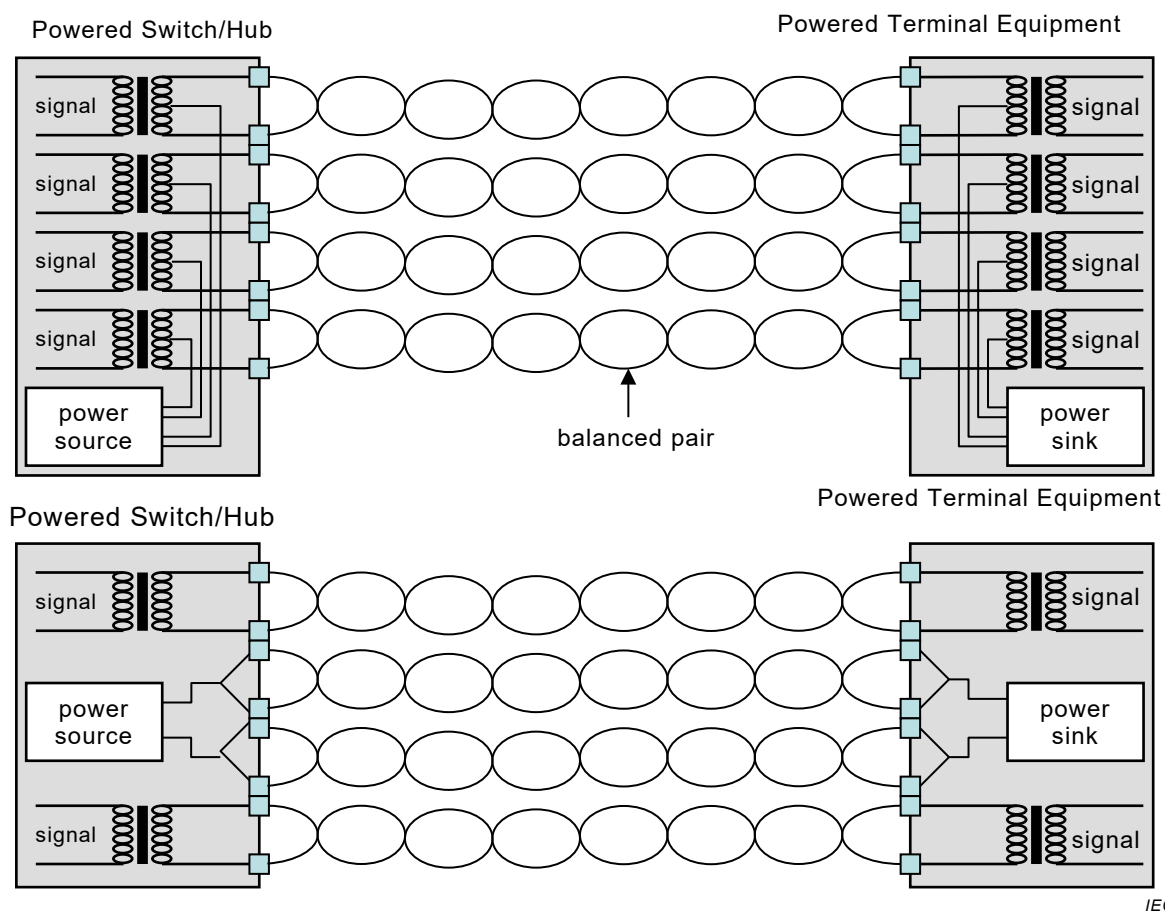


**Figure 1 – Examples of end point powering systems
using signal pairs (top) and spare pairs (bottom)**

Alternatively, remote power may be supplied by mid-span power source equipment that inserts remote power independent of the data source equipment, as shown in Figure 2.

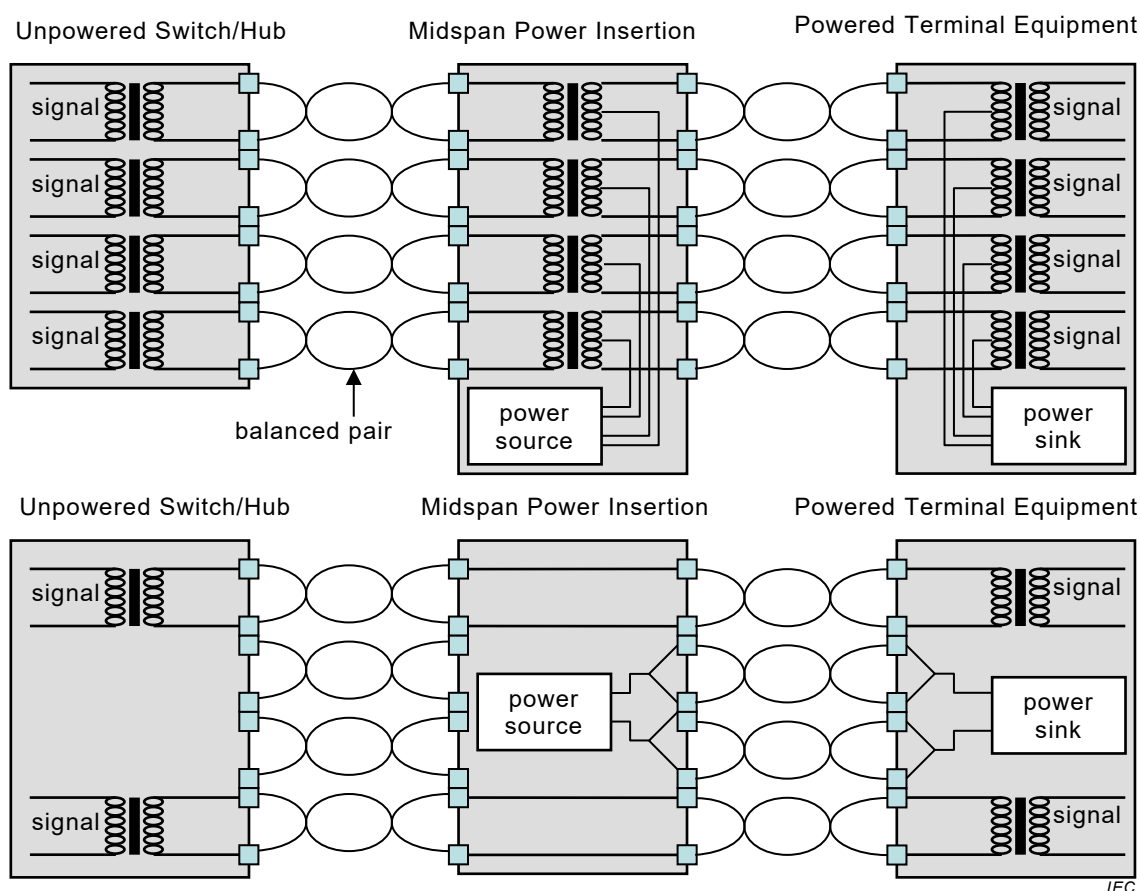


Figure 2 – Examples of mid-span powering systems

When mid-span power source equipment replaces a generic balanced cabling component or components, the data pairs shall meet the performance requirements of the component or components it replaces (e.g. patch cord, patch panel or combination thereof), regardless of the equipment interfaces used for input and output connections. Placement of mid-span power insertion equipment shall be external to the permanent link, see ISO/IEC TR 24746.

7.2 1-pair balanced cabling

Figure 5 shows examples of specified transmission paths used in 1-pair balanced cabling. The channel is the transmission path between equipment such as a LAN switch or hub and the terminal equipment. The channel does not include the connections at the data source equipment and the terminal equipment. The channel, the permanent link or the CP link shall meet the transmission requirements specified in the design standards.

Remote power may be provided to terminal equipment via balanced cabling equipment interfaces. Remote power is introduced to the balanced cabling channel at the Floor Distributor using the phantom circuit of data pairs from the power sourcing equipment, as shown in Figure 5.

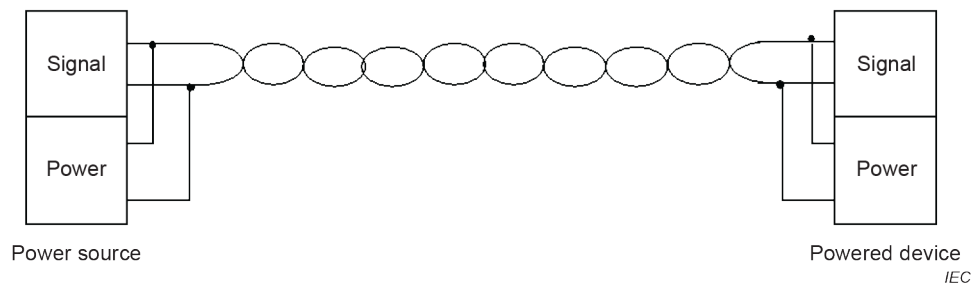


Figure 5 – Single pair remote powering using signal pairs

When mid-span power source equipment replaces a generic balanced cabling component or components, the data pair shall meet the performance requirements of the component or components it replaces (e.g. patch cord, patch panel or combination thereof), regardless of the equipment interfaces used for input and output connections.

8 Connecting hardware

8.1 General

~~Connecting hardware in channels used to support remote power applications shall have an appropriate current rating when mated. Connecting hardware contacts may deteriorate as a result of mating or un-mating under electrical load, leading to possible degradation of transmission characteristics (see IEC 60512-99-001). Manufacturers should be consulted regarding the number of mating and un-mating cycles supported by connecting hardware while conveying the intended levels of electrical power.~~

The temporary removal of remote power should be considered before mating or un-mating connecting hardware in a remotely powered channel.

It is preferable that remote powering is not present during mating or un-mating of connecting hardware.

Intelligent powering systems such as Power over Ethernet and Power over Ethernet-*plus* (defined in ISO/IEC/IEEE 8802-3) automatically recognize compliant loads before applying the required level of remote power, thus eliminating electrical stress during connector mating.

ISO/IEC/IEEE 8802-3 also defines optional features to remotely manage the provision of electrical power to each port via port power management which can be used to remove remote power from a particular channel prior to un-mating connectors.

Port power management is therefore the preferred approach to reconfiguration of remotely powered cabling channels.

8.2 4-pair balanced cabling

Connecting hardware in channels used to support remote power applications shall have an appropriate current rating when mated. Connecting hardware contacts can deteriorate as a result of mating or un-mating under electrical load, leading to possible degradation of transmission characteristics (see IEC 60512-99-001 and IEC 60512-99-002). Manufacturers should be consulted regarding the number of mating and un-mating cycles supported by connecting hardware while conveying the intended levels of electrical power.

Where it is not practicable to switch off the remote power before mating or un-mating (e.g. for power sources that do not have power management), connecting hardware having the required performance for mating and un-mating under the relevant levels of electrical power and load should be chosen. These requirements are not within the scope of the balanced

connecting hardware standards (e.g. IEC 60603-7, IEC 61076-3-104 and IEC 61076-3-110) referenced from ISO/IEC 11801-1 and equivalent standards but may be assessed using additional test schedules.

NOTE A test schedule for ~~engaging and separating connectors under electrical load is described in IEC 60512-99-001~~ connectors under electrical load is described in IEC 60512-99-001 and IEC 60512-99-002.

8.3 1-pair balanced cabling

Contacts need to support 2,0 A for mating and un-mating under load.

Connecting hardware in channels used to support remote power applications shall have an appropriate current rating when mated. Connecting hardware contacts may deteriorate as a result of mating or un-mating under electrical load, leading to possible degradation of transmission characteristics (IEC 60512-99-003). Manufacturers should be consulted regarding the number of mating and un-mating cycles supported by connecting hardware while conveying the intended levels of electrical power.

NOTE A test schedule for engaging and separating connectors under electrical load is described in IEC 60512-99-003.

Annex A

(informative)

Mitigation considerations for installed cabling

A.1 General

Installed cabling is not easy to change to support new applications with additional requirements. Annex A offers some considerations that can be useful to provide remote power over existing installations of Class D or better balanced cabling. Consideration should be given to local heat dissipation conditions, for instance going through framed wall construction or through insulating material.

A.2 Minimum cabling class

Class D is the minimum cabling suitable for remote powering. Better balanced cabling is recommended to allow higher power needed by emerging applications such as next generation WAPs and outdoor heated PTZ cameras.

A.3 Bundle size and location

Cables with improved thermal characteristics may be configured into larger bundles. The location of a cable bundle is also an important consideration. Conduits sealed at both ends typically retain more heat than open conduits, leading to a higher temperature rise in the sealed conduit. If cables are installed in an open tray, the temperature rise will be lower than the temperature rise in conduits (sealed or unsealed) for the same bundle size.

A.4 Mitigation options

If an existing installation does not meet the current capacity in this document for a particular bundle size, the following mitigation options may be considered.

- a) Use only half the cables in a bundle for remote powering with the other half used for applications that do not need remote power.
- b) If ambient temperatures are high, consider adding air-conditioning or air-circulation over cabling segments that are exposed to high temperature.
- c) If possible, separate larger bundles into smaller bundles.

If it is not possible to implement any of the mitigation options listed above, and the number of data terminals requiring remote powering is significant, upgrade the installation using cables with improved thermal characteristics.

Additionally, when the number of data terminals requiring remote powering is significant, upgrade the installation using the appropriate installation procedures to keep the bundle size reasonably low (e.g. 24 cable count) to allow proper heat dissipation all along the channel, permanent link or CP link.

Annex B (informative)

Modelling temperature rise for cable types, bundle sizes and installation conditions

B.1 Model basics

This model derives the temperature rise based on measured data for different cable types and installation environments:

- ΔT is the total temperature rise between the ambient temperature (or that of the unpowered bundle) and the centre of the bundle;
- ΔT_{th} is the temperature rise between the outer surface and the centre of the bundle;
- ΔT_u is the temperature rise between the ambient temperature (or that of the unpowered bundle) and the outer surface of the bundle.

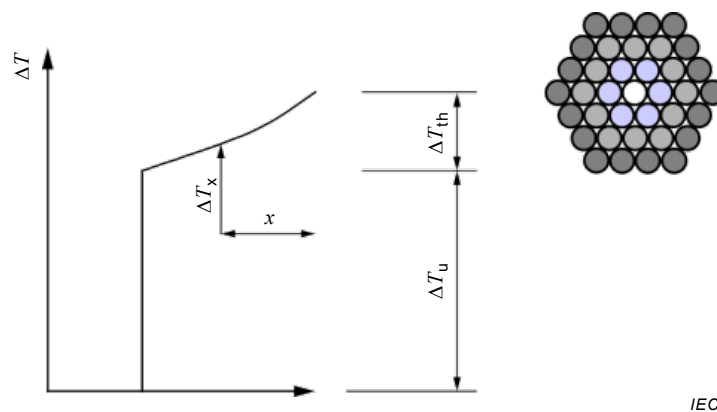


Figure B.1 – Temperature rise profile

An additional element of the model provides a calculation for the temperatures within the bundle at a distance x from the centre (ΔT_x).

B.2 Power dissipated (P)

The model uses a common factor which is defined as P :

$$P = N \times n_c \times i_c^2 \times R \quad (\text{B.1})$$

where

i_c is the current per conductor (A) = 0,5 times the current delivered by a pair;

n_c is the number of conductors per cable carrying remote powering current (i_c)
= 2 times the number of pairs carrying remote powering current;

$n_c = 2$ for 1-pair cables;

$n_c = 8$ for 4-pair cables;

N is the number of cables carrying remote powering current;

R is the average DC resistance per unit length (Ω/m) of conductors carrying remote powering current.