

NFPA®

18A

Standard on
Water Additives for Fire Control
and Vapor Mitigation

2022




NFPA® 18A

Standard on Water Additives for Fire Control and Vapor Mitigation

2022 Edition



NFPA, 1 Batterymarch Park, Quincy, MA 02269-9101
An International Codes and Standards Organization



Documents
Document Sharing Hub

IMPORTANT NOTICES AND DISCLAIMERS CONCERNING NFPA® STANDARDS

NFPA® codes, standards, recommended practices, and guides (“NFPA Standards”), of which the document contained herein is one, are developed through a consensus standards development process approved by the American National Standards Institute. This process brings together volunteers representing varied viewpoints and interests to achieve consensus on fire and other safety issues. While the NFPA administers the process and establishes rules to promote fairness in the development of consensus, it does not independently test, evaluate, or verify the accuracy of any information or the soundness of any judgments contained in NFPA Standards.

The NFPA disclaims liability for any personal injury, property, or other damages of any nature whatsoever, whether special, indirect, consequential or compensatory, directly or indirectly resulting from the publication, use of, or reliance on NFPA Standards. The NFPA also makes no guaranty or warranty as to the accuracy or completeness of any information published herein.

In issuing and making NFPA Standards available, the NFPA is not undertaking to render professional or other services for or on behalf of any person or entity. Nor is the NFPA undertaking to perform any duty owed by any person or entity to someone else. Anyone using this document should rely on his or her own independent judgment or, as appropriate, seek the advice of a competent professional in determining the exercise of reasonable care in any given circumstances.

The NFPA has no power, nor does it undertake, to police or enforce compliance with the contents of NFPA Standards. Nor does the NFPA list, certify, test, or inspect products, designs, or installations for compliance with this document. Any certification or other statement of compliance with the requirements of this document shall not be attributable to the NFPA and is solely the responsibility of the certifier or maker of the statement.

REVISION SYMBOLS IDENTIFYING CHANGES FROM THE PREVIOUS EDITION

Text revisions are shaded. A  before a section number indicates that words within that section were deleted and a  to the left of a table or figure number indicates a revision to an existing table or figure. When a chapter was heavily revised, the entire chapter is marked throughout with the  symbol. Where one or more sections were deleted, a • is placed between the remaining sections. Chapters, annexes, sections, figures, and tables that are new are indicated with an .

Note that these indicators are a guide. Rearrangement of sections may not be captured in the markup, but users can view complete revision details in the First and Second Draft Reports located in the archived revision information section of each code at www.nfpa.org/docinfo. Any subsequent changes from the NFPA Technical Meeting, Tentative Interim Amendments, and Errata are also located there.

REMINDER: UPDATING OF NFPA STANDARDS

Users of NFPA codes, standards, recommended practices, and guides (“NFPA Standards”) should be aware that these documents may be superseded at any time by the issuance of a new edition, may be amended with the issuance of Tentative Interim Amendments (TIAs), or be corrected by Errata. It is intended that through regular revisions and amendments, participants in the NFPA standards development process consider the then-current and available information on incidents, materials, technologies, innovations, and methods as these develop over time and that NFPA Standards reflect this consideration. Therefore, any previous edition of this document no longer represents the current NFPA Standard on the subject matter addressed. NFPA encourages the use of the most current edition of any NFPA Standard [as it may be amended by TIA(s) or Errata] to take advantage of current experience and understanding. An official NFPA Standard at any point in time consists of the current edition of the document, including any issued TIAs and Errata then in effect.

To determine whether an NFPA Standard has been amended through the issuance of TIAs or corrected by Errata, visit the “Codes & Standards” section at www.nfpa.org.

ADDITIONAL IMPORTANT NOTICES AND DISCLAIMERS CONCERNING NFPA® STANDARDS

Updating of NFPA Standards

Users of NFPA codes, standards, recommended practices, and guides (“NFPA Standards”) should be aware that these documents may be superseded at any time by the issuance of a new edition, may be amended with the issuance of Tentative Interim Amendments (TIAs), or be corrected by Errata. It is intended that through regular revisions and amendments, participants in the NFPA standards development process consider the then-current and available information on incidents, materials, technologies, innovations, and methods as these develop over time and that NFPA Standards reflect this consideration. Therefore, any previous edition of this document no longer represents the current NFPA Standard on the subject matter addressed. NFPA encourages the use of the most current edition of any NFPA Standard [as it may be amended by TIA(s) or Errata] to take advantage of current experience and understanding. An official NFPA Standard at any point in time consists of the current edition of the document, including any issued TIAs and Errata then in effect.

To determine whether an NFPA Standard has been amended through the issuance of TIAs or corrected by Errata, visit the “Codes & Standards” section at www.nfpa.org.

Interpretations of NFPA Standards

A statement, written or oral, that is not processed in accordance with Section 6 of the Regulations Governing the Development of NFPA Standards shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

Patents

The NFPA does not take any position with respect to the validity of any patent rights referenced in, related to, or asserted in connection with an NFPA Standard. The users of NFPA Standards bear the sole responsibility for determining the validity of any such patent rights, as well as the risk of infringement of such rights, and the NFPA disclaims liability for the infringement of any patent resulting from the use of or reliance on NFPA Standards.

NFPA adheres to the policy of the American National Standards Institute (ANSI) regarding the inclusion of patents in American National Standards (“the ANSI Patent Policy”), and hereby gives the following notice pursuant to that policy:

NOTICE: The user’s attention is called to the possibility that compliance with an NFPA Standard may require use of an invention covered by patent rights. NFPA takes no position as to the validity of any such patent rights or as to whether such patent rights constitute or include essential patent claims under the ANSI Patent Policy. If, in connection with the ANSI Patent Policy, a patent holder has filed a statement of willingness to grant licenses under these rights on reasonable and nondiscriminatory terms and conditions to applicants desiring to obtain such a license, copies of such filed statements can be obtained, on request, from NFPA. For further information, contact the NFPA at the address listed below.

Law and Regulations

Users of NFPA Standards should consult applicable federal, state, and local laws and regulations. NFPA does not, by the publication of its codes, standards, recommended practices, and guides, intend to urge action that is not in compliance with applicable laws, and these documents may not be construed as doing so.

Copyrights

NFPA Standards are copyrighted. They are made available for a wide variety of both public and private uses. These include both use, by reference, in laws and regulations, and use in private self-regulation, standardization, and the promotion of safe practices and methods. By making these documents available for use and adoption by public authorities and private users, the NFPA does not waive any rights in copyright to these documents.

Use of NFPA Standards for regulatory purposes should be accomplished through adoption by reference. The term “adoption by reference” means the citing of title, edition, and publishing information only. Any deletions, additions, and changes desired by the adopting authority should be noted separately in the adopting instrument. In order to assist NFPA in following the uses made of its documents, adopting authorities are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. For technical assistance and questions concerning adoption of NFPA Standards, contact NFPA at the address below.

For Further Information

All questions or other communications relating to NFPA Standards and all requests for information on NFPA procedures governing its codes and standards development process, including information on the procedures for requesting Formal Interpretations, for proposing Tentative Interim Amendments, and for proposing revisions to NFPA standards during regular revision cycles, should be sent to NFPA headquarters, addressed to the attention of the Secretary, Standards Council, NFPA, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101; email: stds_admin@nfpa.org.

For more information about NFPA, visit the NFPA website at www.nfpa.org. All NFPA codes and standards can be viewed at no cost at www.nfpa.org/docinfo.

Copyright © 2021 National Fire Protection Association®. All Rights Reserved.

NFPA® 18A

Standard on

Water Additives for Fire Control and Vapor Mitigation

2022 Edition

This edition of NFPA 18A, *Standard on Water Additives for Fire Control and Vapor Mitigation*, was prepared by the Technical Committee on Water Additives for Fire Control and Vapor Mitigation. It was issued by the Standards Council on October 2, 2021, with an effective date of October 22, 2021, and supersedes all previous editions.

This edition of NFPA 18A was approved as an American National Standard on October 22, 2021.

Origin and Development of NFPA 18A

In 1998, the NFPA Standards Council approved the formation of the Technical Committee on Water Additives for Fire Control and Vapor Mitigation. The committee was tasked with having primary responsibility for documents on the manufacture, testing, application, and use of water additives for the control and/or suppression of fire and flammable vapor mitigation, including water additives used to prevent or reduce the spread of fire and the use of water additives in fixed, semi-fixed, mobile, and portable fire suppression systems. The standard they were given was NFPA 18, *Wetting Agents*.

Initially, the committee proposed to combine wetting agents and water additives under one standard. This effort was returned to the committee by Association action in June 2003. As a result, the committee decided to divide this work into two subject areas and standards, retaining and revising NFPA 18 and creating a new standard addressing water additives, NFPA 18A, the first edition of which was issued in 2007.

Changes in the 2011 edition included a reorganization of Chapters 5 and 6, clarification of test procedures and criteria, and the removal of secondary (U.S.) units throughout much of the text.

The 2017 edition underwent extensive technical and editorial revision. Technical changes included a new chapter to address Class C fire test methods to provide the fire service with safe limits for fire attack on energized electrical equipment. Editorial changes included updating the structure of the standard to further comply with the *Manual of Style for NFPA Technical Committee Documents*.

The 2022 edition has been significantly enhanced with the addition of two new chapters. New Chapter 9 provides fire test methods for water additives used for the control and suppression of Class D fires and guidance on fire test procedures for testing, approval, and listing purposes. New Chapter 12 provides the end user with application and design guidelines, tying water additives and their requirements with other NFPA standards. Other changes include a re-write of Chapter 4 to classify hazards with a specific class of fires, updates to Chapter 7 to address the spherical micelle stability test, and editorial changes, including updated references.

Technical Committee on Water Additives for Fire Control and Vapor Mitigation

Blake M. Shugarman, *Chair*
UL LLC, IL [RT]

Michael T. Greiner, *Secretary*
Hazard Control Technologies, Inc., GA [M]

Jeffrey Paul Bonkoski, JB Hazmat Consulting, LLC., AR [SE]

John D. Campbell, Global Fire Protection Group, LLC, MO [SE]

Brian R. Foster, AEGIS Insurance Services, Inc., NC [I]

Alison C. Gude, Johnson Controls, WI [M]

Gerald J. Halpin III, CET Fire Pumps Manufacturing, Canada [M]
Rep. Fire Apparatus Manufacturers Association

Anthony Natale, Consolidated Edison of New York, NY [U]
Rep. Edison Electric Institute

Ryan Wyse, Hebron Fire Department, OH [E]

Shirley Zylstra, USDA Forest Service, MT [RT]

Alternates

Tracy Browder, AEGIS Insurance Services, Inc., NJ [I]
(Alt. to Brian R. Foster)

Scott M. Bryant, Fire & Risk Alliance LLC, MD [U]
(Alt. to Anthony Natale)

Michael P. Dupay, Fire Research Corporation, NY [M]
(Alt. to Gerald J. Halpin III)

Jerauld R. Kirkpatrick, UL LLC, IL [RT]
(Alt. to Blake M. Shugarman)

Baran Ozden, NFPA Staff Liaison

This list represents the membership at the time the Committee was balloted on the final text of this edition. Since that time, changes in the membership may have occurred. A key to classifications is found at the back of the document.

NOTE: Membership on a committee shall not in and of itself constitute an endorsement of the Association or any document developed by the committee on which the member serves.

Committee Scope: This Committee shall have primary responsibility for documents on the manufacture, testing, application, and use of water additives for the control and/or suppression of fire and flammable vapor mitigation including water additives used to prevent or reduce the spread of fire and the use of water additives in fixed, semi-fixed, mobile, and portable fire suppression systems.

Contents

Chapter 1 Administration	18A- 4	Chapter 8 Class C Fire Test Methods	18A- 17
1.1 Scope.	18A- 4	8.1 General.	18A- 17
1.2 Purpose.	18A- 4	8.2 Extinguisher Test.	18A- 17
1.3 Application.	18A- 4	8.3 Manual Operations Test.	18A- 17
1.4 Retroactivity.	18A- 4	8.4 Arc Conductor Test.	18A- 18
1.5 Equivalency.	18A- 4	Chapter 9 Class D Fire Test Methods	18A- 19
1.6 Units and Formulas.	18A- 4	9.1 General.	18A- 19
Chapter 2 Referenced Publications	18A- 4	9.2 Test Setup.	18A- 19
2.1 General.	18A- 4	9.3 Application.	18A- 19
2.2 NFPA Publications.	18A- 4	9.4 Acceptable Test.	18A- 20
2.3 Other Publications.	18A- 4	9.5 Liquid State Class D Metal Test. (Reserved)	18A- 20
2.4 References for Extracts in Mandatory Sections.	18A- 5	Chapter 10 Packaging and Labeling	18A- 20
Chapter 3 Definitions	18A- 5	10.1 Packaging.	18A- 20
3.1 General.	18A- 5	10.2 Storage.	18A- 20
3.2 NFPA Official Definitions.	18A- 5	10.3 Labeling.	18A- 20
3.3 General Definitions.	18A- 6	Chapter 11 Supply	18A- 21
Chapter 4 Uses and Limitations	18A- 7	11.1 System Requirements.	18A- 21
4.1 General.	18A- 7	11.2 Fire Department Supply Requirements.	18A- 21
4.2 Limitations.	18A- 7	11.3 Fixed Systems.	18A- 21
4.3 Uses and Applications.	18A- 7	11.4 Self-Contained and Semi-Portable Detection, Notification, and Suppression Systems.	18A- 21
4.4 Compatibility of Water Additive Concentrate and Solutions.	18A- 8	Chapter 12 Design Guidelines	18A- 21
4.5 Concentrations.	18A- 8	12.1 General.	18A- 21
Chapter 5 Properties and General Test Protocols for Evaluation of Water Additive Concentrate and Solution	18A- 8	12.2 Class A Fire Applications.	18A- 21
5.1 General.	18A- 8	12.3 Class B 2D Fire Applications.	18A- 21
5.2 Toxicity and Environmental Tests.	18A- 8	12.4 Class B 3D Fire Applications.	18A- 21
5.3 Physical Properties.	18A- 9	12.5 Class C Fire Applications.	18A- 21
5.4 Stability.	18A- 9	12.6 Class D Fire Applications.	18A- 22
5.5 Uniform Corrosion.	18A- 10	12.7 Combustible and Flammable Liquid Spill Control Applications.	18A- 22
5.6 Intergranular Corrosion Test.	18A- 12	12.8 Combustible and Flammable Liquid Vapor Encapsulation Explosion Prevention (VEEP) Applications.	18A- 22
5.7 Compatibility with Nonmetallic Materials.	18A- 12	Chapter 13 Inspection, Testing, and Maintenance of Fixed Systems	18A- 22
Chapter 6 Class A Fire Test Methods	18A- 13	13.1 Fixed Extinguishing Systems.	18A- 22
6.1 General.	18A- 13	13.2 Inspection of Water Additive Concentrate.	18A- 22
6.2 Wood Panel Fire Test.	18A- 13	Annex A Explanatory Material	18A- 22
6.3 Wood Crib Fire Test.	18A- 13	Annex B Residual Fire Retardancy	18A- 32
6.4 Deep-Seated Fire Test.	18A- 13	Annex C ICAL Radiant Panel Test for Exposure Protection	18A- 32
Chapter 7 Class B Fire Test Methods	18A- 13	Annex D Three-Dimensional Fire Test Apparatus	18A- 33
7.1 General.	18A- 13	Annex E Informational References	18A- 38
7.2 Spill Fire Test.	18A- 13	Index	18A- 39
7.3 Pool Fire Test.	18A- 14		
7.4 Three-Dimensional Fuel Fire Test for Manual Application.	18A- 15		
7.5 Three-Dimensional Fire Test for Fixed Fire Suppression.	18A- 16		
7.6 Polar Solvents Fire Test. (Reserved)	18A- 16		
7.7 Encapsulator — Spherical Micelle Stability Test (Liquid Phase Fuels).	18A- 16		
7.8 Fuel in Depth Fire Test. (Reserved)	18A- 17		

NFPA 18A

Standard on

Water Additives for Fire Control and Vapor Mitigation

2022 Edition

IMPORTANT NOTE: This NFPA document is made available for use subject to important notices and legal disclaimers. These notices and disclaimers appear in all publications containing this document and may be found under the heading “Important Notices and Disclaimers Concerning NFPA Standards.” They can also be viewed at www.nfpa.org/disclaimers or obtained on request from NFPA.

UPDATES, ALERTS, AND FUTURE EDITIONS: New editions of NFPA codes, standards, recommended practices, and guides (i.e., NFPA Standards) are released on scheduled revision cycles. This edition may be superseded by a later one, or it may be amended outside of its scheduled revision cycle through the issuance of Tentative Interim Amendments (TIAs). An official NFPA Standard at any point in time consists of the current edition of the document, together with all TIAs and Errata in effect. To verify that this document is the current edition or to determine if it has been amended by TIAs or Errata, please consult the National Fire Codes® Subscription Service or the “List of NFPA Codes & Standards” at www.nfpa.org/docinfo. In addition to TIAs and Errata, the document information pages also include the option to sign up for alerts for individual documents and to be involved in the development of the next edition.

NOTICE: An asterisk (*) following the number or letter designating a paragraph indicates that explanatory material on the paragraph can be found in Annex A.

A reference in brackets [] following a section or paragraph indicates material that has been extracted from another NFPA document. Extracted text may be edited for consistency and style and may include the revision of internal paragraph references and other references as appropriate. Requests for interpretations or revisions of extracted text shall be sent to the technical committee responsible for the source document.

Information on referenced and extracted publications can be found in Chapter 2 and Annex E.

Chapter 1 Administration

1.1 Scope. This standard provides the minimum requirements for water additives used for the control and/or suppression of Class A, Class B, Class C, Class D, Class K, and lithium ion battery fires and the mitigation of flammable vapors.

1.2 Purpose. This standard is intended for the use and guidance of those responsible for purchasing, testing, listing, and using water additives for use on Class A, Class B, Class D, Class K, and lithium ion battery fires and the mitigation of flammable vapors.

1.3* Application. This standard applies to water additives utilized to prevent flammable liquid vapor explosions, remove the flammability of flammable liquid spills, or extinguish Class A, Class B, Class C, Class D, Class K, and lithium ion battery fires.

1.4 Retroactivity. The provisions of this standard reflect a consensus of what is necessary to provide an acceptable degree

of protection from the hazards addressed in this standard at the time the standard was issued.

1.4.1 Unless otherwise specified, the provisions of this standard shall not apply to facilities, equipment, structures, or installations that existed or were approved for construction or installation prior to the effective date of the standard. Where specified, the provisions of this standard shall be retroactive.

1.4.2 In those cases where the authority having jurisdiction determines that the existing situation presents an unacceptable degree of risk, the authority having jurisdiction shall be permitted to apply retroactively any portions of this standard deemed appropriate.

1.4.3 The retroactive requirements of this standard shall be permitted to be modified if their application clearly would be impractical in the judgment of the authority having jurisdiction and only where it is clearly evident that a reasonable degree of safety is provided.

1.5 Equivalency. Nothing in this standard is intended to prevent the use of systems, methods, or devices of equivalent or superior quality, strength, fire resistance, effectiveness, durability, and safety over those prescribed by this standard.

1.5.1 Technical documentation shall be submitted to the authority having jurisdiction to demonstrate equivalency.

1.5.2 The system, method, or device shall be approved for the intended purpose by the authority having jurisdiction.

1.6 Units and Formulas. The primary system of measurement for this standard is the International System of Units (SI). Inch-pound units are provided where necessary and applicable.

Chapter 2 Referenced Publications

2.1 General. The documents or portions thereof listed in this chapter are referenced within this standard and shall be considered part of the requirements of this document.

2.2 NFPA Publications. National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02169-7471.

NFPA 10, *Standard for Portable Fire Extinguishers*, 2022 edition.

NFPA 13, *Standard for the Installation of Sprinkler Systems*, 2022 edition.

NFPA 14, *Standard for the Installation of Standpipe and Hose Systems*, 2019 edition.

NFPA 15, *Standard for Water Spray Fixed Systems for Fire Protection*, 2022 edition.

NFPA 25, *Standard for the Inspection, Testing, and Maintenance of Water-Based Fire Protection Systems*, 2020 edition.

NFPA 1901, *Standard for Automotive Fire Apparatus*, 2016 edition.

2.3 Other Publications.

2.3.1 ASTM Publications. ASTM International, 100 Barr Harbor Drive, P.O. Box C700, West Conshohocken, PA 19428-2959.

ASTM D92, *Standard Test Method for Flash and Fire Points by Cleveland Open Cup Tester*, 2018.

ASTM D97, *Standard Test Method for Pour Point of Petroleum Products*, 2017b.

ASTM D1293, *Standard Test Methods for pH of Water*, 2018.

ASTM D2196, *Standard Test Methods for Rheological Properties of Non-Newtonian Materials by Rotational Viscometer*, 2020.

ASTM D2240, *Standard Test Method for Rubber Property — Durometer Hardness*, 2015e1.

ASTM D4976, *Standard Specification for Polyethylene Plastics Molding and Extrusion Materials*, 2012.

ASTM E729, *Standard Guide for Conducting Acute Toxicity Tests on Test Materials with Fishes, Macroinvertebrates, and Amphibians*, 1996, reaffirmed 2014.

ASTM G1, *Standard Practice for Preparing, Cleaning, and Evaluating Corrosion Test Specimens*, 2003, reaffirmed 2017e1.

ASTM G31, *Standard Guide for Laboratory Immersion Corrosion Testing of Metals*, 2021.

▲ 2.3.2 EPA Publications. Environmental Protection Agency, William Jefferson Clinton East Building, 1200 Pennsylvania Avenue, NW, Washington, DC 20460.

EPA Method 537.1, *Determination of Selected Per- and Polyfluorinated Alkyl Substances in Drinking Water by Solid Phase Extraction and Liquid Chromatography/Tandem Mass Spectrometry (LC/MS/MS)*, 2018.

OPPTS 835.3110, “Ready Biodegradability,” *Fate, Transport, and Transformation Test Guidelines*, January 1998.

OPPTS 850.1075, “Fish Acute Toxicity Test, Freshwater and Marine,” *Ecological Effects Test Guidelines*, April 1996 (December 2002).

OPPTS 870.1100, “Acute Oral Toxicity,” *Health Effects Test Guidelines*, August 1998.

OPPTS 870.1200, “Acute Dermal Toxicity,” *Health Effects Test Guidelines*, June 1996.

OPPTS 870.2400, “Acute Eye Irritation,” *Health Effects Test Guidelines*, August 1998.

OPPTS 870.2500, “Acute Dermal Irritation,” *Health Effects Test Guidelines*, August 1998.

2.3.3 ISO Publications. International Organization for Standardization, ISO Central Secretariat, BIBC II, Chemin de Blandonnet 8, CP 401, 1214 Vernier, Geneva, Switzerland.

ISO/IEC 17025, *General requirements for the competence of testing and calibration laboratories*, 2017.

2.3.4 NACE Publications. NACE International, 15835 Park Ten Place, Houston, TX 77084-4906.

NACE TM0169, *Standard Guide for Laboratory Immersion Corrosion Testing of Metals*, 2021.

■ 2.3.5 SAE Publications. SAE International, Society of Automotive Engineers, 400 Commonwealth Drive, Warrendale, PA 15096.

AMS C-9084, *Cloth, Glass, Finished, for Resin Laminates*, 1999.

AMS DTL-23059/5A, *Insulation Sleeving, Electrical, Heat Shrinkable, Polyolefin, Flexible, Crosslinked*, 2018.

AMS S-8802, *Sealing Compound, Fuel Resistant, Integral Fuel Tanks and Fuel Cell Cavities*, 2019.

AMS 3208M, *Chloroprene (CR) Rubber, Weather Resistant, 45-55*, 1998, reaffirmed June 2007.

▲ 2.3.6 UL Publications. Underwriters Laboratories Inc., 333 Pfingsten Road, Northbrook, IL 60062-2096.

UL 162, *Foam Equipment and Liquid Concentrates*, 1994, revised 2018.

UL 711/ULC CAN-S508, *Rating and Fire Testing of Fire Extinguishers*, 2018.

2.3.7 ULC Publications. Underwriters Laboratories of Canada, 7 Underwriters Road, Toronto, ON M1R 3A9, Canada.

ULC CAN-S560, *Category 3 Aqueous Film-Forming Foam (AFFF) Liquid Concentrates*, 2006, reaffirmed 2016.

▲ 2.3.8 US Government Publications. US Government Publishing Office, 732 North Capitol Street, NW, Washington, DC 20401-0001.

Title 40, Code of Federal Regulations, Part 86.113-94, “Air Programs — Fuel Specifications.”

Title 40, Code of Federal Regulations, Part 160, “Pesticide Programs — Good Laboratory Practice Standards.”

Title 40, Code of Federal Regulations, Part 792, “Toxic Substances Control Act — Good Laboratory Practice.”

■ 2.3.9 US Military Specifications. Standardization Documents Order Desk, Building 4D, 700 Robbins Ave., Philadelphia, PA 19111-5094.

MIL-A-A-55859A, *Tube, Nonmetallic, Polyvinyl Chloride (PVC) Flexible (General Use)*, 2002.

MIL-PRF-81733D, *Performance Specification: Sealing and Coating Compound, Corrosion Inhibitive*, 1998.

2.3.10 Other Publications.

Merriam-Webster’s Collegiate Dictionary, 11th edition, Merriam-Webster, Inc., Springfield, MA, 2003.

2.4 References for Extracts in Mandatory Sections.

NFPA 10, *Standard for Portable Fire Extinguishers*, 2022 edition.

NFPA 11, *Standard for Low-, Medium-, and High-Expansion Foam*, 2021 edition.

NFPA 36, *Standard for Solvent Extraction Plants*, 2021 edition.

NFPA 1145, *Guide for the Use of Class A Foams in Fire Fighting*, 2022 edition.

NFPA 1150, *Standard on Foam Chemicals for Fires in Class A Fuels*, 2022 edition.

Chapter 3 Definitions

3.1 General. The definitions contained in this chapter shall apply to the terms used in this standard. Where terms are not defined in this chapter or within another chapter, they shall be defined using their ordinarily accepted meanings within the context in which they are used. *Merriam-Webster’s Collegiate Dictionary*, 11th edition, shall be the source for the ordinarily accepted meaning.

3.2 NFPA Official Definitions.

3.2.1* Approved. Acceptable to the authority having jurisdiction.

3.2.2* Authority Having Jurisdiction (AHJ). An organization, office, or individual responsible for enforcing the requirements of a code or standard, or for approving equipment, materials, an installation, or a procedure.

3.2.3 Labeled. Equipment or materials to which has been attached a label, symbol, or other identifying mark of an organization that is acceptable to the authority having jurisdiction and concerned with product evaluation, that maintains periodic inspection of production of labeled equipment or materials, and by whose labeling the manufacturer indicates compliance with appropriate standards or performance in a specified manner.

3.2.4* Listed. Equipment, materials, or services included in a list published by an organization that is acceptable to the authority having jurisdiction and concerned with evaluation of products or services, that maintains periodic inspection of production of listed equipment or materials or periodic evaluation of services, and whose listing states that either the equipment, material, or service meets appropriate designated standards or has been tested and found suitable for a specified purpose.

3.2.5 Shall. Indicates a mandatory requirement.

3.2.6 Standard. An NFPA standard, the main text of which contains only mandatory provisions using the word “shall” to indicate requirements and that is in a form generally suitable for mandatory reference by another standard or code or for adoption into law. Nonmandatory provisions are not to be considered a part of the requirements of a standard and shall be located in an appendix, annex, footnote, informational note, or other means as permitted in the NFPA manuals of style. When used in a generic sense, such as in the phrases “standards development process” or “standards development activities,” the term “standards” includes all NFPA standards, including codes, standards, recommended practices, and guides.

3.3 General Definitions.

3.3.1 Application Rate. Amount or volume of water additive solution applied over a specified area, over a specified period of time, typically expressed in liters per minute per square meter (gallons per minute per square foot).

3.3.2 Biodegradability. A measure of the decomposition of organic matter through the action of microorganisms. [1150, 2022]

3.3.3 Class A Fires. Class A fires are fires in ordinary combustible materials, such as wood, cloth, paper, rubber, and many plastics. [10;5.2.1]

Δ 3.3.4* Class B Fires. Class B fires are fires in flammable liquids, combustible liquids, and flammable gases. [10;5.2.2]

3.3.5 Class C Fires. Class C fires are fires that involve energized electrical equipment. [10;5.2.3]

N 3.3.6 Class D Fires. Class D fires are fires in combustible metals, such as magnesium, titanium, zirconium, sodium, lithium, and potassium. [10;5.2.4]

N 3.3.7 Class K Fires. Class K fires are fires in cooking appliances that involve combustible cooking media (vegetable or animal oils and fats). [10;5.2.5]

3.3.8 Combustible Liquid. Any liquid that has a closed-cup flash point at or above 37.8°C.

3.3.9* Concentration. The percent of water additive concentrate contained in a water additive solution.

3.3.10* Demulsification. A process either physical or chemical by which an emulsion is broken down to its original constituents.

3.3.11* Discharge Device. A device designed to discharge water or foam–water solution or water additive solution in a predetermined, fixed, or adjustable pattern.

3.3.12 Eductor (Inductor). A device that uses the Venturi principle to introduce a proportionate quantity of water additive concentrate into a water stream; the pressure at the throat is below atmospheric pressure and will draw in liquid from atmospheric storage.

3.3.13 Emulsification. The process of forming an emulsion. (See also 3.3.15, *Emulsion*.)

3.3.14 Emulsifier. A chemical or mixture of chemicals that along with some energy input promotes the formation of an emulsion.

3.3.15* Emulsion. A heterogeneous system, consisting of at least one immiscible liquid dispersed in another in the form of droplets.

3.3.16* Fixed Monitor (Cannon). A device that delivers a large water additive solution stream and is mounted on a stationary support that either is elevated or is at grade.

3.3.17 Flammable Liquid. A liquid that has a closed-cup flash point that is below 37.8°C and a maximum vapor pressure of 2068 mm Hg at 37.8°C.

3.3.18* Handline. A hose and nozzle that can be held and directed by hand. [11, 2021]

3.3.19 Hydrocarbon. A chemical substance consisting of only hydrogen and carbon atoms. [36, 2021]

3.3.20 Indirect Attack. Fire-fighting operations involving the application of extinguishing agents to reduce the buildup of heat released from a fire without applying the agent directly onto the burning fuel. [1145, 2017]

3.3.21 LC₅₀ (Lethal Concentration₅₀). The concentration of agent in water, usually expressed as milligrams of agent in a liter or solution, that results in the death of 50 percent of the aquatic test specimens within a specified time frame. [1150, 2022]

3.3.22 LD₅₀ (Lethal Dosage₅₀). The dosage of a chemical, usually expressed as milligrams of the chemical per kilogram of body weight of the test animal, at which 50 percent of the test animals die within a specified time frame. [1150, 2022]

3.3.23* Micelle. The basic building unit of an emulsion.

3.3.24 Miscibility. The property of being capable of mixing in any ratio without separation into phases. [1150, 2022]

3.3.25 Portable Monitor (Cannon). A device that delivers a large water additive solution stream and is mounted on a movable support or wheels so it can be transported to the fire scene.

3.3.26 Proportioning. The introduction of water additive concentrate at the recommended ratio into the water stream to form a water additive solution.

N 3.3.27 Self-Contained and Semi-Portable Detection, Notification, and Suppression System. A prepackaged system of listed components capable of detection, notification, and suppression of a fire hazard utilizing water or another listed water additive stored in a tank and delivered by a monitor(s).

3.3.28 Surface Active Agent (Surfactant). A chemical agent that materially reduces the surface tension of water.

3.3.29 Surface Tension. The elastic-like force at the surface of a liquid, which tends to minimize the surface area, causing drops to form. [1150, 2022]

3.3.30 Synthetic or Artificial Sea Water. A solution consisting of 1.10 percent magnesium chloride hexahydrate, 0.16 percent calcium chloride dihydrate, 0.40 percent anhydrous sodium sulfate, 2.50 percent sodium chloride, and 95.84 percent deionized or distilled water.

3.3.31 Three-Dimensional (3D) Class B Fire. A liquid fuel fire that flows freely from a vertical height, falling on associated equipment or structure, down to a static pooled surface fire.

3.3.32* Water Additive. An agent that, when added to water in proper quantities, suppresses, cools, mitigates fire and/or vapors, and/or provides insulating properties for fuels exposed to radiant heat or direct flame impingement.

3.3.33* Water Additive Concentrate. The chemical or chemical composition as received from the manufacturer.

3.3.34* Water Additive Solution. A homogeneous mixture of water and water additive concentrate.

Chapter 4 Uses and Limitations

4.1 General. Water additive concentrates used in preventing combustible and flammable liquid vapor explosions, removing the flammability of combustible and flammable liquid spills, or extinguishing fires shall be tested and approved, classified, labeled, or listed by a third-party independent testing/listing organization acceptable to the authority having jurisdiction.

4.2 Limitations.

Δ 4.2.1 Water additive concentrate shall be mixed only with water.

Δ 4.2.2 Unless otherwise tested, listed, or classified for use on a specific water reactive chemical, water additive solution shall have the same limitations as water with respect to extinguishing fires involving chemicals that react with water to create additional hazards.

N 4.2.3 Unless otherwise specifically tested, listed, or classified, the use of water additive solution for the extinguishment of fires involving Class B flammable or combustible liquids shall be limited to those fuels not soluble in water.

N 4.2.4 Unless otherwise specifically tested, listed, or classified, the use of fire extinguishers and fixed fire-extinguishing systems using water additive solution shall not be permitted for the extinguishment of fires in commercial cooking equipment that involve combustible cooking media.

N 4.3* Uses and Applications.

N 4.3.1 Class A Fires. Water additive solutions for use on the following hazard and applications shall be evaluated for use on Class A fires in accordance with Chapter 6:

- (1) Material handling — storage piles, sheds (coal, biomass, grain, gluten, other combustible dust)
- (2) Material handling — silos, bunkers, hoppers (coal, biomass, grain, gluten, other combustible dust)
- (3) Material handling — dust collectors (coal, biomass, grain, gluten, other combustible dust)
- (4) Material handling — conveyors (coal, biomass, grain, gluten, other combustible dust)
- (5) Flue gas bag-type dust collectors
- (6) Rubber tire and rubber tire recycling (processing, grinding, storage)
- (7) Structural firefighting and exposure protection
- (8) Other applications as tested, listed, and approved by or acceptable to the authority having jurisdiction

N 4.3.2 Class B 2D Fires. Water additive solutions for use on the following hazard and applications shall be evaluated for use on Class B 2D fires in accordance with Sections 7.2 or 7.3:

- (1) Aircraft (group III hangars, pool fire)
- (2) Other applications as tested, listed, and approved by or acceptable to the authority having jurisdiction

N 4.3.3 Class B 3D Fires. Water additive solutions for use on the following hazard and applications shall be evaluated for use on Class B 3D fires in accordance with Sections 7.4 or 7.5:

- (1) Boiler front — multiple oil-fired burners/igniters
- (2) Auxiliary boilers
- (3) Regenerative air heaters
- (4) Transformer — rectifier sets
- (5) Transformer — oil-filled
- (6) Hydraulic control systems
- (7) Turbine — generator area
- (8) Turbine — generator bearings
- (9) Lubricating oil lines/pressurized oil spray
- (10) Lubrication oil reservoirs and handling equipment
- (11) Emergency generators
- (12) Flammable liquid rack storage
- (13) Aircraft (group III hangars)
- (14) Other applications as tested, listed, and approved by or acceptable to the authority having jurisdiction

4.3.4* Class C Fires. Water additive solutions for use on the following hazard and applications shall be evaluated for use on Class C fires in accordance with Chapter 8:

- (1) Energized electrical cable
- (2) Other applications as tested, listed, and approved by or acceptable to the authority having jurisdiction

4.3.5* Class D Fires. Water additive solutions for use on the following hazard and applications shall be evaluated for use on Class D fires in accordance with Chapter 9:

- (1) Metals and metal recycling (process, storage)
- (2) Transportation, automotive, shipping
- (3) Aircraft manufacturing
- (4) Other applications as tested, listed, and approved by or acceptable to the authority having jurisdiction

N 4.3.6 Combustible and Flammable Liquid Fuel Spill Control (Nonpolar and Polar). Water additive solutions for use on the following hazard and applications shall be evaluated for use on

Class B combustible and flammable liquid spill control (nonpolar and polar) in accordance with Section 7.7:

- (1)* Combustible and flammable liquid fuel spill
- (2) Other applications as tested, listed, and approved by or acceptable to the authority having jurisdiction

N 4.3.7 Combustible and Flammable Liquid Vapor Encapsulation Explosion Prevention (VEEP). Water additive solutions for use on the following hazard and applications shall be evaluated for Class B combustible and flammable liquid VEEP (nonpolar and polar) in accordance with Section 7.7:

- (1) Refinery processing area pipe leaks
- (2) Flammable liquid truck loading racks
- (3) Pump seal leaks
- (4) Distillation column
- (5) Other applications as tested, listed, and approved by or acceptable to the authority having jurisdiction

4.4* Compatibility of Water Additive Concentrate and Solutions.

4.4.1 Water additive concentrate of different brands and other types of concentrate intended for fire prevention, control, suppression, extinguishment, or vapor mitigation shall not be mixed.

4.4.2 Premixed solution prepared with water additive concentrate of different brands and premixed solution prepared with other types of concentrate intended for fire prevention, control, suppression, extinguishment, or vapor mitigation shall not be mixed within the same storage container.

4.4.3 Solution generated separately with water additive concentrate of different brands shall be permitted to be applied to a fire in sequence or simultaneously.

4.4.4 Solution generated with water additive concentrate and solution generated with other types of concentrate intended for fire prevention, control, suppression, extinguishment, or vapor mitigation shall be permitted to be applied to a fire in sequence or simultaneously if approved by the authority having jurisdiction.

4.5 Concentrations. Water additive solution shall be used only in concentrations specified by their listing.

Chapter 5 Properties and General Test Protocols for Evaluation of Water Additive Concentrate and Solution

5.1 General.

5.1.1 Water additive concentrate and water additive solution prepared at the concentrations specified for use by the manufacturer shall be subjected to the tests in this chapter.

5.1.2 The tests detailed in this chapter shall be conducted by an approved independent laboratory using laboratory practices in accordance with 40 CFR 160 and 40 CFR 792 and calibration competency in accordance with ISO/IEC 17025, or equivalent as applicable.

5.1.3 The information developed in response to the requirements of this chapter shall be reported on the manufacturer's technical data sheet and made available to potential users.

5.2 Toxicity and Environmental Tests.

5.2.1 Mammalian Toxicity.

Δ 5.2.1.1 Where water additive concentrate and water additive solution prepared at the maximum concentration specified for use by the manufacturer's water additive listing are to be used, they shall be tested in accordance with the following tests or equivalent tests recognized by the authority having jurisdiction:

- (1) OPPTS 870.1100, for acute oral toxicity
- (2) OPPTS 870.1200, for acute dermal toxicity
- (3) OPPTS 870.2400, for acute eye irritation
- (4) OPPTS 870.2500, for acute dermal irritation

N 5.2.1.2 Where water additive solution prepared at the maximum concentration specified for use by the manufacturer's water additive listing is to be used, it shall be tested for toxic fluorinated ingredients in accordance with EPA Method 537.1 by an EPA-approved laboratory or a laboratory that is recognized by the authority having jurisdiction.

5.2.1.3* The water additive concentrate and water additive solution prepared at the maximum concentration specified for use by the manufacturer shall not exceed the toxicity limits acceptable to the authority having jurisdiction.

5.2.2 Aquatic Toxicity.

Δ 5.2.2.1 Water additive concentrates and water additive solution prepared at the maximum concentration specified for use by the manufacturer shall be tested, using *Oncorhynchus mykiss* (rainbow trout), in accordance with OPPTS 850.1075, ASTM E729, or an equivalent test procedure that is recognized by the authority having jurisdiction where the water additive is to be used.

5.2.2.2 In accordance with ASTM E729, 10 fish that are 60 days $\pm$ 15 days posthatch shall be exposed under static conditions to each level of a water additive solution in soft water as defined in ASTM E729 for 96 hours at $12^{\circ}\text{C} \pm 1^{\circ}\text{C}$.

5.2.2.3* The water additive concentrate shall have an LC_{50} acceptable to the authority having jurisdiction when tested in accordance with ASTM E729 and when measured after 96 hours of static exposure.

5.2.3 Biodegradability.

5.2.3.1* The concentrate shall be readily biodegradable or biodegradable when tested in accordance with 5.2.3.2 through 5.2.3.5.

Δ 5.2.3.2 The biodegradability of the concentrate shall be determined in accordance with Section M, CO_2 Evolution (Modified Sturm) Test, of OPPTS 835.3110 or equivalent test recognized by the authority having jurisdiction.

5.2.3.3 Testing shall be conducted for a minimum of 28 days and shall be continued until an oxygen depletion plateau is reached.

5.2.3.4 Testing shall be discontinued at the end of 42 days, even if the plateau has not been reached.

5.2.3.5 At least one reference substance shall be used to monitor inoculum activity.

5.3 Physical Properties.

5.3.1 Concentrate Pour Point. The concentrate pour point shall be determined in accordance with ASTM D97.

5.3.2 Concentrate Miscibility.

5.3.2.1 The concentrate shall be miscible in water and result in a homogenous solution at the concentrations specified for use by the manufacturer. Opalescence shall be considered equivalent to homogeneity.

5.3.2.2 The concentrate miscibility shall be determined in accordance with 5.3.2.2.1 through 5.3.2.2.9.

5.3.2.2.1 The water and the concentrate shall be conditioned to each of the temperature combinations shown in Table 5.3.2.2.1.

5.3.2.2.2 Five hundred milliliters of deionized water conditioned to the test temperature shall be added to a 1 L glass beaker.


5.3.2.2.3 A stirrer, as illustrated in Figure 5.3.2.2.3, shall be inserted into the water to the depth shown in the figure.

5.3.2.2.4 The stirrer motor shall be adjusted to 60 rpm $\pm$ 10 rpm.

5.3.2.2.5 The required amount of concentrate conditioned to the test temperature shall be added to the beaker of water within 2 seconds.

Table 5.3.2.2.1 Temperature Combinations of Water Additive Concentrates and Water for Miscibility Testing

Water Additive Temperature	Water Temperature
°C	°C
4 $\pm$ 1	21 $\pm$ 1
21 $\pm$ 1	21 $\pm$ 1
4 $\pm$ 1	4 $\pm$ 1
21 $\pm$ 1	4 $\pm$ 1

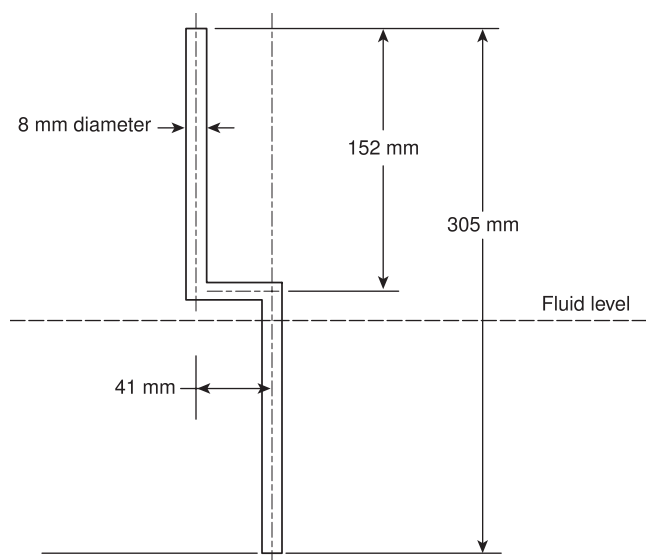

Note: All measurements are approximate.

FIGURE 5.3.2.2.3 Stirrer Shaft for Miscibility Test.

5.3.2.2.6 After 10 revolutions of the stirrer, rotation shall be stopped and the liquid shall be visually examined. If the solution is visually homogeneous, the number of revolutions shall be recorded and the result recorded as miscible.

5.3.2.2.7 If the solution is not visually homogeneous, it shall be stirred for an additional 10 revolutions.

5.3.2.2.8 The procedure described in 5.3.2.2.6 and 5.3.2.2.7 shall be repeated until the total number of revolutions is 100 or the solution is visually homogeneous.

5.3.2.2.9 If the solution is not visually homogeneous immediately following 100 revolutions, the results shall be recorded as not miscible.

5.3.3 Concentrate pH. The pH of the concentrate at 18°C $\pm$ 2.7°C shall be between 6 and 9 when tested in accordance with ASTM D1293.

5.3.4 Concentrate Viscosity.

5.3.4.1 The concentrate viscosity shall be determined and reported in terms of absolute viscosity (centipoise).

5.3.4.2 Two samples of concentrate shall be conditioned to temperatures of 2°C, 21°C, and 49°C prior to measuring the viscosity.

5.3.4.3* A viscometer rotating at 60 rpm with the appropriate spindle shall be used to measure the viscosity in accordance with ASTM D2196.

5.3.4.4 Triplicate measurements of the viscosity of each sample shall be made, with the sample being stirred gently between measurements.

5.3.4.5 The three viscosity measurements for each sample shall be averaged.

5.3.5 Alternate Viscosity Test Methods.

5.3.5.1 Where the preferred method does not provide usable results, an alternative test method shall be permitted.

5.3.5.2 Where an alternative test method is used, the method and test conditions shall be documented and reported with the reported results.

5.3.6 Concentrate Flash Point. The open cup flash point of the concentrate shall be determined in accordance with ASTM D92.

5.4 Stability.

5.4.1 Concentrate Stability.

5.4.1.1 Three 19 L samples of water additive concentrate from a single production lot shall be stored in sealed containers as described in 5.4.1.4, 5.4.1.5, and 5.4.1.6.

5.4.1.2 The samples shall be designated as Sample 1, Sample 2, and Sample 3.

5.4.1.3* Samples shall not be agitated at any time during or between storage periods.

5.4.1.4 Sample 1.

5.4.1.4.1 Sample 1 shall be stored at 41°C $\pm$ 3°C for 30 continuous days.

5.4.1.4.2 At the end of 30 days, Sample 1 shall be removed from the $41^{\circ}\text{C} \pm 3^{\circ}\text{C}$ environment and immediately stored at $21^{\circ}\text{C} \pm 2^{\circ}\text{C}$ for 168 hours.

5.4.1.4.3 Sample 1 shall be handled, opened, and inspected in accordance with 5.4.1.7.

5.4.1.5 Sample 2.

5.4.1.5.1 Sample 2 shall be stored at $41^{\circ}\text{C} \pm 3^{\circ}\text{C}$ for 30 continuous days in a manner identical to that for Sample 1.

5.4.1.5.2 At the end of the 30 days, Sample 2 shall be placed immediately in an environment at a temperature of $-10^{\circ}\text{C} \pm 1^{\circ}\text{C}$.

5.4.1.5.3 Sample 2 shall be kept in this cold environment for a continuous 30-day period.

5.4.1.5.4 At the end of the second 30 days, Sample 2 shall be removed from the $-10^{\circ}\text{C} \pm 1^{\circ}\text{C}$ environment and then placed immediately in an environment of $21^{\circ}\text{C} \pm 2^{\circ}\text{C}$ for 168 hours.

5.4.1.5.5 Sample 2 then shall be handled, opened, and inspected in accordance with 5.4.1.7.

5.4.1.6 Sample 3.

5.4.1.6.1 Sample 3 shall be stored at $-10^{\circ}\text{C} \pm 1^{\circ}\text{C}$ for 30 continuous days.

5.4.1.6.2 At the end of the 30 days, Sample 3 shall be removed from the $-10^{\circ}\text{C} \pm 1^{\circ}\text{C}$ environment and immediately placed at a temperature of $21^{\circ}\text{C} \pm 2^{\circ}\text{C}$ for 168 hours.

5.4.1.6.3 Sample 3 shall then be handled, opened, and inspected in accordance with 5.4.1.7.

5.4.1.7 Concentrate Handling, Opening, and Inspection.

5.4.1.7.1 At the end of the storage periods described in 5.4.1.4 through 5.4.1.6, each sealed sample container shall be inverted four times within a 1-minute period.

5.4.1.7.2 Each sample shall be opened and the water additive concentrate poured into an open pail and allowed to sit undisturbed for 10 minutes to allow bubbles to rise to the surface.

5.4.1.7.3 Each sample then shall be visually examined for separation, stratification, and crystallization.

5.4.1.7.4 Each empty container shall be examined as well for any evidence of residual sediment or crystals.

5.4.1.7.5 The water additive concentrate shall not be stratified, crystallized, or otherwise separated at the end of any test outlined in 5.4.1.

5.4.2 Solution Separation on Standing.

5.4.2.1* If the water additive solution is to be stored for more than 30 days, the water additive solution, in concentrations specified for use by the manufacturer, shall display no tendency to stratify or otherwise separate when stored undisturbed for 30 days in a closed container at the minimum and maximum concentrations and at $21^{\circ}\text{C} \pm 3^{\circ}\text{C}$.

5.4.2.2 The formation of two or more distinct layers or the presence of precipitate occurring during the course of the test shall be considered as separation.

5.5 Uniform Corrosion.

5.5.1 The water additive and its solutions shall not have corrosion rates exceeding those shown in Table 5.5.1 when tested in accordance with Section 5.5.

Table 5.5.1 Maximum Allowable Corrosion Rates (mils per year) for Wildland Fire Chemical Products

Temperature (°F)	2024-T3 Aluminum				4130 Steel				Yellow Brass	AZ31B Magnesium			
	Total		Partial		Total		Partial		Partial	Total		Partial	
	70	120	70	120	70	120	70	120	120	70	120	70	120
<i>mils per year</i>													
Concentrates													
Wet concentrates for fixed-tank helicopters	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0
Wet concentrates ^a except for fixed-tank helicopters	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0
Mixed products													
Fixed-tank helicopters ^b	2.0	2.0	2.0	2.0	5.0	5.0	5.0	5.0	5.0	4.0	4.0	4.0	4.0
Fixed-wing air tankers ^c	2.0	2.0	2.0	2.0	5.0	5.0	5.0	5.0	5.0				
Helicopter bucket and ^a ground-based application	2.0	2.0	2.0	2.0	5.0	5.0	5.0	5.0	5.0				

Note: All uniform corrosion rates shall be determined by 90-day weight loss tests. All uniform corrosion rates are the maximum allowable average of all replicates.

^aMagnesium uniform corrosion tests shall be performed for performance information. Intergranular corrosion tests are not required on aluminum or magnesium.

^bIntergranular corrosion tests shall be performed on aluminum and magnesium coupons; no intergranular corrosion is allowed.

^cIntergranular corrosion tests shall be performed on aluminum coupons; no intergranular corrosion is allowed. Magnesium uniform corrosion tests shall be performed for performance information. Intergranular corrosion tests are not required on magnesium.