Supplementary Information

The following information is associated with Network Rail Standard:
NR CIV/SD/3038 Rev P1

Additional Content Access

Click the link below to access CAD version of this drawing.

CAD Drawing

- CIV/SD/3038

If you have any questions, or need assistance, please contact **IHS Support**

Information accessed via the links above is the property of the Copyright holder

IHS Additional Content Page

Documents
Document Sharing Hub

Copyright Network Rail
Provided by IHS under license with Network Rail
No reproduction or networking permitted without license from IHS
Full document details: NR NR-CIV-SD-3038 ISSUE P1 2006

Licensee=Weston Williamson/5989497001, User=sam, albett
Not for Resale, 03/28/2016 00:37:56 MDT

Full document details: NR NR-CIV-SD-3038 ISSUE P1 2006

A3

Notes

1. This drawing is to be read in conjunction with drawing No. NR/CIV/SD/3035 & 3036 drawings listed thereon.

2. All dimensions shown are in millimetres unless stated otherwise.

3. Where S&C exists adjacent to or near the ends of the platform, the effects of vehicle end throw shall be taken into account.

4. Vertical camber of the precast members to be taken into account in setting out the coping units, mortar bed to be adjusted and insitu topping depth to suit.

5. No drilling is allowed into precast prestressed hollow core planks. Prestressed planks to be designed to allow for their dead load and the following nominal thickness:
75mm Insitu topping
25mm Mortar bed
100mm Precast coper
plus allowance of an extra 40mm topping for future track lifts.
Imposed live load of 5kN/m² or 5kN point load on 300x300mm area, which ever produces the worst case.
Precast planks should comply with the following requirements:–
Minimum cover to reinforcement 30mm
Class 2 serviceability classification to BS8110–1
Nominal unloaded camber 25mm
Typical plank depths for varying spans are:–

Structural Depth (mm)	Wall centres (m)
150	3.0 – 5.0
200	5.01– 6.5
250	6.51– 7.5

End 300mm of voids in precast planks to be filled with concrete grout during manufacture.

6. All mortar joints to be 10mm thick unless noted otherwise.

OVERSAIL UNIT APPROX.
48kg SUBJECT TO MANUAL
HANDLING RESTRICTIONS

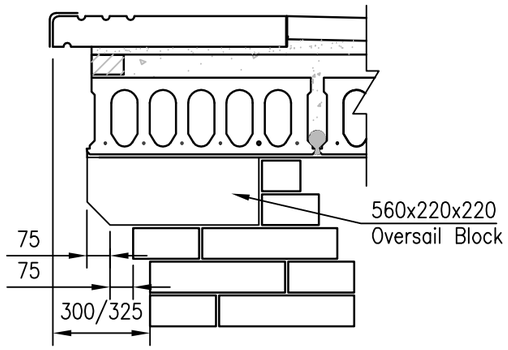

ALTERNATIVE OVERSAIL DETAIL
Scale 1:20

Rev	Date	Description of revision	Design'd	C'kd
P1				

Network Rail

40 Melton Street
London NW1 2EE

Tel: 020–7557–8000

Approved —		Prog.Eng. Manager Civils, MP & I		
Authorised —		Director of Civil Engineering		
	Name	Position	Signature	Date

Master copy with original signatures held by Network Rail HQ
CIVIL ENGINEERING STANDARD DESIGN

© COPYRIGHT NETWORK RAIL 2006

Standard Platform Design

Type 2 Crosswall Platform
Sheet 4 of 14
Crosswall Without Cantilever Beams

Scale	As Shown	
Drawing Number	NR/CIV/SD/3038	P1

Documents
Document Sharing Hub
License=Weston Williamson/5989497001, User=sam, albett
Not for Resale, 03/28/2016 00:37:56 MDT
Copyright Network Rail
Provided by IHS under license with Network Rail
No reproduction or networking permitted without license from IHS