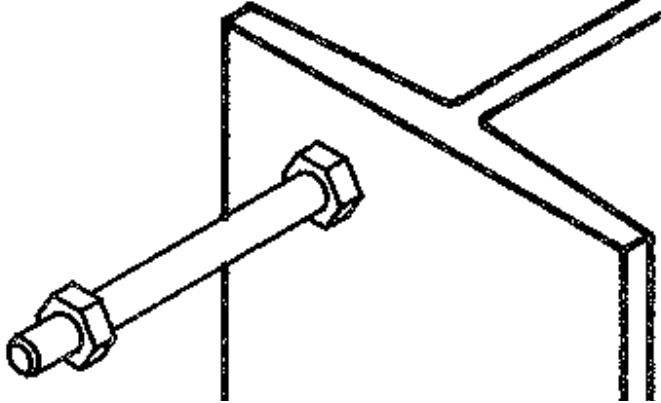


Ref:	NR/L2/ELP/27009/MOD C70
Issue:	1
Date:	03/12/2011
Compliance date:	03/03/2012
Page	1 of 2

OVERHEAD LINE CAMPAIGN CHANGES – DATA SHEET	
70	RENEW DEP STALKS WITHOUT END NUTS.
COMPONENT	Designated Earthing Point (DEP) stalks without retaining nuts fitted.
PROBLEM	Early designs of DEP stalk did not have a retaining nut fitted leading to an increased risk of the earth sliding off the DEP stalk.
ACTION REQUIRED	<p>Replace DEP stalks with stalks that have threads cut at both ends and add retaining nut.</p> <p>See OLEMI drawing 1/199/814.</p> 

Reference Information	
Ellipse standard job number	13070
Ellipse standard job description	Renew DEP stalk without end nuts
Category	Structure
Priority	Yes
Types of OLE affected	Mk1
Original equipment dates	After 2002

Ref:	NR/L2/ELP/27009/MOD C70
Issue:	1
Date:	03/12/2011
Compliance date:	03/03/2012
Page	2 of 2

OVERHEAD LINE CAMPAIGN CHANGES – DATA SHEET

70

RENEW DEP STALKS WITHOUT END NUTS.

