

# Field device tool (FDT) interface specification —

Part 515: Communication implementation for  
common object model - IEC 61784 CPF 15

**National foreword**

This Published Document is the UK implementation of CLC/TR 62453-515:2009.

The UK participation in its preparation was entrusted to Technical Committee AMT/7, Industrial communications: process measurement and control, including fieldbus.

A list of organizations represented on this committee can be obtained on request to its secretary.

This publication does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

© BSI 2010

ISBN 978 0 580 62574 9

ICS 25.040.40; 35.100.05; 35.110

**Compliance with a British Standard cannot confer immunity from legal obligations.**

This Published Document was published under the authority of the Standards Policy and Strategy Committee on 31 January 2010

**Amendments issued since publication**

| Amd. No. | Date | Text affected |
|----------|------|---------------|
|----------|------|---------------|

TECHNICAL REPORT  
RAPPORT TECHNIQUE  
TECHNISCHER BERICHT

**CLC/TR 62453-515**

November 2009

ICS 25.040.40; 35.100.05; 35.110

English version

**Field device tool (FDT) interface specification -  
Part 515: Communication implementation for common object model -  
IEC 61784 CPF 15  
(IEC/TR 62453-515:2009)**

Spécification des interfaces des outils  
des dispositifs de terrain (FDT) -  
Partie 515: Implémentation  
des communications  
pour le modèle objet commun -  
CEI 61784 CPF 15  
(CEI/TR 62453-515:2009)

Field Device Tool (FDT) -  
Schnittstellenspezifikation -  
Teil 515: Kommunikationsimplementierung  
mit dem allgemeinen Objektmodell (COM) -  
Kommunikationsprofilfamilie (CPF) 15  
nach IEC 61784  
(IEC/TR 62453-515:2009)

This Technical Report was approved by CENELEC on 2009-10-01.

CENELEC members are the national electrotechnical committees of Austria, Belgium, Bulgaria, Cyprus, the Czech Republic, Denmark, Estonia, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Latvia, Lithuania, Luxembourg, Malta, the Netherlands, Norway, Poland, Portugal, Romania, Slovakia, Slovenia, Spain, Sweden, Switzerland and the United Kingdom.

**CENELEC**

European Committee for Electrotechnical Standardization  
Comité Européen de Normalisation Electrotechnique  
Europäisches Komitee für Elektrotechnische Normung

**Central Secretariat: Avenue Marnix 17, B - 1000 Brussels**

© 2009 CENELEC - All rights of exploitation in any form and by any means reserved worldwide for CENELEC members.

Ref. No. CLC/TR 62453-515:2009 E

**AVA** **Documents**  
Document Sharing Hub

## Foreword

The text of document 65E/71/CDV, future edition 1 of IEC/TR 62453-515, prepared by SC 65E, Devices and integration in enterprise systems, of IEC TC 65, Industrial-process measurement, control and automation, was submitted to the IEC-CENELEC parallel vote and was approved by CENELEC as CLC/TR 62453-515 on 2009-10-01.

This standard is to be used in conjunction with EN 62453-3xy series.

Annex ZA has been added by CENELEC.

---

## Endorsement notice

The text of the Technical Report IEC/TR 62453-515:2009 was approved by CENELEC as a Technical Report without any modification.

In the official version, for Bibliography, the following note has to be added for the standard indicated:

IEC 61158-5-15      NOTE Harmonized as EN 61158-5-15:2008 (not modified).

## Annex ZA (normative)

### Normative references to international publications with their corresponding European publications

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

NOTE When an international publication has been modified by common modifications, indicated by (mod), the relevant EN/HD applies.

| <u>Publication</u> | <u>Year</u>     | <u>Title</u>                                                                                                                             | <u>EN/HD</u>    | <u>Year</u>        |
|--------------------|-----------------|------------------------------------------------------------------------------------------------------------------------------------------|-----------------|--------------------|
| IEC 61131-3        | - <sup>1)</sup> | Programmable controllers -<br>Part 3: Programming languages                                                                              | EN 61131-3      | 2003 <sup>2)</sup> |
| IEC 61784-2        | - <sup>1)</sup> | Industrial communication networks - Profiles -<br>Part 2: Additional fieldbus profiles for real-time<br>networks based on ISO/IEC 8802-3 | EN 61784-2      | 2008 <sup>2)</sup> |
| IEC 62453-1        | 2009            | Field device tool (FDT) interface<br>specification -<br>Part 1: Overview and guidance                                                    | EN 62453-1      | 2009               |
| IEC 62453-2        | 2009            | Field device tool (FDT) interface<br>specification -<br>Part 2: Concepts and detailed description                                        | EN 62453-2      | 2009               |
| IEC/TR 62453-41    | 2009            | Field device tool (FDT) interface<br>specification -<br>Part 41: Object model integration profile -<br>Common object model               | CLC/TR 62453-41 | 2009               |
| IEC 62453-315      | 2009            | Field device tool (FDT) interface<br>specification -<br>Part 315: Communication profile integration -<br>IEC 61784 CPF 15                | EN 62453-315    | 2009               |

---

<sup>1)</sup> Undated reference.

<sup>2)</sup> Valid edition at date of issue.

## CONTENTS

|                                                                                   |    |
|-----------------------------------------------------------------------------------|----|
| INTRODUCTION.....                                                                 | 5  |
| 1 Scope.....                                                                      | 6  |
| 2 Normative references .....                                                      | 6  |
| 3 Terms, definitions, symbols, abbreviated terms and conventions .....            | 7  |
| 3.1 Terms and definitions .....                                                   | 7  |
| 3.2 Symbols and abbreviated terms.....                                            | 7  |
| 3.3 Conventions .....                                                             | 7  |
| 3.3.1 Data type names and references to data types .....                          | 7  |
| 3.3.2 Vocabulary for requirements .....                                           | 7  |
| 4 Bus category .....                                                              | 7  |
| 5 Access to instance and device data .....                                        | 7  |
| 6 Protocol specific usage of general data types .....                             | 7  |
| 7 Protocol specific common data types .....                                       | 8  |
| 8 Network management data types .....                                             | 8  |
| 8.1 General .....                                                                 | 8  |
| 8.2 Modbus device address - FDTModbusAddressSchema .....                          | 8  |
| 9 Communication data types - FDTModbusCommunicationSchema .....                   | 9  |
| 10 Channel parameter data types - FDTModbusChannelParameterSchema .....           | 17 |
| 11 Device identification .....                                                    | 19 |
| 11.1 Device type identification data types - FDTModbusIdentSchema .....           | 19 |
| 11.2 Topology scan data types - DTMModbusDeviceSchema .....                       | 20 |
| 11.3 Scan identification data types - FDTModbusScanIdentSchema.....               | 21 |
| 11.4 Device type identification data types - FDTModbusDeviceTypeIdentSchema ..... | 23 |
| 11.5 XSLT Transformation .....                                                    | 24 |
| Bibliography.....                                                                 | 30 |
| Figure 1 – Part 515 of the IEC 62453 series .....                                 | 5  |
| Table 1 – Protocol specific usage of general data types.....                      | 8  |

## INTRODUCTION

This part of IEC 62453 is an interface specification for developers of FDT (Field Device Tool) components for function control and data access within a client/server architecture. The specification is a result of an analysis and design process to develop standard interfaces to facilitate the development of servers and clients by multiple vendors that need to interoperate seamlessly.

With the integration of fieldbusses into control systems, there are a few other tasks which need to be performed. In addition to fieldbus- and device-specific tools, there is a need to integrate these tools into higher-level system-wide planning- or engineering tools. In particular, for use in extensive and heterogeneous control systems, typically in the area of the process industry, the unambiguous definition of engineering interfaces that are easy to use for all those involved is of great importance.

A device-specific software component, called DTM (Device Type Manager), is supplied by the field device manufacturer with its device. The DTM is integrated into engineering tools via the FDT interfaces defined in this specification. The approach to integration is in general open for all kind of fieldbusses and thus meets the requirements for integrating different kinds of devices into heterogeneous control systems.

Figure 1 shows how IEC/TR 62453-515 is aligned in the structure of IEC 62453 series.

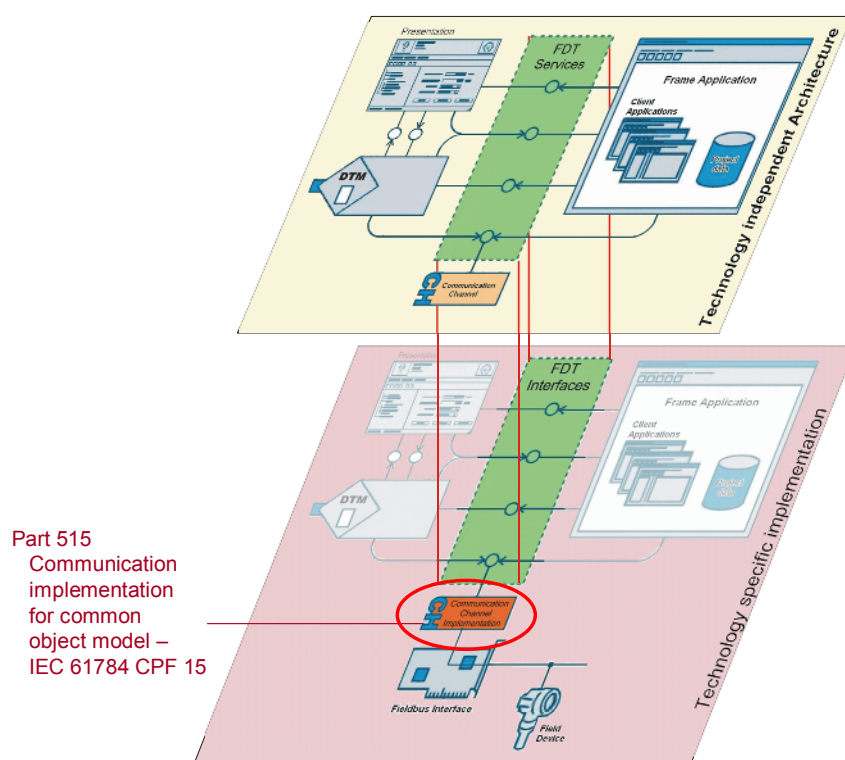


Figure 1 – Part 515 of the IEC 62453 series

## FIELD DEVICE TOOL (FDT) INTERFACE SPECIFICATION –

### Part 515: Communication implementation for common object model – IEC 61784 CPF 15

#### 1 Scope

IEC/TR 62453-515, which is a technical report, provides information for integrating IEC 61784-2 CPF 15 (Modbus TCP®) and Modbus Serial Line®<sup>1)</sup> protocol support into FDT systems based on COM implementation. This part is to be used in conjunction with IEC/TR 62453-41.

NOTE This part of IEC 62453 only specifies the mapping of Modbus parameters to FDT data types. For restrictions of protocol specific parameters concerning allowed values and concerning limitations of arrays used in the definition of FDT data types, refer to IEC 61158-5-15 and the MODBUS Application Protocol Specification.

This part of IEC 62453 specifies communication and other services.

This specification neither contains the FDT specification nor modifies it.

#### 2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 61131-3, *Programmable controllers – Part 3: Programming languages*

IEC 61784-2, *Industrial communication networks – Profiles – Part 2: Additional fieldbus profiles for real-time networks based on ISO/IEC 8802-3*

IEC 62453-1:2009, *Field Device Tool (FDT) interface specification – Part 1: Overview and guidance*

IEC 62453-2:2009, *Field Device Tool (FDT) interface specification – Part 2: Concepts and detailed description*

IEC/TR 62453-41:2009, *Field Device Tool (FDT) interface specification – Part 41: Object model integration profile – Common object model*

IEC 62453-315:2009, *Field Device Tool (FDT) interface specification – Part 315: Communication profile integration – IEC 61784 CPF 15*

---

1) Modbus is the trademark of Schneider Automation Inc. It is registered in the United States of America. This information is given for the convenience of users of this International Standard and does not constitute an endorsement by IEC of the trademark holder or any of its products. Compliance to this profile does not require use of the trademark Modbus. Use of the trademark Modbus requires permission from Schneider Automation Inc.

### 3 Terms, definitions, symbols, abbreviated terms and conventions

#### 3.1 Terms and definitions

For the purpose of this document, the terms and definitions given in IEC 62453-1, IEC 62453-2 and the following apply.

#### 3.2 Symbols and abbreviated terms

For the purpose of this document, the symbols and abbreviations given in IEC 62453-1, IEC 62453-2 and the following apply.

|     |                              |               |
|-----|------------------------------|---------------|
| CP  | Communication Profile        | [IEC 61784-1] |
| CPF | Communication Profile Family | [IEC 61784-1] |

#### 3.3 Conventions

##### 3.3.1 Data type names and references to data types

The conventions for naming and referencing of data types are explained in IEC 62453-2 Clause A.1

##### 3.3.2 Vocabulary for requirements

The following expressions are used when specifying requirements.

|                                    |                                                                                                              |
|------------------------------------|--------------------------------------------------------------------------------------------------------------|
| Usage of “shall” or “Mandatory”    | No exceptions allowed.                                                                                       |
| Usage of “should” or “Recommended” | Strong recommendation. It may make sense in special exceptional cases to differ from the described behavior. |
| Usage of “can” or “Optional”       | Function or behavior may be provided, depending on defined conditions.                                       |

### 4 Bus category

IEC 61784 CPF 15 protocol is identified by the attribute definition busCategory as specified in IEC 62453-315 (protocol identifiers).

### 5 Access to instance and device data

Used at methods:

- IDtmParameter::GetParameters()
- IDtmParameter::SetParameters()

These methods shall provide access to at least to all parameters defined in the IEC 62453-315.

### 6 Protocol specific usage of general data types

Table 1 shows how general data types are used with IEC 61784 CPF 15 devices.

**Table 1 – Protocol specific usage of general data types**

| Attribute              | Description for use                                                                  |
|------------------------|--------------------------------------------------------------------------------------|
| fdt:address            | All these attributes of the FDTDatatype schema are used as defined in IEC 62453-315. |
| fdt:protocolId         |                                                                                      |
| fdt:deviceTypeId       |                                                                                      |
| fdt:deviceTypeInfo     |                                                                                      |
| fdt:deviceTypeInfoPath |                                                                                      |
| fdt:manufacturerId     |                                                                                      |
| fdt:semanticId         |                                                                                      |
| fdt:applicationDomain  |                                                                                      |
| fdt:tag                |                                                                                      |

## 7 Protocol specific common data types

This clause specifies the protocol specific common data types, which are used in the definition of other data types.

## 8 Network management data types

### 8.1 General

The data types specified in this clause are used at following methods:

- IDtmParameter:GetParameters
- IDtmParameter:SetParameters

### 8.2 Modbus device address - FDTModbusAddressSchema

The address of a Modbus device is available at the element <BusInformation/UserdefinedBus>.

```
<?xml version="1.0"?>
<Schema name="FDTModbusAddressSchema" xmlns="urn:schemas-microsoft-com:xml-data"
xmlns:dt="urn:schemas-microsoft-com:datatypes" xmlns:fdt="x-schema:FDTDataTypesSchema.xml">

<!-- Address schema for Modbus protocol V1.0 -->
<!-- This additional schema describes the different methods of addressing for Modbus TCP and Modbus Serial Line
Devices -->

  <AttributeType name = "schemaVersion" dt:type = "number" default = "1.0"/>

  <!--Definition of attributes for Modbus addressing-->

  <!-- Slave address for Modbus Serial Line -->
  <AttributeType name="slaveAddress" dt:type="ui1"/>
  <!-- IP address for Modbus TCP -->
  <AttributeType name="tcpAddress" dt:type="string"/>
  <!-- TCP Port for Modbus TCP (default 502) -->
  <AttributeType name="tcpPort" dt:type="ui2" default = "502"/>

  <ElementType name="ModbusTCP" content="mixed" model="closed">
    <attribute type="fdt:nodeId" required="no"/>
    <attribute type="tcpAddress" required="yes"/>
    <attribute type="tcpPort" required="no"/>
    <attribute type="slaveAddress" required="no"/>
  </ElementType>
```

```

    <ElementType name="ModbusSerial" content="mixed" model="closed">
      <attribute type="fdt:nodeId" required="no"/>
      <attribute type="slaveAddress" required="yes"/>
    </ElementType>
  </Schema>

```

## 9 Communication data types - FDTModbusCommunicationSchema

The data types specified in this clause are used with the methods of IFdtCommunication.

```
<?xml version = "1.0" encoding = "UTF-8"?>
```

```

<!--FDT communication schema for Modbus protocol V1.0-->
<!--This schema describes all Modbus services which are defined in the Modbus Application Protocol Specification
V1.1a from 4 June 2004 -->
<!--Due to the ongoing standardisation process in the CIA Group to specify the encapsulation of the CanOpen
protocol in Modbus -->
<!--it was abstained to describe the Modbus service 0x2B/0x0D -->

```

```

<Schema name = "FDTModbusCommunicationSchema"
  xmlns = "urn:schemas-microsoft-com:xml-data"
  xmlns:dt = "urn:schemas-microsoft-com:datatypes"
  xmlns:fdt = "x-schema:FDTDataTypesSchema.xml"
  xmlns:mb = "x-schema:FDTModbusAddressSchema.xml">

```

```

  <AttributeType name = "schemaVersion" dt:type = "number" default = "1.0"/>
  <AttributeType name = "communicationReference" dt:type = "uuid"/>

```

```
<!--Modbus protocol parameters-->
```

```

<!--ModbusException response-->
  <AttributeType name = "modbusService" dt:type = "enumeration" dt:values = "ReadCoils ReadDiscreteInputs
ReadHoldingRegisters ReadInputRegisters WriteSingleCoil WriteSingleRegister ReadExceptionStatus Diagnostics
GetCommEventCounter GetCommEventLog WriteMultipleCoils WriteMultipleRegisters ReportSlaveID
ReadFileRecord WriteFileRecord MaskWriteRegister ReadWriteRegisters ReadFifoQueue
EncapsulatedInterfaceTransport ReadDeviceIdentification PrivateModbus"/>
  <AttributeType name = "modbusExceptionCode" dt:type = "bin.hex" dt:minLength = "1"/>

```

```
<!--Read/Write Data attributes-->
```

```

  <AttributeType name = "outputAddress" dt:type = "ui2"/>
  <AttributeType name = "startAddress" dt:type = "ui2"/>
  <AttributeType name = "quantity" dt:type = "ui2"/>
  <AttributeType name = "multipleCoilValues" dt:type = "string" dt:minLength = "1" dt:maxLength = "2000"/>
  <AttributeType name = "discreteInputsStatus" dt:type = "string" dt:minLength = "1" dt:maxLength = "2000"/>
  <AttributeType name = "registerValues" dt:type = "bin.hex" dt:minLength = "2" dt:maxLength = "250"/>
  <AttributeType name = "singleCoilValue" dt:type = "boolean"/>
  <AttributeType name = "singleRegister" dt:type = "bin.hex" dt:maxLength = "2" dt:minLength = "2"/>

```

```
<!-- Diagnostic services attributes-->
```

```

  <AttributeType name = "exceptionStatus" dt:type = "bin.hex" dt:maxLength = "1" dt:minLength = "1"/>
  <AttributeType name = "commStatus" dt:type = "bin.hex" dt:maxLength = "2" dt:minLength = "2"/>
  <AttributeType name = "diagnosticsSubFct" dt:type = "bin.hex" dt:maxLength = "2" dt:minLength = "2"/>
  <AttributeType name = "diagnosticsData" dt:type = "bin.hex" dt:maxLength = "250" dt:minLength = "2"/>
  <AttributeType name = "data" dt:type = "bin.hex"/>
  <AttributeType name = "eventCount" dt:type = "bin.hex" dt:maxLength = "2" dt:minLength = "2"/>
  <AttributeType name = "messageCount" dt:type = "bin.hex" dt:maxLength = "2" dt:minLength = "2"/>
  <AttributeType name = "events" dt:type = "bin.hex"/>

```

```
<!-- Read/Write File Record attributes-->
```

```

  <AttributeType name = "referenceType" dt:type = "bin.hex" dt:maxLength = "1" dt:minLength = "1"/>
  <AttributeType name = "fileNumber" dt:type = "bin.hex" dt:maxLength = "2" dt:minLength = "2"/>
  <AttributeType name = "recordNumber" dt:type = "bin.hex" dt:maxLength = "2" dt:minLength = "2"/>
  <AttributeType name = "recordData" dt:type = "bin.hex" dt:minLength = "2"/>

```

```
<!-- Mask Write Register attributes-->
```

```

  <AttributeType name = "referenceAddress" dt:type = "ui2"/>
  <AttributeType name = "andMask" dt:type = "bin.hex" dt:maxLength = "2" dt:minLength = "2"/>
  <AttributeType name = "orMask" dt:type = "bin.hex" dt:maxLength = "2" dt:minLength = "2"/>

```

```
<!-- Read/Write Registers attributes-->
```

```

  <AttributeType name = "readStartAddress" dt:type = "ui2"/>

```