PD IEC TR 60890:2022

BSI Standards Publication

A method of temperature-rise verification of low-voltage switchgear and controlgear assemblies by calculation

Documents
Document Sharing Hub

Full document details: PD IEC TR 60890:2022

National foreword

This Published Document is the UK implementation of IEC TR 60890:2022.

The UK participation in its preparation was entrusted to Technical Committee PEL/121/2, Low voltage switchgear and controlgear assemblies.

A list of organizations represented on this committee can be obtained on request to its committee manager.

Contractual and legal considerations

This publication has been prepared in good faith, however no representation, warranty, assurance or undertaking (express or implied) is or will be made, and no responsibility or liability is or will be accepted by BSI in relation to the adequacy, accuracy, completeness or reasonableness of this publication. All and any such responsibility and liability is expressly disclaimed to the full extent permitted by the law.

This publication is provided as is, and is to be used at the recipient's own risk.

The recipient is advised to consider seeking professional guidance with respect to its use of this publication.

This publication is not intended to constitute a contract. Users are responsible for its correct application.

This publication is not to be regarded as a British Standard.

© The British Standards Institution 2022
Published by BSI Standards Limited 2022

ISBN 978 0 539 11920 6

ICS 29.130.20

Compliance with a Published Document cannot confer immunity from legal obligations.

This Published Document was published under the authority of the Standards Policy and Strategy Committee on 30 November 2022.

Amendments/corrigenda issued since publication

Date	Text affected

Documents
Document Sharing Hub

Full document details: PD IEC TR 60890:2022

IEC TR 60890

Edition 3.0 2022-09

TECHNICAL REPORT

colour inside

A method of temperature-rise verification of low-voltage switchgear and controlgear assemblies by calculation

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

ICS 29.130.20

ISBN 978-2-8322-5762-3

Warning! Make sure that you obtained this publication from an authorized distributor.

® Registered trademark of the International Electrotechnical Commission

Documents
Document Sharing Hub

Full document details: PD IEC TR 60890:2022

CONTENTS

FOREWORD 5
INTRODUCTION 7
1 Scope 8
2 Normative references 8
3 Terms and definitions 8
4 Verification conditions 9
5 Calculation method 9
5.1 Assumptions made in this calculation 9
5.2 Necessary information 10
5.3 Calculation procedure 10
5.3.1 General 10
5.3.2 Determination of the effective cooling surface A_e of the enclosure 10
5.3.3 Determination of the internal temperature-rise $\Delta t_{0,5}$ of the air at mid-height of the enclosure 10
5.3.4 Determination of the internal temperature-rise $\Delta t_{1,0}$ of air at the top of the enclosure 11
5.3.5 Characteristic curve for temperature-rise of air inside enclosure 11
5.4 Maximum internal air temperature limits 13
6 Further considerations 13
6.1 General 13
6.2 Guidance on the effects of an uneven power distribution 13
6.3 Guidance on the additional temperature-rise effect due to solar radiation 14
7 Evaluation of the design 15
Annex A (informative) Examples for the calculation of the temperature-rise of air inside enclosures 26
A.1 Example 1 26
A.2 Example 2 29
Annex B (informative) Guidance on the effects of an uneven power distribution 33
B.1 Horizontal partition 33
B.2 Calculation of internal air temperature-rise for assemblies with ventilation openings with even power distribution and less than 50 % perforation in horizontal partitions 33
B.3 Calculation of internal air temperature-rise with an uneven power distribution 34
Annex C (informative) Guidance on the additional temperature-rise effect due to solar radiation 35
C.1 General 35
C.2 Solar radiation phenomena 35
C.3 Solar radiation – consequences for thermal calculation 36
C.4 Solar radiation of enclosures with air ventilation openings 37
Annex D (informative) Guidance on the effect of different enclosure materials, construction and finishes 38
D.1 General 38
D.2 Validity criteria 38
D.3 Material of enclosure 38
D.4 Results 38

AVA Documents
Document Sharing Hub
Full document details: PD IEC TR 60890:2022

Annex E (informative) Guidance on the effects of different natural ventilation arrangements 40
Annex F (informative) Guidance on forced ventilation management 42
F.1 General 42
F.2 Forced ventilation installation system 42
F.3 Installation considerations 42
Annex G (informative) Power loss values calculation 44
G.1 General 44
G.2 Power losses of low-voltage switchgear and controlgear 44
G.3 Power losses of conductors connecting low-voltage switchgear and controlgear 44
G.4 Power losses of busbars 45
G.5 Power losses of electronic devices 45
Annex H (informative) Guidance on the impact of an adjacent wall on the assembly cooling surfaces 46
Annex I (informative) Operating current and power loss of copper conductors 48
Annex J (informative) Guidance to magnetic and eddy-current power losses 53
Annex K (informative) Forced ventilation airflow calculation 54
K.1 General 54
K.2 Ventilation airflow calculation 55
Bibliography 57

Figure 1 – Temperature-rise characteristic curve for enclosures with A_e exceeding 1,25 m^2 12
Figure 2 – Temperature-rise characteristic curve for enclosures with A_e not exceeding 1,25 m^2 13
Figure 3 – Enclosure constant k for enclosures without ventilation openings, with an effective cooling surface A_e > 1,25 m^2 18
Figure 4 – Temperature distribution factor c for enclosures without ventilation openings and with an effective cooling surface A_e > 1,25 m^2 19
Figure 5 – Enclosure constant k for enclosures with ventilation openings and an effective cooling surface A_e > 1,25 m^2 20
Figure 6 – Temperature distribution factor c for enclosures with ventilation openings and an effective cooling surface A_e > 1,25 m^2 21
Figure 7 – Enclosure constant k for enclosures without ventilation openings and with an effective cooling surface A_e ≤ 1,25 m^2 22
Figure 8 – Temperature distribution factor c for enclosures without ventilation openings and with an effective cooling surface A_e ≤ 1,25 m^2 23
Figure 9 – Calculation of temperature-rise of air inside enclosures 25
Figure A.1 – Example 1, calculation for an enclosure with exposed side faces without ventilation openings and without internal horizontal partitions 26
Figure A.2 – Example 1, calculation for a single enclosure 28
Figure A.3 – Example 2, calculation for an enclosure for wall-mounting with ventilation openings 29
Figure A.4 – Example 2, calculation for one enclosure half 30

AVA Documents
Document Sharing Hub
Full document details: PD IEC TR 60890:2022

Figure A.5 – Example 2, calculation for an enclosure for wall-mounting with ventilation openings 32
Figure B.1 – Examples of assemblies with horizontal partitions 33
Figure B.2 – Temperature-rise verification of a higher-power circuit 34
Figure C.1 – Solar radiation phenomena 35
Figure C.2 – Interpolation curve 36
Figure D.1 – Results of comparison tests 39
Figure E.1 – Examples of crossing diagonal installation 40
Figure E.2 – Effect of additional filters 41
Figure F.1 – Examples of forced ventilation arrangements 43
Figure H.1 – Wall-mounted assembly 46
Figure H.2 – Floor-standing assembly 47
Figure J.1 – Power losses distribution for different gland plates with the same rating 53

Table 1 – Method of calculation, application, formulas and characteristics 15
Table 2 – Symbols, units and designations 16
Table 3 – Surface factor b according to the type of installation 17
Table 4 – Factor d for enclosures without ventilation openings and with an effective cooling surface A_e > 1,25 m^2 17
Table 5 – Factor d for enclosures with ventilation openings and an effective cooling surface A_e > 1,25 m^2 17
Table 6 – Equation for Figure 3 18
Table 7 – Equations for Figure 4 19
Table 8 – Equations for Figure 5 20
Table 9 – Equations for Figure 6 22
Table 10 – Equation for Figure 7 23
Table 11 – Equation for Figure 8 24
Table C.1 – Approximate solar absorption radiation coefficients (according to colour) 36
Table I.1 – Operating current and power loss of single-core copper cables with a permissible conductor temperature of 70 °C (ambient temperature inside the enclosure: 55 °C) 49
Table I.2 – Reduction factor k_1 for cables with a permissible conductor temperature of 70 °C (extract from IEC 60364-5-52:2009, Table B.52.14) 50
Table I.3 – Operating current and power loss of bare copper bars with rectangular cross-section, run horizontally and arranged with their largest face vertical, for DC and AC frequencies 16 2/3 Hz, 50 Hz to 60 Hz (ambient temperature inside the enclosure: 55 °C, temperature of the conductor 70 °C) 51
Table I.4 – Factor k_4 for different temperatures of the air inside the enclosure and/or for the conductors 52
Table K.1 – Factor k for altitudes above sea level 55

Documents
Document Sharing Hub
Full document details: PD IEC TR 60890:2022

INTERNATIONAL ELECTROTECHNICAL COMMISSION

A METHOD OF TEMPERATURE-RISE VERIFICATION OF LOW-VOLTAGE SWITCHGEAR AND CONTROLGEAR ASSEMBLIES BY CALCULATION

FOREWORD

1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
6) All users should ensure that they have the latest edition of this publication.
7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
9) Attention is drawn to the possibility that some of the elements of this IEC Publication may be the subject of patent rights. IEC shall not be held responsible for identifying any or all such patent rights.

IEC TR 60890 has been prepared by subcommittee 121B: Low-voltage switchgear and controlgear assemblies, of IEC technical committee 121: Switchgear and controlgear and their assemblies for low-voltage. It is a Technical Report.

This third edition cancels and replaces the second edition published in 2014. This edition constitutes a technical revision.

This edition includes the following significant technical changes with respect to the previous edition:

- alignment with IEC 61439-1:2020;
- addition of individual annexes for guidance of technical explanations related to:
  - effect of an uneven power distribution;
  - additional temperature-rise due to solar radiation;
  - effect of different enclosure materials;
  - effect of different natural ventilation management;
  - forced ventilation management;

AVA Documents
Document Sharing Hub

  - power losses calculation;
  - impact of an adjacent wall can have on the assembly cooling surface(s);
- maximum internal ambient temperature limit into an assembly;
- validity area of the calculation extended from 3 150 A to 3 200 A;
- addition of an algebraic equation to the different curves included in the document.

The text of this Technical Report is based on the following documents:

Draft	Report on voting
121B/136/DTR	121B/147/RVDTR

Full information on the voting for its approval can be found in the report on voting indicated in the above table.

The language used for the development of this Technical Report is English.

This document was drafted in accordance with ISO/IEC Directives, Part 2, and developed in accordance with ISO/IEC Directives, Part 1 and ISO/IEC Directives, IEC Supplement, available at www.iec.ch/members_experts/refdocs. The main document types developed by IEC are described in greater detail at www.iec.ch/publications.

The committee has decided that the contents of this document will remain unchanged until the stability date indicated on the IEC website under webstore.iec.ch in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

IMPORTANT – The "colour inside" logo on the cover page of this publication indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this publication using a colour printer.

Documents
Document Sharing Hub

Full document details: PD IEC TR 60890:2022

INTRODUCTION

In the series of design verifications of IEC 61439-1 a temperature-rise verification of low-voltage power switchgear and controlgear assemblies is specified. This can be by test, however, alternatives are acceptable under defined circumstances. Selection of the method used for temperature-rise verification is the responsibility of the original manufacturer. Where applicable this document can also be used for temperature-rise verification of similar products in accordance with other standards (e.g. IEC 60204-1). The method of calculation can also be used to determine the thermal power dissipation capability of an enclosure in accordance with IEC 62208 for a given internal air temperature-rise. The factors and coefficients, set out in this document have been derived from measurements on numerous assemblies and the method has been verified by comparison with test results.

Documents
Document Sharing Hub

Full document details: PD IEC TR 60890:2022

A METHOD OF TEMPERATURE-RISE VERIFICATION OF LOW-VOLTAGE SWITCHGEAR AND CONTROLGEAR ASSEMBLIES BY CALCULATION

1 Scope

This document specifies a method of air temperature-rise calculation inside enclosures for low-voltage switchgear and controlgear assemblies or similar products in accordance with their respective standard.

The method is primarily applicable to enclosed assemblies or partitioned sections of assemblies without forced ventilation. However, some technical guidance to adapt it for the use of forced ventilation is given in this document. The results obtained by using this method are directly influenced by the accuracy of the evaluation of power losses used as inputs to perform the thermal calculations.

NOTE The air temperature within the enclosure is equal to the ambient air temperature outside the enclosure plus the temperature-rise of the air inside the enclosure caused by the power losses of the installed equipment.

For the method to be applied, the maximum daily average ambient air temperature outside the assembly at the place of installation is specified between 10 °C and 50 °C. The maximum daily temperature does not exceed the maximum daily average temperature by more than 5 K.

Several annexes in this document provide guidance on how temperature-rise within assemblies can be affected by influences which are not considered in the calculation method included in this document, for example, when the assembly is subject to solar radiation. In such cases, different means of verification to that given in this document can be applied to ensure a definitive result and verification of the design.

2 Normative references

The following documents are referred to in the text in such a way that some or all of their content constitutes requirements of this document. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies.

IEC 61439 (all parts), *Low-voltage switchgear and controlgear assemblies*

IEEE C37.24-2017, *IEEE Guide for Evaluating the Effect of Solar Radiation on Outdoor Metal-Enclosed Switchgear*

3 Terms and definitions

For the purposes of this document, the terms and definitions given in IEC 61439 (all parts) apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at http://www.electropedia.org/
- ISO Online browsing platform: available at http://www.iso.org/obp

Documents
Document Sharing Hub

Full document details: PD IEC TR 60890:2022

4 Verification conditions

When this method of calculation is applied to low-voltage switchgear and controlgear assemblies the following conditions shall be fulfilled:

– the assembly is designed for AC currents and frequencies up to and including 1 600 A, 60 Hz. For higher current ratings or frequencies, the method could be used with additional verifications taking into account the effect of eddy-currents on the temperature distribution inside the assembly as required by the relevant product standards.

NOTE 1 In IEC 61439-2, additional requirements for currents in excess of 1 600 A are specified to take into account the considerably increased power losses due to magnetic effects (eddy currents, proximity effect, skin effect)

– the assembly is designed for DC currents up to and including 3 200 A. For higher current ratings the method could be used with additional verifications as required by the relevant product standards;

– conductors carrying currents in excess of 200 A AC, and the adjacent structural parts are so arranged that eddy-current and hysteresis losses are negligible;

– there is an approximately even distribution of power losses inside the enclosure;

– the power losses data for all built-in components are available or can be calculated (see Clause 5);

– the installed equipment is so arranged that air circulation is not significantly impeded.

NOTE 2 When this method is used to determine the thermal power dissipation capability of an empty enclosure in accordance with IEC 62208, the above conditions do not apply.

5 Calculation method

5.1 Assumptions made in this calculation

To use the calculation method of this document, the following assumptions are deemed valid:

– the enclosure is made of metal (steel, aluminium, stainless steel) coated (both sides, inside and outside), insulating material like thermoplastic or thermoset or similar (see Annex D);

– the enclosure is made of a single layer material or multiple layers without air-gap;

– for enclosures with or without natural ventilation, there are no more than five horizontal partitions in the assembly or in a section of it;

– the enclosure is designed without ventilation openings or;

– the enclosure is designed with free air inlet and outlet ventilation openings, without the inclusion of any additional filter (see Annex E);

- the cross-section of the air outlet openings is at least 10 % bigger than that of the inlet openings to permit the chimney effect;
- the minimum cross section of air inlet openings is 10 cm^2;

NOTE 1 Figure 3 and the formula given in Table 7 are not usable for lower cross sections. Assemblies with a sum of the air inlet openings less than 10 cm^2 are considered as assemblies without an air inlet.

- if the enclosure has air inlet and outlet openings with filters for an IP5X rating or higher then these openings are not considered for the calculation;
- for IP ratings lower than IP5X the effective free air cross section of the openings shall be used for calculation (see Annex E);

– where enclosures with natural ventilation openings have compartments, the surface of each horizontal partition shall be provided with free air ventilation openings of at least 50 % of the horizontal cross-section of the partition (see Clause B.1);

– power losses are considered as a sum of the followings:

- power losses of low-voltage switchgear and controlgear (see Clause G.2);

Documents
Document Sharing Hub

- power losses of conductors connecting low-voltage switchgear and controlgear (see Clause G.3);
- power losses of busbars (see Clause G.4);
- power losses of electronic devices (see Clause G.5);

– the enclosure is not subject to solar radiation.

5.2 Necessary information

The following data shall be used to calculate the temperature-rise of the air inside an enclosure:

– dimensions of the enclosure: height/width/depth;
– type of installation of the enclosure according to Figure 4;
– design of enclosure, i.e. with or without ventilation openings;
– number of internal horizontal partitions;
– effective power loss of equipment installed in the enclosure, see Annex G;
– effective power loss (P_v) of conductors according to Annex I.

5.3 Calculation procedure

5.3.1 General

For the enclosures specified in columns 4 and 5 of Table 1, the calculation of the temperature-rise of the air inside the enclosure is carried out using the formulae laid down in columns 1 to 3 of Table 1.

The pertinent factors and exponents (characteristics) are obtained from columns 6 to 10 of Table 1.

The symbols, units and designations are stated in Table 2.

For enclosures having more than one section with vertical partitions, the temperature-rise of the air inside the enclosure shall be determined separately for each section.

Where enclosures without vertical partitions or individual sections have an effective cooling surface greater than 11,5 m^2 or a width greater than about 1,5 m, they should be divided for the calculation into fictitious sections, whose dimensions approximate to the foregoing values.

NOTE The template (see Figure 9) can be used as a calculation aid.

5.3.2 Determination of the effective cooling surface A_e of the enclosure

The calculation is carried out according to Formula (1) in column 1 of Table 1.

The effective cooling surface A_e of an enclosure is the sum of the individual surfaces A_o multiplied by the surface factor b. This factor takes into account the heat dissipation of the individual surfaces according to the type of installation of the enclosure (see Annex H for additional explanations).

5.3.3 Determination of the internal temperature-rise $\Delta t_{0,5}$ of the air at mid-height of the enclosure

The calculation is carried out according to Formula (2) in column 2 of Table 1.

In Formula (2) the enclosure constant k allows for the size of the effective cooling surface for enclosures without ventilation openings and, in addition, for the cross-section of the air inlet openings for enclosures with ventilation openings.

AVA Documents Document Sharing Hub

The dependence of the temperature-rise occurring in the enclosure on the effective power loss P is expressed by the exponent x.

The factor d allows for the dependence of the temperature-rise on the number of internal horizontal partitions.

5.3.4 Determination of the internal temperature-rise $\Delta t_{1,0}$ of air at the top of the enclosure

The calculation is made according to Formula (3) in column 3 of Table 1.

Factor c allows for the temperature distribution inside an enclosure. Its determination varies with the design and installation of the assembly as follows:

a) For enclosures without ventilation openings and with an effective cooling surface:

A_e > 1,25 m^2

The factor c from Figure 4, depends on the type of installation and the height/base factor f, where:

$$f = \frac{h^{1,35}}{A_b}$$

b) For enclosures with ventilation openings and with an effective cooling surface:

A_e > 1,25 m^2

The factor c from Figure 6, depends on the cross-section of air inlet openings and the height/base factor f, where:

$$f = \frac{h^{1,35}}{A_b}$$

c) For enclosures without ventilation openings and with an effective cooling surface:

A_e ≤ 1,25 m^2

The factor c from Figure 8, depends on the height/width factor g, where:

$$g = \frac{h}{w}$$

where

h is the enclosure height, in m;

A_b is the surface area of the enclosure base, in m^2;

w is the enclosure width, in m.

5.3.5 Characteristic curve for temperature-rise of air inside enclosure

5.3.5.1 General

To evaluate the design according to Clause 7, the calculated results of 5.3.3 and 5.3.4 shall be applied with the proper characteristic curve for temperature-rise of air inside the enclosure as a function of the enclosure height. The air temperatures within horizontal levels are practically constant.

5.3.5.2 Temperature-rise characteristic curve for enclosures with an effective cooling surface A_e exceeding 1,25 m^2

As a general rule, the characteristic curve of temperature-rise is adequately well defined by a straight line which runs through the points $\Delta t_{1,0}$ and $\Delta t_{0,5}$ (see Figure 1).

Documents
Document Sharing Hub
Full document details: PD IEC TR 60890:2022

The internal air temperature-rise at the bottom of the enclosure is close to zero, i.e. the characteristic curve flattens out towards zero. In practice, the dotted part of the characteristic curve is of secondary importance.

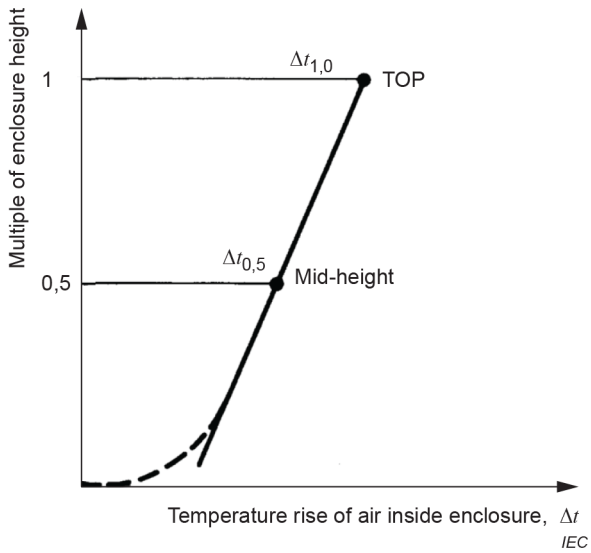

Figure 1 – Temperature-rise characteristic curve for enclosures with A_e exceeding 1,25 m^2

5.3.5.3 Temperature-rise characteristic curve for enclosures with an effective cooling surface A_e not exceeding 1,25 m^2

For this type of enclosure, the maximum temperature-rise in the upper quarter is constant and the values for $\Delta t_{1,0}$ and $\Delta t_{0,75}$ are identical (see Figure 2).

The characteristic curve is obtained by connecting the temperature-rise values at an enclosure level of 0,75 and 0,5 (see Figure 2).

The internal air temperature-rise at the bottom of the enclosure is close to zero, i.e. the characteristic curve flattens out towards zero. In practice, the dotted part of the characteristic curve is of secondary importance.

Documents
Document Sharing Hub
Full document details: PD IEC TR 60890:2022

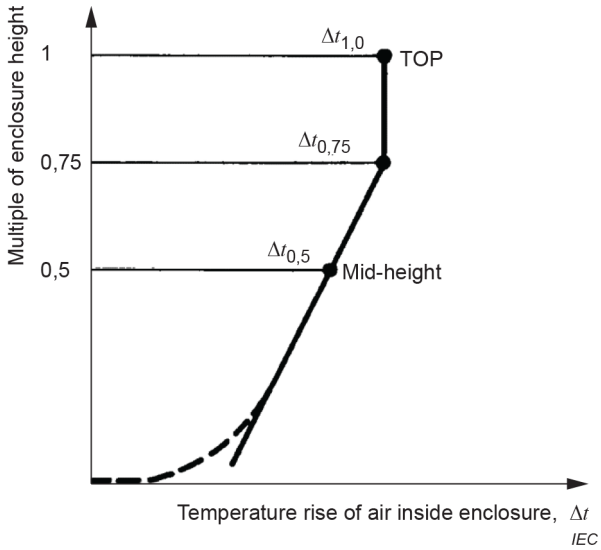

Figure 2 – Temperature-rise characteristic curve for enclosures with A_e not exceeding 1,25 m^2

5.4 Maximum internal air temperature limits

This document contains a method to calculate the internal air temperature within an enclosure. The resulting temperature shall not exceed the maximum absolute temperature allowed by different types of devices and products installed inside.

The user of this document should refer to the manufacturer's instructions regarding the maximum operational temperature allowed for the devices used inside the assembly.

NOTE The value of internal air temperature has a direct influence on the ageing and operation of built-in components.

6 Further considerations

6.1 General

The means of temperature-rise calculation in this document relate to specific arrangements of assembly in the conditions as defined. These arrangements and conditions do not cover all designs of assembly or the conditions in which some are installed. Where good practises are applied the calculation methods in this document can lead to conservative results.

Annex B, Annex C, Annex D, Annex E, Annex F, Annex H, Annex J and Annex K detail good practice that can lead to an improvement in thermal performance or some aspects not considered in the calculation method in this document. However, when using these additional considerations, to ensure a defined performance of an assembly, further verification, e.g. test, shall be performed.

6.2 Guidance on the effects of an uneven power distribution

The aim of Annex B is to determine the temperature-rise where there is not an even power distribution within an assembly using as a starting point the temperature-rise of a reference design or calculation in accordance with Clause 5.

Documents
Document Sharing Hub
Full document details: PD IEC TR 60890:2022

6.3 Guidance on the additional temperature-rise effect due to solar radiation

In case of outdoor assemblies that are subject to direct sunlight, solar irridiance can significantly increase internal air temperature-rise and require a derating of the rated currents of the assembly. See Annex C.

Documents
Document Sharing Hub

Full document details: PD IEC TR 60890:2022

7 Evaluation of the design

It shall be determined whether the equipment within the assembly can operate satisfactorily at the relevant calculated internal air temperature-rise.

If it is not so, the parameters will have to be changed and the calculation repeated.

Table 1 – Method of calculation, application, formulas and characteristics

1	2	3	4	5 [a]	6	7	8	9	10	11
Calculation formulae			**Enclosure**		**Characteristics**					**Characteristic curve**
Effective cooling surface A_e	**Temperature-rise of air**		**Effective cooling surface A_e**		**Factors**				**Exponent**	**Plotting of temperature-rise characteristics**
	At mid-height of the enclosure	**At (internal) top of enclosure**			***b* see**	***k* see**	***d* see**	***c* see**	***x***	
$A_e = \Sigma\,(A_o \times b)$ (1)	$\Delta t_{0,5} = k \times d \times P^x$ (2)	$\Delta t_{1,0} = c \times \Delta t_{0,5}$ (3)	>1,25 m^2	Enclosure without ventilation openings	Table 3	Figure 3	Table 4	Figure 4	0,804	See 5.3.5.2
				Enclosure with ventilation openings		Figure 5	Table 5	Figure 6	0,715	
			≤1,25 m^2	Enclosure without ventilation openings		Figure 7	d=1	Figure 8	0,804	See 5.3.5.3

[a] For enclosure with ventilation openings with effective surface A_e ≤ 1,25 m^2 the criteria of enclosures without ventilation openings can be used.

For symbols, units and designations, see Table 2.

For method of calculation, see also the examples given in Annex A.

Documents
Document Sharing Hub
Full document details: PD IEC TR 60890:2022

Table 2 – Symbols, units and designations

Symbol	Unit	Designation
A_o	m^2	Surfaces of external sides of enclosure
A_b	m^2	Enclosure base surface
A_e	m^2	Effective cooling surface of enclosure
A_s	m^2	Surface area, which can transport heat (usually excluding the bottom area)
α	W/m^2K	Heat transfer coefficient (includes conduction and radiation of heat)
b	–	Surface factor
c	–	Temperature distribution factor
c_p	J/kg*K	Heat capacity (of air)
d	–	Temperature-rise factor for internal horizontal partitions inside enclosure
f	–	Height/base factor
g	–	Height/width factor
h	m	Enclosure height
k	–	Enclosure constant
n	–	Number of internal horizontal partitions (up to five partitions)
P	W	Effective power loss of equipment installed inside enclosure (determined according to Annex G)
P_{890}	W	Calculated power dissipation of the enclosure according to this document, without considering natural ventilation
P_{fan}	W	Power losses dissipated by forced ventilation
P_v	W	Effective power losses of conductors
P_w	W	Total dissipated power
ρ	kg/m^3	Mass density (of air) at T_a
V	m^3/s	Volume flow rate of the air flow through the enclosure
S_{air}	cm^2	Cross-section of air inlet openings
T_a	°C	Ambient temperature
T_{int}	°C	Temperature inside the enclosure
$T_{int,max}$	°C	Maximum temperature allowed inside the enclosure (limited e.g. by devices)
w	m	Enclosure width
x	–	Exponent
Δt	K	Temperature-rise of air inside enclosure in general
$\Delta t_{0,5}$	K	Temperature-rise of air at (internal) mid-height of enclosure
$\Delta t_{0,75}$	K	Temperature-rise of air at (internal) three quarters height of enclosure
$\Delta t_{1,0}$	K	Temperature-rise of air at (internal) top of enclosure

Documents
Document Sharing Hub
Full document details: PD IEC TR 60890:2022