PD IEC TR 63282-102:2025

BSI Standards Publication

LVDC systems

Part 102: Low-voltage DC electric island power supply systems

Documents
Document Sharing Hub

Full document details: PD IEC TR 63282-102:2025

National foreword

This Published Document is the UK implementation of IEC TR 63282-102:2025.

The UK participation in its preparation was entrusted to Technical Committee GEL/8, Systems Aspects for Electrical Energy Supply.

A list of organizations represented on this committee can be obtained on request to its committee manager.

Contractual and legal considerations

This publication has been prepared in good faith, however no representation, warranty, assurance or undertaking (express or implied) is or will be made, and no responsibility or liability is or will be accepted by BSI in relation to the adequacy, accuracy, completeness or reasonableness of this publication. All and any such responsibility and liability is expressly disclaimed to the full extent permitted by the law.

This publication is provided as is, and is to be used at the recipient's own risk.

The recipient is advised to consider seeking professional guidance with respect to its use of this publication.

This publication is not intended to constitute a contract. Users are responsible for its correct application.

This publication is not to be regarded as a British Standard.

© The British Standards Institution 2025
Published by BSI Standards Limited 2025

ISBN 978 0 539 30223 3

ICS 29.020; 29.240.01

Compliance with a Published Document cannot confer immunity from legal obligations.

This Published Document was published under the authority of the Standards Policy and Strategy Committee on 30 November 2025.

Amendments/corrigenda issued since publication

Date	Text affected

Documents
Document Sharing Hub

Full document details: PD IEC TR 63282-102:2025

IEC TR 63282-102

Edition 1.0 2025-11

TECHNICAL REPORT

LVDC systems -
Part 102: Low-voltage DC electric island power supply systems

ICS 29.020; 29.240.01

ISBN 978-2-8327-0805-7

IEC TR 63282-102:2025-11(en)

Documents
Document Sharing Hub

Full document details: PD IEC TR 63282-102:2025

THIS PUBLICATION IS COPYRIGHT PROTECTED
Copyright © 2025 IEC, Geneva, Switzerland

All rights reserved. Unless otherwise specified, no part of this publication may be reproduced or utilized in any form or by any means, electronic or mechanical, including photocopying and microfilm, without permission in writing from either IEC or IEC's member National Committee in the country of the requester. If you have any questions about IEC copyright or have an enquiry about obtaining additional rights to this publication, please contact the address below or your local IEC member National Committee for further information.

IEC Secretariat
3, rue de Varembé
CH-1211 Geneva 20
Switzerland

Tel.: +41 22 919 02 11
info@iec.ch
www.iec.ch

About the IEC
The International Electrotechnical Commission (IEC) is the leading global organization that prepares and publishes International Standards for all electrical, electronic and related technologies.

About IEC publications
The technical content of IEC publications is kept under constant review by the IEC. Please make sure that you have the latest edition, a corrigendum or an amendment might have been published.

IEC publications search - webstore.iec.ch/advsearchform
The advanced search enables to find IEC publications by a variety of criteria (reference number, text, technical committee, …). It also gives information on projects, replaced and withdrawn publications.

IEC Just Published - webstore.iec.ch/justpublished
Stay up to date on all new IEC publications. Just Published details all new publications released. Available online and once a month by email.

IEC Customer Service Centre - webstore.iec.ch/csc
If you wish to give us your feedback on this publication or need further assistance, please contact the Customer Service Centre: sales@iec.ch.

IEC Products & Services Portal - products.iec.ch
Discover our powerful search engine and read freely all the publications previews, graphical symbols and the glossary. With a subscription you will always have access to up to date content tailored to your needs.

Electropedia - www.electropedia.org
The world's leading online dictionary on electrotechnology, containing more than 22 500 terminological entries in English and French, with equivalent terms in 25 additional languages. Also known as the International Electrotechnical Vocabulary (IEV) online.

Warning! Make sure that you obtained this publication from an authorized distributor.

Documents
Document Sharing Hub

Full document details: PD IEC TR 63282-102:2025

CONTENTS

FOREWORD 5
INTRODUCTION 7
1 Scope 8
2 Normative references 8
3 Terms and definitions 8
4 Characteristics of electric island LVDC systems 8
4.1 General 8
4.2 Rural or remote areas without access to the grid 9
4.3 LVDC auxiliary power supply system for ships 10
5 Composition and technical description of electric island LVDC system 11
5.1 General 11
5.2 Voltage levels 12
5.2.1 General 12
5.2.2 Rural or remote areas without access to the grid 12
5.2.3 LVDC auxiliary power supply system in a ship 12
5.3 Topology 13
5.3.1 General 13
5.3.2 Household-level installation 13
5.3.3 County-level installation 14
5.3.4 LVDC auxiliary power supply systems for ship 16
5.4 Protection and operation 17
5.4.1 Earthing configuration 17
5.4.2 Protection 18
5.4.3 System operation and control 19
6 Application cases 21
6.1 Application case 1- A county-level electric island LVDC system in rural Africa 21
6.1.1 General 21
6.1.2 Structure and composition 21
6.1.3 Voltage level 24
6.1.4 Power quality 24
6.1.5 Control and protection configuration 26
6.2 Application case 2 - A household-level electric island LVDC system in rural China 27
6.2.1 General 27
6.2.2 Topology and composition 27
6.2.3 Voltage level 30
6.2.4 Power quality 30
6.2.5 Operation mode control and protection configuration 31
6.2.6 System earthing arrangement 31
6.3 Application case 3 - An electric island LVDC system situated in rural Algeria 31
6.3.1 General 31
6.3.2 Structure and composition 31
6.3.3 Voltage level 33
6.3.4 Power quality 34
6.3.5 Control and protection configuration 35

Documents
Document Sharing Hub
Full document details: PD IEC TR 63282-102:2025

6.4 Application case 4 - Experimental test platforms ... 35
6.4.1 General ... 35
6.4.2 Structure and composition ... 35
6.4.3 Voltage level ... 36
6.4.4 Power quality ... 36
6.4.5 Control and protection configuration ... 39
6.5 Application Case 5 - LVDC powered ship ... 40
6.5.1 General ... 40
6.5.2 Structure and composition ... 40
6.5.3 Voltage level ... 41
6.5.4 Power quality ... 41
6.5.5 Control and Protection configuration ... 42
6.6 Application Case 6 - A solar powered electrical recreational ship in Indonesian waters ... 42
6.6.1 General ... 42
6.6.2 Structure and composition ... 42
6.6.3 Voltage level ... 45
6.6.4 Power quality ... 45
6.6.5 Control and protection configuration ... 45
Annex A (informative) System composition ... 46
A.1 General ... 46
A.2 Power sources ... 46
A.2.1 General ... 46
A.2.2 Types of sources ... 46
A.2.3 Control modes ... 47
A.3 Loads ... 48
A.4 Storage system ... 48
A.5 Wiring system ... 50
A.6 DC breaker and fuses ... 51
A.7 Connectors and socket ... 52
A.8 Energy control and management system ... 52
Annex B (informative) Design and configuration ... 54
Annex C (informative) System installation ... 57
C.1 General ... 57
C.2 PV array mounting structures ... 57
C.3 Battery installations ... 57
C.4 Electrical cables and electrical connections ... 58
Bibliography ... 59

Figure 1 - Multi-tier matrix for measuring access to household electricity supply ... 10
Figure 2 - Guideline to select system voltage ... 12
Figure 3 - A household installation ... 14
Figure 4 - A single line diagram of radial configuration ... 15
Figure 5 - A single line diagram of ring configuration ... 16
Figure 6 - Radial configuration diagram of auxiliary power supply system of ship ... 17
Figure 7 - Ring configuration diagram of auxiliary power supply system of ship ... 17
Figure 8 - Control mode of passive DC systems ... 20

Documents
Document Sharing Hub
Full document details: PD IEC TR 63282-102:2025

Figure 9 - Control mode of active DC systems 20
Figure 10 - Schematic of a PV-based nano-grid installation 21
Figure 11 - Geographical distribution of the nano-grids in Ambohimena 22
Figure 12 - Schematic of the LVDC system installation 23
Figure 13 - Configuration and structure of the LVDC system in Ambohimena 23
Figure 14 - Voltage band when configured with DC/DC converters 24
Figure 15 - Long-term exchanged currents on the LVDC system 25
Figure 16 - Long-term evolution of the DC bus voltage 25
Figure 17 - Exchanged currents during a rainy period 26
Figure 18 - Evolution of the DC bus voltage during a rainy period 26
Figure 19 - Initial inrush current (in green) and DC bus voltage (in pink) without and with smooth start-up procedure 27
Figure 20 - The topology of the LVDC power distribution system in Yuanqu Village 28
Figure 21 - PV modules mounted on the roof and DC loads in the house 28
Figure 22 - Schematic diagram and real photo of the energy router in household-level installation 29
Figure 23 - The variation of ripple coefficient of the peak-to-peak voltages 31
Figure 24 - The topology scheme of the LVDC power distribution system 32
Figure 25 - Voltage band when configured with household electrical devices 34
Figure 26 - System topology of the experimental test platform 36
Figure 27 - 36 V steady-state DC voltage waveforms 36
Figure 28 - 36 V steady state DC voltage waveform expansion 37
Figure 29 - 400 V steady state DC voltage waveforms 37
Figure 30 - 650 V steady state DC voltage waveforms 37
Figure 31 - Voltage ripple analysis with different time window 38
Figure 32 - 36 V transient DC voltage waveforms 38
Figure 33 - 400 V transient DC voltage waveforms 39
Figure 34 - 650 V transient DC voltage waveforms 39
Figure 35 - LVDC powered ship in the Alleppey backwaters 40
Figure 36 - Electrical line diagram of LVDC powered ship hotel loads 41
Figure 37 - A solar powered electrical recreational ship in indonesian water 42
Figure 38 - Electrical line diagram of solar powered electrical recreational ship 43
Figure 39 - Total loads in different conditions 44
Figure A.1 - System composition 46
Figure A.2 - Topology of Dual Active Bridge Converter 47
Figure A.3 - Topology of PMSG connecting to DC grid through rectifier 47
Figure A.4 - Discharge curves of different current rates of lithium cell 49
Figure A.5 - Typical battery management system diagram of lithium battery and lead-acid battery 50
Figure A.6 - Centralized energy management system 52
Figure A.7 - Examples of EMS functions and their relationships 53
Figure B.1 - Design process 54

Table 1 - Voltages for different applications (IEC 60092-201) 13

Documents
Document Sharing Hub

Full document details: PD IEC TR 63282-102:2025

Table 2 - Generic requirements for ESMAP tiers and attributes 13
Table 3 - Daily load profile for single household in Yuanqu village 29
Table 4 - Loads characteristics in the application case 32
Table 5 - Photovoltaic module technical data sheet 33
Table 6 - Lead acid battery specifications 33
Table 7 - Generic requirements for voltage ripple/noise 35
Table 8 - Common hotel loads of LVDC powered ship 41
Table 9 - Loads of solar powered electrical recreational ship 43
Table 10 - Daily power output on different weather conditions (kWh) 44
Table 11 - Power system summary 44
Table A.1 - Load level 48
Table A.2 - Economic comparison of energy storage 49

Documents
Document Sharing Hub

Full document details: PD IEC TR 63282-102:2025

INTERNATIONAL ELECTROTECHNICAL COMMISSION

_____

LVDC systems -
Part 102: Low-voltage DC electric island power supply systems

FOREWORD

1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
6) All users should ensure that they have the latest edition of this publication.
7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
9) IEC draws attention to the possibility that the implementation of this document may involve the use of (a) patent(s). IEC takes no position concerning the evidence, validity or applicability of any claimed patent rights in respect thereof. As of the date of publication of this document, IEC had not received notice of (a) patent(s), which may be required to implement this document. However, implementers are cautioned that this may not represent the latest information, which may be obtained from the patent database available at https://patents.iec.ch. IEC shall not be held responsible for identifying any or all such patent rights.

IEC TR 63282-102 has been prepared by IEC technical committee 8: System aspects of electrical energy supply. It is a Technical Report.

The text of this Technical Report is based on the following documents:

Draft	Report on voting
8/1760/DTR	8/1784/RVDTR

Full information on the voting for its approval can be found in the report on voting indicated in the above table.

This document is to be used in conjunction with and as a supplement to IEC TR 63282 up to 1 500 V DC.

The language used for the development of this Technical Report is English.

Documents
Document Sharing Hub

Full document details: PD IEC TR 63282-102:2025

This document was drafted in accordance with ISO/IEC Directives, Part 2, and developed in accordance with ISO/IEC Directives, Part 1 and ISO/IEC Directives, IEC Supplement, available at www.iec.ch/members_experts/refdocs. The main document types developed by IEC are described in greater detail at www.iec.ch/publications.

A list of all parts in the IEC 63282 series, published under the general title *LVDC systems*, can be found on the IEC website.

The committee has decided that the contents of this document will remain unchanged until the stability date indicated on the IEC website under webstore.iec.ch in the data related to the specific document. At this date, the document will be

– reconfirmed,
– withdrawn, or
– revised.

Documents
Document Sharing Hub

Full document details: PD IEC TR 63282-102:2025

INTRODUCTION

The vast majority of global population lives in the developing countries, and a significant portion of the developing countries have no, or poor, access to electricity. According to the United Nations Foundation, there are still around 1,2 billion people who do not have access to electricity and around 1 billion more who depend on unreliable electric networks. Energy access is a complex task in rural areas as most of the villages/hamlets are located at remote and/or hilly terrain. Barriers to energy access include uneconomic grid expansion and high transportation costs for fuel. However, these remote areas are rich in availability of locally available resources such as waste from agricultural field, solar intensity, wind utilization, etc., so how to use local resources to provide electricity supply has become a challenge in remote rural areas.

Electric island LVDC (Low voltage direct current) systems have recently been recognized by a number of stakeholders as an alternative solution for energy access in rural area. Several countries have already shown interest in the development of DC systems in order to improve the quality of their inhabitants' life together with the development of the local economy.

This document defines electric island LVDC systems for rural or remote areas, and on ships which normally operate with no connections to a national grid infrastructure. The purpose of this document is to provide some effective technical information to support the construction of electric island LVDC systems. It provides the unique characteristics of electric island power supply system and the key elements such as optional voltage level, topology and operation control, and provides some cases.

This document harmonizes with IEC TR 63282 for voltage level and power quality, and as a supplement to IEC TR 63282, but the application scenarios are slightly different and the power quality in this document are more prominent because there is no connection to a nation's primary grid.

This document mainly consists of three parts. The first part (Clause 4) gives the characteristics of the system, and describes the characteristics of the power source, load and the power quality of the electric island LVDC systems. These characteristics are designed to inform a number of stakeholders of the information to be aware of when building electric island LVDC systems. The second part (Clause 5) gives the system composition and technical description, and describes the load requirements, power source requirements, protection and operation of the electric island LVDC systems. Finally, five typical cases are given (Clause 6).

Documents
Document Sharing Hub

Full document details: PD IEC TR 63282-102:2025

1 Scope

The scope of this document is to assess the existing technical requirements (by TC 64, TC 82, SyC LVDC) and close any gaps related to electric island LVDC power supply systems in rural or remote areas without electricity up to a maximum of 1 500 V only. Additionally, it covers the case of LVDC auxiliary power supply systems for ships.

Specific technical items for electric island LVDC systems are explained in this document. Rationale for the proposed voltage level, topology, power quality, etc. are given.

This document gives inputs to several TCs in charge of the standardization of different issues and coordinated by SyC LVDC.

2 Normative references

There are no normative references in this document.

3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

ISO and IEC maintain terminology databases for use in standardization at the following addresses:

– IEC Electropedia: available at https://www.electropedia.org/
– ISO Online browsing platform: available at https://www.iso.org/obp

3.1
nominal system voltage
suitable approximate value of voltage used to designate or identify a system

[SOURCE: IEC 60050-601:1985, 601-01-21, modified - The original term "nominal voltage of a system" has been replaced by "nominal system voltage".]

3.2
electric island power supply system
off-grid or isolated power system
system that provides electricity without relying on any utility power grid

Note 1 to entry: It is designed to generate and store electricity using renewable energy sources such as solar panels and wind turbines, combined with energy storage systems like batteries, sometimes associated with a diesel generator. Electric island power supply systems are usually designed for isolated islands or for rural electrification in developing countries.

4 Characteristics of electric island LVDC systems

4.1 General

Power supply of electric island LVDC systems can be achieved with variable renewable sources like photovoltaic (PV) arrays, wind turbines and energy storage units. Consumption of electric island LVDC systems can be derived from a set of electrical equipment such as fans, lighting, mobile phones, etc.

Documents
Document Sharing Hub

Full document details: PD IEC TR 63282-102:2025

Electric island LVDC system represents a specific scenario within the field of LVDC systems. The power quality phenomena described in IEC TR 63282 are applicable to electric island LVDC power supply systems. Different scenarios and scales exhibit unique features, leading to diverse requirements for power quality.

4.2 Rural or remote areas without access to the grid

Electrification of remote rural regions through national power grids is largely unviable due to both the high infrastructure cost and the limited power generation capacity in many countries.

Generally, rural or remote areas have vast territories with low population density and relatively modest electricity consumption, which are characterized by low energy density. An electric island LVDC system that relies on one or more energy sources in conjunction with a battery and power conversion equipment is a feasible solution.

In terms of power sources, rural or remote areas are basically characterized with abundant renewable energy sources. Technologies such as wind turbines and PV arrays can be utilized in electric island LVDC systems to economically satisfy local energy demands. Generally, the solar power generation ramps up with the sunrise and wanes as the sun sets, while the wind power generation usually peaks at night. Considering that variable renewable sources, like PV arrays and wind turbines, provide intermittent supply, energy storage plays a crucial rule in enhancing flexibility and reliability of the electric island supply systems. The commonly used energy storage in power systems include pump hydro, compressed air, flywheel, as well as lithium-ion batteries, supercapacitors, etc. However, these options are costly and typically designed for large-scale scenarios. For electric island LVDC systems in rural or remote areas, economically viable lead-acid batteries are generally employed as the energy storage components.

In terms of loads, the electricity demand in these regions primarily caters to fundamental living and production necessities. According to the report published by Energy Sector Management Assistance Program (ESMAP), a multi-tier framework is defined for electricity consumption, as shown in Figure 1. Load characteristics in rural or remote areas basically refer to the ESMAP multi-tier framework, ranging from Tier 1 to Tier 3, which pertains to household electricity supply requirements. Most load profiles exhibit morning and evening peaks while more affluent homes also exhibit mid-day peaks. Daytime electricity consumption peaks in the morning, primarily driven by lighting, radios, and other electrical appliances. Nighttime electricity consumption mainly includes lighting, cooking and charger usage. Consequently, there are instances of insufficient power supply and increased electricity demand, leading to potential deviations of the system voltage from its normal operating range.

Electric island LVDC systems in rural or remote areas face limitations of village distribution and topographical factors. The loads tend to be relatively decentralized, resulting in an excessively large radius of electricity supply to cover all households. As the loads increase, low voltage issues arise owing to larger line voltage drop. Phenomenon of voltage fluctuations and deviations will be occasionally caused by the temporal and spatial disparities between the power sources and the loads. A careful consideration on system voltage selection and appropriate voltage level is paramount, which can significantly contribute to the mitigation of such issues. Overall, in remote and rural areas without access to electricity, the primary power quality concerns include voltage deviation, voltage fluctuation, power interruption, and ripple. While prioritizing cost-effectiveness, it is appropriate to consider a reduction in power quality indicators in these scenarios.

Documents
Document Sharing Hub

Full document details: PD IEC TR 63282-102:2025

ATTRIBUTES		TIER 0	TIER 1	TIER 2	TIER 3	TIER 4	TIER 5
1. Peak capacity	Power capacity rating[27] (in W or daily Wh)		Min 3 W	Min 50 W	Min 200 W	Min 800 W	Min 2 kW
			Min 12 Wh	Min 200 Wh	Min 1 kWh	Min 3,4 kWh	Min 8,2 kWh
	OR services		Lighting of 1 000 lmhr/ day	Electrical lighting, air circulation, television, and phone charging are possible			
2. Availability (duration)	Hours per day		Min 4 hrs	Min 4 hrs	Min 8 hrs	Min 16 hrs	Min 23 hrs
	Hours per evening		Min 1 hr	Min 2 hrs	Min 3 hrs	Min 4 hrs	Min 4 hrs
3. Reliability						Max 14 disruptions per week	Max 3 disruptions per week of total duration <2 hrs
4. Quality						Voltage problems do not affect the use of desired appliances	
5. Affordability					Cost of a standard consumption package of 365 kWh/year <5 % of household income		
6. Legality						Bill is paid to the utility, prepaid card seller, or authorized representative	
7. Health and safety						Absence of past accidents and perception of high risk in the future	

IEC

Figure 1 - Multi-tier matrix for measuring access to household electricity supply

4.3 LVDC auxiliary power supply system for ships

The auxiliary power supply system for ships is a typical LVDC, which is mainly responsible for supplying power to auxiliary loads on the ship, such as hotel loads. This will be discussed in this document. Noted that the primary power system of ships for the electrical propulsion is not included.

In terms of power sources, a ship's electric power is supplied by generators, fuel cells, energy storage systems, PV arrays and other energy sources having sufficient capacity to support onboard services. The generator is the most commonly used power supply device of the DC ship, and the number and capacity of the generators can be determined according to the hotel load demand. Energy storage can store electric energy when the power consumption is low, and provide power supply for the hotel load when the load demand is high. PV power generation is a clean energy that can be used in combination with generator and energy storage to improve power utilization. The ships can have both a main power supply and an emergency power supply according to the demand of electricity. According to IEC 60092-201, the main electric power supply ensures uninterrupted power to all essential electrical loads for maintaining the ship in normal operational and habitable condition and preservation of the cargo, without relying on the emergency power supply. The emergency power supply is capable of sustaining for a minimum of 6 hours according to IEC 60092-507. The starting current, surge current and fault current are restricted to a level that guarantees the effectiveness of the safety device and meets the voltage drop limits specified by IEC 60092 (all parts).

Documents
Document Sharing Hub

Full document details: PD IEC TR 63282-102:2025

The loads on a ship can be categorized into two main types: propulsion loads and hotel loads. Hotel loads encompass various elements, including lighting, ventilation, accommodation requirements, and auxiliary systems like small pumps and winches. Their contributions to the overall load are dependent on the shipboard missions. For instance, passenger cruise carriers and survey vessels have significant sensor and operational loads during missions, resulting in a more significant impact from hotel loads on the total power demand. According to IEC 60092-201, loads connected between lines and middle wire are balanced as far as possible within 15 % of the respective loads. According to IEEE Std 45.1™, the capacity of energy storage and on-line generators for redundancy are able to carry on-line uninterruptible and short-term interruptible loads.

The battery can be installed either as a stand-alone unit or in combination with other energy sources as the main electric power supply, while also serving as an emergency power source. When the energy storage is used as an emergency power source, it is capable of carrying emergency loads without charging, while maintaining the storage voltage within [−12 %, +5 %] of its nominal voltage throughout the discharge period. According to IEC 60092-507, the nominal DC voltage tolerance at the battery terminals, within which all the DC equipment is able to operate, is set at ± 10 %. Besides, the important loads of the ships remain functional when subjected to the minimum voltage at the battery terminals.

Overall, the power quality is pretty important to ensure the normal operation of DC ships. IEEE Std 1709 gives certain provisions for medium-voltage DC power systems on ships, mainly focusing on voltage ripple and noise, and according to it, the acceptable rms value of ripple voltage and load induced noise does not exceed 5 % per unit, while further research is needed for the power quality of ships with LVDC power supply.

5 Composition and technical description of electric island LVDC system

5.1 General

Understanding how to utilize an electric island LVDC system implies knowledge of its system composition and technical information, including the power source requirements (refer to Clause A.2 for detail information), load requirements (see Clause A.3), energy storage requirements (see Clause A.4), wiring (see Clause A.5), connectors and sockets (see Clause A.7), voltage level, topology, protection and operation (see Clause A.6 and Clause A.8), design (see Annex B), system installation (see Annex C), etc.

The IEC 62257 series provides comprehensive guidelines for renewable energy and hybrid systems for rural electrification. Some of them are applicable to both AC and DC systems. Specifically:

– IEC TS 62257-4: offers recommendations for system selection and design;
– IEC TS 62257-5: covers protection against electrical hazards;
– IEC TS 62257-7: provides guidance on the use of generators;
– IEC TS 62257-9-4: focuses on integrated systems and user installation;
– IEC TS 62257-9-7: recommends criteria for the selection of inverters;
– IEC TS 62257-9-8: sets requirements for stand-alone renewable energy products with power ratings less than or equal to 350 W.

Documents
Document Sharing Hub

Full document details: PD IEC TR 63282-102:2025

5.2 Voltage levels

5.2.1 General

Nowadays, LVDC distribution projects covers a wide range of scenarios, such as residential and office buildings, data centres, hospitals, retail establishments, transportation systems, lighting networks, and applications in agriculture or fish farming. Voltage levels are influenced by various factors such as topology, load distribution, supply capacity, insulation, wiring features, control strategies, protection requirements and equipment characteristics. Different commonly used voltage levels can be found in IEC 60038 and IEC TR 63282.

The selection of an appropriate DC bus voltage is made comprehensively, taking into account various influencing factors related to safety, power efficiency, and cost-effectiveness.

5.2.2 Rural or remote areas without access to the grid

For power supply to the rural or remote areas, electric island LVDC systems consisting of PV panels, batteries and loads present a promising solution by closing the access gap as well as featuring lower costs. Typically, these systems are installed on rural housing and village houses, where DC power directly feeds lighting and small DC appliances, or small AC appliances powered by dedicated inverters operating on DC power. The capacity of solar panels ranges from hundreds of Wps to thousands of Wps (Watts-peaks). The DC voltages provided to the loads are generally 5 V USB, 5 V USB-PD to 20 V USB-PD (USB Power Delivery), 12 V, 24 V and 48 V. The actual voltage is determined by the requirements of the system.

For example, if the batteries and the inverter are a long way from the PV array and use a switching type solar controller, then a higher voltage can be required to offset the power lost in the cables. In larger systems, 120 V DC or 240 V DC can be used, but these are not typical household systems. Due to the potentially fatal voltages used, the complexity in electrical designs would be increased, and the resulting system would be more expensive than for systems using voltages below 60 V DC that are not so dangerous.

As a general guideline, the nominal system voltage tends to increase with the total daily energy consumption. For smaller daily loads, a 12 V system voltage is commonly used, while intermediate daily loads are typically accommodated with a 24 V system voltage. For more substantial energy requirements, a 48 V system voltage is commonly used. The Sustainable Energy Industry Association of the Pacific Islands (SEIAPI) suggests that a 24 V system voltage is appropriate for systems with a maximum instantaneous power up to 4 kW, and for higher values of maximum instantaneous power, a 48 V system is used, as shown in Figure 2. Specific technical specifications can be found in IS 16711 and IEC 63318. Additionally, communication cables can provide power up to 70 W (PoE, power over Ethernet).

As for larger scale scenarios, further technical specifications are outlined in IEEE Std 2030.10™.

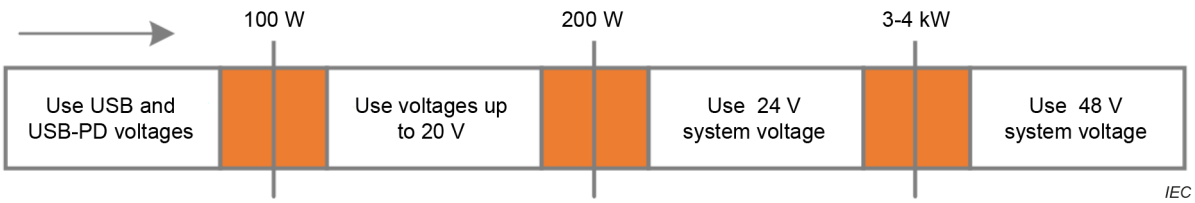

Figure 2 - Guideline to select system voltage

5.2.3 LVDC auxiliary power supply system in a ship

IEC 60092-201 gives typical values of nominal voltages and maximum voltages for common applications of LVDC auxiliary power supply system in a ship, as shown in Table 1.

Documents
Document Sharing Hub
Full document details: PD IEC TR 63282-102:2025

Table 1 - Voltages for different applications (IEC 60092-201)

Application	Nominal voltages (V)	Maximum voltages (V)
Cooking, heating	110, 220	500
Lighting and socket outlets	24, 110, 220	500
Communication	6, 12, 24, 48, 110, 220	250
Supplies to lifeboats or similar craft	12, 24, 48	55
Instrumentation	24, 48, 110, 220	250

5.3 Topology

5.3.1 General

The electric island DC power supply systems can be applied to both remote areas and ship power supply systems. In this document, the electric island DC power supply systems for remote area are further categorized into two levels: household-level and county-level, based on power capacity.

There is no unified standard for the system topology of DC distribution network. The selection process requires a thorough evaluation of various factors, including the power supply range, power supply capacity, the cost of the DC distribution network, and the choice of insulating switch equipment. At present, there are two basic structures, namely ring topology and radial topology. Different topologies are applied to different scenarios.

5.3.2 Household-level installation

A household installation is a small, interconnected, self-sustaining electrical system. For household-level applications, the ESMAP multi-tier framework can be used as a reference, including use cases from Tier 2 to Tier 5, as shown in Table 2.

Table 2 - Generic requirements for ESMAP tiers and attributes

Attribute	Tier 2	Tier 3	Tier 4	Tier 5
Peak capacity (W or daily Wh)	Min 50 W Min 200 Wh	Min 200 W Min 1,0 kWh	Min 800 W Min 3,4 kWh	Min 2 kW Min 8,2 kWh
Availability	Minimum 4 h per day; Minimum 2 h in the evening	Minimum 8 h per day; Minimum 3 h in the evening	Minimum 16 h per day; Minimum 4 h in the evening	Minimum 23 h per day; Minimum 4 h in the evening
Reliability	Not mentioned	Not mentioned	Moderate impact	little (or no) impact
Quality	Not mentioned	Not mentioned	Moderate impact	little (or no) impact

Configuration of such an individual installation is based on the scale of local loads, economic conditions, environmental factors, etc. A household installation commonly includes loads (sorts of household electric appliances), power sources (such as PV panels, wind turbines, DC generating sets and storage units), and ancillary facilities (such as distribution boards, wiring systems, socket-outlets). As depicted in Figure 3, these installations are considered fundamental building blocks. In islanded mode, a household installation is fed directly from local power sources, which is able to achieve self-balancing.

Documents
Document Sharing Hub

Full document details: PD IEC TR 63282-102:2025

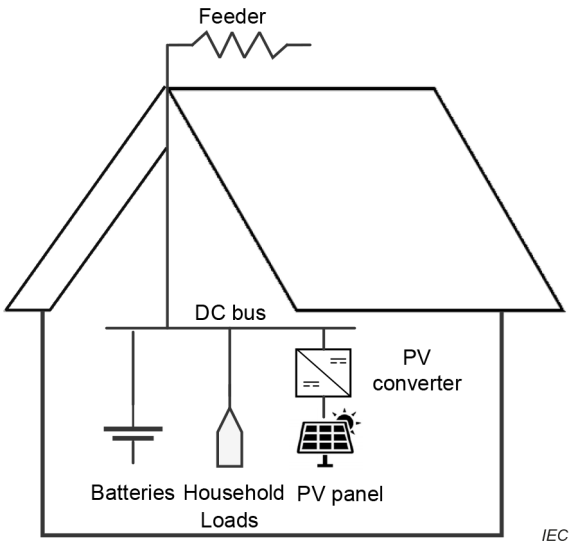

Figure 3 - A household installation

5.3.3 County-level installation

A county-level installation is formed by aggregating household installations, which enables the sharing of excess energy among household installations. Considering the spatial distribution of houses in various villages across developing countries, two types of topologies of county-level installation are listed as follows:

a) Radial configuration

In this topology, power flows along a single path towards different loads. Therefore, only one path is available between each load to the DC source interface. This topology is widely adopted due to its simplicity and low construction cost. However, it suffers from drawbacks such as uneven loading, non-uniform voltage distribution, voltage drops, and subsequent reliability issues. Figure 4 shows a topology of the radial schemes of interconnection with individual household installation design.

Documents
Document Sharing Hub
Full document details: PD IEC TR 63282-102:2025

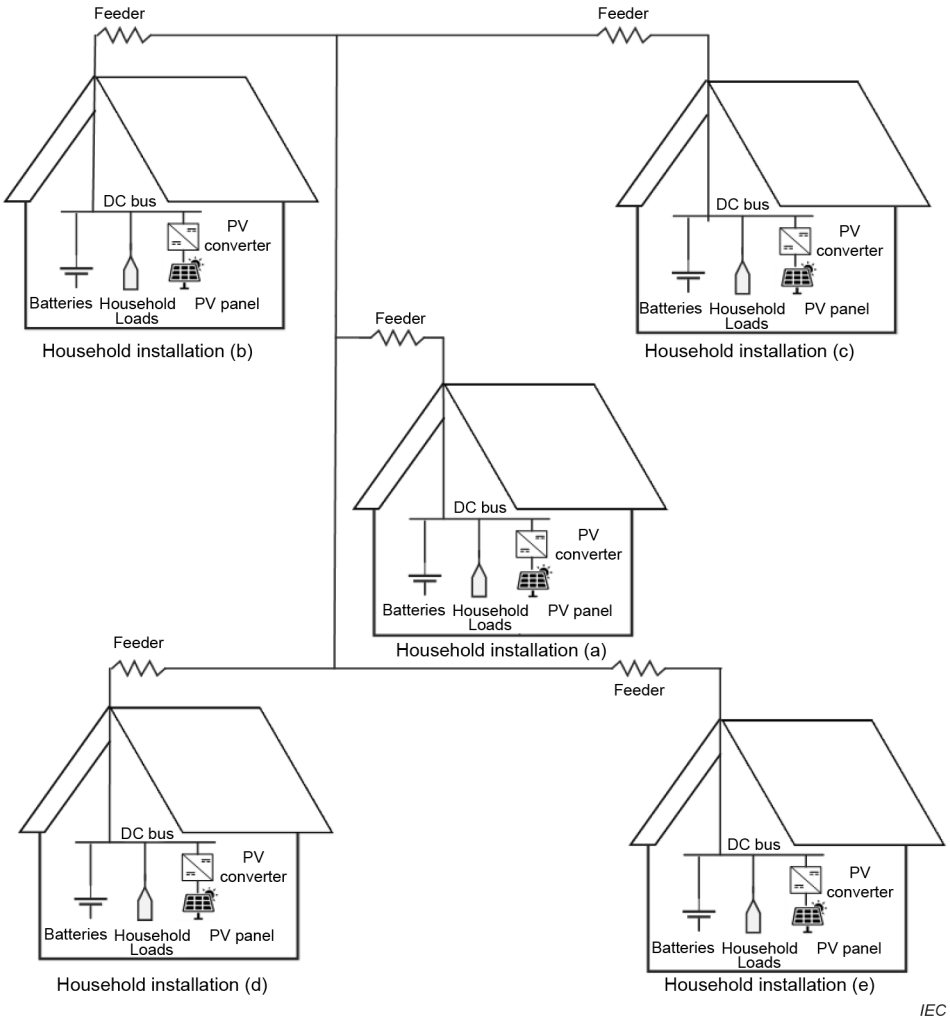

Figure 4 - A single line diagram of radial configuration

b) Ring configuration

This topology consists of multiple paths connecting the DC sources to the loads. DC switches are placed at both ends of each DC bus, providing the flexibility to isolate the faulty bus from the system. This topology not only enables the sharing of excess energy among household installations but also increases capability of system continuity of operation during the line fault. The ring configuration topology offers high performance compared to the radial configuration. In the event of a fault or maintenance on any conductor, the ring distributor continues to supply other feeders. Consequently, at the cost of extra conductors, higher efficiency and increased reliability are achieved, even at relatively low distribution voltages.

Documents
Document Sharing Hub
Full document details: PD IEC TR 63282-102:2025

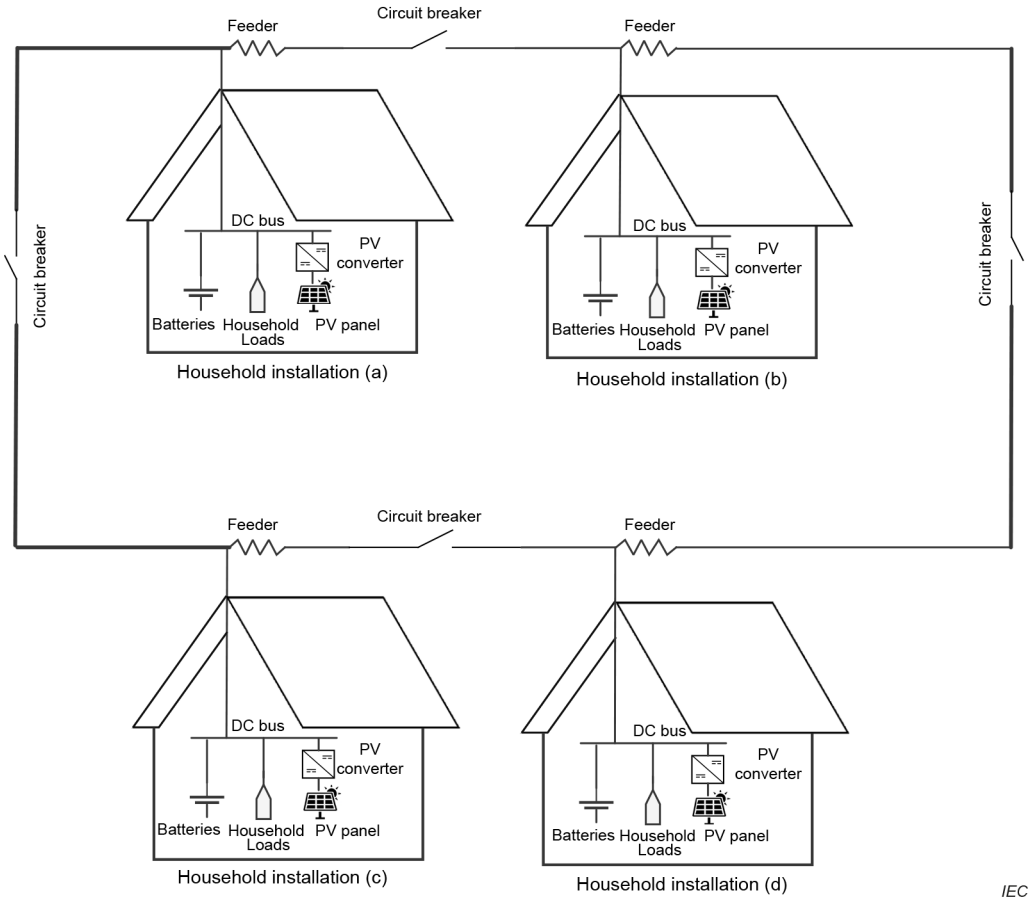

Figure 5 - A single line diagram of ring configuration

5.3.4 LVDC auxiliary power supply systems for ship

The secondary power distribution system topology of the DC ship depends on its design concept and the requirements of the task. The DC ships with different system topologies can be implemented through different bus configurations and cable layouts. Two types of topologies of ships installation are listed as follows:

a) Radial configuration

Most commercial ships have been built to perform a limited number of functions and minimize electrical installation and operating costs. This cost-efficiency motive is a primary driver behind the prevalent use of the radial bus configuration (depicted in Figure 6) on commercial ships. The radial bus configuration stands out as the simplest and most space-saving solution, requiring least number of circuit breakers. Smaller ships like fishing boats, ferries, offshore support vessels and small cargo vessels typically use a radial configuration. This straightforward configuration suits vessels with less complex power requirements and a smaller number of electrical loads.

b) Ring configuration

The ring bus configuration as illustrated in Figure 7, is commonly used on commercial ships with high requirement on system reliability and survivability. Cruise ships, luxury liners, naval vessels, and large passenger vessels often employ a ring configuration. In this configuration, system faults can be isolated by tripping two circuit breakers on either side of the fault (the minimum power outage). However, in this configuration, complex protection schemes and a large number of switching devices (circuit breakers or isolators) are required, which makes commercial ships costly. This configuration ensures a reliable power supply, even in the event of faults or failures in the distribution network.

Documents
Document Sharing Hub
Full document details: PD IEC TR 63282-102:2025