PD IEC TR 63368:2024

BSI Standards Publication

Control and protection systems for high-voltage direct current (HVDC) power transmission systems — Off-site real-time simulation testing

Documents
Document Sharing Hub

Full document details: PD IEC TR 63368:2024

National foreword

This Published Document is the UK implementation of IEC TR 63368:2024.

The UK participation in its preparation was entrusted to Technical Committee PEL/22, Power electronics.

A list of organizations represented on this committee can be obtained on request to its committee manager.

Contractual and legal considerations

This publication has been prepared in good faith, however no representation, warranty, assurance or undertaking (express or implied) is or will be made, and no responsibility or liability is or will be accepted by BSI in relation to the adequacy, accuracy, completeness or reasonableness of this publication. All and any such responsibility and liability is expressly disclaimed to the full extent permitted by the law.

This publication is provided as is, and is to be used at the recipient's own risk.

The recipient is advised to consider seeking professional guidance with respect to its use of this publication.

This publication is not intended to constitute a contract. Users are responsible for its correct application.

This publication is not to be regarded as a British Standard.

© The British Standards Institution 2024
Published by BSI Standards Limited 2024

ISBN 978 0 539 31571 4

ICS 29.240.99

Compliance with a Published Document cannot confer immunity from legal obligations.

This Published Document was published under the authority of the Standards Policy and Strategy Committee on 31 October 2024.

Amendments/corrigenda issued since publication

Date	Text affected

Documents
Document Sharing Hub

Full document details: PD IEC TR 63368:2024

IEC TR 63368

Edition 1.0 2024-09

TECHNICAL REPORT

colour inside

Control and protection systems for high-voltage direct current (HVDC) power transmission systems – Off-site real-time simulation testing

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

ICS 29.240.99

ISBN 978-2-8322-9712-4

Warning! Make sure that you obtained this publication from an authorized distributor.

® Registered trademark of the International Electrotechnical Commission

Documents
Document Sharing Hub

Full document details: PD IEC TR 63368:2024

CONTENTS

FOREWORD 4
INTRODUCTION 6
1 Scope 7
2 Normative references 7
3 Terms and definitions 7
3.1 Terms and definitions 7
3.2 Abbreviated terms 7
4 Test environment 8
4.1 General 8
4.2 Real-time simulator 8
4.2.1 General 8
4.2.2 Simulation interface devices 8
4.2.3 Simulation model 9
4.3 HVDC control and protection devices 11
4.3.1 Control devices 11
4.3.2 Protection devices 11
4.3.3 Measurement devices 12
4.3.4 Monitoring devices 12
4.3.5 Fault recording devices 12
4.3.6 Valve base control devices 12
5 Steady state control tests 12
5.1 General 12
5.2 DC switching sequence tests 13
5.3 Energization of reactive power components 13
5.4 Energization of converter transformers 13
5.5 Open line test of HVDC control system 13
5.6 Deblock-block performance tests 13
5.7 Operator control mode transfer tests 14
5.8 Operation status tests 14
5.9 Tap changer control tests 14
5.10 Reactive power control tests 14
5.10.1 Reactive power component switching function tests 14
5.10.2 Reactive power curve tests 14
5.11 Power ramping tests 15
5.12 Overload tests 15
5.13 Metallic and ground return configuration and transfer tests 15
5.14 Reduced voltage operation tests 15
5.15 Tests of static characteristic curves of converters 15
5.16 PQ diagram tests of VSC-HVDC converters 15
6 Dynamic control tests 16
6.1 General 16
6.2 Power step test 16
6.3 Current step test 16
6.4 Voltage step test 16
6.5 Gamma step test 17
6.6 AC system related tests 17

AVA Documents
Document Sharing Hub

6.6.1 AC disturbance tests 17
6.6.2 AC/DC interaction tests 17
6.7 Stability control function tests 18
6.8 Power system restoration test 18
6.9 Grid code tests 18
7 Protection tests 19
7.1 General 19
7.2 Trip signal logic tests 19
7.3 Converter unit area protection tests 19
7.4 DC bus area protection tests 19
7.5 DC filter area protection tests 20
7.6 DC line area protection tests 20
7.7 Switch protection tests 20
7.8 Other protection tests 20
8 Redundancy and reliability of control and protection system tests 21
8.1 General 21
8.2 Redundant system failure tests 21
8.3 System monitoring and switching tests 21
8.4 Electromagnetic interference tests (optional) 22
8.5 IT security 22
9 Special tests for VSC 23
9.1 General 23
9.2 Control system delay (optional) 23
9.3 Valve control and protection function tests 23
9.3.1 Valve control function test 23
9.3.2 Valve protection function tests 24
9.4 STATCOM tests 24
10 Test report 24
Annex A (informative) Examples of protection areas and faults 25
Annex B (informative) A typical test method for control system delay 28
Bibliography 30

Figure 1 – Relationship between clauses and test phases 6
Figure A.1 – Typical faults in a LCC HVDC substation (IEC/TR 60919-2:2008/AMD1:2015, Figure 7) 26
Figure A.2 – Typical faults in a VSC HVDC substation (example – symmetrical monopole shown in single phase) 27
Figure B.1 – Composition of control system delay 28
Figure B.2 – The real-time simulation test scheme for control system delay 29

Documents
Document Sharing Hub
Full document details: PD IEC TR 63368:2024

INTERNATIONAL ELECTROTECHNICAL COMMISSION

CONTROL AND PROTECTION SYSTEMS FOR HIGH-VOLTAGE DIRECT CURRENT (HVDC) POWER TRANSMISSION SYSTEMS – OFF-SITE REAL-TIME SIMULATION TESTING

FOREWORD

1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
6) All users should ensure that they have the latest edition of this publication.
7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
9) IEC draws attention to the possibility that the implementation of this document may involve the use of (a) patent(s). IEC takes no position concerning the evidence, validity or applicability of any claimed patent rights in respect thereof. As of the date of publication of this document, IEC had not received notice of (a) patent(s), which may be required to implement this document. However, implementers are cautioned that this may not represent the latest information, which may be obtained from the patent database available at https://patents.iec.ch. IEC shall not be held responsible for identifying any or all such patent rights.

IEC TR 63368 has been prepared by subcommittee 22F: Power electronics for electrical transmission and distribution systems, of IEC technical committee 22: Power electronic systems and equipment. It is a Technical Report.

The text of this Technical Report is based on the following documents:

Draft	Report on voting
22F/763/DTR	22F/787/RVDTR

Full information on the voting for its approval can be found in the report on voting indicated in the above table.

The language used for the development of this Technical Report is English.

Documents
Document Sharing Hub

Full document details: PD IEC TR 63368:2024

This document was drafted in accordance with ISO/IEC Directives, Part 2, and developed in accordance with ISO/IEC Directives, Part 1 and ISO/IEC Directives, IEC Supplement, available at www.iec.ch/members_experts/refdocs. The main document types developed by IEC are described in greater detail at www.iec.ch/publications.

The committee has decided that the contents of this document will remain unchanged until the stability date indicated on the IEC website under webstore.iec.ch in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn, or
- revised.

IMPORTANT – The "colour inside" logo on the cover page of this document indicates that it contains colours which are considered to be useful for the correct understanding of its contents. Users should therefore print this document using a colour printer.

Documents
Document Sharing Hub

Full document details: PD IEC TR 63368:2024

INTRODUCTION

It has been the mainstream practice of HVDC transmission system engineering to build a real-time simulation test system with actual control and protection (C&P) devices to test the functionality of various functions of the HVDC C&P system.

In order to provide practical guidance for the functional tests of HVDC transmission systems, this document covers the real-time test environment, functional performance tests, and the test report.

In order to construct the test system in the test preparation phase, Clause 4 introduces the off-site real-time simulation test environment of the functional performance tests (FPT), including the real-time simulator, the C&P system for test purposes, the interface devices and their connection relationships, and the simulation models.

Clause 5 introduces the test practices and test methods of HVDC steady state control functions.

Clause 6 introduces the test practices and test methods of HVDC dynamic control functions, whose main concerns are dynamic responses of DC voltage, DC current and DC power.

Clause 7 introduces the test practices and test methods of DC protection, whose main concerns are DC protection logic and threshold values.

Clause 8 introduces the reliability tests of C&P systems, including redundancy tests and related system switching tests, with the test practices and test methods described in detail.

Clause 9 introduces the special test practices and test methods for VSC-HVDC. In order to thoroughly test the unique functions of VSC-HVDC, it can be necessary to add some specific tests to be decided case by case.

Clause 10 introduces test reports. It includes mainly the contents of a test report.

The above clauses introduce various possible functionalities which do not apply to every HVDC project mandatorily as a whole. It is the purchaser's task to select the appropriate project-specific combination of functionalities. This document describes various possibilities; however, it is important that project-specific needs be clearly defined by the purchaser. The relationship between clauses and test phases is shown in Figure 1.

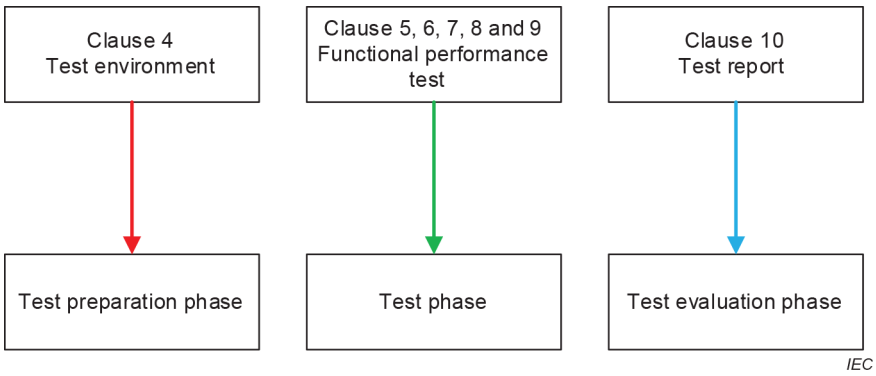

Figure 1 – Relationship between clauses and test phases

Documents
Document Sharing Hub
Full document details: PD IEC TR 63368:2024

CONTROL AND PROTECTION SYSTEMS FOR HIGH-VOLTAGE DIRECT CURRENT (HVDC) POWER TRANSMISSION SYSTEMS – OFF-SITE REAL-TIME SIMULATION TESTING

1 Scope

This document provides guidance on off-site real-time simulation tests of control and protection (C&P) systems for HVDC power transmission systems. The off-site real-time simulation tests are carried out after the testing of C&P devices and prior to on-site system tests.

This document covers point-to-point, back-to-back, and multi-terminal HVDC systems of line commutated converters (LCC), voltage-sourced converters (VSC) and hybrid HVDC technologies.

In order to provide practical guidance for the functional performance tests of HVDC power transmission systems, this document covers the test environment, the contents and methods of functional performance tests, and the test report.

2 Normative references

There are no normative references in this document.

3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

ISO and IEC maintain terminology databases for use in standardization at the following addresses:

- IEC Electropedia: available at https://www.electropedia.org/
- ISO Online browsing platform: available at https://www.iso.org/obp

3.1 Terms and definitions

3.1.1
control system delay
total time delay of the control link, including sampling delays, transmission delays and signal processing time of all control devices

3.2 Abbreviated terms

C&P	Control and protection
EHV	Extra high voltage
EMT	Electromagnetic transient
FPGA	Field-programmable gate array
FPT	Functional performance test
GRTS	Ground return transfer switch
HIL	Hardware in loop
HMI	Human machine interface
HVDC	High-voltage direct current

Documents
Document Sharing Hub

Full document details: PD IEC TR 63368:2024

IGBT	Insulated-gate bipolar transistor
I/O	Input / output
LCC	Line-commutated converter
MMC	Modular multilevel converter
MRTB	Metallic return transfer breaker
MTDC	Multi-terminal HVDC transmission system
RTS	Real-time simulator/simulation
SCADA	Supervisory control and data acquisition
SER	Sequence of event recording / Sequence of event recorder
SM	Sub-module
STATCOM	Static synchronous compensator
SVC	Static var compensator
TCSC	Thyristor controlled series compensation
VDCOL	Voltage dependent current order limitation
VSC	Voltage-sourced converter

4 Test environment

4.1 General

The test environment is used for providing various power system conditions. The system conditions are based on real-time simulation for testing the functionality including dynamic behavior of an HVDC C&P system. It commonly includes RTS with models and delivered C&P devices of a specific HVDC project.

4.2 Real-time simulator

4.2.1 General

RTS refers to real-time digital simulators based on electro-magnetic transient (EMT) algorithm. RTS is used to model HVDC main circuits, adjacent AC system(s), and adjacent HVDC system(s) as required by the purpose of the test, to connect actual C&P devices with simulation interfaces. It runs models with sufficient simulation cycle time, stably and continuously, strictly in real-time in every simulation time step.

4.2.2 Simulation interface devices

4.2.2.1 General

Simulation interface devices are used to connect C&P devices, with RTS for establishing closed-loop HIL simulation systems. The protocols used for the communication among RTS, the C&P devices and the simulation interface devices are dependent on the actual project and type of simulator in use.

4.2.2.2 I/O interface devices

Simulation interface devices are used for establishing the I/O communications with RTS. Generally, there are two types of interface techniques used for commercial RTS nowadays: analog interface and digital interface.

1) Analog interface: the interface connections are performed through wires connected to the I/O interface cards of RTS.
2) Digital interface: the interface connections are performed through digital system buses, and in most of the applications, physically established via optical fibers.

AVA Documents
Document Sharing Hub

4.2.2.3 Other special interfaces for RTS tests

1) Power amplifiers can be used to amplify RTS analog output signals to ensure the interface adaptation to the C&P devices designed for the actual interfaces on site. It is optional and dependent on the measurement input design of the C&P devices.
2) Disconnectors and earthing switches with slow operating time are usually not represented in RTS. Instead, they are simulated in other suitable ways such as by AC and DC switch simulator in the form of relay or digital system.

4.2.2.4 Valve interfaces for MMC-HVDC

In order to test the functions of the MMC valve base control device, appropriate interface devices could be provided for RTS. These devices are optional, and if needed, used for translating the packets of MMC sub-module on/off commands from the MMC valve base control device into a specific form adapting to the MMC models in RTS.

4.2.3 Simulation model

4.2.3.1 General

The simulator model must be adapted for the specific project and for the planned testing. Generally, the detailed characteristics of equipment in the model match the testing purposes. The simulation model is generally composed of one or more of the following in 4.2.3.2.

4.2.3.2 Model of HVDC main circuit

4.2.3.2.1 LCC converter and transformer

The LCC converter and transformer are generally integrated with one component or two individual models according to the test requirement.

The component simulates the key characteristics of the converter and transformer, including compensation algorithm, firing angle, and extinction angle measurement.

4.2.3.2.2 MMC converter and transformer

The large number of sub-modules creates an excessive computational burden for the EMT simulation of MMC-HVDC systems, especially in real-time environments. For the HIL test, the exchange of large numbers of capacitor voltages and individual firing pulses presents a communication challenge for the simulation model and the external physical control devices. In order to meet the requirements of MMC-HVDC simulation and testing, various types of models based on both processors and FPGAs have been developed using vast parallel computation techniques, which can model the MMC converter with up to thousands of sub-modules.

The time step of the MMC converter model on FPGA is usually less than 10 µs. In this case, the transformer can be modelled as an interface model for decoupling the MMC converter in small time step from the main network in large time step.

If the MMC converter model and the main network use the same time step, a traditional transformer model can be used to connect the MMC converter model and the main network.

4.2.3.2.3 HVDC transmission line and electrode line or metallic return conductor

Generally, the distributed parameter frequency-dependent model is used in RTS for HVDC overhead lines, HVDC cables, and the electrode line or metallic return conductor. The model parameters are in accordance with the actual project. For stability and accuracy purposes, the phase domain frequency dependent line model can be utilized to model DC lines and cables.

Documents
Document Sharing Hub
Full document details: PD IEC TR 63368:2024