PD IEC TR 63434:2023

BSI Standards Publication

Low voltage switchgear and controlgear — Partial discharge voltages and PD-level in low voltage switchgear and controlgear

Documents
Document Sharing Hub

Full document details: PD IEC TR 63434:2023

National foreword

This Published Document is the UK implementation of IEC TR 63434:2023.

The UK participation in its preparation was entrusted to Technical Committee PEL/121/1, Low voltage switchgear and controlgear.

A list of organizations represented on this committee can be obtained on request to its committee manager.

Contractual and legal considerations

This publication has been prepared in good faith, however no representation, warranty, assurance or undertaking (express or implied) is or will be made, and no responsibility or liability is or will be accepted by BSI in relation to the adequacy, accuracy, completeness or reasonableness of this publication. All and any such responsibility and liability is expressly disclaimed to the full extent permitted by the law.

This publication is provided as is, and is to be used at the recipient's own risk.

The recipient is advised to consider seeking professional guidance with respect to its use of this publication.

This publication is not intended to constitute a contract. Users are responsible for its correct application.

This publication is not to be regarded as a British Standard.

© The British Standards Institution 2023
Published by BSI Standards Limited 2023

ISBN 978 0 539 21292 1

ICS 29.130.20

Compliance with a Published Document cannot confer immunity from legal obligations.

This Published Document was published under the authority of the Standards Policy and Strategy Committee on 31 October 2023.

Amendments/corrigenda issued since publication

Date	Text affected

Documents
Document Sharing Hub

Full document details: PD IEC TR 63434:2023

IEC TR 63434

Edition 1.0 2023-09

TECHNICAL REPORT

Low voltage switchgear and controlgear – Partial discharge voltages and PD-level in low voltage switchgear and controlgear

INTERNATIONAL
ELECTROTECHNICAL
COMMISSION

ICS 29.130.20

ISBN 978-2-8322-7573-3

Warning! Make sure that you obtained this publication from an authorized distributor.

® Registered trademark of the International Electrotechnical Commission

Documents
Document Sharing Hub

Full document details: PD IEC TR 63434:2023

CONTENTS

FOREWORD 4
INTRODUCTION 6
1 Scope 7
2 Normative references 7
3 Terms and definitions 7
4 Basic information (physics) 10
4.1 Discharge phenomena 10
4.1.1 General 10
4.1.2 Homogeneous electric fields 10
4.1.3 Inhomogeneous electric fields 11
4.2 Dimensioning examples 14
4.2.1 General 14
4.2.2 Influence of design and temperature on a series connection of clearances and solid insulation for AC voltage 17
4.2.3 Series connection of clearances and solid insulation by design for DC voltage 24
4.2.4 Solid insulation – dimensioning – material characteristics 24
5 Application rules 29
5.1 General 29
5.2 Partial discharge considerations 30
5.3 Measures to prevent/reduce the probability of partial discharges 30
Annex A (informative) Research on partial discharge in low-voltage switchgear and controlgear 31
A.1 General 31
A.2 Investigations on switchgear 31
A.3 Reference to other products relevant for applications 35
Annex B (informative) Voltage factors when considering partial discharge effects 36
Bibliography 38

Figure 1 – Temperature dependent variation of the breakdown field strength $\hat{E}_d$ of air per Equation (1), α = 0,8, θ = 20 °C, $p = p_0$ = 1 013 mbar 11
Figure 2 – Inception voltage $U_{i,RMS}$ depending on the electrode radius r, $R \gg r$ 12
Figure 3 – Maximum electrical field strength $\hat{E}$ depending on the electrode edge radius r 13
Figure 4 – Paschen curve $\hat{E}_d = f(p \times d)$ for air 13
Figure 5 – Principle terminal / contact arrangement of a 3-pole device, capacitive voltage divider 15
Figure 6 – Field strength in the air gap, inhomogeneous, η = 0,5 , ε_{r2} = 4, cold state 19
Figure 7 – Field strength in the solid insulation, inhomogeneous, η = 0,5, ε_{r2} = 4, cold state 19
Figure 8 – Field strength in the air gap, inhomogeneous, η = 0,5, ε_{r2} = 12 at 130 °C operational temperature 20
Figure 9 – Field strength in the solid insulation, inhomogeneous, η = 0,5, ε_{r2} = 12 operational temperature 20
Figure 10 – Gaps and voids in a solid and combined solid / gaseous insulation [7] 21

AVA Documents
Document Sharing Hub
Full document details: PD IEC TR 63434:2023

Figure 11 – Model of a void of thickness t in an insulation wall of defined thickness d [20] 23
Figure 12 – Principle arrangement of electrodes and insulation walls of a 3-pole device 24
Figure 13 – Permissible field strength for dimensioning of solid insulation according to Equation (18) 25
Figure 14 – Breakdown at high frequency, solid insulation; d = 0,75 mm [23] 26
Figure 15 – Breakdown at high frequency, solid insulation, influence of humidity; conditioning at 50 °C; 1: mica-filled phenolic, d = 0,75 mm; 2: glass-silicone laminate, d = 1,5 mm [24] 27
Figure 16 – Dielectric strength $\hat{E}_{\mathrm{d}}$ of different types of thermoplastic insulation material depending on the temperature 28
Figure 17 – Dielectric strength $E_{\mathrm{d,RMS}}$ of PA6-GF30 in dry and moist condition (equilibrium moisture content at 23 °C/50 % RH) depending on the temperature θ (°C).....29
Figure A.1 – Example of phase resolved partial discharge measurement on a MPSD at room temperature and at elevated operational temperatures 31
Figure A.2 – PD Testing (690 V, basic insulation, 20°C).....32
Figure A.3 – Inception (U_{i}) and extinction (U_{e}) voltage during partial discharge measurements on motor protection switching devices (MPSD) at elevated temperatures 33

Table 1 – Relationship between electrode radius r and corona inception voltage $U_{\mathrm{i,RMS}}$ 12
Table 2 – Ranking of the internal field strength of different gap and void shapes [7] 22
Table A.1 – Inception U_{i} and extinction U_{e} voltage depending on the temperature as per Figure A.1 and Figure A.2 32
Table A.2 – Maximum discharge values and number of events observed at the test voltage as per Figure A.1 and Figure A.2 32
Table A.3 – Ratings and design parameters of the investigated motor protection switching devices (MPSD).....34
Table A.4 – Partial Discharge (PD) acceptance levels in different IEC documents.....35
Table B.1 – Coordination of rated RMS voltage with partial discharge voltage and extinction voltage 37

Documents
Document Sharing Hub
Full document details: PD IEC TR 63434:2023

INTERNATIONAL ELECTROTECHNICAL COMMISSION

LOW VOLTAGE SWITCHGEAR AND CONTROLGEAR –

PARTIAL DISCHARGE VOLTAGES AND PD-LEVEL IN LOW VOLTAGE SWITCHGEAR AND CONTROLGEAR

FOREWORD

1) The International Electrotechnical Commission (IEC) is a worldwide organization for standardization comprising all national electrotechnical committees (IEC National Committees). The object of IEC is to promote international co-operation on all questions concerning standardization in the electrical and electronic fields. To this end and in addition to other activities, IEC publishes International Standards, Technical Specifications, Technical Reports, Publicly Available Specifications (PAS) and Guides (hereafter referred to as "IEC Publication(s)"). Their preparation is entrusted to technical committees; any IEC National Committee interested in the subject dealt with may participate in this preparatory work. International, governmental and non-governmental organizations liaising with the IEC also participate in this preparation. IEC collaborates closely with the International Organization for Standardization (ISO) in accordance with conditions determined by agreement between the two organizations.
2) The formal decisions or agreements of IEC on technical matters express, as nearly as possible, an international consensus of opinion on the relevant subjects since each technical committee has representation from all interested IEC National Committees.
3) IEC Publications have the form of recommendations for international use and are accepted by IEC National Committees in that sense. While all reasonable efforts are made to ensure that the technical content of IEC Publications is accurate, IEC cannot be held responsible for the way in which they are used or for any misinterpretation by any end user.
4) In order to promote international uniformity, IEC National Committees undertake to apply IEC Publications transparently to the maximum extent possible in their national and regional publications. Any divergence between any IEC Publication and the corresponding national or regional publication shall be clearly indicated in the latter.
5) IEC itself does not provide any attestation of conformity. Independent certification bodies provide conformity assessment services and, in some areas, access to IEC marks of conformity. IEC is not responsible for any services carried out by independent certification bodies.
6) All users should ensure that they have the latest edition of this publication.
7) No liability shall attach to IEC or its directors, employees, servants or agents including individual experts and members of its technical committees and IEC National Committees for any personal injury, property damage or other damage of any nature whatsoever, whether direct or indirect, or for costs (including legal fees) and expenses arising out of the publication, use of, or reliance upon, this IEC Publication or any other IEC Publications.
8) Attention is drawn to the Normative references cited in this publication. Use of the referenced publications is indispensable for the correct application of this publication.
9) IEC draws attention to the possibility that the implementation of this document may involve the use of (a) patent(s). IEC takes no position concerning the evidence, validity or applicability of any claimed patent rights in respect thereof. As of the date of publication of this document, IEC had not received notice of (a) patent(s), which may be required to implement this document. However, implementers are cautioned that this may not represent the latest information, which may be obtained from the patent database available at https://patents.iec.ch. IEC shall not be held responsible for identifying any or all such patent rights.

IEC TR 63434 has been prepared by subcommittee 121A: Low voltage switchgear and controlgear, of IEC technical committee 121: Switchgear and controlgear and their assemblies for low-voltage. It is a Technical Report.

The text of this Technical Report is based on the following documents:

Draft	Report on voting
121A/549/DTR	121A/556A/RVDTR

Full information on the voting for its approval can be found in the report on voting indicated in the above table.

Documents
Document Sharing Hub

Full document details: PD IEC TR 63434:2023

The language used for the development of this Technical Report is English.

This document was drafted in accordance with ISO/IEC Directives, Part 2, and developed in accordance with ISO/IEC Directives, Part 1 and ISO/IEC Directives, IEC Supplement, available at www.iec.ch/members_experts/refdocs. The main document types developed by IEC are described in greater detail at www.iec.ch/publications.

The committee has decided that the contents of this document will remain unchanged until the stability date indicated on the IEC website under webstore.iec.ch in the data related to the specific document. At this date, the document will be

- reconfirmed,
- withdrawn,
- replaced by a revised edition, or
- amended.

Documents
Document Sharing Hub

Full document details: PD IEC TR 63434:2023

INTRODUCTION

The application of this document is intended to provide awareness about partial discharge phenomena. Special emphasis is given to the electrical field stress through solid insulation as it relates to the risk of insulation failure.

IEC 60664-1[1] [1] is only providing requirements for partial discharge testing of solid insulation when the peak value of the operational voltage exceeds 700 V and the average field strength is higher than 1 kV/mm. However, in practice, partial discharge testing gives random results below 4 kV/mm, mainly because of the intrinsic fluctuation of PD inception voltage in gaps, the variations of the shape and size of the internal voids in solid materials, and the large influence of the temperature and humidity on the material characteristics. Therefore, this document is providing guidance related to the proper design of the insulation and the selection criteria of the material.

[1] Numbers in square brackets refer to the Bibliography.

Documents
Document Sharing Hub

Full document details: PD IEC TR 63434:2023

LOW VOLTAGE SWITCHGEAR AND CONTROLGEAR –

PARTIAL DISCHARGE VOLTAGES AND PD-LEVEL IN LOW VOLTAGE SWITCHGEAR AND CONTROLGEAR

1 Scope

This document is intended to provide awareness about partial discharge phenomena. This document gives guidance for some conditions when partial discharge can occur in low voltage switchgear and controlgear connected to networks of up to 1 000 V AC. Internal operational voltages can exceed these values. This document gives guidance on the design of conductors and dimensioning of insulation exposed to electrical fields.

This document explains the partial discharge phenomena considering electrical field stress, type of insulation material and other construction parameters, such as the voltage, frequency, temperature, humidity and the distances within the device.

This document does not cover:

- phenomena associated with semiconductor power switching by effects on equipment placed downstream of semiconductor power switching systems;
- partial discharge test procedures (see IEC 60270) [2];
- pure DC systems which are under consideration;
- selection of solid insulation material.

2 Normative references

There are no normative references in this document.

3 Terms and definitions

For the purposes of this document, the following terms and definitions apply.

ISO and IEC maintain terminological databases for use in standardization at the following addresses:

- IEC Electropedia: available at http://www.electropedia.org/
- ISO Online browsing platform: available at http://www.iso.org/obp

3.1
homogeneous electric field
electric field which has an essentially constant voltage gradient between electrodes, such as that between two spheres where the radius of each sphere is greater than the distance between them

Note 1 to entry: The homogeneous field condition is referred to as case B in IEC 60664-1[1].

[SOURCE: IEC 60050-442:2014[3], 442-09-02]

3.2
inhomogeneous electric field
electric field which does not have an essentially constant voltage gradient between electrodes

AVA Documents
Document Sharing Hub

Full document details: PD IEC TR 63434:2023

Note 1 to entry: The inhomogeneous field condition of a point-plane electrode configuration is the worst case with regard to voltage withstand capability and is referred to as case A in IEC 60664-1[1]. It is represented by a point electrode having a 30 µm radius and a plane of 1 m × 1 m.

Note 2 to entry: For frequencies exceeding 30 kHz, the field is considered to be inhomogeneous when the radius of curvature of the conductive parts is less than 20 % of the clearance.

[SOURCE: IEC 60050-442:2014[3], 442-09-03]

3.3
partial discharge
PD
electric discharge that only partially bridges the insulation between conductors

Note 1 to entry: A partial discharge may occur inside the insulation or adjacent to a conductor.

Note 2 to entry: Scintillations of low energy on the surface of insulating materials are often described as partial discharges but should rather be considered as disruptive discharges of low energy, since they are the result of local dielectric breakdowns of high ionization density, or small arcs, according to the conventions of physics.

[SOURCE: IEC 60050-212:2010[3], 212-11-39, modified — Addition of the synonym “PD”.]

3.4
partial discharge intensity
amount of partial discharge occurring under given conditions

Note 1 to entry: In practice the partial discharge intensity is usually expressed in picocoulombs or in joules.

[SOURCE: IEC 60050-212:2010[3], 212-11-40]

3.5
partial discharge inception voltage
U_{i}
lowest peak value of the test voltage at which the apparent charge becomes greater than the specified discharge magnitude when the test voltage is increased above a low value for which no discharge occurs

Note 1 to entry: For AC tests the RMS value may be used.

[SOURCE: IEC 60050-212:2014[3], 212-11-41]

3.6
partial discharge extinction voltage
U_{e}
highest voltage at which partial discharges are extinguished when the voltage applied is gradually decreased from a higher value at which such discharges are observed

[SOURCE: IEC 60050-212:2010[3], 212-11-42, modified – added abbreviation U_{e}]

3.7
impulse withstand voltage
U_{imp}
highest peak impulse voltage, of prescribed form and polarity, which does not cause breakdown under specified conditions of test

3.8
internal partial discharge
partial discharge inside an insulating material

[SOURCE: IEC 60050-212:2010[3], 212-11-43]

Documents
Document Sharing Hub
Full document details: PD IEC TR 63434:2023

3.9
working voltage
highest RMS value of the AC or DC voltage across any particular insulation which can occur when the equipment is supplied at rated voltage

Note 1 to entry: Transient overvoltages are disregarded.

Note 2 to entry: Both open-circuit conditions and normal operating conditions are taken into account.

[SOURCE: IEC 60947-1:2020[4], 3.7.52]

3.10
recurring peak voltage
U_{rp}
maximum peak value of periodic excursions of the voltage waveform resulting from distortions of an AC voltage or from AC components superimposed on a DC voltage

Note 1 to entry: Random overvoltages, for example due to occasional switching, are not considered to be recurring peak voltages.

[SOURCE: IEC 60050-442:2014[3], 442-09-15]

3.11
temporary overvoltage
overvoltage at power frequency of relatively long duration

Note 1 to entry: A temporary overvoltage is undamped or weakly damped. In some cases, its frequency may be several times smaller or greater than power frequency.

[SOURCE: IEC 60947-1:2020[4], 3.7.53]

3.12
transient overvoltage
short duration overvoltage of a few milliseconds or less, oscillatory or non-oscillatory, usually highly damped

[SOURCE: IEC 60050-614:2016[3], 614-03-14, modified – “overvoltage with a duration” has been replaced with “short duration overvoltage” and the notes have been deleted.]

3.13
glow discharge
self-maintained gas conduction for which most of the charge carriers are electrons supplied by secondary-electron emission

[SOURCE: IEC 60050-121:1998[3], 121-13-13]

3.14
electric breakdown
abrupt change of all or part of an insulating medium into a conducting medium resulting in an electric discharge

[SOURCE: IEC 60050-614:2016[3], 614-03-15]

3.15
electric strength
quotient of the maximum voltage applied without breakdown, by the distance between conducting parts under prescribed test conditions

[SOURCE: IEC 60050-212:2010[3], 212-11-37]

AVA Documents
Document Sharing Hub

Full document details: PD IEC TR 63434:2023

3.16
glass transition
physical change in an amorphous material or in amorphous regions of a partially crystalline material from a viscous or rubbery condition to a hard one, or the reverse

[SOURCE: IEC 60050-212:2010[3], 212-12-28]

3.17
glass transition temperature
T_g
midpoint of a thermodynamic temperature range over which the glass transition takes place

[SOURCE: IEC 60050-212:2010[3], 212-12-29]

4 Basic information (physics)

4.1 Discharge phenomena

4.1.1 General

Partial discharges are well known in the field of high voltage applications and typical for inhomogeneous electrical field distributions.

Partial discharges in electromechanical switchgear can appear in different ways: through air directly (external PD), on surfaces of supporting parts (surface PD) and within voids of solid or liquid insulation components like phase separation walls (internal PD). Surface discharges in air have generally larger values than those inside of cavities of solid insulation [5].

NOTE In [6] a simulation is shown illustrating the potential locations of PD generation in a Motor Protection Switching Device (MPSD).

4.1.2 Homogeneous electric fields

The breakdown field strength or dielectric strength of an air gap of 1 mm distance with a homogeneous electric field – e.g. between parallel plane electrodes – is about 4 kV/mm (see Figure 4). In technical applications the size of the air gaps between electrodes and insulation material can be 1 mm or less.

NOTE For breakdown processes in homogeneous electric fields in air in general the Paschen-Law [7], [9] is valid.

The breakdown field strength $\hat{E}_d$ is depending on the temperature T. The temperature correction is done by using equation (1) with T_0 = 293 K and the worst case temperature coefficient α = 0,8.[[7], p. 169], see Figure 1.

$$\hat{E}_d = \hat{E}_{do}\left(\frac{p / p_0}{T / T_0}\right)^a \quad (1)$$

Documents
Document Sharing Hub
Full document details: PD IEC TR 63434:2023

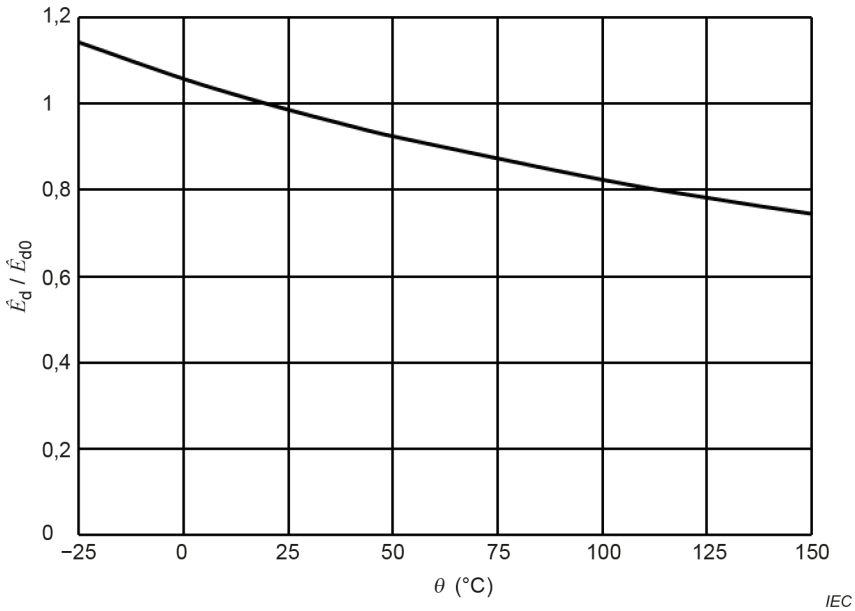

Figure 1 – Temperature dependent variation of the breakdown field strength $\hat{E}_d$ of air per Equation (1), α = 0,8, θ = 20 °C, $p = p_0$ = 1 013 mbar

For 130 °C this results in a dielectric strength of a 1 mm air gap with homogeneous field distribution $\hat{E}_d$ of 3,1 kV/mm (77,5 % of the 20 °C-value). This is the crest value of the field strength and related to the peak value of the applied voltage. The effective value of a corresponding sinusoidal voltage is reduced by the factor 1/√2.

4.1.3 Inhomogeneous electric fields

The PD inception voltage is related to inhomogeneous electrode distribution – like point to plane electrodes – with a degree of homogeneity or utilization factor η lower as the limit of $\eta \approx 0{,}2$ [9]. This value gives the quotient of average field strength to maximum field strength for an electrode arrangement [5], [8]. Stable glow discharges in air can principally appear at field strength values of 2,5 kV/mm (see [9] and IEC 60664-1:2020, Figure A.1[1]). With a low utilization factor of 0,2 the PD inception peak voltage for an inhomogeneous electrode arrangement – like a point or edge electrode against a plane electrode – with an air gap of 1 mm is only about 800 V_{peak} or 566 $V_{RMS.}$ according to the tables in [7].

NOTE 1 Because, in practice, partial discharge testing gives random results below 4 kV/mm, the threshold of 2,5 kV/mm is considered only for initial analysis purposes.

The utilization factor η is dependent on the electrode distance R and the electrode radius r [5], [8]. A reference model in [8] shows the relation between radius r and inception voltage U_i, expressed in RMS, based on real dimensions (see Table 1 and [8]).

Documents
Document Sharing Hub
Full document details: PD IEC TR 63434:2023

Table 1 – Relationship between electrode radius r and corona inception voltage $U_{i,RMS}$

$R \gg r$	r µm	$U_{i,RMS}$ V
	10	450
	50	1 000
	100	1 400
	500	3 500
	1 000	5 500
	5 000	15 000

Key

V – potential

r – electrode radius

R – distance to earth plane

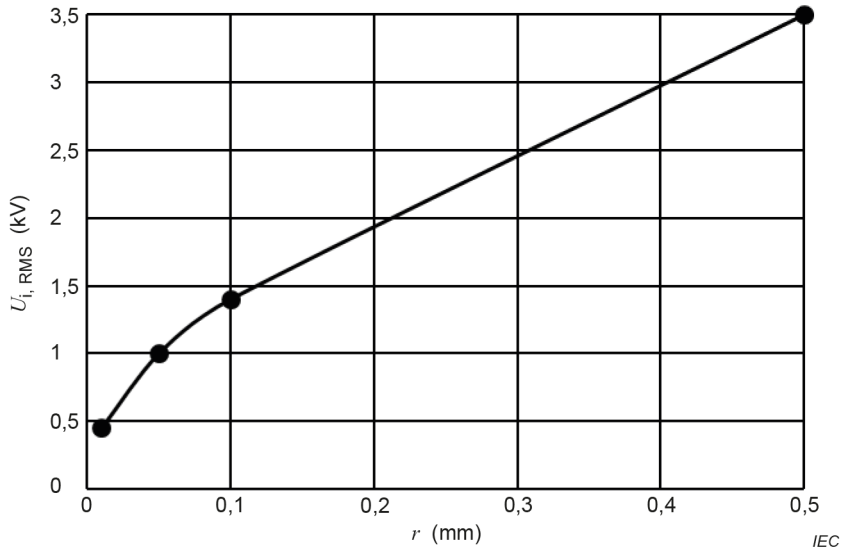

Figure 2 – Inception voltage $U_{i,RMS}$ depending on the electrode radius r, $R \gg r$

The graphical depiction of Table 1 up to a radius of 0,5 mm shows clearly that the inception voltage decreases more rapidly below r = 100 µm corresponding to an inception voltage of only 450 V with a radius of 10 µm.

The evaluation of FEM-simulations on a particular contact arrangement in Figure 3 also shows the progressive rise of the field strength once the edge radius is lower than 0,1 mm [10] and confirm the dependencies in Table 1 and Figure 2.

Documents
Document Sharing Hub
Full document details: PD IEC TR 63434:2023