

Northbrook, Illinois • (708) 272-8800
 Melville, New York • (516) 271-6200
 Santa Clara, California • (408) 985-2400
 Research Triangle Park,
 North Carolina • (919) 549-1400



Subjects 10C (10, 10A, 10B)

1655 Scott Blvd.
 Santa Clara, CA 95050
 February 27, 1996

TO: Fire Council of Underwriters Laboratories Inc.;
 Subscribers to UL's Standards Services for
 Fire Tests of Door Assemblies,
 Tin-Clad Fire Doors;
 Subscribers to UL's Classification Services for Fire Doors;
 Subscribers to UL's Listing Services for
 Bullet-Resisting Type Fire Doors (GSOX),
 Special Purpose Type Fire Doors (GSXZ),
 Swinging Type Fire Doors (GSYX),
 Door Closers, Holders, and Operators (GTBT),
 Door and Window Frames (GVTV),
 Miscellaneous Fire Door Accessories (GVUX),
 Glazing Materials for Doors and Frames (GVUY),
 Fire Door Coordinators (GVVR),
 Fire Door Glass Light Frames (GVVX),
 Gasketing Materials for Fire Doors (GVWZ),
 Fire Door Louvers (GVZS),
 Builders Hardware (GWTZ),
 Fire Door Viewers (HAAU),
 Glazing Materials (KCMZ)

SUBJECT: Request for Comments on the Proposed First Edition of the Standard for Positive Pressure Fire Tests of Door Assemblies, UL 10C; PROPOSED EFFECTIVE DATE

SUMMARY OF TOPICS

This bulletin proposes the first edition of the Standard for Positive Pressure Fire Tests of Door Assemblies, UL 10C.

COMMENTS DUE: APRIL 26, 1996

Attached as Appendix A for your review and comment is the proposed first edition of UL 10C. Questions regarding interpretation of requirements should be directed to the responsible UL Staff. Please see Appendix B of this bulletin regarding designated responsibility for the subject product category.

A not-for-profit organization
 dedicated to public safety and
 committed to quality service

Documents
 Document Sharing Hub

Please note that proposed requirements are of a tentative and early nature and are for review and comment only. Current requirements are to be used to judge a product until these requirements are published in final form.

PROPOSED EFFECTIVE DATE

These proposed requirements will not necessitate a review or additional testing of currently Listed products. Therefore, UL proposes that the new requirements become effective upon publication.

PROPOSED FIRST EDITION OF THE STANDARD FOR POSITIVE PRESSURE FIRE TESTS OF DOOR ASSEMBLIES, UL 10C

RATIONALE

The International Conference of Building Officials (ICBO) has indicated a desire to develop a positive pressure test method for swinging fire doors. Over the last several years the ICBO has reviewed numerous amendments to the test for fire doors. In an attempt to consolidate the proposed changes in a unified document, as well as to create a document that will be useful to other code bodies that are desirous of adopting a positive pressure test method, UL is proposing the development of a new test standard, Positive Pressure Fire Tests of Door Assemblies, UL 10C.

The proposed Standard for Positive Pressure Fire Tests of Door Assemblies, UL 10C, has been developed based on the work completed by the National Fire Protection Research Foundation (NFPRF) in its National Fire Door Fire Test Project. Additional information for the development of the standard was obtained from various international standards such as "Fire tests on building materials and structures", BS 476: Part 20, and additional test information and methodology available to Underwriters Laboratories and the test community.

The following is a list of the major changes and the substantiations for the changes between the existing UL 10B standard and the draft of UL 10C.

For convenience in review, the proposed UL 10C is presented in Appendix A as a revised version of the Standard for Fire Tests of Door Assemblies, UL 10B. Please note, however, that UL 10C – in its final form – is intended to stand alone as a separate document; UL 10B will remain unchanged.

1. UL 10C is proposed to address only swinging doors. It is understood that since the ICBO only indicated a desire for a positive pressure test for swinging fire doors, and the NFPRF project only generated data for swinging doors, the scope of the draft of UL 10C is limited to swinging doors.
2. Based on the NFPRF work, it was shown that the international type of thermocouple (i.e. BS 476) used to measure unexposed surface temperature demonstrates certain advantages. Therefore, this type of thermocouple is specified for use in the UL 10C draft. As there was no evidence to support the use of the international type of thermocouple used to measure furnace temperature over those currently used in UL 10B, the current thermocouples are included in the UL 10C draft.
3. The limitation on "excess smoke" specified in the current Uniform Building Code Standard 7-2 test method was not included since there is no current test protocol available to make a valid measurement of "excess smoke." The UL 10C draft refers to the Recommended Practice for the Installation of Smoke-Control Door Assemblies, NFPA 105, for evaluation of smoke passage around the sample and anticipates that smoke from the sample will be limited by the positive pressure test method.

4. Proposed UL 10C contains a description of the test furnace. The description is consistent with furnaces currently in use in this country with the exception that the burner type is limited to a post mix rather than a premix type. The post mix burner type was chosen as a worst-case condition considering the passage of flames to the unexposed side of the assembly when the opening is compromised and is consistent with the same fire scenario that occurs in a burning room. The change to a post mix burner will not affect current testing laboratory's abilities to test assemblies on their current equipment. The NFPRF project showed that current systems can be converted to post mix with relative ease and still meet the rigorous evaluation of ICBO Evaluation Services.
5. There are no "gap gauges" included in proposed UL 10C since the current methods of measuring gaps, along with observations of flaming, will control the measurement of the excess distortion of the sample.
6. Relative movement of the door away from the frame stop has been retained as the door thickness for the first half of the fire test, and 1-1/2 times the door thickness for the second half of the test, and as a result of the hose stream. There has been a desire to decrease the limit to an overall maximum of door thickness, but there was insufficient data available to justify the need for this reduction.
7. The "cotton pad" test is not included in proposed UL 10C because of both its limited reliability and usefulness and the ability of the furnace to provide visible flaming due to the use of post mix burners to address the escape of hot gases.
8. The location of the neutral pressure plane during the test was established at "a minimum of 1/3 down from the top of the door." This location was selected as being relatively consistent with the location which would naturally occur in many "typical" burning rooms while still exposing the door assembly to positive pressure to evaluate its performance. By establishing the pressure plane at a "minimum" distance, a test sponsor can choose to lower the neutral plane so that a determination of performance to various international standards can be made at the same time as to UL 10C.
9. In order to clarify the application of the hose stream exposure, the pattern for the hose stream test has been further defined.
10. To maintain further consistency with international standards, minimal amounts of flaming (less than 10 seconds, sustained) have been made an exception to the "No Flaming" requirement in proposed UL 10C.

IMPACT

Since the requirements will not necessitate a review or additional testing of currently Listed products, UL proposes that the requirements become effective upon publication.

REQUEST FOR COMMENTS ON PROPOSALS

Please provide the following:

1. Your comments concerning the proposed requirements; and
2. Your comments concerning the proposed effective date, should the proposals be adopted.

Written comments should be sent to the attention of Michael Hieb at UL's Santa Clara office, 1655 Scott Blvd., Santa Clara, CA 95050-4169. Comments may be sent by mail or faxed to (408) 556-6045. Please reference all correspondence to Subject 10A.

Subjects 10C (10, 10A, 10B)

-4-

February 27, 1996

All comments should be sent by April 26, 1996.

Unless specifically requested to do so, UL will not acknowledge comments indicating concurrence with these proposals.

UNDERWRITERS LABORATORIES INC.

Michael J. Hieb

MICHAEL HIEB (Ext. 32404)
Technical Correspondent
Standards Department
SANTA CLARA OFFICE
(408) 985-2400

REVIEWED BY:

Howard Gruszynski

HOWARD GRUSZYNSKI (Ext. 42507)
Engineering Group Leader
Engineering Services 411C
NORTHBROOK OFFICE
(847) 272-8800

SR:RM

0010C __.2RB

PROPOSED REQUIREMENTS ARE OF A TENTATIVE AND EARLY NATURE AND ARE FOR REVIEW AND COMMENT ONLY. CURRENT REQUIREMENTS ARE TO BE USED TO JUDGE A PRODUCT UNTIL THESE REQUIREMENTS ARE PUBLISHED IN FINAL FORM.

APPENDIX A

PROPOSED FIRST EDITION OF THE STANDARD FOR POSITIVE PRESSURE FIRE TESTS OF DOOR ASSEMBLIES, UL 10C

FEBRUARY 1996 DRAFT

For convenience in review, the proposed UL 10C is presented in Appendix A as a revised version of the Standard for Fire Tests of Door Assemblies, UL 10B. Please note, however, that UL 10C – in its final form – is intended to stand alone as a separate document; UL 10B will remain unchanged. Proposed additions to existing requirements are shown underlined and proposed deletions are shown ~~lined-out~~. Proposed new requirements are identified by (NEW). A paragraph that is proposed to be deleted is identified by (DELETED) and is shown ~~lined-out~~.

INTRODUCTION

1 Scope

1.1 These methods of fire tests are applicable to door assemblies of various materials and types of construction for use in wall openings to retard the passage of fire.

1.2 Tests made in conformity with these test methods ~~will~~ are intended to register performance during the test exposure; but such tests shall not be construed as determining suitability for use after exposure to fire.

1.3 It is the intent that tests made in conformity with these test methods ~~will develop~~ allow for the development of data to enable regulatory bodies to determine the suitability of door assemblies for use in locations where fire resistance of a specified duration is required.

1.4 These methods are intended to evaluate the ability of a door assembly to remain in an opening during a predetermined test exposure.

1.5 The tests expose a specimen to a standard fire exposure controlled to achieve specified temperatures throughout a specified time period, followed by the application of a specified standard fire hose stream. The exposure, however, ~~may is~~ is not be representative of all fire conditions, which vary with changes in the amount, nature, and distribution of fire loading, ventilation, compartment size and configuration, and heat sink characteristics of the compartment. It does, however, provide a relative measure of fire performance of door assemblies under these specified fire exposure conditions.

1.6 Any variation from the construction or conditions that are tested ~~may change~~ is capable of substantially changing the performance characteristics of the assembly.

1.7 The methods do not provide the following:

- a) Full information as to performance of all door assemblies in walls constructed of materials other than those tested.
- b) Evaluation of the degree by which the door assembly contributes to the risk of fire by generation of smoke, toxic gases, or other products of combustion.
- c) A temperature limit on the unexposed side of the door assembly.
- d) A limit on the number of openings allowed in glazed areas or of the number and size of lateral openings between the door and frame.
- e) Measurement of the degree of control or limitation of the passage of smoke or products of combustion through the door assembly. Note: See limitations for the passage of smoke detailed in the Recommended Practice for the Installation of Smoke-Control Door Assemblies, NFPA 105.

(NEW)

1.8 A product that contains features, characteristics, components, materials, or systems new or different from those covered by the requirements in this standard, and that involve a risk of fire, electric shock, or injury to persons shall be evaluated using the appropriate additional component and end-product requirements as determined necessary to maintain the acceptable level of safety as originally anticipated by the intent of this standard. A product whose features, characteristics, components,

(1.8 continued)

materials, or systems conflict with specific requirements or provisions of this standard cannot be judged to comply with this standard. Where considered appropriate, revision of requirements shall be proposed and adopted in conformance with the methods employed for development, revision, and implementation of this standard.

2 General

2.1 Units of measurement

2.1.1 If When a value for measurement is followed by a value in other units in parentheses, the second value ~~may be~~ is only approximate. The first stated value is the requirement.

2.2 Undated references

2.2.1 Any undated reference to a code or standard appearing in the requirements of this standard shall be interpreted as referring to the latest edition of that code or standard.

CONTROL OF FIRE TESTS

(NEW SECTION)

3 Furnace Construction

3.1 Furnace size

3.1.1 The furnace shall be able to accommodate the full-sized sample. Small-scale size furnaces are capable of being used for testing small but full-sized samples or representative features. The furnace face shall be greater in area than the exposed face of the sample by at least 20 percent. The additional area between the sample and the furnace shall be filled by wall or partition construction.

3.1.2 The furnace shall have a chamber depth, i.e. the distance between the exposed face of the specimen and the face of the furnace lining immediately opposite the specimen, of not less than 23 inches (584 mm) and not more than 51 inches (1296 mm).

3.2 Furnace construction materials

3.2.1 The furnace shall be constructed of materials which have a greater resistance to heat flow through the other three sides than through the sample.

3.3 Furnace burners

3.3.1 The furnace shall be heated with burners that are fired using either natural gas or liquefied petroleum gases.

3.3.2 The heat output of the burners shall be controllable and shall expose the specimen to a uniform heating as specified in 4.1.1.

3.3.3 The burners shall be constructed so that the fuel gas is introduced into the furnace where the gas mixes with air present in the furnace and then burns.

3.4 Time-Temperature Curve

4.1 General


3.4.1.1 The fire exposure of door assemblies shall be controlled to conform to the applicable portion of the standard time-temperature curve shown in Figure 3.1 Appendix A. The points on the curve that determine its character are:

1000°F (538°C)	at 5 minutes
1300°F (704°C)	at 10 minutes
1462°F (795°C)	at 20 minutes
1550°F (843°C)	at 30 minutes
1638°F (892°C)	at 45 minutes
1700°F (927°C)	at 1 hour
1792°F (978°C)	at 1-1/2 hours
1850°F (1010°C)	at 2 hours
1925°F (1052°C)	at 3 hours
2000°F (1093°C)	at 4 hours

(DELETED)

Figure 3.1

Time-temperature curve

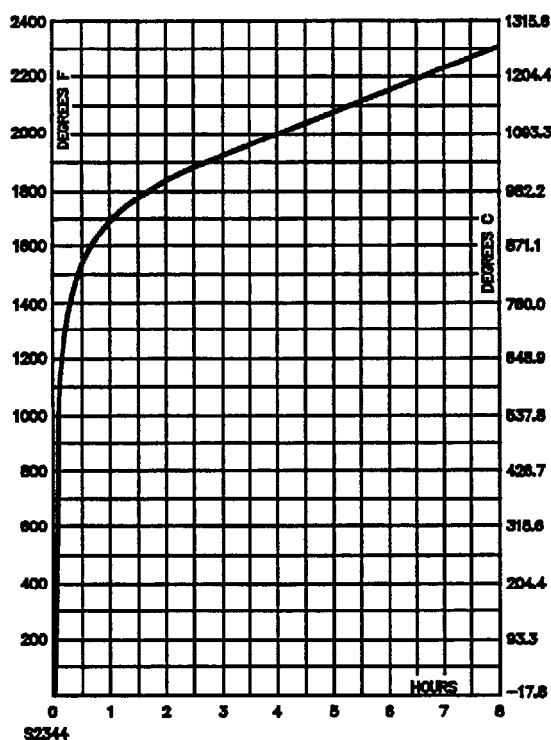


4.2 Uniformity of temperature distribution

4.2.4.2.1 For a closer definition of the time-temperature curve, see Appendix A. At any time after the first 10 minutes of fire exposure, the temperature rise indicated by any of the thermocouples used to determine the furnace temperature shall not differ from each other by more than 270°F (150°C). With test constructions where either the sample or any associated construction incorporates combustion materials that produce flaming within the furnace or where excess air drawn into the furnace is identified as causing localized heating or cooling of one or more of the furnace thermocouple hot junctions, the deviation of temperature rise from each other recorded by the thermocouples so affected shall not exceed 450°F (250°C).

4.5 Furnace Temperatures

4.5.1 The temperatures of the test exposure shall be deemed to be the average temperature obtained from the readings of not less than nine thermocouples symmetrically disposed and distributed to show the temperature near all parts of the test assembly, see Figure 4.5.1. The thermocouples shall be protected by sealed porcelain tube having 3/4 inch (19.1 mm) outside diameter and 1/8 inch (3.2 mm) wall thickness or, as an alternate, in the case of base-metal thermocouples, protected by 1/2 inch (12.7 mm) wrought-steel or wrought-iron pipe of standard weight.

Figure 4.5.1
Test furnace

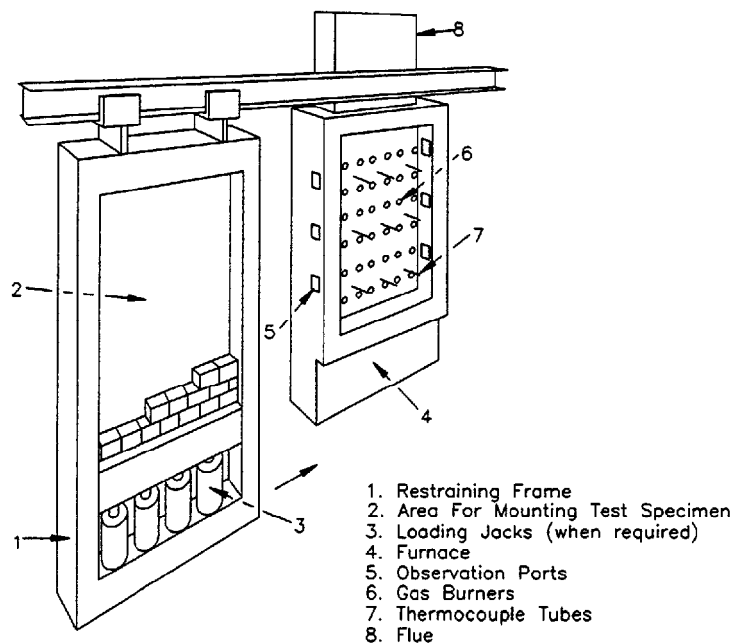

S2320

5.2 The junction of the thermocouples shall be located 6 inches (152 mm) from the exposed face of the test assembly or from the masonry in which the assembly is installed, during the entire test exposure. The location of the junction shall be adjusted at intervals not exceeding 10 minutes during the first 30 minutes. Thereafter, the intervals are to be increased to not more than 30 minutes.

~~4.2 5.3~~ The temperatures shall be read at intervals not exceeding ~~5 minutes during the first 2 hours,~~
~~and thereafter the intervals may be increased to not more than 10 minutes~~ 1 minute.

~~4.3 5.4~~ The accuracy of the furnace control shall be such that the area under the time-temperature curve, obtained by averaging the results from the thermocouple readings, is within 10 percent of the corresponding area under the standard time-temperature curve for fire tests of 1 hour or less duration, within 7.5 percent for those over 1 hour and not more than 2 hours, and within 5 percent for tests exceeding 2 hours in duration.

(NEW)

5.5 For a summary of the accuracies for the various rating periods, see Appendix A.

5.6 Unexposed Surface Temperatures

~~5.1 6.1~~ Unexposed surface temperatures are to be recorded, and are to be determined in the following manner.

Exception: ~~Single-layer metal doors need not comply with this section.~~

~~5.2 6.2~~ Unexposed surface temperatures shall be taken at not less than three points, with at least a minimum of one thermocouple in each 16-square foot (1.5 m²) area of the door. Thermocouples shall not be located over reinforcements extending through the door, over glass panels, or nearer than 12 inches (305 mm) from the edge of the door.

(NEW)

6.3 Surface temperatures of test specimens are to be measured by means of thermocouples with a wire diameter of not more than 0.03 inch (0.7 mm). Each thermocouple is to be attached to the center of the face of a copper disk 1/2 inch (12 mm) in diameter and 0.01 inch (0.2 mm) thick, which is secured to the surface of the specimen at the required position.

~~5.3 6.4~~ Unexposed surface temperatures are to be measured with thermocouples placed under flexible, oven-dry, felted pads. The properties of these pads ~~shall~~ are to comply with the requirements specified in Appendix B.

(NEW)

6.5 The disk and the pad are to be fixed to the surface of the specimen by pins, tape, or a required adhesive, based on the nature of the material forming the specimen.

~~5.4 6.6~~ Unexposed surface temperatures are to be read at intervals not exceeding ~~5 minutes for the first 30 minutes of the test~~ 1 minute.

(NEW)

6.7 The thermocouples and pads are to be removed after 30 minutes of fire exposure.

Exception: The thermocouples and pads are to remain on the assembly when unexposed surface temperature data beyond the first 30 minutes of fire exposure is being evaluated.

(NEW SECTION)

7 Furnace Pressure

7.1 The pressure in the furnace, relative to atmosphere, is to be measured at the top of the assembly and at a location between one-third down and two-thirds down from the top of the assembly, and at the bottom of the assembly.

7.2 The pressure probe is to be constructed from 1/2 inch (12.7 mm) diameter stainless steel tube. The probe is to be located so that the center line of the sensing holes are positioned 6 ± 1 inches (152 ± 2.5 mm) from the surface of the exposed face of the test assembly and 18 inches (457 mm) from the edges of the furnace. The probes are to be positioned horizontally in the furnace without a change in vertical elevation of the probes or tubing within the furnace.

7.3 Data recording is to provide monitoring of the output of an electric pressure transducer in the range of ± 0.0025 w.c. with an accuracy of ± 1 percent. The pressure transducers are to be located within 3 feet (914 mm) vertically, and 10 feet (3048 mm) horizontally from the static probes outside the furnace.

7.4 Pressures are to be read at intervals not exceeding 1 minute.

7.5 The pressure is to be maintained in the furnace while also maintaining a minimum of 4 percent oxygen in the furnace.

7.6 The oxygen percentage is to be determined by centering a minimum of one 1/4-inch (6.4-mm) inside diameter stainless steel tube containing eight 1/16 inch (1.6 mm) diameter holes in the damper plenum, approximately half way between the furnace and the exhaust damper. The tube is then to be connected to an oxygen analyzer which has an accuracy of ± 0.1 percent in the range of 0 to 10 percent. Locating more than one probe in the plenum and averaging the readings is permitted.

7.7 The oxygen percentages are to be read at intervals not exceeding 1 minute.

TEST ASSEMBLIES

6.8 Construction and Size

6.8.1 The construction and size of the test door assembly, consisting of single doors, doors in pairs, ~~special purpose or specialty~~ doors (such as Dutch doors, double-egress doors, and the like), or ~~multi-section doors~~, shall be representative of that for which the classification or rating is ~~desired~~ being evaluated.

6.8.2 A floor structure shall be provided as part of the opening to be protected, except where such floor interferes with the operation of the door. The floor segment shall be of noncombustible material and shall project into the furnace approximately twice the thickness of the test door or to the limit of the frame, whichever is greater.

7.9 Mounting for Test Purposes

7.9.1 Swinging doors shall be mounted so as to open into the furnace chamber.

(DELETED)

~~7.2 Sliding and rolling doors, except horizontal slide type elevator doors, shall be mounted on the exposed side of the opening in the wall closing the furnace chamber.~~

(DELETED)

~~7.3 Horizontal slide type elevator doors shall be mounted on the unexposed side of the opening in the wall closing the furnace chamber.~~

(DELETED)

~~7.4 Access type doors and chute type doors and frame assemblies shall be mounted so as to have one assembly open into the furnace chamber and another assembly open away from the furnace chamber.~~

(DELETED)

~~7.5 Dumbwaiter and service counter doors and frame assemblies shall be mounted on the exposed side of the opening in the wall.~~

~~7.6 9.2 The mounting of all doors shall be such that they fit within the frame, against the wall surfaces, or in guides, but such Such mounting shall not prevent free and easy operation of the test door.~~

(CURRENT)

~~7.7 Clearances for swinging doors shall be as follows: with a minus 1/16 inch (1.6 mm) tolerance—1/8 inch (3.2 mm) along the top, 1/8 inch (3.2 mm) along the hinge and latch jambs, 1/8 inch (3.2 mm) along the meeting edge of doors in pairs, and 3/8 inch (9.5 mm) at the bottom edge of a single swing door, and 1/4 inch (6.4 mm) at the bottom of a pair of doors.~~

(PROPOSED)

9.3 Clearances for swinging doors shall be as follows:

- a) One-eighth (+0, minus 1/16) inch (3.1 ± 1 mm) along the top;
- b) One-eighth (+0, minus 1/16) inch (3.1 ± 1 mm) along the hinge and latch jambs;
- c) One-eighth (+0, minus 1/16) inch (3.1 ± 1 mm) along the meeting edge of doors in pairs;
- d) Three-eighths (+0, minus 1/16) inch (9.5 +0, minus 1.6 mm) at the bottom edge of a single swing door; and
- e) One-fourth (+0, minus 1/16) inch (6.4 +0, minus 1.6 mm) at the bottom of a pair of doors.

(DELETED)

~~7.8 Clearances for horizontal sliding doors not mounted within guides shall be as follows: with a minus 1/8 inch (3.2 mm) tolerance—1/2 inch (12.7 mm) between door and wall surfaces, 3/8 inch (9.5 mm) between door and floor structure, and 1/4 inch (6.4 mm) between the meeting edges of center-parting doors. A maximum lap of 4 inches (102 mm) of the door over the wall opening at sides and top shall be provided.~~

(DELETED)

~~7.9 Clearances for vertical sliding doors moving within guides shall be as follows: with a minus 1/8 inch (3.2 mm) tolerance—1/2 inch (12.7 mm) between door and wall surfaces along top and/or bottom door edges with guides mounted directly to the wall surface and 3/16 inch (4.8 mm) between meeting edges of bi-parting doors or 3/16 inch (4.8 mm) between door and floor structure or sill.~~

(DELETED)

~~7.10 Clearances for horizontal slide type elevator doors shall be as follows: with a minus 1/8 inch (3.2 mm) tolerance—3/8 inch (9.5 mm) between the door and wall surfaces, 3/8 inch (9.5 mm) between multi-section door panels, and 3/8 inch (9.5 mm) from the bottom of a panel to the sill. Multi-section door panels shall overlap 3/4 inch (19.1 mm). Door panels shall lap the wall opening 3/4 inch (19.1 mm) at sides and top.~~

~~7.11 9.4 Door frames shall be evaluated when mounted so as to have the doors open either away from or into the furnace chamber, at the discretion of the testing authority, to obtain representative information on the performance of the construction under test.~~

~~7.12~~ 9.5 Surface-mounted hardware (for example, fire-exit devices) for use on fire doors shall be evaluated by being installed on one door assembly swinging into the furnace chamber and another door assembly swinging away from the furnace chamber.

(DELETED)

~~7.13~~ Door frame wall anchors, when used, shall be acceptable for the wall or partition construction.

CONDUCT OF TESTS

§ 10 Time of Testing

~~8.1~~ 10.1 Masonry shall have sufficient the strength to retain the assembly securely in position throughout the Fire Endurance Test, Section 11, and the Hose Stream Test, Section 12.

§ 11 Fire Endurance Test

~~9.1~~ 11.1 The pressure in the furnace chamber is to be maintained as nearly equal to the atmospheric pressure. ~~as possible.~~

(NEW)

11.2 Within 5 minutes of elapsed time into the fire exposure, the neutral plane of the furnace is to be established at a minimum of one-third down from the top of the test sample.

(NEW)

11.3 The pressure that is maintained over the top one-third of the door is not to exceed 0.08 inch H₂O (20 Pa) over any portion of the test sample.

~~9.2~~ 11.4 The test is to be continued until the exposure period of the ~~desired~~ classification or rating being evaluated is reached. ~~unless the conditions of acceptance set forth in Sections 12 and 13 are exceeded in a shorter period.~~

~~10~~ 12 Hose Stream Test

~~10.1~~ 12.1 Immediately following the Fire Endurance Test, Section 11, ~~subject~~ the test assembly is to be subjected to the impact, erosion, and cooling effects of a hose stream directed first at the middle and then at all parts of the exposed surface, making changes in direction slowly. See Appendix C for a description of the pattern.

~~10.2~~ 12.2 ~~Deliver~~ The hose stream is to be delivered through a 2-1/2 inch (63.5 mm) hose discharging through a National Standard Playpipe of corresponding size equipped with a 1-1/8 inch (28.6 mm) discharge tip of the standard-taper smooth-bore pattern without shoulder at the orifice. The water pressure at the base of the nozzle and duration of application in seconds per square foot (s/m²) of exposed area are to be as prescribed in Table ~~10.1~~ 12.1.

Table 40.1 12.1
Water pressure at base of nozzle and duration of application^a

Desired rating	Water pressure at base of nozzle, psi (kPa)	Duration of application, seconds per square foot (s/m ²) of exposed area
3-hour or 4-hour	45 (310)	3.0 (32)
1-1/2-hour and over if less than 3-hour	30 (207)	1.5 (16)
1 -hour and over if less than 1 -1/2 -hour	30 (207)	0.9 (10)
Less than 1 hour	30 (207)	0.6 (6)

^a NOTE — The exposed area ~~may~~ shall be calculated using the outside dimensions of the test specimen, including a frame, hangers, tracks, or other parts of the assembly ~~if~~ when provided, but normally not including the wall into which the specimen is mounted. Where multiple test specimens are mounted in the same wall, the hose stream is to be calculated and applied to each sample individually, or the rectangular or square wall area encompassing all of the specimens will have is to be considered as the exposed area since the hose stream must traverse this area during its application.

40.3 12.3 The tip of the nozzle shall be located 20 feet (6 m) from and on a line normal to the center of the test door. ~~If~~ When impossible to be so located, the nozzle ~~may~~ shall be on a line deviating not more than 30 degrees from the line normal to the center of the test door. When so located, the distance from the center shall be less than 20 feet (6 m) by an amount equal to 1 foot (0.3 m) for each 10 degrees of deviation from the normal.

REPORT

44 13 General

44.4 13.1 Results shall be reported in accordance with the performance in the tests prescribed in these test methods. The report shall show the performance under the desired exposure period chosen from the following: 20-minute, 30-minute, 3/4-hour, 1-hour, 1-1/2-hour, 3-hour, or 4-hour.

13.2 The report shall include the temperature measurements of the furnace, including the tolerance to the time-temperature curve, and, ~~if determined~~, of the unexposed side of the test assembly. See 5-1 6.1.

13.3 ~~If~~ The report shall also contain a record of all observations having a bearing on the performance of the test assembly.

44.2 13.4 ~~Flaming, if any,~~ Any flaming on the unexposed surface of the ~~door leaf assembly~~ shall be recorded.

44.3 13.5 The amount of movement of any portion of the edges of the door adjacent to the door frame from the original position shall be recorded. See Conditions of Acceptance, General, Section 4-2 14, and Specific, Section 43 15.

44.4 13.6 The materials and construction of the door, frame, and wall or partition, and the details of the installation, hardware, door frame and wall anchors, ~~hangers, guides, trim, finish, and clearance or lap~~ shall be recorded or appropriately referenced to provide positive identification or duplication in all respects.

44.6 13.7 Pressure measurements made in the furnace and the location of such measurements relative to the ~~elevation of the top of the plane one-third down from the top of the door and the plane at the top of the door~~ shall are to be recorded.

CONDITIONS OF ACCEPTANCE

~~12.14~~ 14 General

~~12.1~~ 14.1 A door assembly shall be considered as meeting determined to comply with the requirements for acceptable performance when it remains in the opening during the Fire Endurance Test, Section 11, and the Hose-Stream Test, Section 12, within the following limitations.

(DELETED)

~~12.2~~ The lap edges of horizontal slide type, passenger elevator doors, as defined in the Safety Code for Elevators and Escalators, ANSI A17.1-1990, including the lap edges of multi-section doors, shall not move from the wall or adjacent panel surfaces sufficiently to develop a separation of more than 2 7/8 inches (73.0 mm) during the entire classification period, or immediately following the hose stream test. The meeting edges of center parting elevator door assemblies, for a fire and hose stream exposure of 1 1/2 hours or less, shall not move apart more than 1 1/4 inches (31.8 mm) as measured in any horizontal plane during the entire classification period or immediately following the hose stream test.

(DELETED)

~~12.3~~ Doors mounted in guides shall not release from guides and guides shall not loosen from fastenings.

~~12.4~~ 14.2 The test assembly shall withstand the Fire Endurance Test, Section 11, and the Hose-Stream Test, Section 12, without developing openings anywhere through the assembly.

Exception No. 1: For assemblies with a fire exposure period of 1-1/2 hours or less, dislodging of small portions of glass by the hose stream is acceptable permitted.

Exception No. 2: Separation between meeting edges of pairs of doors within the limits specified in ~~12.2, 13.2.3, 13.2.4, 13.3.5, and 13.3.6~~ 15.5 and 15.6 is acceptable permitted.

Exception No. 3: An opening between the bottom edge of a door and sill within the limits specified in ~~7.7, 7.10, 13.3.3, and 13.3.7~~ 9.3 is acceptable permitted.

~~12.5~~ 14.3 For An opening for the purpose of the requirement of ~~12.4~~ in 14.2, an opening is defined as a through-hole in the assembly that can be is capable of being seen from the unexposed side when viewed from the direction perpendicular to the plane of the assembly at the location of the suspected opening.

~~13.15~~ 15 Specific

~~13.1~~ All doors

~~13.1.1~~ 15.1 No flaming shall occur on the unexposed surface of a door assembly. ~~during the first 30 minutes of the classification period.~~

Exception No. 1: Sustained flaming of less than 10 seconds duration is permitted.

~~13.1.2~~ *Exception No. 2: After 30 minutes, some intermittent light flames [approximately not greater than 6 inches (152 mm) long], or burning for periods not exceeding 5-minute intervals, may occur along the edges of doors is permitted.*