

UL 1640

ISBN 0-7629-0497-6

Portable Power-Distribution Equipment

Underwriters Laboratories Inc. (UL)
333 Pfingsten Road
Northbrook, IL 60062-2096

UL Standard for Safety for Portable Power-Distribution Equipment, UL 1640

Second Edition, Dated July 6, 2000

Revisions: This Standard contains revisions through and including August 16, 2004.

Summary of Topics

This revision of UL 1640 is being issued to update references to the 2002 National Electrical Code (NEC) Articles and their titles in paragraph 1.2 and select paragraphs in Part 4; to revise ampacity limitation levels for portable power-distribution equipment rated above 1200 amperes in paragraph 1.4 and Tables 5.1 and 10.1; and revise requirements for inlet and receptacle covers in paragraph 7.6.1 and new Section 24A, in accordance with the proposals in UL's Subject 1640 bulletin dated March 29, 2004.

UL Standards for Safety are developed and maintained in the Standard Generalized Markup Language (SGML). SGML -- an international standard (ISO 8879-1986) -- is a descriptive markup language that describes a document's structure and purpose, rather than its physical appearance on a page. Due to formatting differences resulting from the use of UL's new electronic publishing system, please note that additional pages (on which no requirements have been changed) may be included in revision pages due to relocation of existing text and reformatting of the Standard.

Text that has been changed in any manner is marked with a vertical line in the margin. Changes in requirements are marked with a vertical line in the margin and are followed by an effective date note indicating the date of publication or the date on which the changed requirement becomes effective.

The following table lists the future effective dates with the corresponding item.

Future Effective Date	References
October 1, 2005	Paragraphs 1.2, 7.6.1, 33A.1, 51.1, 53.1, 59.1, 61.1, 63.1, 63.6; and Section 24A
September 1, 2006	Paragraphs 1.2, 7.6.1, 51.1, 59.1, 61.1, 63.1, 63.6; and Section 24A

The new and/or revised requirements are substantially in accordance with UL's Bulletin(s) on this subject dated March 29, 2004. The bulletin(s) is now obsolete and may be discarded.

The revisions dated August 16, 2004 include a reprinted title page (page1) for this Standard.

The UL Foreword is no longer located within the UL Standard. For information concerning the use and application of the requirements contained in this Standard, the current version of the UL Foreword is located on ULStandardsInfoNet at: <http://ulstandardsinfo.net/ulforeword.html>

The master for this Standard at UL's Northbrook Office is the official document insofar as it relates to a UL service and the compliance of a product with respect to the requirements for that product and service, or if there are questions regarding the accuracy of this Standard.

UL's Standards for Safety are copyrighted by UL. Neither a printed copy of a Standard, nor the distribution diskette for a Standard-on-Diskette and the file for the Standard on the distribution diskette should be altered in any way. All of UL's Standards and all copyrights, ownerships, and rights regarding those Standards shall remain the sole and exclusive property of UL.

All rights reserved. No part of this publication may be reproduced, stored in a retrieval system, or transmitted in any form by any means, electronic, mechanical photocopying, recording, or otherwise without prior permission of UL.

Revisions of UL Standards for Safety are issued from time to time. A UL Standard for Safety is current only if it incorporates the most recently adopted revisions.

UL provides this Standard "as is" without warranty of any kind, either expressed or implied, including but not limited to, the implied warranties of merchantability or fitness for any purpose.

In no event will UL be liable for any special, incidental, consequential, indirect or similar damages, including loss of profits, lost savings, loss of data, or any other damages arising out of the use of or the inability to use this Standard, even if UL or an authorized UL representative has been advised of the possibility of such damage. In no event shall UL's liability for any damage ever exceed the price paid for this Standard, regardless of the form of the claim.

UL will attempt to answer support requests concerning electronic versions of its Standards. However, this support service is offered on a reasonable efforts basis only, and UL may not be able to resolve every support request. UL supports the electronic versions of its Standards only if they are used under the conditions and operating systems for which it is intended. UL's support policies may change from time-to-time without notification.

UL reserves the right to change the format, presentation, file types and formats, delivery methods and formats, and the like of both its printed and electronic Standards without prior notice.

Purchasers of the electronic versions of UL's Standards for Safety agree to defend, indemnify, and hold UL harmless from and against any loss, expense, liability, damage, claim, or judgement (including reasonable attorney's fees) resulting from any error or deviation introduced while purchaser is storing an electronic Standard on the purchaser's computer system.

If a single-user version electronic Standard was purchased, one copy of this Standard may be stored on the hard disk of a single personal computer, or on a single LAN file-server or the permanent storage device of a multiple-user computer in such a manner that this Standard may only be accessed by one user at a time and for which there is no possibility of multiple concurrent access.

If a multiple-user version electronic Standard was purchased, one copy of the Standard may be stored on a single LAN file-server, or on the permanent storage device of a multiple-user computer, or on an Intranet server. The number of concurrent users shall not exceed the number of users authorized.

Electronic Standards are intended for on-line use, such as for viewing the requirements of a Standard, conducting a word search, and the like. Only one copy of the Standard may be printed from each single-user version of an electronic Standard. Only one copy of the Standard may be printed for each authorized user of a multiple-user version of an electronic Standard. Because of differences in the computer/software/printer setup used by UL and those of electronic Standards purchasers, the printed copy obtained by a purchaser may not look exactly like the on-line screen view or the printed Standard.

An employee of an organization purchasing a UL Standard can make a copy of the page or pages being viewed for their own fair and/or practical internal use.

The requirements in this Standard are now in effect, except for those paragraphs, sections, tables, figures, and/or other elements of the Standard having future effective dates as indicated in the note following the affected item. The prior text for requirements that have been revised and that have a future effective date are located after the Standard, and are preceded by a "SUPERSEDED REQUIREMENTS" notice.

New product submittals made prior to a specified future effective date will be judged under all of the requirements in this Standard including those requirements with a specified future effective date, unless the applicant specifically requests that the product be judged under the current requirements. However, if the applicant elects this option, it should be noted that compliance with all the requirements in this Standard will be required as a condition of continued Listing, Recognition, and Follow-Up Services after the effective date, and understanding of this should be signified in writing.

Copyright © 2004 Underwriters Laboratories Inc.

This Standard consists of pages dated as shown in the following checklist:

Page	Date
1-5	August 16, 2004
6	September 19, 2003
7	July 6, 2000
8-9	August 16, 2004
10-12	July 6, 2000
13-14B	August 16, 2004
15-29	July 6, 2000
30	September 19, 2003
31-32	July 6, 2000
33-34B	August 16, 2004
35-40	July 6, 2000
41	August 16, 2004
42-43	July 6, 2000
44	September 19, 2003
45	July 6, 2000
46-46B	September 19, 2003
47-48	July 6, 2000
49-50B	September 19, 2003
51-63	July 6, 2000
64-64B	August 16, 2004
65-68	July 6, 2000
69-70B	September 19, 2003
71-72	July 6, 2000
73-74B	September 19, 2003
75-76	August 16, 2004
76A-76B	September 19, 2003
77	July 6, 2000
78-80	August 16, 2004
SA1-SA3	July 6, 2000
SA4-SA4B	September 19, 2003
SA5-SA8	July 6, 2000
A1-A2	July 6, 2000
SR1-SR2	August 16, 2004

No Text on This Page

JULY 6, 2000

(Title Page Reprinted: August 16, 2004)

1

UL 1640

Standard for Portable Power-Distribution Equipment

The first edition was titled Portable Power Distribution Units.

First Edition – October, 1995

Second Edition

July 6, 2000

An effective date included as a note immediately following certain requirements is one established by Underwriters Laboratories Inc.

Revisions of this Standard will be made by issuing revised or additional pages bearing their date of issue. A UL Standard is current only if it incorporates the most recently adopted revisions, all of which are itemized on the transmittal notice that accompanies the latest set of revised requirements.

ISBN 0-7629-0497-6

COPYRIGHT © 1995, 2004 UNDERWRITERS LABORATORIES INC.

No Text on This Page

CONTENTS

INTRODUCTION

1 Scope	9
2 General	9
2.1 Components	9
2.2 Units of measurement	10
2.3 Undated references	10
3 Glossary	10

PART 1 – ALL EQUIPMENT

CONSTRUCTION

4 General	12
5 Current-Carrying Parts	12
5.1 General	12
5.2 Bus bars	12
5.3 Support and securement of live parts	17
5.4 Internal wiring	17
6 Electrical Insulation Material	21
7 Enclosure	24
7.1 General	24
7.2 Specific enclosures	24
7.3 Cast metal	24
7.4 Sheet metal	24
7.5 Doors and covers	28
7.6 Inlet and receptacle covers	33
7.7 Polymeric	33
7.8 Enclosure of switches, circuit breakers, or fuses	34
7.9 Accessibility of live parts	34
8 Enclosure Performance	38
9 Corrosion Protection	39
10 Grounding and Bonding	41
10.1 General	41
10.2 Output receptacle grounding	42
11 Input Connections	43
11.1 General	43
11.2 Cord-connected equipment	43
11.3 Multi-conductor inlet input	46
11.4 Single-conductor inlets and plugs	46
11.5 Interlocked inlet assemblies	46A
11.6 Sequentially-interlocked inlet assemblies	47
11.7 Bus bars	47
12 Output Connections	47
12.1 General	47
12.2 Receptacles	47
13 Overcurrent Protection	48
13.1 General	48
13.2 Circuit breakers	48

13.3 Fuses	50
13.4 Fuseholders	50
14 Spacings	50
15 Switches	54
16 Transformers	55

PERFORMANCE

17 General	56
18 Temperature Test	56
19 Clamped-Joint Temperature Test	59
20 Dielectric Voltage-Withstand Test	59
20.1 General	59
20.2 Clamped insulating joint	60
20.3 Insulating barriers	60
21 Strain-Relief Test	60
22 Resistance to Rain Test	60
23 Icing Test	64
24 Gasket Tests	64
24A Spring-Closing Cycling Test	64A
25 Metallic Coating Thickness Test	65

RATINGS

26 Details	66
------------------	----

MARKINGS

27 General	67
28 Public Access	68
29 Conductors in Parallel	68
30 Enclosure Type	68
31 Neutral Connection	69
32 Qualified Personnel	69
33 Receptacle Ratings	69
33A Multi-Pole Receptacle Configuration	70
34 Single-Pole Inlets or Output Receptacles	70
35 Supply Cord Without Attachment Plug	70
36 Switches or Circuit Breakers	70

PART 2 – BUS BAR CLAMPS

CONSTRUCTION

37 General	71
------------------	----

PERFORMANCE

38 General	72
------------------	----

MARKINGS

39 Details	72
------------------	----

PART 3 – CABLE-SPLICING BLOCKS**CONSTRUCTION**

40 General	73
------------------	----

PERFORMANCE

41 General	74
42 Temperature Test	74
43 Loose Connection Test	74
44 Drop Test	74
45 Pullout Test	74
46 Crushing Test	74A
47 Insulation Resistance and Dielectric Voltage-Withstand Test	74A
48 Impact Test	75

RATINGS

49 Details	75
------------------	----

MARKINGS

50 Details	75
------------------	----

PART 4 – CONSTRUCTION-SITE EQUIPMENT FOR TEMPORARY INSTALLATIONS IN ACCORDANCE WITH ARTICLE 590 OF THE NEC**CONSTRUCTION**

51 General	75
52 Mounting Legs	76
53 Ground-Fault Protection for Personnel	76
54 Receptacles	76A
55 Supply Connection	77
56 Overcurrent Protection	77
57 Enclosures	77
58 Spacings	77

PERFORMANCE

59 General	78
60 Loading Tests	78
61 Resistance to Rain Test	79
62 Door Endurance Test	79

MARKINGS

63 Details	79
------------------	----

SUPPLEMENT SA - FOLLOW-UP INSPECTION INSTRUCTIONS**General**

SA1 Scope	SA1
SA2 Glossary	SA1

RESPONSIBILITY OF THE MANUFACTURER

SA3 General	SA2
-------------------	-----

RESPONSIBILITY OF THE FIELD REPRESENTATIVE

SA4 General	SA3
SA5 General	SA3
SA6 Enclosures	SA4A
SA6.1 Sheet metal thickness	SA4A
SA6.2 Corrosion protection	SA5
SA6.3 Types	SA5
SA6.4 Current-carrying parts (bus bars)	SA5
SA6.5 Grounding	SA5
SA7 Overcurrent Protection	SA6
SA8 Details	SA6
SA9 General	SA7
SA10 Standard Listing Mark	SA8
SA11 Bus Bar Clamps	SA8
SA12 Construction-Site Equipment	SA8
SA13 Open-Framed Cable-Splicing Blocks	SA8

APPENDIX A

Standards for Components.....	A1
-------------------------------	----

No Text on This Page

This page intentionally left blank.

INTRODUCTION

1 Scope

1.1 These requirements cover portable power-distribution equipment intended to distribute power in accordance with the National Electrical Code, NFPA 70 (NEC).

1.2 These requirements cover portable power-distribution equipment intended for use in the following locations:

- a) Carnivals, circuses, fairs, and similar locations in accordance with Article 525 of the NEC;
- b) Exhibition halls in accordance with Article 518 of the NEC;
- c) Motion picture and television studios and similar locations in accordance with Article 530 of the NEC;
- d) Theaters, audience areas of motion-picture and television studios, and similar locations in accordance with Article 520 of the NEC; and
- e) Temporary installations at construction sites in accordance with Article 590 of the NEC.

Revised 1.2 effective September 1, 2006

1.3 These requirements do not cover portable power-distribution equipment intended to be mounted above or adjacent to the lighting unit it supplies.

1.4 These requirements cover power-distribution equipment rated 600 volts or less and 1600 amperes maximum. They may be intended for either single- or multi-phase supply.

1.4 revised August 16, 2004

1.5 Deleted August 16, 2004

2 General

2.1 Components

2.1.1 Except as indicated in 2.1.2, a component of a product covered by this standard shall comply with the requirements for that component. See Appendix A for a list of standards covering components used in the products covered by this standard.

2.1.2 A component is not required to comply with a specific requirement that:

- a) Involves a feature or characteristic not required in the application of the component in the product covered by this standard, or
- b) Is superseded by a requirement in this standard.

2.1.3 A component shall be used in accordance with its rating established for the intended conditions of use.

2.1.4 Specific components are incomplete in construction features or restricted in performance capabilities. Such components are intended for use only under limited conditions, such as certain temperatures not exceeding specified limits, and shall be used only under those specific conditions.

2.2 Units of measurement

2.2.1 Values stated without parentheses are the requirement. Values in parentheses are explanatory or approximate information.

2.2.2 All applicable alternating-current electrical measurements are in root-mean-square (rms) units unless otherwise stated.

2.3 Undated references

2.3.1 Any undated reference to a code or standard appearing in the requirements of this standard shall be interpreted as referring to the latest edition of that code or standard.

3 Glossary

3.1 For the purposes of this standard the following definitions apply.

3.2 BUS BAR CLAMP (SISTER LUG) – A connector that terminates a single conductor cable and that is secured to a bus bar with an integral set screw. May secure the conductor by soldering, integral pressure wire connector, or by crimping of the clamp body.

3.3 CABLE CONNECTOR – A portable receptacle that is intended to provide power, with means for attachment of flexible cord or cable and not intended for permanent mounting.

3.4 CABLE-SPLICING BLOCK – Power-distribution equipment intended to provide a termination for cable assemblies. Not provided with overcurrent protection; only provide a means to extend runs of single- or multi-conductor cable.

3.5 COVER – An unhinged, removable covering member that is a required part of the enclosure.

3.6 DAMP LOCATION – Protected locations outdoors and interior locations subject to moderate degrees of moisture. This would also include areas near where artificial rain is being produced, or when effect machines that utilize water vapor to generate fog or mist effects are being used. Areas not subject to direct water spray or rain.

3.7 DEAD-FRONT – A panel that may or may not form a part of the enclosure and that may be used behind a door, which may have openings for the passage of cords, to cover wiring and uninsulated live parts.

3.8 DOOR – A hinged, sliding, or similarly attached covering member that is capable of being removed only by the use of a tool and that is a required part of the enclosure.

3.9 ENCLOSURE – That part of power-distribution equipment that:

- a) Renders inaccessible all or any parts of the equipment that may otherwise present a risk of electric shock and/or

b) Retards propagation of flame initiated by an electrical fault occurring within the equipment.

3.10 FORMED HINGE – A strip of metal secured to or integral with the enclosure or trim and formed so that it will cooperate with a slot in a door to form a hinge.

3.11 INLET ASSEMBLY, INTERLOCKED – An assembly of locking-type, single-pole pin-and-sleeve inlets. The assembly is interlocked as specified under 3.18.

3.12 INLET ASSEMBLY, SEQUENTIALLY INTERLOCKED – An assembly of locking-type, single-pole pin-and-sleeve inlets. The assembly is sequentially interlocked as specified under 3.19.

3.13 INTERLOCKED INLET – An inlet having a device, either mechanical or electrical, that is intended to reduce the risk of energizing the contacts before complete engagement with a plug, and that either is intended to reduce risk of the plug being withdrawn while its contacts are energized or de-energizes the line contacts before separation.

3.14 PIN-AND-SLEEVE DEVICE – A plug or receptacle utilizing contacts which generally are cylindrical or circular in shape and telescoping and are shrouded by an extension of the enclosure of the mating devices.

3.15 PLUG (ATTACHMENT PLUG) – A device intended to receive power when inserted in a receptacle or cable connector, which establishes connection between conductors of the attached flexible cord or cable and the conductors connected to the receptacle or cable connector.

3.16 POWER INLET (INLET) – A permanently mounted plug intended to receive power from a cable connector.

3.17 RECEPTACLE (OUTLET) – A device that is intended to provide power to an inserted plug, and that is installed as a fixed outlet on equipment.

3.18 RECEPTACLE ASSEMBLY, INTERLOCKED – An assembly consisting of a number of locking-type, single-pole pin-and-sleeve-type receptacles. Supply receptacles are interlocked to the source so it is not possible to connect or disconnect the plugs when the source of supply is energized.

3.19 RECEPTACLE ASSEMBLY, SEQUENTIALLY INTERLOCKED – An assembly consisting of a number of locking-type, single-pole receptacles that are electrically or mechanically interlocked in such a manner that plugs must be connected in the following sequence and disconnected in the reverse order:

- a) Equipment-grounding conductor connection, if provided;
- b) Grounded circuit conductor connection, if provided; and
- c) Ungrounded conductor connection.

3.20 SHIELDING – A hinged or fixed member that is attached to the enclosure but is not a required part of the enclosure, such as a rain shield.

3.21 TERMINAL, PRESSURE-WIRE – A terminal in which the conductor is clamped under a pressure plate or saddle by one or more screws or nuts.

3.22 TERMINAL, SET SCREW – A terminal that provides clamping by the end of the screw bearing directly on the conductor.

3.23 TERMINAL, WIRE-BINDING SCREW – A terminal having the conductor bent around the screw and clamped directly under the head of the screw when it is tightened. The conductor is intended to encircle the terminal screw at least three-fourths the circumference without overlapping.

PART 1 – ALL EQUIPMENT

CONSTRUCTION

4 General

4.1 Portable power-distribution equipment shall be constructed and assembled so that it has the strength and rigidity necessary to resist the abuses to which it is likely to be subjected, without total or partial collapse resulting in a risk of fire, electric shock, or injury to persons due to the reduction of spacings, loosening or displacement of parts, or other serious defects.

4.2 Portable power-distribution equipment shall be constructed so as to reduce the risk of intentional contact with enclosed electrical devices and to provide internal devices with protection from specified external conditions.

4.3 Portable power-distribution equipment shall be complete when it is shipped from the factory and shall not have provisions for the mounting of additional equipment. Internal wiring and connections between components shall be completed at the factory.

5 Current-Carrying Parts

5.1 General

5.1.1 Current-carrying parts shall be of silver, copper, or alloys of these metals or others determined to be the equivalent. Current-carrying parts of other materials that are used in the construction of components shall comply with the appropriate requirements for that component as specified in Appendix A.

5.1.2 Iron or steel shall not be used for a part that is depended upon to carry current.

5.2 Bus bars

5.2.1 General

5.2.1.1 The bending of a bus bar shall not result in visible cracks, but roughening or slight surface checking is not prohibited.

5.2.2 Ampacity

5.2.2.1 Other than as covered in 5.2.2.4 and 5.2.2.5, the ampacity or size of a bus bar is considered sufficient if the current density is not more than as specified in Table 5.1 or the size is not less than as specified in Table 5.2.

Exception: Bus bars operated at ampacities greater than as specified in Table 5.1 shall be tested in accordance with and comply with the Temperature Test, Section 18.

Table 5.1
Ampacity of single or multiple bus bars and clamped joints

Table 5.1 revised August 16, 2004

Bus bar material ^a	Current, amperes	Current density in amperes per square inch (6.45 square cm)	
		Bus bar cross section ^b	Contact area at clamped joints
Copper	0 – 600	1000 ^d	200
Copper	601 – 1600	1000 ^{d,e}	200 ^c
Brass	0 – 600	500	200

^a Multiple bus bars in parallel shall be of the same material and cross section.

^b See 5.2.2.1 – 5.2.2.4 regarding the ampacity.

^c Joints bolted and plated with silver, tin, nickel, or cadmium.

^d See Table 5.2 for 800 ampere maximum single bus bars.

^e Reference the Standard for Dead-Front Switchboards, UL 891, for 100 percent rated device rated 3,000 amperes or more.

Table 5.2
Rating and sizes of single bus bars – 800 amperes maximum

Table 5.2 revised August 16, 2004

Current rating, amperes	Copper bus			
	Bus size ^a ,		Cross section,	
	inch	(mm)	inch ²	(mm ²)
225	0.125 by 0.875	3.2 by 22.2	0.109	70.3
400	0.250 by 1.500	6.38 by 38.1	0.375	242.0
600	0.250 by 2.000	6.38 by 50.8	0.500	322.6
800	0.250 by 3.000	6.38 by 76.2	0.750	483.9

NOTES

1 For multiple buses in parallel, refer to Table 5.1.

2 A bus connection to a fused power circuit device, to a transfer switch with Class L fuses, or to a molded case circuit breaker rated for continuous use at 100 percent of its rating shall be sized in accordance with Table 5.1 or shall be tested in accordance with the limitation on temperature rise specified in Table 18.1.

3 Joints bolted and plated with silver, tin, nickel, or cadmium.

A bus bar having other dimensions may also be used if it has not less than the cross-sectional area specified in the table and if it has been determined to have equivalent rigidity.

5.2.2.2 The material at any cross-section along the length of a bus bar shall have at least 70 percent of the required ampacity and the remaining metal in any 6 inch (152 mm) length of the bus bar shall have at least 93 percent of the metal of a bus bar having the required ampacity in accordance with Table 5.1.

Exception: Bus bars with a larger amount of material removed shall be tested in accordance with and comply with the Temperature Test, Section 18.

5.2.2.3 In determining the area of contact surfaces of bolted or riveted connections, no additions or subtractions for the diameters and areas of screws, bolts, or rivets shall be made.

5.2.2.4 The contact area shall not be less than the minimum 1 square inch (6.5 cm²) per 200 amperes specified in Tables 5.1 and 5.2 unless the construction complies with one of the following:

- a) The contact area between a plated bus bar and circuit breaker or switch shall not be less than the area on the pressure wire connector that is supplied with a breaker or the full contact area on the circuit breaker, if no pressure wire connector is supplied.
- b) If the full available contact area between a bus bar and pressure terminal connector is not used, the contact area shall not be less than the area that results when two of the same type connectors are bolted together back-to-back with wires leaving in opposite directions or at right angles, whichever results in the smallest area.

5.2.2.5 The limitations on current density mentioned in Tables 5.1 and 5.2 do not apply to:

- a) A connecting strap, bus bar, or the like, comprising all integral part of a circuit breaker, switch, or fuseholder.
- b) A portion of a strap, bus bar, jumper, or the like, adjacent and connected to a terminal of a switch, circuit breaker or fuseholder [but not more than 1 inch (25.4 mm) from the terminal], when a reduced cross-section in that portion is necessary because of the recessing of the terminal or because of barriers adjacent to it.

5.2.2.6 A wire or bus bar leading to a noninterchangeable trip circuit breaker shall have an ampacity not less than the current rating of the breaker.

5.2.2.7 A wire or bus bar leading to a circuit breaker frame constructed for use with interchangeable trip equipment shall have an ampacity not less than the maximum current rating of the frame.

5.2.3 Bolted construction

5.2.3.1 A spring washer shall be used at one end of a bolt that secures current-carrying parts together.

Exception No. 1: A spring washer is not required in a construction that has been tested in accordance with and complies with the Clamped Joint Temperature Test, Section 19.

Exception No. 2: A spring washer shall not be replaced with a split-ring lockwasher and a flat washer unless all the current-carrying parts in the joint, including the tang of a pressure terminal connector, are copper.

Exception No. 3: A flat washer, a split-ring lockwasher, or a bolthead that has an outer diameter of at least 150 percent of the bolt shaft shall not be used in place of a spring washer unless the only aluminum in the joint is the tang of a pressure terminal connector.

5.2.3.2 Unless investigated for such use, a bolted connection between two bus bars or between a bus bar and another current-carrying part shall not depend upon any polymeric insulation to maintain the clamping force and shall not depend on thermoplastic material in any case.

5.2.3.3 A bolted joint in a bus bar shall be accessible for tightening without removing insulating tape or any other part.

5.2.4 Riveted construction

5.2.4.1 Each riveted connection involving current-carrying parts shall have a spring washer at one end and either a spring washer or a flat washer at the other end.

Exception No. 1: The washers are not required in a construction that has been tested in accordance with and complies with the Clamped Joint Temperature Test, Section 19.


Exception No. 2: The washers are not required in a connection rated 220 amperes or less having copper bus bars only.

No Text on This Page

5.2.5 Washers

5.2.5.1 The flat washer as specified in 5.2.3.1 shall have a thickness of at least $\frac{1}{6}$ of the diameter of the rivet shank or bolt and shall have an outer diameter of at least 150 percent of the rivet shank or bolt but not less than the outer diameter of the spring washer.

5.2.5.2 A spring washer as specified in 5.2.3.1 is a dished washer of stainless or hardened or tempered steel having an outer diameter of not less than 150 percent of the bolt diameter, having a thickness not less than $\frac{1}{8}$ of the bolt diameter, and dished not less than 3-1/2 percent of the bolt diameter. A typical spring washer is shown in Figure 5.1. The intended orientation of the spring washer is shown in Figure 5.2.

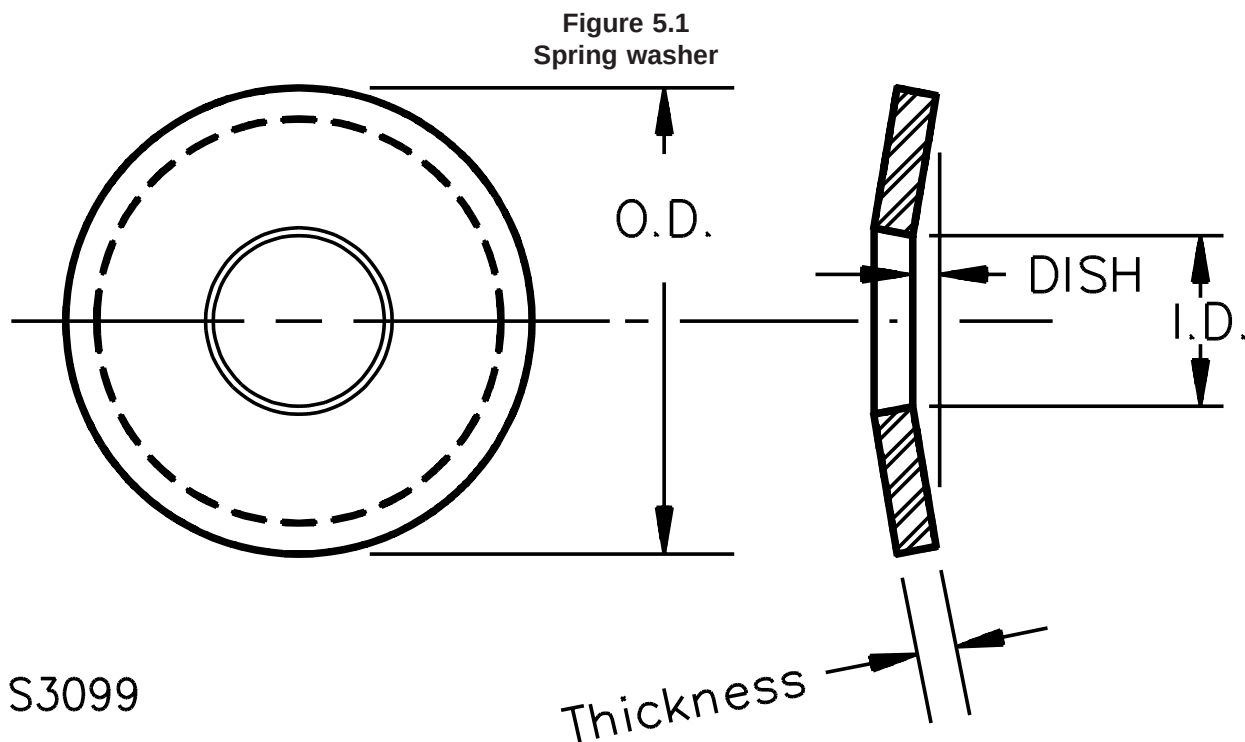

NOTES

1 The spring washer shall comply with the following:

$$OD \geq 1.5 D$$

$$T \geq 0.125 D$$

$$H \geq 0.035 D$$

in which:

OD is the outer diameter of washer,


D is the diameter of bolt or rivet shank,

T is the thickness of washer, and

H is the depth of "dish" of spring washer.

2 Spring washers are also referred to as Belleville and ramp-conical washers.

Figure 5.2
Orientation of spring washer

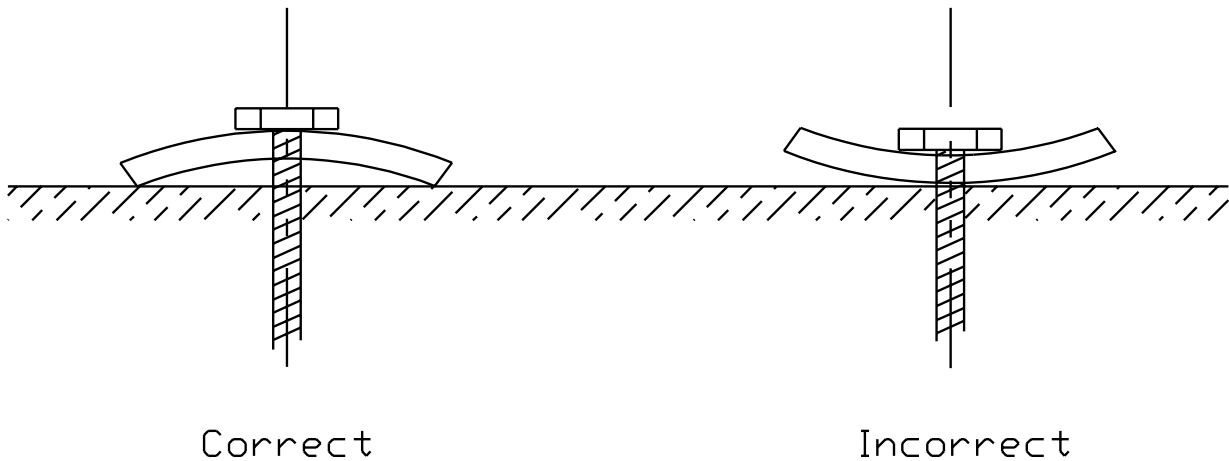

SM1105

5.3 Support and securement of live parts

5.3.1 A bus bar shall either be supported independently of any component to which it is connected (switch, circuit breaker, or the like) or shall be supported by parts that do not depend on a bus bar for support.

5.3.2 A bus bar or an insulated live part shall be secured so that ordinary vibration will not loosen the securing means and shall be prevented from turning or shifting in position if such turning or shifting would result in spacings less than 1/2 of those specified in Table 14.1.

5.3.3 Friction between surfaces is not intended as the sole means to prevent turning or shifting of an uninsulated live part. Turning or shifting shall be prevented by the use of two screws or rivets; by non-circular shoulders or mortises; by a dowel pin, lug, or offset; by a connecting strap or clip fitted into an adjacent part; or by another method determined to be the equivalent.

5.3.4 In evaluating means to prevent turning or shifting in regard to 5.3.3, any screw or nut is to be loosened and retightened fingertight without a tool. The bus bar is then to be pushed to the extent limited by the screws or other means and the resulting spacings checked.

5.4 Internal wiring

5.4.1 Type

5.4.1.1 All internal wiring shall be of copper conductors and have insulation rated 90°C (194°F) minimum and for the voltage involved.

Exception: This requirement does not apply to insulation rated less than 90°C that has been tested in accordance with and complies with the Temperature Test, Section 18.

5.4.2 Routing

5.4.2.1 Wires shall be routed away from sharp edges, screw threads, burrs, fins, or the like that are capable of abrading the wire insulation. A hole through which insulated wires pass in a sheet metal wall shall be provided with a smooth, well-rounded bushing or have smooth, well-rounded surfaces upon which the wires may bear to reduce the risk of abrasion of the insulation.

5.4.3 Terminations

5.4.3.1 A wire connector shall comply with:

- a) The Standard for Wire Connectors and Soldering Lugs for Use with Copper Conductors, UL 486A;
- b) The Standard for Wire Connectors for Use with Aluminum Conductors, UL 486B; or
- c) The Standard for Equipment Wiring Terminals for Use with Aluminum and/or Copper Conductors, UL 486E.

Exception: A wire connector used at an equipment grounding terminal or bonding connection shall comply with 5.4.3.1 or the Standard for Grounding and Bonding Equipment, UL 467.

5.4.3.2 Open-type eyelets shall be of the type with upturned edges or of the type which crimp around the screw shank, or all wiring shall be done in harnesses or shall be formed so that loosening of the terminal screw will not result in the conductor coming away from the intended connection.

5.4.3.3 Quick-connect terminals shall be used under the following conditions:

- a) They mate as intended with terminals integrally provided on components that have been investigated for the intended use;
- b) They have a dimple, depression, or spring-type connection such that a snap-action connection is accomplished; and
- c) They are suitable for the number and sizes of wires involved.

5.4.3.4 Wire-binding screws or studs and nuts shall be used to secure a No. 10 AWG (5.3 mm²) or smaller conductor only.

5.4.3.5 A wire-binding screw or stud of a wiring terminal shall not be smaller than No. 10 (4.8 mm diameter) and shall not have more than 32 threads per inch.

Exception: This requirement does not apply to a No. 8 (4.2 mm diameter) machine screw having not more than 32 threads per inch used at a terminal intended only for the connection of a No. 14 AWG (2.1 mm²) conductor.

5.4.3.6 Wire-binding screw terminals shall have upturned edges, cupped washers, or other means determined to be the equivalent to retain the conductor. No strands shall protrude from the terminal connector.

5.4.3.7 A wire-binding screw shall thread into metal.

5.4.3.8 A terminal plate tapped for a wire-binding screw shall be of non-ferrous metal not less than 0.030 inch (0.76 mm) thick. There shall be two or more full threads in the metal.

5.4.3.9 A splice shall be provided with insulation that has been determined to be equivalent to that of the wires involved.

5.4.3.10 Soldered connections shall be mechanically secure prior to soldering.

5.4.4 Size

5.4.4.1 The minimum conductor size shall be No. 18 AWG (1.82 mm²).

Exception: Conductor size less than No. 18 AWG shall not be used unless investigated and determined to be rated for the purpose.

5.4.5 Ampacity

5.4.5.1 For circuits rated 100 amperes and larger, conductors of 75°C (167°F) ampacity shall be used. For circuits rated 100 amperes or less, conductors of 60°C (140°F) ampacity shall be used. See Table 5.4.

Exception: Higher ampacities shall not be used unless the assembly has been tested in accordance with and complies with the Temperature Test, Section 18. Higher ampacities shall not be used for conductors terminating to components unless the components have been evaluated for such use.

5.4.5.1 effective March 1, 2001

Table 5.4
Ampacity of insulated conductors

Wire size,		60°C (140°F) ^a	75°C (167°F) ^a	90°C (194°F) ^{a,b}
AWG	(mm ²)	Copper	Copper	Copper
14	2.1	15	15	15
12	3.3	20	20	20
10	5.3	30	30	30
8	8.4	40	50 ^c	55
6	13.3	55	65 ^c	75
4	21.2	70	85 ^c	95
3	26.7	85	100 ^c	110
2	33.6	95	115 ^c	130
1	42.4	110	130 ^c	150
1/0 ^d	53.5 ^d	See footnote e	150	170
2/0 ^d	67.4 ^d	See footnote e	175	195
3/0 ^d	85.0 ^d	See footnote e	200	225
4/0 ^d	107.2 ^d	See footnote e	230	260
kcmil		See footnote e		

Table 5.4 Continued on Next Page

Table 5.4 Continued

Wire size,		60°C (140°F) ^a	75°C (167°F) ^a	90°C (194°F) ^{a,b}
AWG	(mm ²)	Copper	Copper	Copper
250 ^d	127 ^d	See footnote e	255	290
300 ^d	152 ^d	See footnote e	285	320
350 ^d	177 ^d	See footnote e	310	350
400 ^d	203 ^d	See footnote e	335	380
500 ^d	253 ^d	See footnote e	380	430
600 ^d	304 ^d	See footnote e	420	475
700 ^d	355 ^d	See footnote e	460	520
750 ^d	380 ^d	See footnote e	475	535
800 ^d	405 ^d	See footnote e	490	555
900 ^d	456	See footnote e	520	585
1000	506	See Footnote e	545	615
1250	633	See footnote e	590	665
1500	760	See footnote e	625	705
1750	887	See footnote e	650	735
2000	1013	See footnote e	665	750

^a The numbers 60°C (140°F), 75°C (167°F), and 90°C (194°F) indicate the wire temperature rating.

^b Except as noted in the Exception to 5.4.5.1, the ampacity of 90°C (194°F) wire is to be considered the same as 75°C (167°F) wire.

^c The ampacity of these sizes is to be considered the same as for 60°C (140°F) wire when connected to molded case circuit breakers unless the breaker is marked 75°C (167°F).

^d For a multiple conductor connector at a terminal, the ampacity value is to be multiplied by the number of conductors that the terminal will accommodate [1/0 AWG (53.5 mm²) and larger].

^e For wire sizes 1/0 AWG (53.5 mm²) and larger, it is assumed that wire with at least a 75°C (167°F) temperature rating will be used.

5.4.6 Neutral

5.4.6.1 The supply neutral input and any associated current-carrying parts shall have at least the ampacity of the largest ungrounded supply conductor.

Exception No. 1: Equipment intended for single conductor supply cables and that are rated for use with 3-phase, 4-wire with ground systems and are intended for use with electronic dimmers shall have the neutral input and any associated current-carrying parts with ampacity at least equal to 130 percent of the largest ungrounded supply conductor and be marked in accordance with 31.1. Also see 5.2.2.1 – 5.2.2.7 and 5.4.5.1 regarding ampacity of internal conductors.

Exception No. 2: Equipment rated for use on both 208Y-/120-volt, 3-phase, 4-wire, and 120-/240-volt, single-phase, 3-wire supplies at the same output rating shall have the neutral input and any associated current-carrying parts with ampacity at least equal to 200 percent of the largest ungrounded supply conductor and shall be marked in accordance with 31.2. Equipment using single-conductor feeders may use two neutral termination inlets for this purpose. Also see 5.2.2.1 – 5.2.2.7 and 5.4.5.1 regarding ampacity of internal conductors.

5.4.7 Plating

5.4.7.1 A plated steel screw, nut, and stud shall be used to secure a soldering lug, pressure wire connector, or bus bar.

5.4.7.2 Steel that is corrosion-resistant (stainless) or protected against corrosion by zinc plating, cadmium plating, silver plating, or an equivalent coating is not prohibited from being used for wire-binding screws and nuts and for a clamp and for stud terminals when the steel parts are not depended upon to carry current.

5.4.7.3 Copper and brass shall not be used for plating steel wire-binding screws, nuts, and stud terminals.

6 Electrical Insulation Material

6.1 An insulation material shall have a Performance Level Category (PLC) that does not exceed the value specified in Table 6.1. The specified values are derived from the Standard for Polymeric Materials – Use in Electrical Equipment Evaluations, UL 746C.

Exception: This requirement does not apply to an insulation material that has been evaluated to and complies with the end-product tests specified in UL 746C.

6.2 Equipment with enclosure designation 3R or marked "Suitable For Use In Damp Locations" shall use electrical insulation that does not exhibit a dimensional change greater than 2.0 percent after immersion for 168 hours in distilled water as described in the Standard for Polymeric Materials – Short-Term Property Evaluations, UL 746A. Untreated fiber and the like are examples of materials that shall not be used.

6.3 A base of a ceramic type material shall not be less than 1/2 inch (12.7 mm) thick.

6.4 With regard to footnote e to Table 6.1, a live screw head, rivet, or nut on the underside of a base intended for surface mounting shall be countersunk not less than 1/8 inch (3.2 mm) in the clear, and covered to a depth of not less than 1/8 inch with a waterproof, insulating, sealing compound that will not soften at a temperature of 90°C (194°F) as determined by the test method in Softening Point by Ring-and-Ball Apparatus in the Standard for Polymeric Materials – Short Term Property Evaluations, UL 746A.

Exception No. 1: The test is not required for a thermosetting material.

Exception No. 2: A sealing compound is not required if the live part specified in 6.4 is prevented from loosening by being staked or upset, by a lock washer or by other means. The spacings through air from the mounting surface to the live part shall comply with Table 14.1.

Table 6.1
Maximum performance level category (PLC) for insulation materials other than insulating barriers


Test specified ^b	Flammability rating of material ^a		
	V-0	V-1	V-2
Comparative tracking index under moist conditions (CTI) ^{d,e}	3 ^c	3 ^c	3 ^c
High-current arc resistance to ignition (HAI) ^{d,f}	3	2	2
Hot wire ignition (HWI) ^{d,g}	4	3	2
^a These flammability ratings are derived from the Standard for Tests for Flammability of Plastic Materials for Parts in Devices and Appliances, UL 94. ^b The additional parameters specified in Table 6.2 shall be considered. ^c A material having a comparative tracking index PLC of 4 shall not be used unless the voltage involved is 250 volts or less. ^d See the Standard for Polymeric Materials – Short Term Property Evaluations, UL 746A, for this specified test. ^e Refer to figurative examples 1 and 2 of Figure 6.1 for application of this requirement. ^f Refer to figurative examples 1 – 3 of Figure 6.1 for application of this requirement. ^g Refer to figurative examples 1 – 3 of Figure 6.1 for application of this requirement.			

Table 6.2
Additional parameters

Property	Tests	Method	Units	Minimum levels related to flammability classification
Distortion under load and mold stress relief	Heat deflection temperature, or	UL 746A	Minimum °C	10°C (18°F) greater than use temperature but not less than 90°C (194°F), or
	Vicat softening point, or	UL 746A	Minimum °C	25°C (45°F) greater than use temperature but not less than 105°C (221°F), or
	Ball pressure temperature	UL 746A	Minimum °C	Greater than the use temperature by the difference between 40°C (72°F) and the ambient, but not less than 95°C (203°).

Figure 6.1
Figurative examples for Table 6.1


1.



In which:

 $d < 1/2 \text{ inch (12.7mm)}$
 $d = \text{Over-surface spacing requirement}$


2.

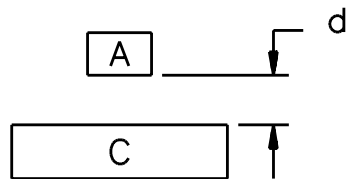

In which:

 $d < 1/2 \text{ inch}$

3.

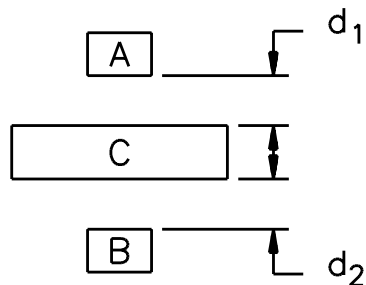

In which:

 $d_1, d_2 = \text{Through-air spacing}$
 $d_1 + d_2 < Sa$
 $\text{and } Sa = \text{Applicable through-air spacing requirement}$

S3661

A – An uninsulated live part

B – (1) An uninsulated live part having a difference in potential from part A or, (2) A dead metal part that may be grounded in service or that is exposed to contact.

C – The polymeric material under consideration.

7 Enclosure

7.1 General

7.1.1 A portable power-distribution equipment enclosure shall be constructed and assembled so that it has the strength and rigidity necessary to resist the abuses to which it is likely to be subjected, without total or partial collapse resulting in a risk of fire, electric shock, or injury to persons due to reduction of spacings, loosening or displacement of parts, or other serious defects.

7.1.2 An enclosure shall be constructed so as to reduce the risk of unintentional contact with enclosed electrical devices, and to provide internal devices with protection from specified external conditions.

7.2 Specific enclosures

7.2.1 An enclosure shall comply with the construction requirements applicable to an enclosure of the type numbers or numbers with which it is marked. See 30.1.

7.2.2 TYPE 2 – A Type 2 enclosure shall have provision for drainage of water. The drainage opening(s) shall be located below the level of the lowest live part when the equipment is oriented in the intended manner.

7.2.3 An enclosure marked Type 3R or "Suitable For Use in Damp Locations " shall be provided with means for the drainage of water to the outside. The drainage opening(s) shall be located below the level of the lowest live part when the equipment is oriented in the intended manner.

7.3 Cast metal

7.3.1 A cast-metal enclosure shall be at least 1/8 inch (3.2 mm) thick at every point, and more than 1/8 inch thick at reinforcing ribs and door edges.

Exception: Malleable iron and die-cast or permanent mold cast aluminum, brass, bronze, or zinc shall be:

- a) At least 3/32 inch (2.4 mm) thick for an area greater than 24 square inches (155 cm²) or having any dimension more than 6 inches (152 mm) and*
- b) At least 1/16 inch (1.6 mm) thick for an area of 24 square inches or less having no dimension more than 6 inches. The area considered may be bounded by reinforcing ribs subdividing a larger area.*

7.4 Sheet metal

7.4.1 General

7.4.1.1 The thickness of a sheet-metal enclosure shall not be less than that specified in Tables 7.1 and 7.2.

Exception: Enclosure thickness need not comply with these requirements if the enclosure complies with the Compression Test, Section 28, and the Deflection Test, Section 29, in the Standard for Enclosures for Electrical Equipment, UL 50.

Table 7.1
Minimum thickness of sheet metal for enclosures– carbon steel or stainless steel

Without supporting frame ^a		With supporting frame or equivalent reinforcing ^a		(Column 5) Minimum thickness uncoated, inch (mm)	(Column 6) Minimum thickness metal coated, inch (mm)
(Column 1) Maximum width, ^b inches (cm)	(Column 2) Maximum length, ^c inches (cm)	(Column 3) Maximum width, ^b inches (cm)	(Column 4) Maximum length, inches (cm)		
4.0	10.2	Not limited	6.25 15.9	Not limited	0.020 0.51
4.75	12.1	5.75 14.6	6.75 17.1	8.25 21.0	
6.0	15.2	Not limited	9.5 24.1	Not limited	0.026 0.66
7.0	17.8	8.75 22.2	10.0 25.4	12.5 31.8	0.029 0.74
8.0	20.3	Not limited	12.0 30.5	Not limited	0.032 0.81
9.0	22.9	11.5 29.2	13.0 33.0	16.0 40.6	0.034 0.86
12.5	31.8	Not limited	19.5 49.5	Not limited	0.042 1.07
14.0	35.6	18.0 45.7	21.0 53.3	25.0 63.5	0.045 1.14
18.0	45.7	Not limited	27.0 68.6	Not limited	0.053 1.35
20.0	50.8	25.0 63.5	29.0 73.7	36.0 91.4	0.056 1.42
22.0	55.9	Not limited	33.0 83.8	Not limited	0.060 1.52
25.0	63.5	31.0 78.7	35.0 88.9	43.0 109.2	0.063 1.60
25.0	63.5	Not limited	39.0 99.1	Not limited	0.067 1.70
29.0	73.7	36.0 91.4	41.0 104.1	51.0 129.5	0.070 1.78
33.0	83.8	Not limited	51.0 129.5	Not limited	0.080 2.03
38.0	96.5	47.0 119.4	54.0 137.2	66.0 167.6	0.084 2.13
42.0	106.7	Not limited	64.0 162.6	Not limited	0.093 2.36
47.0	119.4	59.0 149.9	68.9 172.7	84.0 213.4	0.097 2.46
52.0	132.1	Not limited	80.0 203.2	Not limited	0.108 2.74
60.0	152.4	74.0 188.0	84.0 213.4	103.0 261.6	0.111 2.82
63.0	160.0	Not limited	97.0 246.4	Not limited	0.123 3.12
73.0	185.4	90.0 228.6	103.0 261.6	127.0 322.6	0.126 3.20

NOTE – Sheet steel for a Type 3R enclosure or one marked "Suitable for Use in Damp Locations " shall not be less than 0.034 inch thick when zinc coated and not less than 0.032 inch thick when uncoated.

^a See 7.4.1.2 regarding sheet metal construction.

^b See 7.4.2.1 regarding width of enclosure.

^c "Not limited" applies only if the edge of the surface is flanged at least 1/2 inch (127 mm) or is fastened to adjacent surfaces not normally removed in use.

Table 7.2
Minimum thickness of sheet metal for enclosures– aluminum, copper, or brass

Without supporting frame ^a		With supporting frame or equivalent reinforcing ^a				(Column 5) Minimum thickness, inch (cm)	
(Column 1) Maximum width, ^b inches (cm)	(Column 2) Maximum length, ^c inches (cm)	(Column 3) Maximum width, ^b inches (cm)	(Column 4) Maximum length, inches (cm)	(Column 4) Maximum length, inches (cm)	(Column 4) Maximum length, inches (cm)		
3.0 7.6	Not limited	7.0 17.8	Not limited	Not limited	0.023 0.58		
3.5 8.9	4.0 10.2	8.5 21.6	9.5 24.1	9.5 24.1			
4.0 10.2	Not limited	10.0 25.4	Not limited	Not limited	0.029 0.74		
5.0 12.7	6.0 15.2	10.5 26.7	13.5 34.3	13.5 34.3			
6.0 15.2	Not limited	14.0 35.6	Not limited	Not limited	0.036 0.91		
6.5 16.5	8.0 20.3	15.0 38.1	18.0 45.7	18.0 45.7			
8.0 20.3	Not limited	19.0 48.3	Not limited	Not limited	0.045 1.14		
9.5 24.1	11.5 29.2	21.0 53.3	25.0 63.5	25.0 63.5			
12.0 30.5	Not limited	28.0 71.1	Not limited	Not limited	0.058 1.47		
14.0 35.6	16.0 40.6	30.0 76.2	37.0 94.0	37.0 94.0			
18.0 45.7	Not limited	42.0 106.7	Not limited	Not limited	0.075 1.91		
20.0 50.8	25.0 63.5	45.0 114.3	55.0 139.7	55.0 139.7			
25.0 63.5	Not limited	60.0 152.4	Not limited	Not limited	0.095 2.41		
29.0 73.7	36.0 91.4	64.0 162.6	78.0 198.1	78.0 198.1			
37.0 94.0	Not limited	87.0 221.0	Not limited	Not limited	0.122 3.10		
42.0 106.7	53.0 134.6	93.0 236.2	114.0 289.6	114.0 289.6			
52.0 132.1	Not limited	123.0 312.4	Not limited	Not limited	0.153 3.89		
60.0 152.4	74.0 188.0	130.0 330.2	160.0 406.4	160.0 406.4			
^a See 7.4.1.2 regarding sheet metal construction.							
^b See 7.4.2.1 regarding width of enclosure.							
^c For panels which are not supported along one side, for example, side panels of boxes, the length of the unsupported side.							

7.4.1.2 With reference to Tables 7.1 and 7.2, a supporting frame is a structure of angle or channel or folded rigid section of sheet metal that is rigidly attached to and has essentially the same outside dimensions as the enclosure surface and that has sufficient torsional rigidity to resist bending moments applied to the enclosure surface when it is deflected. A structure that is as rigid as one built with a frame of angles or channels is considered to have equivalent reinforcing. Constructions considered to be without supporting frames include:

- a) A single sheet with single formed flanges – formed edges;
- b) A single sheet that is corrugated or ribbed;
- c) An enclosure surface loosely attached to a frame, for example, with spring clips; and
- d) An enclosure surface having an unsupported edge.

7.4.2 Instructions for using Tables 7.1 and 7.2

7.4.2.1 The width is the smaller dimension of a rectangular sheet metal piece which is part of an enclosure. Adjacent surfaces of an enclosure are not prohibited from having supports in common and be made of a single sheet.


7.4.2.2 Determine if the portion of the enclosure is supported or unsupported using the following criteria:

a) Supported – Supported edges flanged at least 1/2 inch (12.7 mm) or fastened to adjacent surfaces not normally removed in use. (Surfaces A and C of Figure 7.1 are considered supported.)

b) Nonsupported –

- 1) A single sheet with formed flanges or formed edges;
- 2) A single sheet that is corrugated or ribbed;
- 3) An enclosure surface loosely attached to its frame, for example, with spring clips; and
- 4) An enclosure surface having an unsupported edge. (Surface B of example Figure 7.1 is unsupported.)

Figure 7.1
Enclosure surfaces

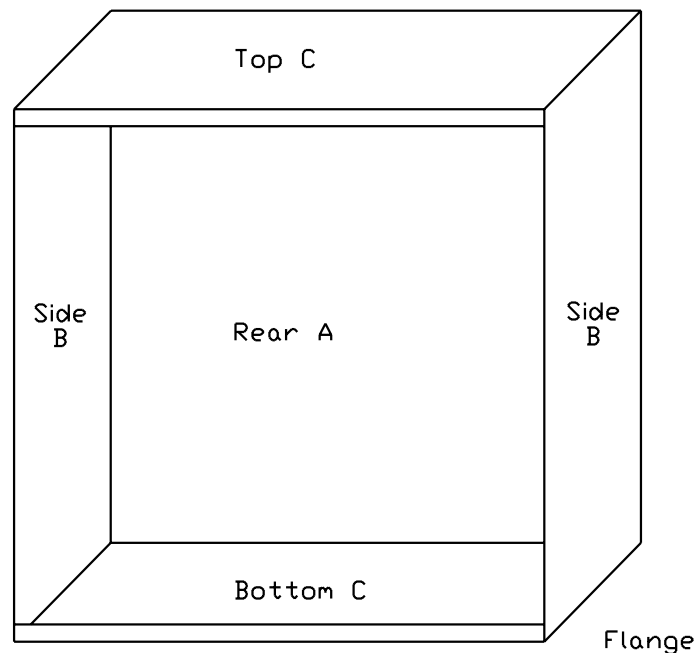

SM787