


Standard for Safety

UL 2096

ISBN 1-55989-498-9

Commercial/Industrial Gas and/or Oil-Burning Assemblies With Emission Reduction Equipment



Underwriters Laboratories Inc.®

Standard



Documents

Document Sharing Hub

Northbrook, Illinois • (708) 272-8800
Melville, New York • (516) 271-6200
Santa Clara, California • (408) 985-2400
Research Triangle Park,
North Carolina • (919) 549-1400



Underwriters Laboratories Inc.®

Underwriters Laboratories Inc., founded in 1894, is chartered as a not-for-profit organization without capital stock, under the laws of the State of Delaware, to establish, maintain, and operate laboratories for the examination and testing of devices, systems and materials to determine their relation to hazards to life and property, and to ascertain, define and publish standards, classifications and specifications for materials, devices, products, equipment, constructions, methods, and systems affecting such hazards.

UL Standards for Safety are developed under a procedure which provides for participation and comment from the affected public as well as industry. The procedure takes into consideration a survey of known existing standards and the needs and opinions of a wide variety of interests concerned with the subject matter of the standard. Thus manufacturers, consumers, individuals associated with consumer-oriented organizations, academicians, government officials, industrial and commercial users, inspection authorities, insurance interests and others provide input to UL in the formulating of UL Standards for Safety, to keep them consonant with social and technological advances.

A not-for-profit organization
dedicated to public safety and
committed to quality service



Underwriters Laboratories Inc.®

A not-for-profit organization dedicated to public safety
and committed to quality service

November 30, 1993

Standard for

**Commercial/Industrial Gas and/or Oil-Burning
Assemblies With Emission Reduction Equipment**

UL 2096, First Edition

Accompanying this transmittal notice is a copy of the First edition of UL 2096.

THIS EDITION OF THE STANDARD BECOMES EFFECTIVE APRIL 1, 1994, AS
INDICATED IN THE SMALL PRINT NOTES FOLLOWING EACH SECTION
HEADING.

The requirements in this standard are substantially in accordance with UL's bulletin
on this subject dated February 15, 1993. The bulletin is now obsolete and may be
discarded.

Revised and/or additional pages may be issued from time to time.

NOVEMBER 30, 1993

1

UL 2096

Standard for

**Commercial/Industrial Gas and/or Oil-Burning
Assemblies With Emission Reduction Equipment**

First Edition

November 30, 1993

An effective date included as a note immediately following certain requirements is one established by Underwriters Laboratories Inc.

Revisions of this standard will be made by issuing revised or additional pages bearing their date of issue. A UL Standard is current only if it incorporates the most recently adopted revisions, all of which are itemized on the transmittal notice that accompanies the latest published set of revision pages.

ISBN 1-55989-498-9

COPYRIGHT © 1993 UNDERWRITERS LABORATORIES INC.

UL's Standards for Safety are copyrighted to protect UL's publication rights, not to restrict their use in product design or evaluation. See paragraph E of the Foreword.

(1 — 11/30/93 — 11/30/93)

CONTENTS**FOREWORD****PART I — ALL EQUIPMENT****INTRODUCTION**

1 Scope	7
2 General	7
3 Glossary	8

CONSTRUCTION

4 General	16
5 Corrosion Protection	17
6 Protection of Users and Service Personnel	18
7 Enclosures	21
8 Field Wiring	30
9 Internal Wiring	34
10 Separation of Circuits	38

ELECTRICAL COMPONENTS

11 Bonding for Grounding	40
12 Mounting of Electrical Components	43
13 Motors and Motor Overload Protection	44
14 Overcurrent Protection of High-Voltage Control-Circuit Conductors	47
15 Overcurrent Protection of Transformers	50
16 Switches and Controllers	52
17 Capacitors	52
18 Electrical Insulating Materials	53

SPACINGS

19 High-Voltage Circuits	54
20 Low-Voltage Circuits	55

PERFORMANCE

21 General	55
22 Instrumentation	56
23 Test Voltage	60
24 Power Input Test	61
25 Temperature Test	61
26 Short-Circuit Test	66
27 Overload Test, High-Voltage Transformers	68
28 Burnout Test, High-Voltage Transformers	69
29 Dielectric Voltage-Withstand Test	70

MANUFACTURING AND PRODUCTION TESTS

30 General	71
31 Production Line Dielectric Voltage-Withstand Test	72

MARKING

32 General	73
33 Nameplate	73
34 Supplemental Marking	74

INSTRUCTIONS

35 General	77
------------------	----

PART II - BURNER ASSEMBLIES**CONSTRUCTION**

36 General	78
37 Assembly	78
38 Accessibility for Servicing	80
39 Fan Housings and Air Tubes	80
40 Combustion Air Controls	81
41 Fuel Strainers	82
42 Fittings, and Piping and Tubing	86
43 Valves and Regulators	88
44 Stuffing Boxes	90
45 Bleeds and Vents	91
46 Gauges	92
47 Ignition Systems – General	92
48 Oil-Burning Devices	93
49 Gas-Burning Devices	93
50 Electric High-Tension Ignition	94
51 Gas Pilots	95
52 Control Applications	96
53 Primary Safety Controls	97
54 Purge and Combustion Air Monitoring Controls	101
55 Oil Atomization Control	102
56 Oil Temperature Control	103
57 Gas Pressure Controls	103
58 Interlocks	103
59 Combination Gas-Oil Burners	104

PERFORMANCE

60 Test Installation	105
61 Tests Firing Oil	105
62 Tests Firing Gas	114

PART III – BOILER ASSEMBLIES**CONSTRUCTION**

63 Assembly	119
64 Accessibility for Servicing	120
65 Casing	120
66 Radiation Shields or Liners	120
67 Combustion Chamber	121
68 Baffles	121
69 Flue Collar	121
70 Flue Dampers, Draft Regulator, and Draft Hoods	121
71 Controls	122
72 Installation of External Controls and Fittings	125

PERFORMANCE

73 General	126
74 Test Installation for Standard Clearances	128
75 Initial Test Conditions	134
76 Combustion – Test No. 1	134
77 Limit Control Cutout – Test No. 2	136
78 Continuous Operation Temperatures – Test No. 3	136
79 Low Water Cutoff – Test No. 4	137

PART IV – FURNACES AND HEATERS**CONSTRUCTION**

80 Assembly	138
81 Accessibility	139
82 Air Filters	139
83 Baffles	139
84 Burner Equipment	139
85 Controls	139
86 Bases	141
87 Heating Surfaces and Combustion Chambers	141
88 Radiation Shields	141
89 Materials in Air Handling Compartments	142
90 Casings	143
91 Fuel Lines and Components	144
92 Flue Collars	144
93 Flue Dampers, Draft Regulators, and Draft Hoods	144

PERFORMANCE

94 General	144
95 Test Installations	146
96 Initial Test Conditions	154
97 Combustion Test – Test No. 1	155
98 Limit Control Cutout – Test No. 2	156
99 Continuity of Operation – Test No. 3	157
100 Airflow Test – Downflow and Horizontal Furnaces – Test No. 4	157

101	Temperature Tests – General	158
102	Continuous Operation – Test No. 5	158
103	Blocked Inlet – Test No. 6	158
104	Fan Failure – Test No. 7	159
105	Blocked Outlet – Test No. 8	159
106	Stalled Fan Motor Test	160

PART IVA – DRAFT HOOD EQUIPPED DEVICES

PERFORMANCE

107	Blocked Outlet – Test No. 1	160
108	Downdrafts and Updrafts – Test No. 2	160
109	Spillage – Test No. 3	161
110	Draft Hood Strength – Test No. 4	162

PART V – OUTDOOR-USE EQUIPMENT

CONSTRUCTION

111	General	162
112	Enclosures	163
113	Field Wiring Connections	165
114	Wiring	165
115	Electrical Insulation Material	165
116	Water Spray Test – Test No. 1	166
117	Wind Tests – Test No. 2	169
118	Accelerated Aging Test – Gaskets, Adhesives, and Sealing Compounds – Test No. 3	170
119	Metallic Coating Thickness Test – Chromic Acid Dropping Test – Test No. 4	171
120	Marking	172

APPENDIX A

Standards for Components	A1
--------------------------------	----

FOREWORD

A. This Standard contains basic requirements for products covered by Underwriters Laboratories Inc. (UL) under its Follow-Up Service for this category within the limitations given below and in the Scope section of this Standard. These requirements are based upon sound engineering principles, research, records of tests and field experience, and an appreciation of the problems of manufacture, installation, and use derived from consultation with and information obtained from manufacturers, users, inspection authorities, and others having specialized experience. They are subject to revision as further experience and investigation may show is necessary or desirable.

B. The observance of the requirements of this Standard by a manufacturer is one of the conditions of the continued coverage of the manufacturer's product.

C. A product which complies with the text of this Standard will not necessarily be judged to comply with the Standard if, when examined and tested, it is found to have other features which impair the level of safety contemplated by these requirements.

D. A product employing materials or having forms of construction differing from those detailed in the requirements of this Standard may be examined and tested according to the intent of the requirements and, if found to be substantially equivalent, may be judged to comply with the Standard.

E. UL, in performing its functions in accordance with its objectives, does not assume or undertake to discharge any responsibility of the manufacturer or any other party. The opinions and findings of UL represent its professional judgment given with due consideration to the necessary limitations of practical operation and state of the art at the time the Standard is processed. UL shall not be responsible to anyone for the use of or reliance upon this Standard by anyone. UL shall not incur any obligation or liability for damages, including consequential damages, arising out of or in connection with the use, interpretation of, or reliance upon this Standard.

F. Many tests required by the Standards of UL are inherently hazardous and adequate safeguards for personnel and property shall be employed in conducting such tests.

PART I — ALL EQUIPMENT

INTRODUCTION

1 Scope

Section 1 effective April 1, 1994

1.1 These requirements cover fuel burning heating appliances that are provided with or are intended for installation with NO_x emissions reduction equipment.

1.2 These requirements apply to factory-built equipment having inputs of more than 400,000 Btu per hour (117 KW) (firing gas), and/or more than 3.0 gph (11.4 L/h) (firing oil), per individual combustion chamber and/or oil or combination gas-oil burning equipment which require flame failure and other safeguards and which are intended primarily for commercial and industrial installation.

1.3 Equipment covered by these requirements may be operated without a competent attendant being constantly on duty at the burners while the burners are in operation.

1.4 The heating appliance shall be suitable for installation in accordance with the National Fire Protection Association Standards for the Installation of Oil-Burning Equipment, NFPA 31, and/or National Fuel Gas Code, NFPA 54 and the National Electrical Code, NFPA 70.

1.5 A product that contains features, characteristics, components, materials, or systems new or different from those in use when the standard was developed, and that involves a risk of fire, electric shock, or injury to persons shall be evaluated using the appropriate additional component and end-product requirements as determined necessary to maintain the level of safety for the user of the product as originally anticipated by the intent of this standard.

2 General

Section 2 effective April 1, 1994

2.1 Undated references

2.1.1 Any undated reference to a code or a standard appearing in the requirements in this standard shall be interpreted as referring to the latest edition of that code or standard.

2.2 Definitions

2.2.1 The term "appliance" refers to any equipment covered by this standard. The term "furnace" refers to a central furnace. The term "heater" refers to a unit heater.

2.2.2 The terms "combustible" and "noncombustible," as used in these requirements, are defined in the Glossary of Terms Relating to Chimneys, Vents, and Heat-Producing Appliances, ANSI/NFPA 97M-1988.

2.3 Units of measurement

2.3.1 If a value for measurement is followed by a value in other units in parentheses, the second value may be only approximate. The first stated value is the requirement.

2.3.2 Unless indicated otherwise, all voltage and current values mentioned in this standard are rms.

2.4 Components

2.4.1 Except as indicated in 2.4.2, a component of a product covered by this standard shall comply with the requirements for that component. See Appendix A for a list of standards covering components generally used in the products covered by this standard.

2.4.2 A component need not comply with a specific requirement that:

- a) Involves a feature or characteristic not needed in the application of the component in the product covered by this standard, or
- b) Is superseded by a requirement in this standard.

2.4.3 A component shall be used in accordance with its recognized rating established for the intended conditions of use.

2.4.4 Specific components are recognized as being incomplete in construction features or restricted in performance capabilities. Such components are intended for use only under limited conditions, such as certain temperatures not exceeding specified limits, and shall be used only under those specific conditions for which they have been recognized.

3 Glossary

Section 3 effective April 1, 1994

3.1 For the purpose of this Standard the following definitions apply.

3.2 **AIR SHUTTER** – An adjustable device for varying the size of the air inlet or inlets regulating primary and/or secondary air.

3.3 **AIR SHUTTER, AUTOMATICALLY OPERATED** – An air shutter operated by an automatic control.

3.4 **AIR SHUTTER, MANUALLY OPERATED** – An air shutter manually set and locked in the desired position.

3.5 **APPLIANCE FLUE** – The flue passages within the appliance.

3.6 **ALUMINUM COATED STEEL** – An aluminum coated steel in which the bond between the steel and the aluminum is an iron-aluminum alloy.

3.7 **BAFFLE** – An object placed in an appliance to direct the flow of air or flue gases.

3.8 **BASE** – The main supporting frame or structure of the assembly, exclusive of legs.

3.9 **BLUE FLAME** – A visual flame condition which may be observed when firing distillate oil fuels.

3.10 **BOILER** – A closed vessel in which water or some other liquid is heated or in which steam is generated or superheated, under pressure or vacuum, by direct application of heat.

3.11 **BOILER, HIGH PRESSURE STEAM** – A boiler in which steam is generated at a pressure higher than 15 psig (103 kPa).

3.12 **BOILER, HIGH TEMPERATURE WATER** – A boiler intended for operation at a pressure exceeding 160 psig (1103 kPa) or at a temperature exceeding 250°F (121°C) or both.

- 3.13 **BOILER, HOT WATER** – A boiler that furnishes hot water at a pressure not exceeding 160 psig (1103 kPa) and at a temperature not exceeding 250°F (121°C).
- 3.14 **BOILER, LOW PRESSURE STEAM** – A boiler in which steam is generated at a pressure not exceeding 15 psig (103 kPa).
- 3.15 **BURNER, GAS** – A device for the final conveyance of the gas, or a mixture of gas and air, to the combustion zone.
- 3.16 **BURNER, MECHANICAL ATOMIZING TYPE** – A power-operated burner which prepares and delivers the oil and all or part of the air by mechanical process in controllable quantities for combustion. Some examples are air atomizing, high and low pressure atomizing, horizontal rotary, vertical rotary atomizing, and vertical rotary wall-flame burner.
- 3.17 **BURNER, MECHANICAL DRAFT TYPE** – A burner which includes a power-driven fan, blower, or other mechanism as the principal means for supplying air for combustion.
- 3.18 **BURNER HEAD, GAS** – That portion of a burner beyond the outlet end of the mixer tube which contains the ports.
- 3.19 **CASING** – An enclosure forming the outside of the appliance, no parts of which are likely to be subjected to intense heat.
- 3.20 **CENTRAL HEATING APPLIANCE** – A stationary indirect-fired vented appliance comprising the following classes: boilers, central furnaces, and recessed heaters. A floor-mounted unit heater to be connected to a duct system is categorized also as a central heating appliance.
- 3.21 **CHIMNEY CONNECTOR** – The pipe which connects a fuel burning appliance to a chimney.
- 3.22 **COMBUSTIBLE MATERIAL** – Combustible material as pertaining to materials adjacent to or in contact with heat-producing appliances, chimney connectors and vent connectors, steam and hot water pipes, refers to material made of or surfaced with wood, compressed paper, plant fibers, or other material that will ignite and burn. Such material shall be considered as combustible even through flameproofed, fire-retardant treated, or plastered.
- 3.23 **COMBUSTION AIR TEMPERATURE INTERLOCK** – A safety control responsive to changes in temperature, normally set beyond the intended operating range of the controlled equipment to cause a safety shutdown.
- 3.24 **COMBUSTION CHAMBER** – The portion of an appliance within which combustion occurs.
- 3.25 **COMBUSTION DETECTOR** – That part of a primary safety control which is responsive directly to flame properties.
- 3.26 **COMBUSTION PRODUCTS** – Constituents resulting from the combustion of a fuel with the oxygen of the air, including the inerts, but excluding excess air.
- 3.27 **CONDENSATE** – The liquid which separates from a gas, including flue gases, due to a reduction in temperature.
- 3.28 **CONTROL** – A device designed to regulate the fuel, air, water, or electrical supply to the controlled equipment. It may be automatic, semiautomatic, or manual.

3.29 CONTROL INPUT, COMBUSTION – A control which automatically regulates the firing rate at predetermined air-fuel ratio in accordance with load demand. It may be a type which positions the air and fuel supplies for low fire and for high fire as required to meet the load demands, or it may be a modulating type which gradually varies the air and fuel supplies within limits to meet the load demand.

3.30 CONTROL, LIMIT – An automatic safety control, responsive to changes in liquid level, pressure, or temperature, for limiting the operation of the controlled equipment.

3.31 CONTROL, OPERATING – A control other than a safety control or interlock, to start or regulate burner firing according to load demand and to stop or regulate fire on satisfaction of demand or upon reaching normal temperature or pressure in the device being fired. Operating controls may also actuate auxiliary equipment.

3.32 CONTROL, PRIMARY SAFETY – An automatic control that monitors the operation of a gas-fired or an oil-fired burner. It normally consists of the following sections that may be integrated into a common unit or may be separate units, interconnected by wiring:

a) **Programming Unit** – A device that programs the burner through start-up and shutdown operations in response to signals from regulating, limiting, and monitoring devices. It also provides the necessary timings, in proper sequence, for purging, pilot flame ignition, main flame ignition, and in case of ignition or flame failure, for safety shutdown (lockout).

b) **Combustion Detector** – A device that is responsive to flame properties. It monitors the flame at the point of flame supervision and transmits a signal to the programming unit, indicating absence or presence of flame.

3.33 CONTROL, SAFETY – Automatic controls, including relays, switches, and other auxiliary equipment used in conjunction therewith to form a safety control system, that is intended to reduce the risk of fire, electric shock, or injury to persons during operation of the controlled equipment.

3.34 CONTROL, SAFETY COMBUSTION – A primary safety control responsive directly to flame properties, sensing the presence of flame and causing fuel to be shut off in event of flame failure.

3.35 DAMPER – A valve or plate for regulating draft or flow of flue gases. A damper is generally considered as being located on the downstream side of the combustion chamber, usually in a flue passage of the appliance or in the chimney connector.

3.36 DAMPER, AUTOMATICALLY OPERATED – A damper operated by an automatic control.

3.37 DAMPER, MANUALLY OPERATED – An adjustable damper manually set and locked in the desired position.

3.38 DIRECT FIRED APPLIANCE – A device in which combustion products (flue gases) are mixed with the medium, e.g., air, being heated.

3.39 DRAFT – The differential in static pressure available, between any two locations, to provide the energy potential for the moving of air for combustion or products of combustion through a fuel-burning heat-exchanging apparatus, or both.

3.40 DRAFT REGULATOR – A device which functions to maintain a desired draft in the appliance by automatically reducing the chimney draft to the desired value.

3.41 ELECTRICAL CIRCUITS:

- a) **High-Voltage Circuit** – A circuit involving a potential of not more than 600 volts and having circuit characteristics in excess of those of a low-voltage circuit.
- b) **Low-Voltage Circuit** – A circuit involving a potential of not more than 30 volts alternating-current (42.4 volts peak) or direct current and supplied by:
 - 1) A Class 2 transformer, or by a battery, by a battery and fixed impedance, or by a transformer and fixed impedance each of which, as a unit is in compliance with what is required for a Class 2 transformer, or
 - 2) Is limited to a maximum of 100 volt-amperes. A circuit derived from a source of supply classified as a high-voltage circuit, by connecting resistance in series with the supply circuit as a means of limiting the voltage and current, is not considered to be a low-voltage circuit.
- c) **Safety Control Circuit** – A circuit involving one or more safety controls.

3.42 EXCESS AIR – Air which passes through the combustion area and the appliance flues in excess of that which is theoretically required for complete combustion.

3.43 FLAME SAFEGUARD – See "Control, Primary Safety."

3.44 FLUE COLLAR – That portion of an appliance designed for attachment of the chimney or vent connector.

3.45 FLUE GASES – Combustion products and excess air.

3.46 FLUE GAS RECIRCULATION (FGR) – A combustion process involving recirculation of a proportional amount of combustion flue gases drawn from the flue gas outlet of a single source and reintroduced into the combustion zone.

3.47 FUEL OIL – Any hydrocarbon oil as defined by the Standard for the Specification for Fuel Oils ANSI/ASTM D396-1989.

3.48 FURNACE, CENTRAL, WARM AIR – A self-contained indirect fired appliance designed to supply heated air through ducts to spaces remote from or adjacent to the appliance location.

3.49 FURNACE, FORCED-AIR TYPE, CENTRAL – A central furnace equipped with a fan or blower which provides the primary means for circulation of air.

3.50 FURNACE, DOWNFLOW – A forced-air type central furnace designed with airflow through the furnace essentially in a vertical path, discharging air at or near the bottom of the furnace.

3.51 FURNACE, DUCT – A central furnace designed for installation in a duct of an air distribution system to supply warm air for heating and which depends for air circulation on a blower not furnished as part of the furnace.

3.52 FURNACE, HORIZONTAL – A forced-air type central furnace designed with airflow through the furnace essentially in a horizontal path.

3.53 FURNACE, UPFLOW – A central furnace designed with airflow through the furnace essentially in a vertical path, discharging air at or near the top of the furnace.

- 3.54 **GAS VENT** – The piping and fittings for conveying flue gases to the outside atmosphere.
- 3.55 **HEAT EXCHANGER, DIRECT** – A heat exchanger in which heat generated in the combustion chamber of the appliance is transferred direct through walls of the appliance to the heating medium (such as air, steam or water) held in close contact with the combustion chamber walls. It is a self-contained combustion and heat transfer device, hence a direct heat exchanger.
- 3.56 **HEAT EXCHANGER, INDIRECT** – A heat exchanger which encloses or contains a heating medium, such as air, steam, or water, the heat from which is transferred to another heating medium separately contained in close contact with or directed through the heat exchanger.
- 3.57 **HEATING SURFACES** – All surfaces which transmit heat directly from flame or flue gases to the medium to be heated.
- 3.58 **IGNITION, CONTINUOUS** – Ignition by an energy source which is continuously maintained during the time the burner is in service, whether the main burner is firing or not.
- 3.59 **IGNITION, INTERMITTENT** – Ignition by an energy source which is continuously maintained during the time the burner is firing.
- 3.60 **IGNITION, INTERRUPTED** – Ignition by an energy source which is automatically energized each time the main burner is fired and subsequently is automatically shut off during the firing cycle.
- 3.61 **INDIRECT-FIRED DEVICE** - A device designed so that combustion products (flue gases) are not mixed in the device with the medium, for example, air, being heated.
- 3.62 **INTERLOCK** – A control to prove the physical state of a required condition, and to furnish that proof to the primary safety control circuit.
- 3.63 **LINER** – See Radiation Shield, 3.88.
- 3.64 **LINING** – Those interior surfaces of a combustion chamber which are exposed to combustion during use of the device.
- 3.65 **LIQUEFIED-PETROLEUM GAS** – Fuel gases, including commercial propane, predominantly propane or propylene or commercial butane, predominantly butane, isobutane, and/or butylene.
- 3.66 **LP-GAS AIR MIXTURE** – Liquefied-petroleum gases distributed at relatively low pressures and normal atmospheric temperatures which have been diluted with air to produce desired heating value and utilization characteristics.
- 3.67 **LOW FIRE HOLD INTERLOCK** – A control other than an operating or safety control or interlock, responsive to changes in temperature, to retain the burner at low fire until such time as the heating appliance has obtained the normal minimum operating temperature.
- 3.68 **MAIN BURNER FLAME-ESTABLISHING PERIOD** – The interval of time the main burner fuel safety shutoff valves are permitted to be open before the primary safety control is required to supervise the main burner flame.
- 3.69 **MANIFOLD** – The conduit of a device which supplies gas to the individual burner.

- 3.70 **NORMAL CARE** – The periodic tasks usually performed to operate and maintain an appliance, such as air, fuel, pressure, and temperature regulation, cleaning, lubrication, resetting of controls.
- 3.71 **OIL-FIRED BOILER ASSEMBLY** – A boiler assembly as defined herein equipped with one or more oil burners, and all the necessary safety controls, electrical equipment as needed, and related equipment, manufactured for assembly as a unit.
- 3.72 **ORIFICE** – The opening in a cap, spud, or other device whereby the flow of gas is limited and through which the gas is discharged to a burner.
- 3.73 **ORIFICE CAP (HOOD)** – A movable fitting having an orifice which permits adjustment of the flow of gas by the changing of its position with respect to a fixed needle or other device.
- 3.74 **ORIFICE SPUD** – A removable plug or cap containing an orifice and which permits adjustment of the flow of gas either by substitution of a spud with a different sized orifice or by the motion of a needle with respect to it.
- 3.75 **PILOT** – A flame which is utilized to ignite the fuel at the main burner or burners.
- 3.76 **PILOT FLAME-ESTABLISHING PERIOD** – The interval of time fuel is permitted to be delivered to a proved pilot before the primary safety control is required to detect pilot flame.
- 3.77 **PILOT, INTERMITTENT** – A pilot which is automatically lighted each time there is a call for heat and which burns during the entire period that the main burner is firing.
- 3.78 **PILOT, INTERRUPTED** – A pilot which is automatically lighted each time there is a call for heat. The pilot fuel is cut off automatically at the end of the main burner flame-establishing period.
- 3.79 **PILOT, PROVED** – A pilot flame supervised by a primary safety control which senses the presence of the pilot flame prior to permitting the main burner fuel to be delivered for combustion.
- 3.80 **PLENUM** – An air compartment in an air distribution system to which one or more ducts are connected.
- a) **Furnace Supply Plenum** – A furnace plenum attached directly to, or an integral part of, the supply outlet of the furnace.
 - b) **Furnace Return Plenum** – A furnace plenum attached directly to, or an integral part of, the return air inlet of the furnace.
- 3.81 **PORT** – Any opening in a burner head through which fuel or an air-fuel mixture is discharged for ignition.
- 3.82 **POST-PURGE PERIOD** – The period of time after the fuel delivered to the burner is stopped and during which the burner motor or fan continues to run to supply air to the combustion chamber.
- 3.83 **PREPURGE PERIOD** – The period of time during the burner start-up in which air is introduced into the combustion chamber and the associated flue passages in such volume and manner as to completely replace the air or fuel-air mixture contained therein prior to initiating ignition.
- 3.84 **PRIMARY AIR** – The air introduced into a burner which mixes with the fuel before it reaches the ignition zone.

3.85 PURGE – To introduce air into the combustion chamber and the device flue passages in such volume and manner as to completely replace the air or gas-air mixture contained therein.

3.86 PUMP, AUTOMATIC OIL – A pump, not an integral part of a burner, that automatically pumps oil from the supply tank and delivers the oil by gravity under a constant head to an oil-burning appliance. The pump is intended to stop pumping automatically in case of total breakage of the oil supply line between the pump and the appliance.

3.87 PUMP, OIL-TRANSFER – An oil pump, automatically or manually operated, that transfers oil through continuous piping from a supply tank to an oil-burning appliance or to an auxiliary tank, and which is not intended to stop pumping automatically in case of total breakage of the oil supply line between the pump and the appliance.

3.88 RADIATION SHIELD OR LINER – A separate panel(s) interposed between heating surfaces and adjacent objects to reduce heat transmission by radiation.

3.89 READILY ACCESSIBLE – Capable of being reached easily and quickly for operation, adjustment, and inspection.

3.90 RECIRCULATION BLOWER ASSEMBLY – A separate blower assembly provided to draw combustion flue gases from the appliance flue gas outlet. Also, see "Recirculation System, High Pressure", 3.95.

3.91 RECIRCULATION DAMPER – RECIRCULATION METERING VALVE – An automatically actuated device installed in the ductwork between the appliance flue gas outlet and the fuel burning equipment manifold to proportionally limit the amount of recirculated flue gases with respect to the main fuel input of the fuel burning equipment.

3.92 RECIRCULATION DUCTWORK – A general term for the conduit or passageway through which flue gases pass from the appliance flue gas outlet to the burning equipment.

3.93 RECIRCULATION FAN (BLOWER) INTERLOCK – A control other than an operating or safety control, responsive to changes in pressure, having a pressure range sufficient to operate at all normal operating conditions, including "cold" start, to cause a safety shutdown in the event of loss of pressure.

3.94 RECIRCULATION FLUE GAS TEMPERATURE INTERLOCK – A control other than an operating or safety control or interlock, responsive to changes in temperature, normally set higher than the maximum normal flue gas temperature to cause safety shutdown.

3.95 RECIRCULATION SYSTEM, HIGH PRESSURE – The method by which the recirculated combustion flue gases are drawn from the appliance flue gas outlet by a separate blower assembly and introduced via ductwork to a separate manifold provided as an integral part of the fuel burning equipment.

3.96 RECIRCULATION SYSTEM, LOW PRESSURE – The method by which the recirculated combustion flue gases are drawn from the appliance flue gas outlet and introduced via ductwork to the combustion air inlet of the fuel burning equipment, using only the combustion air fan for circulation.

3.97 RECIRCULATION SHUTOFF VALVE – A high temperature valve specified suitable for use at higher than the maximum flue gas temperature of the device at rated temperature and/or pressure. The valve shall be designed to permit no leakage when in the closed position.

3.98 REGULATOR, GAS-PRESSURE – A device for controlling and maintaining a uniform outlet gas pressure.

3.99 RESPONSE TIME – FLAME FAILURE – The interval between the occurrence of flame extinguishment and de-energizing the safety shutoff means.

3.100 REFRACTORY – A poured, cast or solid brick type high temperature insulating material, typically used in the installation of a burner onto an appliance.

3.101 SAFETY CONTROL – See Control, Safety, 3.33.

3.102 SAFETY SHUTDOWN (LOCKOUT) – The shutting off of all fuel and ignition energy to the device by means of a safety control or controls such that restart cannot be accomplished without a manual reset.

3.103 SECONDARY AIR – The air externally supplied to the flame at the point of combustion.

3.104 SERVICING – The periodic tasks usually performed to operate and maintain an appliance, such as air, fuel, pressure, and temperature regulation, cleaning, lubrication, and resetting of controls. Repair and replacement of parts other than those expected to be renewed periodically is not considered to be servicing. Some examples of servicing are:

- a) Cleaning or replacing nozzles, atomizers, and pilots.
- b) Setting ignition electrodes.
- c) Cleaning strainers or replacing strainer or filter element.
- d) Resetting safety control.
- e) Replacing igniter cable.

3.105 SPECIAL PARTS AND TOOLS – Those parts and tools that are not available on the open retail market.

3.106 STRAINER, PRIMARY – The strainer through which all oil first passes on way to burner, being upstream from any other strainer.

3.107 STRAINER, SECONDARY – A strainer downstream from the primary strainer, interposed in the fuel line between the primary strainer and the point at which fuel is delivered for combustion.

3.108 THERMOSTAT – An automatic control actuated by temperature change to maintain temperatures between predetermined limits.

3.109 TRIAL-FOR-IGNITION PERIOD – That period of time the main burner fuel is permitted to be delivered into the ignition zone before the main flame-sensing device is required to detect main flame.

3.110 UNIT HEATER:

- a) **Low-Static Pressure Type** – A self-contained, automatically controlled, vented fuel burning device having integral means for circulation of air, normally by a propeller fan (or fans).

Such devices may be equipped with louvers or face extensions made in accordance with the manufacturer's approved specifications.

b) High-Static Pressure Type — A self-contained, automatically controlled, vented fuel burning device having integral means for circulation of air against 0.2 inch or greater static pressure and designed for installation in the space to be heated unless they are equipped with provisions for attaching both inlet and outlet air ducts.

3.111 VALVE, BURNER-INPUT CONTROL — An automatic-control valve for regulating the input of fuel to a burner.

3.112 VALVE, LUBRICATED PLUG TYPE — A valve of the plug and barrel type designed for maintaining a lubricant between the bearing surfaces.

3.113 VALVE, MANUAL GAS SHUTOFF — A manually operated valve in a gas line for the purpose of completely turning on or shutting off the gas supply.

3.114 VALVE, MANUAL OIL SHUT-OFF — A manually operated valve in the oil line for the purpose of completely turning on or shutting off the oil supply to the burner.

3.115 VALVE, OIL CONTROL — An automatically or manually operated device consisting essentially of an oil valve for controlling the fuel supply to a burner.

a) Metering (Regulating) Valve — An oil control valve for regulating burner input.

b) Safety Valve — A normally closed valve of the ON and OFF type, without any bypass to the burner, that is actuated by a safety control or by an emergency device.

3.116 VALVE, SAFETY SHUTOFF — A valve that is automatically closed by the safety control system or by an emergency device. Such valve may be of the automatic or manually opened type.

3.117 VENTED APPLIANCE — An indirect fired appliance provided with a flue collar to accommodate a chimney connector for conveying flue gases to the outside air.

3.118 VENT CONNECTOR — The pipe which connects a gas-fired device to a gas vent or chimney.

CONSTRUCTION

4 General

Section 4 effective April 1, 1994

4.1 Fuel confining parts, or operating parts if failure of the part will allow unsafe leakage of fuel, or unsafe operation, or prevent a safety device from functioning, shall be of sufficient strength, durability, and resistance to fire to insure safe and reliable service of the parts and the assembly. Such parts shall be made of material having a melting point (solidus temperature) of not less than 950°F (510°C) and a tensile strength of not less than 10,000 psi at 400°F (204°C). Such parts shall not sag, distort, melt, oxidize, or show leakage of fuel during any of the tests specified herein.

4.2 Fuel-confining parts not conforming to 4.1 may be employed if a fusible-link valve or the equivalent is included in the assembly of the burner so as to shut off the fuel supply in the event of excessive temperature or fire in the vicinity of such parts.

4.3 A burner part intended for the handling of fluids under pressure shall withstand, without rupture, a hydrostatic pressure equivalent to five times the maximum working pressure.

4.4 A burner part intended for the handling of recirculated flue gases under pressure shall withstand, without leakage, an aerostatic pressure equivalent to three times the maximum working pressure.

4.5 Soft solder shall not be used on any fuel-handling parts if melting of the solder may allow leakage of fuel. Soft-soldered joints, where permitted, shall be made mechanically secure before soldering.

4.6 The burner shall function so as to reduce to a minimum the generation of unburned vapors, and shall not include chambers or pockets in which unburned vapors may accumulate. An oil-conveying pipe or passage shall not be exposed to such temperatures as may result in carbonization or clogging when the burner is tested in accordance with these requirements.

4.7 Electrical equipment and wiring shall be arranged so that oil or water will not drip or run on them during normal usage or from a connection required to be uncoupled for servicing the device also to avoid contact with water from humidifiers.

4.8 Attachment plugs or separable connectors shall not be used in circuits when the breaking or making of the circuit by such devices may result in operation of the equipment in a manner that involves a risk of fire, electric shock, or injury to persons.

4.9 A recirculation metering valve or damper assembly shall be constructed such that no external leakage of combustion gases is permitted in either the open or closed position when installed in a positive pressure location.

4.10 The fuel burning equipment shall be constructed such that supervised firing with operation as specified in 61.6.2 or 62.5.3, as appropriate, may be accomplished without further adjustment even when the FGR system becomes inoperative by fault (failure) or manual means. The manufacturer's instructions shall specify the method provided to secure burner operation from the FGR mode when long term firing cycles are necessary.

4.11 Joints in recirculation ducts shall be essentially gas-tight at the maximum pressure developed downstream of a recirculation blower assembly. Upstream of the recirculation blower assembly, joints in ducts shall be gas-tight as confirmed by examination of the joint construction. Any gaskets used shall be suitable for the temperatures involved.

4.12 There shall be no flow of combustion gases from the flue gas outlet to the fuel burning equipment during preignition and post-ignition purge periods.

4.13 All electrical and mechanical constructions that make up the FGR system shall be provided as part of the device shipment. Ductwork to convey recirculated flue gases may be provided by the field installer when the manufacturer's instructions provide adequate sizing and installation details.

5 Corrosion Protection

Section 5 effective April 1, 1994

5.1 Iron and steel parts shall be protected against corrosion by painting, galvanizing, plating or other equivalent means if the malfunction of such unprotected part would be likely to result in a hazardous condition.

Exception: Cast-iron parts, cast-aluminum parts and ASME coded pressure vessels are not required to be protected against corrosion.

5.2 Surfaces of the burner assembly and flue gas conveying parts that may be in contact with flue gas condensation shall be evaluated with respect to resistance to corrosion. Among the factors to be considered are material thickness and type, length of time subjected to the condensate condition and type of corrosion protection provided.

5.3 Corrosion protection shall be provided on metering valve or damper assemblies, recirculation blowers, and any duct work or piping provided as a part of the FGR system.

6 Protection of Users and Service Personnel

Section 6 effective April 1, 1994

6.1 An uninsulated high-voltage live part and a moving part that may involve a risk of injury to persons shall be located, guarded, or enclosed so as to reduce the likelihood of unintentional contact by personnel performing service functions that may have to be performed with the equipment energized.

6.2 Service functions which may have to be performed with the equipment energized include:

- a) Adjusting the setting of temperature controls with or without marked dial settings,
- b) Resetting control trip mechanism,
- c) Operating manual switches, or
- d) Adjusting air-flow dampers.

A factory set and sealed control is not considered to be adjustable.

6.3 The requirements of 6.1 are not applicable to mechanical service functions which are not normally performed with the equipment energized.

6.4 Adjustable or resettable electrical control or manual switching devices may be located or oriented with respect to uninsulated live parts, so that manipulation of the mechanism for adjustment, resetting, or operation can be accomplished in the normal direction of access if uninsulated live parts or moving parts that may involve a risk of injury to persons are:

- a) Not located in front, in the direction of access, of the mechanism, and
- b) Are not located within 6 inches (152 mm) on any side or behind the mechanism, unless guarded.


6.5 An electrical control component that may require examination, adjustment, servicing, or maintenance while energized, not including voltage measurements, shall be located and mounted with respect to other components and grounded metal parts so that it is accessible for electrical service functions without subjecting the serviceman to a risk of electric shock from adjacent uninsulated live parts or to unintentional contact from adjacent moving parts that may involve a risk of injury to persons.

6.6 Accessibility and protection from a risk of fire, electric shock, or injury to persons may be obtained by mounting the control components in an assembly so that unimpeded access is provided to each component through the access cover or panel in the outer cabinet and the cover of the control assembly enclosure with the following arrangement:

- a) The components are located with respect to the access opening in the cabinet so that the farthest component in the control assembly is not more than 14 inches (356 mm) from the plane of the access opening.
- b) Uninsulated live parts outside the control assembly projected clear space (except for live parts within a control panel) or unguarded moving parts that may involve a risk of injury to persons are located not closer than 6 inches (152 mm) from any side of the access area. The projected clear space is considered to be bounded on the sides by the projection of the smallest rectangular perimeter surrounding the outside edge of the components or control enclosure when provided. The access area is considered to be bounded on the sides by the projection of the perimeter of the access opening in the outer cabinet to the closest rectangular perimeter surrounding the outside edge of the component or control enclosure.
- c) The volume generated by the projected clear space of the control assembly to the access opening in the outer cabinet (within the access area) is completely free of obstructions, including wiring.
- d) Access to the components in the control assembly is not impeded in the direction of access by other components or by wiring in this assembly.
- e) Extractor-type fuseholders and snap switches mounted through the control assembly enclosure are to be located so that
 - 1) There is unimpeded access to these components through the access opening in the outer cabinet and
 - 2) They are not immediately adjacent to uninsulated live parts outside the control assembly enclosure, unless guarded.

Also see Figure 6.1.

Figure 6.1
Accessibility and protection

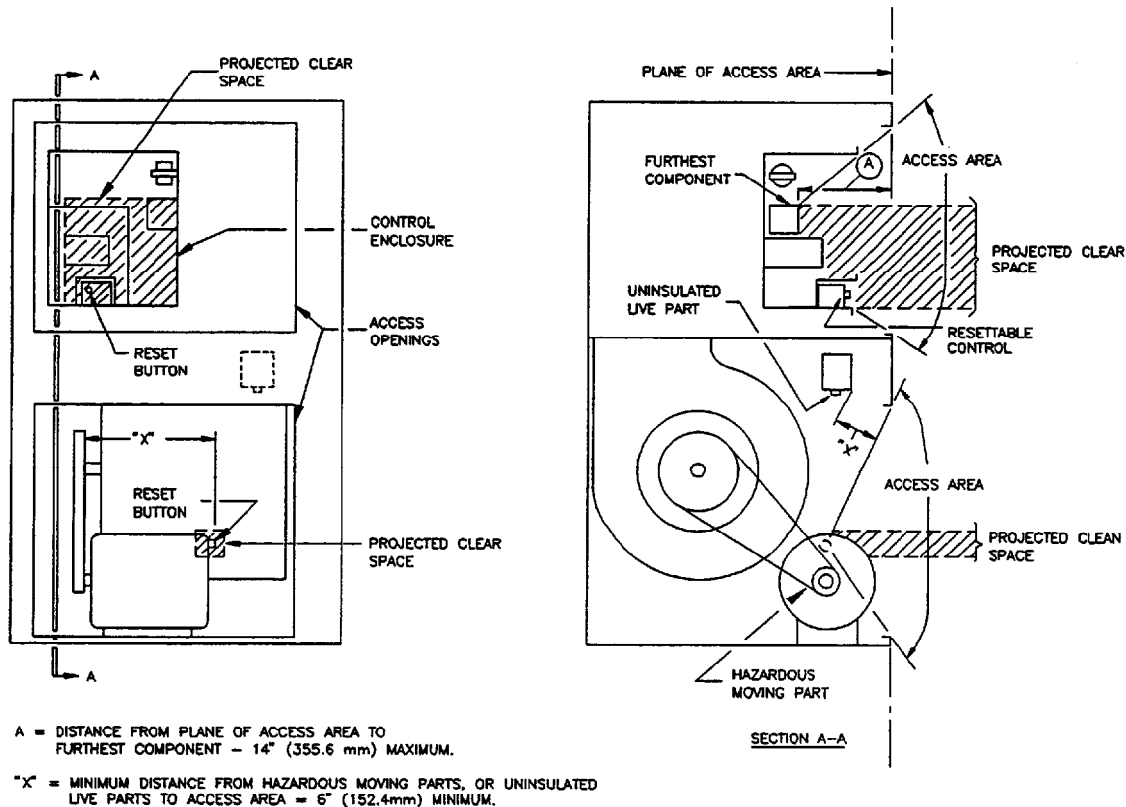

EA105

6.7 Components in a low-voltage circuit shall comply with the requirements of 6.5 in their relation to uninsulated live parts in a high-voltage circuit and to hazardous moving parts.

6.8 The following are not considered to be uninsulated live parts:

- a) Coils of controllers,
- b) Relays and solenoids,
- c) Transformer windings, if the coils and windings are provided with insulating overwraps,
- d) Enclosed motor windings,
- e) Insulated terminals and splices, and
- f) Insulated wires.

6.9 Moving parts such as fan blades, blower wheels, pulleys, belts, and the like, which may cause injury shall be enclosed or guarded. If the removal of doors, panels or shields will expose such moving parts;

- a) The opening or removal of the door, panel or shield shall require the use of tools, or
- b) An interlocking device shall shut off the mechanism, or
- c) A warning marking shall be displayed which reads essentially as follows:

DANGER – TO AVOID INJURY FROM MOVING PARTS, SHUT OFF THE (EQUIPMENT) BEFORE (REMOVING-OPENING) THIS (COVER-DOOR).

6.10 The distance from an opening in a required guard or enclosure to the moving part mentioned in 6.9 shall be in accordance with Table 6.1, but the minor dimension of the opening shall not in any case exceed 3 inches (76.2 mm). For an opening having a minor dimension intermediate between two of the values included in the table, the distance from the opening to the moving part shall be not less than that found by appropriate interpolation between the corresponding values in the right-hand column of the table. The minor dimension of the opening is determined by the largest hemispherically tipped cylindrical probe that can be inserted through the opening with a force of 5 pounds (22 N).

Table 6.1
Dimensions of openings

Minor dimensions of opening.		Minimum distance from opening to moving part.	
Inches ^a	(mm)	Inches	(mm)
1/4	(6.4)	1/2	(12.7)
3/8	(9.5)	1-1/2	(38.1)
1/2	(12.7)	2-1/2	(63.5)
3/4	(19.1)	4-1/2	(114)
1	(25.4)	6-1/2	(165)
1-1/2	(38.1)	10-1/2	(267)
2	(50.8)	14-1/2	(369)
over 2	(over 50.8)	30	(762)

^a Openings less than 1/4 inch (6.4 mm) are not to be considered.

6.11 A moving part is not to be considered when judging compliance with 6.1 and 6.9 if the part is unlikely to be contacted through the opening because of fixed components, including baffles.

7 Enclosures

Section 7 effective April 1, 1994

7.1 General

7.1.1 Uninsulated live high-voltage parts shall be enclosed or guarded to prevent unintentional contact by persons during normal use of the appliance. This applies to such parts located in a compartment where access is required for normal care of the appliance, such as resetting controls, replacing filters, lubrication, cleaning, and the like.

7.1.2 Among the factors taken into consideration when judging the acceptability of an enclosure are:

- a) Mechanical strength,
- b) Resistance to impact,
- c) Moisture-absorptive properties,
- d) Combustibility,
- e) Resistance to corrosion, and
- f) Resistance to distortion at temperatures to which the enclosure may be subjected under conditions of normal or abnormal use.

For a nonmetallic enclosure or part of an enclosure, all these factors are considered with respect to thermal and chemical aging.

7.1.3 The enclosure shall reduce the likelihood of the emission of molten metal, burning insulation, flaming particles, or the like through openings onto combustible material, including the surface on which the equipment is mounted.

7.1.4 Where the design and location of the component and the strength and rigidity of the outer cabinet warrant, an individual enclosure of thinner metal than specified in Table 7.1 or 7.2 whichever applies, may be employed.

7.1.5 Electrical parts within the outer cabinet need not be individually enclosed if the assembly conforms with all of the following:

- a) Their design and location with respect to openings in the outer cabinet will not result in the emission of flame or molten metal through openings in the cabinet or if it can be shown that failure of the component would not result in a risk of fire.
- b) There are no openings in the bottom of the compartment in which the part is located which would permit dropping of molten metal, and the like, onto combustible material.
- c) The part is not in proximity to combustible material other than electrical insulation.
- d) The part is not located closer than 5 inches to the outer cabinet unless the thickness of sheet metal is in compliance with Table 7.1.
- e) The part is not located in an air-handling compartment.
- f) The thickness of the outer cabinet is not less than two-gage thicknesses thinner than indicated in Table 7.1 for the maximum dimensions of the cabinet enclosure.
- g) The part is not subject to unintentional contact by persons. See Protection of Users and Service Personnel, Section 6.

7.1.6 The requirements of 7.1.5 apply only to parts of high-voltage circuits as defined by 3.41.

7.1.7 All intended mounting positions of the unit are to be considered when determining if it complies with the requirement of 7.1.3.

7.1.8 Cabinet compartments housing gas piping and controls shall be ventilated.

7.1.9 Steel enclosures shall be protected against corrosion by painting, plating, or equivalent means.

7.1.10 The thickness of a sheet metal enclosure shall be as indicated in Tables 7.1 and 7.2.

Exception: If the design and location of components and the strength and rigidity of the outer cabinet warrant, an individual enclosure thinner than specified in Tables 7.1 and 7.2 may be employed.

Table 7.1
Minimum thickness of sheet metal for enclosures –
carbon steel or stainless steel

Without supporting frame ^a		With supporting frame or equivalent reinforcing ^a		Minimum thickness, inches (mm)	
Maximum width ^b , inches (cm)	Maximum length ^c , inches (cm)	Maximum width ^b , inches (cm)	Maximum length, inches (cm)	Uncoated (MSG)	Metal coated (GSG)
4.0 (10.2)	Not limited	6.25 (15.9)	Not limited	0.020 (0.51)	0.023 (0.58)
4.75 (12.1)	5.75 (14.6)	6.75 (17.1)	8.25 (21.0)	(24)	(24)
6.0 (15.2)	Not limited	9.5 (24.1)	Not limited	0.026 (0.66)	0.029 (0.74)
7.0 (17.8)	8.75 (22.2)	10.0 (25.4)	12.5 (31.8)	(22)	(22)
8.0 (20.4)	Not limited	12.0 (30.5)	Not limited	0.32 (0.81)	0.034 (0.86)
9.0 (22.9)	11.5 (29.2)	13.0 (33.0)	16.0 (40.6)	(20)	(20)
12.5 (31.8)	Not limited	19.5 (49.5)	Not limited	0.042 (1.07)	0.045 (1.14)
14.0 (35.6)	18.0 (45.7)	21.0 (53.3)	25.0 (63.5)	(18)	(18)
18.0 (45.7)	Not limited	27.0 (68.6)	Not limited	0.053 (1.34)	0.056 (1.42)
20.0 (50.8)	25.0 (63.5)	29.0 (73.7)	36.0 (91.4)	(16)	(16)
22.0 (55.9)	Not limited	33.0 (83.8)	Not limited	0.060 (1.53)	0.063 (1.61)
25.0 (63.5)	31.0 (78.7)	35.0 (89.0)	43.0 (109.2)	(15)	(15)
25.0 (63.4)	Not limited	39.0 (99.1)	Not limited	0.067 (1.70)	0.070 (1.78)
29.0 (73.7)	36.0 (91.4)	41.0 (104.1)	51.0 (129.5)	(14)	(14)
33.0 (83.8)	Not limited	51.0 (129.5)	Not limited	0.080 (2.04)	0.084 (2.13)
35.0 (89.0)	47.0 (119.4)	54.0 (137.1)	66.0 (167.6)	(13)	(13)
42.0 (106.7)	Not limited	64.0 (162.6)	Not limited	0.093 (2.36)	0.097 (2.46)
42.0 (119.4)	59.0 (149.9)	68.0 (172.7)	84.0 (213.4)	(12)	(12)
52.0 (135.1)	Not limited	80.0 (203.2)	Not limited	0.108 (2.74)	0.111 (2.80)
60.0 (152.4)	74.0 (188.0)	84.0 (213.4)	103.0 (261.6)	(11)	(11)
63.0 (160.0)	Not limited	97.0 (246.4)	Not limited	0.123 (3.12)	0.126 (3.20)
73.0 (185.4)	90.0 (228.6)	103.0 (261.6)	127.0 (322.6)	(10)	(10)

^a A supporting frame is a structure of angle or channel or a folded rigid section of sheet metal which is rigidly attached to and has essentially the same outside dimensions as the enclosure surface and which has sufficient torsional rigidity to resist the bending moments which may be applied via the enclosure surface when it is deflected. Construction that is considered to have equivalent reinforcing may be accomplished by designs that will produce a structure which is a rigid as one built with a frame of angles or channels. Construction considered to be without supporting frame includes: (1) single sheet with single formed flanges (formed edges), (2) a single sheet which is corrugated or ribbed, and (3) an enclosure surface loosely attached to a frame, for example, with spring clips.

^b The width is the smaller dimension of a rectangular sheet metal piece which is part of an enclosure. Adjacent surfaces of an enclosure may have supports in common and be made of a single sheet.

^c For panels which are not supported along one side, e.g., side panels of boxes, the length of the unsupported side shall be lifted to the dimensions specified unless the side in question is provided with a flange at least 1/2 inch (12.7 mm) wide.

Table 7.2
Minimum thickness of sheet metal for enclosures —
aluminum, copper, or brass

Without supporting frame ^a		With supporting frame or equivalent reinforcing ^a		Minimum thickness, Inches (mm) (AWG)
Maximum width ^b , Inches (cm)	Maximum length ^c , Inches (cm)	Maximum width ^b , Inches (cm)	Maximum length, Inches (cm)	
3.0 (7.6)	Not limited	7.0 (17.8)	Not limited	0.023 (0.58)
3.5 (8.9)	4.0 (10.2)	8.5 (21.6)	9.5 (24.1)	(22)
4.0 (10.2)	Not limited	10.0 (25.4)	Not limited	0.029 (0.74)
5.0 (12.7)	6.0 (15.2)	10.5 (26.7)	13.5 (34.3)	(20)
6.0 (15.2)	Not limited	14.0 (35.6)	Not limited	0.036 (0.91)
6.5 (16.5)	8.0 (20.3)	15.0 (38.1)	18.0 (45.7)	(18)
8.0 (20.3)	Not limited	19.0 (48.3)	Not limited	0.045 (1.14)
9.5 (24.1)	11.5 (29.2)	21.0 (53.3)	25.0 (63.5)	(16)
12.0 (30.5)	Not limited	28.0 (71.1)	Not limited	0.058 (1.47)
14.0 (35.6)	16.0 (40.6)	30.0 (76.2)	37.0 (94.0)	(14)
18.0 (45.7)	Not limited	42.0 (106.7)	Not limited	0.075 (1.91)
20.0 (50.8)	25.0 (63.4)	45.0 (114.3)	55.0 (139.7)	(12)
25.0 (63.4)	Not limited	60.0 (152.4)	Not limited	0.095 (2.41)
29.0 (73.7)	36.0 (91.4)	64.0 (162.6)	78.0 (198.1)	(10)
37.0 (94.0)	Not limited	87.0 (221.0)	Not limited	0.122 (3.10)
42.0 (106.7)	53.0 (134.6)	93.0 (236.2)	114.0 (289.6)	(8)
52.0 (132.1)	Not limited	123.0 (312.4)	Not limited	0.153 (3.89)
60.0 (152.4)	74.0 (188.0)	130.0 (330.2)	160.0 (406.4)	(6)

^a A supporting frame is a structure of angle or channel or a folded rigid section of sheet metal which is rigidly attached to and has essentially the same outside dimensions as the enclosure surface and which has sufficient torsional rigidity to resist the bending moments which may be applied via the enclosure surface when it is deflected. Construction that is considered to have equivalent reinforcing may be accomplished by designs that will produce a structure which is as rigid as one built with a frame of angles or channels. Construction considered to be without supporting frame includes: (1) single sheet with single formed flanges (formed edges), (2) a single sheet which is corrugated or ribbed, and (3) an enclosure surface loosely attached to a frame, such as, with spring clips.

^b The width is the smaller dimension of a rectangular sheet metal piece which is part of an enclosure. Adjacent surfaces of an enclosure may have supports in common and be made of a single sheet.

^c For panels which are not supported along one side, for example, side panels of boxes, the length of the unsupported side shall be limited to the dimensions specified unless the side in question is provided with a flange at least 1/2 inch (12.7 mm) wide.

7.1.11 Sheet metal to which a wiring system is to be connected in the field shall have a thickness not less than 0.032 inch (0.81 mm) (No. 20 MSG) if uncoated steel, not less than 0.034 inch (0.86 mm) (No. 20 GSG) if galvanized steel, and not less than 0.045 inch (1.14 mm) if nonferrous.

7.1.12 If insulating material other than electrical insulation is provided within the enclosure, consideration is given to the burning characteristics and combustibility of the material and the proximity of an ignition source.

7.1.13 Terminal housings of motors, to which connections are to be made in the field, shall be of metal and shall be sized in accordance with the National Electrical Code, ANSI/NFPA 70-1990.

7.1.14 A junction box partially formed by another part such as a fan scroll or a motor casing is to fit such that:

- a) An opening between the box and motor frame having a dimension exceeding 1/2 inch (12.7 mm) does not permit a flat feeler gauge, 5/64- by 1/2-inch (2.0 by 12.7 mm) wide to enter, and
- b) An opening between the box and motor frame having no dimension exceeding 1/2 inch (12.7 mm) does not permit the entrance of a 13/64 inch (5.2 mm) diameter rod.

7.1.15 The criteria for judging an opening in an electrical enclosure are given in the following items and the related figures:

- a) An opening that will not permit entrance of a 3/4 inch (19.1 mm) diameter rod is acceptable if:
 - 1) A probe, as illustrated in Figure 7.1, cannot be made to touch any uninsulated live part when inserted through the opening, and
 - 2) A probe, as illustrated in Figure 7.2, cannot be made to touch enamel insulated wire when inserted through the opening.
- b) An opening that will permit entrance of a 3/4 inch diameter rod is acceptable under the conditions described in Figure 7.3.

7.1.16 During the examination for conformance with the requirements in 7.1.15, a part of the enclosure, which may be removed with the use of tools is to be removed.

7.2 Accessibility of uninsulated live parts and film-coated wire — general

7.2.1 During the examination of a product to determine whether it complies with the requirements concerning accessibility of uninsulated live parts and film-coated wire:

- a) A part of the enclosure that may be opened or removed by the user without using a tool, (to attach an accessory, to make an operating adjustment, or for other reasons) is to be opened or removed;
- b) Insulated brush caps are not required to be additionally enclosed;
- c) The probes shall be applied to any depth that the opening will permit; and shall be rotated or angled before, during, and after insertion through the opening to any position that is necessary to examine the enclosure; and
- d) The probes shall be used as measuring instruments to judge the accessibility provided by an opening, and not as instruments to judge the strength of a material; they shall be applied with the minimum force necessary to determine accessibility.

7.2.2 The criteria for judging an opening in an electrical enclosure are given in (a) – (b) and the related figures:

- a) An opening that will not permit entrance of a 3/4 inch (19.1 mm) diameter rod is acceptable if:
- 1) A probe as illustrated in Figure 7.1 cannot be made to touch any uninsulated live part when inserted through the opening, and
 - 2) A probe as illustrated in Figure 7.2 cannot be made to touch film-coated wire when inserted through the opening.
- b) An opening that will permit entrance of a 3/4 inch (19.1 mm) diameter rod is acceptable under the conditions described in Figure 7.3.



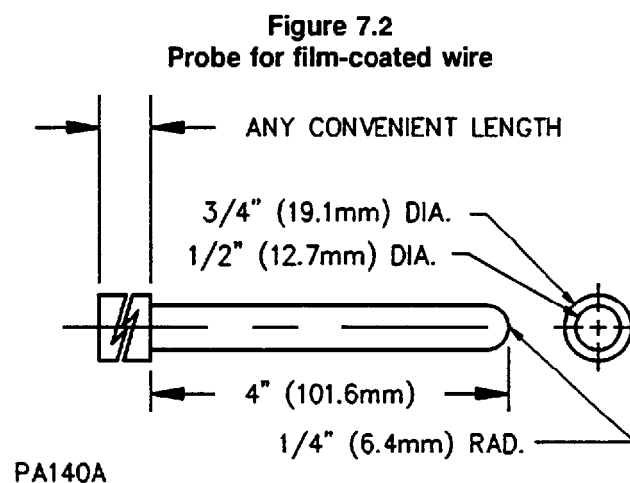


Figure 7.3
Opening in enclosure

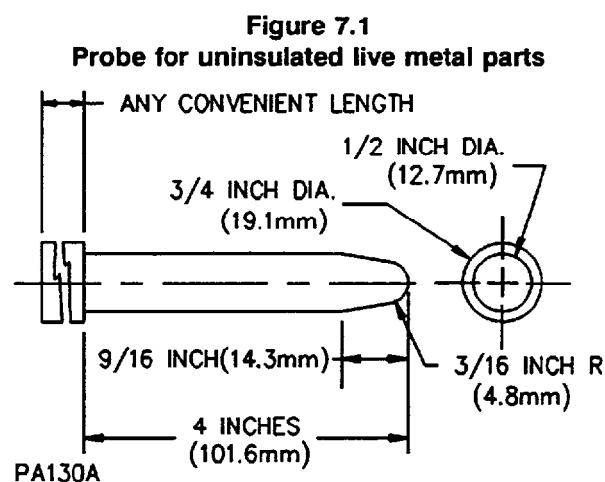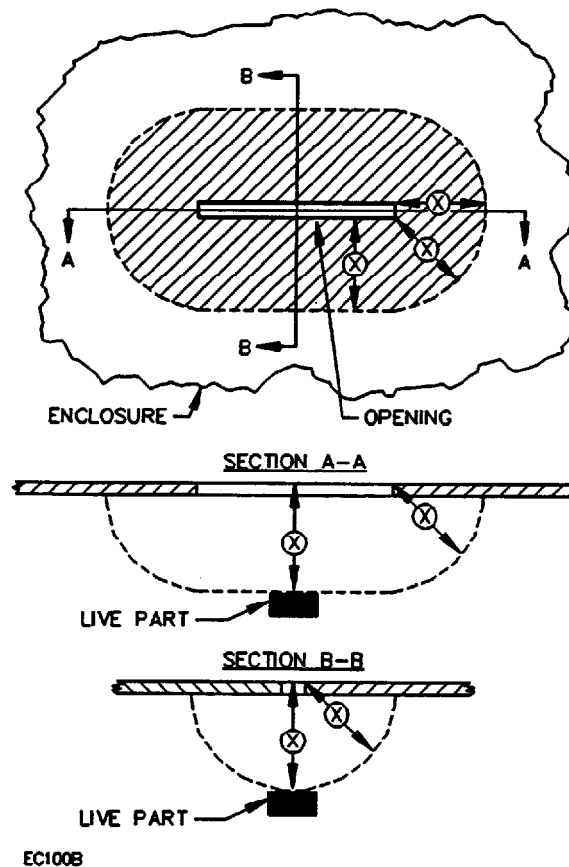

The opening is acceptable if, within the enclosure, there is no uninsulated live part or enamel-insulated wire:

- a) Less than X inches (mm) from the perimeter of the opening, as well as
- b) Within the volume generated by projecting the perimeter X inches (mm) normal to its plane. X equals five times the diameter of the largest diameter rod which can be inserted through the opening, but not less than 4 inches (102 mm).

7.3 Doors and covers

7.3.1 A cover or access panel of an enclosure for uninsulated live parts shall be provided with means for securing it in place.

7.3.2 A hinged or pivoted panel or cover shall be positioned or arranged so that it is not subject to falling or swinging due to gravity or normal vibration in such a manner as to cause injury to persons by the panel or cover, or by hazardous moving parts or uninsulated live parts.

7.3.3 The assembly incorporating overcurrent protective devices shall be arranged so that fuses can be replaced and manual-reset devices can be reset, as applicable, without removing parts other than a service cover or panel and a cover or door enclosing the device. See 7.3.7.

7.3.4 A required protective device shall be wholly inaccessible from outside the assembly without opening a door or cover, except that the operating handle of a circuit breaker, the operating button of a manually operable motor protector, the reset button of a manually resettable pressure switch, and similar parts may project outside the boiler assembly enclosure.

7.3.5 An opening in an enclosure to provide clearance around a dial, knob, lever, or handle shall not allow the entrance of a rod having a diameter of 9/64 inch (3.6 mm) at any setting or position of the dial, knob, lever, or handle.

7.3.6 A fuseholder shall be so constructed, installed, or protected that adjacent uninsulated high-voltage live parts within 4 inches (102 mm), other than the screw shell of a plug fuseholder, cartridge fuse clips, or wiring terminals to the fuseholder, will not be exposed to contact by persons removing or replacing fuses. An insulating barrier of vulcanized fiber or equivalent material employed for this purpose shall be not less than 0.028 inch (0.71 mm) in thickness.

7.3.7 The door or cover of an enclosure shall be hinged if it gives access to fuses or any motor overload protective device, the normal functioning of which requires renewal, or if it is necessary to open the cover in connection with the normal operation of the protective device such as resetting a manual reset overload protective device.

Exception: A hinged cover is not required for a device in which the only fuses enclosed are:

- a) Control-circuit fuses of 2 amperes or less, provided the fuses and control-circuit loads, other than a fixed control-circuit load, such as pilot lamp, are within the same enclosure, or,*
- b) Extractor-type fuses each with its own enclosure, or*
- c) Fuses in low-voltage circuits.*

7.3.8 Hinged covers, where required, shall not depend solely upon screws or other similar means requiring the use of tools to hold them closed, but shall be provided with a catch or spring latch.

7.3.9 A spring latch, a magnetic latch, a dimple or any other mechanical arrangement that will hold the door in place and would require some effort on the user's part to open, is an acceptable means for holding the door in place as required in 7.3.8.

7.3.10 A door or cover giving direct access to fuses in other than low-voltage circuits shall shut closely against a 1/4 inch (6.4 mm) rabbet or the equivalent, or shall have either turned flanges for the full length of four edges or angle strips fastened to it. Flanges or angle strips shall fit closely with the outside of the wall of the box proper and shall overlap the edges of the box not less than 1/2 inch (12.7 mm). A construction which affords equivalent protection, such as a fuse enclosure within an outer enclosure, or a combination of flange and rabbet, is acceptable.

7.3.11 Strips used to provide rabbets, or angle strips fastened to the edges of a door, shall be secured at not less than two points, not more than 1-1/2 inches (41.1 mm) from each end of each strip and at points between these end fastenings not more than 6 inches (152 mm) apart.

7.3.12 A plate or plug for an unused conduit opening or other hole in the enclosure shall have a thickness not less than:

- a) 0.014 inch (0.36 mm) for steel or 0.019 inch (0.48 mm) for nonferrous metal for a hole having a 1/4 inch (6.4 mm) maximum dimensions, and
- b) 0.027 inch (0.68 mm) for steel or 0.032 inch (0.81 mm) for nonferrous metal for a hole having a 1-3/8 inch (34.9 mm) maximum dimensions.

A closure for a larger hole shall have a thickness equal to that required for the enclosure of the device or a standard knockout seal shall be used. Such plates or plugs shall be securely mounted.

7.3.13 An electron tube or similar glass-enclosed device shall be protected against mechanical damage.

7.4 Field wiring system connection

7.4.1 If threads for the connection of conduit are tapped all the way through a hole in an enclosure wall, or if an equivalent construction is employed, there shall be not less than three nor more than five threads in the metal, and the construction of the device shall be such that a conduit bushing can be attached.

7.4.2 If threads for the connection of conduit are not tapped all the way through a hole in an enclosure wall, conduit hub, or the like, there shall be not less than 3-1/2 threads in the metal and there shall be a smooth, rounded inlet hole for the conductors which shall afford protection to the conductors equivalent to that provided by a standard conduit bushing and which shall have an internal diameter approximately the same as that of the corresponding trade size of rigid conduit.

7.4.3 An enclosure threaded for support by rigid conduit shall provide at least five full threads for engaging with the conduit.

7.4.4 A knockout in a sheet metal enclosure shall be capable of being removed without undue deformation of the enclosure.

7.4.5 A knockout shall be provided with a flat surrounding surface for seating of a conduit bushing, and shall be so located that installation of a bushing at any knockout likely to be used during installation will not result in spacings between uninsulated live parts and the bushing of less than those required.

8 Field Wiring

Section 8 effective April 1, 1994

8.1 General

8.1.1 Provision shall be made for connection of a wiring system that would be suitable for power supply in accordance with the National Electrical Code, ANSI/NFPA 70-1990.

8.1.2 The location of an outlet box or compartment in which field wiring connections are to be made shall be such that these connections may be inspected after the equipment is installed as intended.

8.1.3 The connections shall be accessible without removing parts other than a service cover or panel and the cover of the outlet box or compartment in which the connections are made. A component intended for use as the cover of an outlet box or compartment may serve as a cover.

8.1.4 The size of a junction box in which field-installed conductors are to be connected by splicing shall be not less than that indicated in Table 8.1. A conductor passing through the box is counted as one conductor, and each conductor terminating in the box is also counted as one conductor. A field-furnished conductor for high-voltage circuits is considered to be not smaller than No. 14 AWG (2.1 mm²).

Table 8.1
Size of junction boxes

Size of conductor AWG (mm²)	Free space within box for each conductor, cubic inches (cm³)
16 or smaller (1.3 or less)	1.5 (24.6)
14 (2.1)	2.0 (32.8)
12 (3.3)	2.25 (36.9)
10 (5.3)	2.5 (41.0)
8 (8.3)	3.0 (49.2)

8.1.5 A knockout for connection of a field wiring system to a terminal box or compartment shall accommodate conduit of the trade size determined by applying Table 8.2.

Table 8.2
Trade size of conduit in inches^a

Wire size		Number of wires				
AWG	(mm ²)	2	3	4	5	6
14	(2.1)	1/2	1/2	1/2	1/2	1/2
12	(3.3)	1/2	1/2	1/2	3/4	3/4
10	(5.3)	1/2	1/2	1/2	3/4	3/4
8	(8.4)	3/4	3/4	1	1	1-1/4
6	(13.3)	3/4	1	1	1-1/4	1-1/4
4	(21.2)	1	1	1-1/4	1-1/4	1-1/2
3	(26.7)	1	1-1/4	1-1/4	1-1/2	1-1/2
2	(33.6)	1	1-1/4	1-1/4	1-1/2	2
1	(42.4)	1-1/4	1-1/4	1-1/2	2	2
0	(53.5)	1-1/4	1-1/2	2	2	2-1/2
2/0	(67.4)	1-1/2	1-1/2	2	2	2-1/2
3/0	(85.0)	1-1/2	2	2	2-1/2	2-1/2
4/0	(107.2)	2	2	2-1/2	2-1/2	3

^a This table is based on the assumption that all conductors will be of the same size and there will be no more than six conductors in the conduit. If more than six conductors will be involved or if all of them are not of the same size, the internal cross-sectional area of the smallest conduit that may be used is determined by multiplying by 2.5 the total cross-sectional area of the wires, based on the cross-sectional area of type THW wire.

8.1.6 Wiring exterior to an appliance assembly between the burner assembly and a limit control, a primary safety control, or a motor controller, that can be done readily with a wire enclosed in conduit or with metal-clad cable in accordance with the National Electrical Code, ANSI/NFPA 70-1990, need not be furnished by the manufacturer as part of the boiler assembly if adequate instructions for installing such wiring are furnished with each boiler assembly. See 9.1.4.

8.1.7 A box or enclosure, included as part of the assembly and in which a branch circuit supplying power to the boiler assembly is to be connected, shall not require that it be moved for normal care of the unit. This requirement does not apply to separate limit controls and stack switches, where permitted, to which metal-clad cable or flexible metallic conduit is to be directly attached.

8.1.8 A box or enclosure in which field installed conductors are to be connected as indicated in 8.1.5, 8.1.6, 8.1.7, and 8.1.9 shall be so located that the temperature of conductors within the box or surfaces of the box likely to be in contact with the conductors will not exceed that specified for a wire having a 140°F (60°C) temperature rating when the assembly is tested in accordance with these requirements.

8.1.9 Except as otherwise permitted by 15.3.1, wiring to be done in the field between the assembly and devices not attached to the boiler assembly or between separate devices which are field installed and located, shall conform to these requirements if done with a 140°F (60°C) rated wire enclosed in suitable conduit or metal-clad cable.

8.1.10 The wiring of the appliance may terminate in a length of flexible metal conduit with an outlet box, control box, or equivalent enclosure intended for connection of the product to the wiring system specified in 8.1.1. If the conduit terminates in an outlet box larger than 4 by 4 by 2 inches (102 by 102 by 51 mm) for splice connection, locknuts on the fittings are not acceptable as a means to prevent loosening of the conduit fittings. A grounding conductor of the size specified in the National Electrical Code, ANSI/NFPA 70-1990, shall be included unless:

- a) The total length of flexible metal conduit of any ground return path in the product is not more than 6 feet (1.83 m);
- b) No circuit conductor protected by an overcurrent-protective device rated at more than 20 amperes is included; and
- c) The conduit is no larger than 3/4 inch trade size, or the fittings for the conduit are identified as providing grounding.

8.2 Leads and terminals

8.2.1 Wiring terminals or leads not less than 6 inches (152 mm) long for connection of field-wiring conductors of at least the size required by the National Electrical Code, ANSI/NFPA 70-1990, corresponding to the marked rating of the assembly shall be provided.

8.2.2 Leads may be less than 6 inches (152 mm) in length if it is evident that the use of a longer lead might result in a risk of fire, electric shock, or injury to persons.

8.2.3 Leads intended for connection to an external circuit shall be provided with strain relief if stress on the lead may be transmitted to terminals, splices, or internal wiring which may cause the lead to separate from its termination or result in damage to the lead from sharp edges. Each lead shall be capable of withstanding a pull of 10 pounds (44.5 N) for 1 minute without damage to the assembly.

8.2.4 An identified (grounded) terminal or lead shall not be electrically connected to a single-pole manual switching device which has an OFF position or to a single-pole overcurrent (not thermal) protective device.

8.2.5 At terminals, stranded conductors shall be prevented from contacting other uninsulated live parts and from contacting dead metal parts. This may be accomplished by use of pressure-terminal connectors, soldering lugs, crimped eyelets, soldering all strands of the wire together, or equivalent means. An open slot-type connector shall not be used unless it is constructed to reduce the likelihood of disconnection resulting from loosening of the clamping means. The shanks of terminal connectors shall be protected by insulating tubing, or the equivalent, if the required spacings may be reduced as a result of loosening of the clamping means. The thickness of the insulation on the shanks shall be not less than 0.028 inch (0.71 mm).

8.2.6 Field wiring terminals shall be secured to their supporting surfaces by methods other than friction between surfaces so that they will be prevented from turning or shifting in position if such motion may result in reduction of spacings to less than those required. This may be accomplished by two screws or rivets; by square shoulders or mortices; by a dowel pin, lug, or offset; by a connecting strap or clip fitted into an adjacent part; or by some other equivalent means.

8.2.7 Conductors intended for connection to a grounded neutral line shall be identified, that is, finished a white or natural gray color. All other current-carrying conductors visible to the installer shall be finished in colors other than white, natural gray, or green. A terminal for connection of a grounded conductor shall be identified by a metallic-plated coating, substantially white in color and shall be readily distinguishable from other terminals, or it shall be identified in some other manner, such as on an attached wiring diagram.

8.2.8 Leads provided for spliced connections to an external high-voltage circuit shall not be connected to wire-binding screws or pressure terminal connectors, located in the same compartment as the splice or visible to the installer, unless the screws or connectors are rendered unusable for field wiring connections or the leads are insulated at the unconnected ends.

8.2.9 Terminal parts by which field-wiring connections are made shall consist of soldering lugs or pressure terminal connectors secured in place in accordance with the requirements in 8.2.5, except that for No. 10 AWG (5.3 mm²) and smaller wires, the parts to which wiring connections are made may consist of clamps or wire binding screws with cupped washers, terminal plates having upturned lugs, or the equivalent, to hold the wire in position.

8.2.10 A wire binding screw at a high-voltage wiring terminal for field connection shall not be smaller than No. 10 (4.8 mm major diameter).

Exception No. 1: A No. 8 (4.2 mm major diameter) screw may be used for the connection of a conductor not larger than No. 14 AWG (2.1 mm²).

Exception No. 2: A No. 6 (3.5 mm major diameter) screw may be used for the connection of a No. 16 or No. 18 AWG (1.3 or 0.82 mm²) control-circuit conductor.

8.2.11 A terminal plate for a wire binding screw shall be of metal not less than 0.030 inch (0.76 mm) in thickness for a No. 14 AWG (2.1 mm²) or smaller wire, and not less than 0.050 inch (1.27 mm) in thickness for a wire larger than No. 14 AWG (2.1 mm²); and in either case there shall be not less than two full threads in the metal.

8.2.12 A terminal plate formed from stock having the minimum required thickness may have the metal extruded at the tapped hole for the binding screw so as to provide two full threads.

8.2.13 A wire binding screw shall thread into metal.

9 Internal Wiring

Section 9 effective April 1, 1994

9.1 General

9.1.1 The wiring of high-voltage circuits shall conform to the requirements in this section.

9.1.2 Wiring shall be done with insulated conductors having current carrying capacity, voltage, and temperature ratings consistent with their use. A conductor, other than an integral part of a component, shall be not smaller than No. 18 AWG (0.82 mm²).

9.1.3 Except as indicated in 9.2.2, the wiring for each device assembly circuit shall be furnished by the manufacturer as part of the boiler assembly. If the boiler assembly is not assembled and wired at the factory, such wiring shall be furnished as harness with each boiler and be arranged to facilitate attachment when the boiler is assembled; and a pictorial diagram showing the exact arrangement of the wiring shall be included with each boiler assembly.

9.1.4 If insulated conductors rated for use at temperatures in excess of 140°F (60°C) are required, such wiring shall be furnished as part of the assembly and the devices to be connected by such wiring shall be factory-located on the equipment.

9.2 Methods

9.2.1 Electrical wiring to a part which must be moved for normal maintenance and servicing shall be arranged so that the part may be moved without breaking soldered connections or disconnecting conduit. Conductors to be disconnected from terminals of such part shall terminate in eyelets or connectors. If the wiring to a part which functions also as an access plate or cover, that is, a transformer closing the access to the nozzle assembly, is not readily detachable, the assembly shall include provision for support of that part by means other than the wiring when the part is moved for servicing. Any allowable movement of such part shall not unduly twist, bend, or pull the wiring.

9.2.2 Conductors shall be enclosed within conduit, electrical metallic tubing, metal raceway, electrical enclosure, or metal-clad cable, except as permitted by 9.2.15.

Exception: Factory wiring involving a potential of not more than 300 volts between parts attached to the same assembly with a predetermined fixed relationship one to the other may be done with Type SO or ST cord, provided all of the following conditions are fulfilled.

- a) *It is not practical to do the wiring in accordance with 9.2.2.*
- b) *The cord is not required to be bent, twisted, or otherwise displaced to render normal maintenance and service.*
- c) *The length of cord exterior to the assembly is not more than 4 inches (102 mm) and strain relief is provided.*

9.2.3 Group A of Table 9.1 includes some wiring materials suitable for use if enclosed as indicated in 9.2.2.

Table 9.1
Typical wiring materials

Group	Type of wire, cord, cable, or appliance wiring material with insulation thickness shown at the right corresponding to wire sizes indicated	Wire size		Insulation thickness	
		No. AWG	mm ²	Inch	mm
A	FFH-2, TF, TFF, TFN, TFFN, SF-2, SFF-2, RH, RHH, RHW, T, THW, XHHW, MTW, THWN, TW, PF, PFF, PGF, PGFF, RFH-2, RFHH-2, RFHH-3 or thermoplastic appliance wiring material.	10 and smaller	5.3	2/64	0.8
		8	8.3	3/64	1.2
		6	13.3	4/64	1.6
		4	21.2	4/64	1.6
		3	25.7	4/64	1.6
		2	33.6	4/64	1.6
		1	42.4	5/64	2.0
		1/0	53.5	5/64	2.0
		2/0	67.4	5/64	2.0
		3/0	85.0	5/64	2.0
	4/0	107.0	5/64	2.0	
B	SO, ST, SJO, SJT, S, SE, SJ, SJO, SJTO, SJTOO, SOO, STO, STOO, or appliance wiring material with thermoplastic or neoprene insulation	18	0.82	4/64	1.8
		16	1.3	4/64	1.6
		14	2.1	5/64	2.0
		12	3.3	5/64	2.0
		10	5.3	5/64	2.0
		8	8.3	6/64	2.4
		6	13.3	8/64	3.2
Thermoplastic wiring materials, as referenced in group A, with insulation thickness of 2/64 inch (0.8 mm) for No. 16 or 18 AWG (1.3 or 0.82 mm ²) and 3/64 inch (1.2 mm) for No. 14, 12, 10, or 8 AWG (2.1, 3.3, 5.3, or 8.3 mm ²), are considered equivalent to the wiring material referenced in group B, when the conductors are covered with 1/32 inch (0.8 mm) wall thickness thermoplastic insulating tubing of a type suitable for the purpose from the standpoint of dielectric properties, heat resistance, moisture-resistance, flammability, and the like.					

9.2.4 Flexible metal conduit, if used, shall be not smaller than 3/8 inch (9.5 mm) electrical trade size. This does not apply to parts of components, such as conduit protecting flame sensor leads. See 2.4.1.

9.2.5 Flexible metal conduit shall be mechanically secured at intervals not exceeding 4-1/2 feet (1.37 m) and within 12 inches (305 mm) on each side of every junction box except for lengths not over 36 inches (914 mm) where flexibility is necessary.

9.2.6 All splices and connections shall be mechanically secure and bonded electrically. A soldered connection shall be made mechanically secure before being soldered if breaking or loosening of the connection may result in risk of fire, electric shock, or injury to persons.

9.2.7 A splice shall be provided with insulation equivalent to that required for the wires involved if permanence of spacing between the splice and other metal parts is not ensured.

9.2.8 A splicing device, such as a fixture-type splicing connector, pressure wire connector, and the like, may be employed if the device has insulation suitable for the voltage to which it is subjected. Thermoplastic tape wrapped over a sharp edge is not acceptable.

9.2.9 Each splice shall be enclosed by being installed in a junction box, control box, or other compartment in which high-voltage wiring materials may be employed.

9.2.10 Splices shall be located, enclosed, and supported so that they are not subject to damage, flexing, motion, or vibration.

9.2.11 A splice is considered to be adequately enclosed when installed in a junction box, control box, or other enclosed compartment in which wiring materials, as specified in Group A of Table 9.1, may be employed. Splices in enclosed machinery compartments are to be secured to a fixed member in the compartment so that they are not subject to movement or damage during servicing.

9.2.12 At all points where conduit or metal tubing terminates, the conductor shall be protected from abrasion. If metal-clad cable is used, an insulating bushing or its equivalent shall be provided between the conductors and the metal cladding, and the connector or clamp shall be of such design that the insulating bushing or its equivalent will be visible for inspection.

9.2.13 A wireway shall be such that the interconnection of sections and fittings will provide a rigid mechanical assembly and ensure electrical conductivity. The interior of the wireway shall be free from burrs and sharp corners or edges which might cause damage to the insulation on wires.

9.2.14 All wiring shall be supported and routed to prevent damage due to sharp edges or moving parts.

9.2.15 Cords or appliance wiring material as referenced in Group B of Table 9.1 may be employed if the wiring is enclosed by a casing or compartment conforming to all of the following:

- a) There are no openings in the bottom, unless a U-shaped channel or trough is located under the wiring and the wires do not project through the plane of the top of the trough or channel.
- b) If the appliance is for installation only on noncombustible flooring, the bottom of such compartment may be open provided all sides of the compartment extend to the floor level.
- c) Louvers or openings in other than the bottom will not permit entrance of a rod having a diameter of 1/2 inch (12.7 mm), and openings for such items as pipe or conduit are not more than 1/2 inch in diameter larger than the object that will be installed through the opening.
- d) Openings are not closer than 6 inches (152 mm) to the wiring unless metallic barriers or baffles are placed between the wiring and the openings.
- e) Combustible material, other than electrical insulation, located within the casing or compartment is separated from such wiring material.

9.2.16 With reference to 9.2.15(e), plastic materials shall be classified as Type 94V-0, 94V-1, 94V-2, 94-5V, 94HF-1, or 94HF-2 in accordance with requirements in the Standard for Flammability of Plastic Materials for Parts in Devices and Appliances, UL 94, and other nonmetallic materials shall have equivalent characteristics.

9.2.17 Cords and other wiring material permitted in accordance with 9.2.15 shall be arranged to avoid being physically damaged, such as by closely following surfaces, and shall be supported. Strain relief, where required, shall be provided.

9.2.18 Holes in walls or partitions through which insulated wires or cords pass and on which they may bear shall be provided with smoothly rounded bushings or surfaces upon which the wires or cords may bear, to prevent abrasion of the insulation. Bushings, if required, shall be ceramic, phenolic, cold-molded composition, fiber, or equivalent material.

9.2.19 A fiber bushing shall be not less than 3/64 inch (1.2 mm) in thickness, shall be so located that it will not be exposed to moisture, and shall not be employed where it will be subjected to a temperature higher than 194°F (90°C) under normal operating conditions.

9.2.20 To provide an acceptable unbushed opening in sheet metal, not requiring a bushing, usually requires roll or extrusion of the metal around the opening, or both, or the insertion of a grommet conforming to 9.2.18.

9.3 Short-circuit protection

9.3.1 Conductors of motor circuits having two or more motors, one or more of which are thermal or overcurrent protected and wired for connection to one supply line shall withstand the conditions of a short-circuit test without creating a risk of fire or electric shock. See Short-Circuit Test, Section 26.

Exception: Conductors that conform to the following are considered acceptable without test:

- a) Conductors that have not less than one-third the ampacity of the required branch-circuit conductors, or*
- b) Conductors that are No. 18 AWG (0.82 mm²) or larger and not more than 4 feet (1.2 m) in length provided that the circuit will be protected by a fuse or HACR Type circuit breaker rated 60 amperes or less as specified on the product nameplate or provided as part of the product and acceptable for branch-circuit protection. This applies to any of the wiring materials specified in this standard, including those enclosed in raceways, or*
- c) Conductors that serve as jumper leads between controls providing the length of the leads does not exceed 3 inches (76 mm) or the conductors are located in a control panel.*

9.3.2 Factory wiring of a low-voltage safety circuit may be done with SP-2 cord having all-neoprene insulation, SPT-2 cord or appliance wiring material having neoprene, thermoplastic, or equally durable insulation of equivalent thickness, or power limited circuit cable, if such wiring is located in a cavity or compartment of an appliance and is adequately shielded from harm.

10 Separation of Circuits

Section 10 effective April 1, 1994

10.1 Unless provided with insulation for the highest voltage involved, insulated conductors of different internal wiring circuits shall be separated by barriers or shall be segregated; and shall also be so separated or segregated from uninsulated live parts connected to different circuits or opposite-polarity parts of the same circuit.

10.2 Segregation of insulated conductors may be accomplished by clamping, routing, or equivalent means which provides permanent separation from insulated or uninsulated live parts of a different circuit.

10.3 Field-installed conductors of any circuit shall be segregated or separated by barriers from:

- a) Field-installed and factory-installed conductors connected to any other circuit, unless the conductors of both circuits are insulated for the maximum voltage of either circuit.

- b) Uninsulated live parts of any other circuit.
- c) Any uninsulated live parts whose short-circuiting may permit operation of the appliance that may result in a risk of fire, electric shock, or injury to persons except that a construction in which field-installed conductors may make contact with wiring terminals is acceptable, provided that conductors having insulation at least equivalent to those referenced in group A of Table 9.1 are or will be installed when wired in accordance with the National Electrical Code, ANSI/NFPA 70-1990.

10.4 Segregation between field installed conductors and from uninsulated live parts connected to different circuits may be accomplished by arranging the location of the openings in the enclosure for the various conductors, with respect to the terminals or other uninsulated live parts, so that there is no likelihood of the intermingling of the conductors or parts of different circuits. If:

- a) The number of openings in the enclosure does not exceed the minimum required for proper wiring and if each opening is located opposite a set of terminals, it is to be assumed, for the purpose of determining compliance with 10.3, that the conductors entering each opening will be connected to the terminals opposite the opening.
- b) More than the minimum number of openings are provided, the possibility of conductors entering at points other than opposite the terminals to which they are intended to be connected and contacting insulated conductors or uninsulated live parts connected to a different circuit is to be investigated.

10.5 To determine if an appliance complies with the requirements of 10.3, it is to be wired as it would be in service and in doing a reasonable amount of slack is to be left in each conductor within the enclosure, and no more than average care is to be exercised in stowing this slack into the wiring compartment.

10.6 If a barrier is used to provide separation between the wiring of different circuits or between operating parts and field installed conductors, it shall be of metal or insulating material and shall be held in place.

10.7 A metal barrier shall have a thickness at least as great as that required by Table 7.1 or Table 7.2, whichever applies, based on the size of the barrier. A barrier of insulating material shall be not less than 0.028 inch (0.71 mm) in thickness and shall be of greater thickness if its deformation may be readily accomplished so as to defeat its purpose. Any clearance at the edges of a barrier shall be not more than 1/16 inch (1.6 mm) wide.

10.8 Openings in a barrier for the passage of conductors shall be not larger than 1/4 inch (6.4 mm) in diameter and shall not exceed in number, on the basis of one opening per conductor, the number of wires which will need to pass through the barrier. The closure for any other opening shall present a smooth surface wherever an insulated wire may be in contact with it; and the area of any such opening, with the closure removed, shall not be larger than required for the passage of the necessary wires.

10.9 The output of a transformer device supplying a circuit classified as a Class 2 low-voltage circuit and provided as a part of the equipment shall not be interconnected with the output of another such transformer device unless the voltage and current measurements at the output terminals of the interconnected devices are within the values for a single Class 2, 30 volt, or less, transformer device.

10.10 Two or more transformer devices supplying circuits classified as Class 2, low-voltage circuits provided as a part of the appliance shall be treated as two separate circuits each having its own separate wiring compartment, and the output of each circuit shall be marked to warn that the separation shall be maintained.

ELECTRICAL COMPONENTS

11 Bonding for Grounding

Section 11 effective April 1, 1994

11.1 Exposed or accessible noncurrent carrying metal parts which may become energized, and which may be contacted by the user or by service personnel during service operations likely to be performed when the appliance is energized, shall be electrically connected to the point of connection of an equipment ground.

11.2 Except as indicated in 11.3, uninsulated metal parts of cabinets, electrical enclosures, motor frames and mounting brackets, controller mounting brackets, capacitors and other electrical components, interconnecting tubing and piping valves, and the like, are to be bonded for grounding if they may be contacted by the user or serviceman.

11.3 Metal parts, as described below, need not be grounded:

- a) Adhesive-attached metal-foil markings, screws, handles, etc., which are located on the outside of enclosures or cabinets and isolated from electrical components or wiring by grounded metal parts.
- b) Isolated metal parts, such as magnet frames and armatures, small assembly screws, and the, which are separated from wiring and uninsulated live parts.
- c) Panels and covers which do not enclose uninsulated live parts if insulated parts and wiring are separated from the panel or cover.
- d) Panels and covers which are insulated from electrical components and wiring by an attached insulating barrier of vulcanized fiber, varnished cloth, phenolic composition, or similar material not less than 1/32 inch (0.8 mm) thick.

11.4 A component, such as a switch, likely to become separated from its normal grounding means for purposes of testing or adjustment while the equipment is energized, is to be provided with a grounding conductor not requiring removal for such service.

11.5 Splices shall not be employed in wire conductors used for bonding.

11.6 Metal-to-metal hinge bearing members may be considered as a means for bonding a door for grounding.

11.7 A separate bonding conductor shall be of material rated for use as an electrical conductor. Ferrous metal parts in the grounding path shall be protected against corrosion by enameling, galvanizing, plating, or equivalent means. A separate bonding conductor or strap shall:

- a) Be protected from mechanical damage, such as by being located within the confines of the outer enclosure or frame, and
- b) Not be secured by a removable fastener used for any purpose other than bonding for grounding unless the bonding conductor is unlikely to be omitted after removal and replacement of the fastener.

11.8 The bonding shall be by a positive means, such as by clamping, riveting, bolted or screwed connection, or by welding, soldering, or brazing with materials having a softening or melting point greater than 850°F (454°C). The bonding connection shall penetrate nonconductive coatings such as paint or vitreous enamel.

11.9 A connection that depends upon the clamping action exerted by rubber or similar materials is acceptable if it complies with 11.11 under any degree of compression permitted by a variable clamping device and if the results are still acceptable after exposure to the effects of oil, grease, moisture, and thermal degradation which are likely to occur in service. The effect of assembling and disassembling, for maintenance purposes, such a clamping device is to be considered with respect to the likelihood of the clamping device being reassembled in its intended position.

11.10 Where the bonding means depend on screw threads, two or more screws or two full threads of a single screw engaging metal is considered in compliance with 11.8.

11.11 If the adequacy of a bonding connection cannot be determined by examination, or if a bonding conductor is smaller than required by 11.12 – 11.14, it shall be considered acceptable if the connecting means does not open:

- a) When carrying for the time indicated in Table 11.1 twice the current equal to the rating of the branch-circuit overcurrent device required to protect the equipment, and
- b) During a short-circuit test in series with a fuse of proper rating. See Short-Circuit Test, Section 26.

Table 11.1
Duration of current flow, bonding-conductor test

Rating of overcurrent device, amperes	Minimum duration of current flow, minutes
30 or less	2
31–60	4
61–100	6
101–200	8

11.12 The size of a conductor or strap employed to bond an electrical enclosure or motor frame shall be based on the rating of the branch-circuit overcurrent device to which the equipment will be connected. Except as indicated in 11.11, the size of the conductor or strap shall be in accordance with Table 11.2.

Table 11.2
Bonding wire conductor size

Rating of overcurrent device, amperes	Size of bonding conductor ^a			
	Copper wire		Aluminum wire	
	AWG	(mm ²)	AWG	(mm ²)
15	14	(2.1)	12	(3.3)
20	12	(3.3)	10	(5.3)
30	10	(5.3)	8	(8.3)
40	10	(5.3)	8	(8.3)
60	10	(5.3)	8	(8.3)
100	8	(8.3)	6	(13.3)
200	6	(13.3)	4	(21.2)

^a Or equivalent cross-sectional area.

11.13 A bonding conductor to a component or electrical enclosure is not required to be larger than the size of the conductors supplying power to the component(s) within the enclosure.

11.14 If more than one size of branch-circuit overcurrent device is involved, the size of the bonding conductor is to be based on the rating of the overcurrent device intended to provide ground-fault protection for the component bonded by the conductor. For example, if a motor is individually protected by a branch-circuit overcurrent device smaller than other overcurrent devices used with the equipment, a bonding conductor for that motor is sized on the basis of the overcurrent device intended for ground-fault protection of the motor.

11.15 The following are considered to constitute means for connection to a ground:


- a) In equipment intended to be connected to a metal-enclosed wiring system — A knockout or equivalent opening in a metal enclosure intended to receive the power-supply system.
- b) In equipment intended to be connected by a nonmetal-enclosed wiring system, for example, metal-clad cable — An equipment grounding terminal or lead.

11.16 A terminal for connection of an equipment-grounding conductor shall be capable of securing a conductor of the size required for the particular application, in accordance with the National Electrical Code, ANSI/NFPA 70-1990.

11.17 A soldering lug, a push-in (screwless) connector, or a quick-connect or similar friction fit connector shall not be used for the terminal for the field installed grounding conductor.

11.18 A wire-binding screw intended for the connection of an equipment-grounding conductor shall have a green colored head that is hexagonal, slotted, or both. A pressure wire connector intended for connection of such a conductor shall be identified by being marked "G, GR, GROUND, GROUNDING," by the symbol in Figure 11.1, or by a marking on a wiring diagram provided on the equipment. The wire-binding screw or pressure wire connector shall be secured to the frame or enclosure and shall be so located that it is unlikely to be removed during normal servicing. At a wire-binding screw, upturned lugs, or the equivalent, shall be provided to retain the conductor. If a pressure connector is used adjacent to the connectors intended for the supply conductors and if it could be mistaken for the neutral of a grounded supply, a marking shall be additionally provided indicating "EQUIPMENT GROUND" and/or identifying the connector by a green color.

Figure 11.1
Grounding symbol



11.19 The surface of an insulated lead intended for the connection of an equipment-grounding conductor shall be finished continuous green color or a continuous green color with one or more yellow stripes, and no other lead visible to the installer shall be so identified.

12 Mounting of Electrical Components

Section 12 effective April 1, 1994

12.1 A switch, fuseholder, lampholder, or similar electrical component shall be mounted to prevent it from turning, except as noted in 12.2 and 12.3.

12.2 The requirement that a switch be prevented from turning may be waived if all of the following conditions are met:

- a) The switch is of a plunger or other type that does not tend to rotate when operated. A toggle switch is considered to be subject to forces that tend to turn the switch during normal operation of the switch.
- b) The means for mounting the switch makes it unlikely that operation of the switch will loosen it.
- c) The spacings are not reduced below the required values if the switch rotates.
- d) The normal operation of the switch is by mechanical means rather than by direct contact by persons.

12.3 A lampholder of the type in which the lamp cannot be replaced, such as a neon pilot or indicator light in which the lamp is sealed in a nonremovable jewel, need not be prevented from turning if rotation cannot reduce spacings below the required values.

12.4 The means for preventing turning is to consist of more than friction between surfaces. A toothed lock washer which provides both spring take-up and an interference lock is acceptable as the means for preventing a small stem-mounted switch or other device having a single-hole mounting means from turning.

12.5 Uninsulated live parts shall be so secured to the base or mounting surface that they will be prevented from turning or shifting in position if such motion may result in a reduction of spacings below the acceptable values.

13 Motors and Motor Overload Protection

Section 13 effective April 1, 1994

13.1 Each motor shall be protected by an integral thermal protector or by an overcurrent protective device or combinations thereof.

13.2 "Overcurrent protective device" as referred to in 13.1 means those that conform to the requirements of the National Electrical Code, ANSI/NFPA 70-1990, as follows:

a) A separate overcurrent device that is responsive to motor current. This device shall be rated or selected to trip at no more than the following percent of the motor full-load current rating:

- 1) Motors with marked service factor not less than 1.15, 125 percent;
- 2) Motors with a marked temperature rise not over 72°F (40°C), 125 percent; and
- 3) All other motors, 115 percent.

For a multispeed motor, each winding connector shall be considered separately and the motor is to be protected at all speeds.

b) If the values specified for motor-running overcurrent protection do not correspond to the standard sizes or ratings of fuses, or magnetic or thermal overload protective devices, the next higher size or rating may be used, but not higher than the following percent of motor full-load current rating:

- 1) Motors with a marked service factor not less than 1.15, 140 percent;
- 2) Motors with a marked temperatures rise not over 72°F (40°C), 140 percent; and
- 3) All other motors, 130 percent.

13.3 An integral thermal protective device shall comply with the Standard for Thermal Protectors for Motors, UL 547.

13.4 Separate overcurrent devices, except when included as part of a magnetic motor controller, are to be assembled as part of the equipment, and be readily identifiable as such after assembly to the equipment. Such protection is not to include means for manually interrupting the motor circuit if such interruption may result in the risk of fire, electric shock, or injury to persons.

13.5 Three-phase motors shall be provided with overcurrent protection as follows:

- a) Three properly rated overcurrent devices shall be employed, or
- b) Thermal protectors, combination of thermal protectors and overcurrent devices, or equivalent methods of protection may be employed where the specific protective arrangement has been investigated and found to provide proper protection under primary single-phase failure conditions when supplied from transformers connected wye-delta or delta-wye. Assemblies so investigated shall be marked to indicate that the motor is protected under primary single-phase conditions. This marking may be a paper sticker, decal, or an attached wiring diagram.

13.6 Motors such as direct-drive fan motors which are not normally subjected to overloads, and which are determined to be adequately protected against overheating due to locked-rotor current by a thermal or overcurrent protective device, may be accepted under the requirement for overcurrent protection provided it is determined that the motor will not overheat under actual conditions of use.

13.7 Impedance protection may be accepted for motors which are determined to be adequately protected against overheating due to locked-rotor current, provided it is determined that the motor will not overheat under the performance requirements of this standard.

13.8 Fuses shall not be used as motor overload protective devices unless the motor is adequately protected by the largest size fuse which can be inserted in the fuseholder.

13.9 Overcurrent protective devices and thermal protective devices for motors shall comply with the requirements of the Short-Circuit Test, Section 26.

13.10 A motor shall be designed for continuous duty as indicated by the designation "CONTINUOUS" or "CONT" on the nameplate.

13.11 In no case shall interruption of the circuit to a motor by the overcurrent or thermal protective device result in a risk of fire, electric shock, or injury to persons during operation of the equipment or the discharge of fuel that may result in a risk of fire or injury to persons. If a burner depends solely upon an electrical valve to stop the flow of fuel to the burner, the interruption of the circuit to the motor by the protective device shall also cause the interruption of the circuit to the valve.

13.12 Automatic-reset type protective devices shall not be used if the automatic reclosing of the circuit to the motor by the device may result in a risk of fire, electric shock, or injury to persons during operation of the equipment.

13.13 The enclosure of a motor shall have no openings which will permit a drop of liquid, or a particle falling vertically onto the motor, to enter the motor as applied to the assembly.

13.14 Conformance to 13.13 may be provided by the motor frame or by another enclosure, structure, shield, or a combination of two or more such items, and is to be determined with the motor applied to the assembly.

13.15 Motors having openings in the enclosure or frame shall be installed or shielded to prevent particles from falling out of the motor onto combustible material located within or under the assembly.


13.16 The requirement in 13.15 will necessitate the use of a barrier of nonflammable material under an open type motor unless:

- a) The structural parts of the motor or the burner such as the bottom closure, provide the equivalent of such a barrier, or
- b) The motor overload protection device provided with a single-phase motor is such that no burning insulation or molten material falls to the surface that supports the appliance when the motor is energized under each of the following fault conditions, as applicable to the particular type of motor:
 - 1) Open main winding,
 - 2) Open starting winding,
 - 3) Starting switch short-circuited, and
 - 4) Capacitor shorted, permanent split capacitor type, or
- c) The motor is provided with a thermal motor protector (a protective device that is sensitive to temperature and current) that will prevent the temperature of the motor windings from becoming more than 275°F (125°C) under the maximum load below which the motor will run without causing the protector to cycle and from becoming more than 302°F (150°C) with the rotor of the motor locked.
- d) The motor complies with the requirements for impedance-protected motors and the motor winding will not exceed a temperature greater than 302°F (150°C) during the first 72 hours of operation with the rotor of the motor locked.

13.17 The barrier mentioned in 13.16 shall be horizontal, located as indicated in Figure 13.1, and have an area not less than that described in that illustration. Openings for drainage, ventilation, and the like, may be employed in the barrier provided that such openings would not permit molten metal, burning insulation, or the like to fall on combustible material.

Figure 13.1

LOCATION AND EXTENT OF BARRIER

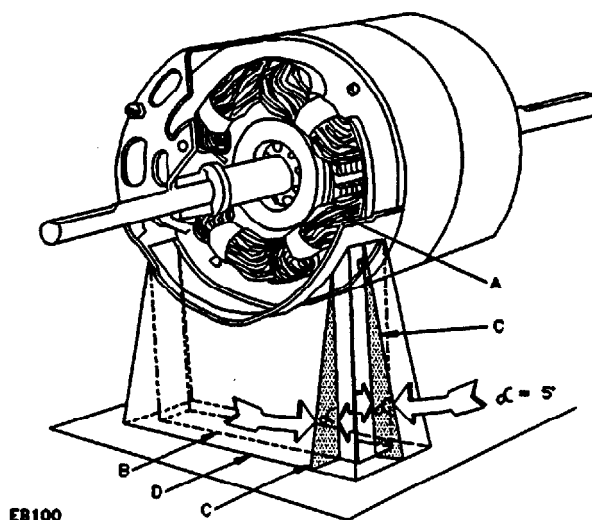

A – Motor winding to be shielded by barrier. This is to consist of the entire motor winding if it is not otherwise shielded, and is to consist of the unshielded portion of a motor winding which is partially shielded by the motor enclosure or equivalent.

B – Projection of outline of motor winding on horizontal plane.

C – Inclined line which traces out minimum area of the barrier. When moving, the line is to be always (1) tangent to the motor winding, (2) 5 degrees from the vertical, and (3) so oriented that the area traced out on a horizontal plane is maximum.

D – Location (horizontal) and minimum area for barrier. The area is to be that included inside the line of intersection traced out by the inclined line C and the horizontal plane of the barrier.

14 Overcurrent Protection of High-Voltage Control-Circuit Conductors

Section 14 effective April 1, 1994

14.1 General

14.1.1 For the purpose of the requirements in 14.2.1 – 14.4.2, a control circuit is one that carries electric signals to operate a controller that, in turn, governs power delivered to a motor or other load in the product. A control circuit does not carry main-power current. If a control circuit is supplied through a transformer provided as part of the product, see Overcurrent Protection of Transformers, Section 15, for additional requirements.