

UL 2166

ISBN 0-7629-0410-0

Halocarbon Clean Agent Extinguishing System Units

Copyright Underwriters Laboratories Inc.
Provided by IHS under license with UL
No reproduction or networking permitted without license from IHS

Underwriters Laboratories Inc. (UL)
333 Pfingsten Road
Northbrook, IL 60062-2096

UL Standard for Safety for Halocarbon Clean Agent Extinguishing System Units, UL 2166

First Edition, Dated March 31, 1999

Revisions: This Standard contains revisions through and including March 22, 2001.

A change in an effective date is indicated by a note following the affected item, and giving both the previous effective date and the new date the requirement becomes effective.

The following table lists the future effective dates with the corresponding reference.

Future Effective Dates	References
June 30, 2001	Entire Standard

The master for this Standard at UL's Northbrook Office is the official document insofar as it relates to a UL service and the compliance of a product with respect to the requirements for that product and service, or if there are questions regarding the accuracy of this Standard.

UL's Standards for Safety are copyrighted by UL. Neither a printed copy of a Standard, nor the distribution diskette for a Standard-on-Diskette and the file for the Standard on the distribution diskette should be altered in any way. All of UL's Standards and all copyrights, ownerships, and rights regarding those Standards shall remain the sole and exclusive property of UL.

All rights reserved. No part of this publication may be reproduced, stored in a retrieval system, or transmitted in any form by any means, electronic, mechanical photocopying, recording, or otherwise without prior permission of UL.

Revisions of UL Standards for Safety are issued from time to time. A UL Standard for Safety is current only if it incorporates the most recently adopted revisions.

UL provides this Standard "as is" without warranty of any kind, either expressed or implied, including but not limited to, the implied warranties of merchantability or fitness for any purpose.

In no event will UL be liable for any special, incidental, consequential, indirect or similar damages, including loss of profits, lost savings, loss of data, or any other damages arising out of the use of or the inability to use this Standard, even if UL or an authorized UL representative has been advised of the possibility of such damage. In no event shall UL's liability for any damage ever exceed the price paid for this Standard, regardless of the form of the claim.

UL will attempt to answer support requests concerning electronic versions of its Standards. However, this support service is offered on a reasonable efforts basis only, and UL may not be able to resolve every support request. UL supports the electronic versions of its Standards only if they are used under the conditions and operating systems for which it is intended. UL's support policies may change from time-to-time without notification.

UL reserves the right to change the format, presentation, file types and formats, delivery methods and formats, and the like of both its printed and electronic Standards without prior notice.

Purchasers of the electronic versions of UL's Standards for Safety agree to defend, indemnify, and hold UL harmless from and against any loss, expense, liability, damage, claim, or judgement (including reasonable attorney's fees) resulting from any error or deviation introduced while purchaser is storing an electronic Standard on the purchaser's computer system.

If a single-user version electronic Standard was purchased, one copy of this Standard may be stored on the hard disk of a single personal computer, or on a single LAN file-server or the permanent storage device of a multiple-user computer in such a manner that this Standard may only be accessed by one user at a time and for which there is no possibility of multiple concurrent access.

If a multiple-user version electronic Standard was purchased, one copy of the Standard may be stored on a single LAN file-server, or on the permanent storage device of a multiple-user computer, or on an Intranet server. The number of concurrent users shall not exceed the number of users authorized.

Electronic Standards are intended for on-line use, such as for viewing the requirements of a Standard, conducting a word search, and the like. Only one copy of the Standard may be printed from each single-user version of an electronic Standard. Only one copy of the Standard may be printed for each authorized user of a multiple-user version of an electronic Standard. Because of differences in the computer/software/printer setup used by UL and those of electronic Standards purchasers, the printed copy obtained by a purchaser may not look exactly like the on-line screen view or the printed Standard.

An employee of an organization purchasing a UL Standard can make a copy of the page or pages being viewed for their own fair and/or practical internal use.

The requirements in this Standard are now in effect, except for those paragraphs, sections, tables, figures, and/or other elements of the Standard having future effective dates as indicated in the note following the affected item. The prior text for requirements that have been revised and that have a future effective date are located after the Standard, and are preceded by a "SUPERSEDED REQUIREMENTS" notice.

New product submittals made prior to a specified future effective date will be judged under all of the requirements in this Standard including those requirements with a specified future effective date, unless the applicant specifically requests that the product be judged under the current requirements. However, if the applicant elects this option, it should be noted that compliance with all the requirements in this Standard will be required as a condition of continued Listing and Follow-Up Services after the effective date, and understanding of this should be signified in writing.

Copyright © 1999 Underwriters Laboratories Inc.

This Standard consists of pages dated as shown in the following checklist:

Page	Date
1-5	March 22, 2001
6	March 31, 1999
7-56	March 22, 2001
SA1-SA6	March 22, 2001

MARCH 31, 1999

(Title Page Reprinted: March 22, 2001)

1

UL 2166

Standard for Halocarbon Clean Agent Extinguishing System Units

First Edition

March 31, 1999

An effective date included as a note immediately following certain requirements is one established by Underwriters Laboratories Inc.

Revisions of this Standard will be made by issuing revised or additional pages bearing their date of issue. A UL Standard is current only if it incorporates the most recently adopted revisions, all of which are itemized on the transmittal notice that accompanies the latest set of revised requirements.

ISBN 0-7629-0410-0

COPYRIGHT © 1999, 2001 UNDERWRITERS LABORATORIES INC.

No Text on This Page

CONTENTS

FOREWORD	6
----------------	---

INTRODUCTION

1 Scope	7
2 General	7
3 Glossary	8
4 Components	10
5 Design Manual	10
6 Owner's Manual	11

CONSTRUCTION

7 General	12
8 Electrically Operated Alarms	13
9 Controls and Indicators	13
10 Pressure Vessels	14
11 Gaskets and "O" Rings	18
12 Filling Densities	18
13 Pressure Gauges and Indicators	18
14 Puncturing Mechanisms	20
15 Electrically Operated Valves and Pressure Switches	20
16 Siphon Tubes	20
17 Clean Agents	21
18 Expellant Gases	21
19 Polymeric Materials and Nonmetallic Parts	21
20 Anti-Recoil Devices	22
21 Pressure Switches	22

PERFORMANCE

22 General	22
23 Discharge Test	22
24 Valve Leakage Test	23
25 Hydrostatic Pressure Test	23
26 30-Day Elevated Temperature Test	25
27 Temperature Cycling Test	26
28 Salt Spray Corrosion Test	26
29 500 Cycle Operation Test	27
30 Time Delay Verification Test	28
31 Pressure-Operated Alarm Test	28
32 One-Year Time Leakage Test	29
33 Mounting Device Test	30
34 Class A and B Fire Clean Agent Extinguishment Tests	30
34.1 General test parameters	30
34.2 Class A fire extinguishment tests	31
34.3 Class B fire extinguishment tests	36
35 Nozzle Distribution Verification Tests	37
35.1 General	37
35.2 Test enclosure	38

35.3	System arrangement	39
35.4	Minimum room height/nozzle area coverage test arrangement	40
35.5	Maximum room height test arrangement	40
36	Automatic Extinguisher Unit Fire Tests	40
36.1	General	40
36.2	Test enclosures	41
36.3	Nozzle distribution extinguishment test	41
36.4	Automatic operation extinguishment tests	42
37	Verification of Flow Calculation Method Test	42
38	Equivalent Length Determination	44
39	High Pressure Discharge Test	44
40	Flexible Hose Low Temperature Test	45
41	Operation Test of Manual Actuators and Manual Pull Stations	45
42	Pneumatic Operation Test	45
43	Pressure Relief Tests	46
44	Calibration Test – Gauges and Indicators	46
45	Burst Strength Test – Gauges and Indicators	47
46	Overpressure Test – Gauges	47
47	Impulse Test – Gauges	47
48	Pressure Gauge Relief Test	48
49	Water Resistance Test – Gauges and Indicators	48
50	Liquid Level Indicators	48
51	Elastomeric Parts Test	49
52	Aging Tests – Plastic Materials	49
52.1	Air-oven aging test	49
52.2	Exposure to extinguishing agent test	50
52.3	Light and water test	51
53	10-Day Moist Ammonia Air Stress Cracking Test	51
54	Nameplate Exposure Tests	52
55	Nameplate Adhesion Test	53
56	Nameplate Abrasion Test	53

MANUFACTURING AND PRODUCTION TESTS

57	General	54
57.1	General	54
57.2	Hydrostatic pressure test – shells	54
57.3	Gauge calibration test	54
57.4	Leakage test	54A
57.5	Clean agent	54A

MARKING

58	General	54A
59	Manuals	54C
60	Placards	54D

INSTALLATION INSTRUCTIONS

61	Installation, Operation, and Maintenance Instruction Manual	54D
----	---	-----

SUPPLEMENT SA - MARINE-TYPE HALOCARBON CLEAN AGENT EXTINGUISHING SYSTEM UNITS

SA1 Scope	SA1
SA2 Installation, Operation, and Maintenance Instruction Manual	SA1
SA3 Wiring	SA1
SA4 Controls and Indicators	SA1
SA5 Pressure Vessels	SA2
SA6 Salt Spray Corrosion Test	SA2
SA7 Vibration and Shock Resistance Test	SA2
7.1 General	SA2
SA7.2 Vibration test	SA3
SA7.3 Shock resistance test	SA4
SA8 Area Coverage Test	SA4
SA9 Aging Tests – Polymeric Materials	SA4
SA10 Marking	SA5

FOREWORD

A. This Standard contains basic requirements for products covered by Underwriters Laboratories Inc. (UL) under its Follow-Up Service for this category within the limitations given below and in the Scope section of this Standard. These requirements are based upon sound engineering principles, research, records of tests and field experience, and an appreciation of the problems of manufacture, installation, and use derived from consultation with and information obtained from manufacturers, users, inspection authorities, and others having specialized experience. They are subject to revision as further experience and investigation may show is necessary or desirable.

B. The observance of the requirements of this Standard by a manufacturer is one of the conditions of the continued coverage of the manufacturer's product.

C. A product which complies with the text of this Standard will not necessarily be judged to comply with the Standard if, when examined and tested, it is found to have other features which impair the level of safety contemplated by these requirements.

D. A product employing materials or having forms of construction which conflict with specific requirements of the Standard cannot be judged to comply with the Standard. A product employing materials or having forms of construction not addressed by this Standard may be examined and tested according to the intent of the requirements and, if found to meet the intent of this Standard, may be judged to comply with the Standard.

E. UL, in performing its functions in accordance with its objectives, does not assume or undertake to discharge any responsibility of the manufacturer or any other party. The opinions and findings of UL represent its professional judgment given with due consideration to the necessary limitations of practical operation and state of the art at the time the Standard is processed. UL shall not be responsible to anyone for the use of or reliance upon this Standard by anyone. UL shall not incur any obligation or liability for damages, including consequential damages, arising out of or in connection with the use, interpretation of, or reliance upon this Standard.

F. Many tests required by the Standards of UL are inherently hazardous and adequate safeguards for personnel and property shall be employed in conducting such tests.

INTRODUCTION

1 Scope

1.1 These requirements cover the construction and operation of halocarbon clean agent fire extinguishing system units intended to be installed, inspected, tested, and maintained in accordance with the Standard on Clean Agent Fire Extinguishing Systems, NFPA 2001.

Effective date for 1.1 changed from March 31, 2001 to June 30, 2001

1.2 These requirements also cover halocarbon clean agent automatic extinguisher units that do not have a manual means of operation, and are intended to be used in accordance with the manufacturer's installation instructions. Automatic extinguisher units are not intended:

- a) For use as a general substitute for pre-engineered or engineered clean agent extinguishing system units; or
- b) For protection of fire risks larger than those specified in the manufacturer's instructions for a single unit by using multiple units.

Effective date for 1.2 changed from March 31, 2001 to June 30, 2001

1.3 A product that contains features, characteristics, components, materials, or systems new or different from those covered by the requirements in this standard, and that involves a risk of fire or of electric shock or injury to persons shall be evaluated using appropriate additional component and end-product requirements to maintain the level of safety as originally anticipated by the intent of this standard. A product whose features, characteristics, components, materials, or systems conflict with specific requirements or provisions of this standard does not comply with this standard. Revision of requirements shall be proposed and adopted in conformance with the methods employed for development, revision, and implementation of this standard.

Effective date for 1.3 changed from March 31, 2001 to June 30, 2001

2 General

2.1 Values stated without parentheses are the requirement. Values in parentheses are explanatory or approximate information.

Effective date for 2.1 changed from March 31, 2001 to June 30, 2001

2.2 Where these requirements reference "extinguishing system unit," the requirements also apply to automatic extinguisher units unless specifically noted otherwise.

Effective date for 2.2 changed from March 31, 2001 to June 30, 2001

3 Glossary

3.1 For the purpose of these requirements, the following definitions apply.

Effective date for 3.1 changed from March 31, 2001 to June 30, 2001

3.2 AGENT TIME IMBALANCE – A situation in which the start of agent discharge at a nozzle occurs after agent discharge has been completed at any other nozzle in the system.

Effective date for 3.2 changed from March 31, 2001 to June 30, 2001

3.3 AUTOMATIC EXTINGUISHER UNIT – A unit that has no manual means of actuation and discharges extinguishing agent upon thermal actuation, is intended for use in normally unoccupied space, and is limited to a single protected area per 1.2.

Effective date for 3.3 changed from March 31, 2001 to June 30, 2001

3.4 CLEAN AGENT – Electrically nonconducting, volatile, or gaseous fire extinguishant that does not leave a residue upon evaporation. The word "agent" as used in this document shall mean "clean agent" unless otherwise indicated.

Effective date for 3.4 changed from March 31, 2001 to June 30, 2001

3.5 CYLINDER/VALVE ASSEMBLY – A container that incorporates a valve and which provides storage of the extinguishing agent and expellant (when applicable) until the valve is actuated. When actuated, the valve releases the agent into the distribution network of the extinguishing system.

Effective date for 3.5 changed from March 31, 2001 to June 30, 2001

3.6 DISCHARGE NOZZLE – A device that is used to uniformly distribute the extinguishing agent:

- a) Over a specific area; or
- b) Within a specific volume;

or both.

Effective date for 3.6 changed from March 31, 2001 to June 30, 2001

3.7 DISCHARGE TIME – The time required to discharge from the nozzle 95 percent of the agent mass at 70°F (21°C) necessary to achieve the minimum design concentration for flame extinguishment. For some halocarbon agents, it is the time interval between the first appearance of liquid at the nozzle and the time at which the discharge becomes predominantly gaseous.

Effective date for 3.7 changed from March 31, 2001 to June 30, 2001

3.8 ENGINEERED SYSTEM – A system that requires individual calculation and design, in accordance with the extinguishing system unit manufacturer's instructions, to determine the flow rates, nozzle pressures, quantities of extinguishing agent, and number and types of nozzles for effective extinguishing agent distribution and fire coverage.

Effective date for 3.8 changed from March 31, 2001 to June 30, 2001

3.9 EXPELLANT GAS – An inert gas used to facilitate the discharge of a superpressurized extinguishing agent at low temperatures.

Effective date for 3.9 changed from March 31, 2001 to June 30, 2001

3.10 EXTINGUISHING SYSTEM UNIT – Identified components that are assembled into system for the discharge of an extinguishing agent through fixed piping and nozzles for the purpose of extinguishing fires.

Effective date for 3.10 changed from March 31, 2001 to June 30, 2001

3.11 HALOCARBON CLEAN AGENT – A clean agent that contains as primary components one or more organic compounds containing one or more of the elements fluorine, chlorine, bromine, or iodine. Examples are: hydrofluorocarbons (HFCs); hydrochlorofluorocarbons (HCFCs); perfluorocarbons (PFCs or FCs); and fluoroiodocarbons (FICs).

Effective date for 3.11 changed from March 31, 2001 to June 30, 2001

3.12 MANUAL MEANS OF ACTUATION – A means of system actuation in which the system operator initiates system discharge, either mechanically or electrically.

Effective date for 3.12 changed from March 31, 2001 to June 30, 2001

3.13 MASTER VALVE – A discharge valve that upon automatic or manual actuation operates other valves or devices in an extinguishing system.

Effective date for 3.13 changed from March 31, 2001 to June 30, 2001

3.14 MINIMUM DESIGN NOZZLE PRESSURE – Typically, the minimum average pressure for a nozzle present during system discharge.

Effective date for 3.14 changed from March 31, 2001 to June 30, 2001

3.15 OPERABLE PRESSURE RANGE – The pressure range corresponding to the pressures in the storage container at the specified minimum and maximum temperatures for which the extinguishing system unit is intended to be operable.

Effective date for 3.15 changed from March 31, 2001 to June 30, 2001

3.16 OPERATING PRESSURE – The pressure in a fully charged storage container at 70°F (21°C).

Effective date for 3.16 changed from March 31, 2001 to June 30, 2001

3.17 PRE-ENGINEERED SYSTEM – A system that is tested in accordance with the limitations prescribed by the manufacturer for maximum and minimum pipe lengths, accessories, number of fittings, number and types of nozzles and nozzle placement, maximum areas, volumes, or both areas and volumes of protection.

Effective date for 3.17 changed from March 31, 2001 to June 30, 2001

3.18 PROOF TEST PRESSURE – The factory test pressure of each cylinder used to evaluate cylinder leakage and construction integrity. For Department of Transportation (DOT) approved cylinders, the factory test pressure is specified in the appropriate DOT specification. For ASME vessels, the factory test pressure is specified in Section VIII, Pressure Vessels, of the 1992 ANSI/ASME Boiler and Pressure Vessel Code. For non-DOT cylinders and non-ASME cylinders, the factory test pressure is three times the cylinder operating pressure at 70°F (21°C).

Effective date for 3.18 changed from March 31, 2001 to June 30, 2001

3.19 SELECTOR (DIRECTIONAL) VALVE – A device that is installed in the piping of an extinguishing system and that directs the flow of extinguishing agent to the appropriate protected volume. This valve is used only when more than one volume is being protected by a single extinguishing system.

Effective date for 3.19 changed from March 31, 2001 to June 30, 2001

3.20 TOTAL FLOODING SYSTEM – A system consisting of a supply of halocarbon clean agent arranged to discharge the extinguishing agent into the intended protected volume and to fill that volume to an effective extinguishing agent concentration.

Effective date for 3.20 changed from March 31, 2001 to June 30, 2001

4 Components

4.1 Except as indicated in 4.2, a component of a product covered by this standard shall comply with the requirements for that component.

Effective date for 4.1 changed from March 31, 2001 to June 30, 2001

4.2 A component is not required to comply with a specific requirement that:

- a) Involves a feature or characteristic not required in the application of the component in the product covered by this standard, or
- b) Is superseded by a requirement in this standard.

Effective date for 4.2 changed from March 31, 2001 to June 30, 2001

4.3 A component shall be used in accordance with its rating established for the intended conditions of use.

Effective date for 4.3 changed from March 31, 2001 to June 30, 2001

4.4 Specific components are incomplete in construction features or restricted in performance capabilities. Such components are intended for use only under limited conditions, such as certain temperatures not exceeding specified limits, and shall be used only under those specific conditions.

Effective date for 4.4 changed from March 31, 2001 to June 30, 2001

5 Design Manual

5.1 An engineered clean agent extinguishing system unit shall have a design manual that references the limitations determined by the calculation method and includes at least the following items:

- a) A description of the general principles utilized in the calculation method;
- b) Limitation on percent of agent in the pipe;
- c) Limitations on minimum and maximum pipeline flow rates;
- d) Limitations regarding the types of tee splits (for example, bull head, side outlet) and attached fittings. In addition, the intended range of flow splits and information on the orientation, installation, and critical length for each type of split.
- e) Limitations on conditions that result in agent time imbalance condition at each nozzle; for example limits on the variance for agent arrival time and runout time between nozzles.
- f) Minimum design nozzle pressure;
- g) Method for determining nozzle orifice area and selection of nozzle, as well as nozzle flow information; limits for minimum and maximum orifice area in relation to the attached pipe area;

- h) Nozzle area coverage limitations, minimum and maximum height limitations, and information on location of nozzle in the protected area;
- i) Range of filling weights for each size container;
- j) Minimum and maximum design discharge time;
- k) Operating temperature range limitations;
- l) Description of the system design procedure and a sample problem indicating all computer input required and computer output information calculated;
- m) Equivalent length values of all fittings and all system equipment through which the clean agent flows;
- n) Reference to installation, operation, and maintenance manual;
- o) The name of the manufacturer or private labeler or equivalent designation;
- p) Date and manual designation number on each page;
- q) When the calculation method has not been investigated at temperatures other than 70°F (21°C), appropriate cautionary information stating that when the storage temperature varies by $\pm 10^\circ\text{F}$ (5.5°C) there is the risk that the system will not supply the designed quantity of extinguishing agent;
- r) Cautionary information indicating the calculation method has been investigated for specific types of fittings, types of pipe and pipe inside diameter. Also that when the specified limitations are not maintained there is the risk that the system will not supply the required quantity of extinguishing agent.

Effective date for 5.1 changed from March 31, 2001 to June 30, 2001

6 Owner's Manual

6.1 When an owner's manual is provided with an extinguishing system unit, see 59.1, it shall include at least the following:

- a) Clear indication that it is not a detailed installation, operation, and maintenance manual or design manual (when applicable).
- b) Clear reference to the availability of the installation, operation, and maintenance manual and design manual by contacting the manufacturer.
- c) A statement that the system periodically be inspected by trained personnel.
- d) Information regarding the essentials required to maintain the system in operation both before and after a fire.
- e) A statement that no modifications are to be made to the system without consulting a qualified system designer who is to refer to the detailed installation or maintenance manual. The statement shall include the following or equivalent wording: "This system is made up of units

tested within limitations contained in the detailed installation manual. The system designer must be consulted whenever changes are planned for the system or area of protection. An authorized installer or system designer must be consulted after the system has discharged."

Effective date for 6.1 changed from March 31, 2001 to June 30, 2001

CONSTRUCTION

7 General

7.1 After discharge of the extinguishing agent is initiated, an extinguishing system unit shall maintain the maximum rate of application of the extinguishing agent without requiring a manual action.

Effective date for 7.1 changed from March 31, 2001 to June 30, 2001

7.2 All exposed parts of an extinguishing system, including the finishes on coated or painted parts, the assemblies of moving parts, the nameplates as secured in place, the mounting bracket, or other similar parts, shall be resistant to commonly encountered atmospheric corrosive influences, and to galvanic corrosion, as determined by the Salt Spray Corrosion Test, Section 28.

Effective date for 7.2 changed from March 31, 2001 to June 30, 2001

7.3 When the deterioration, breakage or other malfunction of a material for an extinguishing system unit presents a risk of causing the extinguishing system to become inoperable, the material shall not be susceptible to stress cracking. See 10-Day Moist Ammonia Test, Section 53.

Effective date for 7.3 changed from March 31, 2001 to June 30, 2001

7.4 As covered by these requirements, an extinguishing system unit consists of:

- a) Actuating assemblies;
- b) An extinguishing agent storage container and valve assembly;
- c) Discharge nozzle(s);
- d) Indicators that show the condition of the extinguishing system;
- e) A means for mounting the extinguishing system;
- f) Manifold check valves;
- g) Remote manual controls;
- h) Selector valves; and/or
- i) Other accessory equipment.

Effective date for 7.4 changed from March 31, 2001 to June 30, 2001

7.5 An extinguishing system unit shall have a minimum storage temperature of either minus 65°F (minus 53.9°C), minus 40°F (minus 40°C), minus 20°F (minus 28.9°C), 0°F (minus 17.8°C), or 32°F (0°C); and a maximum storage temperature of either 100°F (37.8°C), 120°F (48.9°C), 130°F (54.4°C), 150°F (65.6°C), or higher, except that the 100°F maximum storage temperature applies to an automatic extinguisher unit only.

Effective date for 7.5 changed from March 31, 2001 to June 30, 2001

7.6 When used as part of a multiple unit system, an extinguishing system unit shall be provided with a means for simultaneous operation of all system units.

Effective date for 7.6 changed from March 31, 2001 to June 30, 2001

7.7 The design concentrations for an extinguishing system unit and an automatic extinguisher unit shall be in accordance with the Standard for Clean Agent Fire Extinguishing Systems, NFPA 2001. Also, compliance with the Class A and Class B Fire Extinguishing Tests described in Section 34, and Nozzle Distribution Verification Tests described in Section 35, shall be demonstrated.

Effective date for 7.7 changed from March 31, 2001 to June 30, 2001

8 Electrically Operated Alarms

8.1 When an electrically operated alarm is used, it shall comply with the Standard for Audible Signal Appliances, UL 464.

Effective date for 8.1 changed from March 31, 2001 to June 30, 2001

9 Controls and Indicators

9.1 An extinguishing system shall be provided with:

- a) An automatic and manual means of actuation; or
- b) A manual means of actuation only.

An automatic extinguisher unit shall incorporate an automatic means of actuation.

Effective date for 9.1 changed from March 31, 2001 to June 30, 2001

9.2 A manual means of operation shall be provided with a seal or other device to minimize the potential for accidental discharge.

Effective date for 9.2 changed from March 31, 2001 to June 30, 2001

9.3 An extinguishing system unit shall incorporate a pressure gauge for each pressure vessel containing a super pressurized agent, showing the pressure within the container. See Pressure Gauges and Indicators, Section 13.

Effective date for 9.3 changed from March 31, 2001 to June 30, 2001

9.4 When a manual means of actuation is provided (see 9.1) and it utilizes an electrical power source:

- a) That electrical power source shall be independent of the power source for the automatic means of actuation; or
- b) When the power source is used for both manual and automatic actuation, it shall have an independent back-up source, such as a battery.

Effective date for 9.4 changed from March 31, 2001 to June 30, 2001

9.5 A control unit, such as a control panel, push-button station, or similar unit, used as part of an extinguishing system shall comply with the Standard for Control Units for Fire-Protective Signaling Systems, UL 864.

Effective date for 9.5 changed from March 31, 2001 to June 30, 2001

10 Pressure Vessels

10.1 A pressure vessel shall be fabricated of a material having rigidity, durability, and resistance to corrosion at least equivalent to:

- a) A mild steel alloy, such as SAE 1010, having a minimum thickness of 0.028 inch (0.71 mm).
- b) An aluminum alloy, such as 6061-T6 or 6361-T6 (see the Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate, ASTM B209-93), having a minimum thickness of 0.028 inch; or
- c) An aluminum alloy, such as 1100, 1170, and 3003, having a minimum thickness of 0.028 inch.

Effective date for 10.1 changed from March 31, 2001 to June 30, 2001

10.2 The requirements in this section do not apply to a pressure vessel marked as complying with DOT or ASME specifications, unless otherwise specifically indicated.

Effective date for 10.2 changed from March 31, 2001 to June 30, 2001

10.3 An extinguishing system pressure vessel that is not intended to be used where U.S. Department of Transportation, Canadian Transport Commission or Section VIII of the ASME Boiler and Pressure Vessel Code are required, is able to be tested in accordance with the National Standard which applies, and is not required to comply with the requirements in this section, Sections 25 and 58.2.

Effective date for 10.3 changed from March 31, 2001 to June 30, 2001

10.4 An extinguishing system pressure vessel under the jurisdiction of the Department of Transportation shall comply with the appropriate DOT specifications for shipping containers.

Effective date for 10.4 changed from March 31, 2001 to June 30, 2001

10.5 An extinguishing system pressure vessel that is not intended to be shipped pressurized shall be designed, constructed, inspected, certified and marked in accordance with Section VIII, Pressure Vessels, of the 1992 ANSI/ASME Boiler and Pressure Vessel Code.

Effective date for 10.5 changed from March 31, 2001 to June 30, 2001

10.6 For the purpose of these requirements, thickness measurements of the sidewall are to be measured on uncoated metal. The thickness of the dome and of the bottom is to be measured at several points after forming and before coating.

Effective date for 10.6 changed from March 31, 2001 to June 30, 2001

10.7 The minimum width of a brazed joint on the sidewall shall be at least four times the thickness of the sidewall.

Effective date for 10.7 changed from March 31, 2001 to June 30, 2001

10.8 Automatic extinguisher unit pressure vessels for use with a halocarbon clean agent and with an operating pressure of 240 psi (1.65 MPa) or less at 70°F (21°C) and an internal volume not exceeding 1100 cubic inches (0.018 m³) for a non-liquefied compressed gas, or 55 cubic inches for a liquefied compressed gas, shall be constructed so that the stress in any part of the pressure vessel does not exceed 80 percent of the yield strength of the material or 50 percent of the ultimate tensile strength of the material when subjected to the proof test pressure specified in 25.2. (See 10.9 – 10.18).

Exception: Pressure vessels complying with 10.4 or 10.10 are not required to comply with this requirement.

Effective date for 10.8 changed from March 31, 2001 to June 30, 2001

10.9 With reference to the requirements of 10.8, the maximum stress at proof pressure for commonly used materials and fabricating processes shall not exceed the values specified in Table 10.1.

Effective date for 10.9 changed from March 31, 2001 to June 30, 2001

Table 10.1
Maximum stress at proof pressure

Effective date for Table 10.1 changed from March 31, 2001 to June 30, 2001

Material	Maximum stress,	
	psi	(MPa)
Copper brazed mild steel	25,000	(172)
Welded mild steel	27,000	(186)
Extruded 6061-T6, 6361-T6 aluminum	27,000	(186)
Extruded 3003 aluminum	16,000	(110)
Extruded 1100 aluminum	14,500	(100)
Extruded 1170 aluminum	11,000	(76)

10.10 When the metal and the maximum stress value of the fabricating method used is other than that specified in Table 10.1 or when the mode of use or construction is such that the values specified are not appropriate, pull tests are to be conducted to determine the yield and ultimate strength of the material. Test samples are to be taken either from stock material or from finished parts in accordance with Standard Test Methods and Definitions for Mechanical Testing of Steel Products, ASTM A370-1994. When samples are taken from ruptured pressure vessels, the samples are to be taken in a direction perpendicular to the ruptured opening, as determined during the rupture test specified in 25.8. The maximum stress value is to be based upon the mean values resulting from the test series minus two unbiased standard deviations.


Effective date for 10.10 changed from March 31, 2001 to June 30, 2001

10.11 To determine the stress acting on the pressure vessel at the specified proof test pressure, the formulas specified in Figure 10.1 are to be used.

Effective date for 10.11 changed from March 31, 2001 to June 30, 2001

Figure 10.1
Stress determination formulas

Effective date for Figure 10.1 changed from March 31, 2001 to June 30, 2001

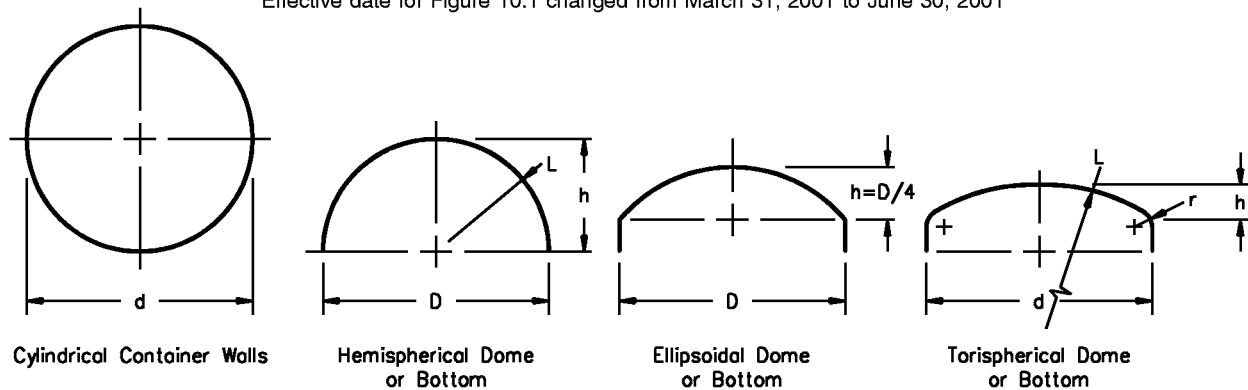

$$S = \frac{Pd}{2t}$$

$$S = \frac{PL}{2t}$$

$$S = \frac{PD}{2t}$$

$$S = \frac{0.885PL}{t}$$

$$S = \frac{Pd}{4t} \text{ (sphere)}$$

S2509B

in which:

S is the stress at proof test pressure, psi (kPa)

P is the proof test pressure, psi (kPa)

d is the inside diameter (cylindrical portion of shell), inches (mm)

D is the inside diameter of dome or bottom, inches (mm)

L is the inside spherical radius or dish radius, inches (mm)

t is the material thickness, inches (mm)

r is the "Knuckle" radius, inches (mm)

h is the distance from outside crest of head to tangent point with sidewall

10.12 When the pressure is applied to the convex side of an ellipsoidal or torispherical dome or bottom, the material thickness of the dome and bottom used for the calculations of 10.11 is to be multiplied by a factor of 1.67.

Effective date for 10.12 changed from March 31, 2001 to June 30, 2001

10.13 The material of the dome and bottom of a metal pressure vessel shall be of the same material as the sidewall of the pressure vessel and shall have a thickness after forming equal to or greater than the minimum measured wall thickness of the pressure vessel.

Exception No. 1: When the dome or bottom is formed integral with the sidewall and its thickness after forming less than the minimum measured sidewall thickness of the cylinder, the intent of this requirement is met when the measured dome or bottom thickness is more than 87 percent of the thickness of the sidewall (to account for any reduction in thickness which results from the forming process).

Exception No. 2: These requirements do not apply to pressure vessels with a flat dome or bottom as defined in 10.17.

Effective date for 10.13 changed from March 31, 2001 to June 30, 2001

10.14 A dome or bottom is evaluated as being integral with the sidewall when the distance from the point at which the dome or bottom is turned (the tangent point between the dome or bottom and the sidewall) to the nearest circumferential joint of the pressure vessel (excluding the collar) is greater than the radius of the sidewall to the center of the pressure vessel.

Effective date for 10.14 changed from March 31, 2001 to June 30, 2001

10.15 When a torispherical form dome or bottom is used, the knuckle radius r shall be not less than 6 percent of the inside dish radius L , and the cylinder diameter d shall be equal to or larger than the inside dish radius L . See Figure 10.1.

Effective date for 10.15 changed from March 31, 2001 to June 30, 2001

10.16 When either a flat dome or flat bottom is integral with the sidewall, the minimum thickness of the thinnest section of the dome or bottom shall be twice the minimum measured sidewall thickness. The minimum inside knuckle radius shall be 2.5 percent of the inside diameter of the sidewall.

Effective date for 10.16 changed from March 31, 2001 to June 30, 2001

10.17 For the purpose of these requirements, the shape of a dome or bottom shall be determined by calculating the ratio of the inside diameter of the dome or bottom to twice the distance from the outside crest of the head to the inside tangent point with the sidewall. The ratio ($D/2h$) then shall be applied as specified in Table 10.2.

Effective date for 10.17 changed from March 31, 2001 to June 30, 2001

Table 10.2
Shape determination of domes and bottoms

Effective date for Table 10.2 changed from March 31, 2001 to June 30, 2001

Ratio range	Shape
1.00 – 1.50	Hemispherical
1.51 – 3.00	Ellipsoidal
3.01 – 3.50	Torispherical
Greater than 3.50	Flat

10.18 A flat dome or bottom shall be used only on seamless pressure vessels or on pressure vessels having a linear sidewall length greater than 1-1/2 times the sidewall inside diameter.

Effective date for 10.18 changed from March 31, 2001 to June 30, 2001

11 Gaskets and "O" Rings

11.1 A gasket of an elastomeric material shall be thick enough to provide a compression-type seal. A seal, gasket, or an "O" ring that is continuously exposed to the extinguishing agent under pressure during intended service shall be made of a material compatible with the halocarbon extinguishing agent. See Elastomeric Parts Test, Section 51, and One-Year Time Leakage Test, Section 32.

Effective date for 11.1 changed from March 31, 2001 to June 30, 2001

12 Filling Densities

12.1 The maximum and minimum filling densities shall be specified by the manufacturer.

Effective date for 12.1 changed from March 31, 2001 to June 30, 2001

13 Pressure Gauges and Indicators

13.1 An extinguishing system unit shall be equipped with a pressure gauge indicating the pressure in the chamber. The operating range of the gauge shall take into account the operating temperature-pressure relationship of the extinguishing system unit, except that the minimum operating pressure line is able to be higher than the pressure that corresponds to the minimum operating temperature.

Exception: The pressure gauge is not required for an extinguishing system unit that is filled with a halocarbon extinguishing agent only and not charged with an expellant gas.

Effective date for 13.1 changed from March 31, 2001 to June 30, 2001

13.2 The pressure gauge face shall indicate the appropriate units for which the gauge is calibrated, such as psig, kPa, kg/cm², or any combination of pressure units.

Effective date for 13.2 changed from March 31, 2001 to June 30, 2001

13.3 The gauge dial face shall comply with the requirements in 13.4, 13.5, and 13.6.

Effective date for 13.3 changed from March 31, 2001 to June 30, 2001