

Subject 2683

September 17, 2018

SUMMARY OF TOPICS

The following new standard is being proposed for preliminary review and comment only:

1. For Preliminary Review Only: Proposed First Edition of the Standard for Electric Heating Systems for Floor and Ceiling Installation

COMMENTS DUE: NOVEMBER 1st, 2018

This proposal is for review and comment only (no ballot at this time). Please note that comments on a preliminary review document will not receive a response from the proposal author through CSDS. Instead, the proposal author will be asked to review the comments and adjust the proposals and/or supporting rationale as the author determines to be appropriate. The preliminary review process is an informal mechanism that provides authors with the opportunity to refine their proposals before they advance to the next stage in UL's standards development process.

In some cases, the author of the proposals may choose to discontinue them. In this case, the author need not do anything after preliminary review has ended. Normally, the next step in the process is the more formal STP ballot and stakeholder review process. Only comments posted during the STP ballot and stakeholder review process will be provided with a response in CSDS.

1. For Preliminary Review Only: Proposed First Edition of the Standard for Electric Heating Systems for Floor and Ceiling Installation

RATIONALE

Proposal submitted by: Stephen Kuscsik and Tim Lassila, UL LLC

Presently there are three published documents in the U.S. being used to evaluate and certify electric floor and ceiling radiant heating systems: The Standard for Electric Space Heating Cables, UL 1673; The Standard for Electric Radiant Heating Panels and Heating Panel Sets, UL 1693; and Outline of Investigation for Electric Heating Products for Installation Under Floor Coverings, UL 1683. Together, these three documents cover electric radiant heating equipment (cable, mats, panels, etc.) for floor and ceiling installations.

As product technology advances, and installation scenarios continue to evolve, the need was identified to continue to evolve and update the standards that contain the product safety requirements for these systems. The objectives include continuing to allow advancement in technology, to proactively address growing installation locations, and to combine/assimilate safety requirements where similarities exist.

Towards these goals, discussions were held at a series of STP meeting for UL 1673/1693/1683 starting in June 2012, and the consensus input at the meetings was that these three documents should be eventually combined into one UL standard. This would provide opportunity to have safety requirements for a wider scope of electric radiant heating system types and installations covered under one

**UL COPYRIGHTED MATERIAL –
NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
DISTRIBUTION WITHOUT PERMISSION FROM**



Documents
Document Sharing Hub

document. Once created, it is anticipated to result in a consolidated document that is easier to use and apply for product designers, manufacturers, and certifiers. Significant work was done by STP and industry members on several drafts of this Standard.

In parallel with the development of UL 2683, a number of changes were proposed to the 2014 National Electrical Code, NFPA 70 and adopted in the 2017 edition of NFPA 70 to better align the code requirements for installation of these products with the product safety requirements in the existing and proposed Standards.

UL 2683 is being proposed as the new Standard. Much attention was given to the scope of the document such that it is clear as to what is covered, and is clear as to what is not covered, while also not inhibiting advances in technology or applications that might arise. The main intent of UL 2683 is to cover all types of systems and installations that are already addressed by UL 1673/1683/1693. Additionally, several specific system type and installations are being added to reflect product types and installations developments that were not within the scope of the other documents.

The Standard UL 2683 is laid out in two parts. Part 1 covers all Heating Systems within the scope of the document. Part 2 covers specific installation scenarios and/or specific system types or technologies that warrant additional or unique requirements. Additionally, the main tests were summarized in a convenient table format, for ease of reference when using the document. The goal was to have Part 1 and Part 2 work together so the user of the Standard can more easily identify the appropriate set of requirements that apply to a particular heating system type or installation.

Many of the requirements were adopted from existing documents UL 1673/1683/1693, and only changed editorially to fit into UL 2683. In some cases, requirements were revised to better address current system and testing considerations. Additionally, new requirements were included to be consistent with IEC standards covering these product types. These requirements are useful and applicable today, and may also provide future benefit in terms of possibly harmonizing US requirements with other global standards at some time in the future. In several sections of UL 2683, reference is made to an IEC Standard and specific Clause, for example for a test requirement. As an alternative to simply "pointing to" that external test, which is the present format, the complete test method or IEC standard text could be replicated in UL 2683, assuming copyright release is granted for this. There are pros and cons of each approach, and STP members are requested to comment on their preferred approach.

As a guide to the rationale for the particular sections/parts of UL 2683, the following table was developed as part of the overall rationale statement. This table provides specific comments, rationale, or explanations for requirements in UL 2683 and can be found below this rationale introduction.

This draft of UL 2683 first edition is intended to represent and reflect the requirements discussed during STP meetings held on November 14-15, 2012, April 2-4, 2013, and October 21-23, 2013, the work done by STP members and guests, as well as a number of Ad-Hoc group discussions and work leading to this draft. Our thanks extend to all those who were part of and assisted in these efforts.

After UL 2683 is affirmed and published, it is anticipated that the legacy documents (UL 1673, UL 1693, UL 1683) will be obsoleted at some future date.

UL 2683 – REQUIREMENTS EXPLANATION PER SECTION

PART 1 - ALL SYSTEMS	
This Standard is comprised of two parts. Part 1 consists of requirements that are to be applied to all HEATING SYSTEMS unless otherwise specified. Part 2 consists of requirements for specific system designs and for specific system installation locations and methods. The requirements contained in Part 2 supplement or modify the requirements in Part 1. A system specific design and installation may result in the application of more than one set of requirements in Part 2.	
CONSTRUCTION - ALL PRODUCTS	
Section 1, Scope	The scope of UL 2683 covers products and installation locations that were covered under UL 1673, UL 1683, and UL 1693, with the following additions: -Modular flooring heating systems -Heating systems with self-regulating elements -Low voltage heating systems in accordance with National Electrical Code, NFPA 70, Article 424, Part X. -Above subfloor heating systems intended to be installed in contact with surface floor coverings and carpet. -Product intended to be installed under ceilings. -Product embedment in asphalt has been excluded.
Section 7, Components	This section was developed based on the requirements contained in UL 1673, UL 1683, and UL 1693 and enhanced to include general requirement for components that are commonly used in the manufacturing of floor and ceiling heating systems. Exception No. 2 to Clause 7.1 was added to permit other suitable component standards to be used to judge the acceptability of components and is consistent with other UL appliance standards that allow this option.
Section 8, Enclosures	This section was developed based on the requirements contained in UL 1673, UL 1683, and UL 1693 and enhanced by providing requirements for product that may have metal or polymeric enclosures.
Section 9, Accessibility of Live Parts	This section has not changed from the requirements contained in UL 1673, UL 1683, and UL 1693.
Section 10, Flammability	This section was developed based on the requirements contained in UL 1673, UL 1683, and UL 1693 and enhanced by the UL 1673 STP by providing appropriate flame class type ratings for cable and flexible film products and different options on how compliance can be demonstrated, such as, the use of IEC based flammability requirements. The requirements also allow a testing performance path in lieu of flame ratings.
Section 11, Large Surface Flame Spread	This is a new section to address flame spread concern for product that employ large surfaces made with a polymeric material surface area greater than 0.93 m ² (10 ft ²).
Section 12, Grounding and Bonding	This section is comprised of requirements contained in UL 1673, UL 1683, and UL 1693 and has been update to clarify: -What types of product need grounding. -New requirements for grounding components (coverings, sheaths, braids) with different options on how to demonstrate compliance. This section also includes new requirements for systems intended to be installed under floor coverings for new National Electrical Code, NFPA 70, Article 424, Part X. -Updated bonding requirements.
Section 13, Non-Heating Leads	This section is based on the requirements contained in UL 1673, UL 1683, and UL 1693 and has been written to help clarify the different types of non-heating leads that can be used and how they can be installed.

UL COPYRIGHTED MATERIAL –
 NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
 DISTRIBUTION WITHOUT PERMISSION FROM UL

Documents

UL 2683 – REQUIREMENTS EXPLANATION PER SECTION Continued on Next Page

Document Sharing Hub

UL 2683 – REQUIREMENTS EXPLANATION PER SECTION Continued

Section 14, Heating Cable Elements	This section is from UL 1673, UL 1683, and UL 1693 and has been written to help clarify the requirements.
Section 15, Laminate Elements	This section is from UL 1673, UL 1683, and UL 1693 and has been written to help clarify the requirements.
Section 16, Connectors	This section is partially based on the requirements contained in UL 1673, UL 1683, and UL 1693 and has updated to include different options how noncertified connectors can be evaluation under UL 2683 based on IEC requirements. See the Connection Temperature Cycling Test, Section 43.
Section 17, Current Carrying Parts	This section has not changed from the requirements contained in UL 1673, UL 1683, and UL 1693.
Section 18, Splices and Connections	This section has not changed from the requirements contained in UL 1673, UL 1683, and UL 1693.
Section 19, Strain Relief	This is a new section to address the need for strain relief at electrical connections that may be subject to strain during the installation. See Strain Relief Test, Section 44 for the testing requirements.
Section 20, Electrical Insulation	This section is a carry over for the requirements contained in UL 1673, UL 1683, and UL 1693.
Section 21, Electrical Spacings	This section has not changed from the requirements contained in UL 1673, UL 1683, and UL 1693.
Section 22, Securement Means	This is a new section to address the need for securing heating systems in place during installation.
Section 23, Accessories	This section has not changed from the requirements contained in UL 1673, UL 1683, and UL 1693.
PERFORMANCE - ALL PRODUCTS This PERFORMANCE section applies to all HEATING SYSTEMS that are covered under this Standard. These requirements are to be combined with the relevant PERFORMANCE requirements in Part 2 of this Standard. When a HEATING SYSTEM represents more than one system type or installation method, tests from multiple sections in Part 2 shall be considered.	
Section 24, General	This section has not changed from the requirements contained in UL 1673, UL 1683, and UL 1693.
Section 25, Test Voltage Determination Test	This is a new test based on the requirements contained in UL 1673, UL 1683, and UL 1693. This test is used to help determine what voltage should be used during testing.
Section 26, Installation Test	This section has not changed from the requirements contained in UL 1683, and is conducted to ensure that a system can be installed in a safe manner.
Section 27, Power Input Test	This section has not changed from the requirements contained in UL 1673, UL 1683, and UL 1693.
Section 28 Normal Temperature Test	This test has been updated from the methods contained in UL 1673, UL 1683, and UL 1693 and includes updated test fixtures and easier to follow test set up instructions.
Section 29, Dielectric Voltage Withstand Test	This test combines the dielectric requirements contained in UL 1673, UL 1683, and UL 1693 into one test in an easy to follow format.
Section 30, Insulation Resistance Test	This section uses the methodology from UL 1673 and adds updated requirements
Section 31, Grounding Component DC Resistance Test	This is a new test that was developed to verify the suitability of a grounding component by measuring its resistance and comparing it to that of a product's bus conductors.
Section 32, Grounding Component Ampacity Test	This is a new test that was developed to provide an alternate way to verify the suitability of a grounding component by evaluating the current capability by using the Grounded conductive layer—other than low impedance test, Clause 4.2.14.2.2 of IEEE 515.1.

UL 2683 – REQUIREMENTS EXPLANATION PER SECTION Continued

Section 33, Grounding Component Stabilized Resistance Test	This is a new test to evaluate the resistance of carbon based grounding components.
Section 34, Bonding Circuit Impedance Test	This is a new test and is commonly used by many product safety standards for testing ground bond connections using a resistance measurement.
Section 35, Bonding Circuit Ampacity Test	This is a new test and is commonly used by many product safety standards for testing ground bond connections by passing current through the connection.
Section 36, Pin Penetration Test	This is a test that was not in UL 1683 and provides an alternate method for determining if a grounding component provides suitable coverage over a heating element. The method of this test is from IEC 60335-2-96.
Section 37, Elevated Temperature Test	This test replaces similar tests in UL 1673, UL 1683, and UL 1693 and is conducted to verify elevated temperature exposure on a heating system. This test uses IEC 60335-2-106 and IEC 60335-2-96 for the method and compliance criteria.
Section 38, Resistance to Cutting Test	This is a new test that was developed by the UL 1673 STP to address the mechanical abuse that a heating system may be subject to during installation.
Section 39, Crush Test	This is a new test that was developed by the UL 1673 STP to address the mechanical abuse that a heating system may be subject to during installation.
Section 40, Impact Test	This is a new test that was developed by the UL 1673 STP to address the mechanical abuse that a heating system may be subject to during installation.
Section 41, Cold Bend Test	This is from the requirements contained in UL 1673, UL 1683, and UL 1693. The method has been updated for clarification.
Section 42, Scratch Test - Underlayment	This is a new test that can be used to evaluate underlayments that are relied on for the safe installation of the heating system. The test method and compliance criteria are from the Scratch Test per Clause 21.104 of IEC 60335-2-96.
Section 43, Connection Temperature Cycling Test	This is a new test that can be used to evaluate connectors that are not certified or are being used differently from its intended use. The test method and compliance criteria are from the Electrical Connections Test per Clause 18.101 of IEC 60335-2-96 and IEC 60335-2-106.
Section 44, Strain Relief Test	This is a new test that can be used to evaluate connectors that are not certified or are being used differently from its intended use. The test method and compliance criteria are from the Strain Relief Test per Clause 22.101 of IEC 60335-2-96.
Section 45, Permanence of Cord Tag Test	This is a new test that can be used to evaluate system nameplate and warning markings that can be applied to non-heating leads in the form of a tag.
MANUFACTURING AND PRODUCTION LINE TESTS - ALL SYSTEMS	
Section 45, General	This section is from UL 1673, UL 1683, and UL 1693.
RATINGS - ALL HEATING SYSTEMS	
Section 46, General	This section is from UL 1673, UL 1683, and UL 1693.
MARKINGS - ALL SYSTEMS	
Section 47, General	The requirements in this section are from UL 1673, UL 1683, and UL 1693 and have been updated to help simplify what markings need to be applied to heating systems and what labels need to be supplied with a product in accordance with the NEC.
INSTALLATION INSTRUCTIONS – ALL HEATING SYSTEMS	

UL COPYRIGHTED MATERIAL –
NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
DISTRIBUTION WITHOUT PERMISSION FROM UL

UL 2683 – REQUIREMENTS EXPLANATION PER SECTION Continued on Next Page

Documents

Document Sharing Hub

UL 2683 – REQUIREMENTS EXPLANATION PER SECTION Continued

Section 48, General	The requirements for this section are from UL 1673, UL 1683, and UL 1693 and have been updated to help simplify what is needed in installation instructions.
PART 2 - SPECIFIC HEATING SYSTEM DESIGNS AND INSTALLATION LOCATIONS This Standard is comprised of two parts. Part 1 consists of requirements that are to be applied to all HEATING SYSTEMS unless otherwise specified. Part 2 consists of requirements for specific system designs and for specific system installation locations and methods. The requirements contained in Part 2 supplement or modify the requirements in Part 1. A system specific design and installation may result in the application of more than one set of requirements in Part 2.	
Sections, 50 and 51, FLOOR HEATING SYSTEMS	This section of the standard covers all types of heating systems that are intended to be installed above, inside, and below wood and concrete subfloors. The requirements for this section are from UL 1673, UL 1683, and UL 1693 and have been updated to help clarify the requirements.
Sections, 52 and 53, CEILING HEATING SYSTEMS	This section of the standard covers all types of heating systems that are intended to be installed above, inside, and under ceilings. The requirements for this section are from UL 1673 and UL 1693 and have been updated to help clarify the requirements.
Sections, 54 and 55, LAMINATE ELEMENTS	The requirements for this section were in part developed by the STP and contain requirements from IEC 60335-2-96 and IEC 60335-2-106.
Sections, 56 and 57, SYSTEMS WITH A RIGID ENCLOSURE	This section has not changed from the requirements contained in UL 1693.
Sections, 58, 59 and 60, MODULAR FLOORING SYSTEMS	The requirements in this section have been developed for modular flooring heating systems, which is a new type of product and not previously covered by UL 1673, UL 1683, and UL 1693.
Sections, 61, 62 and 63, RIGID AND SEMI-RIGID FLOORING SYSTEMS	The requirements for this section were in part developed by the STP and contain requirements from IEC 60335-2-96 and IEC 60335-2-106.
Sections, 64 and 65, INSIDE CONCRETE SYSTEMS	This section has not changed from the requirements contained in UL 1673.
Sections, 66 and 67, CARPET HEATING SYSTEMS	The requirements for this section were in part developed by the STP and contain requirements from IEC 60335-2-106.
Sections, 68 and 69, WET LOCATION INSTALLATIONS	This section has not changed from the requirements contained in UL 1683.
Sections, 70 and 71, SELF-REGULATING SYSTEMS	The requirements for this section were in part developed by the STP and contain requirements from IEEE 515.1.
Sections, 72, 73 and 74, LOW VOLTAGE SYSTEMS	The requirements in this section have been developed for low voltage systems per NEC 424, Part X. This is new type of product type and not previously covered by UL 1673, UL 1683, and UL 1693.

CONTENTS

PART 1 – ALL SYSTEMS

INTRODUCTION

1 Scope	12
2 Units of Measurement	13
3 Normative References	13
4 Glossary	15
5 Application of Requirements	19

CONSTRUCTION – ALL HEATING SYSTEMS

6 General	20
7 Components	20
7.5 Controls	21
7.6 Gaskets and seals	22
7.7 Ground-fault circuit-interrupters	22
7.8 Internal wiring	22
7.9 Overcurrent protection	22
7.10 Insulation, insulating bushings, and assembly aids	23
8 Enclosures	23
8.9 Openings	24
8.10 Metal Enclosures	26
8.11 Nonmetallic enclosures	27
9 Accessibility of Live Parts	27
10 Flammability	29
10.4 Heating cables, non-heating leads, and integral components	29
10.5 Laminate heating elements	30
10.6 Laminate heating elements - in direct contact with carpet	31
10.7 Nonmetallic enclosures	31
11 Large Surface Flame Spread	31
12 Grounding and Bonding	31
12.1 Grounding	31
12.2 Grounding Component	33
12.3 Grounding component coverage	34
12.3.1 Heating cables - grounding component coverage	34
12.3.2 Non-heating cables - grounding component coverage	34
12.3.3 Heating panels - grounding component coverage	34
12.4 Bonding	35
13 Non-Heating Leads	35
14 Heating Cable Elements	37
15 Laminate Elements	37
16 Splice Connectors	37
17 Current Carrying Parts	38
18 Electrical Connections	38
19 Strain Relief	38
20 Electrical Insulation	39
21 Electrical Spacings	39
22 Securement Means	40

UL COPYRIGHTED MATERIAL –
NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
DISTRIBUTION WITHOUT PERMISSION FROM  **Documents**
Document Sharing Hub

23 Accessories	40
----------------------	----

PERFORMANCE – ALL SYSTEMS

24 General	40
25 Test Voltage Determination	41
26 Installation Test	41
27 Power Input Test	41
28 Normal Temperature Test	42
28.1 General	42
28.3 Test samples	42
28.4 Test fixtures	42
28.5 Temperature measurements	43
28.6 Test procedure	43
29 Dielectric Voltage Withstand Test	44
30 Insulation Resistance Test	45
31 Grounding Component DC Resistance Test	45
32 Grounding Component Ampacity Test	46
33 Grounding Component Stabilized Resistance Test	46
34 Bonding Circuit Impedance Test	46
35 Bonding Circuit Ampacity Test	47
36 Pin Penetration Test	47
37 Elevated Temperature Test	48
38 Cutting Test	48
39 Crush Test	48
40 Impact Test	48
41 Cold Bend Test	49
42 Scratch Test – Underlayment	49
43 Connection Temperature Cycling Test	49
44 Strain Relief Test	49
45 Permanence of Cord Tag Test	50
45.2 Test samples and conditions	50
45.3 Test method	50

MANUFACTURING AND PRODUCTION LINE TESTS - ALL SYSTEMS

46 General	51
------------------	----

RATINGS - ALL HEATING SYSTEMS

47 General	52
------------------	----

MARKINGS - ALL SYSTEMS

48 General	53
48.3 Nameplate marking	53
48.4 Warning labels	54
48.5 Supply wire marking	55
48.6 Assembly kits and Accessories	56

INSTALLATION AND OPERATING INSTRUCTIONS - ALL HEATING SYSTEMS

49 General	56
------------------	----

UL COPYRIGHTED MATERIAL –
NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
DISTRIBUTION WITHOUT PERMISSION FROM  **Documents**
Document Sharing Hub

49.4	Safety instructions	56
49.5	Heating system identification	57
49.6	System specifications and limitations	58
49.7	Rating section	58
49.8	Installation section	59
49.9	Operation	61
49.10	Labeling	61
49.11	Inspection	61
49.12	Assembly kits	61
49.13	Accessories	62

PART 2 - SPECIFIC HEATING SYSTEM DESIGNS AND INSTALLATION LOCATIONS

FLOOR HEATING SYSTEMS

50	General	62
51	Performance	62
51.1	Normal temperature test - floor systems	62
51.2	Abnormal operation test – floor systems	64

CEILING HEATING SYSTEMS

52	General	64
53	Performance	64
53.1	Normal temperature test - ceiling systems	64
53.2	Abnormal operation test - ceiling systems	65

LAMINATE ELEMENTS

54	General	65
55	Performance	65
55.1	Non-heating conductor (busbar) securement test	65
55.2	Resistance - stabilized conditioning test	66
55.3	Cold bend test - laminate elements	66
55.4	Scratch test - laminate elements	67
55.5	Laminate bond strength test	67
55.6	Insulation bond strength test	68
55.7	Non-heating conductor (busbar) overload test	68

SYSTEMS WITH A RIGID ENCLOSURE

56	General	68
57	Performance	68
57.1	Drop Test – rigid enclosure	68

MODULAR FLOORING SYSTEMS

58	General	69
59	Construction	69
59.1	Connector securement means	69
59.2	Panel securement means	69
60	Performance	69

UL COPYRIGHTED MATERIAL –
NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
DISTRIBUTION WITHOUT PERMISSION FROM  Documents
Document Sharing Hub

60.1 Normal temperature test - modular flooring systems	69
60.2 Drop test - modular flooring systems	70
60.3 Moisture resistance test - modular flooring systems	70

RIGID AND SEMI-RIGID FLOORING SYSTEMS

61 General	70
62 Construction	70
63 Performance	70
63.1 Normal temperature test - systems in contact with rigid and semi-rigid flooring	70
63.2 Moisture resistance test - systems in contact with rigid and semi-rigid flooring systems	71

INSIDE CONCRETE SYSTEMS

64 General	71
65 Performance	71
65.1 Concrete slab cracking test	71

CARPET HEATING SYSTEMS

66 General	72
67 Performance	72
67.1 Normal temperature test - carpet heating systems	72
67.2 Moisture resistance test - carpet heating systems	72
67.3 Crush test - carpet heating systems	72
67.4 Crush test (chair)	73
67.5 Flexing test (carpet heating cable)	73
67.6 Severe conditions test	73
67.7 Spark emission test (laminated heating elements)	74

WET LOCATION INSTALLATIONS

68 General	74
69 Performance	74
69.1 Long-term insulation resistance test – non-heating leads and heating elements	74
69.2 Long-term Insulation resistance test - integral components	75
69.3 Water resistance test	75

SELF-REGULATING SYSTEMS

70 General	76
71 Performance	76
71.1 Thermal endurance test	76
71.2 Verification of startup current test	76

LOW VOLTAGE SYSTEMS

72 General	77
73 Construction	77
73.1 Enclosure	77
73.2 Power unit	78
73.3 Power unit overload protection	78
73.4 Power supply connection	79

UL COPYRIGHTED MATERIAL –
 NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
 DISTRIBUTION WITHOUT PERMISSION FROM  **Documents**
 Document Sharing Hub

73.5 Exposed current carrying parts	79
73.6 Securement means - power units	80
74 Performance	80
74.1 General	80
74.2 Verification of rated input	80
74.3 Maximum output test	81
74.4 Exposed current carrying parts test	81
74.5 Dielectric voltage withstand test – exposed electrical insulation	82
74.6 Dielectric voltage withstand test – power units	83
74.7 Static load test for mounting means	83

ANNEX A – Applicable tests for heating systems

ANNEX B – Test Fixtures

B.1 General	86
-------------------	----

**UL COPYRIGHTED MATERIAL –
NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
DISTRIBUTION WITHOUT PERMISSION FROM UL**



Documents
Document Sharing Hub

PROPOSAL

PART 1 – ALL SYSTEMS

INTRODUCTION

1 Scope

1.1 These requirements cover indoor fixed electric heating systems for use on system voltages not exceeding 600 V.

1.1.1 The heating systems covered by this Standard are intended for installation in accordance with the National Electrical Code, NFPA 70, Article 424.

1.2 These requirements cover the following electric heating systems:

- a) Heating cable systems;
- b) Heating mat systems;
- c) Heating panel systems;
- d) Modular flooring heating systems; and
- e) Low voltage systems including power units.

With the following types of insulated heating elements:

- f) Heating cable elements;
- g) Laminate elements; and
- h) Flat strip elements.

Of the following types:

- i) Constant wattage elements;
- j) Self-regulating elements; and
- k) Low voltage elements.

1.3 These requirements cover electric heating systems permanently installed as follows:

- a) WOOD SUBFLOORS - Installed above (on top of) or under (adjacent to rafters or joists);
- b) CONCRETE SUBFLOORS - Installed above (on top of), inside (embedded), or under (in earth or sand bed);
- c) CEILINGS – Installed inside (embedded), above (attic or between floors of a building adjacent to ceiling rafters or joists), or under (room side);

**UL COPYRIGHTED MATERIAL –
NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
DISTRIBUTION WITHOUT PERMISSION FROM UL**



Documents
Document Sharing Hub

- d) In WET LOCATIONS - Locations where the heating element may be subject to saturation with water after installation;
- e) Underneath and in direct contact with floor coverings, while above wood or concrete subfloors;
- f) Modular flooring heating systems installed above wood or concrete subfloors; and
- g) Shower benches.

1.4 These requirements do not cover electric heating systems that are covered under the following standards:

- a) Electrical Resistance Heat Tracing for Commercial and Industrial Applications, UL 515;
- b) Movable and Wall- or Ceiling-Hung Electric Room Heaters, UL 1278;
- c) Fixed and Location-Dedicated Electric Room Heaters, UL 2021; and
- d) Electric Heating Appliances, UL 499.

1.5 These requirements do not cover the following products:

- a) Heating systems connected to the supply by use of a flexible cord with attachment plug;
- b) Heating systems that are portable or easily moved after installation;
- c) Heating systems with integral means of producing air flow;
- d) Heating systems intended for snow melting/deicing or pipe maintenance;
- e) Heating systems intended to be installed outdoors; and
- f) Heating systems intended to be installed in a dropped or suspended ceiling.

1.6 These requirements do not cover the use of electrical heating systems on or as part of a Certified fire-resistance building assembly.

2 Units of Measurement

2.1 Values stated without parentheses are the requirement. Values in parentheses are explanatory or approximate information.

3 Normative References

3.1 The following documents are referenced in this Standard. For dated references, only the edition cited applies. For undated references, the latest edition of the referenced document (including any amendments) applies. References to UL standards are not included in this list and are referenced throughout this Standard.

ASTM International**ASTM C39**

Standard Test Method for Compressive Strength of Cylindrical Concrete Specimens

ASTM B193

Standard Test Method for Resistivity of Electrical Conductor Materials

ASTM B258

Standard Specification for Standard Nominal Diameters and Cross-Sectional Areas of AWG Sizes of Solid Round Wires Used as Electrical Conductors

ASTM C665

Standard Specification for Mineral-Fiber Blanket Thermal Insulation for Light Frame Construction and Manufactured Housing

ASTM C1396 / C1396M

Standard Specification for Gypsum Board

International Electrotechnical Commission (IEC) Standards**IEC 60695-2-11**

Standard for Fire hazard testing - Part 2-11: Glowing/hot wire based test methods - Glow-wire flammability test method for end-products

IEC 60695-2-12

Standard for Fire hazard testing – Part 2-12: Glowing/hot wire based test methods – Glow-wire flammability test method for materials

IEC 60695-2-13

Standard for Fire hazard testing – Part 2-13: Glowing/hot wire based test methods – Glow-wire ignitability test method for materials

IEC 60335-2-96; Edition 1.2

Standard for Household and similar electrical appliances - Safety - Part 2-96: Particular requirements for flexible sheet heating elements for room heating

IEC 60335-2-106; Edition 1

Standard for Household and similar electrical appliances – Safety – Part 2-106: Particular requirements for heated carpets and for heating units for room heating installed under removable floor coverings

IEC 60529

Degrees of Protection Provided by Enclosures (IP Code)

Institute of Electrical and Electronics Engineers**IEEE 515.1-2012**

IEEE Standard for the Testing, Design, Installation, and Maintenance of Electrical Resistance Trace Heating for Commercial Applications

National Fire Protection Association Standards

NFPA 70

National Electrical Code (NEC), 2017 Edition

4 Glossary

4.1 For the purpose of this standard, the following definitions apply.

4.2 **ASSEMBLY KIT** – Part(s) needed in the field installation for assembly of a heating system provided by the heating system manufacturer. Common assembly kits include splice connection kit, end seal kit, securement hardware kit, etc.

4.3 **BONDING** – The joining of metallic parts to form an electrically conductive path that provides electrical continuity and the capacity to conduct any current likely to be imposed without a risk of electric shock, fire, or injury to persons.

4.4 **CARRIER (SCRIM OR MESH)** – Part of a cable-based mat product, such as a mesh, fabric, or similar material, used to bind or arrange the cable in a preset configuration at the factory. Serves to maintain spacing of heating cable between adjacent runs and to facilitate installation. A carrier may provide some mechanical protection for the product but does not serve as an electrical or fire enclosure. Applied to one or both sides of the product. The heating cable is either visible or fully covered after being mated with the carrier.

4.5 **COMBUSTIBLE MATERIAL** – A material that is not inherently resistant to ignition and flame spread, used in buildings for subfloors and ceiling. Includes gypsum board, wood, adhesives, etc. May include underlayment, floor coverings, carrier, etc.

4.6 **COMBUSTION RESISTANT MATERIAL** – A material known to be resistant to ignition and flame spread used in buildings for subfloors, floor coverings, ceilings, and adjacent walls. Includes metal, concrete, masonry, cement board, thinset, floor leveler, etc.

4.7 **CONDUCTORS, EXPOSED** – With reference to a low voltage heating system. Current carrying wire, bus bars, and heating elements intended for use with a power unit provided with overcurrent protection in case of shorting or overloading may be constructed of conductors with or without insulation.

4.8 **CONSTANT WATTAGE HEATING ELEMENT** – A heating element that has approximately the same power consumption over a temperature range of a typical heating system installation. Examples include elements made with resistance wire.

4.9 **EMBEDDED** – Fully covered on top and bottom with combustion resistant material, such as thinset, mortar, sand, concrete, etc. A heating system not covered on all surfaces is not considered embedded.

4.10 **ENCLOSURE** – The part of a heating system that does one or more of the following:

- a) Renders inaccessible all or any part(s) of the heating system that may present a risk of electric shock.
- b) Retards propagation of flame initiated by electrical disturbances occurring within the heating system.

4.11 FLOOR COVERING – A finished top surface of a floor exposed to the room, such as hardwood, tile, stone, linoleum, laminate, decorative concrete, or carpet. Intended to be a permanent part of the building.

4.12 FLOATING (FLOOR COVERING) – A finished top surface of a floor exposed to the room, that does not need to be nailed, adhered, or otherwise secured to the subfloor. Often consist of panels of tile, stone, laminate, wood, vinyl, or the like. The panels may incorporate an underlayment. The panels are mechanically secured together by interlocking or adhesive.

4.13 GROUND (GROUNDING) – A connection (conductor) between an electrical circuit or accessible metal part of a heating system and the earth. A direct physical conducting connection to the earth.

4.14 GROUND-FAULT CIRCUIT-INTERRUPTER (GFCI) – A device intended for the protection of personnel that functions to de-energize a circuit or portion thereof within an established period of time when a current to ground exceeds the values established for a Class A device. Class A ground-fault circuit interrupters trip when the current to ground is 6 mA or higher and do not trip when the current to ground is less than 4 mA. For further information, see UL 943 , Standard for Ground-Fault Circuit Interrupters. These devices are intended for use on alternating current (AC) circuits of 120 V, 208Y/120 V, 120/240 V, 127 V, or 220Y/127 V, 60 Hz circuits.

4.15 GROUNDING COMPONENT – A metal covering, sheath, or braid that is to be connected to protective earth ground and intended to operate a circuit protection device in the event live parts are short circuited to the grounding component. Intended to reduce the risk of electric shock.

4.16 HEATING CABLE ELEMENTS (HEATING CABLE) – A insulated cable that is intended to heat by means of electrical resistance.

4.17 HEATING CABLE SYSTEM – A complete system that consists of non-heating leads, heating cable, integral components, mounting hardware, power unit (for a low voltage heating system), installation instructions, and marking labels. The system can be provided on a spool or attached to a carrier. A heating cable system is considered a heating panel system when it is installed in a rigid or non-rigid enclosure.

4.18 HEATING ELEMENT – The portion of the electric heating system that, by means of electrical resistance, is provided for the intent of heating. Can be a heating cable, flat strip, heating ribbon, or laminate heating element.

4.19 HEATING PANEL SYSTEM – A rigid or non-rigid heating panel assembly employing a heating cable element or laminate heating element and provided with non-heating leads or a terminal junction assembly identified as being suitable for connection to a wiring system. A complete system that consists of non-heating leads, heating cable, integral components, mounting hardware, power unit (for a low voltage heating system), installation instructions, and marking labels.

4.20 HEATING SYSTEM – A complete system consists of non-heating leads, heating element, integral components, a power unit (for a low voltage heating system), installation instructions, and marking labels. The system may be provided with any associated controls, protective devices, and installation hardware or materials. Can employ heating cable elements or laminate heating elements.

4.21 INTEGRAL COMPONENT – Assemblies such as end seals and splices which may be exposed to the same environments as the rest of the heating system. The assemblies typically consist of connectors, and insulation, such as shrink tubing enclosure or a molded enclosure. May be assembled at a factory or in the field.

4.22 ISOLATED – Electrically separated from line voltage via an isolating transformer such that no common ground reference is shared between the primary and secondary side of the isolating device. An isolating transformer has the primary and secondary windings galvanically / electrically separated with basic insulation, and also includes a protective partition between primary and all secondary circuits.

4.23 LAMINATE HEATING ELEMENT (LAMINATE ELEMENT) – An insulated electric heating panel composed of sheets of electrical insulating material (as required) enclosing a metallic or carbon-based heating material and is intended to provide heat.

4.24 LOW VOLTAGE – For the purpose of this standard, low voltage is limited to 25 amperes and operates at or below the risk of electric shock voltages. May still present a risk of fire.

4.25 LOW VOLTAGE HEATING SYSTEM – See Heating System. Additionally, limited to 25 amperes, operates at or below the risk of electric shock voltage and is intended to be powered by a low voltage supply. The system may be provided with associated controls, protective devices, and installation hardware or materials. The power source may consist of a means for connecting to building supply power, together with a power unit to convert from line voltage to low voltage, or by a direct dc low voltage source (e.g. solar, battery, etc.). Low voltage heating systems may still present a risk of fire.

4.26 MEMBRANE – A layer of material used in the installation of a heating system. Often provided to serve as a vapor barrier, cushioning, flame barrier, to provide mechanical protection, crack prevention, or as a sound reducer.

4.27 MODULAR FLOORING HEATING PANEL SYSTEM (MODULAR FLOORING SYSTEM) – A solid-surface panel intended to be a floor covering that incorporates a heating element. The materials used can provide mechanical protection to electrical components and may consist of tile, stone, wood laminate, wood, vinyl, or the like. The panels are mechanically secured together by interlocking or adhesive.

4.28 NON-HEATING LEADS – The leads of a heating system that are not intended to consume electrical energy for the purpose of heating, usually used to connect the heated portion to the source of power.

4.29 OCCUPIED SPACE – For the purpose of this standard, a room or enclosed space designed for human occupancy or use (i.e. kitchens, bedrooms, bathrooms, rooms, hallways, etc.).

4.30 PARALLEL HEATING ELEMENT (SERIES/PARALLEL ELEMENT) – A heating element that is constructed electrically in parallel; or in discrete zones of series heating elements (series/parallel element).

4.31 PERM VALUE – A measure of the ability to pass water vapor through a specific material. Usually used for building materials such as a vapor barrier, membrane, or plywood. A lower perm value allows less moisture to pass through, thus providing better resistance to moisture. A perm is a measure at 23°C of the number of grains of water vapor passing through a square foot of material per hour at a differential vapor pressure equal to one inch of mercury (1" W.C.). 1.0 US perm = 1.0 grain/square-foot-hour-inch of mercury $\approx$ 57 SI perm = 57 ng/s·m²·Pa. Any material with a perm rating of less than 1.0 is considered to be impermeable.

4.32 POWER UNIT – The equipment that powers low voltage heating systems. For the purpose of this standard, a power unit has all of the following characteristics:

- a) An isolating transformer or isolating electronic power supply of output voltage not exceeding the risk of electric shock voltage; and
- b) Employs a suitable enclosure; and
- c) Is intended for field installation; and
- d) Each secondary circuit is limited to 25 amperes under described loading conditions.

NOTE: Reference; NEC NFPA 70, Section 424.101(A).

4.33 R VALUE – The degree of thermal resistance of a material, expressed in the U.S. as $R = \text{ft}^2 \cdot ^\circ\text{F} \cdot \text{h} / \text{Btu}$. Commonly used with reference to building materials (insulation, wood, floor coverings, etc.), where materials with a higher R-value provide a higher insulating value.

4.34 RIGID AND SEMI-RIGID FLOORING – For the purpose of this standard, decorative floor coverings having a solid or multiple layer product structure that provide some level of mechanical protection for a heating system. Can be plank or tile format. Can be floating, nailed, or adhered to the subfloor. Can incorporate an underlayment. Intended to be mechanically secured together by interlocking or adhesive. Does not include carpet.

4.35 RISK OF ELECTRIC SHOCK – A risk of shock exists between any two uninsulated conductive parts, or between an uninsulated conductive part and earth ground, if the continuous current flow through a 1500 ohm resistor in parallel with a 0.015 μF capacitor connected between the two points exceeds 0.5 mA and if the open circuit voltage exceeds the following limits in Table 4.1 under normal use and abnormal use conditions.

Table 4.1
Risk of electric shock voltage limits

Waveform type ^a	Maximum voltage, dry locations
Sinusoidal ac	30 V rms
Non-sinusoidal ac	42.4 V peak
Continuous dc ^b	60 V
10 – 200 Hz interrupted dc ^c	24.8 V
^a For a combined ac + dc waveform, the dry and damp location voltage limit shall be the non-sinusoidal ac limit where the dc voltage is no more than 20.9 V, and shall be $(33 + 0.45V_{dc})$ where the dc voltage is greater than 20.9 V.	
^b If the peak-to-peak ripple voltage on a dc waveform exceeds 10% of the dc voltage, the waveform shall be considered a combined waveform per footnote a above.	
^c Contact with interrupted dc at a lower or higher frequency shall be permitted only after a special investigation based on the specific waveform parameters.	

4.36 RISK OF FIRE – A risk of fire is considered to exist between any two points in a circuit where the open circuit voltage is more than risk of electric shock values and the energy available to the circuit under any condition of load including short circuit, results in a current of 8 A or more after one minute of operation.

4.37 SELF-REGULATING (ELEMENT) – A heating element made with a conductive material whose resistance varies with temperature. The power consumption varies in response to an increase or decrease in the actual temperature in the immediate vicinity of the element. Typically self-regulating heating elements have a positive temperature coefficient (PTC) characteristic; resistance increases with an increase in temperature.

4.38 SERIES HEATING ELEMENT – A heating element that uses a high resistance conductor in order to generate heat through electrical resistance. The total resistance varies with length due to being constructed electrically in series. At all temperatures, the total wattage varies with length while the wattage per foot remains constant.

4.39 SUBFLOOR – A structural layer of a floor on top of which a floor covering is commonly installed. Common subfloor materials include plywood, wood, concrete, or similar materials.

4.40 TEMPERATURE REGULATING DEVICE – A component, control, or device that regulates the temperature of the floor, the room, or both, and turns the power on and off to the heating system when the area being monitored reaches a set point temperature. Typically separate from the system but installed at the same time as the system installation.

4.41 TEMPERATURE STABILIZATION – A temperature is considered to be stabilized when three successive readings taken at 15 minute intervals are within 1°C of one another and are not rising.

4.42 THINSET – Also called thinset mortar, thinset cement, thinset adhesive. A blend of cement, sand, and a water retention compound that allows the cement to properly hydrate and set. Considered to provide protection and secureness for a heating systems.

4.43 UNDERLAYMENT – A material that is placed under floor covering and above the subfloor and is an intended barrier for waterproofing, thermal insulation, sound dampening, crack prevention or to protect the heating system from physical damage.

4.44 VAPOR BARRIER – A layer of material used during installation to prevent or reduce moisture from passing through. Also known as a vapor diffusion retarder (when the perm value is less than 1.0) or water barrier.

4.45 WATT DENSITY – The electrical power consumption at a defined temperature of a heating element in watts per unit area. Given in units of W/ft² or W/m². Often used as an indicator of heat output (higher watt density equals higher heat output).

4.46 WET LOCATION – Locations subject to saturation with water after installation. For the purposes of this standard, a wet location is considered to include installations underground, in concrete slabs that are in direct contact with the earth, or in shower areas depending on the installation.

5 Application of Requirements

5.1 This Standard is comprised of two parts. Part 1 consists of requirements that are to be applied to all heating systems unless otherwise specified. Part 2 consists of requirements for specific system designs and for specific system installation locations and methods. The requirements contained in Part 2 supplement or modify the requirements in Part 1 as specified. A specific system design and installation may result in the application of more than one set of requirements in Part 2.

CONSTRUCTION – ALL HEATING SYSTEMS

6 General

6.1 Also see Part 2 for requirements for specific heating system designs and installations.

6.2 A heating system shall be provided as a complete system as defined by 4.20.

6.3 The heating system shall be designed such that the installation can be done in a consistent and controlled manner. Any permitted variations with the installation within the intended parameters shall not increase risk of fire, risk of electric shock, or risk of injury to persons.

6.4 Low voltage systems are not prohibited from being evaluated to line voltage requirements.

6.5 A heating system intended to be installed in any of the following locations shall be supplied from a Class A, ground-fault circuit-interrupter (GFCI) upon installation.

- a) Installed inside concrete subfloor of bathrooms, kitchens, or hydromassage bathtub locations; or
- b) Installed under floor coverings and above a subfloor; or
- c) Installed in wet locations; or
- d) Modular flooring heating panel systems.

NOTE: Reference; NEC NFPA 70, Section 424.44(E), 424.45(E), 424.99(B)(5).

6.6 An underlayment that is installed between a subfloor and the heating system and is relied on to protect electrical parts from physical damage must be provided with the system or be an inherent part of the system. The heating product with underlayment shall meet mechanical tests in this standard when specified.

6.7 A heating system can be factory assembled or field assembled or a combination of the two. Field assembly shall not require the soldering of electrical connections.

7 Components

7.1 A component of a heating system covered by this Standard shall comply with all of the following:

- a) Comply with the requirements for that component as indicated in subsequent items of this section; and
- b) Be used in accordance with its rating(s) established for the intended conditions of use; and
- c) Be used within its established use limitations or conditions of acceptability; and
- d) Additionally comply with the applicable requirements of this end product Standard.

Specific components are incomplete in construction features or restricted in performance capabilities. Such components that are intended for use only under limited conditions, such as certain temperatures not exceeding specified limits, shall be used only under those specific conditions.

**UL COPYRIGHTED MATERIAL –
NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
DISTRIBUTION WITHOUT PERMISSION FROM**

Documents
Document Sharing Hub

Exception No. 1: A component of a heating system covered by this Standard is not required to comply with a specific component requirement that:

- a) Involves a feature or characteristic not required in the application of the component in the system; or*
- b) Is superseded by a requirement in this standard; or*
- c) Is separately investigated when forming part of another component, provided the component is used within its established ratings and limitations.*

Exception No. 2: A component complying with a component standard other than those cited in Sections 7.2 – 7.9, or in other sections of this standard is acceptable if the component standard:

- a) Is compatible with the ampacity and overcurrent protection requirements in the National Electrical Code (NEC), NFPA 70, where appropriate; and*
- b) Considers long-term thermal properties of polymeric insulating materials in accordance with the Standard for Polymeric Materials - Long Term Property Evaluations, UL 746B; and*
- c) Any use limitation of the other component standard is identified and appropriately accommodated in the end use application. For example, a component used in a household application, but intended for industrial use and complying with the relevant component standard may assume user expertise not common in household applications.*

7.2 A component that is also intended to perform other functions, such as over current protection, ground-fault circuit-interruption, surge suppression, any other similar functions, or any combination thereof, shall comply additionally with the requirements of the applicable standard(s) that cover devices that provide those functions.

Exception: Where these other functions are not required for the application and not identified as part of markings, instructions, or packaging for the appliance, the additional component standard(s) need not be applied.

7.3 A component not anticipated by the requirements of this Standard, not specifically covered by the component standards covered by this Standard, and that involves a potential risk of electric shock, risk of fire, or personal injury, shall be additionally investigated in accordance with the applicable standard, and shall comply with 7.1(b)-(d).

7.4 With regard to a component being additionally investigated, reference to construction and performance requirements in another UL end product standard is appropriate where that standard anticipates normal and abnormal use conditions consistent with the application of this Standard.

7.5 Controls

7.5.1 A control shall comply with the Standard for Automatic Electrical Controls for Household and Similar Use; Part 1: General Requirements, UL 60730-1. Protective temperature controls shall additionally comply with Part 2: Particular Requirements for Temperature Sensing Controls, UL 60730-2-9.

7.6 Gaskets and seals

7.6.1 Gaskets and seals shall comply with the Standard for Gaskets and Seals, UL 157.

7.7 Ground-fault circuit-interrupters

7.7.1 Ground-Fault Circuit-Interrupters (GFCI) for protection against electrical shock shall comply with the Standard for Ground-Fault Circuit-Interrupters, UL 943.

7.8 Internal wiring

7.8.1 Wiring within an enclosure composed of insulated conductors shall comply with one of the following standards.

- a) Appliance Wiring Material, UL 758; or
- b) Thermoset-Insulated Wires and Cables, UL 44; or
- c) Thermoplastic-Insulated Wires and Cables, UL 83; or
- d) The applicable UL standard(s) for other insulated conductor types specified in Chapter 3, Wiring Methods and Materials, of the National Electrical Code (NEC), NFPA 70.

7.9 Overcurrent protection

7.9.1 Fuses shall comply with the Standard for Low-Voltage Fuses - Part 1: General Requirements, UL 248-1; and the applicable UL 248 Part 2 (e.g. UL 248-5). Defined-Use fuses that comply with UL 248-1 and any another appropriate UL standard for the fuse are considered to fulfill this requirement.

7.9.2 Circuit breakers shall comply with the Standard for Molded-Case Circuit Breakers, Molded-Case Switches and Circuit-Breaker Enclosures, UL 489.

7.9.3 Circuit breakers that have an integral ground-fault circuit-interrupter (GFCI) capability for protection against electrical shock shall additionally comply with the Standard for Ground-Fault Circuit-Interrupters, UL 943.

7.9.4 Circuit breakers that have an integral Arc-Fault Circuit-Interrupter (AFCI) capability for protection against electrical arc faults shall additionally comply with the Standard for Arc-Fault Circuit-Interrupters, UL 1699.

7.9.5 Supplementary protectors shall comply with the Standard for Supplementary Protectors for Use in Electrical Equipment, UL 1077.

7.10 Insulation, insulating bushings, and assembly aids

7.10.1 The requirements for insulation (e.g. tape, sleeving, tubing, bushings, assembly aids) are not specified unless the insulation or device is required to comply with Electrical Insulation, Section 20, or a performance requirement of this Standard. In such cases, the insulation shall comply with the following standards as applicable:

- a) Insulating tape shall comply with the Standard for Polyvinyl Chloride, Polyethylene, and Rubber Insulating Tape, UL 510; or
- b) Sleeving shall comply with the Standard for Coated Electrical Sleeving, UL 1441; or
- c) Tubing shall comply with the Standard for Extruded Insulating Tubing, UL 224.

7.10.2 Wire positioning devices shall comply with the Standard for Positioning Devices, UL 1565.

7.10.3 Insulating bushings shall comply with the requirements in 7.1 or the Standard for Insulating Bushings, UL 635. Tests specified in this end product Standard may still need to be performed to confirm the combination of the insulating bushing and the supporting part comply with the intent of the requirements.

8 Enclosures

8.1 Electrical parts shall be provided with or within an enclosure that meets this section, unless otherwise specified in this Standard.

8.2 Enclosure requirements for non-heating leads, heating cable elements, and laminate elements are not covered under this section and are covered under Sections 13 to 15, respectively.

8.3 Integral components with molded enclosures are covered under this section.

8.4 Integral components with insulating tubing enclosures and the like are also covered under Section 7.10.

8.5 A carrier that is part of a heating cable system that is intended to provide mechanical protection is covered under this section. This includes systems employing metal foil carriers intended to be used as a grounding component. The requirements for a carrier not intended to provide mechanical protection are not specified.

8.6 The enclosure of a heating system shall be so formed and assembled so that it will have the strength necessary to resist the abuses likely to be encountered during its installation and intended use. The enclosure shall be resistant to damage, reduction of electrical spacings, loosening or displacement of parts, and other serious defects which create a risk of fire, electric shock, or injury to persons.

8.7 The factors taken into consideration when an enclosure is being judged for acceptability are its mechanical strength, resistance to impact, moisture-absorption properties, flammability, resistance to corrosion, and resistance to distortion or delamination at temperatures at which the enclosure may be subjected to under conditions of intended or abnormal use.

8.8 Adhesives used to secure parts together and relied upon to maintain the proper functioning of the device with regard to the likelihood of risk of fire, or risk of electric shock, and injury to persons, shall meet Section 39 of the Standard for Polymeric Materials - Use in Electrical Equipment Evaluations, UL 746C.

Exception No. 1: An enclosure need not meet the adhesive requirements in UL 746C for parts of a heating system that is required to be embedded in combustion resistant material during installation.

Exception No. 2: Adhesive used in the construction of a modular floor heating system need not meet the adhesive requirements in UL 746C if degradation of the adhesive is not likely to result in non-compliance with this Standard.

8.9 Openings

8.9.1 All splices, open coil devices, capacitors, leads, terminals for field connection of supply wires, other arcing live parts and current carrying parts involving a risk of fire or risk of electric shock, shall be provided with an enclosure without any open holes.

Exception: Openings are able to be used when all uninsulated current carrying parts or splices involving a risk of electric shock as are not accessible by the accessibility probe shown in Figure 9.1.


8.9.2 An enclosure containing a fuse mounted in an open type fuseholder shall have no openings unless the opening is located 152 mm (6.0 in) or more from the fuse, measured horizontally, when the device is mounted as intended.

8.9.3 An enclosure shall have no openings or shall be provided with a barrier as described under 8.9.4 under any of the following locations:

- a) Under a transformer; or
- b) Under wire, unless the wire complies with the requirements of the Vertical Wires test in the Standard for Electrical Wires, Cables, and Flexible Cords, UL 1581, and is marked VW-1; or
- c) Under a switch, relay, solenoid, or similar component unless a short circuit or overload in the component does not result in a risk of fire.

8.9.4 The requirements in 8.9.3 necessitate the use of a metal barrier or a non-metallic barrier of a material having a zero flame spread rating when tested as described in the Standard for Tests for Surface Burning Characteristics of Building Materials, UL 723. The barrier shall be horizontal, shall be located as illustrated in Figure 8.1, and shall have an area in accordance with the illustration. Openings for ventilation, and the like, shall not be employed in the barrier unless such openings do not permit molten metal, burning insulation, or similar material, to fall onto flammable material.

**Figure 8.1
Barrier**

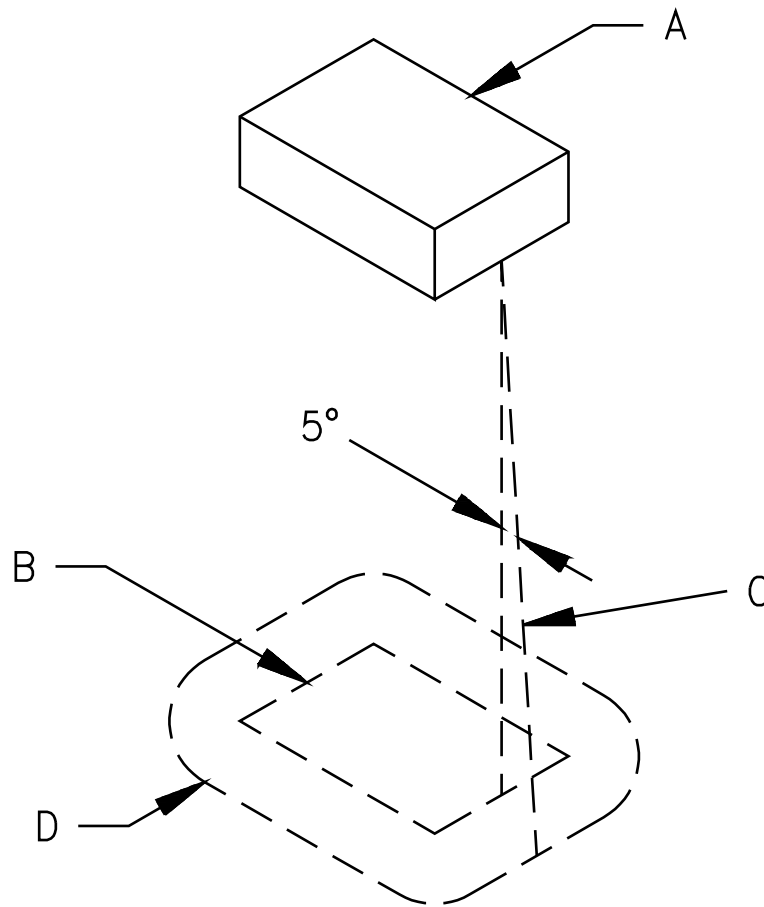

EB120A

A - Region to be shielded by barrier. This will consist of the entire component if it is not otherwise shielded and will consist of the unshielded portions of a component that is partially shielded by the component enclosure or equivalent.

B - Projection of outline of component on horizontal plane.

C - Inclined line that traces out minimum area of barrier. The line is always:

- 1) Tangent to the component; and
- 2) 5 degrees from the vertical; and
- 3) So oriented that the area traced out on a horizontal plane is maximum.

D - Location (horizontal) and minimum area for barrier. The area is that included inside the line of intersection traced out by the inclined line C and the horizontal plane of the barrier.

**UL COPYRIGHTED MATERIAL –
NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
DISTRIBUTION WITHOUT PERMISSION FROM UL**



Documents

Document Sharing Hub

8.10 Metal Enclosures

8.10.1 Cast and sheet metal portions of the enclosure shall be a minimum thickness as indicated in Table 8.1 unless the enclosure is found to be acceptable when judged under 8.10.2.

Exception: A metallic material used as a functional part of the heating system for mechanical protection, heat sink, grounding, etc. and that does not enclose uninsulated live parts is not required to meet this section.

8.10.2 In reference to 8.10.1, other than a surface on an enclosure to which a wiring system is to be connected to in the field, an enclosure of sheet metal can be thinner than specified in Table 8.1 when judged for its acceptability for a particular application and use of the heating system with respect to its size, shape, and the thickness of metal.

Table 8.1
Minimum acceptable thickness of enclosure metal

Metal	At small, flat, unreinforced surfaces and at surfaces that are reinforced by curving, ribbing and the like or are otherwise of a shape and/or size to provide physical strength		At surfaces to which a wiring system is to be connected in the field		At relatively large unreinforced flat surfaces	
	(mm)	(in)	(mm)	(in)	(mm)	(in)
Die-cast	(1.2)	3/64	-	-	(2.0)	5/64
Cast malleable iron	(1.6)	1/16	-	-	(2.4)	3/32
Other cast metal	(2.4)	3/32	-	-	(3.2)	1/8
Uncoated sheet steel	(0.66) ^a	0.026 ^a	(0.81)	0.032	(0.66)	0.026
Galvanized sheet steel	(0.74) ^a	0.029 ^a	(0.86)	0.034	(0.74)	0.029
Nonferrous sheet metal	(0.91) ^a	0.036 ^a	(1.14)	0.045	(0.91)	0.036

^a Thinner sheet metal may be employed if found to be acceptable when the enclosure is judged under considerations such as those mentioned in 8.10.2.

8.11 Nonmetallic enclosures

8.11.1 A polymeric enclosure shall comply with the applicable requirements in accordance with Table 4.1, Path III of the Standard for Polymeric Materials - Use in Electrical Equipment Evaluations, UL 746C. The requirements that apply shall be based on the enclosure type and location of use. For flammability requirements see Flammability, Section 10.

8.11.2 Heating systems employing a nonmetallic laminate fiberglass enclosure shall comply with the Standard for Polymeric Materials - Industrial Laminates, Filament Wound Tubing, Vulcanized Fibre, and Materials used in Printed Wiring Boards, UL 746E. For flammability requirements see Flammability, Section 10.

9 Accessibility of Live Parts

9.1 An electrical part of a heating system, installed in accordance with the manufacturer's installation instructions, shall be located or enclosed to provide protection against unintentional contact with uninsulated live parts that may involve a risk of electric shock.

9.2 To reduce the likelihood of unintentional contact that may involve a risk of electric shock from an uninsulated live part, an opening in an enclosure shall comply with one of the following:


- a) For an opening that has a minor dimension of 25.4 mm (1.0 in) or more, such a part or wire shall be spaced from the opening as specified in Table 9.1; or
- b) For an opening that has a minor dimension less than 25.4 mm (1.0 in), such a part or wire shall not be contacted by the probe illustrated in Figure 9.1.

NOTE: The minor dimension of an opening is the diameter of the largest cylindrical probe having a hemispherical tip that can be inserted through the opening.

Table 9.1
Minimum acceptable distance from an opening to a part that may involve a risk of electric shock

Minor dimension of opening ^a		Minimum distance from opening to part	
mm ^b	(in) ^b	mm ^b	(in) ^b
25.4	(1)	165.0	(6-1/2)
31.8	(1-1/4)	190.0	(7-1/2)
38.1	(1-1/2)	318.0	(12-1/2)
47.6	(1-7/8)	394.0	(15-1/2)
54.0	(2-1/8)	444.0	(17-1/2)
^c	^c	762.0	(30)
^a See 9.2.			
^b Between 19.1 mm (3/4 in) and 54 mm (2-1/8 in), interpolation is to be used to determine a value between values specified in the table.			
^c More than 54 mm (2-1/8 in), but not more than 152 mm (6.0 in).			

Figure 9.1
Articulate probe with web stop

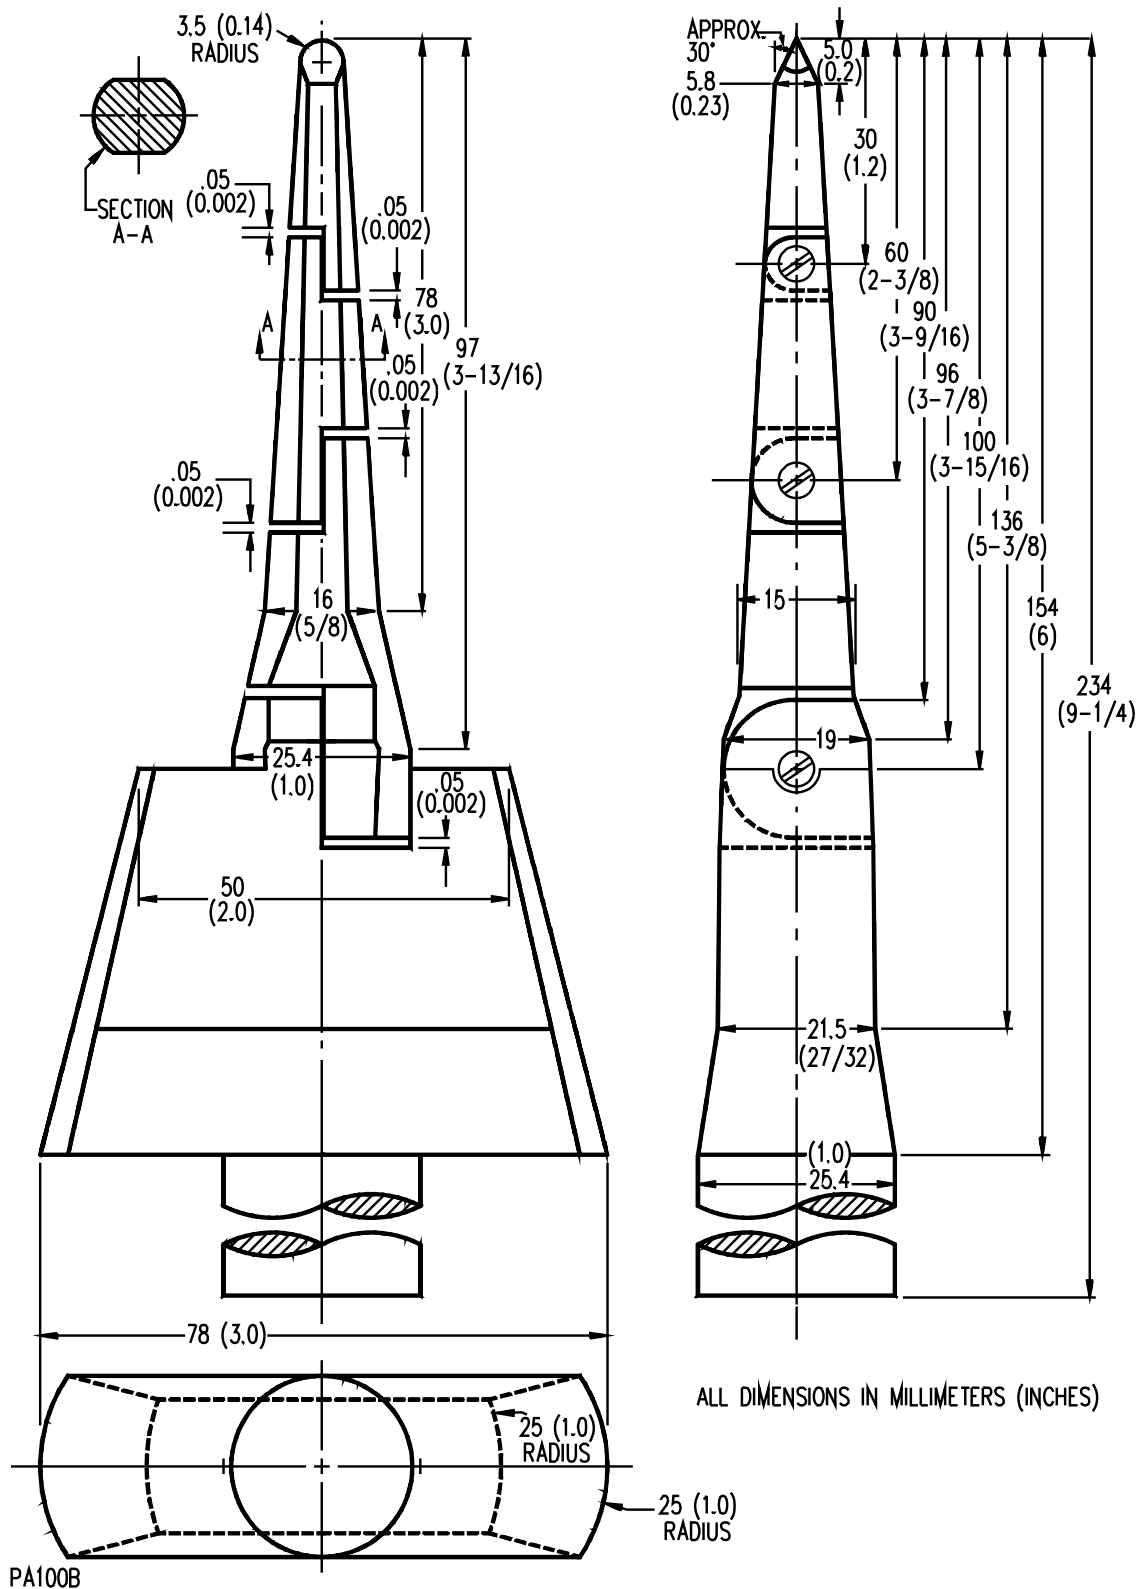

UL COPYRIGHTED MATERIAL –
NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
DISTRIBUTION WITHOUT PERMISSION FROM UL



Documents

Document Sharing Hub

9.3 The probe illustrated in Figure 9.1 shall be used as a measuring instrument to judge the accessibility provided by an opening, and not as an instrument to judge the strength of a material; it shall be applied with the minimum force necessary to determine accessibility.

10 Flammability

10.1 These requirements apply to all heating systems based on the construction described below. The requirements for the heating element, non-heating leads, and integral components may differ and shall be evaluated accordingly.

10.2 Heating systems employing nonmetallic materials including adhesives that are relied on for compliance with this Standard are to be subjected to the applicable test in this section and shall be tested as an assembly.

Exception No. 1: The carrier of a heating cable that is not serving as electrical insulation need not be part of the test.

Exception No. 2: Parts of a modular flooring heating system that are not serving as electrical insulation need not be part of the test.

10.3 The use of an applied flame-retardant coating shall be evaluated to and comply with Section 20 of the Standard for Polymeric Materials - Use in Electrical Equipment Evaluations, UL 746C.

10.4 Heating cables, non-heating leads, and integral components

10.4.1 Heating cables, non-heating leads, and integral components shall meet one of the following:

- a) Have a flame class rating of VW-1 in accordance with the Standard for Electrical Wires, Cables and Flexible Cords, UL 1581; or
- b) Meet the FV-2/VW-1 Flame Test, in accordance with the Standard for Wire and Cable Test Methods, UL 2556.

Exception: Heating cables, non-heating leads, and integral components that are intended to be embedded in combustion resistant material during installation shall be considered to satisfy this requirement when one of the following are met:

- a) Have a flame class rating of minimum HB or HBF in accordance with the Standard for Safety for Tests for Flammability of Plastic Materials for Parts in Devices and Appliances, UL 94; or
- b) Meet the 12 mm or 20 mm end-product flame test in accordance with the Standard for Polymeric Materials - Use in Electrical Equipment Evaluations, UL 746C.