



UL 498D

STANDARD FOR SAFETY

Attachment Plugs, Cord Connectors
and Receptacles with Arcuate (Locking
Type) Contacts

This document is only permissible for use by Anonymous User of University of Toronto. 8/26/2020 6:22:03 PM

UL Standard for Safety for Attachment Plugs, Cord Connectors and Receptacles with Arcuate (Locking Type) Contacts, UL 498D

First Edition, Dated July 29, 2020

SUMMARY OF TOPICS

This First edition of ANSI/UL 498D dated July 29, 2020 covers attachment plugs, receptacles, cord connectors, and inlets, with arcuate contacts (locking-type configurations), rated 20 or 30 of the non-grounding type or devices rated 15, 50 or 60 A grounding or non-grounding type.

The requirements are substantially in accordance with Proposal(s) on this subject dated March 27, 2020.

All rights reserved. No part of this publication may be reproduced, stored in a retrieval system, or transmitted in any form by any means, electronic, mechanical photocopying, recording, or otherwise without prior permission of UL.

UL provides this Standard "as is" without warranty of any kind, either expressed or implied, including but not limited to, the implied warranties of merchantability or fitness for any purpose.

In no event will UL be liable for any special, incidental, consequential, indirect or similar damages, including loss of profits, lost savings, loss of data, or any other damages arising out of the use of or the inability to use this Standard, even if UL or an authorized UL representative has been advised of the possibility of such damage. In no event shall UL's liability for any damage ever exceed the price paid for this Standard, regardless of the form of the claim.

Users of the electronic versions of UL's Standards for Safety agree to defend, indemnify, and hold UL harmless from and against any loss, expense, liability, damage, claim, or judgment (including reasonable attorney's fees) resulting from any error or deviation introduced while purchaser is storing an electronic Standard on the purchaser's computer system.

This document is only permissible for use by Anonymous User of University of Toronto. 8/26/2020 6:22:03 PM

No Text on This Page

This document is only permissible for use by Anonymous User of University of Toronto. 8/26/2020 6:22:03 PM



JULY 29, 2020



ANSI/UL 498D-2020

1

UL 498D

Standard for Attachment Plugs, Cord Connectors and Receptacles with Arcuate (Locking Type) Contacts

First Edition

July 29, 2020

This ANSI/UL Standard for Safety consists of the First Edition.

The most recent designation of ANSI/UL 498D as an American National Standard (ANSI) occurred on May 28, 2020. ANSI approval for a standard does not include the Cover Page, Transmittal Pages, and Title Page.

Comments or proposals for revisions on any part of the Standard may be submitted to UL at any time. Proposals should be submitted via a Proposal Request in UL's On-Line Collaborative Standards Development System (CSDS) at <https://csds.ul.com>.

UL's Standards for Safety are copyrighted by UL. Neither a printed nor electronic copy of a Standard should be altered in any way. All of UL's Standards and all copyrights, ownerships, and rights regarding those Standards shall remain the sole and exclusive property of UL.

COPYRIGHT © 2020 UNDERWRITERS LABORATORIES INC.

This document is only permissible for use by Anonymous User of University of Toronto. 8/26/2020 6:22:03 PM



Documents

Document Sharing Hub

No Text on This Page

This document is only permissible for use by Anonymous User of University of Toronto. 8/26/2020 6:22:03 PM



CONTENTS

INTRODUCTION

1	Scope	7
2	Components	8
3	Units of Measurement	8
4	Referenced Publications	8
5	Glossary	9

CONSTRUCTION

6	All Devices	12
7	Configurations	12
8	Insulating Materials	12
	8.1 General	12
	8.2 Flammability	12
	8.3 Electrical properties	13
	8.4 Thermal properties	14
	8.5 Vulcanized fiber	15
	8.6 Sealing compounds	15
	8.7 Fuse enclosures	15
9	Enclosure	15
	9.1 General	15
	9.2 Male faces and wire terminations	18
10	Current-Carrying Parts	19
	10.1 General	19
	10.2 Contacts	19
11	Grounding and Dead Metal Parts	20
12	Terminals	21
	12.1 General	21
	12.2 Wire-binding screw terminals	21
	12.3 Soldering lugs	22
	12.4 Pressure-wire terminals	22
	12.5 Combination wire binding/pressure-wire terminals	23
	12.6 Spring action clamp terminals	23
13	Cord Entry and Strain Relief	23
14	Spacings	24
15	Assembly	24
	15.1 General	24
	15.2 Grounding and polarization	25
	15.3 Mating and interchangeability	25
	15.4 Fuseholders	26
	15.5 Switches	27

ATTACHMENT PLUGS AND INLETS

16	Insulating Materials	27
17	Enclosure	27
	17.1 General	27
18	Grounding and Dead Metal Parts	27
19	Terminals and Leads	28
	19.1 Terminals	28
	19.2 Leads	28
	19.3 Inlet with spring action clamp terminal	29

This document is only permissible for use by Anonymous User of University of Toronto. 8/26/2020 6:22:03 PM

20	Assembly.....	29
21	Weatherproof Type.....	30

CORD CONNECTORS

22	Grounding and Dead Metal Parts.....	30
23	Assembly.....	30

RECEPTACLES

24	Insulating Materials	31
25	Enclosure	31
26	Grounding and Dead Metal Parts.....	31
	26.1 General.....	31
	26.2 Flush receptacles	32
27	Terminals and Leads	32
	27.1 General.....	32
	27.2 Leads	32
	27.3 Separable terminal assembly.....	33
	27.4 Receptacle with spring action clamp terminal	33
28	Assembly.....	34
	28.1 General.....	34
	28.2 Flush receptacles	34
	28.3 Surface-mount receptacles.....	35
29	Flush Plates.....	35
30	Self-Grounding Receptacles	36
31	Isolated-Ground Receptacles	36
32	Pendant Receptacles	36
33	Lighted Receptacle	36

PERFORMANCE

GENERAL

34	Representative Devices	37
----	------------------------------	----

ALL DEVICES

35	Comparative Tracking Index Test.....	41
36	Glow Wire Test.....	41
37	High-Current Arc Resistance to Ignition Test.....	41
38	Mold Stress Relief Test	42
39	Moisture Absorption Resistance Test	43
40	Dielectric Voltage-Withstand Test	43
	40.1 Devices for fixed or permanent installation.....	43
	40.2 Cord-connected devices.....	44
41	Accelerated Aging Tests	44
	41.1 General.....	44
	41.2 Rubber, EPDM, and TEE compounds.....	44
	41.3 PVC compounds and copolymers	45
42	Insulation Resistance Test	45
43	Conductor Secureness Test	45
44	Tightening Torque Test.....	46

ATTACHMENT PLUGS

This document is only permissible for use by Anonymous User of University of Toronto. 8/26/2020 6:22:03 PM

UL COPYRIGHTED MATERIAL – NOT AUTHORIZED FOR FURTHER REPRODUCTION OR DISTRIBUTION WITHOUT PERMISSION FROM UL



Documents

Document Sharing Hub

45	All Devices.....	46
46	Secureness-Of-Cover Test.....	46
47	Integrity of Assembly Test – General.....	46
48	Terminal Temperature Test.....	47
49	Fuseholder Temperature Test.....	47

INLETS

50	All Devices.....	48
51	Terminal Temperature Test.....	48
52	Fuseholder Temperature Test.....	49
53	Pressure-Wire Terminals.....	50
54	Combination Wire Binding/Pressure Wire-Type Terminals	51
55	Strength of Insulating Base Test	52
56	Spring Action Clamp Terminal Pull Test.....	52

CORD CONNECTORS

57	All Devices.....	53
58	Overload Tests	53
	58.1 General.....	53
	58.2 Current overload test	54
	58.3 Horsepower overload test.....	55
59	Temperature Test	56
60	Resistance to Arcing Test.....	57
61	Fuseholder Temperature Test.....	57
62	Potential Drop in Grounding Connections Test.....	58
63	Integrity of Assembly Test	58
64	Self-Hinged Cord Connectors.....	59
65	Self-Hinge Flexing Test.....	59

RECEPTACLES

66	All Devices.....	59
67	Overload Test.....	59
	67.1 General.....	59
	67.2 Current overload test	61
	67.3 Horsepower overload test.....	61
68	Temperature Test	62
	68.1 Contact and terminal temperature	62
	68.2 Feed-through terminal temperature	63
69	Resistance to Arcing Test.....	63
70	Fuseholder Temperature Test.....	64
71	Pressure-Wire Terminals.....	65
72	Combination Wire Binding/Pressure Wire-Type Terminals	66
73	Strength of Insulating Base Test	66
74	Spring Action Clamp Terminal Pull Test	66
75	Self-Grounding Receptacles	67
76	Fault Current Test.....	67
77	Receptacles Employing a Separable Terminal Assembly.....	70
78	Retention of Tab Connection Test	70
79	Separable Connector Pull Test	70
80	Mold Stress Relief Test	70
81	Dielectric Voltage-Withstand Test.....	71
82	Grounding Contact Temperature Test.....	71

83	Resistance Test.....	72
84	Latching Mechanism Test.....	72
85	Short Circuit Test.....	72
86	Continuity Impedance Test.....	73

RATINGS

87	Details	73
----	---------------	----

MARKINGS AND INSTRUCTIONS

88	General	75
	88.1 Details	75
	88.2 Location of markings and instructions.....	84
89	Identification and Marking of Terminals.....	85
	89.1 Grounded and grounding.....	85
	89.2 Other terminals.....	86
	89.3 Removable parts	87

ANNEX A (NORMATIVE) Wiring Device Configurations

This document is only permissible for use by Anonymous User of University of Toronto. 8/26/2020 6:22:03 PM

INTRODUCTION

1 Scope

1.1 These requirements cover attachment plugs, receptacles, cord connectors, and inlets, with arcuate contacts (locking-type configurations), rated 20 or 30 of the non-grounding type or devices rated 15, 50 or 60 A grounding or non-grounding type. All intended for connection to a branch circuit for use in accordance with the National Electrical Code, ANSI/NFPA 70.

1.2 These requirements do not cover plugs, socket outlets (receptacles), cord connectors, and inlets with arcuate contacts (locking-type configurations) rated 20 and 30 A grounding type, refer to the Standard for Plugs, Socket-Outlets and Couplers with Arcuate (Locking Type) Contacts, UL 498F.

1.3 These requirements do not cover devices rated at more than 200 A or for more than 600 V. See [6.1](#).

1.4 This Standard does not directly apply to, but supplements the following standards:

- a) Straight-blade attachment plugs, receptacles, cord connectors, and inlets, covered by the Standard for Attachment Plugs and Receptacles, UL 498;
- b) Attachment plugs, receptacles, cord connectors, and inlets with arcuate contacts (locking-type configurations) – Enclosure Types for Environmental Protection, UL 498E;
- c) Inlets with arcuate contacts (locking-type configurations) – Marine Shore Power Inlets, UL 498M;
- d) Devices produced integrally with flexible cord or cable, covered by the Standard for Cord Sets and Power-Supply Cords, UL 817;
- e) Current taps and adapters not provided with wiring terminals for flexible cord covered by the Standard for Current Taps and Adapters, UL 498A;
- f) Devices employing male or female screwshells, covered by the Standard for Lampholders, UL 496;
- g) Devices solely intended for direct connection to the branch circuit in accordance with the National Electrical Code, ANSI/NFPA 70, that are provided with contacts of the pin and sleeve type, covered by the Standard for Plugs, Receptacles and Cable Connectors of the Pin-and-Sleeve Type, UL 1682;
- h) Single and multipole connectors intended for factory assembly to copper or copper alloy conductors or printed wiring boards for use in data, signal, control and power applications within and between electrical equipment, covered by the Standard for Component Connectors for Use in Data, Signal, Control and Power Applications, UL 1977;
- i) Devices intended for installation and use in hazardous (classified) locations in accordance with the National Electrical Code, ANSI/NFPA 70, covered by the Standard for Explosion-Proof and Dust-Ignition-Proof Electrical Equipment for Use in Hazardous (Classified) Locations, UL 1203;
- j) Devices intended for use with telecommunications networks, covered by the Standard for Information Technology Equipment – Safety – Part 1: General Requirements, UL 60950-1, or the Standard for Communications Circuit Accessories, UL 1863;
- k) Devices incorporating ground-fault circuit interruption circuitry, covered by the Standard for Ground-Fault Circuit Interrupters, UL 943;
- l) Single- or two-outlet direct plug-in devices incorporating transient voltage surge suppression circuitry, covered by the Standard for Surge Protective Devices, UL 1449;

- m) Single- or two-outlet direct plug-in devices incorporating electromagnetic interference filter circuitry, covered by the Standard for Electromagnetic Interference Filters, UL 1283;
- n) Cord-connected, relocatable power taps intended only for indoor use as a temporary extension of a grounding alternating-current branch circuit for general use, covered by the Standard for Relocatable Power Taps, UL 1363; or
- o) Single pole locking-type separable connectors, covered by the Standard for Single Pole Locking-Type Separable Connectors, UL 1691.

2 Components

2.1 A component of a product covered by this Standard shall:

- a) Comply with the requirements for that component as specified in this Standard;
- b) Be used in accordance with its rating(s) established for the intended conditions of use; and
- c) Be used within its established use limitations or conditions of acceptability.

2.2 A component of a product covered by this Standard is not required to comply with a specific component requirement that:

- a) Involves a feature or characteristic not required in the application of the component in the product;
- b) Is superseded by a requirement in this Standard; or
- c) Is separately investigated when forming part of another component, provided the component is used within its established ratings and limitations.

2.3 Specific components are incomplete in construction features or restricted in performance capabilities. Such components are intended for use only under limited conditions, such as certain temperatures not exceeding specified limits, and shall be used only under those specific conditions.

2.4 A component that is also intended to perform other functions such as overcurrent protection, ground-fault circuit-interruption, surge suppression, any other similar functions, or any combination thereof, shall comply additionally with the requirements of the applicable UL standard(s) that cover devices that provide those functions.

3 Units of Measurement

3.1 Values stated without parentheses are the requirement. Values in parentheses are explanatory or approximate information.

4 Referenced Publications

4.1 Any undated reference to a code or standard appearing in the requirements of this Standard shall be interpreted as referring to the latest edition of that code or standard.

4.2 The following publications are referenced in this Standard:

ANSI/NEMA WD6, *Standard are in accordance with Wiring Devices – Dimensional Specifications*
ANSI/NFPA 70, *National Electrical Code*

ASTM E28, *Standard Test Methods for Softening Point of Resins Derived from Pine Chemicals and Hydrocarbons, by Ring-and-Ball Apparatus*
UL 20, *Standard for General-Use Snap Switches*
UL 94, *Standard for Tests for Flammability of Plastic Materials for Parts in Devices and Appliances*
UL 98, *Standard for Enclosed and Dead-Front Switches*
UL 486A-486B, *Standard for Wire Connectors*
UL 486E, *Standard for Equipment Wiring Terminals for Use with Aluminum and/or Copper Conductors*
UL 496, *Standard for Lampholders*
UL 498, *Standard for Attachment Plugs and Receptacles*
UL 498A, *Standard for Current Taps and Adapters*
UL 498E, *Standard for Attachment Plugs, Cord Connectors and Receptacles – Enclosure Types for Environmental Protection*
UL 498F, *Standard for Plugs, Socket-Outlets and Couplers with Arcuate (Locking Type) Contacts*
UL 498M, *Standard for Marine Shore Power Inlets*
UL 514A, *Standard for Metallic Outlet Boxes*
UL 514B, *Standard for Conduit, Tubing, and Cable Fittings*
UL 514C, *Standard for Nonmetallic Outlet Boxes, Flush-Device Boxes, and Covers*
UL 746A, *Standard for Polymeric Materials – Short Term Property Evaluations*
UL 746B, *Standard for Polymeric Materials – Long Term Property Evaluations*
UL 746C, *Standard for Polymeric Materials – Use in Electrical Equipment Evaluations*
UL 746D, *Standard for Polymeric Materials – Fabricated Parts*
UL 796, *Standard for Printed-Wiring Boards*
UL 817, *Standard for Cord Sets and Power-Supply Cords*
UL 943, *Standard for Ground-Fault Circuit Interrupters*
UL 969, *Standard for Marking and Labeling Systems*
UL 1203, *Standard for Explosion-Proof and Dust-Ignition-Proof Electrical Equipment for Use in Hazardous (Classified) Locations*
UL 1283, *Standard for Electromagnetic Interference Filters*
UL 1449, *Standard for Surge Protective Devices*
UL 1681, *Standard for Wiring Device Configurations*
UL 1682, *Standard for Plugs, Receptacles and Cable Connectors of the Pin-and-Sleeve Type*
UL 1863, *Standard for Communications Circuit Accessories*
UL 1691, *Standard for Single Pole Locking-Type Separable Connectors*
UL 1977, *Standard for Component Connectors for Use in Data, Signal, Control and Power Applications*
UL 4248-1, *Standard for Fuseholders – Part 1: General Requirements*
UL 4248-4, *Standard for Fuseholders – Part 4: Class CC*
UL 4248-5, *Standard for Fuseholders – Part 5: Class G*
UL 4248-6, *Standard for Fuseholders – Part 6: Class H*
UL 4248-8, *Standard for Fuseholders – Part 8: Class J*
UL 4248-9, *Standard for Fuseholders – Part 9: Class K*
UL 4248-11, *Standard for Fuseholders – Part 11: Type C (Edison Base) and Type S Plug Fuse*
UL 4248-12, *Standard for Fuseholders – Part 12: Class R*
UL 4248-15, *Standard for Fuseholders – Part 15: Class T*
UL 60950-1, *Standard for Information Technology Equipment – Safety – Part 1: General Requirements*
UL 61058-1, *Standard for Switches for Appliances – Part 1: General Requirements*

5 Glossary

5.1 For the purposes of this standard the following definitions apply.

5.2 **APPLIANCE COUPLER** – A single-outlet, female contact device for attachment to a flexible cord as part of a detachable power-supply cord to be connected to an inlet (motor attachment plug).

5.3 **ATTACHMENT PLUG** – A male contact device for the temporary connection of a flexible cord or cable to a receptacle, cord connector, flanged equipment power outlet, or other outlet device.

5.4 BULK SHIPMENT – Any packaging container having more than one receptacle not provided with a unit container.

5.5 CONFIGURATION, LOCKING – A device having a configuration that requires a motion other than a straight push or pull to connect or separate it when used with its mating part.

5.6 CORD CONNECTOR – A female contact device to be wired on flexible cord for use as an extension from an outlet to make a detachable electrical connection to an attachment plug or, as an appliance coupler, to an equipment inlet.

5.7 ELECTRICAL (FUNCTIONAL) INSULATION – The insulation necessary for the proper functioning of the product and for basic protection against electrical shock. This includes all parts relied upon to support live parts in place, all internal barriers necessary to maintain spacings, and the outlet face portion of all female devices.

5.8 ENCLOSURE – That part of the device that renders inaccessible all or any parts of the device that may otherwise present a risk of electric shock, retards propagation of flame initiated by electrical disturbances occurring within, or both.

5.9 FIXTURE, EQUIPMENT, OR APPLIANCE OUTLET – A receptacle outlet device for mounting on utilization equipment.

5.10 GROUNDING-CONDUCTOR PATH – A path between the grounding pin, blade, or contact and the grounding terminal or, if the device has no grounding terminal, the point at which the path makes contact with a part of the metal raceway system, such as a box, box cover, or the raceway itself.

5.11 GROUNDING DEVICE – A device having a L5-15, L6-15, TT-R, or ML-2R configuration, the standard configuration illustrated in the Hospital Use Only 2-Pole, 3-Wire Grounding-Type Locking Devices Rated 20 A, 125 V, Figure C1.1, of UL 1681, or a nonstandard configuration that employs one blade, pin, or contact exclusively for grounding.

5.12 HOUSING ADAPTER, ANGLE – A part that is intended to replace a portion of an attachment plug or cord connector housing so that the flexible cord exits the strain relief in the same plane as the face of the device.

5.13 HOUSING ADAPTER, SHROUD – A part that is intended to be assembled onto an attachment plug or cord connector to extend the housing beyond the plane of the face of the device.

5.14 INLET – (Motor Attachment Plug) A male contact device to be mounted on utilization equipment to provide an integral blade configuration for the connection of an appliance coupler or cord connector.

5.15 POLARIZED DEVICE – A device constructed for connection to a mating device only in the position that connects related poles of an electrical circuit.

5.16 RECEPTACLE, DUPLEX – A receptacle having two contact devices on a single mounting yoke for flush mounting in a plane surface.

5.17 RECEPTACLE, FLUSH – A receptacle which is intended for mounting in or on an outlet box, an outlet-box cover, or a flush-device cover plate for fixed installation on a branch circuit.

5.18 RECEPTACLE, ISOLATED GROUND – A receptacle having the grounding terminal electrically isolated from the system ground when installed in a metallic outlet box or raceway system.

This document is only permissible for use by Anonymous User of University of Toronto. 8/26/2020 6:22:03 PM

5.19 RECEPTACLE, LIGHTED – A receptacle employing an integral lens (jewel) and electrical or electronic components that produce light. Two basic types:

- a) Power Indicator type – Illuminates to indicate power is on.
- b) Illuminated/Nightlight – Illuminates when power is on and may not when controlled by a photoelectric sensor.

5.20 RECEPTACLE, PENDANT – Pendant receptacles include an enclosure with cover plate and strain relief means, intended to be assembled at the end of flexible cord, for use in branch circuit applications.

5.21 RECEPTACLE, SELF-GROUNDING – A receptacle which includes a spring clip or other part to provide for electrical continuity between the grounded device yoke and the mounting screw.

5.22 RECEPTACLE, SPLIT – A duplex receptacle having line terminals which are capable of being electrically separated.

5.23 RECEPTACLE, SURFACE-MOUNT – A receptacle which includes an enclosure and mounting means intended for surface mounting without the use of a separate outlet box in accordance with ANSI/NFPA 70.

5.24 TERMINAL, PRESSURE-WIRE – A terminal which establishes a connection between one or more conductors and a terminal plate by means of mechanical pressure without the use of solder. A pressure-wire terminal may be either of the following types:

- a) Clamp-Type – A pressure-wire terminal in which the conductor is held under a pressure plate or saddle clamp by one or more screws. This type of terminal may be provided in combination with a wire-binding screw terminal.
- b) Setscrew-Type – A pressure-wire terminal in which the pressure is applied by the end of the screw bearing on the conductor, either directly or through a wire-protecting pad.
- c) Combination Wire Binding/Pressure-Type – A wire binding screw with an integrally machined pressure ring. Pressure ring terminals accept both single and multiple conductors that are captured under the machine formed pressure ring. These terminals may be wired with a single conductor using the conventional 3/4 loop around the wire-binding screw.

5.25 TERMINAL, SPRING ACTION CLAMP – A terminal where the stripped end of a conductor is inserted into the terminal and a manually operated integral lever applies clamping pressure to a spring mechanism, without the use of screws.

5.26 TERMINAL, WIRE-BINDING SCREW – A terminal in which the conductor is bent around the screw and is clamped directly under the head of the screw when it is tightened.

5.27 TERMINAL ASSEMBLY, SEPARABLE – A two-piece terminal assembly provided with an integral mechanical latching mechanism(s). It consists of permanently attached pins or tabs located on the body of the receptacle and is capable of receiving a special purpose connector with leads for connection to the branch circuit.

5.28 THROUGH-WIRING – A wiring method which permits a group of receptacles to be wired in parallel to a common branch circuit.

5.29 UNIT CONTAINER – The smallest carton, package, or container, in which a receptacle is packaged. A unit container may contain more than one receptacle if they are not intended to be removed from the container for individual sale.

CONSTRUCTION

6 All Devices

6.1 The ratings mentioned throughout this Standard including those mentioned in [Table 87.1](#) represent maximum ampacity and maximum operating potential in volts for receptacles and other outlet devices such as cord connectors or current taps.

6.2 A device is considered to be for use on either alternating or direct current unless the rating includes the letters "ac" to restrict the use to alternating current.

7 Configurations

7.1 The NEMA configurations of various attachment plug and receptacle combinations referenced in ANSI/NEMA WD6 are included in Annex [A](#) for ease of reference. The figures referenced as Section C1, Non-NEMA Plugs and Receptacles, contain non-NEMA configurations and are found in UL 1681.

8 Insulating Materials

8.1 General

8.1.1 All parts that act as the electrical insulation or enclosure of a device shall be made of an insulating material intended for the particular application and shall comply with the requirements in [8.2.1](#) – [8.4.1](#). Hard rubber shall not be employed.

Exception No. 1: The internal insulating systems of components where component requirements exist are not required to comply with the requirements in [8.2.1](#) – [8.4.1](#).

Exception No. 2: A small part meeting all of the following criteria is not required to comply with the requirements in [8.2.1](#) – [8.4.1](#):

- a) Its volume does not exceed 0.122 cubic inch (2 cm³),*
- b) Its maximum dimension does not exceed 1.18 inches (3 cm), and*
- c) Its location is such that it cannot propagate flame from one area to another or act as a bridge between a possible source of ignition and other ignitable parts.*

Exception No. 3: Fiber or similar material that is equal to or less than 0.010 inch (0.25 mm) thick is not required to comply with the requirements in [8.2.1](#) – [8.4.1](#).

8.1.2 A polymeric material used for electrical insulation or enclosure of live parts shall be fabricated in accordance with UL 746D.

Exception: A polymeric material that is fabricated in the same location where final assembly takes place and where no blending or compounding operations are involved is not required to comply with this requirement.

8.2 Flammability

8.2.1 A polymeric material used for electrical insulation or enclosure of live parts shall have a flame class rating of HB, V-2, V-1, V-0, VTM-2, VTM-1, or VTM-0 in accordance with the requirements of UL 94. The flame class rating of the material shall be judged at the minimum thickness employed at the walls and barriers in the device which are critical to the functioning of the insulation or enclosure of the device.

Exception : A polymeric material that complies with either the 3/4-inch (12 mm or 20 mm) flame flammability test described in UL 746C, need not have a flammability class rating.

8.3 Electrical properties

8.3.1 A polymeric material used for electrical insulation or enclosure of live parts shall have a Comparative Tracking Index (CTI) rating of 175 V or greater or a performance level class of at least 3.

Exception No. 1: A polymeric material used for electrical insulation or enclosure of live parts is not required to comply with this requirement if it complies with the Comparative Tracking Index Test, Section [35](#).

Exception No. 2: A polymeric material used in an enclosure that is separated through air by more than 1/32 inches (0.8 mm) from uninsulated live parts and more than 1/2 inch (12.7 mm) from arcing parts is not required to comply with this requirement.

8.3.2 A polymeric material used for electrical insulation or enclosure of live parts shall have Hot Wire Ignition (HWI) and High-Current Arc Resistance to Ignition (HAI) ratings or performance level classes of at least those shown in [Table 8.1](#) for the flame class rating determined in accordance with [8.2.1](#). For materials with other than VTM flammability classifications, the HWI and HAI ratings of the material shall be evaluated using the specimen thickness employed in the end product or nominal 1/8 inch (3.2 mm) thickness, whichever is greater.

Exception No. 1: A polymeric material used for electrical insulation or enclosure of live parts is not required to comply with the HWI requirements if it complies with the Glow Wire Test, Section [36](#).

Exception No. 2: A polymeric material used for electrical insulation or enclosure of live parts is not required to comply with the HAI requirements if it complies with the High-Current Arc Resistance to Ignition Test, Section [37](#).

Exception No. 3: A polymeric material used in an enclosure of an attachment plug or cord connector which does not enclose live parts, or which encloses insulated live parts where the insulation thickness is greater than 0.028 inches (0.71 mm), is not required to comply with the HWI requirements.

Exception No. 4: A polymeric material used in an enclosure that is separated through air by more than 1/32 inches (0.8 mm) from uninsulated live parts and more than 1/2 inch (12.7 mm) from arcing parts is not required to comply with the HWI and HAI requirements.

Table 8.1
Hot Wire Ignition (HWI) and High-Current Arc Resistance to Ignition (HAI) Ratings of Insulating Materials

Flammability classification ^a	HWI ^{b,d}		HAI ^{c,d}	
	Mean ignition time (sec)	PLC	Mean no. of arcs	PLC
V-0, VTM-0	7 and up to 15	4	15 and up to 30	3
V-1, VTM-1 ^e	15 and up to 30	3	15 and up to 30	3
V-2, VTM-2	15 and up to 30	3	15 and up to 30	3
HB	30 or more	2	60 or more	1

^a Flammability classification – Described in UL 94.

^b Hot Wire Resistance to Ignition – Described in UL 746A.

This document is only permissible for use by Anonymous User of University of Toronto. 8/26/2020 6:22:03 PM

Table 8.1 Continued

Flammability classification ^a	HWI ^{b,d}		HAI ^{c,d}	
	Mean ignition time (sec)	PLC	Mean no. of arcs	PLC
^c High-Current Arc Resistance to Ignition – Described in UL 746A. ^d Mean ignition time and mean no. of arcs to be used to evaluate Filament Wound Tubing, Industrial Laminates, Vulcanized Fiber, and similar polymeric materials only. All other materials are to be judged using the performance level class values. ^e A polymeric material subjected to the flammability test with either the 3/4-inch (12 mm or 20 mm) flame in accordance with the Exception to 8.2.1 shall comply with the PLC for a V-1 rating.				

8.4 Thermal properties

8.4.1 A polymeric material used for electrical insulation or enclosure of live parts shall have the relative thermal index ratings shown in Table 8.2 for the specific application of the insulating material. For materials with other than VTM flammability classifications, the material shall be evaluated using the specimen thickness employed in the end product or nominal 1/8 inch (3.2 mm) thickness, whichever is greater.

Exception: The following generic materials having readings of 65 or less on the Shore Durometer D scale [when measured for five seconds at an ambient temperature of 23.0 ±2.0°C (73.4 ±3.6°F)] are acceptable for use at 60°C (140°F) based on their successful completion of the appropriate accelerated aging test described in Accelerated Aging Tests, Section 41:

- a) Ethylene/Propylene/Diene (EPDM)
- b) Natural Rubber (NR)
- c) Neoprene (Chloroprene Butadiene) Rubber (CBR)
- d) Nitrile Rubber (NBR)
- e) Polyvinyl Chloride (PVC) and its copolymers
- f) Silicone Rubber (SIR)
- g) Styrene (Butadiene) Rubber (SBR)
- h) Thermo Elastomeric [TEE; includes Thermoplastic Elastomers (TPE) and Ethylene Propylene Thermoplastic Rubber (EPTR)]

Table 8.2
Minimum Relative Thermal Indices of Insulating Materials Used in Insulation and Enclosure Applications

Application	Minimum relative thermal index ^a , Degrees C		
	Electrical	Mechanical with impact ^b	Mechanical without impact
Permanently-wired devices (including appliance, fixture and equipment outlets, inlets, and receptacles)	80°C	60°C	80°C
Cord-connected devices (including attachment plugs, and cord connectors)	60°C	60°C	60°C

This document is only permissible for use by Anonymous User of University of Toronto. 8/26/2020 6:22:03 PM

Table 8.2 Continued

Application	Minimum relative thermal index ^a , Degrees C		
	Electrical	Mechanical with impact ^b	Mechanical without impact
^a Relative Thermal Index – Described in UL 746B. ^b For industrial laminates, vulcanized fiber, and similar polymeric materials, the material's minimum RTI for Mechanical shall be evaluated using the values specified for Mechanical Without Impact. ^c For devices containing fuses, the minimum thermal indices shall be the values shown above or the temperature measured on the insulating material during the Fuseholder Temperature Test, whichever is greater. See Sections 49 , 52 , 61 , and 67 .			

8.5 Vulcanized fiber

8.5.1 Vulcanized fiber is not prohibited from being used for insulating washers, separators, and barriers, but shall not be used as the sole support of live parts.

8.5.2 Vulcanized fiber shall comply with the requirements in [8.2.1](#) – [8.4.1](#) and shall be moisture-resistant in accordance with [39.1](#) and [39.2](#).

8.6 Sealing compounds

8.6.1 A sealing compound shall be insulating, waterproof, and shall not soften at a temperature of 65°C (149°F). The softening point is to be determined using ASTM E28.

8.6.2 Sulphur shall not be employed as a sealing compound.

8.7 Fuse enclosures

8.7.1 A fuse enclosure shall be of a moisture-resistant material in accordance with [39.1](#) and [39.2](#). Fiber and similar absorptive materials shall not be used for the enclosure of a fuse.

8.7.2 A polymeric material classified as Type V-0, V-1, or V-2 is considered as having flammability properties acceptable for use as the enclosure of a fuse.

9 Enclosure

9.1 General

9.1.1 A device shall have live parts protected against exposure to contact by persons when fully assembled using all essential parts (described in [9.1.5](#)) and installed in the intended manner.

Exception No. 1: Male blades which are energized only when mated with the corresponding outlet are not required to comply with this requirement.

Exception No. 2: Exposed wiring terminals or other live parts enclosed within equipment or within an outlet box when the device is installed in the intended manner are not required to comply with this requirement.

9.1.2 Accessible dead-metal parts of a grounding device shall be conductively connected to the grounding-conductor path through the device.

Exception: Accessible dead-metal parts electrically insulated from current-carrying parts are not required to comply with this requirement.


9.1.3 Accessible dead-metal parts of a non-grounding device shall be electrically insulated from live parts and wiring other than the complete flexible cord so that they are unable to be energized by stray strands, failure of wiring terminals (such as loosening of screws), or damaged or broken wiring. When the stray strand length affects whether a device complies with this requirement, the device shall be marked in accordance with Reference No. 3 to [Table 88.1](#). See [9.1.7](#).

9.1.4 In order to judge the accessibility of a live or dead-metal part, the device is to be wired and assembled in accordance with the manufacturer's instructions, except that any nonessential parts (described in [9.1.6](#)) that are able to be opened or removed by the user without using a tool are to be opened or removed. The probe shown in [Figure 9.1](#) is to be applied with a force of not more than 3 lbf (13.3 N) to any depth that recessing will permit. The probe is to be rotated, changed in configuration, or angled before, during, and after application to any position that is necessary to examine the device. A live or dead-metal part is determined to be accessible when:

- a) The part is contacted by the probe, or
- b) The part is located in a hole larger than 9/32 inch (7.1 mm) in diameter and recessed less than 3/16 inch (4.8 mm).

This document is only permissible for use by Anonymous User of University of Toronto. 8/26/2020 6:22:03 PM

Figure 9.1
Articulate Probe with Web Stop

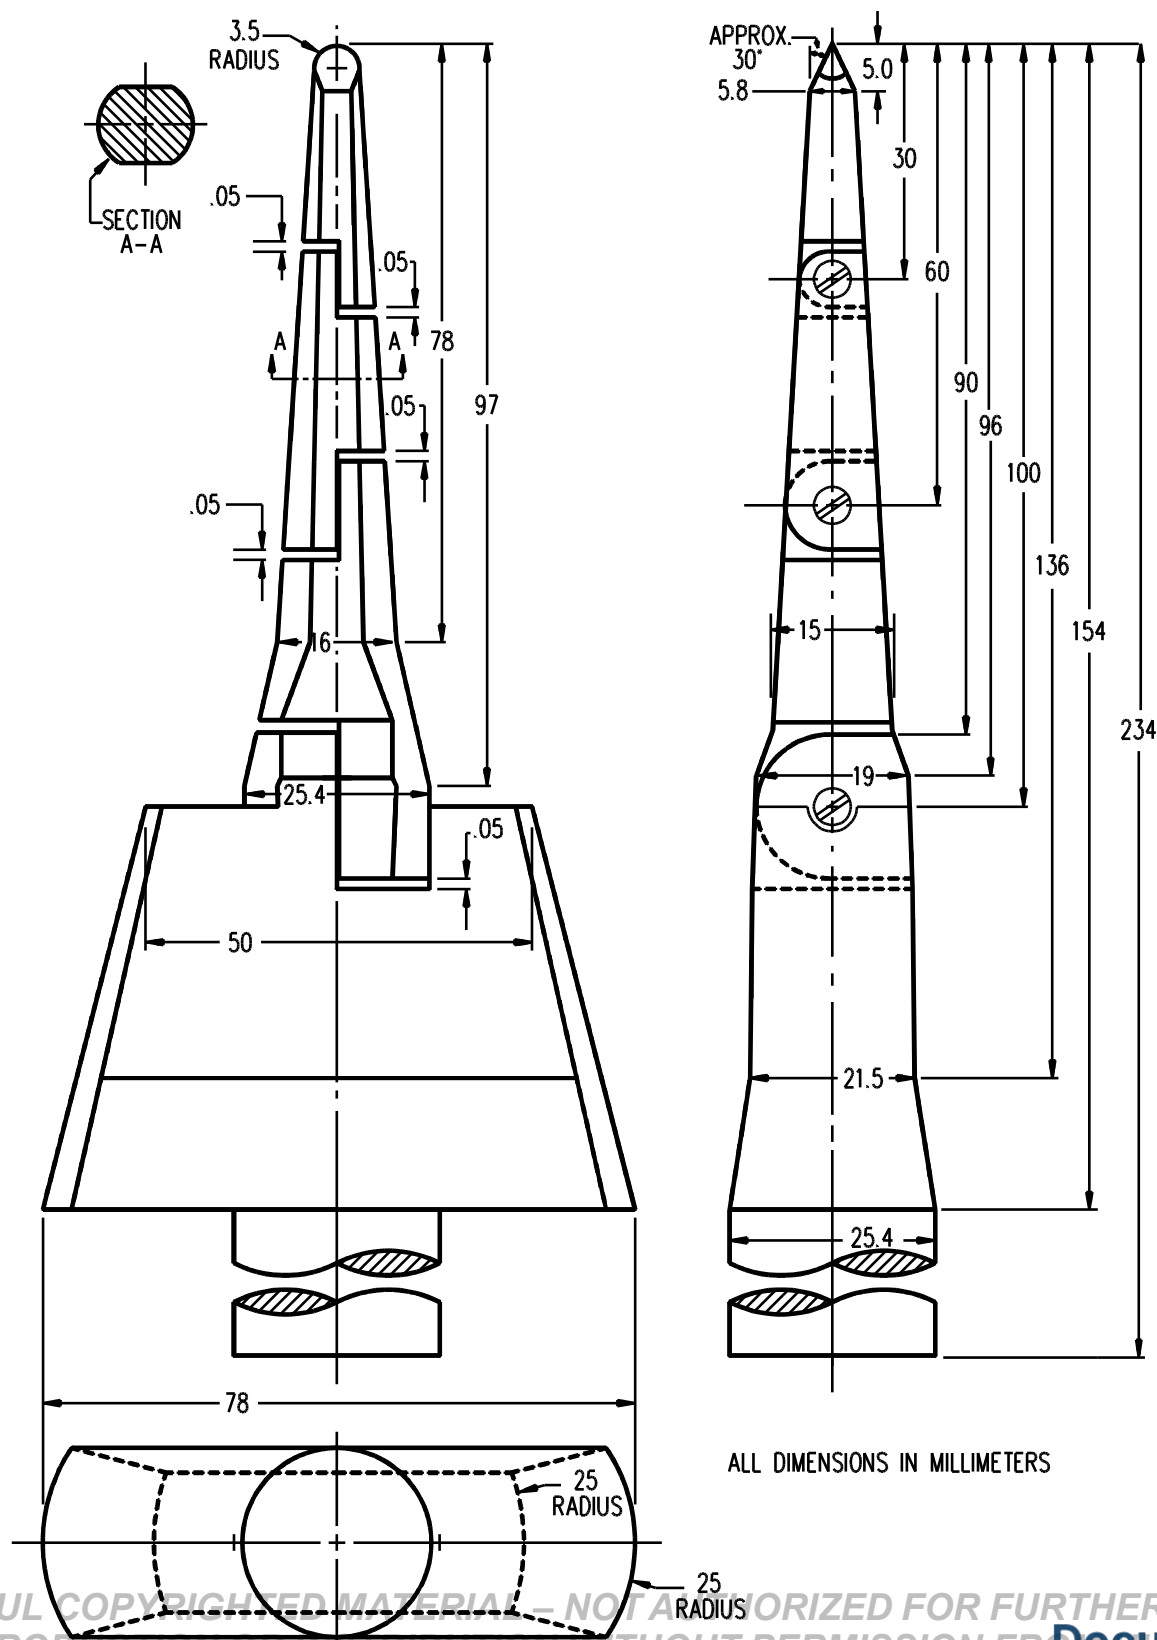

This document is only permissible for use by Anonymous User of University of Toronto. 8/26/2020 6:22:03 PM

9.1.5 A separable part is considered essential for the operation of the device if it employs a latch or detent or requires use of a tool to remove, and if it performs any of the following functions:

- a) Encloses or completes the enclosure of current-carrying parts other than those on the male face of an attachment plug;
- b) Encloses or completes the enclosure of the flexible cord from which the jacket has been removed for wiring;
- c) Provides for the placement and removal of a fuse.

9.1.6 A separable part (such as an insulating face cover, disc or strain relief clamp) is not considered essential for the operation of the device if it can be removed without the use of a tool or without defeating a latch or detent and if it performs any of the following functions:

- a) Provides strain relief;
- b) Encloses wiring terminals that would otherwise be exposed on the male face of an attachment plug or current tap; or
- c) Provides access to a fuse through the male face of an attachment plug.

9.1.7 With respect to [9.1.5\(b\)](#), the enclosure of a flexible cord is not considered to be complete where two insulated conductors of a parallel-type cord are split apart or where the jacket is removed from the insulated conductors of a jacketed-type cord.

9.2 Male faces and wire terminations

9.2.1 The wire terminations of a 15 or 20 A attachment plug shall be completely enclosed when the device is wired on flexible cord and assembled as intended, using only those parts essential for the operation of the device (dead-front construction). See [9.1.5](#) and [9.1.6](#).

9.2.2 An exposed live part on the face of an attachment plug rated other than 15 or 20 A shall be provided with an insulating disc or face cover that is at least 0.028 inch (0.71 mm) thick and completely covers all exposed live parts. Any unfilled openings on a face cover or disc provided with multiple clearance openings to enable its use with a number of blade arrangements are to be located opposite the anticipated insulating face of the corresponding outlet device.

9.2.3 An insulating disc or face cover intended to be opened or removed to provide access to the wiring terminals shall be mechanically secured after wiring by one or more screws, latches, or detents that cannot be unintentionally opened or removed. A cover that is held in place by only friction without any positive detent action is not considered mechanically secured and is to be subjected to the Secureness-Of-Cover Test described in Section [46](#).

9.2.4 An insulating disc or face cover shall enclose the wiring terminal compartments with a fit at the periphery that will not permit the entrance of a 0.030 inch diameter (0.76 mm) probe.

Exception: A notch may be provided in the cover to facilitate removal but only in areas remote from wiring terminals so that unclamped live strands cannot reach the opening. The notch is to comply with all of the following:

- a) *It shall not be deeper than 1/8 inch (3.2 mm) from the periphery;*
- b) *It shall not be wider than 3/8 inch (9.5 mm) along the periphery of the cover; and*

c) It shall not be located within 3/8 inch (9.5 mm) of the binding screw head as measured from the closest point in the notch periphery.

9.2.5 A device with a separable face cover shall be capable of being properly wired with the maximum size of the heaviest-duty type of flexible cord intended without inhibiting the full seating of the cover. The flexible cord used to determine compliance shall:

- a) Have an ampacity at least equal to the rating of the device configuration;
- b) Be of the type and size marked on the device; or
- c) Be of the maximum size that can be accommodated by the cord-entrance opening into the device.

9.2.6 An attachment plug with a separable face cover or disc shall be shipped with the cover attached to the device but not necessarily mechanically secured.

10 Current-Carrying Parts

10.1 General

10.1.1 Iron or steel, plated or unplated, shall not be used for parts that are depended upon to carry current.

Exception No. 1: Stainless steel may be employed for a part not subject to arcing.

Exception No. 2: A steel that is corrosion-resistant (stainless) or is protected against corrosion by cadmium plating, zinc plating, or an equivalent protective coating, may be used for wire-binding nuts and screws if these parts are not depended upon to carry current.

10.1.2 A current-carrying part shall be restricted from turning relative to the surface on which it is mounted if such turning would adversely affect the performance of the device.

10.1.3 Uninsulated live parts shall be secured in place so that a reduction in the spacings below those required in [14.1](#) is not likely.

10.2 Contacts


10.2.1 Female contacts and associated live parts in the contact opening of an outlet device that can be touched by the probe illustrated in [Figure 10.1](#) shall be recessed from the plane of the opening a distance not less than 1/4 of the maximum straight-line dimension of the opening, or 3/64 inch (1.2 mm), whichever is larger. That plane nearest the face of the device having the minimum opening for the pin or blade clearance is to be used to determine the minimum recess. Bevels, tapers, or other expansions of the opening to the face of the device do not affect the measurement. The probe in [Figure 10.1](#) is to be inserted point first as far as possible in the opening without distorting the perimeter of the opening. The maximum straight-line dimension is the maximum-length straight-line that will fit within the opening at the plane of measurement.

Exception No. 1: Devices having openings that close upon removal of the attachment plug are not required to comply with this requirement.

Exception No. 2: Specific-purpose devices intended only for disconnecting use (see [87.6](#)), are not required to comply with this requirement.

Figure 10.1

Probe

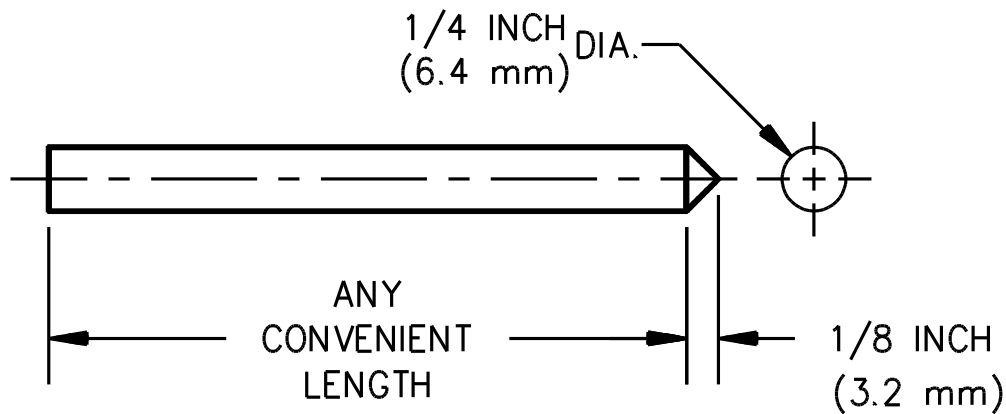

PA190

11 Grounding and Dead Metal Parts

11.1 The following grounding parts shall be of copper or of a copper-base alloy:

- a) The grounding pin, blade, or contact,
- b) The grounding-conductor path through an attachment plug or cord connector, except for a metal housing or armor, and
- c) The grounding-conductor path through a receptacle up to the strap, yoke, or other mounting means.

Exception: A rivet, bolt, or clamp that is used to secure parts in the grounding-conductor path, but which is not an essential conductor in the grounding-conductor path, may be of steel or its equivalent.

11.2 A copper-base-alloy rivet that is used to secure parts in the grounding-conductor path, or that forms a part of the grounding-conductor path, shall not contain less than 80 percent copper.

11.3 The grounding-conductor path connections in a grounding device shall be secured by riveting, bolting, welding, or equivalent means.

Exception: Another form of connection employed in a cord connector is not prohibited when the connection complies with the requirement in Potential Drop in Grounding Connections Test, Section [62](#).

11.4 The grounding pin, blade, or contact, of a grounding device shall be permanently attached to the body of the device.

Exception: A device in which the grounding member is mounted in soft rubber or similarly flexible material is not precluded by this requirement. The requirement contemplates that the element is to be secured in a manner so that it is not readily removable or movable.

11.5 Grounding and other dead metal parts shall be secured in place so that a reduction in spacings below those required in [14.1](#) is not likely.

11.6 The grounding terminal of a grounding device shall be connected to the contact that is intended for use for equipment grounding. For devices having one of the standard grounding configurations, the grounding contact is identified by the letter "G" in the corresponding figure in ANSI/NEMA WD6 and in UL 1681. The grounding terminal shall be permanently identified in accordance with [89.1.1](#) in a manner that is readily recognizable during installation. See also [18.1](#), [21.1](#), [26.1.2](#), and Section [89](#), Identification and Marking of Terminals.

11.7 Dead-metal parts of a grounding device shall be conductively connected to the grounding-conductor path through the device. See [9.1.2](#).

Exception: Dead-metal parts isolated from current-carrying parts and wiring other than complete flexible cords (see [9.1.7](#)) are not required to comply with this requirement.

11.8 A conductive connection between a blade, pin, or contact, and an exposed dead-metal part capable of being grounded in service, such as the mounting strap, yoke, or body armor, shall be provided only in a grounding device. A non-grounding device with exposed dead-metal parts shall not be provided with a wiring terminal identified for an equipment grounding conductor. See also [18.3](#) and [21.2](#).

Exception: A nonstandard-configuration device that does not employ a dedicated grounding blade, pin, or contact, but which uses body armor or similar exposed metal parts as an equipment grounding conductor is not prohibited from being provided with an equipment grounding terminal only when the conductive connection between the grounding terminal and the exposed metal parts is obvious to the installer.

11.9 Dead metal parts of a device for use in non-grounding applications shall be insulated from live parts and wiring other than the complete flexible cord so that stray strands, failure of wiring terminals, or failure of wiring shall not energize accessible dead metal parts. See [9.1.3](#).

11.10 Iron or steel other than machine screws, washers, nuts, and stainless steel parts shall be protected against corrosion.

Exception: Parts determined to comply with [28.2.4](#), are not required to comply with this requirement.

12 Terminals

12.1 General

12.1.1 When a device is intended for the connection of conductors, a means shall be provided for connection such as a wire-binding screw or pressure-wire type wiring terminal, or a lead that is factory-assembled by means of soldering, welding, riveting or crimping. A wire-binding screw terminal shall not be used for the connection of circuit wires to a device rated more than 30 A and intended for connection to conductors greater than 10 AWG (5.3 mm²).

12.1.2 A terminal provided for the field connection of a grounding conductor shall employ a mechanical clamping means that does not depend upon solder for the connection of the wire.

12.2 Wire-binding screw terminals

12.2.1 A wiring terminal that involves a wire-binding screw shall have upturned lugs, or the equivalent, to hold a wire under the head of the screw.

12.2.2 A terminal plate that has a tapped hole for a wire-binding screw shall be of 0.030 inch (0.76 mm) or thicker metal and shall not have fewer than two full threads in the metal. A binding screw that has 32 or

more threads per inch (per 25.4 mm) with a terminal plate formed from stock 0.030 inch (0.76 mm) thick, may have the metal extruded at the tapped hole to provide two full threads for the binding screw.

12.2.3 A wire-binding screw shall thread into metal.

12.2.4 The minimum size and maximum number of threads per inch (per 25.4 mm) for a wire-binding screw shall be as indicated in [Table 12.1](#).

Table 12.1
Sizes of Terminal Screws

Rating of device in amperes	Minimum size of screw	Maximum number of threads per inch (per 25.4 mm)
15 or less	6 ^a	36 ^c
20	8 ^b	32 ^c
30	8	32
^a No. 5-40 screws may be used on devices intended only for other than outlet-box use. ^b No. 6-36 screws with a 0.296 inch diameter (7.52 mm) or larger head may be used for terminals on attachment plugs and cord connectors. On the device with a 5-20 configuration, the terminal screw that is used for connecting the grounding conductor to the outlet box shall not be smaller than No. 6-36. ^c No. 8 or larger screws having more than the number of threads per inch (per 25.4 mm) indicated may be used for terminals when the assembly complies with the Tightening Torque Test, Section 44 .		

12.2.5 A receptacle or inlet rated 30 A or less and employing wire-binding screw terminals for connection to copper branch circuit conductors only, shall comply with the general performance requirements for receptacles, Section [66](#) or the general performance requirements for inlets, Section [50](#), as applicable.

12.2.6 The tightening torque for the wire-binding screw terminals shall be specified by the device manufacturer and shall be marked as described in Reference No. 4 of [Table 88.2](#) for inlets and Reference No. 18 of [Table 88.4](#) for receptacles.

12.3 Soldering lugs

12.3.1 A terminal plate for a soldering lug shall be at least 0.050 inch (1.27 mm) thick and shall not have fewer than two full threads in the metal for a terminal screw.

12.4 Pressure-wire terminals

12.4.1 A terminal plate for a pressure-wire terminal shall be at least 0.030 inch (0.76 mm) thick and shall not have fewer than two full threads in the metal for a terminal screw.

12.4.2 A pressure-wire terminal intended for the connection of branch circuit conductors to an inlet or receptacle shall be investigated in accordance with [Table 12.2](#).

Table 12.2
Pressure-wire Terminals used in Receptacles and Inlets

Use	Current rating	Pressure-wire terminal type	Reference paragraphs
Copper wire only	<30A	Clamp	53.3 , 71.3
		Setscrew	12.4.3 , 56.1 , 71.2

Table 12.2 Continued on Next Page

This document is only permissible for use by Anonymous User of University of Toronto. 8/26/2020 6:22:03 PM

Table 12.2 Continued

Use	Current rating	Pressure-wire terminal type	Reference paragraphs
	≥35A	Clamp	12.4.3 , 56.1 , 71.3
		Setscrew	12.4.3 , 56.1 , 71.3

12.4.3 The tightening torque for the pressure-wire terminals designated in [Table 12.2](#) shall be specified by the device manufacturer and shall be marked as described in Reference No. 4 of [Table 88.2](#) for inlets and Reference No. 18 of [Table 88.4](#) for receptacles. The specified tightening torque shall not be less than 90 percent of the value employed in the static heating test in UL 486E, for the maximum wire size corresponding to the ampere rating of the device.

Exception: A lesser torque value is not prohibited when the connector is investigated in accordance with UL 486A-486B or UL 486E using the lesser assigned torque value.

12.5 Combination wire binding/pressure-wire terminals

12.5.1 A receptacle or inlet employing a combination wire binding/pressure-type terminal shall be limited to 10, 12 or 14 AWG conductors. The terminals shall comply with the applicable performance requirements as specified in UL 486E.

12.5.2 A receptacle or inlet employing a combination wire binding/pressure-wire terminal for connection to copper branch circuit conductors only, shall comply with the general performance requirements for receptacle, as specified in Section [60](#), Combination Wire Binding/Pressure Wire-Type Terminals, or the general performance requirements for inlets, Section [50](#), as applicable.

12.6 Spring action clamp terminals

12.6.1 In addition to the requirements contained in this standard, a receptacle or inlet employing a spring action clamp terminal shall also comply with the applicable requirements, as specified in UL 486E. All tests shall be investigated with minimum and maximum conductor AWG size and for each type of conductor (solid and stranded), for each device construction.

12.6.2 A receptacle or inlet employing spring action clamp terminals are intended for either stranded or solid or both, copper wire only.

12.6.3 A receptacle or inlet employing spring action clamp terminals are intended for the connection of a single conductor only.

13 Cord Entry and Strain Relief

13.1 A device intended for connection to flexible cord shall be provided with a means of strain relief so that a pull on the flexible cord will not be transmitted directly to the wiring terminations. Acceptability of the strain relief means shall be determined by the test described in Integrity of Assembly Test, Sections [47](#) or [60](#).

Exception: The strain relief provided on a device intended solely for factory assembly to the conductors of a flexible cord shall be subjected to the Integrity of Assembly Test, Section [46](#) but is not required to restrict a pull on the flexible cord from being transmitted directly to the wiring terminations when the conductors are terminated as described in [13.2\(a\)](#).

13.2 A device intended solely for factory assembly to the conductors of a flexible cord is to be connected to the conductors by:

- a) Welding, riveting, crimping, or the equivalent, or
- b) Soldering, when an offset or one or more right-angle bends in the conductor are employed so that a pull on the conductor will not be transmitted directly to the connection.

13.3 The diameter of a round cord-entry hole shall not be longer than 1/4 inch (6.4 mm).

13.4 A metal-covered device intended for connection to a flexible cord shall be provided with an insulating bushing of porcelain, phenolic or cold-molded composition, or other insulating material with equivalent properties.

Exception No. 1: Hard fiber is acceptable for the bushing if the fiber is not less than 3/64 inch (1.2 mm) thick, and it is so formed and secured in place that it will not be affected by ordinary conditions of moisture.

Exception No. 2: If the metal covering (armor) of a device is not in proximity to the cord-entry hole, and the insulating material of which the plug is made serves as a smooth, well-rounded bushing for a flexible cord, a separate insulating bushing is not required.

Exception No. 3: A metal-covered device with a metal cord grip intended specifically for use with a jacketed type of flexible cord, such as Type S or SJ is not required to have an insulating bushing.

14 Spacings

14.1 The spacings maintained through air or over surface shall be a minimum 3/64 inch (1.2 mm) for a device rated 250 V or less, and a minimum 1/8 inch (3.2 mm) for a device rated more than 250 V, between the following:

- a) Uninsulated live parts of opposite polarity;
- b) An uninsulated live part and a dead-metal part that is likely to be grounded or exposed to contact by persons when the device is installed as intended, including a metal surface on which the device is mounted in the intended manner or a metal face plate used with a flush receptacle.

Exception No. 1: The grounding terminal of a flush receptacle shall instead comply with the spacing requirements in [28.2.1](#).

Exception No. 2: A dead-metal screw head, rivet, or the like, which is located in a hole not larger than 9/32 inch (7.1 mm) in diameter and recessed not less than 3/16 inch (4.8 mm) is not considered to be exposed to contact by persons after the device is installed in the intended manner.

14.2 In measuring a spacing, an isolated dead-metal part interposed between live parts of opposite polarity, or between a live part and a grounded or exposed dead-metal part, is considered to reduce the spacing by an amount equal to the dimension of the isolated dead-metal part in the direction of the measurement.

15 Assembly

15.1 General

15.1.1 A device shall be capable of being readily wired as intended.

15.1.2 Electrical contact shall be reliably maintained at any point at which a connection is made between current-carrying parts.

15.1.3 An outlet device shall have live parts protected against exposure to contact by persons when the outlet is assembled and installed as intended.

15.1.4 When internal connections exist in a multiple-outlet device, similar and corresponding contacts of individual outlets shall be connected together.

15.1.5 A device having female contacts shall be constructed so that a standard attachment plug of the same configuration and with maximum length blades is capable of seating properly without exposure of the blades between the plane of the face of the plug and the plane of the rim of the female contact device.

15.2 Grounding and polarization

15.2.1 A grounding outlet device shall be so constructed that the grounding member of the corresponding attachment plug cannot be inserted by hand into any outlet slot to touch the live contact.

15.2.2 A device consisting of two or more pieces shall be such that polarization cannot be defeated by improper assembly during installation.

15.3 Mating and interchangeability

15.3.1 A general-use device, including any configuration illustrated in ANSI/NEMA WD6 and UL 1681, shall be constructed so that electrical continuity between respective and similarly marked terminals is established automatically when the mating plug and outlet device are connected together.

Exception: A special-purpose device for use in equipment where intermixed connections do not increase the risk of fire, electric shock, injury to persons, or damage to equipment, is not required to comply with this requirement.

15.3.2 An outlet device shall not accommodate an attachment plug other than one that is specifically intended for use with the outlet.

15.3.3 A male or female device that is capable of making a conductive connection with a female or male device of an established general-use design shall be constructed and rated for complete and correct interchangeability with the established design. An established general-use design is considered to include any of the following:

- a) Any of the configurations outlined in ANSI/NEMA WD6;
- b) Any of the configurations outlined in UL 1681;
- c) Another configuration that is an American National Standard configuration; or
- d) A special-purpose configuration that is acceptable for use in one of the wiring systems that complies with ANSI/NFPA 70.

Exception: A special-purpose receptacle configuration that will not accept any standard general-use plugs shall be permitted to accept a modified general-use plug that will also be accepted by the mating general-use receptacle. (For example, a receptacle for use in a hazardous location that is intended to supply hazardous-location equipment provided with a modified plug that may be used in either an ordinary or hazardous location.)

15.3.4 A male or female device of an established general-use design shall comply with the dimensions, spacings, and the relative arrangement of blade and contact slots required by one of the following:

- a) ANSI/NEMA WD6;