



UL 508A

STANDARD FOR SAFETY

Industrial Control Panels

UL Standard for Safety for Industrial Control Panels, UL 508A

Third Edition, Dated April 24, 2018

Summary of Topics

This revision of ANSI/UL 508A dated June 26, 2025 includes the following changes in requirements:

- Limits to Control Circuit Voltages; [66.12.1](#) and [66.12.2](#)
- Need for Emergency Stop Function; [66.11.2](#)
- Disconnecting Means – Industrial Machinery; [66.6.1](#), [66.6.1A](#), [Table 52.1](#)
- Correction to [Table SB4.1](#) – Controllers Rated 601 – 1000V
- UL 1059 Terminal Block Requirements; [28.2.1](#)
- Overload Protection for Group Motor Applications; [31.4.1](#)
- Terminals for Motors or Motors and Other Loads; [28.3.3](#)
- Correction to [SB4.2.2\(b\)](#)
- Connection Means for Single Port Surge Protective Devices; [SB4.2.1](#)
- Alternate Class 2 Sources; [44.1.5](#)
- Location of Ventilation Opening; [21.2.2](#) and [Figure 21.1](#)
- Additional Insulating Barrier Materials; [12.2](#)
- Addition of GPO-2 and GPO-3 as Insulating Materials; [13.2](#), [Table 13.1](#)
- Semiconductor Fuses and Fuseholder Markings; [2.24](#), [30.3.4](#), [31.1.3](#), [31.3.2](#), [31.3.5](#), [Table 52.1](#), [56.1](#) and [56.2](#)
- Revisions to UL Component Standards; [30.1.4](#) – [30.1.6](#), [31.1.1](#), [31.1.4](#), [31.1.7](#), [31.4.3](#), [32.1.3](#), [33.1.1](#), [33.1.3](#), [33.7.1](#), [34.1.1](#), [42.3.1](#), [45.1.1](#), [46.1.1](#), [90.4.1](#) and [90.4.2](#)
- Clarification of Locked Rotor Current Ratings for Disconnected Switches; [Table 30.1](#) and [Table 30.2](#)
- Addition of Reference to UL 60335-2-40; [26.3.1](#)
- Revision to [26.1.1](#) – Enclosure Environmental Control Devices
- Addition of Requirements for Voltage Detection Devices; [2.1A](#), [2.1B](#), [2.42A](#), Section [36.6](#), [75.8.5](#) and Appendix [A](#)
- Exclusion of Current Limited OCPD Drives; [SB4.3.2](#) and [SB4.3.3](#)



Documents

Document Sharing Hub

- Clarification of Note “b” in [Table 52.1](#)
- Eliminate Exception for One-Port SPDs; [SB4.2.1](#)
- Panels Not Covered by the Scope of UL 508A; [1.27](#)
- Formatting Correction to Table 19.2; [Table 19.1](#), [Table 19.2A](#), and [19.3](#)
- Pipelines, Tubing or Devices for Handling Air, Gasses or Liquids; [18.2A](#) – [18.2D](#), and [18.6](#) – [18.8](#)
- Wiring Ferrules; [29.3.6](#) and Appendix [A](#)
- Field Provided Components; [60.3](#)
- Addition of Requirements for Instrument Transformers; [43.1.1](#) and Section [47.5](#)
- Power Supplies in a Power Circuit; [35.4.1.1](#), [35.4.1.2](#) and Sections [35.5](#) and [35.6](#)
- Optical Fiber Cables; [38.1.2](#) and Appendix [A](#)
- Correction to [21.3.4](#)
- Special-purpose Solid-state Overcurrent Protectors; [40.1.3A](#), [43.1.3](#), [44.1.5](#) and Appendix [A](#)
- Addition of Voltage Indicators and Voltage Test Point Devices; [66.6.1](#)
- Wiring of an Oversized Variable Speed Drive; [28.3.5](#), [29.6.3](#) and [34.2.3](#)

Text that has been changed in any manner or impacted by ULSE's electronic publishing system is marked with a vertical line in the margin.

The new and revised requirements are substantially in accordance with Proposal(s) on this subject dated April 19, 2024 and February 28, 2025.

All rights reserved. No part of this publication may be reproduced, stored in a retrieval system, or transmitted in any form by any means, electronic, mechanical photocopying, recording, or otherwise without prior permission of ULSE Inc. (ULSE).

ULSE provides this Standard "as is" without warranty of any kind, either expressed or implied, including but not limited to, the implied warranties of merchantability or fitness for any purpose.

In no event will ULSE be liable for any special, incidental, consequential, indirect or similar damages, including loss of profits, lost savings, loss of data, or any other damages arising out of the use of or the inability to use this Standard, even if ULSE or an authorized ULSE representative has been advised of the possibility of such damage. In no event shall ULSE's liability for any damage ever exceed the price paid for this Standard, regardless of the form of the claim.

Users of the electronic versions of UL's Standards for Safety agree to defend, indemnify, and hold ULSE harmless from and against any loss, expense, liability, damage, claim, or judgment (including reasonable attorney's fees) resulting from any error or deviation introduced while purchaser is storing an electronic Standard on the purchaser's computer system.

APRIL 24, 2018
(Title Page Reprinted: June 26, 2025)



ANSI/UL 508A-2025

1

UL 508A

Standard for Industrial Control Panels

First Edition – April, 2001
Second Edition – December, 2013

Third Edition

April 24, 2018

This ANSI/UL Standard for Safety consists of the Third Edition including revisions through June 26, 2025.

The most recent designation of ANSI/UL 508A as an American National Standard (ANSI) occurred on June 26, 2025. ANSI approval for a standard does not include the Cover Page, Transmittal Pages, and Title Page. Any other portions of this ANSI/UL standard that were not processed in accordance with ANSI/UL requirements are noted at the beginning of the impacted sections.

Comments or proposals for revisions on any part of the Standard may be submitted to ULSE at any time. Proposals should be submitted via a Proposal Request in the Collaborative Standards Development System (CSDS) at <https://csds.ul.com>.

Our Standards for Safety are copyrighted by ULSE Inc. Neither a printed nor electronic copy of a Standard should be altered in any way. All of our Standards and all copyrights, ownerships, and rights regarding those Standards shall remain the sole and exclusive property of ULSE Inc.

© 2025 ULSE Inc. All rights reserved.

No Text on This Page

CONTENTS

PART 1 – GENERAL USE INDUSTRIAL CONTROL PANELS

INTRODUCTION

1 Scope 11

2 Glossary..... 13

3 Undated References 17

4 Components 18

5 Units of Measurement 18

6 Terminology 18

CONSTRUCTION

ALL PANELS

7 General 21

8 Protection Against Corrosion..... 21

9 Support and Securement of Live Parts 22

10 Spacings 22

11 Conduit Bushings 25

12 Insulating Barriers 26

13 Insulating Materials 27

14 Grounding – General 28

15 Grounding – Size of Terminal or Bonding Conductor 29

16 Transformer and Power Supply Secondary Grounding 30

17 Identification of Grounding and Grounded Circuit Conductors and Terminals..... 31

ENCLOSED PANELS

18 Enclosures..... 32

19 Enclosure Openings 33

20 Accessibility of Live Parts..... 37

21 Ventilation Openings..... 38

 21.1 General..... 38

 21.2 Location of ventilation opening 38

 21.3 Construction..... 39

22 Barriers Used with Ventilation Openings..... 40

23 Observation Windows..... 41

24 Bonding 42

25 Wire Bending Space 42

26 Enclosure Environmental Control Devices..... 43

 26.1 General 43

 26.2 Enclosure fans 43

 26.3 Enclosure air conditioner 44

 26.4 Enclosure heater 44

 26.5 Air filters..... 44

 26.6 Enclosure thermal insulation..... 44

27 Enclosure Maintenance Lighting..... 45

 27.1 General..... 45

 27.2 Component requirements 45

 27.3 Circuit requirements..... 45

POWER CIRCUITS

28	Field Wiring.....	45
28.1	General.....	45
28.2	Component requirements	46
28.3	Sizing	47
28.4	Separation of circuits	49
28.5	Cord-connected equipment	50
28.6	Receptacles	52
28.7	Cable assemblies and fittings	52
29	Internal Wiring.....	52
29.1	General.....	52
29.2	Conductor requirements	53
29.3	Wiring methods	54
29.4	Routing of internal wiring	56
29.5	Separation of circuits	56
29.6	Sizing	56
30	Disconnect Switches	57
30.1	Component requirements	57
30.2	Sizing of disconnect switch	58
30.3	Location	59
30.4	Mechanical operating mechanism	60
31	Branch Circuit Protection	61
31.1	Component requirements	61
31.2	Location	62
31.3	Sizing of branch circuit protection for single motor circuit.....	62
31.4	Sizing of branch circuit protection for motor groups.....	65
31.5	Receptacles	66
31.6	Sizing of branch circuit protection for heater loads	66
31.7	Sizing of branch circuit protection for appliance loads	67
31.8	Sizing of branch circuit protection for lighting loads	67
32	Overcurrent Protection of Feeder.....	67
32.1	Component requirements	67
32.2	Location	68
32.3	Sizing of overcurrent protection.....	68
32.4	Feeder taps for non-motor loads	68
32.5	Feeder taps for motor loads	69
33	Load Controllers.....	69
33.1	Component requirements	69
33.2	Sizing/rating of load controllers	70
33.3	Location	71
33.4	Reversing motor controllers	71
33.5	Wye-delta motor controllers	71
33.6	Controllers for multi-speed and part winding motors	74
33.7	Autotransformer- and resistor-type reduced voltage motor controllers	74
34	Overload Protection of Motor Loads.....	74
34.1	Component requirements	74
34.2	Sizing of overload relay	74
34.3	Location	74
35	Power Transformers	76
35.1	Component requirements	76
35.2	Sizing of overcurrent protection for power transformer	76
35.3	Location	77
35.4	Low-voltage limited energy circuits.....	77
35.5	Power supplies	78
35.6	Overcurrent protection of power supply secondary	78

36	Other Circuit Components	78
36.1	Capacitors	78
36.2	Resistors.....	78
36.3	Reactors	79
36.4	Surge protective devices (SPDs).....	79
36.5	Line filters	80
36.6	Voltage detection devices.....	80

CONTROL CIRCUITS

37	Field Wiring Terminals	81
37.1	Component requirements.....	81
37.2	Sizing	81
37.3	Field wiring terminals of a low-voltage limited energy circuit	82
37.4	Field wiring terminals of Class 2 circuits.....	82
37.5	Separation of circuits	82
37.6	Receptacles	82
37.7	Flexible cords	83
37.8	Cable assemblies and fittings	83
38	Internal Wiring.....	83
38.1	Component requirements.....	83
38.2	Sizing of internal control circuit conductors	83
38.3	Wiring methods, wire routing, and separation of circuits for internal wiring of a control circuit.....	84
39	Disconnecting Means	84
40	Overcurrent Protection.....	84
40.1	Component requirements.....	84
40.2	Location of overcurrent protective devices	85
40.3	Sizing of overcurrent protection.....	85
41	Sizing of Overcurrent Protection – Control Circuits (Common)	86
42	Overcurrent Protection – Control Circuits (Isolated Secondary).....	87
42.1	Control transformers	87
42.2	Power supplies	89
42.3	Other isolated secondary sources	90
43	Low-Voltage Limited Energy Circuits.....	90
43.1	Component requirements.....	90
43.2	Secondary side requirements	91
44	Class 2 Circuits	91
44.1	Component requirements	91
44.2	Secondary side requirements	92
45	Switching Devices	92
45.1	Component requirements.....	92
45.2	Sizing/ratings of control circuit switching devices.....	92
45.3	Location	94
45.4	Undervoltage protection	95
46	Loads	95
46.1	Component requirements.....	95
46.2	Location.....	96
46.3	Rating of control circuit load.....	96
47	Miscellaneous Devices	96
47.1	Surge protective devices SPDs.....	96
47.2	Resistors.....	97
47.3	UPS (Uninterruptible Power-Supply) Equipment	97
47.4	Line filters	97
47.5	Instrument transformers (current transformers and voltage transformers).....	97
48	Pneumatic Switching Devices.....	98

RATING

49	Supply Ratings.....	98
50	Individual Load Ratings.....	98
51	Ratings for Control Circuit Outputs.....	102

MARKINGS

52	General Markings.....	102
53	Enclosure Markings.....	105
54	Field Wiring Terminal Markings.....	105
55	Hazard Markings.....	109
56	Fuseholder Markings.....	110
57	Switch Markings.....	110
58	Overload Relay Heater Table Markings.....	111
59	Receptacle Markings.....	111
60	Field Provided Components.....	111
61	Schematic Wiring Diagrams.....	111

PART 2 – SPECIFIC USE INDUSTRIAL CONTROL PANEL TYPES

ENCLOSURES

62	General.....	112
63	Construction.....	112
	63.1 Metal thickness.....	112
	63.2 Covers and doors.....	118
	63.3 Corrosion protection.....	120
	63.4 Enclosure openings.....	121
	63.5 Ventilation openings.....	121
	63.6 Observation windows.....	121
64	Markings.....	121

INDUSTRIAL MACHINERY

65	General.....	121
66	Construction.....	122
	66.1 Enclosures.....	122
	66.2 Electrical assembly.....	123
	66.3 Grounding.....	123
	66.4 Field wiring – power circuits.....	124
	66.5 Internal wiring – power circuits.....	125
	66.6 Disconnecting means.....	126
	66.7 Branch circuit protection.....	128
	66.8 Motor controllers.....	129
	66.9 Internal wiring of control circuit.....	130
	66.10 Overcurrent protection of common control circuit.....	131
	66.11 Operator controls.....	131
	66.12 Control circuit voltages.....	131
67	Markings.....	131
	67.1 Nameplate markings.....	131
	67.2 Operator controls.....	132
	67.3 Components.....	132
	67.4 Cautionary marking.....	132

CRANE CONTROL

68 General 133

69 Glossary 133

70 Construction 133

 70.1 Field wiring terminals of power circuits 133

 70.2 Internal wiring 134

 70.3 Disconnecting means 135

 70.4 Branch circuit protection 135

 70.5 Motor overload protection 135

 70.6 Field wiring of control circuits 135

 70.7 Overcurrent protection of control circuit 136

71 Ratings 136

72 Markings 136

SERVICE EQUIPMENT USE

73 General 136

74 Glossary 136

75 Construction 137

 75.1 Grounding and bonding 137

 75.2 Spacings 143

 75.3 Field wiring terminals 144

 75.4 Disconnecting means 144

 75.5 Neutral disconnecting means 144

 75.6 Ground-fault protection 145

 75.7 Overcurrent protection 149

 75.8 Components on the supply side of the disconnecting means 149

76 Ratings 149

77 Markings 150

 77.1 Bonded neutral 150

 77.2 Insulated neutral 150

 77.3 Marking location 150

 77.4 Disconnects 150

 77.5 Ground-fault protection 151

78 Installation Instructions 151

79 Tests By The Manufacturer – Ground-Fault Protection Test 152

ELEVATOR CONTROL

80 General 152

FLAME CONTROL

81 General 152

82 Construction 153

 82.1 Component requirements 153

 82.2 Spacings 153

 82.3 Internal wiring 153

 82.4 Location 153

 82.5 Separation of circuits 153

 82.6 Overcurrent protection 154

83 Marking 154

MARINE USE

84	General	154
85	Construction	154
	85.1 Enclosures	154
	85.2 Autotransformer starters	154
	85.3 Insulating materials	155
	85.4 Branch circuit overcurrent devices	155
86	Ratings	155
87	Markings	155

AIR CONDITIONING AND REFRIGERATION EQUIPMENT

88	General	155
89	Glossary	155
90	Construction	155
	90.1 Field wiring sizing – power circuit	155
	90.2 Disconnecting switches – power circuits	156
	90.3 Branch circuit protection sizing – power circuits	156
	90.4 Load controllers – power circuits	156
91	Ratings	156
92	Marking	157

FOUNTAIN CONTROL PANELS

93	General	157
94	Construction	157
	94.1 Grounding	157
	94.2 Ground – fault protection	157
	94.3 Equipotential bonding	158
	94.4 Cord strain relief	158
95	Ratings	158
96	Marking	158

INDUSTRIAL CONTROL PANELS FOR IRRIGATION EQUIPMENT

97	General	158
98	Construction	159
	98.1 Sizing of motor controller	159
	98.2 Disconnecting means	159
	98.3 Branch circuit protection	159
	98.4 Internal conductors	159
99	Marking	159

CONTROL PANELS FOR AQUATIC PLAYGROUNDS

100	General	160
101	Glossary	160
102	Construction	160
	102.1 Grounding	160
	102.2 Ground-fault protection	160
	102.3 Transformers and power supplies	161
103	Ratings	161
104	Marking	161

CONTROL PANELS FOR SWIMMING POOLS AND IN-GROUND SPAS

105	General	161
106	Glossary	162
107	Construction	162
	107.1 General.....	162
	107.2 Grounding	162
	107.3 Ground-fault protection.....	162
	107.4 Luminaire transformers and power supplies	163
	107.5 Cord strain relief	163
108	Ratings	163
109	Markings.....	163

CONTROL PANELS FOR WATER PARK RIDES AND SIMILAR INSTALLATIONS

110	General.....	163
111	Glossary.....	164
112	Construction.....	164
	112.1 General	164
	112.2 Grounding of wave pools	164
	112.3 Sensors.....	164
	112.4 Ground– fault protection	164
	112.5 Luminaire transformers and power supplies	165
113	Ratings	165
114	Marking.....	165

SUPPLEMENT SA – Deleted

SUPPLEMENT SB – SHORT CIRCUIT CURRENT RATINGS FOR INDUSTRIAL CONTROL PANELS

SB1	Scope	169
SB2	Glossary	169
SB3	Construction.....	169
	SB3.1 Internal wiring connections.....	169
	SB3.2 Overcurrent protection of control circuit.....	169
SB4	Ratings	169
	SB4.1 Short circuit current rating	169
	SB4.2 Short circuit current ratings of individual power circuit components	169
	SB4.3 Feeder components that limit the short circuit current available.....	175
	SB4.4 Determination of the overall short circuit current rating of the panel	179
SB5	Markings	180
	SB5.1 General	180
	SB5.2 Cautionary markings	180

APPENDIX A

Standards for Components	181
--------------------------------	-----

APPENDIX B – (informative) – USE OF COMPONENTS NOT UL LISTED OR RECOGNIZED IN INDUSTRIAL CONTROL PANELS

B.1	Scope	183
B.2	Conditions of Use.....	183

B.2.1 Enclosures..... 183

B.2.2 Power supplies..... 186

B.2.3 Inputs 186

B.2.4 Outputs 187

B.3 Responsibility of the Manufacturer..... 187

Appendix C – Reserved for Future Use

Appendix D – Maximum 100 000 Ampere Short-Circuit Current Rating Without Short-Circuit Test(normative)

D1 Scope 190

D2 Glossary 190

D3 Construction..... 190

 D3.1 General..... 190

 D3.2 Spacings 204

 D3.3 Supports..... 205

D4 Performance 205

 D4.1 General..... 205

 D4.2 Tensile 205

 D4.3 Cantilever..... 207

D5 Marking..... 208

PART 1 – GENERAL USE INDUSTRIAL CONTROL PANELS

INTRODUCTION

1 Scope

1.1 These requirements cover industrial control panels intended for general industrial use, operating from a voltage of 1000 volts or less. This equipment is intended for installation in ordinary locations, in accordance with the National Electrical Code, ANSI/NFPA 70 and where the ambient temperature shall be between 5°C (41°F) and 40°C (104°F), unless marked with an ambient temperature rating.

1.2 These requirements also cover industrial control panel enclosures and industrial control panels primarily intended for flame safety supervision of combustible fuel type equipment, crane or hoist control, service equipment use, marine use, air conditioning and refrigeration equipment, equipment for load management applications, fountain control, irrigation equipment control, and for control of industrial machinery including metalworking machine tools, power press controls, and plastic injection molding machinery. Also covered are industrial control panels intended for control of permanently installed electrical equipment for aquatic playgrounds, permanently installed electrical equipment associated with commercial water park rides, wave pools and similar installations, and permanently installed electrical equipment associated with commercial and large residential swimming pools and in-ground spas.

1.3 This equipment consists of assemblies of two or more power circuit components, such as motor controllers, overload relays, fused disconnect switches, and circuit breakers, or control circuit components, such as pushbuttons, pilot lights, selector switches, timers, and control relays, or a combination of power and control circuit components, with associated wiring, and terminals. These components are mounted on, or contained within, an enclosure, or are mounted on a sub-panel.

1.4 An industrial control panel does not include an evaluation of the controlled equipment such as motors, heaters, lighting, and other loads connected to power circuits. Unless specifically noted on the wiring diagram of the industrial control panel, an industrial control panel does not include equipment mounted remotely from the panel and connected via a wiring systems or equipment field installed on or within the industrial control panel.

1.5 An evaluation of the adequacy of the controls and protective devices contained in an industrial control panel for supervision and proper functioning of the controlled loads or equipment is not covered by the requirements in this standard. Such evaluations are covered by the standards applicable to the complete piece of utilization equipment.

1.6 The evaluation of a pre-fabricated building, structure, or platforms supplied with industrial control panels are not covered by the requirements in this standard.

1.7 Fire pump controllers are covered by the Standard for Fire Pump Controllers, UL 218.

1.8 Equipment intended for use in hazardous locations, as defined in the National Electrical Code, ANSI/NFPA 70, are covered by the Standard for Explosion-Proof and Dust-Ignition-Proof Electrical Equipment for Use in Hazardous (Classified) Locations, UL 1203.

1.9 Industrial control panels incorporating intrinsic safety barriers and intended for connection to circuits residing in hazardous locations are covered by the Standard for Industrial Control Panels Relating to Hazardous (Classified) Locations, UL 698A.

1.10 Motor control centers, including motor control center sections and units, or equipment intended for field installation into a motor control center are covered by the Standard for Motor Control Centers, UL 845.

1.11 Assemblies of electrical control units or equipment containing electrical control units for fire-protective signaling systems are covered by the Standard for Control Units and Accessories for Fire Alarm Systems, UL 864.

1.12 A freestanding assembly of overcurrent protective devices and busses for control of electric light and power circuits or equipment intended for field installation in dead-front switchboards shall be evaluated to the Standard for Switchboards, UL 891.

1.13 Equipment intended to supply automatic illumination, power, or both, to critical areas and equipment essential to safety of human life is covered by the Standard for Emergency Lighting and Power Equipment, UL 924.

1.14 Control equipment for use with swimming pools and spas is covered by the Standard for Electric Spas, Equipment Assemblies, and Associated Equipment, UL 1563.

1.15 Portable control panels containing switches, overcurrent protection, and cord connected via attachment plugs and receptacles for use at carnivals, circuses, fairs, exhibition halls, motion picture and television studios, theaters, construction sites and similar locations are covered by the Standard for Portable Power-Distribution Equipment, UL 1640.

1.16 Equipment for the control of fuel cells, photovoltaic systems, or utility interactive systems are covered by the Standard for Inverters, Converters, Controllers and Interconnection System Equipment for Use With Distributed Energy Resources, UL 1741.

1.17 Enclosures or pedestals containing terminals for connection of power circuit conductors are covered by the Standard for Termination Boxes, UL 1773.

1.18 Emergency alarm equipment or control panels containing emergency alarm equipment are covered by the Standard for General-Purpose Signaling Devices and Systems, UL 2017.

1.19 Equipment for gas or vapor detection or control panels containing gas or vapor detection equipment is covered by the Standard for Gas and Vapor Detectors and Sensors, UL 2075.

1.20 Control panels containing predominately communication equipment, such as telephone equipment and intended for installation in accordance with Chapter 8 of the NEC, is evaluated to the Standard for Information Technology Equipment – Safety – Part 1: General Requirements, UL 60950-1.

1.21 Control equipment intended for use in physical access control systems, which provide an attended or unattended means of monitoring or controlling traffic through portals of a protected area for security purposes; or in key management systems, which regulate or control access to the use of a device by electrical, electronic or mechanical means, are covered by the Standard for Access Control System Units, UL 294.

1.22 Electrically operated or mechanically operated control equipment or enclosures intended for theft deterrent or warning purposes, such as detectors, security containers or alarms for merchandise or property, are covered by the Standard for Antitheft Alarms and Devices, UL 1037.

1.23 Equipment primarily intended to energize or de-energize electrical loads to achieve the desired use of electrical power is covered by the Standard for Energy Management Equipment, UL 916. Such equipment is intended to control electrical loads by responding to sensors or transducers monitoring power consumption, by sequencing, by cycling the loads through the use of preprogrammed data logic circuits, or any combination thereof.

1.24 Control panels, control units, and other various electrical circuits employed within a control circuit device intended for support functions, maintain operation and limiting safety control features for use in a Stationary Engine Driven Assembly or similar power production equipment (generator) control applications are covered by the Standard for Controllers for Use in Power Production, UL/ULC 6200.

1.25 Industrial control panels intended for control of elevators, dumbwaiters, escalators, moving walks, inclined lifts, and associated equipment are evaluated to the requirements contained in ANSI/ASME A17.1, American National Standard Safety Code for Elevators and Escalators, and ANSI/ASME A17.5, Elevator and Escalator Electrical Equipment.

1.26 An assembly of overcurrent protective devices and busses for control of electric light and power circuits, provided as part of an industrial control panel, shall be evaluated to the Standard for Panelboards, UL 67.

1.27 Equipment or assemblies intended solely for providing ground fault protection are covered by the Standard for Ground-Fault Circuit-Interrupters, UL 943, or the Standard for Ground-Fault Sensing and Relaying Equipment, UL 1053.

2 Glossary

2.1 For the purpose of this standard, the following definitions apply.

2.1A ABSENCE OF VOLTAGE DETECTION DEVICE – A permanently-mounted device that is provided with voltage test points that allow for insertion of meter probes to perform absence of voltage tests from outside an electrical enclosure.

2.1B ABSENCE OF VOLTAGE TESTER (AVT) – A permanently-mounted test device that is used to verify that a circuit is de-energized prior to opening an electrical enclosure that contains energized electrical conductors and circuit parts. An AVT is provided with a test circuit with active indications to verify the absence of phase-to-phase voltage and phase-to-ground voltage. AVTs are provided with a test circuit and visual indicators to confirm that the tester is functioning properly before and after the process of determining that voltage is absent.

2.2 APPLIANCE – A piece of utilization equipment that incorporates both controls and loads.

2.3 BRANCH CIRCUIT – The conductors and components following the last overcurrent protective device protecting a load.

2.4 BRANCH CIRCUIT PROTECTION – Overcurrent protection with an ampere rating selected to protect the branch circuit. For a motor branch circuit, the overcurrent protection is required for overcurrents due to short circuits and faults to ground only, see [2.5](#) and [2.23](#) and [2.29](#). For motor overload protection, see [2.39](#).

2.5 BRANCH CIRCUIT PROTECTIVE DEVICE – A fuse or circuit breaker that has been evaluated to a safety standard for providing overcurrent protection. See [2.23](#) and [2.30](#).

2.6 CLASS 1 CIRCUIT – A control circuit on the load side of overcurrent protective device where the voltage does not exceed 600 volts, and where the power available is not limited, or control circuit on the load side of power limiting supply, such as a transformer.

2.7 CLASS 1 WIRING – Conductors of a Class 1 Circuit.

2.8 CLASS 2 CIRCUIT – A control circuit supplied from a source having limited voltage (30 Vrms or less) and current capacity, such as from the secondary of a Class 2 transformer, and rated for use with Class 2 remote-control or signaling circuits.

2.9 CLASS 2 WIRING – Conductors of a Class 2 circuit.

2.10 COMBINATION MOTOR CONTROLLER – One or more devices assembled to provide disconnecting means, branch circuit protection, motor control, and motor overload protection for a single motor circuit.

2.11 CONTROL CIRCUIT – A circuit that carries the electric signals directing the performance of a controller, and which does not carry the main power circuit. A control circuit is, in most cases, limited to 15 amperes.

2.12 CONTROL TRANSFORMER – A transformer whose secondary supplies power to control circuit devices only (excluding loads).

2.13 CONTROLLER – A device or group of devices that serves to govern, in some predetermined manner, the electric power delivered to the apparatus to which it is connected.

2.14 COVER – An unhinged portion of an enclosure that covers an opening.

2.15 DISCONNECT SWITCH – A device that disconnects all ungrounded conductors of a circuit from their electrical supply.

2.16 DOOR – A hinged portion of an enclosure that covers an opening.

2.17 DUTY, INTERMITTENT – Operation for alternate intervals of:

- a) Load and no load; or
- b) Load and rest; or
- c) Load, no load, and rest.

2.18 ENCLOSED INDUSTRIAL CONTROL PANEL – An industrial control panel provided with an enclosure at the factory.

2.19 FEEDER CIRCUIT – The conductors and circuitry on the supply side of the branch circuit overcurrent protective device.

2.20 FIELD INSTALLED EQUIPMENT – Devices to be installed after an industrial control panel is built/labeled.

2.21 FIELD WIRING – Conductors to be installed by others to connect the industrial control panel to source(s) of supply, remote control devices, and loads.

2.22 FIELD WIRING TERMINAL – A terminal provided in an industrial control panel to terminate field wiring.

2.23 FUSE, BRANCH CIRCUIT TYPE – A fuse of Class CC, CF, G, H, J, K, L, R, and T. These fuses are able to provide branch circuit protection.

2.24 FUSE, SEMICONDUCTOR TYPE – A fuse designed for the protection of semiconductor devices. These fuses are able to provide branch circuit protection of motor circuits containing power conversion equipment or a solid state motor controller or starter as in [31.1.3](#).

2.25 FUSE, SUPPLEMENTARY TYPE – Miscellaneous type and miniature type fuses. These fuses are able to provide supplementary protection only.

2.26 GENERAL-USE RATING – A rating, expressed in volts and amperes, assigned to a device that is intended to control:

- a) A load with a continuous or inrush current rating not exceeding the ampere rating of the device;
- b) When ac rated, a load that has a power factor of 0.75 to 0.80 (inductive); and
- c) When dc rated, a load that is resistive (noninductive).

2.27 HEATER TABLE – Table supplied by the manufacturer of an overload relay having replaceable current elements that provides additional instructions as to the proper installation.

2.28 INDUSTRIAL CONTROL PANEL FOR GENERAL USE – A control panel intended to be installed in accordance with the general use requirements in Chapter 4 of the National Electrical Code, ANSI/NFPA 70.

2.28A INTERLOCK (for safeguarding of industrial machinery) – An arrangement that interconnects guard(s) or device(s) with the control system or all or part of the electrical energy distributed to the machine.

2.28B INTERRUPTING RATING – The highest current at rated voltage that a device is identified to interrupt under standard test conditions.

2.29 INSTANTANEOUS TRIP CIRCUIT BREAKER – A circuit breaker in which no delay is introduced into the tripping action of the circuit breaker. These circuit breakers are able to provide motor branch circuit protection when evaluated as a part of a combination motor controller as in [31.1.1](#).

2.30 INVERSE-TIME CIRCUIT BREAKER – A circuit breaker in which a delay is introduced into the tripping action of the circuit breaker. The delay decreases as the magnitude of the current increases. These circuit breakers are able to provide branch circuit protection.

2.31 ISOLATED SECONDARY CIRCUIT – A circuit derived from an isolating source (such as a transformer, optical isolator, limiting impedance, or electro-mechanical relay) and having no direct connection back to the primary circuit (other than through the grounding means). A secondary circuit that has a direct connection back to the primary circuit is evaluated as part of the primary circuit.

2.32 LOAD – A device external to the industrial control panel that is connected to the power circuit.

2.33 LOW-VOLTAGE LIMITED ENERGY CIRCUIT – A control circuit involving a peak open-circuit potential of not more than 30 volts ac rms, 42.4 volts peak, or 60 volts dc supplied by a primary battery or by an isolated secondary circuit, and where the current capacity is limited by an overcurrent device, such as a fuse, or by the inherent capacity of the secondary transformer or power supply, or a combination of a secondary winding and an impedance. A circuit derived from a line-voltage circuit by connecting a resistance in series with the supply circuit to limit the voltage and current is not identified as a low-voltage limited energy circuit.

2.34 MANUAL SELF-PROTECTED COMBINATION MOTOR CONTROLLER – A self-protected combination motor controller that is operable only by manual means.

2.35 MOTOR STARTER – An assembly of an overload relay and a contactor.

2.36 ONE-PORT SPD – An SPD having provisions (terminals, leads, plug) for connection to the ac power circuit but no provisions (terminals, leads, receptacles) for supplying current to ac power loads.

2.37 OPEN INDUSTRIAL CONTROL PANEL – An industrial control panel that includes internal wiring, field wiring terminals, and components mounted on a subpanel without a complete enclosure. The enclosure is intended to be supplied/completed at the installation.

2.38 OVERCURRENT PROTECTION – A device designed to open a circuit when the current through it exceeds a predetermined value. The ampere rating of the device is selected for a circuit to terminate a condition where the current exceeds the rating of conductors and equipment due to overloads, short circuits and faults to ground.

2.39 OVERLOAD PROTECTION – Protection required for motor circuits that will operate to prohibit excessive heating due to running overloads and failure to start.

2.40 PILOT DUTY RATING – A rating assigned to a relay or switch that controls the coil of another relay or switch.

2.41 POWER CIRCUIT – Conductors and components of branch and feeder circuits.

2.42 POWER TRANSFORMER – A transformer whose secondary winding supplies power to loads or a combination of loads and control circuit devices operating at the secondary voltage.

2.42A PRESENCE OF VOLTAGE DETECTION DEVICE – A permanently-mounted device that is provided with a visual indicator that signals the presence of voltage from outside an electrical enclosure.

2.43 SELF-PROTECTED COMBINATION MOTOR CONTROLLER – A combination motor controller that contains coordinated overload and short circuit protection, and also provides disconnecting means and remotely-operable motor controller. Coordinated protection is able to be inherent or obtained by correct selection of components or accessory parts in accordance with the manufacturer's instructions.

2.44 SHORT CIRCUIT CURRENT RATING – The prospective symmetrical fault current at a nominal voltage to which an apparatus or system is able to be connected without sustaining damage exceeding the defined acceptance criteria.

2.45 SUPPLEMENTARY PROTECTION – A device intended to provide additional protection subsequent to branch circuit protection. They have not been evaluated for providing branch circuit protection.

2.46 SUPPLEMENTARY PROTECTOR – A manually resettable device designed to open the circuit automatically on a predetermined value of time versus current or voltage within an appliance or other electrical equipment. It is also able to be provided with manual means for opening or closing the circuit. These devices are able to provide supplementary protection only.

2.47 SURGE PROTECTIVE DEVICE (SPD) – A device composed of at least one non-linear component and intended for limiting surge voltages on equipment by diverting or limiting surge current and is capable of repeating these functions as specified. SPDs were previously known as Transient Voltage Surge Suppressors or secondary surge arresters.

2.48 SURGE PROTECTIVE DEVICE (SPD) ELECTRICAL RATINGS:

- a) **NOMINAL DISCHARGE CURRENT (In)** – Peak value of the current, selected by the manufacturer, through the SPD having a current waveshape of 8/20 where the SPD remains functional after 15 surges.
- b) **MAXIMUM CONTINUOUS OPERATING VOLTAGE (MCOV) rating** – The maximum continuous operating voltage that may be applied between the terminals of a surge protective device (SPD).
- c) **NORMAL OPERATING VOLTAGE RATING** – The voltage rating assigned to an SPD by the manufacturer. For an SPD, other than a Component-SPD, it is generally equal to the nominal value of the voltage of the circuit (for example, 120, 208, 240, 347, 480, or 600 Vrms).

2.49 SURGE PROTECTIVE DEVICE (SPD) TYPE DESIGNATIONS – SPD Type designations are as follows:

TYPE 1 – Permanently connected SPDs intended for installation between the secondary of the service transformer and the line side of the service equipment overcurrent device, as well as the load side, including watt-hour meter socket enclosures and intended to be installed without an external overcurrent protective device.

TYPE 2 – Permanently connected SPDs intended for installation on the load side of the service equipment overcurrent device – including SPDs located at the branch panel.

TYPE 3 – Point of utilization SPDs, installed at a minimum conductor length of 10 meters (30 feet) from the electrical service panel to the point of utilization, for example cord connected, direct plug-in, receptacle type and SPDs installed at the utilization equipment being protected. The distance of 10 meters (30 feet) is exclusive of conductors provided with or used to attach SPDs.

TYPE 4 COMPONENT ASSEMBLIES – Component assembly consisting of one or more Type 5 components together with a disconnect (integral or external) or a means of complying with the limited current tests.

TYPE 1, 2, 3 COMPONENT ASSEMBLIES – Consists of a Type 4 component assembly with internal or external short circuit protection. These types are tested and rated based on the intended application as either Type 1, 2 or 3 SPD's.

TYPE 5 – Discrete component surge suppressors, such as MOVs that may be mounted on a PWB, connected by its leads or provided within an enclosure with mounting means and wiring terminations.

2.50 TUNGSTEN RATING – A rating assigned to devices intended to control incandescent lamp loads.

2.51 TWO-PORT SPD – An SPD having provisions (terminals, leads, plug) for connection to the ac power circuit and provisions [terminals, leads, receptacles(s)] for supplying current to one or more ac power loads. SPDs provided with a minimum of two adjacent terminals for each circuit conductor may be considered and tested as a two-port SPD.

2.52 WIRE BENDING SPACE – The amount of space required between a field wiring terminal and an enclosure wall directly opposite the terminal, to provide enough space for field wiring conductors.

3 Undated References

3.1 Any undated reference to a code or standard appearing in the requirements of this standard shall be interpreted as referring to the latest edition of that code or standard.

4 Components

4.1 Except as indicated in [4.2](#), a component of a product covered by this standard shall comply with the requirements for that component. See Appendix [A](#) for a list of standards covering components used in the products covered by this standard.

4.2 A component is not required to comply with a specific requirement that:

- a) Involves a feature or characteristic not required in the application of the component in the product covered by this standard, or
- b) Is superseded by a requirement in this standard.

4.3 A component shall be used in accordance with its rating established for the intended conditions of use.

4.4 Specific components are incomplete in construction features or restricted in performance capabilities. Such components are intended for use only under limited conditions, such as certain temperatures not exceeding specified limits, and shall be used only under those specific conditions.

4.5 A component that complies with the requirements of Appendix [B](#), or Appendix [D](#) is able to be used in a product covered by this standard.

5 Units of Measurement


5.1 Values stated without parentheses are the requirement. Values in parentheses are explanatory or approximate information.

5.2 For calculations involving amperes, calculations resulting in a fraction of less than 0.5 shall be rounded down to the next whole number. Calculations resulting in a fraction of 0.5 or more shall be rounded up to the next whole number.

6 Terminology

6.1 For the purpose of this standard, the terms illustrated in [Figure 6.1](#), [Figure 6.2](#), and [Figure 6.3](#) shall apply.

Figure 6.1
Description of terminology

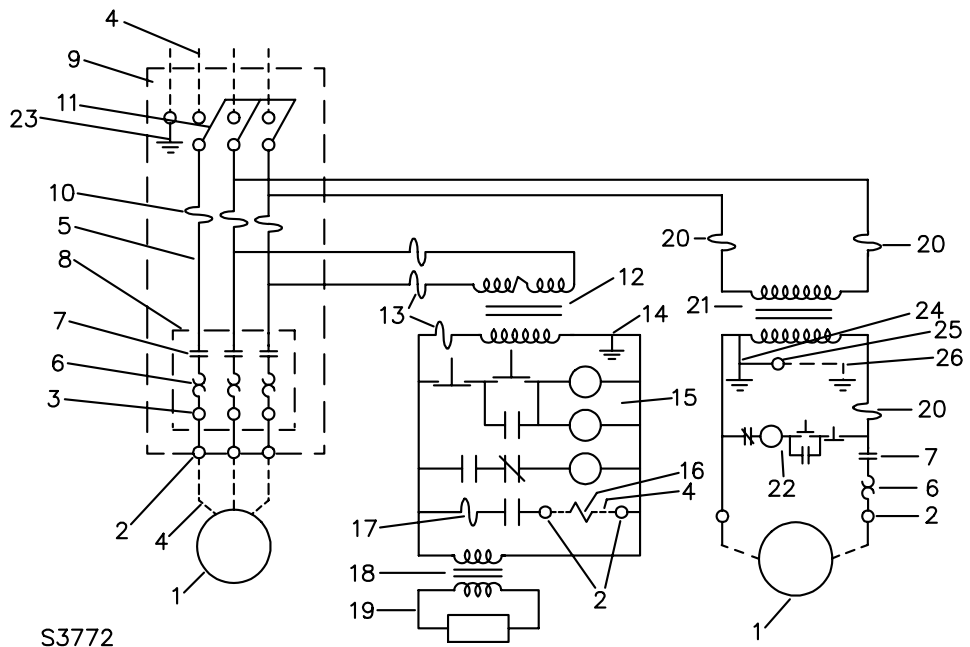

- | | |
|--|--|
| 1 Load (provided in field) | 14 Control transformer ground (for 1000 VA max control transformer) |
| 2 Field wiring terminals | 15 Control circuit devices and wiring/Class 1 circuit/isolated secondary circuit |
| 3 Alternate field terminals | 16 Solenoid or other control device – provided in field |
| 4 Field wiring | 17 Supplementary protection |
| 5 Power circuit internal wiring | 18 Class 2 transformer |
| 6 Overload relay & heater elements | 19 Class 2 circuit |
| 7 Contactor/Controller | 20 Power transformer fuse/branch circuit protection |
| 8 Starter | 21 Power transformer – for motor load and control circuit |
| 9 Combination motor controller | 22 Control circuit/Class 1 circuit/common control circuit |
| 10 Branch circuit protection | 23 Equipment ground and equipment ground terminal |
| 11 Fused disconnect switch or circuit breaker | 24 Bonding conductor/bonding jumper |
| 12 Control transformer | 25 Grounding electrode conductor terminal |
| 13 Control transformer fuse/supplementary protection | 26 Grounding electrode conductor (provided in field) |

Figure 6.2
Description of control circuits and power circuits


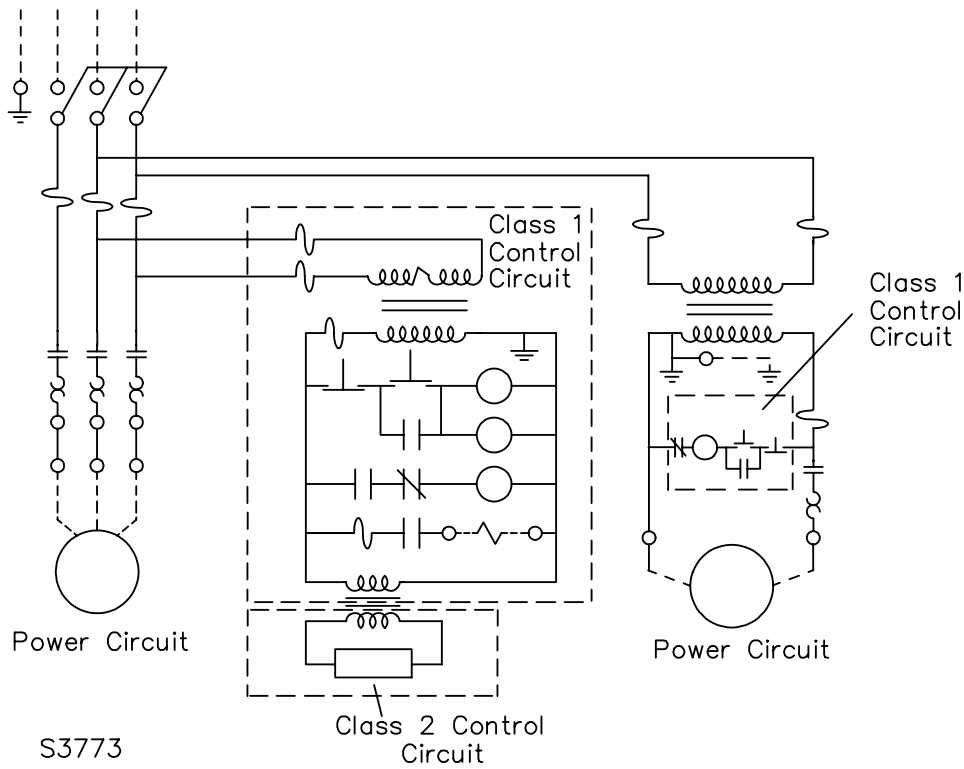


Figure 6.3
Description of branch circuits and feeder circuits

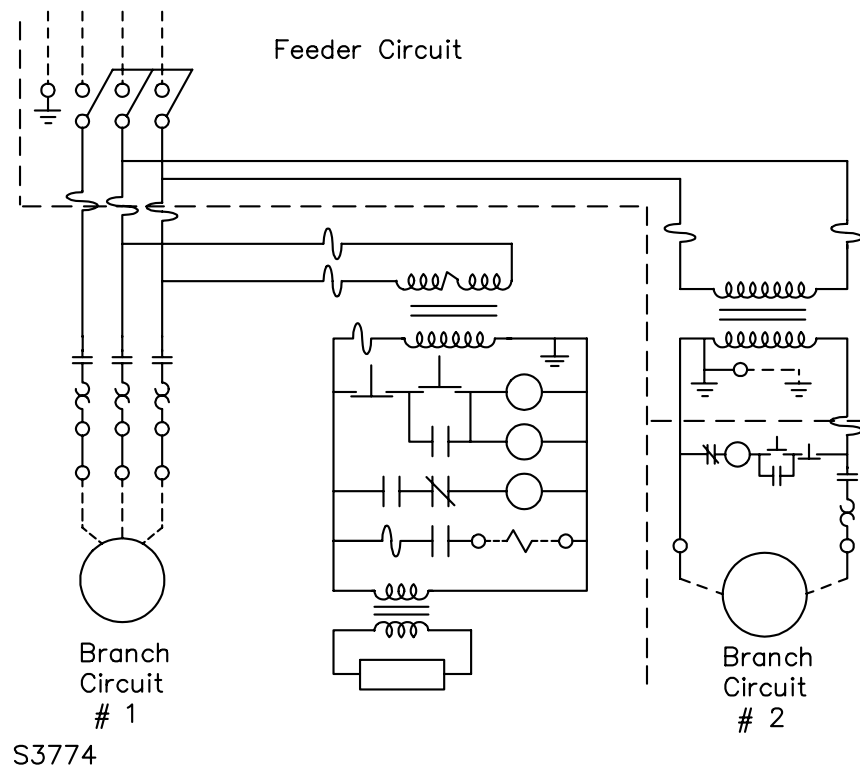

CONSTRUCTION

ALL PANELS

7 General

7.1 An industrial control panel shall:

- Be constructed so that it complies with the rules for installation and use of such equipment as given in the National Electrical Code, ANSI/NFPA 70; and
- Employ materials and components that are determined to be usable in the application.

8 Protection Against Corrosion

8.1 Iron and steel parts shall be protected against corrosion by enameling galvanizing, plating, or other equivalent means. This applies to all springs and other parts required for proper mechanical operation.

Exception: This requirement does not apply to:

- Bearings, thermal elements, sliding surfaces of a hinge, shaft, or similar part, where such protection is impracticable;
- Small parts of iron or steel, such as washers, screws, bolts, or similar parts, when the parts are not current carrying or relied upon to support or maintain the relative position of uninsulated live parts or components; and

c) Parts made of stainless steel.

9 Support and Securement of Live Parts

9.1 Provisions shall be made for securely mounting components to a supporting surface. A bolt, screw, or other part used to secure a part of a component shall not also be used to secure the component to the supporting surface.

9.2 A live screwhead or nut on the underside of an insulating base shall be prohibited from loosening by means of a star or lock washer and shall be insulated from the mounting surface by an insulating barrier that complies with Section [12](#), Insulating Barriers, or by through air and over surface spacings specified in Section [10](#), Spacings.

9.3 An uninsulated live part, including a terminal, or a component with uninsulated live parts shall be secured to its supporting surface by a method other than friction so that it is prohibited from turning or shifting in position. Turning or shifting of a live part is able to be prohibited by the use of:

- a) Two or more screws or rivets securing the component or part to the mounting surface;
- b) Non-circular shoulders or mortises that abuts an adjacent part or mechanical stop member such as a mounting rail;
- c) Non-circular shoulders or mortises that fit through an opening of the same shape cut into the mounting surface for a panel-mounted component or part;
- d) A dowel, pin, lug, or offset that mates with a hole, recess or offset in the mounting surface; or
- e) A connecting strap or clip fitted into an adjacent part.

9.4 For a live part or a component with uninsulated live parts that are secured by means other than as in [9.3](#), the part or component shall comply with the following:

- a) The mounting screw or nut, when provided, is loosened (one component or part at a time) to allow movement;
- b) Is subjected to typical operation of the device, such as switch operation, relamping operation or fuse replacement operation, or rotated to the extent limited by the mounting screw or other means; and
- c) As a result of (a) and (b), the spacings between the uninsulated live parts shall not be reduced below the requirements in Section [10](#), Spacings, and the internal wiring shall not be damaged or strain transmitted to the terminals due to operation or rotation.

10 Spacings

10.1 Other than as required by [9.2](#), [9.4](#), [10.8](#), [12.1](#), [13.2](#), Exception to [21.3.4](#), [28.2.1\(a\)](#), [28.2.2\(a\)](#), [29.2.2\(a\)](#), [29.3.7](#), [29.3.9](#), and [36.2.3](#), spacings at and within a component or device shall be investigated based on the requirements for that component or device.

10.2 Unless otherwise specified in this standard, spacings between uninsulated live parts of adjacent components, between uninsulated live parts of components and grounded or accessible dead-metal parts, between uninsulated live parts of components and the enclosure, and at field wiring terminals, shall be:

- a) According to [Table 10.1](#) or [Table 10.1A](#) for the following:

- 1) Field wiring terminals of a feeder tap terminating in a branch circuit protective device in a remote subpanel included on the panel schematic;
- 2) Field wiring terminals of a branch circuit, control circuit (including the control circuits of power circuit components), or an instrumentation circuit;
- 3) Factory wired terminals of feeder circuits, feeder tap circuits, branch circuits, control circuits, and instrumentation circuits;
- 4) Bus bars in a branch circuit constructed and rated according to the requirements in [29.6.2](#) or Appendix [D](#) of this standard.

b) According to [Table 10.2](#) for the following:

- 1) Field wiring terminals for input or output of feeder circuits, except for voltages of 251 – 1000V, a 12.7mm (1/2 in) spacing through air to grounded parts is permitted; and
- 2) Bus bars in a feeder circuit constructed and rated according to the requirements in [29.6.2](#) or Appendix [D](#) of this standard.

Exception: Spacings at field wiring terminals for the supply connection to an industrial control panel, where the branch circuit protective device, protecting a branch circuit in the panel, is omitted and provided by the installer in accordance with [60.1](#), shall be permitted to comply with [Table 10.1](#).

Table 10.1
Minimum required spacings in branch and control circuits

Potential involved in volts rms ac or dc		Minimum spacing, inch (mm)					
		A			B		C
		General industrial control equipment			Devices having limited ratings ^a		All circuits ^d
		51 – 150	151 – 300	301 – 600	51 – 300	301 – 600	0 – 50
Between any uninsulated live part and an uninsulated live part of opposite polarity, uninsulated grounded part other than the enclosure, or exposed metal part ^{f,g}	Through air or oil	1/8 ^b (3.2)	1/4 (6.4)	3/8 (9.5)	1/16 ^b (1.6)	3/16 ^b (4.8)	1/16 ^b (1.6)
	Over surface	1/4 (6.4)	3/8 (9.5)	1/2 (12.7)	1/8 ^b (3.2)	3/8 (9.5)	1/16 ^b (1.6)
Between any uninsulated live part and the walls of a metal enclosure including fittings for conduit or armored cable ^{c,e}	Shortest distance	1/2 (12.7)	1/2 (12.7)	1/2 (12.7)	1/4 (6.4)	1/2 (12.7)	1/4 (6.4)
NOTES –							
1 A slot, groove, or similar gap, 0.013 inch (0.33 mm) wide or less in the contour of insulating material is to be disregarded for the purpose of measuring over surface spacings.							
2 An air space of 0.013 inch (0.33 mm) or less between a live part and an insulating surface is to be disregarded for the purpose of measuring over surface spacings.							
^a See 10.5 .							
^b The spacing between field wiring terminals of opposite polarity and the spacing between a field wiring terminal and a grounded dead metal part shall be at least 1/4 inch (6.4 mm) when short-circuiting or grounding of such terminals results from projecting strands of wire. For circuits involving no potential greater than 50 volts rms ac or dc, spacings at field wiring terminals are able to be 1/8 inch (3.2 mm) through air and 1/4 inch (6.4 mm) over surface.							

Table 10.1 Continued on Next Page

Table 10.1 Continued

Potential involved in volts rms ac or dc		Minimum spacing, inch (mm)					
		A			B		C
		General industrial control equipment			Devices having limited ratings ^a		All circuits ^d
		51 – 150	151 – 300	301 – 600	51 – 300	301 – 600	0 – 50
^c For the purpose of this requirement, a metal piece or component attached or mounted to the enclosure is evaluated as a part of the enclosure when deformation of the enclosure reduces the spacings between uninsulated live parts or between uninsulated live parts and metal parts.							
^d Spacings do not apply within a low-voltage limited energy circuit or a Class 2 circuit.							
^e Applicable to devices with sheet metal enclosures regardless of wall thickness and cast metal enclosures with a wall thickness of less than 1/8 inch (3.2 mm).							
^f These spacings are also applicable between any uninsulated live parts and the walls of a cast metal enclosure with a wall thickness of minimum 1/8 inch (3.2 mm) for devices with a limited rating complying with 10.5 .							
^g These spacings are also applicable between an insulated live part and the wall of a metal enclosure to which the component is mounted. Deformation of the enclosure shall not reduce spacings.							

Table 10.1A
Minimum required spacings in branch circuits rated 601 – 1000 V

Voltage, V rms ac or dc	Minimum Spacing, in (mm)			
	Between any uninsulated live part and an uninsulated live part of opposite polarity, uninsulated grounded part other than the enclosure, or exposed metal		Between any uninsulated live part and the walls of a metal enclosure including fittings for conduit or armored cable	
	Through Air	Over Surface	Through Air	Over Surface
601 – 1000	0.55 (14.0)	0.85 (21.6)	0.80 ^a (20.3) ^a	1.00 (25.4)
^a The through-air spacing shall not be less than 1/2 inch between live parts of a circuit breaker or fusible disconnecting means and grounded metal.				

Table 10.2
Spacings in feeder circuit

Voltage involved	Minimum spacing, inch (mm)		
	Between live parts of opposite polarity		Between live parts and grounded metal parts, through air and over surface
	Through air	Over surface	
125 or less	1/2 (12.7)	3/4 (19.1)	1/2 (12.7)
126 – 250	3/4 (19.1)	1-1/4 (31.8)	1/2 (12.7)
251 – 1000	1 (25.4)	2 (50.8)	1 ^a (25.4) ^a
NOTE – An isolated dead metal part, such as a screw head or a washer, interposed between uninsulated parts of opposite polarity or between an uninsulated live part and grounded dead metal is evaluated as reducing the spacing by an amount equal to the dimension of the interposed part along the path of measurement.			
^a The through-air spacing shall not be less than 1/2 inch between live parts of a circuit breaker or fusible disconnecting means and grounded metal, and between grounded metal and the neutral of an industrial control panel rated 277/480 volt, 3-phase, 4-wire.			

10.3 Spacings between isolated circuits at different potentials shall be in accordance with those required for the higher potential circuit.

10.4 A through air spacing of 5/8 inch (15.9 mm) shall be provided between the terminals of an oil-filled capacitor and any uninsulated live part at opposite polarity, of a different (isolated) circuit, or to grounded metal parts. The spacing shall be measured in a direction perpendicular to the end cap.

10.5 The spacings specified in column B of [Table 10.1](#) are applicable to equipment:

- a) Rated 1 horsepower (746 W output) or equivalent FLA, or less, 720 volt-amperes break pilot duty or less; or not more than 15 amperes at 51 – 150 volts, 10 amperes at 151 – 300 volts, or 5 amperes at 301 – 600 volts.
- b) Of the type described in (a) which controls more than one load when the total load connected to the line at one time does not exceed 2 horsepower (1492 W output), 1440 volt-amperes, or have a current rating greater than 30 amperes at 51 – 150 volts, 20 amperes at 151 – 300 volts, or 10 amperes at 301 – 600 volts.

10.6 The spacings between live parts and metal parts that are intended to be grounded, such as the heads of mounting screws that pass through an insulating panel, shall be evaluated as grounded parts within an enclosure.

10.7 For an enclosed panel without conduit openings or knockouts, spacings not less than the minimum specified in [11.1](#) shall be provided between uninsulated live parts and a conduit bushing installed at any location intended to be used during installation. A permanent marking on the enclosure, a template, or a full-scale drawing furnished with the equipment is able to be used to identify such locations as in [53.6](#).

10.8 The spacings for a discrete fuseholder shall be as follows:

- a) A fuseholder used for fuses providing required branch circuit protection or feeder circuit protection shall comply with the spacings specified in column A of [Table 10.1](#);
- b) A fuseholder used for fuses providing supplementary protection within the branch circuit shall comply with the spacings specified in [Table 10.1](#).

10.9 The spacings for connectors, receptacles, attachment plugs, inlets and cable assemblies described in [28.2.5](#), [28.6.1](#), [28.6.6](#) and [28.7.1](#) provided in a feeder circuit, branch circuit or control circuit and rated 600V or less shall be a minimum 3/64 inch (1.2 mm) for a device rated 250 V or less, and a minimum 1/8 inch (3.2 mm) for a device rated more than 250 V, between the following:

- a) Uninsulated live parts of opposite polarity;
- b) An uninsulated live part and a dead-metal part that is likely to be grounded or exposed to contact by persons when the device is installed as intended, including a metal surface on which the device is mounted in the intended manner or a metal face plate used with a flush receptacle.

11 Conduit Bushings

11.1 An enclosure with openings for wiring systems, where provided, shall have a flat surrounding surface for proper seating of a conduit bushing. Each opening shall be so located that installation of a bushing having dimensions as specified in [Table 11.1](#) does not result in spacings between uninsulated live parts and the bushing of less than the minimum requirement. When multiple size knockouts are provided, spacings shall be determined using the largest bushing size accommodated unless the equipment is marked to specify maximum usable size.

Table 11.1
Dimensions of bushings

Trade size of conduit, inches	Bushing dimensions, inches (mm)			
	Overall diameter		Height	
1/2	1	(25.4)	3/8	(9.5)
3/4	1-15/64	(31.4)	27/64	(10.7)
1	1-19/32	(40.5)	33/64	(13.1)
1-1/4	1-15/16	(49.2)	9/16	(14.3)
1-1/2	2-13/64	(56.0)	19/32	(15.1)
2	2-45/64	(68.7)	5/8	(15.9)
2-1/2	3-7/32	(81.8)	3/4	(19.1)
3	3-7/8	(98.4)	13/16	(20.6)
3-1/2	4-7/16	(112.7)	15/16	(23.8)
4	4-31/32	(126.2)	1	(25.4)
4-1/2	5-35/64	(140.7)	1-1/16	(27.0)
5	6-7/32	(158.0)	1-3/16	(30.2)
6	7-7/32	(183.4)	1-1/4	(31.8)

12 Insulating Barriers

12.1 When an insulating material is used as a barrier in order to comply with the required over surface or through air spacings, or both, the required spacings in Section 10, Spacings, shall be applied by tracing over the surface of the insulator and through air to the edges of the insulator.

12.2 Insulating material used as specified in 12.1 shall comply with the following requirements:

a) The material shall be:

- 1) An insulating material described in Table 12.1 or Table 13.1; or
- 2) Tubing or sleeving complying with 29.2.3 and rated for the voltage involved;

b) The material is able to be in direct contact with uninsulated live parts; and

c) The material does not serve to physically support or maintain the position of an uninsulated live part.

Exception: A material that does not comply with 12.2 shall be investigated as an insulating barrier in accordance with the requirements in the Standard for Industrial Control Equipment, UL 508, or the Standard for Low-voltage Switchgear and Controlgear – Part 1: General Rules, UL 60947-1.

Table 12.1
Generic materials for use as barriers

Generic material	Minimum thickness	
	inches	(mm)
Aramid Paper	0.010	(0.25)
Electrical Grade Paper	0.028	(0.71)
Epoxy	0.028	(0.71)
Mica	0.006	(0.15)
Mylar (PETP)	0.007	(0.18)
RTV	0.028	(0.71)
Silicone Rubber	0.028	(0.71)
Vulcanized Fiber	0.028	(0.71)

13 Insulating Materials

13.1 An insulating material that is used for the direct support of an uninsulated live part, such as a standoff or insulating base for a bus bar, current shunt, or terminal, shall comply with [13.2](#). A material is in direct support of an uninsulated live part when:

- a) It is in direct physical contact with the uninsulated live part; and
- b) It serves to physically support or maintain the relative position of the uninsulated live part.

Exception: A material in direct contact only with uninsulated live parts of a low-voltage limited energy circuit or a Class 2 circuit is not required to comply with [13.1](#).

13.2 Insulating material used as specified in [13.1](#) shall comply with the following requirements:

- a) The material shall be an insulating material described in [Table 13.1](#); and
- b) The dimensions of the insulating material shall comply with the required spacings of Section [10](#), Spacings.

Exception: A material that does not comply with [13.2](#) shall be investigated as an insulating material in accordance with the requirements in the Standard for Industrial Control Equipment, UL 508, or the Standard for Low-voltage Switchgear and Controlgear – Part 1: General Rules, UL 60947-1.

Table 13.1
Generic materials for direct support of uninsulated live parts

Generic material	Minimum thickness	
	inches	(mm)
Diallyl phthalate	0.028	(0.71)
Epoxy	0.028	(0.71)
Melamine	0.028	(0.71)
Melamine-phenolic	0.028	(0.71)
Phenolic	0.028	(0.71)
Unfilled nylon	0.028	(0.71)
Unfilled polycarbonate	0.028	(0.71)
Urea formaldehyde	0.028	(0.71)
Ceramic, porcelain, and slate	no limit	no limit
Beryllium oxide	no limit	no limit
GPO-2 and GPO-3 Glass reinforced thermoset polyester	0.055	(1.4)

14 Grounding – General

14.1 An industrial control panel shall have provision for grounding all noncurrent carrying metal parts that are exposed or that are able to be contacted by persons during normal operation or adjustment of the equipment and that are able to become energized due to a breakdown of insulation, loose wiring connection, or electrical disturbance. Grounding (bonding) braids shall be listed according to UL 467 and sized according to [15.1](#).

14.2 An industrial control panel shall be provided with a field wiring terminal for the connection of an equipment grounding conductor. The terminal shall comply with:

- a) The component requirements of a field wiring terminal in accordance with Section [28](#), Field Wiring; or
- b) The requirements in the Standard for Grounding and Bonding Equipment, UL 467.

14.3 The equipment grounding terminal shall have electrical continuity with all metal parts of the enclosure, or subpanel for open type equipment, by means of metal-to-metal contact or by means of an internal bonding conductor that complies with [15.2](#).

14.4 An industrial control panel that is not intended to be permanently connected to the building power supply shall be provided with a flexible cord that:

- a) Complies with [28.5](#);
- b) Contains a grounding conductor that is connected to the grounding prong of the attachment plug; and
- c) Has the grounding conductor connected to the enclosure as in [14.1](#) and [14.2](#) and terminated with wiring methods described in [29.3.1](#) – [29.3.9](#).

15 Grounding – Size of Terminal or Bonding Conductor

15.1 A field wiring terminal for connection of an equipment grounding conductor shall accommodate the conductor size required by [Table 15.1](#) based upon the overcurrent protection provided for field wiring conductors supplying panel that is:

- a) The rating of the branch circuit protection marked on the industrial control panel, or wiring diagram, or as calculated from the requirements in [Section 31](#), Branch Circuit Protection, when branch circuit protection is not provided in the panel; or
- b) An ampere rating equal to the ampacity of the anticipated field wiring size calculated from [Section 28](#), Field Wiring, when the branch circuit and/or feeder protection is provided in the panel.

Exception: The terminal for the equipment grounding conductor is not required to retain a wire larger than the field wiring conductors supplying the panel.

Table 15.1
Size of equipment grounding conductor terminal

Maximum ampere rating of overcurrent protection for field wiring conductors supplying panel, see 15.1	Size of equipment grounding or bonding conductor, minimum			
	Copper		Aluminum	
	AWG or kcmil	(mm ²)	AWG or kcmil	(mm ²)
15	14	(2.1)	12	(3.3)
20	12	(3.3)	10	(5.3)
30	10	(5.3)	8	(8.4)
40	10	(5.3)	8	(8.4)
60	10	(5.3)	8	(8.4)
100	8	(8.4)	6	(13.3)
200	6	(13.3)	4	(21.2)
300	4	(21.2)	2	(33.6)
400	3	(26.7)	1	(42.4)
500	2	(33.6)	1/0	(53.5)
600	1	(42.4)	2/0	(67.4)
800	1/0	(53.5)	3/0	(85.0)
1000	2/0	(67.4)	4/0	(107.2)
1200	3/0	(85.0)	250 kcmil	(127)
1600	4/0	(107.2)	350	(177)
2000	250 kcmil	(127)	400	(203)
2500	350	(177)	600	(304)
3000	400	(203)	600	(304)
4000	500	(253)	800	(405)
5000	700	(355)	1200	(608)
6000	800	(506)	1200	(608)

15.2 The size of an internal bonding conductor shall not be less than the size specified in [Table 15.1](#) or the size of the field wiring conductor supplying the industrial control panel, whichever is smaller.

Exception: Where an internal over-current device is installed to protect control circuit conductors for door mounted equipment, the ampere rating of this over-current device can be used to size the bonding conductor for enclosure doors.

16 Transformer and Power Supply Secondary Grounding

16.1 A secondary circuit that contains field wiring terminals and is supplied from a power transformer, control transformer, or power supply shall have the secondary grounded under any of the following conditions:

- a) When the secondary voltage is less than 50 volts; and
 - 1) The supply to the primary is over 150 volts to ground; or
 - 2) The supply to the primary at any voltage is ungrounded;
- b) When the secondary voltage is 50 volts or greater and the secondary circuit is able to be grounded so that the maximum voltage to ground on the ungrounded conductors does not exceed 150 volts;
- c) When the secondary is a 3-phase, 4-wire, wye connected in which the center point of the wye is used as a circuit conductor; or
- d) When the secondary is a 3-phase, 4-wire, delta connected in which the midpoint of one phase winding is used as a circuit conductor.

16.2 For a transformer or power supply that is required to be grounded in accordance with [16.1](#), the secondary circuit shall be factory connected by a system bonding jumper to the enclosure and the grounding electrode conductor terminal. The size of the system bonding jumper shall be as specified in [75.1.4](#), based on the secondary rating. A grounding electrode conductor terminal sized to retain the required grounding electrode conductor in accordance with [75.1.4](#), based on the secondary rating, shall be provided in the enclosure containing the transformer or power supply and marked as specified in [54.10](#).

Exception No. 1: When the transformer or power supply is rated not more than 1000 volt-amperes and supplies only control circuits, the grounding electrode conductor terminal is able to be omitted and the system bonding jumper shall not be smaller than a 14 AWG (2.1 mm²) copper conductor. The jumper is not otherwise required to be larger than the phase conductors connected to the transformer secondary.

Exception No. 2: Where multiple separately derived systems are provided within the same industrial control panel enclosure, a single grounding electrode conductor terminal suitable for a 3/0 AWG conductor is able to be supplied in the industrial control panel as the field wiring connection for the common grounding electrode conductor.

16.3 When components marked with a slash voltage rating, such as 120/240V, 480Y/277V, or 600Y/347V, are provided on the secondary side of a power transformer or power supply, the secondary shall be grounded as in [16.1\(b\)](#), [16.1\(c\)](#), or at the center point of the wye for a 3 phase, 3 wire secondary circuit, and [16.2](#).

16.4 For a power circuit or control circuit supplied from a secondary circuit voltage that is not required to be grounded as in [16.1](#) and is rated 100 V or more, the secondary circuit shall be provided with monitoring devices to provide an audible or visual indication when a ground fault occurs in any ungrounded conductor, such as a panel mounted indicator light or display, or one that interrupts the circuit in the event of a ground fault, such as a ground fault protective device. For a monitoring device that does not interrupt the circuit, a ground fault shall not result in the bypassing of safety shutdown devices.

Exception: A control circuit supplied from a control transformer or power supply with secondary circuit voltage rated 100 V or more that has no provisions for field wiring connections is not required to comply with [16.4](#).

16.5 An industrial control panel that contains a transformer or power supply with a 3-phase, 4-wire delta secondary, as described in [16.1](#)(d), and provided with field wiring terminals for loads to be connected between a phase and the neutral, shall comply with [29.3.14](#).

17 Identification of Grounding and Grounded Circuit Conductors and Terminals

17.1 A pressure wire connector intended for connection of a field-installed equipment grounding conductor shall be marked in accordance with [54.5](#).

17.2 A wire-binding screw terminal intended for connection of a field-installed equipment grounding conductor not larger than 10 AWG (5.3 mm²) shall be colored green or marked in accordance with [54.5](#).

17.3 Insulated grounding and bonding conductors shall be identified by the color green with or without one or more yellow stripes and no other conductor shall be so identified.

Exception No. 1: Insulated conductors sized 4 AWG (21.2 mm²) or larger and having insulation colored other than as in [17.3](#), and insulated conductors that are not manufactured in this color, shall be identified at each termination point by a green marking, such as tape wrapped around the conductor.

Exception No. 2: Integral leads of components are not required to meet this requirement.

17.4 Insulated grounded circuit conductors connected to the grounded side of a transformer secondary circuit containing field wiring terminals as in Section [16](#), Transformer and Power Supply Secondary Grounding, shall be identified by the color white or gray or by three continuous white stripes on other than green insulation along its entire length.

Exception No. 1: Insulated conductors sized 4 AWG (21.2 mm²) or larger and having insulation colored other than as in [17.4](#), and insulated conductors that are not manufactured in this color, shall be identified at each termination point by a white marking, such as tape wrapped around the conductor.

Exception No. 2: Integral leads of components are not required to meet this requirement.

Exception No. 3: Insulated conductors of a multi-conductor cable colored other than as in [17.4](#) shall be identified at each termination point by a white marking, such as tape wrapped around the conductor.

17.5 Where more than one grounded circuit conductor is identified within an industrial control panel, each grounded circuit conductor shall be:

a) Identified by:

1) A means that complies with [17.4](#); or

2) An outer covering of white or gray with a colored stripe other than green running along the length of the insulation; and

b) Identified by means in (a) that is different than the grounded circuit conductors of another system and no other conductors in the industrial control panel shall be so identified.

17.6 A grounded circuit conductor of a flexible cord shall be identified by one of the following means:

- a) A white or gray outer finish;
- b) A braid with an outer finish colored white or gray; or
- c) A white or gray tracer woven into the braid of contrasting color and no other conductor in the cord having a tracer.

ENCLOSED PANELS

18 Enclosures

18.1 An open industrial control panel intended to be installed completely within an enclosure in the field shall comply with the requirements in Sections [7 – 17](#) and Sections [28 – 61](#). Portions of an open industrial control panel that serve to complete an ultimate enclosure after installation shall additionally comply with Sections [18 – 27](#) and [62 – 64](#).

18.2 Two or more open type industrial control panels having partial enclosures intended to be assembled together in the field in order to form a completely enclosed industrial control panel shall be evaluated as an enclosed device and comply with Sections [18 – 27](#). Each open type section shall be marked in accordance with [53.4](#).

18.2A Pipelines, tubing or devices for handling air, or liquids, where pressures do not exceed 300psi, shall not be located in electrical enclosures containing uninsulated live parts, and shall be installed on the exterior of the panel, or in a compartment of the enclosure that is completely separated by a barrier from the electrical control equipment other than enclosed electrical components. Enclosure compartments containing pipelines or tubing carrying liquids shall be located so that any leakage will not enter the electrical equipment compartment and have a means for drainage.

Exception: For components requiring air supply, liquid cooling or intended for air or liquid analyzing for other than life safety purposes, the pipeline or tubing supplying the component is not required to be separated.

18.2B Where provided with a metal barrier inside the enclosure it shall be at least 0.053 inch (1.35 mm) thick uncoated steel, or 0.075 inch (1.91 mm) thick aluminum.

Exception: A metal barrier may be of thinner metal provided its strength and rigidity are not less than that of a flat sheet of steel having the same dimensions as the barrier and of the specified thickness.

18.2C Where provided with a nonmetallic barrier inside the enclosure it shall be at least 0.250 inch (6.35 mm) thick and shall be supported to provide mechanical strength and rigidity.

Exception: A nonmetallic material less than 0.250 inch thick shall be located so that it is not subjected to mechanical damage during installation and supported to provide mechanical strength and rigidity.

18.2D The separated compartment, containing equipment for handling liquids, mentioned in [18.2A](#), shall be investigated to the performance requirements applicable to the enclosure environmental Type(s) in the Standard for Enclosures for Electrical Equipment, Environmental Considerations, UL 50E.

18.3 An enclosed industrial control panel shall comply with Sections [18 – 27](#) and the enclosure shall comply with:

- a) The requirements in the Standard for Enclosures for Electrical Equipment, Non-Environmental Considerations, UL 50, and the Standard for Enclosures for Electrical Equipment, Environmental Considerations, UL 50E; or

b) The industrial control panel enclosure requirements in Sections [62](#) – [64](#).

18.4 A door shall be provided on an enclosure that contains:

- a) Power circuit fuses;
- b) Circuit breakers located within power circuits which require renewal or resetting from inside the enclosure;
- c) Motor overload protective devices which require renewal or resetting from inside the enclosure; or
- d) Devices, such as timers or chart recorders, for which servicing or resetting is required.

Exception: A door is not required for an enclosure:

- a) To which access is required only in the event of a burnout of a current element or similar component on short circuit;*
- b) In which the only fuse enclosed is a control-circuit fuse, when the fuse and control-circuit load are within the same enclosure; or*
- c) In which a means is provided for resetting all overload-protective devices from outside the enclosure.*
- d) When the removable cover is flanged and is interlocked with the external operating handle of the disconnecting means so that power is removed from all components in the enclosure before the cover can be removed in order to replace fuses or to reset overload protective devices.*

18.5 The enclosure shall be constructed so that all doors are able to be opened to a minimum of 90 degrees from the closed position.

18.6 Pipelines, tubing and/or devices for managing air or liquid media shall not be installed within an industrial control panel enclosure incorporating electrical control equipment, unless they are installed in a separate compartment segregated from electrical control equipment by a barrier that meets the requirements of [22.3](#) – [22.5](#).

Exception: Components requiring air supply, liquid cooling, intended for air or liquid analyzing or equipment for fire suppression systems are not required to be separated.

18.7 Enclosure compartments containing pipelines or tubing that contain a liquid media shall have provisions to prevent the potential leakage of liquid or condensation from coming into contact with electrical control equipment.

18.8 In addition, compartments containing pipelines, tubing and/or devices for managing air or liquid media shall also comply with the requirements defined in [18.3](#) – [18.5](#).

19 Enclosure Openings

19.1 All openings provided for conduit connections in the field shall be of standard dimensions. When provided, conduit fittings shall comply with the Standard for Conduit, Tubing, and Cable Fittings, UL 514B. For enclosures other than Type 1, as noted in column 1 of [Table 19.1](#), the conduit openings and fittings shall additionally comply with the requirements specified in column 2 of [Table 19.1](#).

Exception: A conduit fitting that does not comply with [Table 19.1](#) is able to be evaluated to the performance requirements in the Standard for Enclosures for Electrical Equipment, Environmental Considerations, UL 50E, corresponding to the required enclosure type rating.

Table 19.1
Openings for conduit connections in enclosures with environmental rating other than Type 1

Enclosure type (Column 1)	Conduit instructions (Column 2)
2, 3R, 3RX	a) All holes for conduit shall be below all uninsulated live parts; or b) Conduit openings above the lowest uninsulated live parts shall be provided with conduit fittings having an environmental rating that complies with Table 19.2 or Table 19.2A ; or c) The enclosure shall be marked as in 53.2 with instructions for the installer to apply fittings complying with (a) or (b).
3, 3S, 3SX, 3X, 4, 4X, 5, 12, 12K	d) All holes for conduit shall be provided with conduit fittings having an environmental rating that complies with Table 19.2 or Table 19.2A or as specified by the enclosure manufacturer; or e) The enclosure shall be marked as in 53.3 with instructions to apply fittings complying with (d).
6, 6P	f) All holes for conduit shall be provided with conduit fittings having an environmental rating that complies with Table 19.2 or Table 19.2A .
13	g) All holes for conduit shall be provided with conduit fittings having an environmental rating that complies with Table 19.2 or Table 19.2A ; or h) No conduit openings shall be provided.

19.2 Openings for wireways shall be provided with a cover plate or supplied with the wireway. When provided, wireway shall comply with the Standard for Wireways, Auxiliary Gutters, and Associated Fittings, UL 870.

19.3 Openings provided in enclosures for mounting components shall be covered with components intended for such mounting. Openings provided for components, including ventilation openings, or observation windows, shall be closed with components that have been evaluated for one of the enclosure Types in the heading of column 2 of [Table 19.2](#) or [Table 19.2A](#). The assembled enclosure is derated to the enclosure type rating indicated in the table corresponding to the type rating of the empty enclosure from column 1 and the type rating of the component from column 2 that results in the lowest rating.

Exception: A component that does not comply with [Table 19.2](#) or [Table 19.2A](#) is able to be evaluated to the performance requirements in the Standard for Enclosures for Electrical Equipment, Environmental Considerations, UL 50E, corresponding to the required enclosure type rating.

Table 19.2
Enclosure rating/derating table

Enclosure Type (Column 1)	Component rating (Column 2)										
	1	2	3R	Wet Loc		RainTight	RainProof	Weather Proof	3RX	3	3S
1	1	1	1	1		1	1	1	1	1	1
2	2 or 1 ^a	2	2	2		2	1	1	2	2	2
3R	1	2	3R	3R		3R	3R ^b	3R ^b	3R	3R	3R
3RX	1	2	3R	3R		3R	3R ^b	3R ^b	3RX	3R	3R
3	1	2	3R ^e	3R ^e		3R ^e	3R ^{b,e}	3R ^{b,e}	3R	3	3
3S	1	2	3R ^e	3R ^e		3R ^e	3R ^{b,e}	3R ^{b,e}	3R	3 ^c	3S
3SX	1	2	3R ^e	3R ^e		3R ^e	3R ^{b,e}	3R ^{b,e}	3RX	3	3S
3X	1	2	3R ^e	3R ^e		3R ^e	3R ^{b,e}	3R ^{b,e}	3RX	3	3S ^c
4	1	2	3R ^e	3R ^e		3R ^e	3R ^{b,e}	3R ^{b,e}	3R	3	3
4X	1	2	3R ^e	3R ^e		3R ^e	3R ^{b,e}	3R ^{b,e}	3RX	3	3
4X Indoor Use Only	1	2	5 ^f	5 ^f		5 ^f	1	1	5 ^f	5 ^f	5 ^f
5	1	2	5	5		5	1	1	5	5	5
6	1	2	3R ^e	3R ^e		3R ^e	3R ^e	3R ^e	3R ^e	3	3
6P	1	2	3R ^e	3R ^e		3R ^e	3R ^e	3R ^e	3RX ^e	3	3
12	1	2	5 ^f	5 ^f		5 ^f	1	1	5 ^f	5 ^f	5 ^f
12K	1	1	1	5 ^f		5 ^f	1	1	1	5 ^f	5 ^f
13	1	1	1	5 ^f		5 ^f	1	1	1	5 ^f	5 ^f

^a Type 1 Components, ventilation openings, or windows under a drip shield are allowed to be used as Type 2.

^b Components marked Weatherproof, or Rainproof are allowed to be installed below all other live parts in enclosure.

^c Components with external operating mechanisms must be Type 3S or 3SX for use on 3S, otherwise rating becomes Type 3.

^d Components with external operating mechanisms must be Type 3SX for use on 3SX, otherwise rating becomes Type 3.

^e Must add drain, and locking mechanism or require tool entry.

^f Must add locking mechanism or require tool entry.

Table 19.2A
Enclosure Rating/Derating Table

Enclosure Type (Column 1)	Component rating (Column 2)										
	3SX	3X	4	4X	4X Indoor Use Only	5	6	6P	12	12K	13
1	1	1	1	1	1	1	1	1	1	1	1
2	2	2	2	2	2	2	2	2	2	2	2
3R	3R	3R	3R	3R	1	1	3R	3R	1	1	1
3RX	3RX	3RX	3R	3RX	1	1	3R	3RX	1	1	1
3	3	3	3	3	5 ^f	5 ^f	3	3	1	1	1
3S	3S	3S ^c	3S ^c	3S ^c	5 ^f	5 ^f	3S ^c	3S ^c	1	1	1
3SX	3SX	3SX ^d	3 ^d	3SX ^d	5 ^{d,f}	5 ^{d,f}	3S ^{c,d}	3SX ^{c,d}	1	1	1
3X	3X	3X	3	3X	5 ^f	5 ^f	3	3X	1	1	1
4	3	3	4	4	5 ^f	5 ^f	4	4	1	1	1
4X	3RX	3RX	4	4X	4X Indoor Use Only	5 ^f	4	4X	1	1	1
4X Indoor Use Only	5 ^f	5 ^f	5 ^f	4X Indoor Use Only	4X Indoor Use Only	5 ^f	5 ^f	4X Indoor Use Only	1	1	1
5	5	5	5	5	5	5	5	5	5	5	5
6	3	3	4	4	5 ^f	5 ^f	6	6	1	1	1
6P	3X	3X	4	4X	4X Indoor Use Only	5 ^f	6	6P	1	1	1
12	5 ^f	5 ^f	5 ^f	5 ^f	5 ^f	5 ^f	5 ^f	5 ^f	12	12	12
12K	1	1	5 ^f	5 ^f	5 ^f	5 ^f	5 ^f	5 ^f	12K	12K	12K
13	1	1	5 ^f	5 ^f	5 ^f	5 ^f	5 ^f	5 ^f	12	12	13

^a Type 1 Components, ventilation openings, or windows under a drip shield are allowed to be used as Type 2.

^b Components marked Weatherproof, or Rainproof are allowed to be installed below all other live parts in enclosure.

^c Components with external operating mechanisms must be Type 3S or 3SX for use on 3S, otherwise rating becomes Type 3.

^d Components with external operating mechanisms must be Type 3SX for use on 3SX, otherwise rating becomes Type 3.

^e Must add drain and locking mechanism or require tool entry.

^f Must add locking mechanism or require tool entry.

19.4 Deleted

Table 19.3
Alternate enclosure ratings
Table deleted

19.5 No covering is required across the bottom of a floor-mounting enclosure when the lower edge of the enclosure is within 6 inches (152 mm) of the floor and when exposed live parts within the device are at least 6 inches above the highest portion of the lower edge of the enclosure.

19.6 Enclosures intended for use with conduit hubs, closure plates and other equipment intended to be field installed shall be marked or provided with instructions that identify the equipment necessary to maintain the environmental integrity of the enclosure. This may be accomplished by identifying the necessary environmental type designation or by identifying the specific manufacturer and models of the field installed equipment.

20 Accessibility of Live Parts

20.1 The minimum distance specified in [Table 20.1](#) shall be provided between an opening in an enclosure and:

- a) Uninsulated live parts of components inside of the enclosure where the circuit voltage is greater than 30 V ac or 42.4 V dc; and
- b) Moving parts of components inside of the enclosure, such as a fan blade. The distance is measured in a straight line from any point around the edge of the opening to uninsulated live parts or moving parts.

Exception: A construction as described in [19.5](#) is not required to comply with this requirement.

Table 20.1
Minimum distance from an opening to a part involving risk of electric shock or personal injury

Minor dimension of opening ^a		Minimum distance from opening to uninsulated live part or moving part	
inches	(mm)	inches	(mm)
Less than 1/8	(Less than 3.18)	1/2	(12.7)
1/2	(12.7)	4	(101.6)
1 ^b	(25.4)	6-1/2 ^b	(165.0)
1-1/2 ^b	(38.1)	8-3/8 ^b	(212.7)
2 ^b	(50.8)	11-5/8 ^b	(295.3)
over 2 and not more than 3 ^b	(over 50.8 and not more than 76.2)	30 ^b	(762.0)

^a The minor dimension of an opening is the diameter of the largest cylindrical probe having a hemispherical tip that is able to be inserted through the opening. The opening is evaluated without removable filters.

^b Interpolation shall be used to determine intermediate distances between the table requirement and the previous entry specified in this table. Where the intermediate distance = (distance for previous entry) + (difference between intermediate minor dimension and minor dimension of previous entry) × (difference between required distance and distance of previous entry) / (difference between required minor dimension and minor dimension of previous entry).

Example: To find required distance for 3/4 inch opening (minor dimension) between 1/2 inch (12.7 mm) and 1 inch (25.4 mm) table values

Required distance = 4 inches + (3/4 – 1/2) × (6-1/2 – 4) / (1 – 1/2) = 5.25 inches

21 Ventilation Openings

21.1 General

21.1.1 A ventilation opening provided in an enclosure shall comply with the construction requirements in [21.3.1](#) – [21.3.5](#), and shall be evaluated as a Type 1 component with respect to [19.3](#). A ventilation opening that is an integral part of an enclosure or an accessory kit for an enclosure that complies with [18.3](#) complies with [21.3.1](#) – [21.3.5](#).

Exception: A ventilation opening for use in an enclosure with a Type 2 or 3R enclosure shall be evaluated to the performance requirements in the Standard for Enclosures for Electrical Equipment, Environmental Considerations, UL 50E, for the environmental rating.

21.1.2 The location of a ventilation opening with respect to components inside of the enclosure shall comply with [21.2.1](#) – [21.2.4](#).

21.2 Location of ventilation opening

21.2.1 A ventilation opening in the top of the enclosure shall be covered by a hood or protective shield spaced above the opening when there are uninsulated live components below the opening.

Exception: A hood or protective shield is not required over ventilation openings to a compartment of an industrial control panel where no uninsulated live parts are present.


21.2.2 A ventilation opening that serves as an air outlet of exhaust air from a forced ventilation system shall not direct air at the area occupied by the equipment operator. The area occupied by the operator in front of the industrial control panel shall be 30 inches wide (horizontal) centered on any operator control or display over the entire (vertical) height of the enclosure for wall mounted equipment or up to 6-1/2 feet above the floor for floor mounted equipment.

Exception No. 1: When an air outlet from a forced ventilation system is directed at the area occupied by an operator, a barrier or duct shall be provided to redirect the airflow by 90 degrees or greater so that the exhaust air is directed away from the operator area. See [Figure 21.1](#) for permitted air directions. If a barrier is used, it shall be provided in addition to the barrier that may be required per [22.1](#). Redirecting airflow upward is only permitted if the construction ensures that water and/or solid objects cannot enter the enclosure.

Exception No. 2: Air filters which baffle the airflow are permitted, provided they meet the requirements in [22.4](#).

Exception No. 3: An enclosure containing external switch actuators or displays that only require a short time presence of an operator, such as handles for disconnecting means, emergency stop buttons, external overload reset buttons, simple control devices (such as start / stop pushbuttons, selector switches), indicator lights, non-interactive digital displays, electrical meter faces and similar devices, is not required to comply with [21.2.2](#).

Figure 21.1
Enclosure with forced exhaust air redirected away from the operator area

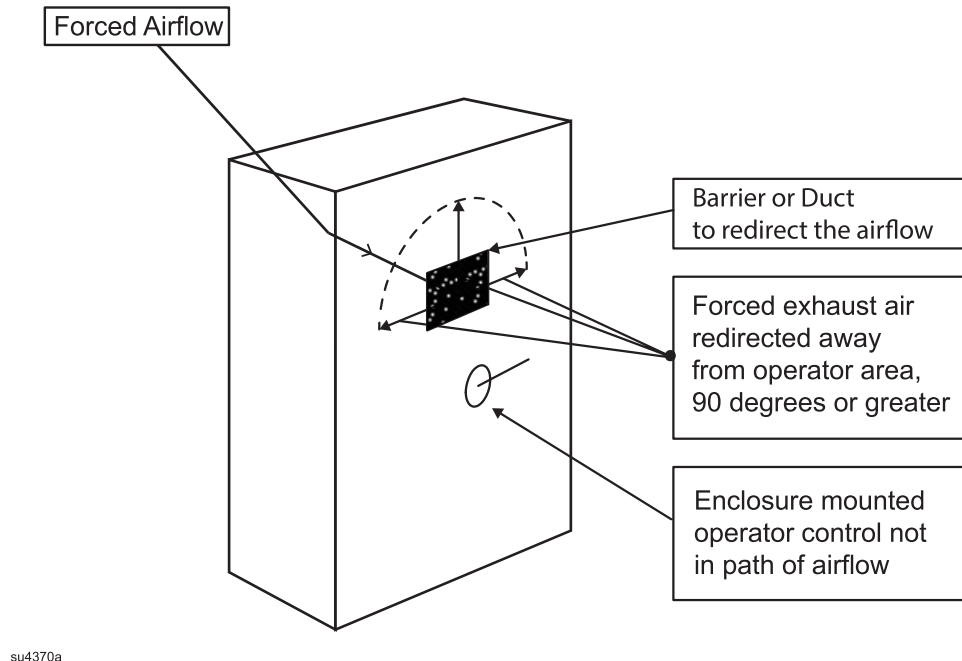

21.2.3 An industrial control panel with a ventilation opening that contains power-circuit switches, circuit breakers, fuses, contactors, or overload relays shall additionally comply with Section [22](#), Barriers Used with Ventilation Openings.

21.2.4 An industrial control panel with a ventilation opening shall comply with Section [20](#), Accessibility of Live Parts.

21.3 Construction

21.3.1 A louver shall not be more than 12 inches (305 mm) long.

21.3.2 The area of an opening covered by a louver, a perforated or an expanded-metal mesh panel that is thinner than the enclosure, shall not exceed 200 square inches (0.129 m²).

21.3.3 The diameter of the wires of a screen covering a ventilation opening shall be at least 0.051 inch (1.30 mm) when the screen openings are 0.500 square inch (322 mm²) or less in area, and shall be at least 0.081 inch (2.06 mm) for larger screen openings.

21.3.4 Perforated sheet steel employed for an expanded-metal mesh panel covering a ventilation opening shall be at least 0.042 inch (1.07 mm) thick for mesh openings or perforations 0.500 square inch (322 mm²) or less in area, and shall be at least 0.080 inch (2.03 mm) thick for larger openings.

Exception: Where the indentation of a guard or enclosure does not alter the clearance between uninsulated, movable, live parts and grounded metal so as to adversely affect the performance or reduce

the spacings below the minimum value specified in [Table 10.1](#), expanded-metal mesh of steel not less than 0.020 inch (0.5 mm) thick is able to be employed when:

- a) The exposed mesh on any one side or surface of the device has an area not more than 72 square inches (464 cm²) and has no dimension greater than 12 inches (305 mm); or
- b) The width of the opening protected is not greater than 3.50 inches (88.9 mm).

21.3.5 A ventilation opening provided in the top of an enclosure shall comply with [21.2.1](#).

22 Barriers Used with Ventilation Openings

22.1 Unless a ventilation opening is located at least 12 inches (305 mm) from an arcing part, a barrier of metal or of a material such as those specified in [22.4](#) shall be interposed between the ventilation opening and a possible source of arcing, such as a power-circuit disconnect switch, the vent openings of a circuit breaker, a contactor, or an overload relay.


22.2 A barrier shall be of such dimension and so located that any straight line drawn from any arcing part past the edge of the barriers intersects a point in the ventilation opening plane that is at least 0.25 inch (6.35 mm) outside the edge of the ventilation opening. A barrier shall be secured in place by mechanical means, such as mechanical fasteners. See [Figure 22.1](#).

22.3 A sheet-metal barrier shall be at least 0.053 inch (1.35 mm) thick when steel or 0.075 inch (1.9 mm) thick when aluminum.

22.4 A barrier of polycarbonate shall be at least 0.125 inch (3.2 mm) thick. A nonmetallic barrier other than polycarbonate shall be at least 0.25 inch (6.35 mm) thick.

22.5 A barrier constructed other than as in [22.3](#) and [22.4](#) shall be evaluated to the requirements of the Standard for Industrial Control Equipment, UL 508.

Figure 22.1
Barriers for ventilation openings

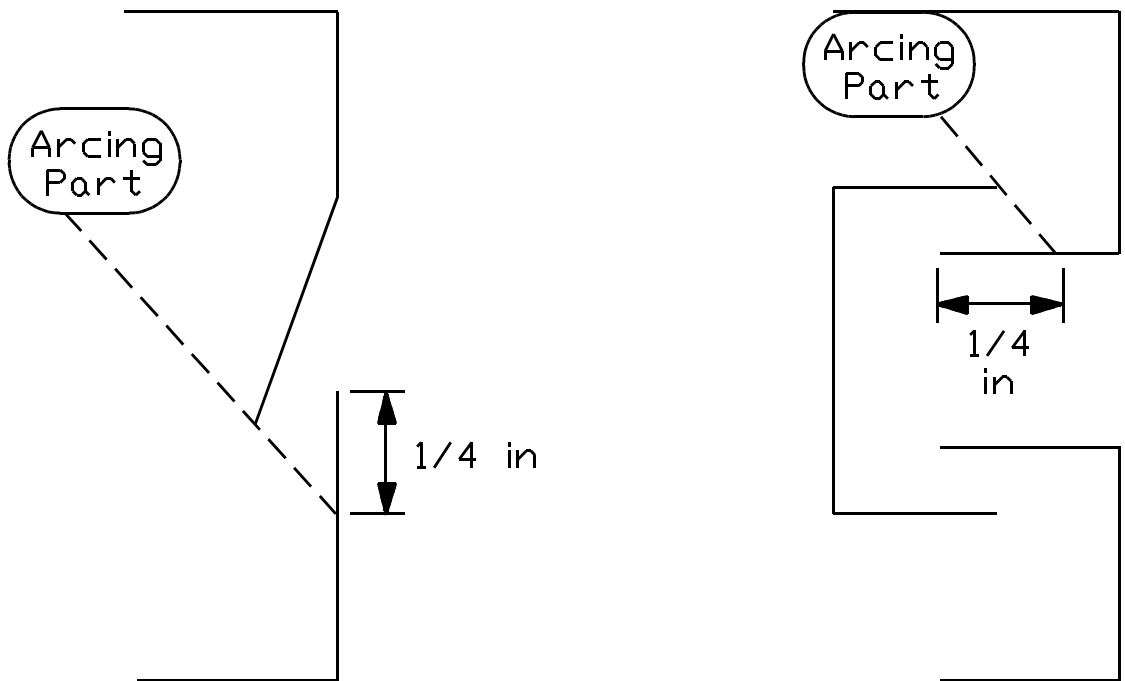

SM786B

23 Observation Windows

23.1 An observation window constructed as described in [23.2](#) – [23.6](#) shall be evaluated as a Type 1 component with respect to [19.3](#). An observation window that is an integral part of or an accessory for an enclosure that complies with [18.3](#) complies with [23.2](#) – [23.6](#).

Exception: An observation window for use in an enclosure with a Type designation other than Type 1 shall be evaluated to the performance requirements in the Standard for Enclosures for Electrical Equipment, Environmental Considerations, UL 50E, for the environmental rating.

23.2 Glass covering an observation opening and forming a part of the enclosure shall be:

- a) Not more than 4 inches (102 mm) in any dimension (including the diagonal) and shall not be less than 0.055 inch (1.40 mm) thick; or
- b) Not more than 12 inches (305 mm) in any dimension (including the diagonal) and shall not be less than 0.115 inch (2.92 mm) thick.

23.3 A polymeric material covering an observation opening and forming a part of the enclosure shall be a polycarbonate material not less than 1/8 inch (3.2 mm) thick, having a flammability rating of 5VA at the use thickness, and having an area not more than 380 square inches (2452 cm²).

23.4 An observation window constructed other than as described in [23.2](#) or [23.3](#) shall comply with the requirements for Observation Windows or Polymeric Parts of Enclosures in the Standard for Industrial Control Equipment, UL 508.

23.5 An observation window shall be secured to the enclosure by mechanical means, such as mechanical fasteners.

23.6 When an adhesive is used to secure an observation window to the enclosure, the assembly shall comply with the Standard for Polymeric Materials – Use in Electrical Equipment Evaluations, UL 746C.

24 Bonding

24.1 An enclosure made of insulating material, either wholly or in part, shall have a bonding means to provide continuity of grounding between all conduit openings. The bonding means shall be:

- a) Completely assembled on the product; or
- b) Provided as separate parts or available as an accessory for field installation and marked in accordance with [53.7](#) and [55.5](#).

Exception: A bonding means is not required for the enclosure of a pushbutton station or a selector switch that is intended to be connected to a single conduit and is marked in accordance with [53.5](#).

24.2 A separate bonding conductor shall comply with the requirements in Section [14](#), Grounding – General.

25 Wire Bending Space

25.1 The distance between the end of a pressure wire connector or terminal block for connection of a field installed wire, and the wall of the enclosure toward which the wire is to be directed, shall not be less than that indicated in [Table 25.1](#).

Table 25.1
Wire bending space at field wiring terminals

Size of wire AWG or MCM (mm ²)		Minimum bending space, terminal to wall, inches (mm)							
		Wires per terminal ^a							
		1		2		3		4 or more	
14 – 10	(2.1 – 5.3)	Not specified		a		a		a	
8 – 6	(8.4 – 13.3)	1-1/2	(38)	a		a		a	
4 – 3	(21.2 – 26.7)	2	(51)	a		a		a	
2	(33.6)	2-1/2	(64)	a		a		a	
1	(42.4)	3	(76)	a		a		a	
1/0	(53.5)	5	(127)	5	(127)	7	(178)	–	
2/0	(67.4)	6	(152)	6	(152)	7-1/2	(191)	–	
3/0	(85.0)	7	(178)	7	(178)	8	(203)	–	
4/0	(107.2)	7	(178)	7	(178)	8-1/2	(216)	–	
250	(127)	8	(203)	8	(203)	9	(229)	10	(254)
300	(152)	10	(254)	10	(254)	11	(279)	12	(305)
350	(177)	12	(305)	12	(305)	13	(330)	14	(356)
400	(203)	12	(305)	12	(305)	14	(356)	15	(381)
500	(253)	12	(305)	12	(305)	15	(381)	16	(406)

Table 25.1 Continued on Next Page

Table 25.1 Continued

Size of wire AWG or MCM (mm ²)		Minimum bending space, terminal to wall, inches (mm)			
		Wires per terminal ^a			
		1	2	3	4 or more
600	(304)	14 (356)	16 (406)	18 (457)	19 (483)
700	(355)	14 (356)	16 (406)	20 (508)	22 (559)
750 – 800	(380 – 405)	18 (457)	19 (483)	22 (559)	24 (610)
900	(456)	18 (457)	19 (483)	24 (610)	24 (610)
1000	(506)	20 (508)	–	–	–
1250	(633)	22 (559)	–	–	–
1500 – 2000	(760 – 1013)	24 (610)	–	–	–
NOTE: "–" indicates no value established					
^a Conductors smaller than 1/0 AWG shall not be connected in parallel.					

25.2 Upon leaving the lug or connector, the distance specified in [25.1](#) shall be measured in a straight line from the center of the opening in the connector, in the direction in which the wire leaves the terminal, perpendicular to the enclosure wall.

25.3 When a wire is restricted by barriers or other means from being bent where it leaves the connector, the distance required by [Table 25.1](#) shall be measured from the end of the barrier.

25.4 The required bending space is dependent on the size of the anticipated field wire to be connected to the connector or terminal in accordance with Section [28](#), Field Wiring.

26 Enclosure Environmental Control Devices

26.1 General

26.1.1 A fan, air conditioner, or heater mounted to the industrial control panel for the purpose of conditioning air within the control panel shall comply with the requirements for general construction and power circuits in addition to the requirements in [26.2](#) – [26.6](#).

Exception: A fan that complies with [26.2.1](#) or [26.2.3](#), an air conditioner that complies with [26.3.1](#), and a heater that complies with [26.4.1](#) or [26.4.2](#) are able to be supplied from the isolated secondary of a control transformer or power supply and comply with the requirements for control circuits.

26.2 Enclosure fans

26.2.1 A fan or blower shall have provisions for permanent installation within electrical equipment and shall comply with the Standard for Electric Fans, UL 507.

26.2.2 A fan motor shall comply with the requirements in the Standard for Rotating Electrical Machines – General Requirements, UL 1004-1.

26.2.3 A fan incorporated into an accessory intended for use with industrial control panels shall comply with the requirements for accessories in the Standard for Industrial Control Equipment, UL 508.

26.2.4 Each fan or motor shall incorporate one of the following forms of locked rotor protection:

- a) Thermal protection complying with the Standard for Thermally Protected Motors, UL 1004-3, where the motor is marked "thermally protected" or "T.P."; or
- b) Impedance protection complying with the Standard for Impedance Protected Motors, UL 1004-2, where the motor is marked "Impedance Protected" or "Z.P."; or
- c) Motor overload protection in accordance with Section [34](#), Overload Protection of Motor Loads.

26.3 Enclosure air conditioner

26.3.1 An air conditioner shall be identified as a special-purpose type, intended for mounting to an electrical enclosure and complying with the Standard for Room Air Conditioners, UL 484, the Standard for Heating and Cooling Equipment, UL 1995, or the Standard for Household And Similar Electrical Appliances – Safety – Part 2-40: Particular Requirements for Electrical Heat Pumps, Air-Conditioners and Dehumidifiers, UL 60335-2-40.

26.3.2 For an air conditioner as described in [26.3.1](#) that is marked with an "interface" environmental rating, such as Type 1 enclosure with Type 12 interface, the "interface" type rating marked on the component is used as the basis for compliance with [Table 19.1](#).

26.4 Enclosure heater

26.4.1 An electric heater including a heater where the metal sheath is mounted to grounded metal and a heater enclosed in a polymeric material, such as silicone rubber, shall comply with the Standard for Electric Heating Appliances, UL 499.

26.4.2 A heater incorporated into an accessory intended for use with industrial control panels shall comply with the requirements for accessories in the Standard for Industrial Control Equipment, UL 508.

26.4.3 A heater shall be mounted 2 inches (50.8 mm) or more from polymeric insulating materials of components and wiring, other than the internal wiring connected to the heater.

26.4.4 Internal wiring connecting to a sheath-type heater shall have a temperature rating of 200°C (392°F) or more.

Exception: Internal wiring rated less than 200°C (392°F) is able to be used with a heater provided with a disc thermostat mounted to the sheath and set for a temperature lower than the temperature rating of the internal wiring.

26.5 Air filters

26.5.1 Air filters shall be provided over ventilation openings in enclosures containing power conversion equipment, programmable controllers, power supplies, and information technology equipment.

Exception: An air filter is not required over ventilation openings when fans are not provided in the enclosure or an integral part of any component in the enclosure.

26.6 Enclosure thermal insulation

26.6.1 Thermal insulation provided on the inside of the cabinet walls shall:

- a) Be supported by mechanical means, not adhesives only, such that the insulation does not contact uninsulated live parts within the enclosure; and

b) Be 1/2 inch (12.7 mm) or more from uninsulated live parts and 12 inches (305 mm) or more from arcing parts.

26.6.2 An adhesive used to secure thermal insulation to the inside of the cabinet walls shall be evaluated for the intended use.

27 Enclosure Maintenance Lighting

27.1 General

27.1.1 The requirements in this section apply to maintenance lighting provided on the inside of an industrial control panel.

27.2 Component requirements

27.2.1 A lampholder for an incandescent lamp shall comply with the Standard for Lampholders, UL 496.

27.2.2 A fluorescent lighting fixture shall comply with the requirements in the Standard for Luminaires, UL 1598.

27.2.3 An incandescent lampholder or fluorescent lighting fixture incorporated into an accessory intended for use with industrial control panels shall comply with the requirements for accessories in the Standard for Industrial Control Equipment, UL 508.

27.3 Circuit requirements

27.3.1 The lighting circuit voltage for an incandescent lamp shall not exceed 150 volts between conductors. The screwshell of the lampholder shall be connected to the grounded circuit conductor.

27.3.2 The maintenance lighting circuit shall comply with the requirements for a power circuit in Sections [28](#) – [36](#).

Exception No. 1: A 120-volt lighting circuit located on the inside of the industrial control panel is able to be supplied from the isolated secondary of a control transformer and comply with the requirements for control circuits in Section [37](#) – [44](#).

Exception No. 2: LED luminaires are able to comply with the requirements for control circuits in Section [37](#) – [44](#).

27.3.3 A lighting fixture provided with a receptacle for an attachment plug shall:

- a) Comply with [31.5](#) when provided in a power circuit; or
- b) Comply with [40.3.5](#) when located in a control circuit.

POWER CIRCUITS

28 Field Wiring

28.1 General

28.1.1 A terminal, such as a pressure wire connector or wire-binding screw, shall be provided for connection of each conductor intended to be installed in the industrial control panel in the field.

Exception: Bus bars complying with [29.2.2](#) with provisions for field installation of pressure wire connectors, cable lugs or similar termination devices that comply with [28.2.2](#) for connection of field wiring, are not required to be supplied with terminals when the control panel is marked in accordance with [60.4](#).

28.1.2 A field wiring terminal shall be located so that:

- a) It is accessible for examination; and
- b) Connection is able to be tightened or wires removed without loosening any screws that secure internal (factory) wiring, bus bars, or components (such as circuit breakers, switches, and fuseholders).

28.1.3 A field wiring terminal shall be for use with copper or aluminum conductors or both and marked in accordance with [54.11](#).

28.1.4 A plug-in circuit breaker installed in a panelboard, that is intended to be back-fed by means of a field wired supply conductor connected to its load terminal, shall be secured in place by an additional fastener that requires other than a pull to release the device from the mounting means on the panelboard. This securing means shall comply with UL 67 as an accessory to the panelboard.

28.2 Component requirements

28.2.1 A pressure wire connector of a terminal block shall be permitted to be used in only branch or control circuits and comply with the requirements contained in the Standard for Terminal Blocks, UL 1059. In addition a terminal block shall:

- a) Have electrical spacings that comply with Section [10](#), Spacings; and
- b) Have been investigated for connection of field wiring.

28.2.2 A pressure wire connector of a component other than a terminal block shall:

- a) Comply with the requirements in the Standard for Wire Connectors, UL 486A-486B or the Standard for Equipment Wiring Terminals for Use with Aluminum and/or Copper Conductors, UL 486E; and
- b) Have electrical spacings at field wiring terminals that comply with Section [10](#), Spacings.

28.2.3 A wire binding screw, other than one on a terminal block or a component, shall comply with the following:

- a) A terminal plate tapped for a wire-binding screw shall be of metal not less than 0.030 inch (0.76 mm) thick for a 14 AWG (2.1 mm²) or smaller wire, and not less than 0.050 inch (1.27 mm) thick for a wire larger than 14 AWG (2.1 mm²). There shall be at least two full threads in the plate; and

Exception: Two full threads are not required if fewer threads result in a secure connection in which the threads will not strip upon application of a 20 pound-inch (2.3 N·m) tightening torque.

- b) A terminal plate formed from stock having the required thickness specified in (a) is able to have the metal extruded at the tapped hole for the binding screw to provide two full threads; and
- c) A wire-binding screw shall thread into metal; and
- d) A wire-binding screw shall be No. 8 (4.2 mm diameter) or larger screw for securing a 10 AWG (5.3 mm²) or smaller conductor, or a No. 6 (3.5 mm diameter) screw for securing a 14 AWG (2.1 mm²) conductor only.

28.2.4 A power distribution block shall comply with the requirements contained in:

- a) The Outline of Investigation for Power Distribution Blocks, UL 1953, for use in branch or feeder circuits; or
- b) [28.2.1](#).

28.2.5 Single and multipole connectors, intended for factory assembly to copper or copper alloy conductors or printed wiring boards shall:

- a) Comply with the requirements in the Standard for Component Connectors for Use in Data, Signal, Control and Power Applications, UL 1977; and
- b) Comply with the spacing requirements of [10.9](#).

28.3 Sizing

28.3.1 The required size of the field wiring terminal shall not be less than 14 AWG (2.1 mm²) and shall be determined by:

- a) Calculating the required ampacity per [28.3.2](#) – [28.3.6](#); and
- b) Determining the minimum field wiring conductor size from [Table 28.1](#) having a corresponding ampacity that is equal to or greater than the required ampacity from (a).

Table 28.1
Ampacities of insulated conductors

Wire size		60°C (140°F)		75°C (167°F)	
AWG	(mm ²)	Copper	Aluminum	Copper	Aluminum
14	(2.1)	15	–	15	–
12	(3.3)	20	15	20	15
10	(5.3)	30	25	30	25
8	(8.4)	40	30	50	40
6	(13.3)	55	40	65	50
4	(21.2)	70	55	85	65
3	(26.7)	85	65	100	75
2	(33.6)	95	75	115	90
1	(42.4)	110	85	130	100
1/0	(53.5)	–	–	150	120
2/0	(67.4)	–	–	175	135
3/0	(85.0)	–	–	200	155
4/0	(107.2)	–	–	230	180
250 kcmil	(127)	–	–	255	205
300	(152)	–	–	285	230
350	(177)	–	–	310	250
400	(203)	–	–	335	270
500	(253)	–	–	380	310

Table 28.1 Continued on Next Page