



UL 773A

STANDARD FOR SAFETY

Nonindustrial Photoelectric Switches for Lighting Control

.....

**UL COPYRIGHTED MATERIAL –
NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
DISTRIBUTION WITHOUT PERMISSION FROM UL**



Documents
Document Sharing Hub

UL Standard for Safety for Nonindustrial Photoelectric Switches for Lighting Control, UL 773A

Sixth Edition, Dated January 19, 2016

Summary of Topics

The six edition of the Standard for Nonindustrial Photoelectric Switches for Lighting Control, UL 773A, incorporates requirements based on Canadian and US requirements.

The new requirements are substantially in accordance with Proposal(s) on this subject dated November 21, 2014 and October 16, 2015.

All rights reserved. No part of this publication may be reproduced, stored in a retrieval system, or transmitted in any form by any means, electronic, mechanical photocopying, recording, or otherwise without prior permission of UL.

UL provides this Standard "as is" without warranty of any kind, either expressed or implied, including but not limited to, the implied warranties of merchantability or fitness for any purpose.

In no event will UL be liable for any special, incidental, consequential, indirect or similar damages, including loss of profits, lost savings, loss of data, or any other damages arising out of the use of or the inability to use this Standard, even if UL or an authorized UL representative has been advised of the possibility of such damage. In no event shall UL's liability for any damage ever exceed the price paid for this Standard, regardless of the form of the claim.

Users of the electronic versions of UL's Standards for Safety agree to defend, indemnify, and hold UL harmless from and against any loss, expense, liability, damage, claim, or judgment (including reasonable attorney's fees) resulting from any error or deviation introduced while purchaser is storing an electronic Standard on the purchaser's computer system.

No Text on This Page

**UL COPYRIGHTED MATERIAL –
NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
DISTRIBUTION WITHOUT PERMISSION FROM UL**



Documents

Document Sharing Hub



Association of Standardization and Certification
NMX-J-715-ANCE
First Edition



CSA Group
CSA C22.2 No. 284-16
First Edition



Underwriters Laboratories Inc.
UL 773A
Sixth Edition

Nonindustrial Photoelectric Switches for Lighting Control

January 19, 2016



ANSI/UL 773A-2016

UL COPYRIGHTED MATERIAL –
NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
DISTRIBUTION WITHOUT PERMISSION FROM UL



Documents
Document Sharing Hub

Commitment for Amendments

This standard is issued jointly by the Association of Standardization and Certification (ANCE), the Canadian Standards Association (operating as "CSA Group"), and Underwriters Laboratories Inc. (UL). Comments or proposals for revisions on any part of the standard may be submitted to ANCE, CSA Group, or UL at anytime. Revisions to this standard will be made only after processing according to the standards development procedures of ANCE, CSA Group, and UL. CSA Group and UL will issue revisions to this standard by means of a new edition or revised or additional pages bearing their date of issue. ANCE will incorporate the same revisions into a new edition of the standard bearing the same date of issue as the CSA Group and UL pages.

Copyright © 2016

Rights reserved in favor of ANCE.

ISBN 978-1-77139-732-2 © 2016 CSA Group

All rights reserved. No part of this publication may be reproduced in any form whatsoever without the prior permission of the publisher.

This Standard is subject to review five years from the date of publication, and suggestions for its improvement will be referred to the appropriate committee. To submit a proposal for change, please send the following information to inquires@csagroup.org and include "Proposal for change" in the subject line: Standard designation (number); relevant clause, table, and/or figure number; wording of the proposed change; and rationale for the change.

To purchase CSA Group Standards and related publications, visit CSA Group's Online Store at shop.csa.ca or call toll-free 1-800-463-6727 or 416-747-4044.

Copyright © 2016 Underwriters Laboratories Inc.

UL's Standards for Safety are copyrighted by UL. Neither a printed nor electronic copy of a Standard should be altered in any way. All of UL's Standards and all copyrights, ownerships, and rights regarding those Standards shall remain the sole and exclusive property of UL.

This ANSI/UL Standard for Safety consists of the Sixth Edition including revisions through January 19, 2016. The most recent designation of ANSI/UL 773A as an American National Standard (ANSI) occurred on January 19, 2016. ANSI approval for a standard does not include the Cover Page, Transmittal Pages, Title Page (front and back), or the Preface. The National Difference Page and IEC Foreword are also excluded from the ANSI approval of IEC-based standards. Any other portions of this ANSI/UL standard that were not processed in accordance with ANSI/UL requirements are noted at the beginning of the impacted sections.

The Department of Defense (DoD) has adopted UL 773A on June 13, 1989. The publication of revised pages or a new edition of this Standard will not invalidate the DoD adoption.

Comments or proposals for revisions on any part of the Standard may be submitted to UL at any time. Proposals should be submitted via a Proposal Request in UL's On-Line Collaborative Standards Development System (CSDS) at <http://csds.ul.com>.

**UL COPYRIGHTED MATERIAL –
NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
DISTRIBUTION WITHOUT PERMISSION FROM**

 **Documents**
Document Sharing Hub

To purchase UL Standards, visit Comm 2000 at http://www.comm-2000.com/help/how_to_order.aspx or call toll-free 1-888-853-3503.

**UL COPYRIGHTED MATERIAL –
NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
DISTRIBUTION WITHOUT PERMISSION FROM**



Documents
Document Sharing Hub

No Text on This Page



CONTENTS

PREFACE	8
----------------------	---

INTRODUCTION

1 Scope	10
2 General	10
2.1 Components	10
2.2 Units of measurement	11
2.3 Undated references	11
2.4 Normative references	11
2.5 Definitions	13
2.6 Suitability for control of loads	13
2.7 Grounding/Bonding Conductor	13

CONSTRUCTION

3 Enclosures	14
3.1 General	14
3.2 Metal Enclosures	14
3.3 Polymeric enclosure	16
3.4 Snap-on covers	17
4 Accessibility of Uninsulated Live Parts	17
5 Openings in Enclosure	20
5.7 Knockouts	22
6 Provision for Mounting	23
7 Protection Against Corrosion	23
8 Supply Connections	24
8.1 Permanently connected units	24
8.2 Outlet-box-mounted units	26
8.3 Cord-connected or direct plug-in units	27
8.4 Receptacles Incorporated in Equipment	28
8.5 Direct Plug-in	28
8.6 Strain relief	30
8.7 Bushings	30
9 Bonding/Grounding	30
9.7 Bonding/Grounding lead requirements	32
9.8 Bonding/Grounding lead securement	33
10 Current-Carrying Parts	33
11 Internal Wiring	33
12 Spacings	33
13 Alternate Spacings – Clearances and Creepage Distances	34
13.4 Limited power point determination	34
13.5 Printed-wiring board abnormal operation test	37
14 Bonding of Internal Parts for Bonding/Grounding	39
14.1 General	39
14.2 Construction and connection	41
15 Polymeric Materials	42
16 Coil Windings	44
17 Air-Gap Switches	44

**UL COPYRIGHTED MATERIAL –
NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
DISTRIBUTION WITHOUT PERMISSION FROM**

Documents
Document Sharing Hub

PERFORMANCE

18	General	44
19	Overload and Endurance Testing - General	45
19.1	General	45
19.2	Air-gap switch used in series with solid state switching devices	47
20	Overload Test	47
21	Endurance Test	49
22	Temperature Test	52
23	Dielectric Voltage-Withstand Test	55
24	Operation Test	56
25	Abnormal Switching Test	56
26	Limited Short-Circuit Test for Solid-State Switching Control	57
27	Rain Test	58
28	Exposure to Humid Atmospheres	61
29	Permanence of Marking Tests	61
29.1	Requirements for pressure sensitive labels	61
29.2	Oven-aging test	62
29.3	Immersion test	62
29.4	Standard-atmosphere test	62
29.5	Unusual-conditions exposure test	62
30	Bonding/Grounding Connection Tests	62
30.1	Creep and mold stress relief	62
30.2	Overcurrent tests	63
30.3	Impedance test	63
31	Leakage Current Test	64
32	Leakage Current Following Humidity Conditioning Test	67
33	Power Supply Abnormal Tests	67
33.1	General	67
33.2	Output loading	68
33.3	Power supply burnout	69
33.4	Power supply abnormal test	70
34	Component Breakdown Test	70
34.1	Effects on equipment	70
34.2	Effects on controlled load	71
34.3	Component evaluation	71
35	Strain Relief and Lead Securement Tests	71
35.1	Strain relief – cord-connected device	71
35.2	Lead securement - for self enclosed devices with nipples	71
35.3	Lead securement – outlet box mounted devices	71
36	Knockout Test	71
37	Mechanical integrity	71
37.1	Impact test for outdoor devices	71
37.2	Crush test	72
38	Conduit Connection to Enclosure Tests	72
38.1	Polymeric Enclosures	72
38.2	Metallic enclosure threaded opening test	73
38.3	Metallic enclosure conduit hub test	74
39	Snap-On Cover Test	74
40	Tests on 120V Devices with Varistors	74
40.3	Test requirements	74

MANUFACTURING AND PRODUCTION TESTS

UL COPYRIGHTED MATERIAL –
NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
DISTRIBUTION WITHOUT PERMISSION FROM UL



Documents

Document Sharing Hub

41 Dielectric Voltage-Withstand Test	75
--	----

RATINGS, MARKINGS AND INSTRUCTIONS

42 Details	77
43 Instructions	83
44 Marking requirements for minimum outlet box volume	83

PREFACE

This is the harmonized ANCE, CSA Group, and UL standard for Nonindustrial Photoelectric Switches for Lighting Control. It is the first edition of NMX-J-715-ANCE, the first edition of CSA-C22.2 No. 284-16, and the sixth edition of UL 773A. This edition of UL 773A supersedes the previous edition published on February 10, 2006.

This harmonized standard was prepared by the Association of Standardization and Certification, (ANCE), CSA Group and Underwriters Laboratories Inc. (UL). The efforts and support of the Technical Harmonization Subcommittee, on the Harmonization of Electrotechnical Standards of the Nations of the Americas (CANENA), are gratefully acknowledged.

The CSA Group standard also replaces the following Technical Information Letters (T.I.L.), for products covered in this Standard:

- TIL No. A-15 Photo-electric switches

This standard is considered suitable for use for conformity assessment within the stated scope of the standard.

The present Mexican standard was developed by the CT 23 Electrical Accesries from the Comite de Normalizacion de la Asociacion de Normalizacion y Certificacion, A.C., CONANCE, with the collaboration of the Electrical of manufactures, manufacturers and users.

This standard was reviewed by the CSA Integrated Committee on Wiring Devices, under the jurisdiction of the CSA Technical Committee on Wiring Products and the CSA Strategic Steering Committee on requirements for Electrical Safety, and has been formally approved by the CSA Technical Committee.

This standard has been approved by the American National Standards Institute (ANSI) as an American National Standard.

Application of Standard

Where reference is made to a specific number of samples to be tested, the specified number is to be considered a minimum quantity.

Note: Although the intended primary application of this standard is stated in its scope, it is important to note that it remains the responsibility of the users of the standard to judge its suitability for their particular purpose.

Level of Harmonization

This standard is published as an identical standard for ANCE, CSA Group and UL.

An identical standard is a standard that is exactly the same in technical content except for national differences resulting from conflicts in codes and governmental regulations. Presentation is word for word except for editorial changes.

Reasons for Differences From IEC

There is no corresponding IEC standard.

Interpretations

The interpretation by the standards development organization of an identical or equivalent standard is based on the literal text to determine compliance with the standard in accordance with the procedural rules of the standards development organization. If more than one interpretation of the literal text has been identified, a revision is to be proposed as soon as possible to each of the standards development organizations to more accurately reflect the intent.

INTRODUCTION

1 Scope

1.1 Requirements contained in this Standard cover controls of the light-sensitive or presence-sensitive types, or both; for indoor or outdoor service; intended for the control of indoor or outdoor loads up to a maximum of 20 A and maximum 347 V; intended for installations on 50 Hz or 60 HZ systems or DC up to 60 V (for US); and DC up to 42.4 V (for Canada); and intended to be installed in accordance with the National Electrical Code (NEC), NFPA 70, the Canadian Electrical Code (CE Code) Part I, CSA C22.2 No. 0, and NOM 001 SEDE.

1.2 These requirements do not cover controls intended to be used under the following conditions:

- a) Devices that are locking type, used for area or roadway lighting fixtures;
- b) Devices that monitor or control safety critical loads or personal protection circuits;
- c) Devices intended to be installed in areas designated hazardous locations;
- d) Devices intended to be installed for manufacturing process control.

2 General

2.1 Components

2.1.1 A component of a product covered by this standard shall comply with the requirements for that component. A component shall be used in accordance with its rating established for the intended conditions of use.

2.1.2 A component is not required to comply with a specific requirement that:

- a) Involves a feature or characteristic not required in the application of the component in the product covered by this standard, or
- b) Is superseded by a requirement in this standard.

2.1.3 Specific components are incomplete in construction features or restricted in performance capabilities. Such components are intended for use only under limited conditions, such as certain temperatures not exceeding specified limits, and shall be used only under those specific conditions.

2.2 Units of measurement

2.2.1 Values stated without parentheses are the requirement. Values in parentheses are explanatory or approximate information. SI (metric) units shall be normative, except for trade sizes.

2.3 Undated references

2.3.1 For undated references to Standards, such reference shall be considered to refer to the latest edition and all revisions to that edition up to the time when this Standard was approved.

2.4 Normative references

2.4.1 Products covered by this Standard shall comply with the referenced installation codes and standards noted in this Clause.

CSA Group Standards

Note: For products intended for use in Canada, general requirements are given in CSA-C22.2 No. 0

C22.1-15

Canadian Electrical Code (CE Code), Part I

CSA C22.2 No. 0

General requirements - Canadian Electrical Code, Part II

CSA 22.2 No. 0.2

Insulation Coordination

CSA 22.2 No. 0.17

Evaluation of Properties of Polymeric Materials

CSA 22.2 No. 42

General Use Receptacles, Attachment Plugs, and Similar Wiring Devices

CSA C22.2-111

General-Use Snap Switches

CSA 18.1

Metallic Outlet Boxes

CSA 66.1

Low Voltage Transformers - Part 1: General Requirements

CSA 66.3

Low Voltage Transformers - Part 3: Class 2 and Class 3 Transformers

CSA 223

Power Supplies With Extra-Low-Voltage Class 2 Outputs

UL Standards

UL 498

Attachment Plugs and Receptacles

UL COPYRIGHTED MATERIAL –
NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
DISTRIBUTION WITHOUT PERMISSION FROM  Documents
Document Sharing Hub

UL 60730-1

Automatic Electrical Controls for Household and Similar Use, Part 1: General Requirements

UL 1414

Capacitors and Suppressors for Radio- and Television-Type Appliances

UL 1310

Class 2 Power Units

UL 61810-1

Electromechanical Elementary Relays – Part 1: General Requirements

UL 157

Gaskets and Seals

UL 20

General-Use Snap Switches

UL 508

Industrial Control Equipment

UL 840

Insulation Coordination Including Clearances and Creepage Distances for Electrical Equipment

UL 5085-3

Low Voltage Transformers – Part 3: Class 2 and Class 3 Transformers

UL 5085-1

Low Voltage Transformers – Part 1: General Requirements

UL 514A

Metallic Outlet Boxes

UL 746E

Polymeric Materials – Industrial Laminates, Filament Wound Tubing, Vulcanized Fibre, and Materials Used in Printed Wiring Boards

UL 746A

Polymeric Materials - Short Term Property Evaluations

UL 746C

Polymeric Materials - Use in Electrical Equipment Evaluations

UL 796

Printed-Wiring Boards

UL 244A

Solid-State Controls for Appliances

UL 1472

Solid-State Dimming Controls

UL COPYRIGHTED MATERIAL –
NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
DISTRIBUTION WITHOUT PERMISSION FROM UL



Documents
Document Sharing Hub

UL 1449
Surge Protective Devices

ANCE Standards

ANCE NMX-J-005

ANCE NMX-J-023/1

ANCE NMX-J-412

2.5 Definitions

2.5.1 **Enclosure** – The part of the device that:

- a) Renders inaccessible all or any parts of the device that may present a risk of electric shock; and
- b) Retards propagation of fire initiated from within the device

2.5.2 **Outlet-box device** – A device intended to be installed in an electrical box, with or without a cover plate.

2.5.3 **Snap-on cover** – A cover that is held in place by friction-fit and not requiring the use of a tool for removal.

2.6 Suitability for control of loads

2.6.1 A device suitable for control of receptacles shall have a rating equivalent to the rating (amps, hp) of the receptacle(s) it is intended to control.

2.6.2 A device intended for pilot duty loads shall be tested for the specific load and so marked.

2.7 Grounding/Bonding Conductor

– a conductor that is defined in the *National Electrical Code (NEC)* as an *Equipment Grounding Conductor*, and a conductor that is defined in the *Canadian Electrical Code (CE Code)*, Part I, as a *Bonding Conductor*.

CONSTRUCTION

3 Enclosures

3.1 General

3.1.1 The enclosure of a unit shall be strong and rigid so as to resist the abuses likely to be encountered in the operation of the unit. The degree of resistance inherent in the unit shall preclude total or partial collapse with the attendant reduction of spacings, loosening or displacement of parts, and other serious defects which alone or in combination may increase the risk of fire, electric shock, or injury to persons.

3.1.2 Devices rated for outdoor use or wet locations shall comply with the Rain Test, Clause 27.

3.2 Metal Enclosures

3.2.1 A cast-metal enclosure shall be at least 3.2 mm (1/8 in) thick at every point, more than 3.2 mm (1/8 in) thick at reinforcing ribs and door edges, and not less than 6.4 mm (1/4 in) thick at tapped holes for conduit.

3.2.2 Other than at plain or threaded conduit holes, die-cast metal may be:

- a) Not less than 2.4 mm (3/32 in) thick for an area greater than 155 cm² (24 in²) or having any dimensions more than 152 mm (6 in); and
- b) Not less than 1.6 mm (1/16 in) thick for an area of 155 cm² (24 in²) or less and having no dimensions more than 152 mm (6 in). The area limitation may be obtained by the provision of reinforcing ribs subdividing a larger area.

3.2.3 The cast-metal enclosure described in 3.2.1 or an enclosure of sheet metal having the construction indicated in Table 3.1 or Table 3.2 will generally be considered to have an acceptable level of the factors indicated in Clause 3, Enclosures.

Table 3.1
Minimum thickness of sheet metal for enclosures –
carbon steel or stainless steel

Without supporting frame ^a		With supporting frame or equivalent reinforcing ^a		Minimum thickness			
Maximum width ^b		Maximum length of supported edge ^c		Thickness Uncoated		Minimum thickness metal coated	
cm	(inches)	cm	(inches)	cm	(inches)	cm	(inches)
10.2	(4.0)	Not limited	15.9	(6.25)	Not limited		
12.1	(4.75)	14.6	(5.75)	17.1	(6.75)	0.51	(0.020 ^d)
15.2	(6.0)	Not limited	24.1	(9.5)	Not limited	0.58	(0.023 ^d)
17.8	(7.0)	22.2	(8.75)	25.4	(10.0)	0.66	(0.026 ^d)
20.3	(8.0)	Not limited	30.5	(12.0)	Not limited	0.74	(0.029 ^d)
22.9	(9.0)	29.2	(11.5)	33.3	(13.0)	0.81	(0.032)
31.8	(12.5)	Not limited	40.6	(16.0)	Not limited	0.86	(0.034)
35.6	(14.0)	45.7	(18.0)	49.5	(19.5)	1.07	(0.042)
45.7	(18.0)	Not limited	63.5	(25.0)	Not limited	1.14	(0.045)
50.8	(20.0)	68.6	(27.0)	73.7	(29.0)	1.35	(0.053)
						1.42	(0.056)

Table 3.1 Continued

Without supporting frame ^a		With supporting frame or equivalent reinforcing ^a		Minimum thickness	
Maximum width ^b	Maximum length of supported edge ^c	Maximum width ^b	Maximum length	Thickness Uncoated	Minimum thickness metal coated
cm (inches)	cm (inches)	cm (inches)	cm (inches)	cm (inches)	cm (inches)
55.9 (22.0)	Not Limited	83.8 (33.0)	Not Limited		
63.5 (25.0)	78.7 (31.0)	88.9 (35.0)	109.2 (43.0)	1.52 (0.060)	1.60 (0.063)
63.5 (25.0)	Not Limited	99.1 (39.0)	Not Limited		
73.7 (29.0)	91.4 (36.0)	104.1 (41.0)	129.5 (51.0)	1.70 (0.067)	1.78 (0.070)
83.8 (33.0)	Not Limited	129.5 (51.0)	Not Limited		
96.5 (38.0)	119.4 (47.0)	137.2 (54.0)	167.6 (66.0)	2.03 (0.080)	2.13 (0.084)
106.7 (42.0)	Not Limited	162.6 (64.0)	Not Limited		
119.4 (47.0)	149.9 (59.0)	172.7 (68.0)	213.4 (84.0)	2.36 (0.093)	2.46 (0.097)
132.1 (52.0)	Not Limited	203.2 (80.0)	Not Limited		
152.4 (60.0)	188.0 (74.0)	213.4 (84.0)	261.6 (103.0)	2.74 (0.108)	2.82 (0.111)
160.0 (63.0)	Not Limited	246.4 (97.0)	Not Limited		
185.4 (73.0)	228.6 (90.0)	261.6 (103.0)	322.6 (127.0)	0.123 (0.123)	3.20 (0.126)

^a See 3.2.5 for description of supporting frame and method for accomplishing equivalent reinforcing.

^b The width is the smaller dimension of a rectangular piece of sheet metal that is part of an enclosure. Adjacent surfaces of an enclosure may have common supports and be made of a single sheet.

^c Not limited applies only if the edge of the surface is flanged at least 12.7 mm (1/2 inch) or fastened to adjacent surfaces not normally removed in use.

^d Sheet steel for an enclosure intended for outdoor use - raintight or rainproof - shall not be less than 0.86 mm (0.034 inch) thick if zinc coated and not less 0.81 mm (0.032 inch) thick if uncoated.

Table 3.2
Minimum thickness of sheet metal for enclosures aluminum, copper, or brass

Without supporting frame ^a		With supporting frame or equivalent reinforcing ^a		Minimum thickness	
Maximum width ^b	Maximum length ^c	Maximum width ^b	Maximum length	Minimum thickness	
cm (inches)	cm (inches)	cm (inches)	cm (inches)	mm	(inch)
7.6 (3.0)	Not limited	17.8 (7.0)	Not limited		
8.9 (3.5)	10.2 (4.0)	21.6 (8.5)	24.1 (9.5)	0.58	(0.023 ^d)
10.2 (4.0)	Not limited	25.4 (10.0)	Not limited		
12.7 (5.0)	15.2 (6.0)	26.7 (10.5)	34.3 (13.5)	0.74	(0.029)
15.2 (6.0)	Not limited	35.6 (14.0)	Not limited		
16.5 (6.5)	20.3 (8.0)	38.1 (15.0)	45.7 (18.0)	0.91	(0.036)
20.3 (8.0)	Not limited	48.3 (19.0)	Not limited		
24.1 (9.5)	29.2 (11.5)	53.3 (21.0)	63.5 (25.0)	1.14	(0.045)
30.5 (12.0)	Not limited	71.1 (28.0)	Not limited		
35.6 (14.0)	40.6 (16.0)	76.2 (30.0)	94.0 (37.0)	1.47	(0.058)
45.7 (18.0)	Not limited	106.7 (42.0)	Not limited		
50.8 (20.0)	63.5 (25.0)	114.3 (45.0)	139.7 (55.0)	1.91	(0.075)
63.5 (25.0)	Not limited	152.4 (60.0)	Not limited		
73.7 (29.0)	91.4 (36.0)	162.6 (64.0)	198.1 (78.0)	2.41	(0.095)
94.0 (37.0)	Not limited	221.0 (87.0)	Not limited		
106.7 (42.0)	134.6 (53.0)	236.2 (93.0)	289.6 (114.0)	3.10	(0.122)
132.1 (52.0)	Not limited	312.4 (123.0)	Not limited		
152.4 (60.0)	188.0 (74.0)	330.2 (130.0)	406.4 (160.0)	3.89	(0.153)

UL COPYRIGHTED MATERIAL –
NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
DISTRIBUTION WITHOUT PERMISSION FROM
Table 3.2 Continued on Next Page



Documents

Document Sharing Hub

Table 3.2 Continued

Without supporting frame ^a		With supporting frame or equivalent reinforcing ^a		Minimum thickness
Maximum width ^b	Maximum length ^c	Maximum width ^b	Maximum length	
cm (inches)	cm (inches)	cm (inches)	cm (inches)	mm (inch)
^a See 3.2.5 for description of supporting frame and method for accomplishing equivalent reinforcing. ^b The width is the smaller dimension of a rectangular sheet metal piece that is part of an enclosure. Adjacent surfaces of an enclosure may have supports in common and be made of a single sheet. ^c Not limited applies only if the edge of the surface is flanged at least 12.7 mm (1/2 inch) or fastened to adjacent surfaces not normally removed in use. ^d Sheet copper, brass, or aluminum for an enclosure intended for outdoor use – raintight or rainproof – shall not be less than 0.74 mm (0.029 inch) thick.				

3.2.4 Tables 3.1 and 3.2 are based on a uniform deflection of the enclosure surface for any given load concentrated at the center of the surface regardless of metal thickness.

3.2.5 With reference to Tables 3.1 and 3.2, a supporting frame is a structure of angle or channel or folded rigid section of sheet metal that is rigidly attached to and has essentially the same outside dimensions as the enclosure surface and that has sufficient torsional rigidity to resist the bending moments that may be applied by the enclosure surface when it is deflected. Construction that is considered to have equivalent reinforcing may be accomplished by designs that will produce a structure that is as rigid as one built with a frame of angles or channels. Construction considered to be without supporting frame includes:

- a) Single sheet with single formed flanges – formed edges;
- b) A single sheet that is corrugated or ribbed;
- c) An enclosure surface loosely attached to a frame, for example, with spring clips; and
- d) An enclosure surface having an unsupported edge.

3.3 Polymeric enclosure

3.3.1 A polymeric (non-metallic) enclosure shall comply with the requirements of Clause 15, Polymeric Materials.

3.4 Snap-on covers

3.4.1 Snap-on covers shall not permit access to live parts as described in 4.7. When snap on covers are required for compliance with other sections of this standard, they shall be evaluated to the Snap-On Cover Test, Clause 39.

3.4.2 The enclosure shall have provision for the connection of a wiring system suitable for the application.

4 Accessibility of Uninsulated Live Parts

4.1 Construction shall be such that uninsulated live parts that may involve a risk of electric shock shall not be accessible to contact by user under conditions of normal use including use as described in 4.7.

4.2 A live part is considered to involve a risk of electric shock unless it is in one of the following circuits:

a) A circuit supplied by one or more isolated secondary windings of a transformer or equivalent power supply in which the maximum possible open circuit voltage at the transformer is less than:

- 1) 30 V (42.4 V peak) where wet contact is not likely to occur; and
- 2) 15 V (21.2 V peak) where wet contact is likely to occur

b) A circuit derived from a source other than that described in (a) in which the available current is limited to 0.5 mA, regardless of supply polarity. The current shall be measured between accessible points and from these points to earth ground through a 1500- Ω resistor. If circuit impedance is used to limit the current, the circuitry shall comply with the requirements specified in 4.3 and 4.4.

c) A dry-cell battery having output characteristics not greater than those of an energy-limiting Class 2 transformer or power source;

d) A combination of a rechargeable battery and a fixed impedance that complies with all of the performance requirements for an energy-limiting Class 2 transformer or power source; or

e) Terminals or conductors intended to extend in the building wiring that are part of a Class 2 circuit and comply with Class 2 power supply requirements.

4.3 Class 2 transformers shall comply with performance and marking requirements in the Standard for Low Voltage Transformers: General Requirements, UL 5085-1/CSA 66.1; and the Standard for Low Voltage Transformers: Class 2 Transformers, UL 5085-3/CSA 66.3. Class 2 power units shall comply with performance and marking requirements in the Standard for Class 2 Power Units, UL 1310 and CSA 223.

4.4 Power supply circuits having accessible live parts shall comply with 4.3. Power supply circuits having accessible live parts complying with the tests of Clause 33, Power Supply Abnormal Tests, shall be considered to comply with the performance requirements of 4.3.

4.5 The circuit impedance described in 4.2 (b) shall be provided by two independent means. Either independent means shall limit the available leakage current to less than 0.5 mA.


4.6 With respect to 4.3, the following components can be used for the application:

- a) Metal film, carbon film, wire wound, and metal glazed resistors;
- b) Metallized polyester film capacitors;
- c) Antenna-coupling capacitors, and line-by-pass capacitors that comply with the Standard for Capacitors and Suppressors for Radio- and Television-Type Appliances, UL 1414; and
- d) Other components, if investigated and found acceptable for the application.

4.7 For supplies of circuits of the types specified in 4.2 (b), the minimum spacings shall be in accordance with Spacings, Clause 12, or Alternate Spacings – Clearances and Creepage Distances, Clause 13.

4.8 The probe illustrated in Figure 4.1, when inserted through an opening in an enclosure, guard, or operator accessible barrier, shall not touch any uninsulated live part that involves a risk of electric shock. See 4.9. The probe shall be rotated with the movable sections straight or in any possible position resulting from bending one or more sections in the same direction. The maximum force applied to the probe shall not exceed approximately 10 N.

Figure 4.1
Articulate probe with web stop

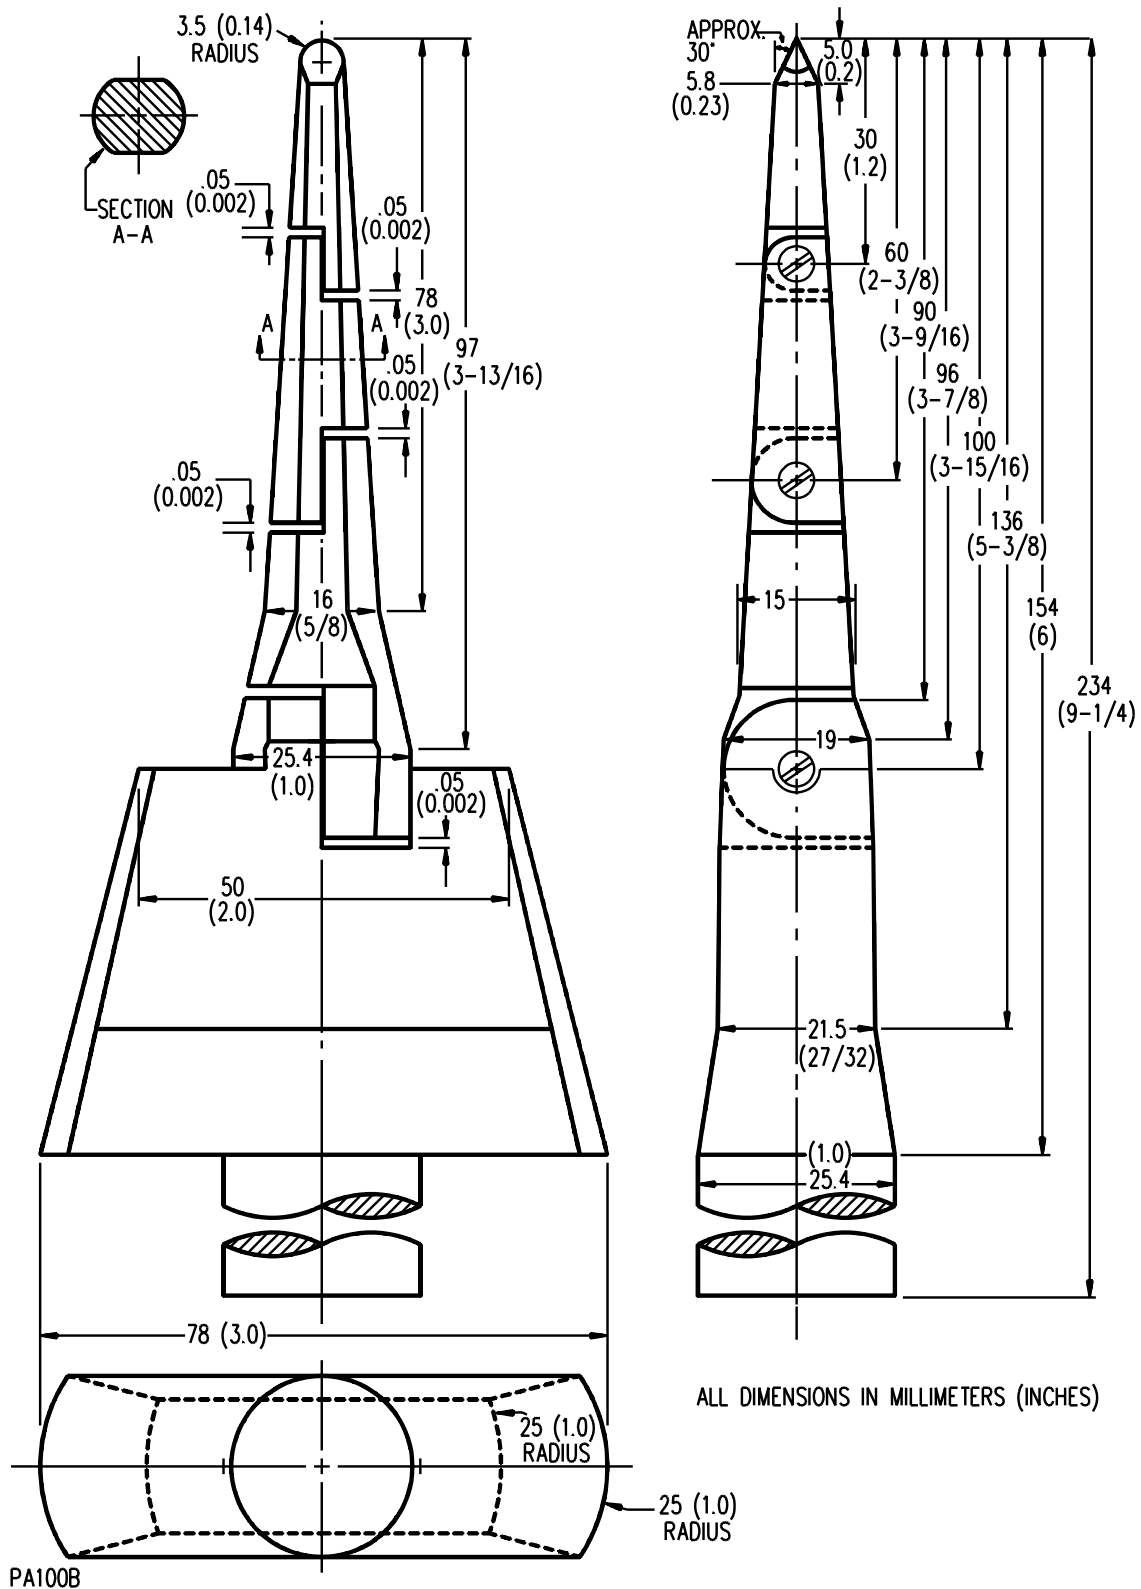

UL COPYRIGHTED MATERIAL –
NOT AUTHORIZED FOR FURTHER REPRODUCTION OR
DISTRIBUTION WITHOUT PERMISSION FROM



Documents
Document Sharing Hub

4.9 If any part of the enclosure must be opened or removed as part of energized set-up, normal operation, regular adjustment, or regular or required maintenance (set point adjustment, timer or time of day clock adjustment, battery replacement, or similar maintenance) with or without the use of tools, or can be opened or removed without the use of tools, the accessibility probe shall be applied without the part in place. The maximum force applied to the probe shall be 20 N (4.5 lb).

4.10 If a marking or an operating instruction refers a user to a hole or opening in an enclosure through which a tool is to be inserted for adjustment or a similar purpose, it shall not be possible to contact an un-insulated live part through the hole or opening with a 1.6-mm (1/16-inch) diameter rod. Maximum force shall not be greater than 10 N.

5 Openings in Enclosure

5.1 Openings in an enclosure shall not have any dimensions large enough to permit the entrance of a 25.4 mm (1 in) diameter rod, and shall comply with 5.2 – 5.6. The maximum force applied to the probe shall be 20 N (4.5 lb).


5.2 An opening shall not be provided in a compartment or part of an enclosure intended for field-wiring connections in a line-voltage circuit.

5.3 Openings in the mounting surface shall be limited to the following:

- a) A mounting opening that complies with Provision for Mounting, Clause 6.
- b) A maximum of four openings provided for the escape of air or paint during a painting process. The maximum dimension of such an opening shall not exceed 3.2 mm (1/8 in).
- c) A maximum of four unused holes provided for mounting of internal components. The maximum dimension of such an opening shall not exceed 4.8 mm (3/16 in).


5.4 An opening may be provided in the bottom surface of an enclosure if the opening does not permit materials to fall directly out from the interior of the unit. Figure 5.1 illustrates a construction that meets this requirement.

Figure 5.1
Bottom surface opening of an enclosure

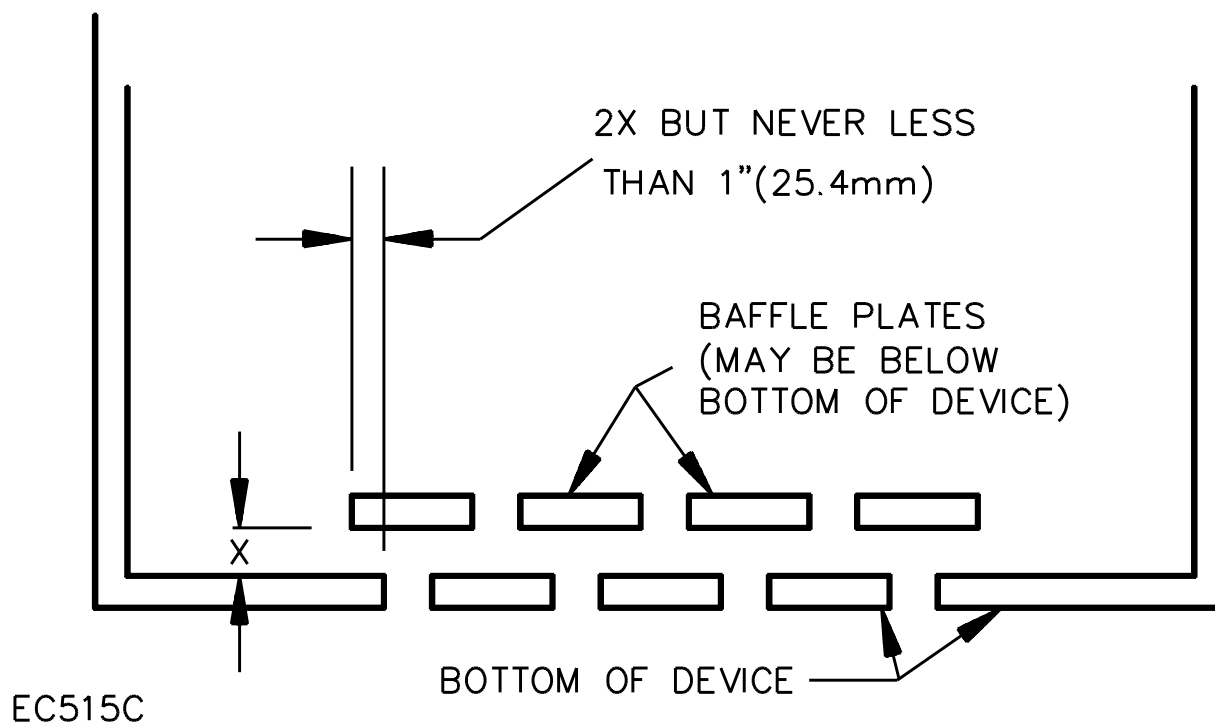

5.5 The shortest distance between an opening and the bottom of an enclosure or a wall-mounting surface shall be at least one-quarter of the enclosure height or depth, respectively, or 25.4 mm (1 in), whichever is less – see Figure 5.2.

Figure 5.2
Examples of Shortest Distances from Enclosure Openings

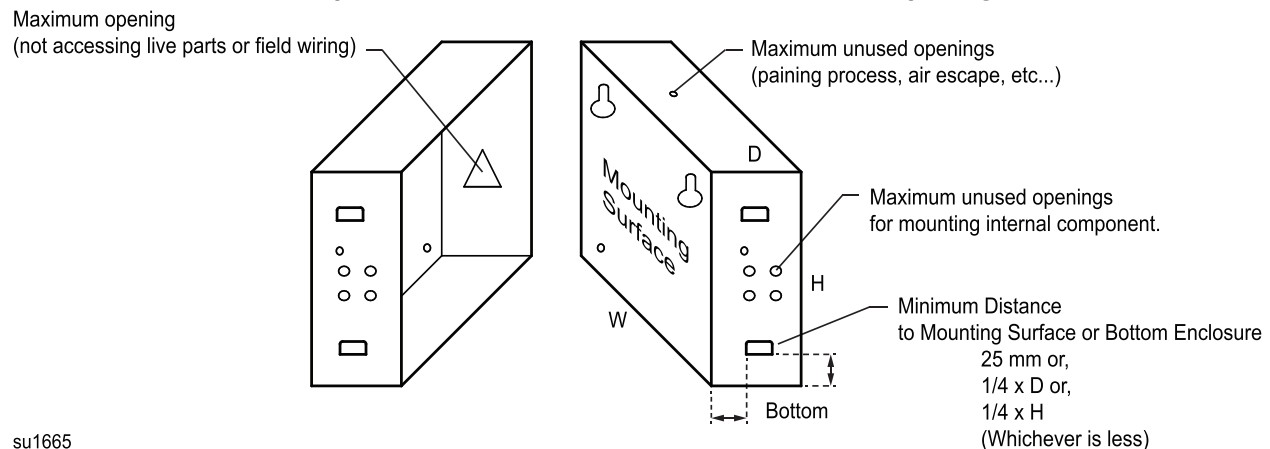

su1665

5.6 There shall be no emission of flame or molten material through an opening, or manifestation of risk of fire, during normal tests or during abnormal tests, such as transformer burnout.

5.7 Knockouts

If a knockout is provided, it shall comply with Table 5.1 and Clause 36, Knockout Test.

Table 5.1
Knockout diameters and width of flat surface surrounding knockouts

Trade size of conduit (metric designator)		Minimum width of flat surface surrounding knockout, mm (in)		Knockout diameters, mm (in)					
				Minimum		Nominal		Maximum	
1/2	(16)	3.38	(0.133)	21.84 ^a	(0.860)	22.23	(0.875)	22.61	(0.890)
3/4	(21)	3.68	(0.145)	27.79 ^b	(1.094)	28.17	(1.109)	28.96	(1.140)
1	(27)	4.72	(0.186)	34.52	(1.359)	34.93	(1.375)	35.71	(1.406)
1-1/4	(35)	6.45	(0.254)	43.66	(1.719)	44.04	(1.734)	44.83	(1.765)
1-1/2	(41)	7.80	(0.307)	49.73	(1.958)	50.39	(1.984)	51.20	(2.016)
2	(53)	8.97	(0.353)	61.80	(2.433)	62.71	(2.469)	63.50	(2.500)

^a In Canada, a reduced diameter of 21.46 mm (0.8 in) on a multiple knockout shall be allowed.

^b In Canada, a reduced diameter of 27.05 mm (1.065 in) on a multiple knockout shall be allowed.

6 Provision for Mounting

6.1 Provision shall be made for securely mounting a permanently connected unit in position. Bolts, screws, or other parts used for assembling the unit shall be independent of those used for securing component parts of the unit to the frame, base, or panel.

6.2 Bolts, screws, or other parts used for assembling the unit shall be independent of those used for securing component parts of the unit to the frame, base, or panel.

6.3 There shall be no more than four holes for mounting.

6.4 A cord-connected unit shall not include means for permanent mounting. One or two keyhole slots for wall hanging may be provided if the hanging screws, nails, and similar means, are not accessible for tightening, and if long nails, hooks, or screws for hanging will not be likely to touch internal wiring, the operating mechanism, or live parts and will not result in spacings less than those required in 12.1. Blind key hole slots are considered suitable to fulfill this requirement.

7 Protection Against Corrosion

7.1 Iron and steel parts shall be protected against corrosion by enameling, galvanizing, plating, or other equivalent means if the corrosion of such unprotected parts might result in a risk of fire, electric shock, or injury to persons.

7.2 Thermal elements, magnet pole faces, and hardened and polished parts such as latching surfaces, and similar parts where such protection is impractical need not be protected.

7.3 The metal enclosure of an indoor switch need not be protected.

7.4 Phosphate treatment with an oil or wax coating is acceptable as corrosion protection for magnets and armatures; oil treatment is acceptable as corrosion protection for steel springs; and stainless steel is acceptable without additional protection, if polished or treated.

7.5 All surfaces of a raintight metal enclosure, and all attached metal parts of such an enclosure, shall be protected against corrosion by one of the coatings described in 7.6 and 7.7, unless the metal is inherently resistant to corrosion. Metals used in combinations shall be galvanically compatible.

7.6 A sheet steel enclosure shall be protected against corrosion as specified in (a) – (d).

a) Hot-dipped mill-galvanized sheet steel conforming with the coating Designation G90 in the Weight (Mass) of Coating Requirements table in the Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process, ASTM A653/A653M, with not less than 40 percent of the zinc on any side, based on the minimum single spot test requirement in this ASTM specification. The weight of the zinc coating may be determined by any method; however, in case of question the weight of coating shall be established in accordance with the Standard Test Method for Weight [Mass] of Iron or Steel Articles with Zinc or Zinc-Alloy Coatings, ASTM A90.

b) A zinc coating, other than that provided on hot-dipped mill-galvanized sheet steel, uniformly applied to an average thickness of not less than 0.015 mm (0.00061 in) on each surface with a minimum thickness of 0.014 mm (0.00054 in). An annealed coating shall comply with 7.7.