

4L 795

ORDER OF DATA

[illegible]



Underwriters Laboratories Inc.®

A not-for-profit organization dedicated to public safety
and committed to quality service

January 12, 1996

Revision pages for

Standard for

Commercial-Industrial Gas Heating Equipment

UL 795, Fourth Edition

Attached to this transmittal notice is a revision of the Fourth edition of UL 795.

A CHANGE ON A PAGE DATED JANUARY 12, 1996 IS INDICATED BY A SMALL PRINT NOTE FOLLOWING THE AFFECTED ITEM, PRECEDED AND FOLLOWED BY AN ASTERISK.

THIS REVISION IS CONSIDERED NON-SUBSTANTIVE AND IS BEING ISSUED TO ELIMINATE THE OXYGEN BOMB TEST. THE OXYGEN BOMB TEST IS NO LONGER APPROPRIATE IN MOST CASES DUE TO THE ADDITION OF ANTIOXIDANTS TO RUBBER AND POLYMERIC COMPOUNDS. THEREFORE, UL IS ELIMINATING THE OXYGEN BOMB TEST AND REPLACING IT WITH AN AIR OVEN AGING TEST WHICH IS USED FOR THERMOPLASTIC COMPOUNDS. THE REQUIREMENTS ARE NOW IN EFFECT.

Attention is directed to the note on the title page of this standard outlining the procedure to be followed to retain the Department of Defense approved text of UL 795.

Revised and/or additional pages may be issued from time to time.

With the inclusion of the accompanying material, the standard consists of pages dated as shown in the following checklist:

Page	Date
1	June 10, 1994 (Reprinted January 12, 1996)
2 – 109	June 10, 1994
110	January 12, 1996
111 – 118, A1	June 10, 1994



Documents

Document Sharing Hub

JUNE 10, 1994

(Title Page Reprinted: January 12, 1996)

1

UL 795

Standard for

Commercial-Industrial Gas Heating Equipment

First Edition – November, 1952

Second Edition – October, 1964

Third Edition – April, 1973

Fourth Edition

June 10, 1994

An effective date included as a note immediately following certain requirements is one established by Underwriters Laboratories Inc.

The Department of Defense (DoD) has adopted UL 795 on January 27, 1992. The publication of revised pages or a new edition of this Standard will not invalidate the DoD adoption.

Revisions of this standard will be made by issuing revised or additional pages bearing their date of issue. A UL Standard is current only if it incorporates the most recently adopted revisions, all of which are itemized on the transmittal notice that accompanies the latest published set of revision pages.

ISBN 1-55989-568-1

COPYRIGHT © 1973, 1996 UNDERWRITERS LABORATORIES INC.

CONTENTS**FOREWORD****INTRODUCTION**

1 Scope	5
2 Glossary	5
3 Units of Measurement	12
4 Components	12

CONSTRUCTION — MECHANICAL

5 General	12
-----------------	----

CONSTRUCTION — ELECTRICAL

6 General	13
7 Servicing and Adjustment	14
8 Electrical Enclosures	14
9 Field Wiring Connections	22
10 Internal Wiring	25
11 Separation of Circuits	29
12 Mounting of Components	30
13 Motors and Motor Overcurrent or Overload Protection	30
14 Overcurrent Protection of High-Voltage Control-Circuit Conductors	34
15 Overcurrent Protection of Transformers	37
16 Switches and Controllers	39
17 Capacitors	40
18 Electrical Insulating Material	40
19 Spacings — High-Voltage Circuits	40
20 Spacings — Low-Voltage Circuits	42
21 Accessibility of Uninsulated Live Parts	42
22 Bonding For Grounding	44


CONSTRUCTION — BURNER ASSEMBLIES

23 General	47
24 Controls	48
25 Combustion Air Controls	49
26 Primary Safety Controls	51
27 Ignition Systems	53
28 Fittings and Piping	56
29 Valves and Regulators	59
30 Combination Gas-Oil Burner Assemblies	60

CONSTRUCTION — BOILERS, FURNACES AND HEATERS

31 General	61
32 Accessibility	62
33 Baffles	62
34 Burner Equipment	62

Figure 66.2
Rain-test spray head

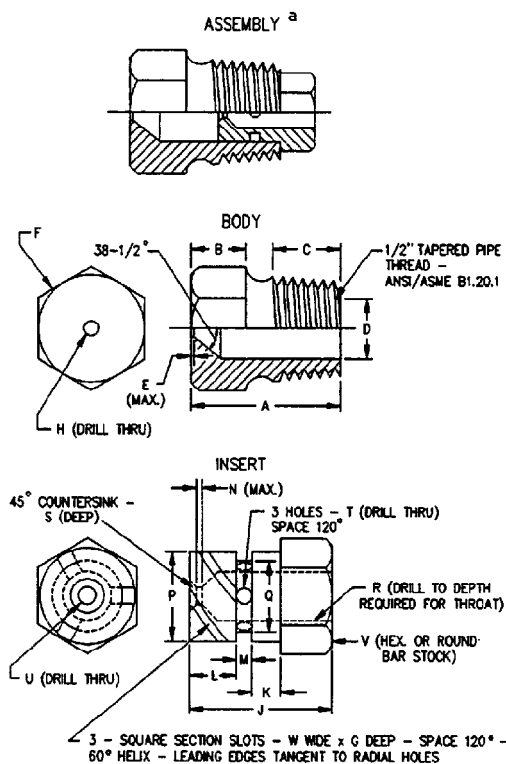

RT100C

Item	Inch	mm	Item	Inch	mm
A	1-7/32	31.0	N	1/32	0.80
B	7/16	11.0	P	.575	14.61
C	9/16	14.0		.576	14.63
D	.578	14.68	Q	.453	11.51
	.580	14.73		.454	11.53
E	1/64	0.40	R	1/4	6.35
F	c	c	S	1/32	0.80
G	.06	1.52	T	(No.35) ^b	2.79
H	(No.9) ^b	5.0	U	(No.40) ^b	2.49
J	23/32	18.3	V	5/8	16.0
K	5/32	3.97	W	0.06	1.52
L	1/4	6.35			
M	3/32	2.38			

^a - Molded nylon Rain-Test Spray Heads are available from Underwriters Laboratories Inc.

b - ANSI B94.11 Drill Size.

^c - Optional - To serve as wrench grip.

RB42-1

66.3 Wind Test – No. 25

66.3.1 The pilot(s) of a device designed for outdoor installation shall be capable of being ignited when the unit is exposed to a wind velocity of 10 miles per hour.

66.3.2 The test is to be conducted at normal test pressure.

66.3.3 A draft produced by a blower having sufficient capacity to develop a 10 mile per hour wind is to be directed against the outer surface of the device at the point(s) deemed to be most critical by the testing agency. The blower is to be located so that a uniform draft covering the total vertical projected area of the device is directed horizontally toward the device at a velocity of 10 miles per hour measured in a vertical plane 18 inches (45.7 cm) from windward surface of the device.

66.3.4 With the furnace subjected to the above wind conditions, the pilot(s) shall be capable of being ignited.

66.3.5 The main burner(s) and pilot(s) of a device designed for outdoor installation shall not become extinguished and the main burner(s) shall ignite from the pilot without excessive delay when the device is exposed to a wind velocity of 40 miles per hour.

66.3.6 The test is to be conducted at normal test pressure.

66.3.7 A draft produced by a blower having sufficient capacity to develop a 40 mile per hour wind is to be directed against the outer surface of the device and the outlet of the draft hood or integral venting system at points deemed to be most critical by the testing agency. The blower is to be located so that a uniform draft covering the total vertical projected area of the device is directed horizontally toward the device at a velocity of 40 miles per hour measured in a vertical plane 18 inches from the windward surface of the device.

66.3.8 With the device operating under the above wind conditions, the pilot(s) when operating alone, and the pilot(s) and the main burner(s) when operating simultaneously, are to be operated for a sufficient length of time to determine whether or not they will be extinguished and main burner(s) will be reliably ignited.

66.3.9 The device shall comply with the provisions of 51.1.1 and 51.1.2, sample to be taken at the end of 15 minutes of device operation under the following conditions of test with the device operating at normal test pressure.

66.3.10 A draft produced by a blower having a sufficient capacity to develop a 10 mile per hour wind is to be directed against the outer surface of the device at the point(s) deemed to be most critical by the testing agency. The blower is to be located so that a uniform draft covering the total vertical projected area of the device is directed horizontally toward the device at a velocity of 10 miles per hour measured in a vertical plane 18 inches (45.7 cm) from the windward surface of the device.

67 Gaskets

67.1 Neoprene or rubber compounds, except foamed materials, used for gaskets required to seal electrical enclosures, shall have physical properties before and after an air oven aging test for 70 hours at 100°C (212°F), as indicated in Table 67.1.

67.1 revised January 12, 1996

67.2 Foamed neoprene or rubber compounds forming gaskets are to be subjected to an air oven aging test for 70 hours at 100°C (212°F). The compounds shall not harden or otherwise deteriorate to a degree which will affect their sealing properties.

67.2 revised January 12, 1996

Commercial-Industrial Gas Heating Equipment



Northbrook, Illinois • (708) 272-8800

Melville, New York • (516) 271-6200

Santa Clara, California • (408) 985-2400

Research Triangle Park,
North Carolina • (919) 549-1400**Underwriters Laboratories Inc.®**

Underwriters Laboratories Inc., founded in 1894, is chartered as a not-for-profit organization without capital stock, under the laws of the State of Delaware, to establish, maintain, and operate laboratories for the examination and testing of devices, systems and materials to determine their relation to hazards to life and property, and to ascertain, define and publish standards, classifications and specifications for materials, devices, products, equipment, constructions, methods, and systems affecting such hazards.

UL Standards for Safety are developed under a procedure which provides for participation and comment from the affected public as well as industry. The procedure takes into consideration a survey of known existing standards and the needs and opinions of a wide variety of interests concerned with the subject matter of the standard. Thus manufacturers, consumers, individuals associated with consumer-oriented organizations, academicians, government officials, industrial and commercial users, inspection authorities, insurance interests and others provide input to UL in the formulating of UL Standards for Safety, to keep them consonant with social and technological advances.

A not-for-profit organization
dedicated to public safety and
committed to quality service



Underwriters Laboratories Inc.®

A not-for-profit organization dedicated to public safety
and committed to quality service

June 10, 1994

Standard for

Commercial-Industrial Gas Heating Equipment

UL 795, Fourth Edition

Accompanying this transmittal notice is a copy of the Fourth edition of UL 795.

THIS EDITION OF THE STANDARD IS NOW IN EFFECT.

Revised and/or additional pages may be issued from time to time.



JUNE 10, 1994

1

UL 795

Standard for

**Commercial-Industrial Gas Heating
Equipment**

First Edition – November, 1952
Second Edition – October, 1964
Third Edition – April, 1973

Fourth Edition

June 10, 1994

An effective date included as a note immediately following certain requirements is one established by Underwriters Laboratories Inc.

Revisions of this standard will be made by issuing revised or additional pages bearing their date of issue. A UL Standard is current only if it incorporates the most recently adopted revisions, all of which are itemized on the transmittal notice that accompanies the latest published set of revision pages.

ISBN 1-55989-568-1

COPYRIGHT © 1973, 1994 UNDERWRITERS LABORATORIES INC.

CONTENTS**FOREWORD****INTRODUCTION**

1 Scope	5
2 Glossary	5
3 Units of Measurement	12
4 Components	12

CONSTRUCTION — MECHANICAL

5 General	12
-----------------	----

CONSTRUCTION — ELECTRICAL

6 General	13
7 Servicing and Adjustment	14
8 Electrical Enclosures	14
9 Field Wiring Connections	22
10 Internal Wiring	25
11 Separation of Circuits	29
12 Mounting of Components	30
13 Motors and Motor Overcurrent or Overload Protection	30
14 Overcurrent Protection of High-Voltage Control-Circuit Conductors	34
15 Overcurrent Protection of Transformers	37
16 Switches and Controllers	39
17 Capacitors	40
18 Electrical Insulating Material	40
19 Spacings — High-Voltage Circuits	40
20 Spacings — Low-Voltage Circuits	42
21 Accessibility of Uninsulated Live Parts	42
22 Bonding For Grounding	44

CONSTRUCTION — BURNER ASSEMBLIES

23 General	47
24 Controls	48
25 Combustion Air Controls	49
26 Primary Safety Controls	51
27 Ignition Systems	53
28 Fittings and Piping	56
29 Valves and Regulators	59
30 Combination Gas-Oil Burner Assemblies	60

CONSTRUCTION — BOILERS, FURNACES AND HEATERS

31 General	61
32 Accessibility	62
33 Baffles	62
34 Burner Equipment	62

35	Operating Controls	62
36	Limit Controls	63
37	Installation of External Controls and Fittings on Boilers	65
38	Flue Dampers, Draft Regulators, and Draft Hoods	66
39	Bleeds and Vents	67
40	Bases	67
41	Heating Surfaces and Combustion Chambers	68
42	Radiation Shields	68
43	Materials in Air Handling Compartments	68
44	Casings	69
45	Fuel Lines and Components	70
46	Flue Collars	70
47	Air Filters	70

PERFORMANCE

48	General	70
49	Test Installations	72
50	Test Methods	76
51	Burner Assembly Tests	80
52	Operation Tests	86
53	Temperature Tests	88
54	Low water cutoff of boilers – Test No. 17A	95
55	Short-Circuit – Test No. 18	95
56	Overload Test, High-Voltage Transformers – Test No. 18A	97
57	Burnout Test, High-Voltage Transformers – Test No. 18B	98
58	Dielectric Voltage-Withstand Test – Test No. 19	98
59	Draft Hood Equipped Devices	99
60	Flame Test	103
61	Strain Relief Test	103

OUTDOOR-USE EQUIPMENT

62	General	104
63	Enclosures	104
64	Field Wiring Connections	106
65	Wiring	106
66	Outdoor-Use Equipment Tests	107
67	Gaskets	110
68	Chromic Acid Dropping Test – No. 26	111

MANUFACTURING AND PRODUCTION TESTS

69	General	113
----	---------------	-----

MARKING AND INSTRUCTIONS

70	Marking	114
71	Instructions	117

APPENDIX A

	Standards for Components	A1
--	--------------------------------	----

FOREWORD

A. This Standard contains basic requirements for products covered by Underwriters Laboratories Inc. (UL) under its Follow-Up Service for this category within the limitations given below and in the Scope section of this Standard. These requirements are based upon sound engineering principles, research, records of tests and field experience, and an appreciation of the problems of manufacture, installation, and use derived from consultation with and information obtained from manufacturers, users, inspection authorities, and others having specialized experience. They are subject to revision as further experience and investigation may show is necessary or desirable.

B. The observance of the requirements of this Standard by a manufacturer is one of the conditions of the continued coverage of the manufacturer's product.

C. A product which complies with the text of this Standard will not necessarily be judged to comply with the Standard if, when examined and tested, it is found to have other features which impair the level of safety contemplated by these requirements.

D. A product employing materials or having forms of construction differing from those detailed in the requirements of this Standard may be examined and tested according to the intent of the requirements and, if found to be substantially equivalent, may be judged to comply with the Standard.

E. UL, in performing its functions in accordance with its objectives, does not assume or undertake to discharge any responsibility of the manufacturer or any other party. The opinions and findings of UL represent its professional judgment given with due consideration to the necessary limitations of practical operation and state of the art at the time the Standard is processed. UL shall not be responsible to anyone for the use of or reliance upon this Standard by anyone. UL shall not incur any obligation or liability for damages, including consequential damages, arising out of or in connection with the use, interpretation of, or reliance upon this Standard.

F. Many tests required by the Standards of UL are inherently hazardous and adequate safeguards for personnel and property shall be employed in conducting such tests.

INTRODUCTION

1 Scope

1.1 These requirements apply to factory-built gas appliances having inputs of more than 400,000 Btu per hour, per individual combustion chamber which require flame failure and other precautions and which are intended primarily for commercial and industrial installation. The appliances covered by these requirements are gas burners, comfort heating furnaces, heaters and gas-fired boiler assemblies except watertube boilers having outputs of 10,000 pounds of steam per hour or more.

1.2 Gas-heating equipment covered by these requirements may be operated without a competent attendant being constantly on duty at the burners while the burners are in operation.

1.3 These requirements do not apply to process equipment.

1.4 Other requirements are available for central-heating gas appliances, domestic conversion burners, floor furnaces, room heaters, unit heaters, and water heaters as defined by the Standard for Installation of Gas Appliances and Gas Piping, NFPA 54-1992.

1.5 A product that contains features, characteristics, components, materials, or systems new or different from those covered by the requirements in this Standard, and that involve a risk of fire, electric shock, or injury to persons shall be evaluated using the appropriate additional component and end-product requirements as determined necessary to maintain the acceptable level of safety as originally anticipated by the intent of this Standard. A product whose features, characteristics, components, materials, or systems conflict with specific requirements or provisions of this Standard cannot be judged to comply with this Standard. Where considered appropriate, revision of requirements may be proposed and adopted in conformance with the methods employed for development, revision, and implementation of this Standard.

2 Glossary

2.1 For the purposes of this Standard the following definitions apply.

2.2 **AIR HEATER** – An indirect fired vented appliance intended to supply heated air for space heating and other purposes, but not intended for permanent installation.

2.3 **AIR SHUTTER** – An adjustable device for varying the size of the air inlet or inlets regulating primary or secondary air.

2.4 **AIR SHUTTER, AUTOMATICALLY OPERATED** – An air shutter operated by an automatic control.

2.5 **AIR SHUTTER, MANUALLY OPERATED** – An air shutter manually set and locked in the desired position.

2.6 **APPLIANCE FLUE** – The flue passages within an appliance.

2.7 **ALUMINUM COATED STEEL** – An aluminum coated steel in which the bond between the steel and the aluminum is an iron-aluminum alloy.

2.8 **BAFFLE** – An object placed in an appliance to direct the flow of air or flue gases.

2.9 **BASE** – The main supporting frame or structure of the assembly, exclusive of legs.

2.10 **BOILER** – A closed vessel in which water or some other liquid is heated or steam is generated or superheated, under pressure or vacuum, by direct application of heat.

- 2.11 **BOILER, HIGH PRESSURE STEAM** – A boiler in which steam is generated at a pressure higher than 15 psig (103 kPa).
- 2.12 **BOILER, HIGH TEMPERATURE WATER** – A boiler intended for operation at a pressure exceeding 160 psig (1103 kPa) and at a temperature exceeding or at a temperature exceeding 250°F (121°C).
- 2.13 **BOILER, HOT WATER** – A boiler that furnishes hot water at a pressure not exceeding 160 psig (1103 kPa) and at a temperature not exceeding 250°F (121°C).
- 2.14 **BOILER, LOW PRESSURE STEAM** – A boiler in which steam is generated at a pressure not exceeding 15 psig (103 kPa).
- 2.15 **BURNER GAS** – A device for the final conveyance of the gas, or a mixture of gas and air, to the combustion zone.
- 2.16 **BURNER, AUTOMATICALLY LIGHTED** – One where fuel to the main burner is normally turned on and ignited automatically.
- 2.17 **BURNER, MANUALLY LIGHTED** – One where fuel to the main burner is turned on only by hand and ignited under supervision.
- 2.18 **BURNER HEAD, GAS** – That portion of a burner beyond the outlet end of the mixer tube which contains the ports.
- 2.19 **CASING** – An enclosure forming the outside of the appliance, no parts of which are likely to be subjected to intense heat.
- 2.20 **CHIMNEY CONNECTOR** – The pipe which connects a fuel burning appliance to a chimney.
- 2.21 **COMBUSTIBLE MATERIAL** – Combustible material, as pertaining to materials adjacent to or in contact with heat producing appliances, chimney connectors and vent connectors, steam and hot water pipes, and warm air ducts, means material made of or surfaced with wood, compressed paper, plant fibers, or other material that will ignite and burn. Such material shall be considered as combustible even though flameproofed, fire retardant treated, or plastered.
- 2.22 **COMBUSTION** – As used herein, the rapid oxidation of fuel accompanied by the production of heat, or heat and light. Complete combustion of a fuel is possible only in the presence of an adequate supply of oxygen.
- 2.23 **COMBUSTION CHAMBER** – The portion of an appliance within which combustion occurs.
- 2.24 **COMBUSTION DETECTOR** – That part of a primary safety control which is responsive directly to flame properties.
- 2.25 **COMBUSTION PRODUCTS** – Constituents resulting from the combustion of a fuel with the oxygen of the air, including the inerts, but excluding excess air.
- 2.26 **CONDENSATE** – The liquid which separates from a gas, including flue gases, due to a reduction in temperature.
- 2.27 **CONTROL** – A device designed to regulate the fuel, air, water, or electrical supply to the controlled equipment. It may be automatic, semi-automatic, or manual.

2.28 CONTROL INPUT, COMBUSTION – A control which automatically regulates the firing rate at predetermined air-fuel ratio in accordance with load demand. It may be a type which positions the air and fuel supplies for low fire and for high fire as required to meet the load demands, or it may be a modulating type which gradually varies the air and fuel supplies within limits to meet the load demand.

2.29 CONTROL, LIMIT – An automatic safety control responsive to changes in liquid level, pressure, or temperature and normally set beyond the operating range for limiting the operation of the controlled equipment.

2.30 CONTROL, OPERATING – A control other than a safety control or interlock, to start or regulate burner firing according to load demand and to stop or regulate fire on satisfaction of demand or upon reaching normal temperature or pressure in the device being fired. Operating controls may also actuate auxiliary equipment.

2.31 CONTROL, SAFETY – Automatic controls and interlocks, including relays, switches, and other auxiliary equipment used in conjunction therewith to form a safety control system, which are intended to prevent unsafe operation of the controlled equipment.

2.32 CONTROL, PRIMARY SAFETY – An automatic control that monitors the operation of a gas-fired or an oil-fired burner. It normally consists of the following sections that may be integrated into a common unit or may be separate units, interconnected by wiring:

a) **Programming Unit** – A device that programs the burner through start-up and shutdown operations in response to signals from regulating, limiting, and monitoring devices. It also provides the timings, as required, in proper sequence, for purging, flame establishing periods and in case of ignition or flame failure, for safety shutdown (lockout).

b) **Combustion Detector** – A device that is responsive to flame properties. It monitors the flame at the point of flame supervision and transmits a signal to the programming unit, indicating absence or presence of flame.

2.33 DAMPER – A valve or plate for regulating draft or flow of the flue gases. A damper is generally considered as being located on the downstream side of the combustion chamber, usually in a flue passage of the appliance or in the chimney or vent connector.

2.34 DAMPER, AUTOMATICALLY OPERATED – A damper operated by an automatic control.

2.35 DAMPER, MANUALLY OPERATED – An adjustable damper manually set and locked in the desired position.

2.36 DIRECT FIRED APPLIANCE – A device in which combustion products (flue gases) are mixed with the medium, e.g., air, being heated.

2.37 DRAFT REGULATOR, BAROMETRIC – A device which functions to maintain a desired draft by automatically reducing the chimney draft to the desired value.

2.38 ELECTRICAL CIRCUITS:

a) **High-Voltage Circuit** – A circuit involving a potential of not more than 600 volts and having circuit characteristics in excess of those of a low-voltage circuit.

- b) **Low-Voltage Circuit** – A circuit involving a potential of not more than 30 volts alternating current (42.4 peak) or direct current and supplied by a primary battery or by a standard Class 2 transformer or other suitable transforming device, or by a suitable combination of transformer and fixed impedance having output characteristics in compliance with what is required for a Class 2 transformer. A circuit derived from a source of supply classified as a high-voltage circuit, by connecting resistance in series with the supply circuit as a means of limiting the voltage and current, is not considered to be a low-voltage circuit.
- c) **Isolated Limited Secondary Circuit** – A circuit of limited energy derived from an isolated secondary winding of a transformer having a maximum capacity of 100 volt-amperes (VA) and open-circuit secondary voltage rating not exceeding 1000 volts.
- d) **Safety Control Circuit** – A circuit involving one or more safety controls.
- 2.39 **EXCESS AIR** – Air which passes through the combustion chamber and the appliance flues in excess of that which is theoretically required for complete combustion.
- 2.40 **FLAME SAFEGUARD** – See Control, Primary Safety, 2.31.
- 2.41 **FLUE COLLAR** – That portion of an appliance designed for attachment of the chimney or vent connector.
- 2.42 **FLUE GASES** – Combustion products and excess air.
- 2.43 **FURNACE, CENTRAL, WARM AIR** – A self-contained indirect fired appliance designed to supply heated air through ducts to spaces remote from or adjacent to the appliance location.
- 2.44 **FURNACE, FORCED-AIR TYPE, CENTRAL** – A central furnace equipped with a fan or blower which provides the primary means for circulation of air.
- 2.45 **FURNACE, DOWNFLOW** – A forced-air type central furnace designed with air flow through the furnace essentially in a vertical path, discharging air at or near the bottom of the furnace.
- 2.46 **FURNACE, DUCT** – A central furnace designed for installation in a duct of an air distribution system to supply warm air for heating and which depends for air circulation on a blower not furnished as part of the furnace.
- 2.47 **FURNACE, HORIZONTAL** – A forced-air type central furnace designed with air flow through the furnace essentially in a horizontal path.
- 2.48 **FURNACE, UPFLOW** – A central furnace designed with air flow through the furnace essentially in a vertical path, discharging air at or near the top of the furnace.
- 2.49 **GAS VENT** – The piping and fittings for conveying flue gases to the outside atmosphere.
- 2.50 **HEAT EXCHANGER, DIRECT** – A heat exchanger in which heat generated in the combustion chamber of the device is transferred direct through walls of the heat exchanger to the heating medium such as air, steam, or water, held in close contact with the combustion-chamber walls. It is a self-contained combustion and heat-transfer device, hence a direct heat-transfer device.

2.51 **HEAT EXCHANGER, INDIRECT** – A heat exchanger which encloses or contains a heating medium such as air, steam, or water, the heat from which is transferred to another heating medium separately contained in close contact with or directed through the heat exchanger. It is an indirect heat-transfer device.

2.52 **HEATING SURFACES** – All surfaces which transmit heat directly from flame or flue gases to the medium to be heated.

2.53 **IGNITION, CONTINUOUS** – Ignition by an energy source which is continuously maintained through the time the burner is in service, whether the main burner is firing or not.

2.54 **IGNITION, INTERMITTENT** – Ignition by an energy source which is continuously maintained through the time the burner is firing.

2.55 **IGNITION, INTERRUPTED** – Ignition by an energy source which is automatically energized each time the main burner is fired and subsequently is automatically shut off during the firing cycle.

2.56 **IGNITION, MANUAL** – Ignition by an energy source which is manually energized and where the fuel to the pilot is lighted automatically when the ignition system is energized.

2.57 **INDIRECT-FIRED DEVICE** – A device designed so that combustion products (flue gases) are not mixed in the device with the medium, e.g., air, being heated.

2.58 **INTERLOCK** – A control to prove the physical state of a required condition, and to furnish that proof to the primary safety control circuit.

2.59 **LINER** – See Radiation Shield, 2.82.

2.60 **LINING** – Those interior surfaces of a combustion chamber which are exposed to combustion during use of the device.

2.61 **LIQUEFIED-PETROLEUM GAS** – Fuel gases, including commercial propane, predominantly propane or propylene or commercial butane, predominantly butane, isobutane, and/or butylene.

2.62 **LP-GAS AIR MIXTURE** – Liquefied-petroleum gases distributed at relatively low pressures and normal atmospheric temperatures which have been diluted with air to produce desired heating value and utilization characteristic.

2.63 **MAIN BURNER FLAME-ESTABLISHING PERIOD** – The interval of time the main burner fuel safety shutoff valves are permitted to be open before the primary safety control is required to supervise the main burner flame.

2.64 **MANIFOLD** – The conduit of a device which supplies gas to the individual burner.

2.65 **MIXER, GAS** – The combination of mixer head, mixer throat, and mixer tube.

a) **Mixer Head** – That portion of an injection type burner, usually enlarged, into which primary air flows to mix with the gas stream.

b) **Mixer Throat** – That portion of the mixer which has the smallest cross-sectional area and which lies between the mixer head and the mixer tube.

c) **Mixer Tube** – That portion of the mixer which lies between the throat and the burner head.

- 2.66 **MIXER FACE, GAS** – The air inlet end of the mixer head.
- 2.67 **NORMAL CARE** – The periodic tasks usually performed to operate and maintain an appliance, such as air, fuel, pressure, and temperature regulation, cleaning, lubrication, and resetting of controls.
- 2.68 **ORIFICE** – The opening in a cap, spud, or other device whereby the flow of gas is limited and through which the gas is discharged to a burner.
- 2.69 **ORIFICE CAP (HOOD)** – A movable fitting having an orifice which permits adjustment of the flow of gas by the changing of its position with respect to a fixed needle or other device.
- 2.70 **ORIFICE SPUD** – A removable plug or cap containing an orifice and which permits adjustment of the flow of gas either by substitution of a spud with a different sized orifice or by the motion of a needle with respect to it.
- 2.71 **PILOT, CONTINUOUS** – A pilot that burns without turn-down throughout the entire time the burner assembly is in service, whether the main burner is firing or not.
- 2.72 **PILOT, EXPANDING** – A pilot that burns throughout the entire time the burner assembly is in service, whether the main burner is firing or not. Upon a call for heat, the pilot is automatically expanded so as to reliably ignite the main burner. This pilot may be turned down automatically at the end of main burner flame-establishing period.
- 2.73 **PILOT FLAME-ESTABLISHING PERIOD** – The interval of time fuel is permitted to be delivered to a proved pilot before the primary safety control is required to detect pilot flame.
- 2.74 **PILOT, INTERMITTENT** – A pilot which is automatically lighted each time there is a call for heat, if burns during the entire period that the main burner is firing.
- 2.75 **PILOT, INTERRUPTED** – A pilot which is automatically lighted each time there is a call for heat. The pilot fuel is cut off automatically at the end of the main burner flame-establishing period.
- 2.76 **PILOT, PROVED** – A pilot flame supervised by a primary safety control.
- 2.77 **PLENUM** – An air compartment, part of a distributing system, to which one or more ducts are connected.
- a) **Furnace Supply Plenum** – A furnace plenum attached directly to, or an integral part of, the supply outlet of the furnace.
 - b) **Furnace Return Plenum** – A furnace plenum attached directly to, or an integral part of, the return air inlet of the furnace.
- 2.78 **PORT** – Any opening in a burner head through which fuel or an air-fuel mixture is discharged for ignition.
- 2.79 **PRIMARY AIR** – The air introduced into a burner which mixes with the fuel before it reaches the ignition zone.
- 2.80 **POST-PURGE PERIOD** – The period of time after the fuel delivered to the burner is stopped and during which the burner motor or fan continues to run to supply air to the combustion chamber.

- 2.81 **PREPURGE PERIOD** – The period of time during the burner start-up in which air is introduced into the combustion chamber and the associated flue passages in such volume and manner as to completely replace the air or fuel-air mixture contained therein prior to initiating ignition.
- 2.82 **RADIATION SHIELD** – A separate panel or panels interposed between heating surfaces and adjacent objects to reduce heat transmission by radiation.
- 2.83 **READILY ACCESSIBLE** – Capable of being reached easily and quickly for operation, adjustment, and inspection.
- 2.84 **REGULATOR, GAS-PRESSURE** – A device for controlling and maintaining a uniform outlet gas pressure.
- 2.85 **RESPONSE TIME – FLAME FAILURE** – The interval between the occurrence of flame extinguishment and de-energizing the safety shutoff means.
- 2.86 **SAFETY CONTROL** – See Control, Safety, 2.31.
- 2.87 **SAFETY SHUTDOWN** – The action of shutting off all fuel and ignition energy to the device by means of a safety control or controls such that restart cannot be accomplished without manual reset.
- 2.88 **SECONDARY AIR** – The air externally supplied to the flame at the point of combustion.
- 2.89 **THERMOSTAT** – An automatic control actuated by temperature change to maintain temperatures between predetermined limits.
- 2.90 **TOOLS, SPECIAL** – Those tools that are not available on the open retail market.
- 2.91 **UNIT HEATER:**
- a) **Low-Static Pressure Type** – A self-contained, automatically controlled, vented fuel burning device having integral means for circulation of air, normally by a propeller fan (or fans). Such devices may be equipped with louvers or face extensions made in accordance with the manufacturer's approved specifications.
 - b) **High-Static Pressure Type** – A self-contained, automatically controlled, vented fuel burning device having integral means for circulation of air against 0.2 inch or greater static pressure and designed for installation in the space to be heated unless they are equipped with provisions for attaching both inlet and outlet air ducts.
- 2.92 **VALVE, BURNER-INPUT CONTROL** – An automatic-control valve for regulating the input of fuel to a burner.
- 2.93 **VALVE, SAFETY SHUTOFF** – A valve that is automatically closed by the safety control system or by an emergency device. Such valve may be of the automatic or manually opened type.
- 2.94 **VALVE, LUBRICATED PLUG TYPE** – A valve of the plug and barrel type designed for maintaining a lubricant between the bearing surfaces.
- 2.95 **VALVE, MANUAL GAS SHUTOFF** – A manually operated valve in a gas line for the purpose of completely turning on or shutting off the gas supply.

2.96 VENT CONNECTOR – The pipe which connects a gas-fired device to a gas vent or chimney.

2.97 ZERO GOVERNOR – A regulating device which is normally adjusted to deliver gas at atmospheric pressure within its flow rating.

3 Units of Measurement

3.1 If a value for measurement is followed by a value in other units in parentheses, the second value may be only approximate. The first stated value is the requirement.

4 Components

4.1 Except as indicated in 4.2, a component of a product covered by this standard shall comply with the requirements for that component. See Appendix A for a list of standards covering components generally used in the products covered by this standard.

4.2 A component need not comply with a specific requirement that:

- a) Involves a feature or characteristic not needed in the application of the component in the product covered by this standard, or
- b) Is superseded by a requirement in this standard.

4.3 A component shall be used in accordance with its recognized rating established for the intended conditions of use.

4.4 Specific components are recognized as being incomplete in construction features or restricted in performance capabilities. Such components are intended for use only under limited conditions, such as certain temperatures not exceeding specified limits, and shall be used only under those specific conditions for which they have been recognized.

CONSTRUCTION – MECHANICAL

5 General

5.1 The requirements of 21.1 are not applicable to mechanical service functions which are not normally performed with the equipment energized.

5.2 Moving parts such as fan blades, blower wheels, pulleys, belts, etc., which may cause injury shall be enclosed or guarded.

5.3 If the removal of doors or panels or shields will expose such moving parts:

- a) The opening or removal of the door, panel or shield shall require the use of tools, or
- b) An interlocking device shall shut off the mechanism, or
- c) A warning marking shall be displayed which reads essentially as follows:

DANGER – To Avoid Injury From Moving Parts, Shut Off The (Equipment) Before (Removing-Opening) This (Cover-Door).

5.4 The distance from an opening in a required guard or enclosure to the moving part mentioned in 5.3 shall be in accordance with the following table, but the minor dimension of the opening shall not in any case exceed 3 inches (76.2 mm). For an opening having a minor dimension intermediate between two of the values included in the table, the distance from the opening to the moving part shall be not less than that found by appropriate interpolation between the corresponding values in the right hand column of the table. The minor dimension of the opening is determined by the largest hemispherically tipped cylindrical probe that can be inserted through the opening with a force of 5 pounds.

Minor dimensions of opening, inches ^a	Minimum distance from opening to moving part, inches
1/4	1/2
3/8	1-1/2
1/2	2-1/2
3/4	4-1/2
1	6-1/2
1-1/2	10-1/2
2	14-1/2
Over 2	30

^a Openings less than 1/4 inch are not to be considered.

5.5 A moving part is not to be considered when judging compliance with 5.3 and 5.4 if the part is unlikely to be contacted through the opening because of fixed components, including baffles.

5.6 Parts that may come in contact with the operator's hand during normal adjustment or servicing shall be free from sharp projections or edges and projecting screw ends.

CONSTRUCTION — ELECTRICAL

6 General

6.1 Fuel confining parts, or operating parts if failure of the part will allow excess leakage of fuel, unintended operation, or restrict a safety device from functioning, shall be of sufficient strength, durability, and resistance to fire. Such parts shall be made of material having a melting point (solidus temperature) of not less than 950°F (510°C) and a tensile strength of not less than 10,000 psi at 400°F (204°C). Such parts shall not sag, distort, melt, oxidize, or show leakage of fuel during any of the tests specified herein.

6.2 Electrical equipment and wiring shall be arranged so that oil or water will not drip or run on them during normal usage or from a connection required to be uncoupled for servicing the device also to reduce the risk of contact with water from humidifiers.

6.3 Attachment plugs or separable connectors shall not be used in circuits when the breaking or making of the circuit by such devices may result in operation of the equipment in a manner that involves a risk of fire, electric shock, or injury to persons.

7 Servicing and Adjustment

7.1 Service functions which may have to be performed with the equipment energized include:

- a) Adjusting the setting of temperature controls with or without marked dial settings;
- b) Resetting control trip mechanism; operating manual switches;
- c) Adjusting air-flow dampers.

A factory set and sealed control is not considered to be adjustable.

7.2 Adjustable or resettable electrical control or manual switching devices may be located or oriented with respect to uninsulated live parts so that manipulation of the mechanism for adjustment, resetting, or operation can be accomplished in the normal direction of access if uninsulated live parts or moving parts are:

- a) Not located in front, in the direction of access of the mechanism, and
- b) Are not located within 6 inches on any side or behind the mechanism, unless guarded.

7.3 An electrical control component which may require examination, adjustment, servicing, or maintenance while energized, not including voltage measurements, shall be located and mounted with respect to other components and with respect to grounded metal parts so that it is accessible for electrical service functions without subjecting the serviceman to the likelihood of risk of electric shock from adjacent uninsulated live parts or to the risk of injury from adjacent moving parts.

7.4 Components in a low-voltage circuit are to comply with the requirements of 7.3 in their relation to uninsulated live parts in a high-voltage circuit and to moving parts.

8 Electrical Enclosures

8.1 Uninsulated high-voltage parts shall be enclosed or guarded to reduce the likelihood of unintentional contact by persons during normal use of the equipment. This applies also to such parts located in a compartment into which access is required for normal care of the equipment, such as resetting controls, replacing filters, lubrication, cleaning, and the like.

8.2 Sheet metal complying with Tables 8.1 and 8.2 whichever applies, meets the requirement for the individual enclosure of electrical components.

Table 8.1
Minimum thickness of sheet metal for enclosures carbon steel or stainless steel

Without supporting frame ^a			With supporting frame or equivalent reinforcing ^a				Minimum thickness in inches (mm)			
Maximum width ^b In inches (cm)		Maximum length ^c In inches (cm)	Maximum width ^b In inches (cm)		Maximum length In inches (cm)	Uncoated (MSG)		Metal coated (GSG)		
4.0	(10.2)	Not limited	6.25	(15.9)	Not limited	0.020 ^d	(0.51)	0.023 ^d	(0.58)	
4.75	(12.1)	5.75 (14.6)	6.75	(17.1)	8.25 (21.0)	(24)		(24)		
6.0	(15.2)	Not limited	9.5	(24.1)	Not limited	0.026 ^d	(0.66)	0.029 ^d	(0.74)	
7.0	(17.8)	8.75 (22.2)	10.0	(25.4)	12.5 (31.8)	(22)		(22)		
8.0	(20.4)	Not limited	12.0	(30.5)	Not limited	0.032	(0.81)	0.034	(0.86)	
9.0	(22.9)	11.5 (29.2)	13.0	(33.0)	16.0 (40.6)	(20)		(20)		
12.5	(31.8)	Not limited	19.5	(49.5)	Not limited	0.042	(1.07)	0.045	(1.14)	
14.0	(35.6)	18.0 (45.7)	21.0	(53.3)	25.0 (63.5)	(18)		(18)		
18.0	(45.7)	Not limited	27.0	(68.6)	Not limited	0.053	(1.34)	0.056	(1.42)	
20.0	(50.8)	25.0 (63.5)	29.0	(73.7)	36.0 (91.4)	(16)		(16)		
22.0	(55.9)	Not limited	33.0	(83.8)	Not limited	0.060	(1.53)	0.063	(1.61)	
25.0	(63.5)	31.0 (78.7)	35.0	(89.0)	43.0 (109.2)	(15)		(15)		
25.0	(63.4)	Not limited	39.0	(99.1)	Not limited	0.067	(1.70)	0.070	(1.78)	
29.0	(73.7)	36.0 (91.4)	41.0	(104.1)	51.0 (129.5)	(14)		(14)		
33.0	(83.8)	Not limited	51.0	(129.5)	Not limited	0.080	(2.04)	0.084	(2.13)	
35.0	(89.0)	47.0 (119.4)	54.0	(137.1)	66.0 (167.6)	(13)		(13)		
42.0	(106.7)	Not limited	64.0	(162.6)	Not limited	0.093	(2.36)	0.097	(2.46)	
47.0	(119.4)	59.0 (149.9)	68.0	(172.7)	84.0 (213.4)	(12)		(12)		
52.0	(132.1)	Not limited	80.0	(203.2)	Not limited	0.108	(2.74)	0.111	(2.80)	
60.0	(152.4)	74.0 (188.0)	84.0	(213.4)	103.0 (261.6)	(11)		(11)		
63.0	(160.0)	Not limited	97.0	(246.4)	Not limited	0.123	(3.12)	0.126		
73.0	(185.4)	90.0 (228.6)	103.0	(261.6)	127.0 (322.6)	(10)		(10)	(3.20)	

^a A supporting frame is a structure of angle or channel or a folded rigid section of sheet metal which is rigidly attached to and has essentially the same outside dimensions as the enclosure surface and which has sufficient torsional rigidity to resist the bending moments which may be applied via the enclosure surface when it is deflected. Construction that is considered to have equivalent reinforcing may be accomplished by designs that will produce a structure which is as rigid as one built with a frame of angles or channels. Construction considered to be without supporting frame includes:

- 1) Single sheet with single formed flanges (formed edges),
- 2) A single sheet which is corrugated or ribbed, and
- 3) An enclosure surface loosely attached to a frame, e.g. with spring clips.

^b The width is the smaller dimension of a rectangular sheet metal piece which is part of an enclosure. Adjacent surfaces of an enclosure may have supports in common and be made of a single sheet.

^c For panels which are not supported along one side, e.g., side panels of boxes, the length of the unsupported side shall be limited to the dimensions specified unless the side in question is provided with a flange at least 1/2 inch (12.7 mm) wide.

^d Sheet metal for an enclosure intended for outdoor use shall comply with 63.7 and 63.8.

Table 8.2
Minimum thickness of sheet metal for enclosures aluminum, copper, or brass

Without supporting frame ^a		With supporting frame or equivalent reinforcing ^a		Minimum thickness Inches (mm) (AWG)
Maximum width ^b In Inches (cm)	Maximum length ^c In Inches (cm)	Maximum width ^b In Inches (cm)	Maximum length In Inches (cm)	
3.0 (7.6)	Not limited	7.0 (17.8)	Not limited	0.023 ^d (22)
3.5 (8.9)	4.0 (10.2)	8.5 (21.7)	9.5 (24.1)	(0.58)
4.0 (10.2)	Not limited	10.0 (25.4)	Not limited	0.029 (20)
5.0 (12.7)	6.0 (15.2)	10.5 (26.7)	13.5 (34.2)	(0.74)
6.0 (15.2)	Not limited	14.0 (35.6)	Not limited	0.036 (18)
6.5 (16.5)	8.0 (20.4)	15.0 (38.1)	18.0 (45.7)	(0.91)
8.0 (20.4)	Not limited	19.0 (48.3)	Not limited	0.045 (16)
9.5 (24.1)	11.5 (29.2)	21.0 (53.3)	25.0 (63.5)	(1.14)
12.0 (30.5)	Not limited	28.0 (71.1)	Not limited	0.058 (14)
14.0 (35.6)	16.0 (40.6)	30.0 (76.2)	37.0 (94.0)	(1.47)
18.0 (45.7)	Not limited	42.0 (106.7)	Not limited	0.075 (12)
20.0 (50.8)	25.0 (63.4)	45.0 (114.3)	55.0 (139.7)	(1.91)
25.0 (63.4)	Not limited	60.0 (152.4)	Not limited	0.095 (10)
29.0 (73.7)	36.0 (91.4)	64.0 (162.6)	78.0 (198.1)	(2.41)
37.0 (94.0)	Not limited	87.0 (221.9)	Not limited	0.122 (8)
42.0 (106.7)	53.0 (134.6)	93.0 (236.2)	114.0 (289.6)	(3.10)
52.0 (132.1)	Not limited	123.0 (312.4)	Not limited	0.153 (6)
60.0 (152.4)	74.0 (188.0)	130.0 (330.2)	160.0 (406.4)	(3.89)

^a A supporting frame is a structure of angle or channel or a folded rigid section of sheet metal which is rigidly attached to and has essentially the same outside dimensions as the enclosure surface and which has sufficient torsional rigidity to resist the bending moments which may be applied via the enclosure surface when it is deflected. Construction that is considered to have equivalent reinforcing may be accomplished by designs that will produce a structure which is as rigid as one built with a frame of angles or channels. Construction considered to be without supporting frame includes:

- 1) Single sheet with single formed flanges (formed edges),
- 2) A single sheet which is corrugated or ribbed, and
- 3) An enclosure surface loosely attached to a frame, e.g. with spring clips.

^b The width is the smaller dimension of a rectangular sheet metal piece which is part of an enclosure. Adjacent surfaces of an enclosure may have supports in common and be made of a single sheet.

^c For panels which are not supported along one side, e.g., side panels of boxes, the length of the unsupported side shall be limited to the dimensions specified unless the side in question is provided with a flange at least 1/2 inch (12.7 mm) wide.

^d Sheet metal for an enclosure intended for outdoor use shall comply with 63.7 and 63.8.

8.3 Among the factors taken into consideration when evaluating an enclosure are:

- a) Mechanical strength,
- b) Resistance to impact,
- c) Moisture absorptive properties,
- d) Combustibility,
- e) Resistance to corrosion, and
- f) Resistance to distortion at temperatures to which the enclosure may be subjected under conditions of normal or abnormal use.

For a nonmetallic enclosure or part of an enclosure, all these factors are considered with respect to thermal and chemical aging.

8.4 Where the design and location of the component and the strength and rigidity of the outer cabinet warrant, an individual enclosure of thinner metal than specified in Table 8.1 or 8.2 whichever applies, may be employed.

8.5 Electrical parts within the outer cabinet need not be individually enclosed if the assembly conforms with all of the following:

- a) Their design and location with respect to openings in the outer cabinet will not result in the emission of flame or molten metal through openings in the cabinet or if it can be shown that failure of the component would not result in a risk of fire.
- b) There are no openings in the bottom of the compartment in which the part is located which would permit dropping of molten metal, and the like, onto combustible material.
- c) The part is not in proximity to combustible material other than electrical insulation.
- d) The part is not located closer than 5 inches to the outer cabinet unless the thickness of sheet metal is in compliance with Table 8.1.
- e) The part is not located in an air-handling compartment.
- f) The thickness of the outer cabinet is not less than two-gage thicknesses thinner than indicated in Table 8.1 for the maximum dimensions of the cabinet enclosure.
- g) The part is not subject to unintentional contact by persons.

8.6 The requirements of 8.5 apply only to parts of high-voltage circuits as defined by 2.38.

8.7 Terminal housings of motors, to which connections are to be made in the field, shall be of metal and shall be sized in accordance with the National Electrical Code, ANSI/NFPA 70-1993.

8.8 Steel enclosures shall be protected against corrosion by painting, plating, or other equivalent means.

8.9 Sheet metal to which a wiring system is to be connected in the field shall have a thickness not less than 0.032 inch (0.813 mm) if uncoated steel, No. 20 MSG, not less than 0.034 inch (0.864 mm) if galvanized steel, No. 20 GSG, and not less than 0.045 inch (1.14 mm) if nonferrous.

8.10 If threads for the connection of conduit are tapped all the way through a hole in an enclosure wall, or if an equivalent construction is employed, there shall be not less than three nor more than five threads in the metal, and the construction of the device shall be such that a conduit bushing can be attached. If threads for the connection of conduit are not tapped all the way through a hole in an enclosure wall, conduit, hub, or the like, there shall be not less than 3-1/2 threads in the metal and there shall be a smooth, rounded inlet hole for the conductors which shall afford protection to the conductors equivalent to that provided by a standard conduit bushing and which shall have an internal diameter approximately the same as that of the corresponding trade size of rigid conduit.

8.11 An enclosure threaded for support by rigid conduit shall provide at least five full threads for engaging with the conduit.

8.12 A knockout in a sheet metal enclosure shall be secured but shall be capable of being removed without undue deformation of the enclosure.

8.13 A knockout shall be provided with a flat surrounding surface for seating of a conduit bushing, and shall be so located that installation of a bushing at any knockout likely to be used during installation will not result in spacings between uninsulated live parts and the bushing of less than those required.

8.14 A plate or plug for an unused conduit opening or other hole in the enclosure shall have a thickness not less than:

- a) 0.014 inch (0.356 mm) for steel or 0.019 inch (0.483 mm) for nonferrous metal for a hole having a 1/4 inch (6.4 mm) maximum dimension and
- b) 0.027 inch (0.686 mm) steel or 0.032 inch (0.813 mm) nonferrous metal for a hole having a 1-3/8 inch (34.9 mm) maximum dimension.

A closure for a larger hole shall have a thickness equal to that required for the enclosure of the device or a standard knockout seal shall be used. Such plates or plugs shall be securely mounted.

8.15 The enclosure shall reduce the risk of emission of molten metal, burning insulation, flaming particles, or the like through openings onto combustible material, including the surface on which the equipment is mounted.

8.16 If insulating material other than electrical insulation is provided within the enclosure, consideration is given to the burning characteristics and combustibility of the material, and the proximity of an ignition source.

8.17 All intended mounting positions of the unit are to be considered when determining if it complies with the requirement of 8.15.


8.18 A junction box which is formed in part by another part such as a fan scroll or a motor casing is to fit such that:

- a) An opening between the box and motor frame having a dimension exceeding 1/2 inch (12.7 mm) does not permit a flat feeler gauge, 5/64 by 1/2 inch (12.7 mm) wide to enter.
- b) An opening between the box and motor frame having no dimension exceeding 1/2 inch does not permit the entrance of a 13/64 inch (5.16 mm) diameter rod.

8.19 The criteria for judging an opening in an electrical enclosure are given in the following items and the related figures:

- a) An opening that will not permit entrance of a 3/4 inch (19.1 mm) diameter rod is acceptable if:
 - 1) A probe, as illustrated in Figure 8.1, cannot be made to touch any uninsulated live part when inserted through the opening, and
 2. A probe, as illustrated in Figure 8.2, cannot be made to touch enamel insulated wire when inserted through the opening.
- b) An opening that will permit entrance of a 3/4 inch (19.1 mm) diameter rod is acceptable under the conditions described in Figure 8.3.

Figure 8.1
Probe for uninsulated live metal parts

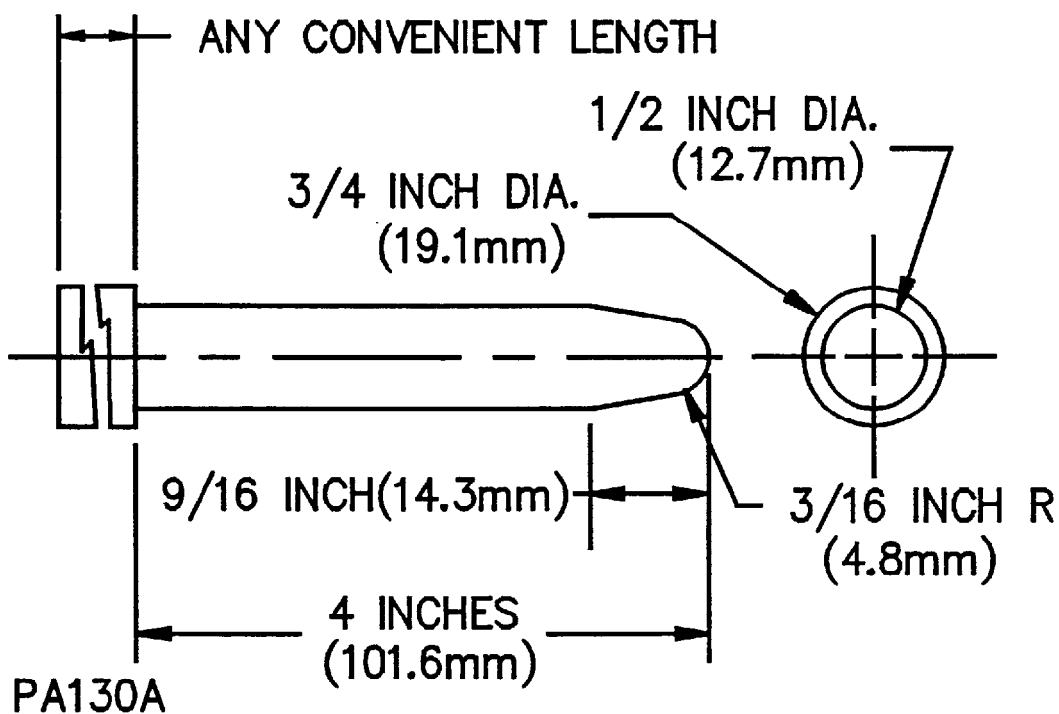

8.20 During the examination for conformance with the requirements in 8.19, a part of the enclosure, including air filters, which may be removed without the use of tools is to be removed.

8.21 A cover or access panel of an enclosure for uninsulated live parts shall be provided with means for securing it in place.

8.22 A hinged or pivoted panel or cover shall be positioned or arranged so that it is not subject to falling or swinging due to gravity or normal vibration in such a manner as to cause injury to persons by the panel or cover, or by moving parts or uninsulated live parts.

8.23 The assembly shall be so arranged that an overcurrent protective device, such as a fuse, whose normal functioning requires renewal, can be replaced and manual reset devices can be reset without removing parts other than a service cover or panel, and a cover or door enclosing the device.

8.24 A required protective device shall be wholly inaccessible from outside the appliance without opening a door or cover, except that the operating handle of a circuit breaker, the operating button of a manually operable motor protector, the reset button of a manually resettable pressure switch, and similar parts may project outside the appliance enclosure.

8.25 An opening in an enclosure to provide clearance around a dial, knob, lever, or handle shall not allow the entrance of a rod having a diameter of 9/64 inch (3.57 mm) at any setting or position of the dial, knob, etc.

Figure 8.2
Probe for enamel insulated wire


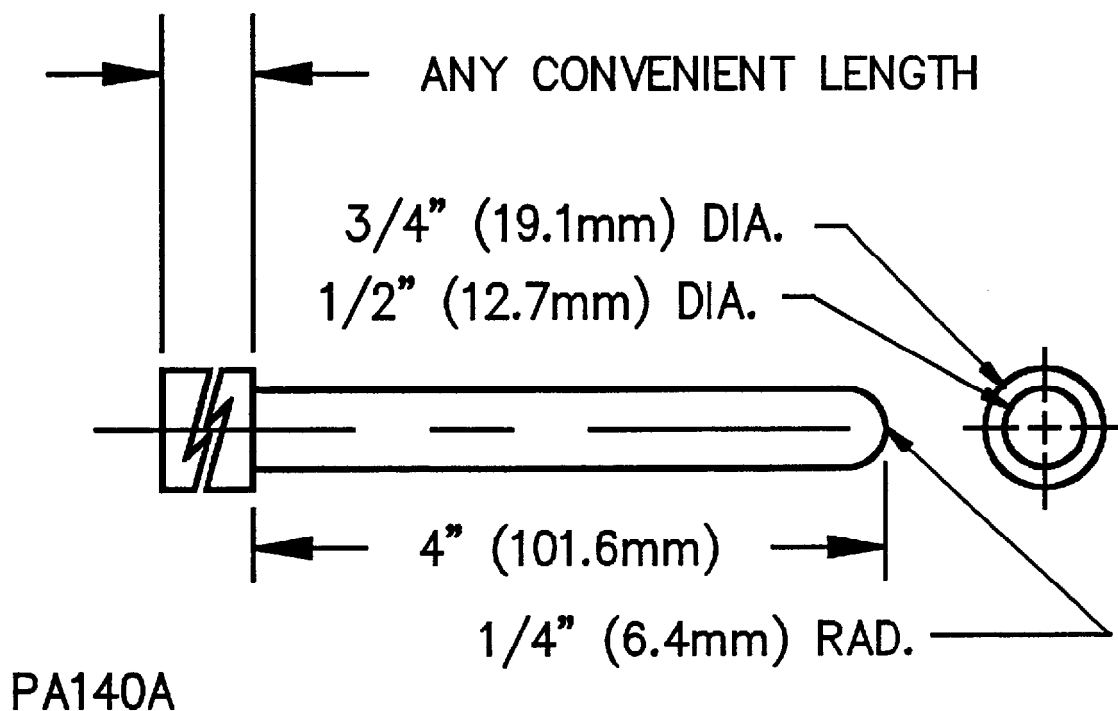


Figure 8.3
Opening in enclosure

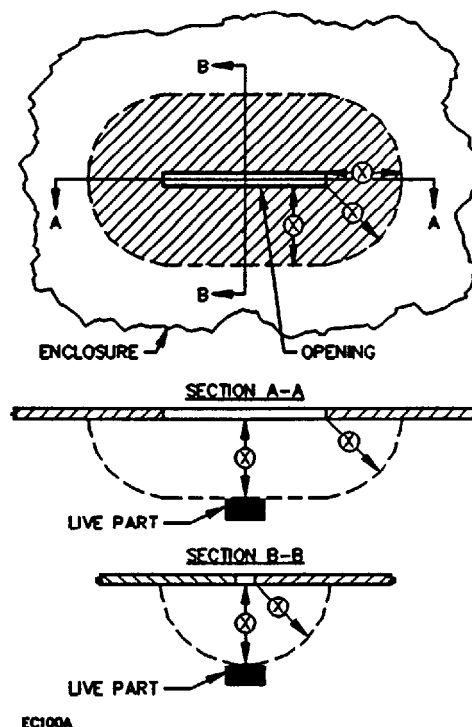

The opening is acceptable if, within the enclosure, there is no uninsulated live metal part or enamel-insulated wire:

- a) Less than X inches from the perimeter of the opening, as well as
- b) Within the volume generated by projecting the perimeter X inches normal to its plane. X equals five times the diameter of the largest diameter rod which can be inserted through the opening, but not less than four inches.

8.26 A fuseholder shall be so designed, installed, or protected that adjacent uninsulated high-voltage live parts within 4 inches (101.6 mm), other than the screw shell of a plug fuseholder, cartridge fuse clips, or wiring terminals to the fuseholder, will not be exposed to contact by persons removing or replacing fuses. An insulating barrier of vulcanized fiber or similar material employed for this purpose shall be not less than 0.028 inch (0.711 mm) in thickness.

8.27 The door or cover of an enclosure shall be hinged if it gives access to fuses or any motor overload protective device, the normal functioning of which requires renewal, or if it is necessary to open the cover in connection with the normal operation of the protective device such as resetting a manual reset overload protective device, except as indicated in 8.28.

8.28 A hinged cover is not required for a device in which the only fuses enclosed are:

- a) Control circuit fuses of 2 amperes or less, provided the fuses and control circuit loads (other than a fixed control circuit load, such as pilot lamp) are within the same enclosure,
- b) Extractor type fuses each with its own enclosure, or
- c) Fuses in low-voltage circuits.

8.29 Hinged covers, where required, shall not depend solely upon screws or other similar means requiring the use of tools to hold them closed, but shall be provided with a catch or spring latch.

8.30 A spring latch, a magnetic latch, a dimple, or any other mechanical arrangement that will hold the door in place and would require some effort on the user's part to open it is considered to be suitable means for holding the door in place as required in 8.29.

8.31 A door or cover giving direct access to fuses in other than low-voltage circuits shall shut closely against a 1/4 inch (6.35 mm) rabbet or the equivalent, or shall have either turned flanges for the full length of four edges or angle strips fastened to it. Flanges or angle strips shall fit closely with the outside of the wall of the box proper and shall overlap the edges of the box not less than 1/2 inch (12.7 mm). A construction which affords equivalent protection, such as a fuse enclosure within an outer enclosure, or a combination of flange and rabbet, is acceptable.

8.32 Stripes used to provide rabbets, or angle strips fastened to the edges of a door, shall be secured at not less than two points, not more than 1-1/2 inches (38.1 mm) from each end of each strip and at points between these end fastenings not more than 6 inches (152 mm) apart.

8.33 An electron tube or similar glass enclosed device shall be protected against mechanical damage.

9 Field Wiring Connections

9.1 As used in the following a wiring terminal is considered to be a terminal to which power supply or control circuit connections will be made in the field when the unit is installed.

9.2 Provision shall be made for connection of a wiring system that would be suitable for a power supply in accordance with the National Electrical Code, ANSI/NFPA 70-1993.

9.3 The location of an outlet box or compartment in which field wiring connections are to be made shall be such that these connections may be inspected after the equipment is installed as intended.

9.4 The connections are to be accessible without removing parts other than a service cover or panel and the cover of the outlet box or compartment in which the connections are made. A component intended for such use, may serve as a cover. A knockout for connection of a field wiring system to a field wiring compartment shall accommodate conduit of the trade size determined by applying Table 9.1.

9.5 The wiring of the equipment may terminate in a length of flexible metal conduit with an outlet box, control box, or equivalent enclosure intended for connection of the equipment to the wiring system specified in 9.2. If the conduit terminates in an outlet box larger than 4 by 4 by 2 inches (102 by 102 by 51 mm) for splice connection, locknuts on the fittings are not acceptable as a means to reduce the risk of loosening of the conduit fittings. A grounding conductor of the size specified in the National Electrical Code, ANSI/NFPA 70-1993, shall be included unless:

- a) The total length of flexible metal conduit of any ground return path in the equipment is not more than 6 feet (1.83 m);
- b) No circuit conductor protected by an overcurrent-protective device rated at more than 20 amperes is included; and
- c) The conduit is no larger than 3/4-inch (19.1 mm) trade size, or the fittings for the conduit are identified as providing grounding.

Table 9.1
Trade size of conduit in inches^a

Wire size		Number of wires				
		2	3	4	5	6
AWG	(mm ²)					
14	(2.1)	1/2	1/2	1/2	1/2	1/2
12	(3.3)	1/2	1/2	1/2	3/4	3/4
10	(5.3)	1/2	1/2	1/2	3/4	3/4
8	(8.4)	3/4	3/4	1	1	1-1/4
6	(13.3)	3/4	1	1	1-1/4	1-1/4
4	(21.2)	1	1	1-1/4	1-1/4	1-1/2
3	(26.7)	1	1-1/4	1-1/4	1-1/2	1-1/2
2	(33.6)	1	1-1/4	1-1/4	1-1/2	2
1	(42.4)	1-1/4	1-1/4	1-1/2	2	2
0	(53.5)	1-1/4	1-1/2	2	2	2-1/2
2/0	(67.4)	1-1/2	1-1/2	2	2	2-1/2
3/0	(85.0)	1-1/2	2	2	2-1/2	2-1/2
4/0	(107.2)	2	2	2-1/2	2-1/2	3
MCM						
250	(127)	2	2-1/2	2-1/2	3	3
300	(152)	2	2-1/2	3	3	3-1/2
350	(177)	2-1/2	2-1/2	3	3-1/2	3-1/2
400	(203)	2-1/2	3	3	3-1/2	4
500	(253)	3	3	3-1/2	4	4

^a This table is based on the assumption that all conductors will be of the same size and there will be no more than 6 conductors in the conduit. If more than 6 conductors will be involved or if all of them are not of the same size, the internal cross-sectional area of the smallest conduit that may be used is determined by multiplying by 2.5 the total cross-sectional areas of the wires, based on the cross-sectional area of Type THW wire.

9.6 The size of a junction box in which field installed conductors are to be connected by splicing shall be not less than that indicated in Table 9.2. A conductor passing through the box is counted as one conductor, and each conductor terminating in the box is also counted as one conductor. A field furnished conductor for high-voltage circuits is considered to be not smaller than No. 14 AWG.

9.7 The limitations in 9.6 do not apply to terminal housings supplied with motors, nor to boxes or enclosures which contain terminals for electrical connections.

9.8 Wiring terminals or leads not less than 6 inches (152 mm) long for connection of field wiring conductors of at least the size required by the National Electrical Code, ANSI/NFPA 70-1993, corresponding to the marked rating of the assembly shall be provided.

9.9 Leads may be less than 6 inches (152 mm) in length if it is evident that the use of a longer lead might result in a risk of electric shock.

Table 9.2
Size of junction boxes

Size of conductor, AWG	Free space within box for each conductor, cubic inches
16 or smaller	1.5
14	2.0
12	2.25
10	2.5
8	3.0

9.10 Leads intended for connection to an external circuit shall be provided with strain relief if stress on the lead may be transmitted to terminals, splices, or internal wiring which may cause the lead to separate from its terminal or result in damage to the lead from sharp edges. Leads shall be tested in accordance with the Strain Relief Test in Section 61.

9.11 An identified, grounded, terminal or lead shall not be electrically connected to a single-pole manual switching device which has an off position or to a single-pole overcurrent, not inherent overheating, protective device.

9.12 At terminals, stranded conductors shall be restrained from contacting other uninsulated live parts and from contacting dead metal parts. This may be accomplished by use of pressure terminal connectors, soldering lugs, crimped eyelets, soldering all strands of the wire together, or equivalent means. Open slot-type connectors shall not be used unless they are designed to prevent disconnection resulting from loosening of the clamping means. The shanks of terminal connectors shall be protected by insulating tubing, or the equivalent, if the required spacings may be reduced as a result of loosening of the clamping means, the thickness of the insulation on the shanks shall be not less than 0.028 inch (0.711 mm).

9.13 Leads provided for spliced connections to an external high-voltage circuit shall not be connected to wire binding screws or pressure terminal connectors located in the same compartment as the splice or visible to the installer, unless the screws or connectors are rendered unusable for field wiring connections or the leads are insulated at the unconnected ends.

9.14 Terminal parts by which field-wiring connections are made shall consist of soldering lugs or pressure terminal connectors secured in place in accordance with the requirements in 9.19, except that for No. 10 AWG (5.3 mm²) and smaller wires, the parts to which wiring connections are made may consist of clamps or wire binding screws with cupped washers, terminal plates having upturned lugs, or the equivalent, to hold the wire in position.

9.15 A wire binding screw at a high-voltage wiring terminal for field connection shall be not smaller than No. 10 (4.8 mm major diameter).

Exception No. 1: A No. 8 (4.2 mm major diameter) screw may be used for the connection of a conductor not larger than No. 14 AWG (2.1 mm²).

Exception No. 2: A No. 6 (3.5 mm major diameter) screw may be used for the connection of a No. 16 or 18 AWG (1.3 or 0.82 mm²) control-circuit conductor.

9.16 A terminal plate for a wire binding screw shall be of metal not less than 0.030 inch (0.762 mm) in thickness for a No. 14 AWG or smaller wire, and not less than 0.050 inch (1.27 mm) in thickness for a wire larger than No. 14 AWG; and in either case there shall be not less than two full threads in the metal.

9.17 A terminal plate formed from stock having the minimum required thickness may have the metal extruded at the tapped hole for the binding screw so as to provide two full threads.

9.18 A wire binding screw shall thread only into metal.

9.19 Field wiring terminals shall be secured to their supporting surfaces by methods other than friction between surfaces so that they will be restrained from turning or shifting in position if such motion may result in reduction of spacings to less than those required. This may be accomplished by two screws or rivets; by square shoulders or mortices; by a dowel pin, lug, or offset; by a connecting strap or clip fitted into an adjacent part; or by some other equivalent method.

9.20 Conductors intended for connection to a grounded neutral line shall be identified, i.e., finished a white or natural gray color. All other current carrying conductors shall be finished in colors other than white, natural gray, or green. A terminal for connection of a grounded conductor shall be identified by a metallic plated coating, substantially white in color, and shall be readily distinguishable from other terminals, or it shall be identified in some other manner, such as on an attached wiring diagram.

9.21 A box or enclosure included as part of the assembly and in which a branch circuit supplying power to the furnace is to be connected, shall not require that it be moved for normal care of the unit. This requirement does not apply to separate limit controls and stack switches, where permitted, to which metal-clad cable or flexible metallic conduit is to be directly attached.

10 Internal Wiring

10.1 The wiring of high-voltage and safety control circuits shall conform to the requirements in this Section.

10.2 Wiring shall be accomplished with insulated conductors having current carrying capacity, voltage, and temperature ratings consistent with their use. A conductor, other than an integral part of a component, shall be not smaller than No. 18 AWG (0.82 mm²).

10.3 If insulated conductors rated for use at temperatures in excess of 140°F (60°C) are required, such wiring shall be furnished by the manufacturer as part of the assembly and the devices to be connected by such wiring shall be factory located on the equipment.

10.4 Electrical wiring to a part which must be moved for normal maintenance and servicing shall be arranged so that the part may be moved without breaking soldered connections or disconnecting conduit. Conductors to be disconnected from terminals of such part shall terminate in eyelets or connectors. If the wiring to a part which functions also as an access plate or cover, i.e., a transformer closing the access to the nozzle assembly, is not readily detachable, the assembly shall include provision for support of that part by means other than the wiring when the part is moved for servicing. Any allowable movement of such part shall not unduly twist, bend, or pull the wiring.

10.5 Conductors shall be enclosed within conduit, electrical metallic tubing, metal raceway electrical enclosure, or metal-clad cable, except as permitted by 10.17 and 10.18.

10.6 Group A of Table 10.1 includes some wiring materials suitable for use if enclosed as indicated in the preceding paragraph.

10.7 Flexible metal conduit, if used, shall be not smaller than 3/8 inch electrical trade size. This does not apply to parts of components, such as conduit protecting flame sensor leads, considered under other Standards.

10.8 If flexible metal conduit is used, it shall be mechanically secured at intervals not exceeding 4-1/2 feet (1.37 m) and within 12 inches (30.5 cm) on each side of every junction box except for lengths not over 36 inches (91 cm) where flexibility is necessary.

10.9 All splices and connections shall be mechanically secure and bonded electrically. A soldered connection shall be made mechanically secure before being soldered if bushing or loosening of the connection may result in any hazardous condition.

10.10 A splice shall be provided with insulation equivalent to that required for the wires involved if permanence of spacing between the splice and other metal parts is not ensured.

10.11 Splicing devices, such as fixture type splicing connectors, pressure wire connectors, and the like, may be employed if they have insulation suitable for the voltage to which they are subjected. In determining if splice insulation consisting of coated fabric, thermoplastic, or other type of tubing is acceptable, consideration is to be given to such factors as its dielectric properties, heat resistant and moisture resistant characteristics, and the like. Thermoplastic tape wrapped over a sharp edge does not meet the intent of the requirement.

10.12 A splice is to be enclosed by being installed in a junction box, control box, or other compartment in which high-voltage wiring materials, may be employed.

10.13 Splices shall be located, enclosed, and supported so that they are not subject to mechanical damage, flexing, motion, or vibration.

10.14 At all points where conduit or metal-clad cable terminates the conductors shall be protected from abrasion. If metal-clad cable is used, an insulating bushing or its equivalent shall be provided between the conductors and the cable and the connector or clamp shall be of such design that the insulating bushing or its equivalent will be visible for inspection.

Table 10.1
Typical wiring materials

Group	Type of wire, cord, cable, or wiring material	Wire size		Insulation thickness	
		No. AWG	mm ²	Inch	mm
A	FFH-2, MTW, PF, PFF, PGF, PGFF, RFH-2, RFHH-2, RFHH-3, RH, RHH, RHW, SF-2, SFF-2, T, TF, TFF, TFN, TFFN, THW, THW-MTW, THWN, TW, XHHW, or thermoplastic appliance wiring material.	10 and smaller	5.3	2/64	0.8
		8	8.4	3/64	1.2
		6	13.3	4/64	1.6
		4	21.2	4/64	1.6
		3	26.7	4/64	1.6
		2	33.6	4/64	1.6
		1	42.4	5/64	2.0
		1/0	53.5	5/64	2.0
		2/0	67.4	5/64	2.0
		3/0	85.0	5/64	2.0
	4/0	107.2	5/64	2.0	
B	S, SE, SJ, SJO, SJO0, SJT, SJTO, SJTOO, SO, SOO, ST, STO, STOO, or appliance wiring material with thermoplastic or neoprene insulation	18	0.82	4/64	1.6
		16	1.3	4/64	1.6
		14	2.1	5/64	2.0
		12	3.3	5/64	2.0
		10	5.3	5/64	2.0
		8	8.4	6/64	2.4
		6	13.3	8/64	3.2
Thermoplastic wiring materials, as referenced in Group A, with insulation thickness of 2/64 inch (0.8 mm) for No. 16 or 18 AWG (1.3 or 0.82 mm ²) and 3/64 inch (1.2 mm) for No. 14, 12, 10, or 8 AWG (2.1, 3.3, 5.3, or 8.4 mm ²), are considered equivalent to the wiring material referenced in Group B, when the conductors are covered with 1/32 inch (0.8 mm) wall thickness thermoplastic insulating tubing of a type suitable for the purpose from the standpoint of dielectric properties, heat resistance, moisture-resistance, and flammability.					

10.15 The design of a wireway shall be such that the interconnection of sections and fittings will provide a rigid mechanical assembly and electrical conductivity. The interior of the wireway shall be free from burrs and sharp corners or edges which might cause damage to the insulation on wires.

10.16 All wiring shall be supported and routed to reduce the risk of damage due to sharp edges or moving parts.

10.17 Internal wiring involving a potential of not more than 300 volts between parts attached to the same assembly with a predetermined fixed relationship one to the other may be done with Type SO or ST cord, provided all of the following conditions are fulfilled:

- It is not practical to do the wiring in accordance with 10.5.
- The cord is not required to be bent, twisted, or otherwise displaced to render normal maintenance and service.
- The length of cord exterior to the assembly is not more than 4 inches and strain relief is provided.

10.18 Cords or wiring material as referenced in Group B, Table 10.1 may be employed if the wiring is enclosed by a furnace casing conforming to all of the following:

- a) There are no openings in the bottom, unless a U-shaped channel or trough is located under the wiring and the wires do not project through the plane of the top of the trough or channel.
- b) If the device is for installation only on noncombustible flooring, the bottom of such compartment may be open provided all sides of the compartment extend to the floor level.
- c) Louvers or openings in other than the bottom will not permit entrance of a rod having a diameter of 1/2 inch (12.7 mm), and openings for such items as pipe or conduit are not more than 1/2 inch (12.7 mm) in diameter larger than the object that will be installed through the opening.
- d) Openings are not closer than 6 inches to the wiring unless metallic barriers or baffles are placed between the wiring and the openings.
- e) Where combustible material other than electrical insulation is located within the compartment the wiring is separated from such material and the material has self-extinguishing characteristics. An air filter may be employed within the enclosure.

10.19 In applying the requirement of 10.18, an opening which is always intended to be connected to an air duct may be considered as closed.

10.20 Holes in walls or partitions through which insulated wires or cords pass and on which they may bear shall be provided with smoothly rounded bushings or shall have smooth, rounded surfaces upon which the wires or cords may bear, to prevent abrasion of the insulation. Bushings, if required, shall be ceramic, phenolic, cold-molded composition, fiber, or equivalent material.

10.21 A fiber bushing shall be not less than 3/64 inch (1.2 mm) in thickness, shall be so located that it will not be exposed to moisture, and shall not be employed where it will be subjected to a temperature higher than 194°F (90°C) under normal operating conditions.

10.22 To provide an unbushed opening in sheet metal usually requires rolling and/or extrusion of the metal around the opening, or the insertion of a grommet conforming to 10.20.

10.23 Except as indicated in the following paragraph, conductors of motor circuits having two or more motors, one or more of which are thermal or overcurrent protected, wired for connection to one supply line shall withstand the conditions of a short circuit test without creating a risk of fire or electric shock. See Short-Circuit Test.

10.24 Conductors that conform to the following are considered to meet the intent of the requirements without test:

- a) Conductors that have not less than one-third the ampacity of the required branch-circuit conductors,
- b) Conductors that are No. 18 AWG (0.82 mm²) or larger and not more than 4 feet (1.2 m) in length provided that the circuit will be protected by a fuse or HACR Type circuit breaker rated 60 amperes or less as specified on the product nameplate or provided as part of the product and acceptable for branch-circuit protection. This applies to any of the wiring materials specified in this standard, including those enclosed in raceways, or
- c) Conductors that serve as jumper leads between controls providing the length of the leads does not exceed 3 inches (76 mm) or the conductors are located in a control panel.

11 Separation of Circuits

11.1 Unless provided with insulation rated for the highest voltage involved, insulated conductors of different internal wiring circuits shall be separated by barriers or shall be segregated; and shall, in any case, be so separated or segregated from uninsulated live parts connected to different circuits or opposite polarity parts of the same circuit.

11.2 Segregation of insulated conductors as required above may be accomplished by clamping, routing, or equivalent means which promotes permanent separation from insulated or uninsulated live parts of a different circuit.

11.3 Field-installed conductors of any circuit shall be segregated or separated by barriers from:

- a) Field-installed and factory-installed conductors connected to any other circuit, unless the conductors of both circuits are insulated for the maximum voltage of either circuit.
- b) Uninsulated live parts of any other circuit.
- c) Any uninsulated live parts whose short-circuiting may result in operation of the product in a manner that involves a risk of fire, electric shock, or injury to persons, except that a construction in which field-installed conductors may make contact with wiring terminals is acceptable, provided that Type T or equivalent conductors are or will be installed when wired in accordance with the National Electrical Code, ANSI/NFPA 70-1993.

11.4 Segregation of field installed conductors from other field installed conductors and from uninsulated live parts connected to different circuits may be accomplished by arranging the location of the openings in the enclosure for the various conductors, with respect to the terminals or other uninsulated live parts, so that there is no likelihood of the intermingling of the conductors or parts of different circuit. If the number of openings in the enclosure does not exceed the minimum required for proper wiring and if each opening is located opposite a set of terminals, it is to be assumed, for the purpose of determining compliance with the above paragraph that the conductors entering each opening will be connected to the terminals opposite the opening. If more than the minimum number of openings are provided, the possibility of conductors entering at points other than opposite the terminals to which they are intended to be connected and contacting insulated conductors or uninsulated current carrying parts connected to a different circuit is to be investigated. To determine if a device complies with the requirements of the above paragraph, it is to be wired as it would be in service and in doing so a reasonable amount of slack is to be left in each conductor, within the enclosure, and no more than average care is to be exercised in stowing this slack into the wiring compartment.

11.5 If a barrier is used to provide separation between the wiring of different circuits or between operating parts and field installed conductors, it shall be of metal or of suitable insulating material and be held in place.

11.6 A metal barrier shall have a thickness at least as great as that required by Table 8.1, based on the size of the barrier. A barrier of insulating material shall be not less than 0.028 inch (0.711 mm) in thickness and shall be of greater thickness if its deformation may be readily accomplished so as to defeat its purpose. Any clearance at the edges of a barrier shall be not more than 1/16 inch (1.6 mm) wide.

11.7 Openings in a barrier for the passage of conductors shall be not larger than 1/4 inch (6.3 mm) in diameter and shall not exceed in number, on the basis of one opening per conductor, the number of wires which will need to pass through the barrier. The closure for any other opening shall present a smooth surface wherever an insulated wire may be in contact with it; and the area of any such opening, with the closure removed, shall not be larger than required for the passage of the necessary wires.

12 Mounting of Components

12.1 A switch, fuseholder, lampholder, or similar electrical component shall be mounted to restrain it from turning, except as noted in the following paragraphs.

12.2 The requirement that a switch be restrained from turning may be waived if all of the following conditions are met:

- a) The switch is to be of a plunger or other type that does not tend to rotate when operated. A toggle switch is considered to be subject to forces that tend to turn the switch during normal operation of the switch.
- b) The means for mounting the switch makes it unlikely that operation of the switch will loosen it.
- c) The spacings are not to be reduced below the required values if the switch rotates.
- d) The normal operation of the switch is to be by mechanical means rather than by direct contact by persons.

12.3 A lampholder of the type in which the lamp cannot be replaced, such as a neon pilot or indicator light in which the lamp is sealed in a nonremovable jewel, need not be restrained from turning if rotation cannot reduce spacings below the required values.

12.4 The means for restraining turning is to consist of more than friction between surfaces: a lock washer which provides both spring take-up and an interference lock, is acceptable as the means for restraining a small stem mounted switch or other device having a single-hole mounting means from turning.

12.5 Uninsulated live parts shall be so secured to the base or mounting surface that they will be restrained from turning or shifting in position if such motion may result in a reduction of spacings below the acceptable values.

12.6 Control equipment located within the plenum or return air compartment of a furnace shall be so designed, enclosed, and/or protected that dense smoke will not be generated or flame emitted under any conditions likely to occur in service.

13 Motors and Motor Overcurrent or Overload Protection

13.1 All motors shall be protected by an integral thermal protector or by overcurrent protective devices, or combinations thereof.